



Kollaard Associates

Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario K0G 1J0

Civil • Geotechnical •
Structural • Environmental •
Hydrogeology •

(613) 860-0923
FAX: (613) 258-0475

**SERVICING AND STORMWATER
MANAGEMENT REPORT
Residential Apartment Building**

841, 845 and 855(A) GRENON AVENUE
OTTAWA, ONTARIO

Prepared For:
Building Investment Inc.
205 - 1320 Carling Avenue
Ottawa Ontario
K1Z 7K8

PROJECT #: 180966

City of Ottawa SPC Application File # D07-12-19-0018

DISTRIBUTION

6 copies – City of Ottawa
1 copy – Building Investments Inc.
1 copy – Kollaard Associates Inc.

Rev 0 – Issued for Site Plan Approval

Rev 1 – Response to Review Comments and Revised Site Plan

Rev 2 – Revised in accordance with Revised Site Plan

Rev 3 – Response to Review Comments

January 21, 2019

August 16, 2019

October 21, 2019

January 8, 2020



Professional Engineers
Ontario

Authorized by the Association of Professional Engineers
Of Ontario to offer professional engineering services



TABLE OF CONTENTS

LIST OF APPENDICES	2
LIST OF DRAWINGS	2
1 INTRODUCTION	3
1.1 Purpose	3
1.2 Proposed Development	3
1.3 Referenced Documents	4
2 STORMWATER DESIGN	4
2.1 Stormwater Management Design Criteria	4
2.1.1 Minor System Design Criteria	4
2.1.2 Major System Design Criteria	5
2.1.3 Quality Control	5
2.1.4 Approval Authorities	5
2.2 Stormwater Quantity Control	6
2.2.1 Runoff Coefficients	7
2.2.2 Time of Concentration	7
2.2.3 Pre-development Site Conditions	7
2.2.3.1 Pre-development Runoff Coefficients	8
2.2.3.2 Pre-development Runoff Rate	8
2.2.4 Controlled and Uncontrolled Areas	9
2.2.5 Uncontrolled Area Runoff	10
2.2.6 Allowable Release Rate to Grenon Avenue	11
2.2.7 Runoff to Park Land / Open Space	11
2.2.8 Post Development Restricted Flow and Storage	12
2.2.8.1 Catchment CA1 - Roof	12
2.2.8.2 Catchment CA2 – South Side of Building Above the Basement / Below Grade Parking	13
2.2.9 Roof Top Storage	14
2.2.10 Underground Storage Tanks	15
2.3 Protection of Underground Parking From Major System Flooding	16
2.4 Stormwater Quality Control	17
2.5 Stormwater System Operation and Maintenance	18
2.5.1 Inlet Control Device (ICD) and Roof Drains	18
2.5.2 Catchbasin/ Manhole and Inspection Ports	18
2.5.3 Brentwood StormTank Storage Tanks	18
2.6 Storm Sewer Design	19
3 SANITARY SEWER DESIGN	20
3.1 Design Flows	20
3.2 Sanitary Service Lateral	21
3.3 Sanitary Main	22
4 WATERMAIN DESIGN	23
4.1 Water Demand	23
4.2 Fire Flow	23
4.3 Sufficiency of Existing Infrastructure	23
4.3.1 Existing Water Service	24
4.3.2 Existing Fire Hydrants	24
4.4 Proposed Service	25
5 EROSION AND SEDIMENT CONTROL	27
6 CONCLUSIONS	28



LIST OF APPENDICES

Appendix A: Storm Design Information

Appendix B: Product Information

Appendix C: Sanitary Sewer Calculation Sheet and Water Pressure Loss Calculation Sheet

Appendix D: Fire Flow Calculations and Boundary Conditions

Appendix E: Drawings

Appendix F: Correspondence

Appendix G: Servicing Guidelines Checklist

Appendix H: Additional Material

LIST OF DRAWINGS

- 180966– PRE – PRE-DEVELOPMENT DRAINAGE
- 180966– POST – POST-DEVELOPMENT DRAINAGE
- 180966– SER – Site Servicing Plan
- 180966– GRD – Site Grading Plan
- 180966– ER – Sediment and Erosion Control



1 INTRODUCTION

Kollaard Associates was retained by Building Investments Inc. to complete a Site Servicing and Stormwater Management Report for a new residential development in the City of Ottawa, Ontario.

1.1 Purpose

This report will address the serviceability of the proposed site, specifically relating to the adequacy of the existing municipal storm sewer, sanitary sewer, and watermains to hydraulically convey the necessary storm runoff, sanitary sewage and water demands that will be placed on the existing system as a result of the proposed development located at 841, 845 and 855(A) Grenon Avenue, Ottawa, Ontario. The report shall summarize the stormwater management (SWM) design requirements and proposed works that will address stormwater flows arising from the site under post-development conditions. The report and will identify and address any stormwater servicing concerns and also describe any measures to be taken during construction to minimize erosion and sedimentation.

1.2 Proposed Development

The development being proposed by Building Investments Inc. is located on the east side of Grenon Avenue between Michele Drive and Carling Avenue within the City of Ottawa. Prior to the proposed development, the subject properties 841, 845 and 855(A) Grenon Avenue will be legally combined into one single property.

The site has a total area of 0.142 hectares divided between three properties currently known as 855(A), 845 and 841 Grenon Avenue. The property is within Ward 7 – Bay of the City of Ottawa. The property is legally described as Part of Lot 14 Registered Plan 457, City of Ottawa. A plan of Survey has been included in Appendix E. The property known as 841 Grenon Avenue is currently occupied by an existing single family residential dwelling. It is understood that the owner of the subject site intends to demolish the existing building.

The proposed development is to consist of a residential apartment building with 4 storeys having a total of 27 residential units on the upper three floors. The ground floor and basement will contain one level of floor parking as well as three level multiparking (stacked parking) systems.



1.3 Referenced Documents

The following documents have been referenced during the preparation of this Servicing and Stormwater management Report. These documents are publicly available or have been provided as part of the Site Plan Control Application and are not included with this report.

- Geotechnical Investigation Report Prepared by Kollaard Associates Inc.
- Site Plan prepared by Project 1 Studio.
- Preliminary Architectural drawings of the Proposed Building
- City of Ottawa Sewer Design Guidelines October 2012 as amended by technical bulletins
 - ISDTB-2014-01, PIEDTB-2016-01, ISTB-2018-01, ISTB-2018-04
- City of Ottawa Design Guidelines Water Distribution as amended by technical bulletins
 - ISD 2010-2, ISDTB-2014-02, ISDTB-2018-02

2 STORMWATER DESIGN

2.1 Stormwater Management Design Criteria

Design of the storm sewer system was completed in conformance with the City of Ottawa Design Guidelines. (October 2012). Section 5 “Storm and Combined Sewer Design” as amended.

The storm sewer in Grenon Avenue has been designed to accommodate the demand from a 2 year storm event under free flow conditions. In accordance with the SWM design criteria provided by the City, 100 year post development flow from the proposed development to Grenon Avenue will be restricted to 2 year pre-development flow from the site assuming the lesser of the actual pre-development runoff coefficient or a pre-development runoff coefficient of $C = 0.5$.

A time of concentration is to be calculated and to be no less than 10 minutes. Alternatively a pre-development time of concentration of 20 minutes could be used without calculation or engineered justification.

2.1.1 Minor System Design Criteria

The storm sewers have been designed and sized based on the rational formula and the Manning’s Equation under free flow conditions for the 5-year storm using a 10-minute inlet time.



2.1.2 Major System Design Criteria

The major system has been designed to accommodate on-site detention with sufficient capacity to attenuate the runoff generated onsite during a 100-year design storm to 2 year pre-development conditions.

On site storage is provided and calculated for up to the 100-year design storm. Calculations of the required storage volumes have been prepared based on the Modified Rational Method as identified in Section 8.3.10.3 of the City's Sewer Guidelines and have been provided in Appendix A.

Since there is both roof top storage and underground storage, the underground storage size has been increased to compensate for a reduced discharge rate due to lack of head on the outlet orifice.

The proposed ramp to the underground parking is to slope upward onto the site in order to form a high point in the ramp that is at least 0.3 metres above the spill elevation on Grenon Avenue. This is to protect the underground parking garage from flooding during a Major System on Grenon Avenue.

2.1.3 Quality Control

Quality control requirements for the site have been provided by the Rideau Valley Conservation Authority. Communication with RVCA is included in Appendix F. The quality control requirement for the site is considered to be the equivalent of an enhanced level of treatment and is expected to be met by the elimination of and control of the potential sources of stormwater contamination.

Best management practices will be incorporated at the site to reduce potential suspended solid contamination. Snow and Ice control management practices will be incorporated to reduce contamination from winter snow and ice removal.

2.1.4 Approval Authorities

The approval authorities for the proposed stormwater management facility consist of the Rideau Valley Conservation Authority (RVCA), the City of Ottawa and the Ministry of Environment Conservation and Parks (MECP).

As stated above, all of the parcels which are the subject of the proposed development will be legally consolidated into one parcel. Offsite runoff from a portion of the adjacent lands will continue to be directed onto the subject property. As such the stormwater management



facilities will be designed to serve more than one property. It is considered that an MECP ECA will be required for the proposed stormwater management facility.

2.2 Stormwater Quantity Control

Peak Flow for runoff quantities for the Pre-Development and Post-Development stages of the project were calculated using the rational method. The rational method is a common and straightforward calculation, which assumes that the entire drainage area is subject to uniformly distributed rainfall. The formula is:

$$Q = \frac{CiA}{360}$$

Where

Q is the Peak runoff measured in m^3/s

C is the Runoff Coefficient, **Dimensionless**

A is the runoff area in **hectares**

i is the storm intensity measure in mm/hr

All values for intensity, i, for this project were derived from IDF curves provided by the City of Ottawa for data collected at the Ottawa International airport. For this project three return periods were considered, 2, 5 and 100-year events. The formulas for each are:

2-Year Event

$$i = \frac{732.951}{(t_c + 6.199)^{0.810}}$$

5-Year Event

$$i = \frac{998.071}{(t_c + 6.053)^{0.814}}$$

100-Year Event

$$i = \frac{1735.071}{(t_c + 6.014)^{0.82}}$$

where t_c is time of concentration

For a 10 minute time of concentration the above formula provide the following intensities: 2-year = 76.81; 5-year = 104.19; 100 year = 178.56.



2.2.1 Runoff Coefficients

Runoff coefficients for impervious surfaces (roofs, asphalt, and concrete) were taken as 0.90, for gravel surfaces were taken as 0.7 and pervious surfaces (grass) were taken as 0.25.

A 25% increase for the post development 100-year runoff coefficients was used as per City of Ottawa guidelines. Refer to Appendix A for pre-development and post development runoff coefficients.

2.2.2 Time of Concentration

The time of concentration for pre-development was calculated using the FAA method or Airport Formula to be 7.13 minutes.

$$t_c = \frac{3.26 \times (1.1 - C) \times l_c^{0.5}}{S^{0.33}}$$

Where: t_c = time of concentration
C = Runoff coefficient = 0.34
 l_c = length of flow path = 29.8
S = slope of flow path = 6.9

t_c = 7.13 minutes.

The minimum time of concentration to be used in accordance with the City of Ottawa Guidelines is 10 minutes. Therefore, a pre-development time of concentration of 10 minutes was used.

2.2.3 Pre-development Site Conditions

As previously indicated, the site is located along the east side of Grenon Avenue within the City of Ottawa. The site has a total area of about 1421 square metres and is partially developed. The site is currently occupied by a single family residential dwelling with a footprint of about 88 square metres and a gravel surface driveway with a surface area of about 100 square metres. The site is within a residential area with a rowhouse development immediately south of the proposed site. The area immediately north and east of the site is zoned as open space and Community Leisure and is currently occupied by a walking path and park area.

There is a row of large deciduous trees / cedar hedge along both the north and east property lines between the site and the open space / park areas. There are several deciduous trees on the site in proximity to the existing dwelling. The remainder of the site appears to be grass covered.



There is a decrease in ground surface elevation from south to north across the site of about 2.1 metres.

As indicated on drawing 180966-PRE, runoff from a portion of the adjacent rowhouse development is directed on to the site. This area includes a portion of the roof area and the rear yards between the site and the adjacent rowhouse units. This additional offsite area consisting of 112 m² of roof area and 180 m² of grass surfaced landscape area has been included in the stormwater model under both pre- and post-development conditions.

As indicated on drawing 180966-PRE, runoff from about 611 square metres of the catchment area (including both onsite and offsite area) is directed by sheet flow to the park area and from about 1098 square metres of the catchment area directed to Grenon Avenue.

2.2.3.1 Pre-development Runoff Coefficients

The predevelopment runoff coefficient for the site was calculated using weighted average based on the existing ground surface conditions as follows:

$$C = \frac{(A_{imp} \times 0.9 + A_{gravel} \times 0.7 + A_{soft} \times 0.25)}{A_{total}}$$

$$C = \frac{(0.0200 \times 0.9 + 0.01 \times 0.7 + 0.1409 \times 0.25)}{0.1709} = 0.37$$

Based on the existing ground cover the pre-development runoff coefficient was calculated to be 0.37.

The predevelopment runoff coefficient for the portion of the site directing runoff to the park was calculated to be $C = 0.27$ as there is a portion of the adjacent rowhouse roof draining towards the park across the site.

2.2.3.2 Pre-development Runoff Rate

Using the City of Ottawa IDF curve for a 2-year storm event, the storm intensity at a 10 minute time of concentration is 76.81 mm/hr. Using the Rational Method with a time of concentration of 10 minutes, and the previously calculated runoff coefficient, the pre-development runoff rate for the 2-year design storm for the site is:

$$2 \text{ year} = 0.34 \times 76.81 \times 0.1709 / 360 = 13.5 \text{ L/s}$$



The pre-development runoff rate during a 2 year storm event for the portion of the site outletting to the open space / park lands was calculated as follows:

$$2 \text{ year} = 0.275 \times 76.81 \times 0.0611 / 360 = 3.5 \text{ L/s}$$

The pre-development runoff rate during the 5 year and 100 year storm events for the portion of the site outletting to the open space / park lands were calculated as follows:

$$5 \text{ year} = 0.25 \times 104.19 \times 0.0545 / 360 = 4.8 \text{ L/s}$$

$$100 \text{ year} = 0.31 \times 178.56 \times 0.0545 / 360 = 10.0 \text{ L/s}$$

2.2.4 Controlled and Uncontrolled Areas

For the purposes of this storm water management design, the site has been divided into uncontrolled and controlled areas as outlined on drawing 180966-POST. The controlled areas are defined as area CA1 and CA2 and uncontrolled areas are defined as UA1 and UA2. CA1 consists of the upper roof area. CA2 in general consists of the site area between the building and the south property line and the majority of the offsite area south of the site. UA1 consists of the area along the north and east sides of the site which directs runoff to the parkland. UA2 consists of the ground surface between the proposed building and Grenon Avenue as well as a portion of the ground surface along the north side of the site which directs runoff to Grenon Avenue without control.

Run-off from the upper roof will be restricted by means of WATTS Small Area Roof Drains with Adjustable Flow Control which will outlet to a proposed storm sewer. Runoff from the ground between the building and the south property line will be captured by trench drains and directed to a shallow storage tank located on top of the parking structure roof slab. The discharge from the storage tank will be controlled by means of a Hydrovex Flow Regulator. Runoff from the uncontrolled area between the building Grenon Avenue will be directed by means of sheet flow to the street. Runoff from the uncontrolled area along the east and north sides of the site will consist of uncontrolled sheet flow. Post-development site conditions are summarized in the following Table 2.1.

The following post-development runoff conditions have been built into the stormwater management facility:

- The ramp to the parking garage will be surfaced with either asphaltic concrete pavement or portland cement concrete pavement.
- The walkways along the side of the building will be surfaced with permeable pavers.
- The amenity area will consist of a mixture of permeable pavers and other landscaping surfaces.



- No credit in terms of reduced runoff has been assumed for the permeable pavers along either the walkway or amenity area.

Table 2.1 - Post Development Site Conditions

Total Area = 0.1709 (Total Site Area = 0.1421 hectares, Total Offsite Area = 0.0292)					
Event Frequency		2,5 Year Return Period		100 year Return Period	
Surface Covering	Area of surface ha	Runoff Coef. C	C avg.	Runoff Coef. C	C avg.
Controlled Area CA1 – 0.0649 hectares					
Roof	0.0664	0.9	0.9	1.0	1.0
Controlled Area CA2 – 0.0753 hectares					
Landscape	0.0425	0.25	0.53	0.31	0.61
Walkway	0.0126	0.9		1.0	
Amenity	0.0090	0.9		1.0	
Roof	0.0112	0.9		1.0	
Uncontrolled Area UA1 – 0.0166 hectares					
Asphalt / Roof	0.0	0.9	0.25	1.0	0.31
Landscape	0.0152	0.25		0.31	
Amenity / Walkway	0.0	0.9		1.0	
Uncontrolled Area UA2 – 0.0294 hectares					
Asphalt/Roof	0.0040	0.9	0.42	1.0	0.53
Landscape	0.0100	0.25		0.31	
Walkway	0.0005	0.9		1.0	

2.2.5 Uncontrolled Area Runoff

The runoff from the uncontrolled areas was determined using the rational method for a time of concentration of 10 minutes using the above calculated runoff coefficients.

The uncontrolled runoff from UA1 directed to the Park Land / Open space is:

$$2 \text{ year} = 0.25 \times 76.81 \times 0.0152 / 360 = 0.8 \text{ L/s}$$

$$5 \text{ year} = 0.25 \times 104.19 \times 0.0152 / 360 = 1.1 \text{ L/s}$$

$$100 \text{ year} = 0.31 \times 178.56 \times 0.0152 / 360 = 2.3 \text{ L/s}$$



The uncontrolled runoff from UA2 directed to Grenon Avenue is:

$$5 \text{ year} = 0.42 \times 104.19 \times 0.0145 / 360 = 1.8 \text{ L/s}$$

$$100 \text{ year} = 0.53 \times 178.56 \times 0.0145 / 360 = 3.8 \text{ L/s}$$

2.2.6 Allowable Release Rate to Grenon Avenue

As previously indicated, the City of Ottawa has indicated that the storm sewer along Grenon Avenue has been designed to have capacity for a 2 year storm event. As such, the stormwater management criteria requires that the maximum runoff rate from the site directed towards Grenon Avenue during a 100 year storm is to be restricted to that of the 2 year pre-development storm conditions.

The total allowable runoff rate to be directed to Grenon Avenue from the site was determined to be 13.5 L/s based on the 2 year pre-development runoff rate.

Storm water runoff from the controlled areas CA1 and CA2 as well as the uncontrolled area UA2 is directed to Grenon Avenue. The combined allowable release rate from the controlled areas CA1 and CA2 is equal to the total allowable runoff rate less the runoff rate from the uncontrolled area UA2.

$$Q_{\text{controlled}} = Q_{\text{total allowable}} - Q_{\text{uncontrolled}}$$

For the 5-year Storm event

$$Q_{\text{controlled}} = 13.5 - 1.8 = 11.7 \text{ L/s}$$

For the 100-year Storm event

$$Q_{\text{controlled}} = 13.5 - 3.8 = 9.7 \text{ L/s}$$

Since the allowable release rate during the 100-year storm is more restrictive than the allowable release rate during the 5-year storm event, the allowable release rate for the 100 year storm event is the governing criteria.

2.2.7 Runoff to Park Land / Open Space

The total combined uncontrolled runoff rate from the site is equal to 6.1 L/s during a 100-year storm event. Of this uncontrolled runoff, 2.3 L/s is directed to the park land / open space and 3.8 L/s is directed to Grenon Avenue. This storm water management design is contingent on the presented design criteria which limits runoff to Grenon Avenue.



Runoff from the uncontrolled area UA1 will be allowed to flow in accordance with the existing pre-development drainage patterns to the adjacent Park Land / Open Space with the following justification.

The pre-development runoff rate directed to the park land / open space as calculated above is 3.5 L/s, 4.8 L/s and 10.0 L/s during the 2-year, 5-year and 100-year storm events respectively.

The uncontrolled flow rate directed to the park land / open space as calculated above is 0.8 L/s, 1.1 L/s and 2.3 L/s during the 2-year, 5-year and 100 year storm events respectively.

The post-development runoff rates directed to the park have been compared to the runoff rates directed to the park during pre-development conditions in the following Table 2.2

Table 2.2 Comparison of Flows to the Park Land / Open Space

Storm Event	Runoff During Pre-Development Conditions	Runoff During Post-Development Conditions	Difference in Runoff Rate	Percent Decrease in Runoff Rate
2 – year	3.5 L/s	0.8 L/s	-2.7 L/s	77 %
5 – year	4.8 L/s	1.1 L/s	-3.7 L/s	77 %
100 – year	10.0 L/s	2.3 L/s	-7.7 L/s	77 %

From the above table, the proposed development will result in a reduction in flow to the park of 77 percent for all storm events. The 100 year post-development flow rate to the park will be less than the 2 year pre-development rate.

2.2.8 Post Development Restricted Flow and Storage

In order to meet the stormwater quantity control restriction, the post development runoff rate cannot exceed the 2 year predevelopment runoff rate. Runoff generated on site in excess of the allowable release rate will be temporarily stored on the roof (catchment CA1) and within undersurface storage tanks placed at the southwest corner of the site between the building and the rowhouse property (catchment CA2). The stored water will be released at a controlled rate during and following the storm event.

2.2.8.1 Catchment CA1 - Roof

In order to achieve the allowable controlled area storm water release rate, storm water runoff from the roof will be controlled by eight roof drains fitted with flow control. The drains will discharge to an uncontrolled stormwater lead which in turn will discharge into the underground storage tanks. There will be no direct discharge from the roof to the storm sewers along



Grenon Avenue. The roof drains will consist of WATTS Small Area Roof Drain with Adjustable Flow Control. RD-200-A-ADJ – set with a closed Weir opening exposure. The closed Weir opening setting on the drain allows the drain to discharge a constant rate of 5 US gallons per minute or about 0.3 L/s over a change in head on the weir between 1 and 6 inches (25 to 152 mm). During both the 5 year and 100 year storm events, the roof drains will release at a combined discharge rate of 2.5 L/s Design information for the Roof Drain is provided in Appendix B.

2.2.8.2 Catchment CA2 – South Side of Building Above the Basement / Below Grade Parking

The stormwater runoff originating from the south side of the building including the adjacent offsite areas will be directed to storage tanks placed at two locations as indicated in the Site Servicing Plan. The runoff from the proposed amenity area and walkway will be directed by sheet flow to proposed rear yard style catch basins located along the walkway and adjacent the amenity area. The rear yard catch basins will discharge by means of storm sewer to the storage tanks. The ground surface along the walkway will be landscaped with permeable pavers. The tanks will discharge by means of a 250 mm diameter storm sewer to a maintenance hole STMH1 located between the storage tanks and the front property line. This storm sewer will have an invert elevation at the tanks of 72.70 metres. Release from the tanks to the maintenance hole will be uncontrolled. Discharge from maintenance hole STMH1 will be controlled by a Hydrovex Flow Regulator Model 100 SVHV-1 and will be directed to a maintenance hole STMH2 located between the building and Grenon Avenue. Discharge from STMH2 will be directed to the storm sewer along Grenon Avenue without restraint.

The Hydrovex Flow Regulator can be order using the following specification:

Model	100-SVHV-2
Pipe Outlet	250 mm PVC SDR 35
Discharge	9.7 L/s
Upstream Head	2.0 m
Maintenance Hole Diameter	1.2 metres
Minimum Clearance	0.45 m

The above outlet restrictions from the roof and underground storage tanks result in the storage requirements as summarized the following Table 2.3.

As previously indicated, the storm tanks will be divided between two locations. The first group of tanks will be located at beneath the rear amenity area and will be connected to the second group of storage tanks located at the front of the site. The bottom of the first group of storage tanks will be at an elevation of 73.0 metres. The top of these storage tanks will be at 73.60 metres. The lowest finished ground surface above these storage tanks will be at an elevation of 75.85 metres.



The top of the second group of storage tanks will be at an elevation of 73.3 metres. The lowest finished ground surface above the storage tanks will be at an elevation of 73.60 metres.

Overflow from the storage tanks will occur by means of the grate on STMH1 at an elevation of 73.50 metres which is sufficient to ensure protection of the ground surface. Overflow from STMH1 would be directed to Grenon Avenue which is about 4.5 metres west at an elevation of 72.8 metres. The entrance to the proposed building is at an elevation of 73.80 which is 0.3 metres above the overflow elevation.

Table 2.3 – Summary of Post-Development Release rates and Storage Requirements.

Return period	Allowable Release Rate	Actual Release rate	Required Storage	Available Storage	Required Storage Depth	Available Storage Depth
(years)	(L/s)	(L/s)	(m ³)	(m ³)	(m)	(m)
Catchment Area CA1 – Upper Roof						
5	--	2.5	11.6	32.97	0.95	0.15
100	--	2.5	28.1	32.97	0.14	0.15
Catchment Area CA2 – Underground Storage Tanks – Normal Conditions						
5	11.7	8.5	3.3	14.6	0.1	0.46
100	9.7	9.2	10.4	14.6	0.32	0.46
Catchment Area CA2 – Underground Storage Tanks – Grenon Avenue Becomes Flooded During a Storm Event – Elevated HGL						
5	11.7	5.3	6.1	14.6	0.19	0.45
100	9.7	6.3	14.3	14.6	0.44	0.45

2.2.9 Roof Top Storage

Roof Top Storage will be provided on the upper roof of the proposed building. The roof will be provided with a low slope towards the roof top drains by means of a Tapered Roofing System Product. The minimum slope on the roof will be 1 percent and will be as much as 2 percent. The roof will be fitted with overflow scuppers 0.13 metres above the lowest point on the roof.

It is assumed that about 60 percent of the roof surface will be used for stormwater storage. This will result in a ponding depth of about 0.13 metres on the roof deck.

Outlet will be controlled by the roof drains which will discharge to a storm water lead. The maximum flow through the storm water lead during a 100 year event will be 2.5 L/s. A 135 mm diameter storm sewer at a 1 percent slope has a capacity of 11.51 L/s. A storm sewer lead with a minimum diameter of 135 mm is recommended and will have sufficient capacity for the roof



discharge. The storm sewer lead will be installed near vertical or with a slope exceeding 1 percent within the building. The storm sewer lead will discharge to the underground storage tanks. It is recommended that the storm sewer lead be constructed with PVC pressure pipe to ensure protection in the advent of backup the storm sewer lead.

2.2.10 Underground Storage Tanks

The underground storage will be provided using Brentwood StormTank Modular Tanks. A Brentwood StormTank Module is a subsurface storage unit load-rated for use under surfaces such as parking lots, athletic fields, and parks as well as landscaped areas. Design information for the Brentwood StormTanks is provided in Appendix B. It is considered that there are similar modular stormwater management systems that are directly comparable to the Brentwood Modular Tank system. The developer / sewer contractor may propose the use of an alternative equivalent modular product. Shop drawings should be submitted to the design engineer prior to acceptance of equivalency. Shop drawings should be submitted to the design engineer or the Brentwood StormTank or accepted equivalent system for approval prior to installation.

The City of Ottawa Sewer design guideline indicates that an assumed constant flow rate during a storm event underestimates the required storage during a storm event. The guideline recommends that an assumed average release rate equal to 50% of the peak allowable rate shall be used to account for additional storage requirements. The underground stormwater storage tanks have been designed with sufficient volume to accommodate a reduced discharge under normal flow conditions of 8.2 L/s. Under normal flow conditions (Storm sewer along Grenon Avenue is not surcharged) the minimum discharge from the storm tank will occur when the tank is essentially empty and is equal to 8.2 L/s. The resulting storage requirement is 11.6 m³ during a 100 year storm event at this discharge rate.

It is known that the storm sewer along Grenon Avenue has been designed to a two year storm event without surcharge protection. As such, it is expected that the storm sewer along Grenon Avenue will surcharge and overflow during a 100 year storm event. Additional head and discharge columns were added to the storage volume provided calculation sheet in the appendix to illustrate the reduced head resulting from the surcharge. It is assumed that the minimum head during a 100 year storm event will be equal to the difference in elevation between the bottom of the storage tanks and 0.05 m higher than the center of road elevation (72.60 m) at the location where the proposed site storm sewer connects to the Sewer along Grenon Avenue. This results in a minimum head of 0.2 metres with a minimum discharge of 1 L/s and a maximum head on the storage tanks without surcharging of the tanks of 0.95 metres with a discharge of 6.5 L/s. This results in an average head of 0.58 metres and a 50% discharge during surcharge conditions of 4.4 L/s. A discharge rate of 4.4 L/s results in a storage requirement of 18.9 m³ during a 100 year storm event. There is a total storage available in the



storage tanks of 19.2 m^3 below the overflow elevation without considering the available volume in the catch basin manholes, manholes and storm pipe.

The underground tanks in the rear below the amenity area are comprised of ST-24 Modular Units. Each unit has a height of 0.61 m, a width of 0.48 m and a length of 0.91 m. The rear stormwater storage tank will be comprised of a total of 65 modules. The modules will be placed at the south east corner of the site below the amenity area as indicated in the Servicing Drawing. The tanks will be placed with a bottom of tank elevation of 73.0 metres. The tanks will be wrapped in an impervious geotextile fabric to reduce the infiltration into the foundation drainage layer and weeping tile of the adjacent proposed building.

The underground tanks at the front of the site are comprised of ST-18 Modular Units. Each unit has a height of 0.46 m, a width of 0.46 m and a length of 0.91 m. The stormwater storage tank will be comprised of a total of 33 modules. The modules will be placed at the south west corner of the site as indicated in the Servicing Drawing. The tanks will be placed with a bottom of tank elevation of 72.85 metres. The tanks will be wrapped in an impervious geotextile fabric to reduce the infiltration into the foundation drainage layer and weeping tile of the adjacent proposed building.

It is noted that the front tank will have an additional module placed below the tank bottom. This additional module is required to facilitate the connection of the outlet pipe to the manhole. It has not been included in the available storage calculations as it will be partially filled during surcharge conditions.

As previously indicated, discharge from the underground storage tank is by means of STMH1. The restriction on the runoff rate from the underground storage tank is provided by a Hydrovex ICD.

2.3 Protection of Underground Parking From Major System Flooding and Foundation Drainage

The existing road surface has a continuous downward slope for a minimum distance of 10 metres past the parking garage ramp entrance. The elevation at this distance is about 72.05 metres which is about 0.4 metres lower than the grade at the entrance to the parking ramp. The proposed parking ramp will slope upward to the high point in the ramp at an elevation of 72.82 metres or 0.4 metres above the entrance elevation. This maintains a minimum clearance of 0.3 metre with a flow depth of 0.1 metres along Grenon Avenue.

The groundwater table is at an elevation of between 68.2 and 67.0 metres. A conventional, perforated perimeter drain, with a 150 millimetre surround of 20 millimetre minus crushed stone, should be provided at the founding level for the basement floor parking area



(approximate elevation of 70 metres) and should lead by gravity flow to a sump. The sump should be equipped with a backup pump and generator. Since this perimeter drainage system is above the ground water level there will be no significant extraneous flow from the foundation drainage system.

The bottom portion of the car stacker pit will be below the ground water level. Since the subsurface conditions at the founding level for the car stacker pit consist of medium to coarse sand, it is not reasonable to expect that a foundation drainage system will be able to lower the groundwater level sufficiently to keep the foundation dry. As such, the car stacker pit should be constructed in a waterproof manner and should be provided with an exterior waterproof liner for secondary protection. Design of the liner and waterproofing should be completed by a specialist in building membranes and related building waterproofing design. There will be no significant extraneous flows from the car stacker pit portion of the foundation as it will not be dewatered.

2.4 Stormwater Quality Control

As previously indicated in the report, quality control requirements for the site have been provided by the Rideau Valley Conservation Authority. Communication with RVCA is included in Appendix F.

The quality control requirement for the site is considered to be the equivalent of an enhanced level of treatment or 80% removal of total suspended solids and is expected to be met by the elimination of and control of the potential sources of stormwater contamination.

The major source of stormwater contamination from a development site is the onsite surface parking areas. Surface parking has been eliminated in the revised development design. Runoff from parked vehicles will be directed to the sanitary sewer from the parking floor drains.

The surface areas at the site consist of the roof of the building, the landscaped areas and the walkway and amenity area.

- The roof of the building is not considered to be a major source of suspended solids contamination.
- The runoff from surface area of the below grade parking area driveway is limited to a short section not covered by the building. The remainder of the driveway is covered and not subject to precipitation.
- The landscaped areas are not considered to be a source of suspended contamination as the landscaped areas provide vegetative filtration of the surface runoff and the vegetation and landscaping protects the ground surface reducing the potential for



erosion and eliminating the landscaped ground surface area as a source of suspended solids.

- The walkways and amenity area can be a source of suspended solids especially during winter snow and ice removal. The use of permeable unit pavers reduces the amount of salt and other snow and ice removal products required. In addition, the runoff from the majority of the walkway and amenity area is directed to the adjacent landscaped surface prior to being collected or discharged from the site.

Best management practices will be incorporated at the site to reduce potential suspended solid contamination. Snow and Ice control management practices which include proper timing of the application of the salt and sand will be incorporated to reduce contamination from winter snow and ice removal.

2.5 Stormwater System Operation and Maintenance

2.5.1 Inlet Control Device (ICD) and Roof Drains

The inlet control device (ICD) and Roof Drains should be inspected on a semi-annual basis and following major storm events. Any blockages, trash or debris should be removed. The Roof Drains should be inspected before winter to ensure they have not be clogged with leaves.

2.5.2 Catchbasin/ Manhole and Inspection Ports

The catchbasin / manhole and inspection ports (including sediment traps in storm tanks) should be cleaned with a hydrovac excavation truck following completion of construction, paving of the asphaltic concrete surface, placement of the walkway and exterior parking pavers and establishment of adequate grass cover on the landscaped areas.

Following the initial cleaning these structures should be inspected on a semi-annual basis and following major storm events. Any blockages, trash or debris should be removed. Once the sediment accumulation in the catchbasin / manhole has reached a level equal to 0.15 metres below the outlet invert of the structure, or a thickness of 0.15 metres in the sediment traps, the sediment should be removed by hydro excavation.

2.5.3 Brentwood StormTank Storage Tanks

Detailed installation, operation and maintenance guidelines are provided in the StormTank Module Design Guide included in Appendix B. In general maintenance procedures consist of Inspection and cleaning as follows:

Inspection:

- Inspect all observation ports, inflow and outflow connections, and the discharge area.



- Identify and log any sediment and debris accumulation, system backup, or discharge rate changes.
- If there is a sufficient need for cleanout, contact a local cleaning company for assistance.

Cleaning:

- If a pretreatment device is installed, follow manufacturer recommendations.
- Using a vacuum pump truck, evacuate debris from the inflow and outflow points.
- Flush the system with clean water, forcing debris from the system.
- Repeat steps 2 and 3 until no debris is evident.

2.6 Storm Sewer Design

The on-site storm sewers were designed to be in general conformance with the City of Ottawa Sewer Design Guidelines (October 2012). Specifically, storm sewers were sized using Manning's Equation, assuming a roughness coefficient $N = 0.013$, to accommodate the uncontrolled runoff from the 5-year storm, under 'open-channel' conditions. The uncontrolled runoff was determined using the rational method and the City of Ottawa IDF curve for a 10-minute time of concentration. Refer to Storm Sewer Design Sheets in Appendix A.

The storage volume within the storm pipes and structures (catch basins and maintenance holes) has not been utilized in the calculations for available storage in the proposed stormwater management facility. Since these unaccounted volumes are small, this will have no significant impact to the stormwater management facility and any impact that does occur will not have a negative effect to the design. There is no surface storage.



3 SANITARY SEWER DESIGN

The existing residential sanitary service is connected to the existing 9 inch (225 mm) diameter concrete sanitary sewer which is located slightly west of the center of road along Grenon Avenue.

Sewage discharges will be domestic in type and in compliance with the City of Ottawa Sewer Use By-law. The anticipated peak sanitary flow from the building will be a total of approximately 0.69 L/s.

The sanitary sewage flow for the proposed building was calculated based on the City of Ottawa Sewer Design Guidelines (Section 4.4.1.2) and incorporated Technical Bulletin ISTB-2018-01.

3.1 Design Flows

Residential

Total domestic pop:

1 Bedroom units (5) x 1.4 ppu:	7
2 Bedroom units (22) x 2.1 ppu:	<u>46.2</u>
Total:	53.2

Alternatively:

Total domestic pop:

1 Bedroom units (14) x 1.4 ppu:	19.6
2 Bedroom units (16) x 2.1 ppu:	<u>33.6</u>
Total:	53.2

$$Q_{\text{Domestic}} = 54 \times 280 \text{ L/person/day} \times (1/86,400 \text{ sec/day}) = 0.18 \text{ L/sec}$$

$$\text{Peaking Factor} = 1 + \frac{14}{4 + (54/1000)^{0.5}} \times 0.8 = 3.65 - \text{maximum } 4.0$$

$$Q_{\text{Peak Domestic}} = 0.18 \text{ L/sec} \times 3.65 = 0.64 \text{ L/sec}$$

Infiltration

$$Q_{\text{Infiltration}} = 0.33 \text{ L/ha/sec} \times 0.1421 \text{ ha} = 0.05 \text{ L/sec}$$

$$\text{Total Peak Sanitary Flow} = 0.64 + 0.05 = 0.69 \text{ L/sec}$$



3.2 Sanitary Service Lateral

The Ontario Building Code specifies minimum pipe size and maximum hydraulic loading for sanitary sewer pipe. OBC 7.4.10.8 (2) states "Horizontal sanitary drainage pipe shall be designed to carry no more than 65% of its full capacity." A 135 mm diameter sanitary service with a minimum slope of 1.0% has a capacity of 11.51 Litres per second.

The maximum peak sanitary flows for the site is 0.69 L/sec. Since 0.69 L/sec is much less than $0.65 \times 11.51 = 7.48$ L/s, the sanitary service would be properly sized if greater than or equal to 135 mm in diameter.

Table 3.1 Fixture Unit Consideration

Apartment Unit Type	Number of Apartments	Number of fixture units per apartment	Total number of Fixture Units.
• 1 Bedroom	5	10.0	50
• 2 Bedroom	22	10.0	220
• Total fixtures			270

However, from Table 7.4.10.8, the allowable number of fixture units for a 135 mm diameter sanitary service pipe at 1.0% slope is 390. There are approximately 330 fixtures in the building. As such a 135 mm diameter sanitary service will be adequate to meet the hydraulic demands for the proposed sanitary flow.

The proposed sanitary service will be connected to the existing sanitary main at a proposed invert of 70.25 metres. The sanitary service will be connected to the existing sanitary service in accordance with City of Ottawa Standard Drawing S11. The service will be extended over the existing watermain by 500 mm in accordance with procedure F-6-1 Section 5.2 of the Ontario Drinking water Resources Act. This will result in a sanitary service invert elevation at the building of 70.80 metres. As such a sump pit and sump pump will be required for the basement parking area floor drains. The discharge line from the sump pit will require a backflow preventer.

Based on the City of Ottawa Sewer Design Guidelines, as amended, the minimum sanitary service diameter for a multiunit residential development of the size proposed is 200 mm. Therefore the proposed service lateral will be 200 mm in diameter.

The sanitary fixtures on the ground floor and within the units are more than 1 metres above the adjacent street surface. As such, the building grade is above the HGL of the sewer.



3.3 Sanitary Main

The existing sanitary sewer along Grenon Avenue downstream of the site consists of a 9 inch (225 mm) diameter concrete pipe at a slope of 2.72 percent. The capacity of this section of sewer is 74 Litres per second. The sewer along Grenon Avenue originates about 81 metres south of the site and discharges into the sanitary sewer main along Carling Avenue about 155 metres downstream of the site. The sewer along Carling Avenue consists of a 225 mm diameter concrete sewer with a slope of about 1.53 percent and a capacity of 55 Litres per second.

The demand on the existing sanitary sewer along Grenon Avenue was calculated based on the occupation and contributing area estimated from geoOttawa Mapping. The sanitary sewer calculation sheet is attached in Appendix C. A figure illustrating the sanitary manholes and catchment areas has also been included in Appendix C. From the attached sheet, the calculated peak demand on the existing sanitary sewer main is 3.65 L/sec.

The additional peak demand resulting from the proposed development consists of 0.69 L/sec or about an 18.9 percent increase. This additional demand represents 1 percent of the capacity of the sanitary sewer. The total demand on the sanitary sewer along Grenon Avenue will be 4.44 L/s after the proposed development. This total demand represents only 5.9 percent of the capacity of the Sanitary Sewer along Grenon Avenue. Therefore, it is considered that there is sufficient capacity in the existing sanitary sewer for the proposed development.



4 WATERMAIN DESIGN

4.1 Water Demand

The water demand for the proposed development was calculated based on the City of Ottawa Water Distribution Design Guidelines as follows:

Residential

Total domestic pop:

1 Bedroom units (5) x 1.4 ppu:	7
2 Bedroom units (22) x 2.1 ppu:	<u>46.2</u>
Total:	53.2

Residential Average Daily Demand = 350 L/c/d.

- Average daily demand of 350 L/c/day x 54 persons = 18,900 Litres/day or 0.22 L/s
- Maximum daily demand (factor of 2.5) is 0.22 L/s x 2.5 = 0.55 L/s
- Peak hourly demand (factor of 2.2) = 0.55 L/s x 2.2 = 1.20 L/s

4.2 Fire Flow

Fire flow protection requirements were calculated as per the Fire Underwriter's Survey (FUS) taking into account the methodology provided in Technical Bulletin ISTB-2018-02. Calculations of the fire flow required are provided in Appendix D. Based on the FUS, the fire flow requirements for the site are 133.3 L/s (8000 L/min).

4.3 Sufficiency of Existing Infrastructure

The proposed development is within the City of Ottawa water distribution network pressure zone 1W.

A previously calculated residential water supply requirement and Fire Fighting Requirement were provided to the City of Ottawa for boundary conditions. The correspondence is attached in Appendix D. These requirements consisted of a average daily demand of 0.25 L/sec, a maximum daily demand of 0.62 L/s and a Maximum hourly demand of 1.37 L/sec. The fire flow requirement was 116.7 L/s (7002 /min).

The following are boundary conditions, HGL, for hydraulic analysis at 841 Grenon Avenue (zone 1W) assumed to be connected to the 152mm on Grenon were based on the above requirements.



Minimum HGL = 107.2 m

Maximum HGL = 115.7 m

MaxDay + FireFlow (117 L/s) = 96.5 m

Based on the existing ground surface elevation of the roadway over the watermain at the site, an HGL of 96.5 at the site indicates a residual pressure at the adjacent fire hydrants to the site of about 230 kPa under fire flow conditions. Since the required fire flow rate is above 5700 L/min at a residual pressure above 140 kPa (20 psi), the hydrants are considered to be Class AA.

4.3.1 Existing Water Service

The site is currently occupied by a single family dwelling which has a residential water service connected to the 150 mm water main along Grenon Avenue. This water service will not be sufficient for the proposed development and must be capped at the water main to the satisfaction of City of Ottawa Staff.

4.3.2 Existing Fire Hydrants

The existing fire hydrants within the vicinity of the site are located as follows: At the intersection of Grenon Avenue and Carling Avenue 144 metres north of the site; At 855 Grenon Avenue 80 metres south of the site. There is a proposed hydrant to be located at the southwest corner of the site about 16.5 metres from the building.

City of Ottawa Technical Bulletin ISTB-2018-02 Appendix I Table 1 provides guidance with respect to maximum flow from to be considered from a given hydrant. From this table, a Class AA hydrant can contribute a maximum flow of 5,700 L/min when located less than 75 metres from the building and 3,800 L/min when located between 75 and 150 metres from the building.

Since both of the above existing hydrants are between 75 and 150 metres from the proposed building, and the proposed hydrant is less than 75 metres from the building these hydrants can be expected to provide contributions of 3,800 L/min and 5,700 L/min to the required fire flow for a total combined flow of 13,300 L/min. As previously indicated, the required fire flow is $133.3 \text{ L/sec} \times 60 \text{ sec/min} = 8000 \text{ L/min}$. The existing and proposed hydrants are considered to be sufficient to meet the required fire flow at the site.

Building	Fire Flow Demand (L/min)	Fire Hydrant(s) within 75m	Fire Hydrant(s) within 150 m	Combined Fire Flow (L/min)
Residential Apartment	7002 L/min	1	2	13,300 L/min



4.4 Proposed Service

The City of Ottawa Design Guidelines – Water Distribution as amended by technical bulletin ISDTB-2014-02 indicates that if possible water distribution systems are to be designed to provide residual pressures of 345 to 552 kPa in all occupied areas outside of the public right-of-way.

In accordance with MOE Guidelines, the distribution system shall be sized so that system pressures during the maximum hourly demand flows are no less than 276 kPa (40 psi) under normal operating conditions.

The proposed building is a 4 storey residential building with a ground floor elevation of 73.8 metres. The existing ground surface elevation adjacent at the street adjacent the site is 72.4 metres. Assuming a height of 3 metres per floor, the fourth floor fixtures will have a maximum elevation of about 85.3 metres.

The pressure loss between the watermain and the first floor and the pressure loss between the watermain and the fourth floor were calculated using Bernoulli's Equation in combination with the Darcy-Weisbach Equation and the Colebrook Equations.

$$H_P + Z_1 - Z_2 + \frac{P_1 - P_2}{\rho g} + \frac{V_1^2 - V_2^2}{2g} = h_f + h_m \quad \text{where:}$$

$$h_m = K_m \frac{V^2}{2g} \quad \text{Re} = \frac{VD}{\nu} \quad Q = VA \quad A = \frac{\pi}{4} D^2$$

$$\text{Darcy-Weisbach Equation: } h_f = f \frac{L}{D} \frac{V^2}{2g} \quad \text{where:}$$

$$\text{If laminar flow } \left(\text{Re} < 4000 \text{ and any } \frac{e}{D} \right), \quad f = \frac{64}{\text{Re}}$$

$$\text{If turbulent flow } \left(4000 \leq \text{Re} \leq 10^8 \text{ and } 0 \leq \frac{e}{D} < 0.05 \right), \text{ then}$$

$$\text{Colebrook Equation: } \frac{1}{\sqrt{f}} = -2.0 \log \left(\frac{e/D}{3.7} + \frac{2.51}{\text{Re} \sqrt{f}} \right)$$

An excel spreadsheet was utilized to facilitate the calculations and is included in Appendix C.

Using the above minimum HGL, a 50 mm service diameter would result in a residual pressure during maximum hourly demand on the ground floor of about 325 kPa. Due to the height of the proposed building a hydraulic grade line of 107.2 results in residual pressure on the top floor of the proposed building of about 212 kPa using a 50 mm diameter service and about 215 kPa using a 150 mm diameter service during maximum hourly demand. It is noted that 215 kPa is below the minimum allowable pressure of 275 kPa. As such a booster pump will be required to provide adequate pressure at the top floor of the building regardless of the service size used.



Alternatively - Neglecting Minor Losses:

$$HGL = \frac{P}{\gamma} + Z$$

$$P = (HGL - Z) \times \gamma$$

$\gamma = 9.79 \text{ kN/m}^3$ (unit weight of water)

P = Pressure (KPa) at the Street Z = 72.4

- Minimum pressure $P = (107.2 - 72.4) \times \gamma = 341 \text{ KPa}$
- Maximum pressure $P = (115.7 - 72.4) \times \gamma = 423 \text{ KPa}$

P = Pressure (KPa) at First Floor Z = 73.8

- Minimum pressure $P = (107.2 - 73.8) \times \gamma = 326 \text{ KPa}$
- Maximum pressure $P = (115.7 - 73.8) \times \gamma = 410 \text{ KPa}$

P = Pressure (KPa) at Fourth Floor Z = 85.3

- Minimum pressure $P = (107.2 - 85.3) \times \gamma = 214 \text{ KPa}$
- Maximum pressure $P = (115.7 - 85.3) \times \gamma = 298 \text{ KPa}$

Neglecting minor and frictional pipe losses in the lateral, the maximum pressure at the ground floor water meter is below 552 KPa. Neglecting minor and frictional pipe losses in the lateral, the minimum pressure at the fourth floor is below 276 KPa.

The proposed building will be equipped with sprinklers. In order to meet the required fire flow at the building, a minimum service diameter of 150 mm would be required in order to ensure the pressure at the building on the ground floor is above the minimum residual pressure of 140 kPa.

The water demand of a sprinkler system is based on the design of the sprinkler system. The mechanical engineer designing the sprinkler system must determine the actual required fire flow for the sprinkler system at the building in order to verify the required service diameter. A booster pump will be required in order to provide adequate pressure for the sprinkler system and water fixtures on the upper floors.



5 EROSION AND SEDIMENT CONTROL

The owner (and/or contractor) agrees to prepare and implement an erosion and sediment control plan at least equal to the stated minimum requirements and to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current best management practices for erosion and sediment control. It is considered to be the owners and/or contractors responsibility to ensure that the erosion control measures are implemented and maintained.

In order to limit the amount of sediment carried in stormwater runoff from the site during construction, it is recommended to install a silt fence along the property, as shown in Kollaard Associates Inc. Drawing #180966-ECP Erosion Control Plan. The silt fence may be polypropylene, nylon, and polyester or ethylene yarn.

If a standard filter fabric is used, it must be backed by a wire fence supported on posts not over 2.0 m apart. Extra strength filter fabric may be used without a wire fence backing if posts are not over 1.0 m apart. Fabric joints should be lapped at least 150 mm (6") and stapled. The bottom edge of the filter fabric should be anchored in a 300 mm (1 ft) deep trench, to prevent flow under the fence. Sections of fence should be cleaned, if blocked with sediment and replaced if torn.

Filter socks should be installed across existing storm manhole and catch basin lids. As well, filter socks should be installed across the proposed catch basin lids immediately after the catch basins are placed. The filter socks should only be removed once the asphaltic concrete is installed and the site is cleaned.

The proposed landscaping works should be completed as soon as possible. The proposed granular and asphaltic concrete surfaced areas should be surfaced as soon as possible.

The silt fences should only be removed once the site is stabilized and landscaping is completed.

These measures will reduce the amount of sediment carried from the site during storm events that may occur during construction.



6 CONCLUSIONS

This report addresses the adequacy of the existing municipal storm and sanitary sewer system and watermain to service the proposed development of an apartment building on Grenon Avenue. Based on the analysis provided in this report, the conclusions are as follows:

SWM for the proposed development will be achieved by restricting the 100 year post development flow to Grenon Avenue to the 2 year pre-development flow rate from the site. Uncontrolled runoff directed to the adjacent parkland / open will be reduced during post development condition to less than 40 percent of the current flow directed to the park.

The peak sewage flow rate from the proposed development will be 0.78 L/sec. The existing municipal sanitary sewer will have adequate capacity to accommodate the minimal increase in peak flow. The City has not identified any capacity issues in the existing sanitary sewer system and the calculation indicate sufficient capacity.

The existing municipal watermain along Grenon Avenue will have adequate capacity to service the proposed development for both domestic and fire protection. A booster pump will be needed within the building to ensure sufficient pressure on the upper floors.

During all construction activities, erosion and sedimentation shall be controlled.

We trust that this report provides sufficient information for your present purposes. If you have any questions concerning this report or if we can be of any further assistance to you on this project, please do not hesitate to contact our office.

Sincerely,
Kollaard Associates, Inc.



Steven deWit, P.Eng.



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix A: Storm Design Information

- Sheet 1 - Allowable Release Rate and SWM Summary
- Sheet 2 - Pre-Development Runoff to Park Area
- Sheet 3 - Uncontrolled Area Runoff Calculation to Park Land
- Sheet 4 - Uncontrolled Area Runoff Calculation to Grenon Ave
- Sheet 5 - Actual Discharge Rate and Storage Volume Requirements
- Sheet 6 - Storage Volume Provided
- Sheet 7 – Storm Sewer Design Sheet

APPENDIX A: STORMWATER MANAGEMENT MODEL
SHEET 1 - ALLOWABLE RELEASE RATE AND SWM SUMMARY

Client: Building Investments Inc.
Job No.: 180966
Location: 841 Grenon Ave
Date: January 8, 2020

Pre Dev run-off Coefficient "C"

Area	Surface	Ha	0.039	C _{avg}
Total	Gravel	0.0099	0.70	0.37
0.1713	Building	0.0088	0.90	
	Offsite Building	0.0112	0.90	
	Offsite Landsc.	0.0180	0.25	
	Landscaping	0.1333	0.25	

PRE DEVELOPMENT FLOW

2 Year Event			
Pre Dev.	C	Intensity	Area
2 Year	0.37	76.81	0.171
2.78CIA= 13.53			
13.5 L/s			

**Use a 10 minute time of concentration for 2 year

Total Allowable Release: 13.5 L/s

100 Year Event			
Pre Dev.	C	Intensity	Area
100 Year	0.46	178.56	0.171
2.78CIA= 39.33			
39.3 L/s			

**Use a 10 minute time of concentration

Total Allowable Release: 39.3 L/s

Pre Dev Time of Concentration "t_c"

From City of Ottawa Sewer Design Guidelines - Appendix 5 - D

Slope of Site = 6.9% Inlet Time = less than 10 min
Distance Across Site = 29.8 Therefore use a minimum Time of Concentration of 10 min
Runoff Coefficient = 0.34

Alternatively:

Pre Dev Time of Concentration "t _c "	Airport Formula
$t_{ca} = \frac{3.26 \times (1.1 - C) \times l_c^{0.5}}{S^{0.33}}$	<p>C = Runoff Coefficient 0.34</p> <p>l_c = length of flow path 29.8</p> <p>Elevation Change 2.07</p> <p>S = Slope of flow path 6.9</p>
t_c = 7.13	

Total t_c 7.13 min

Minimum as per City Guidelines 10.00 min

STORMWATER MANAGEMENT SUMMARY

Sub Area I.D.	Sub Area (ha)	2,5 year C	100 year C	Outlet Location	5 Year Controlled Release (L/s)	Required 5 year Storage (m ³)	100 Year Controlled Release (L/s)	Required 100 year Storage (m ³)
Pre-Development Runoff to the Park Land								
					4.8		10.0	
Proposed Post-Development Runoff to the Park Land								
UA1	0.0152	0.25	0.31	PARK	1.1		2.3	
Total Allowable discharge to Grenon Avenue					13.5		13.5	
Actual Discharge to Grenon Avenue								
UA2	0.0145	0.42	0.53	GRENON	1.8		3.8	
CA1	0.0664	0.90	1.00	GRENON	0.0	11.6	0.0	28.1
CA2	0.0753	0.53	0.61	GRENON	1.7	4.4	9.7	18.9
TOTAL								
	0.171				3.5	16.0	13.5	47.1

Equations:

Flow Equation

$$Q = 2.78 \times C \times I \times A$$

Where:

C is the runoff coefficient

I is the intensity of rainfall, City of Ottawa IDF

A is the total drainage area

Runoff Coefficient Equation

$$C = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{tot}}$$

APPENDIX A: STORMWATER MANAGEMENT MODEL

Sheet 2 - Pre-Development Runoff Rate to Park Area Calculation

Client: Building Investments Inc.

Job No.: 180966

Location: 841 Grenon Ave

Date: January 8, 2020

PRE-DEVELOPMENT RUNOFF TO PARK AREA

Pre-Dev Run-off Coefficient "C"

Area	Surface	Ha	5 Year Event		100 Year Event	
			"C"	C _{avg}	"C"	C _{avg}
Total 0.0611	Asphalt	0.0000	0.90	0.27	0.99	0.33
	Landscape	0.0595	0.25		0.31	
	Building	0.0016	0.90		0.99	

2 Year Event			
Pre Dev.	C	Intensity	Area
2 Year	0.27	76.81	0.0611
2.78CIA= 3.52			
3.5 L/s			

**Use a 10 minute time of concentration for 2 year

Post Dev Free Flow

5 Year Event

	C	Intensity	Area
5 Year	0.27	104.19	0.0611
2.78CIA= 4.78			
4.8 L/S			

**Use a 10 minute time of concentration for 5 year

100 Year Event

	10	Intensity	Area
100 Year	0.33	178.56	0.0611
2.78CIA= 10.01			
10.0 L/S			

**Use a 10 minute time of concentration for 100 year

Equations:

Flow Equation

$$Q = 2.78 \times C \times I \times A$$

Where:

C is the runoff coefficient

I is the intensity of rainfall, City of Ottawa IDF

A is the total drainage area

Runoff Coefficient Equation

$$C = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{tot}}$$

APPENDIX A: STORMWATER MANAGEMENT MODEL

Sheet 3 - Uncontrolled Area Runoff Rate Calculation

Client: Building Investments Inc.

Job No.: 180966

Location: 841 Grenon Ave

Date: January 8, 2020

UA1 - UNCONTROLLED AREA DISCHARGE TO PARK LAND

Post Dev run-off Coefficient "C"

Area	Surface	Ha	5 Year Event		100 Year Event	
			"C"	C _{avg}	"C"	C _{avg}
Total	Asphalt/Roof	0.0000	0.90	0.25	1.00	0.31
0.0152	Landscape	0.0152	0.25		0.31	
	Walkway	0.0000	0.25		0.31	

2 Year Event

	C	Intensity	Area
2 Year	0.25	76.81	0.0152
2.78CIA= 0.81			
0.8 L/s			

**Use a 10 minute time of concentration for 2 year

Post Dev Free Flow

5 Year Event

	C	Intensity	Area
5 Year	0.25	104.19	0.0152
2.78CIA= 1.10			
1.1 L/S			

**Use a 10 minute time of concentration for 5 year

100 Year Event

	C	Intensity	Area
100 Year	0.31	178.56	0.0152
2.78CIA= 2.34			
2.3 L/S			

**Use a 10

minute time of concentration for 100 year

Equations:

Flow Equation

$$Q = 2.78 \times C \times I \times A$$

Where:

C is the runoff coefficient

I is the intensity of rainfall, City of Ottawa IDF

A is the total drainage area

Runoff Coefficient Equation

$$C = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{tot}}$$

APPENDIX A: STORMWATER MANAGEMENT MODEL

Sheet 4 - Uncontrolled Area Runoff Rate Calculation

Client: Building Investments Inc.

Job No.: 180966

Location: 841 Grenon Ave

Date: January 8, 2020

UA2 - UNCONTROLLED AREA DISCHARGE TO GRENON AVE

Post Dev run-off Coefficient "C"

Area	Surface	Ha	5 Year Event		100 Year Event	
			"C"	C _{avg}	"C"	C _{avg}
Total	Asphalt/Roof	0.0040	0.90	0.42	1.00	0.53
0.0145	Landscape	0.0100	0.25		0.31	
	Walkway	0.0005	0.90		1.00	

Post Dev Free Flow

5 Year Event

	C	Intensity	Area
5 Year	0.42	104.19	0.0145
2.78CIA= 1.76			
1.8 L/S			

**Use a 10 minute time of concentration for 5 year

100 Year Event

	10	Intensity	Area
100 Year	0.53	178.56	0.0145
2.78CIA= 3.80			
3.8 L/S			

**Use a 10 minute time of concentration for 100 year

Equations:

Flow Equation

$$Q = 2.78 \times C \times I \times A$$

Where:

C is the runoff coefficient

I is the intensity of rainfall, City of Ottawa IDF

A is the total drainage area

Runoff Coefficient Equation

$$C = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{tot}}$$

APPENDIX A: STORMWATER MANAGEMENT MODEL

Sheet 5 - ACTUAL DISCHARGE RATE AND STORAGE VOLUME REQUIREMENTS

Client: Building Investments Inc.
Job No.: 180966
Location: 841 Grenon Ave
Date: January 8, 2020

**Use a 10 minute time of concentration

Roof Area (CA1)			5 Year Event				100 Year Event			
Area ha	Surface	Ha	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)
0.0664	Asphalt/ Concrete Roof	0.0000	0.90	0.90	104.19	17.30	1.00	1.00	178.56	32.95
		0.0664	0.90				1.00			
	Amenity / Walkway Landscape	0.0000	0.50				0.63			
		0.0000	0.25				0.31			

Ground (CA2)			5 Year Event				100 Year Event			
Area ha	Surface	Ha	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)	"C" 10	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)
0.0753	Amenity Walkway	0.0090	0.90	0.53	104.19	11.55	1.00	0.61	178.56	22.79
		0.0126	0.90				1.00			
	Building Roof Landscape	0.0112	0.90				1.00			
		0.0425	0.25				0.31			

Total Allowable Release Rate 5 year 2.00 L/s
100 year 2.00 L/s

Storage Requirements for Roof Area (CA1)

Area = 0.0664 hectares
5-year Runoff Coefficient = 0.90 post development
100-year Runoff Coefficient = 1.00 post development

Release Rate L/s				0.5	1	1.5	1.9	2.5	3.5	4.5	5.5	6.5	7.5
Return Period	Time (min)	Intensity (mm/hr)	Flow Q (L/s)	Storage Required (m³)									
5 Year	10	104.19	17.30	10.1	9.8	9.5	9.2	8.9	8.3	7.7	7.1	6.5	5.9
	20	70.25	11.67	13.4	12.8	12.2	11.7	11.0	9.8	8.6	7.4	6.2	5.0
	30	53.93	8.96	15.2	14.3	13.4	12.7	11.6	9.8	8.0	6.2	4.4	2.6
	40	44.18	7.34	16.4	15.2	14.0	13.1	11.6	9.2	6.8	4.4	2.0	-0.4
	50	37.65	6.25	17.3	15.8	14.3	13.1	11.3	8.3	5.3	2.3	-0.7	-3.7
	60	32.94	5.47	17.9	16.1	14.3	12.9	10.7	7.1	3.5	-0.1	-3.7	-7.3
	70	29.37	4.88	18.4	16.3	14.2	12.5	10.0	5.8	1.6	-2.6	-6.8	-11.0
	Maximum 5 year storage rate			18.4	16.3	14.3	13.1	11.6	9.8	8.6	7.4	6.5	5.9
100 Year	Release Rate L/s			0.5	1	1.5	1.9	2.5	3.5	4.5	5.5	6.5	7.5
	10	178.56	32.95	19.5	19.2	18.9	18.6	18.3	17.7	17.1	16.5	15.9	15.3
	20	119.95	22.14	26.0	25.4	24.8	24.3	23.6	22.4	21.2	20.0	18.8	17.6
	30	91.87	16.95	29.6	28.7	27.8	27.1	26.0	24.2	22.4	20.6	18.8	17.0
	40	75.15	13.87	32.1	30.9	29.7	28.7	27.3	24.9	22.5	20.1	17.7	15.3
	50	63.95	11.80	33.9	32.4	30.9	29.7	27.9	24.9	21.9	18.9	15.9	12.9
	60	55.89	10.31	35.3	33.5	31.7	30.3	28.1	24.5	20.9	17.3	13.7	10.1
	70	49.79	9.19	36.5	34.4	32.3	30.6	28.1	23.9	19.7	15.5	11.3	7.1
	80	44.99	8.30	37.5	35.1	32.7	30.7	27.9	23.1	18.3	13.5	8.7	3.9
	90	41.11	7.59	38.3	35.6	32.9	30.7	27.5	22.1	16.7	11.3	5.9	0.5
	100	37.90	6.99	39.0	36.0	33.0	30.6	27.0	21.0	15.0	9.0	3.0	-3.0
	110	35.20	6.50	39.6	36.3	33.0	30.3	26.4	19.8	13.2	6.6	0.0	-6.6
	120	32.89	6.07	40.1	36.5	32.9	30.0	25.7	18.5	11.3	4.1	-3.1	-10.3
	130	30.90	5.70	40.6	36.7	32.8	29.7	25.0	17.2	9.4	1.6	-6.2	-14.0
	Maximum 100 year storage rate			40.6	36.7	33.0	30.7	28.1	24.9	22.5	20.6	18.8	17.6

Storage Requirements for Ground Area (CA2)

Area = 0.0753 hectares
5-year Runoff Coefficient = 0.53 post development
100-year Runoff Coefficient = 0.61 post development

Release Rate L/s				2.6	3.3	4	4.4	4.7	5.4	6.1	6.8	7.5	8.2	8.9	9.6	10.3
Return Period	Time (min)	Intensity (mm/hr)	Flow CA2 Q (L/s)	Storage Required (m³)												
5 Year	5	141.18	18.18	4.7	4.5	4.3	4.1	4.0	3.8	3.6	3.4	3.2	3.0	2.8	2.6	2.4
	10	104.19	14.08	6.9	6.5	6.0	5.8	5.6	5.2	4.8	4.4	3.9	3.5	3.1	2.7	2.3
	20	70.25	10.31	9.3	8.4	7.6	7.1	6.7	5.9	5.1	4.2	3.4	2.5	1.7	0.9	0.0
	30	53.93	8.50	10.6	9.4	8.1	7.4	6.8	5.6	4.3	3.1	1.8	0.5	-0.7	-2.0	-3.2
	40	44.18	7.42	11.6	9.9	8.2	7.3	6.5	4.9	3.2	1.5	-0.2	-1.9	-3.5	-5.2	-6.9
	50	37.65	6.70	12.3	10.2	8.1	6.9	6.0	3.9	1.8	-0.3	-2.4	-4.5	-6.6	-8.7	-10.8
	70	29.37	5.78	13.4	10.4	7.5	5.8	4.5	1.6	-1.3	-4.3	-7.2	-10.2	-13.1	-16.0	-19.0
	Maximum 5 year storage rate			13.4	10.4	8.2	7.4	6.8	5.9	5.1	4.4	3.9	3.5	3.1	2.7	2.4
100 Year	Release Rate L/s			2.6	3.3	4	4.4	4.7	5.4	6.1	6.8	7.5	8.2	8.9	9.6	10.3
	5	242.70	33.50	9.3	9.1	8.8	8.7	8.6	8.4	8.2	8.0	7.8	7.6	7.4	7.2	7.0
	10	178.56	25.31	13.6	13.2	12.8	12.5	12.4	11.9	11.5	11.1	10.7	10.3	9.8	9.4	9.0
	20	119.95	17.83	18.3	17.4	16.6	16.1	15.8	14.9	14.1	13.2	12.4	11.6	10.7	9.9	9.0
	30	91.87	14.25	21.0	19.7	18.4	17.7	17.2	15.9	14.7	13.4	12.1	10.9	9.6	8.4	7.1
	40	75.15	12.11	22.8	21.2	19.5	18.5	17.8	16.1	14.4	12.8	11.1	9.4	7.7	6.0	4.4
	50	63.95	10.69	24.3	22.2	20.1	18.9	18.0	15.9	13.8	11.7	9.6	7.5	5.4	3.3	1.2
	60	55.89	9.66	25.4	22.9	20.4	18.9	17.8	15.3	12.8	10.3	7.8	5.2	2.7	0.2	-2.3
	70	49.79	8.88	26.4	23.4	20.5	18.8	17.5	14.6	11.7	8.7	5.8	2.8	-0.1	-3.0	-6.0
	80	44.99	8.27	27.2	23.8	20.5	18.6	17.1	13.8	10.4	7.0	3.7	0.3	-3.0	-6.4	-9.8
	Maximum 100 year storage rate			27.2	23.8	20.5	18.9	18.0	16.1	14.7	13.4	12.4	11.6	10.7	9.9	9.0

Sheet 6 - STORAGE VOLUME PROVIDED

Catchment Area 1

Roof Drain Type - WATTS Small Area Roof Drain with Adjustable Flow Control. RD-200-A-ADJ - Closed Weir Opening Exposure.

Total Roof Area m ² =	649	Area used for Storage m ² =	340
----------------------------------	-----	--	-----


		East Side of Roof			West Side of Roof						
Depth	Layer Thickness	Layer Area	Layer Volume	East Side Volume	Layer Area	Layer Volume	West Side Volume	Total Cum. Volume	Release Rate per drain	Number of Drains	Total Release Rate
m	m	m ²	m ³	m ³	m ²	m ³	m ³	m ³	US gpm		L/s
0.15	0.025	170	4.25	17.75	170	4.25	17.75	35.51	5	8	2.5
0.125	0.025	170	4.25	13.50	170	4.25	13.50	27.01	5	8	2.5
0.1	0.025	170	4.25	9.25	170	4.25	9.25	18.51	5	8	2.5
0.075	0.025	170	3.34	5.00	170	3.34	5.00	10.01	5	8	2.5
0.05	0.025	100	1.46	1.67	100	1.46	1.67	3.33	5	8	2.5
0.025	0.025	25	0.21	0.21	25	0.21	0.21	0.42	5	8	2.5
0	0	0	0.00	0.00	0	0.00	0.00	0.00	0	8	0.0

[illegible]

** Discharge Rate Should Grenon Avenue be Surcharged

Client: Building Investments Inc
Job No.: 180966
Location: 841, 845, 855(A) Grenon Avenue, Ottawa
Date: January 8, 2020

APPENDIX A - STORMWATER MANAGEMENT MODEL
FIGURE 1 - UNDERGROUND STORAGE TANK STORAGE DISCHARGE CURVES

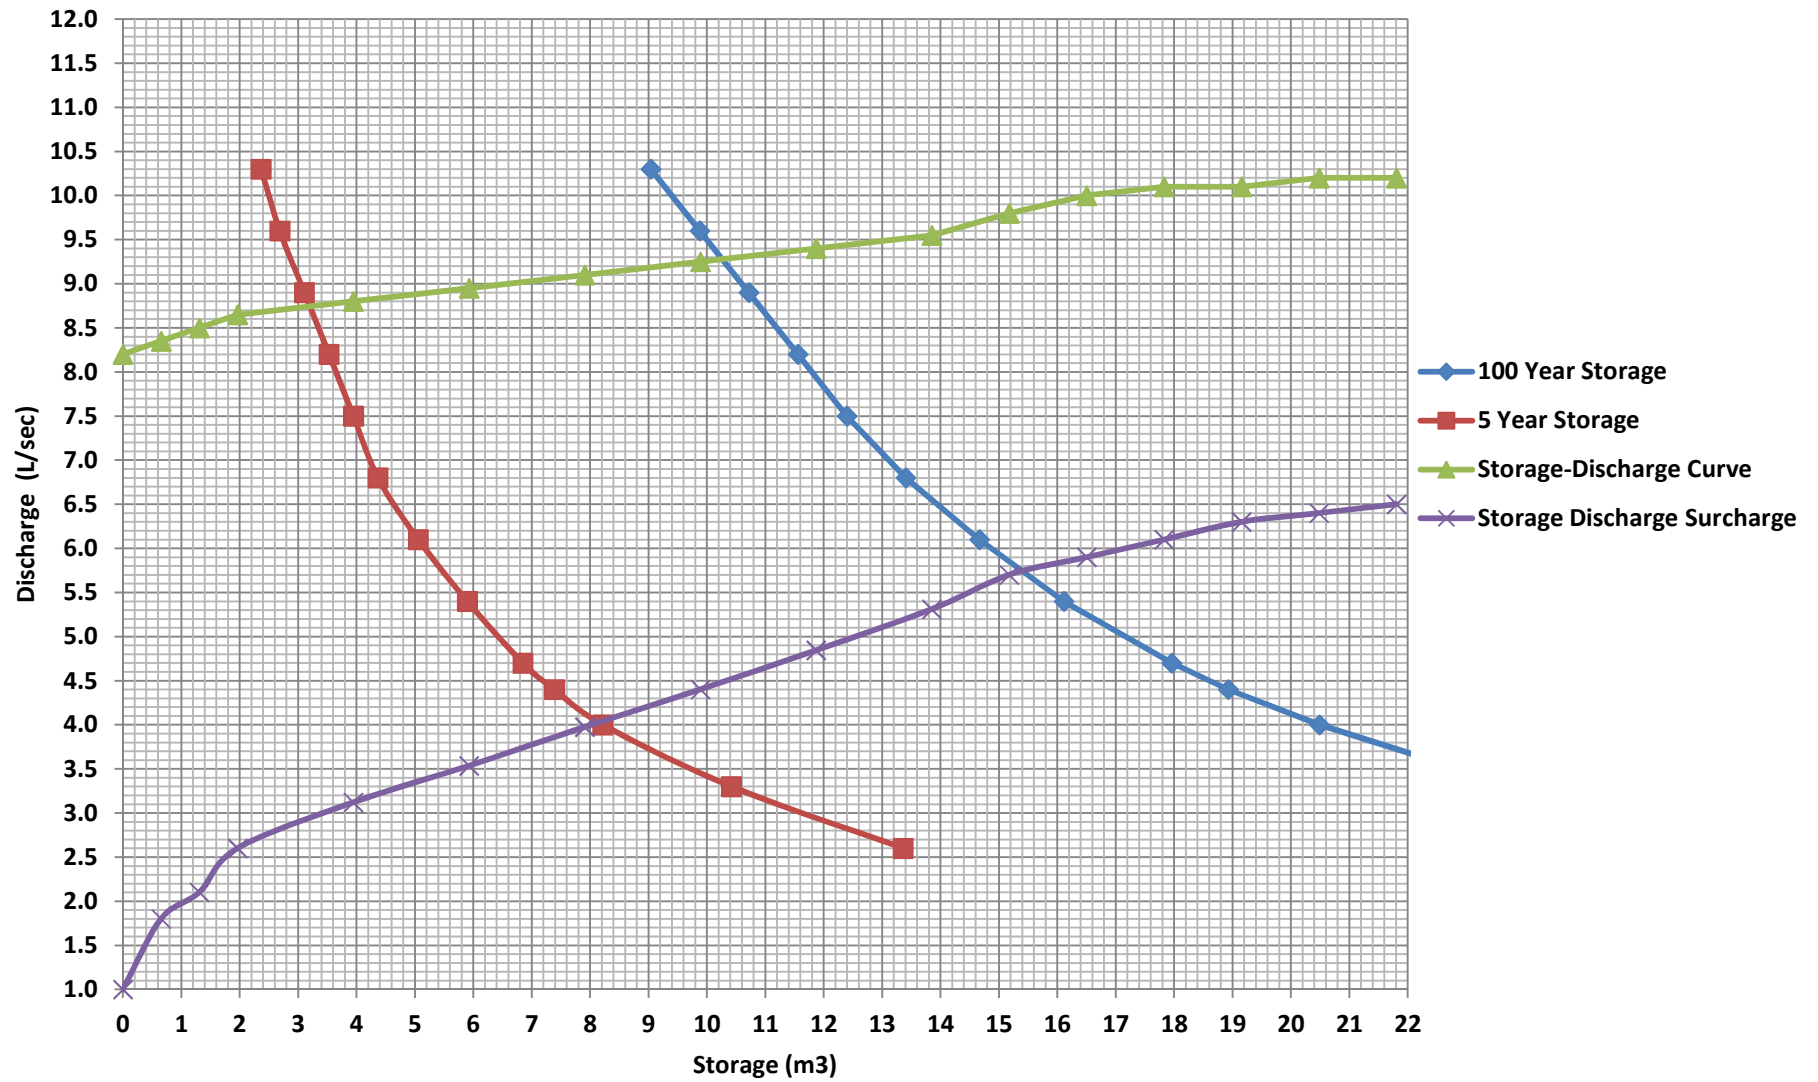

APPENDIX A: STORMWATER MANAGEMENT MODEL

Sheet 7 - Storm Sewer Design Sheet

Client: Building Investments Inc.
 Job No.: 180966
 Location: 841 Grenon Ave
 Date: January 8, 2020

Storm Sewer Design Sheet (5-yr storm)

LOCATION											
FROM	TO	Total Area (ha)	C 0.25	C 0.50	C 0.90	Actual R (°C)	INDIV 2.78 AR	ACCUM 2.78 AR	TIME OF CONC.	RAINFALL INTENSITY I	PEAK FLOW Q (l/s)
Storm Tank	STM-MH	0.075	0.0112	0.0000	0.064	0.80	0.17	0.17	10.00	104.19	17.52
ROOF	STM-MH	0.0649	0.000	0.000	0.0649	0.90	0.16	0.16	10.00	104.19	16.92

PROPOSED SEWER									Controlled /Uncontrolled	Controlled Flow	ICD
TYPE OF PIPE	PIPE SIZE (mm)	PIPE SLOPE (%)	LENGTH (m)	CAPACITY (l/s)	FULL FLOW VELOCITY (m/s)	TIME OF FLOW (min.)	EXCESS CAPACITY (l/s)	Q/Qfull		(L/s)	
PVC	200.00	1.00	45.0	32.83	1.04	0.72	15.31	0.53	Controlled	8.5	Hydrovex 100 SVHV
PVC	150.00	2.00	10.0	21.56	1.22	0.14	4.64	0.78	Controlled	2.5	WATTS
											RD-200-A-ADJ

Rainfall Intensity = $998.071 / (T + 6.053)^{-0.814}$ T = time in minutes
 (City of Ottawa, 5 year storm)



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix B: Product Information

- Hydrovex Selection Chart
- Roof Drain Selection
- Brentwood Storage Tanks



SVHV Vertical Vortex Flow Regulator


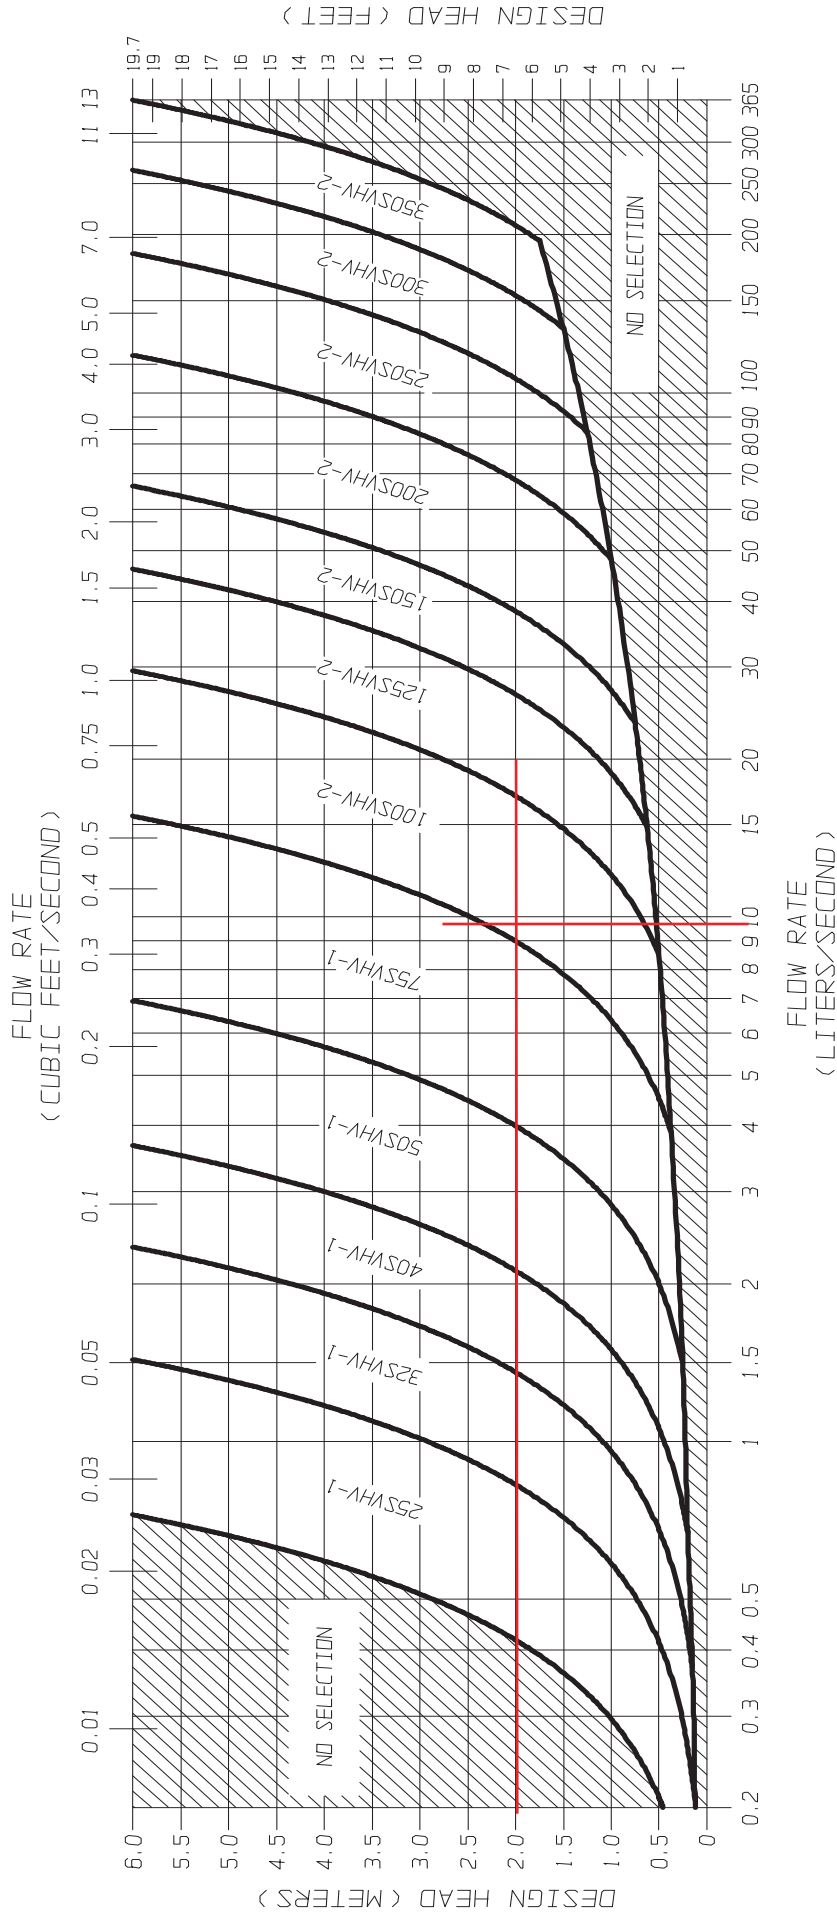


FIGURE 3 - SVHV

JOHN MEUNIER



HYDROVEX[®] VHV / SVHV **Vertical Vortex Flow Regulator**

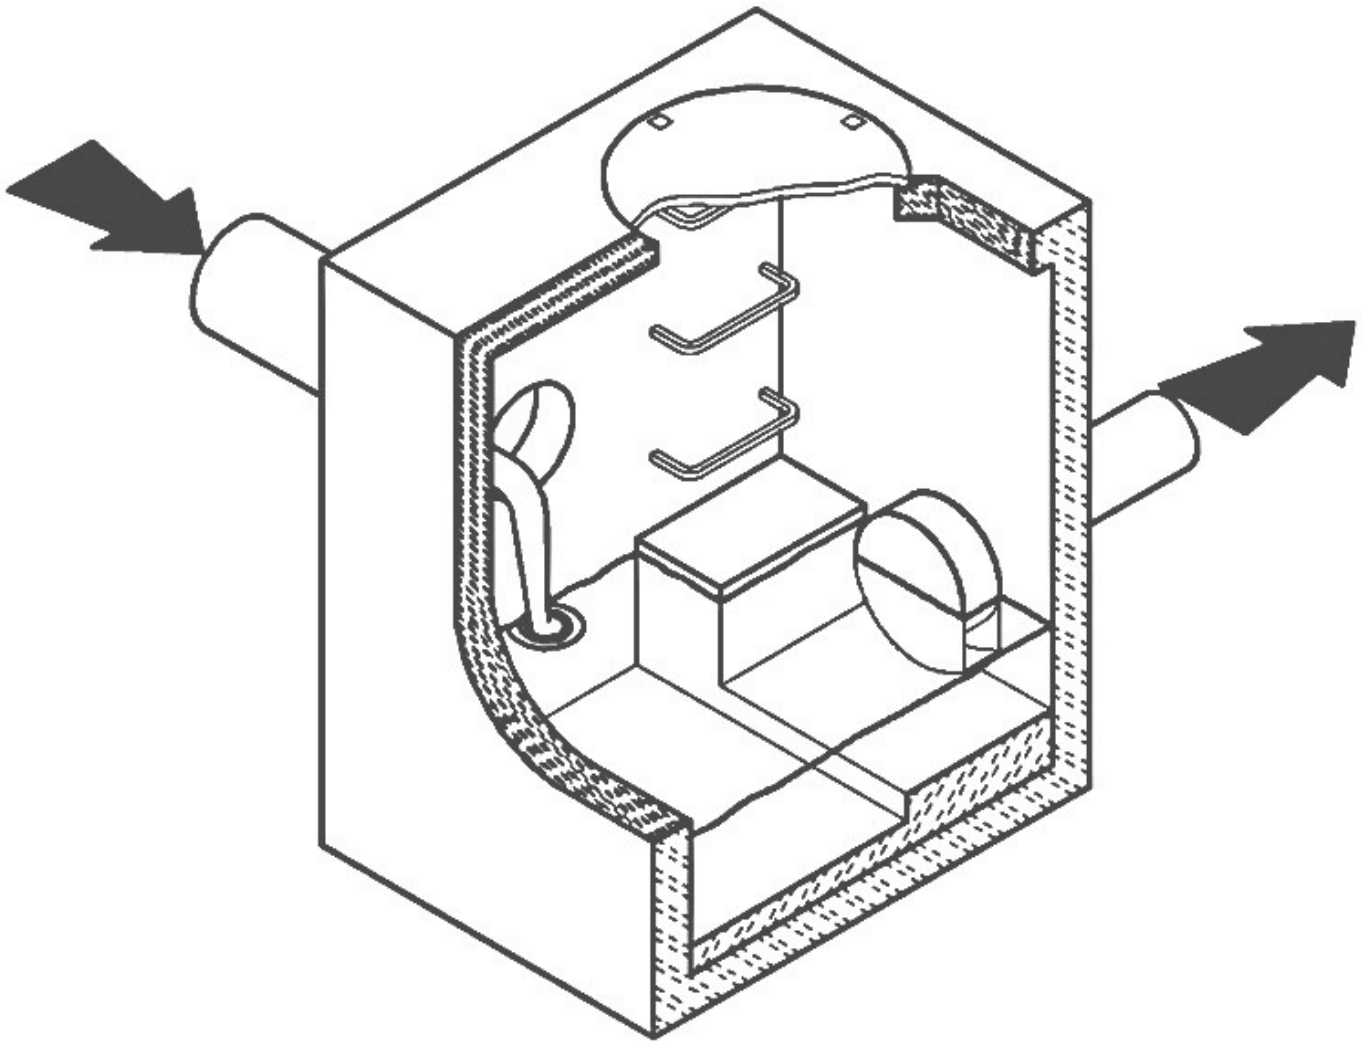

JOHN MEUNIER

HYDROVEX® VHV / SVHV VERTICAL VORTEX FLOW REGULATOR

APPLICATIONS


One of the major problems of urban wet weather flow management is the runoff generated after a heavy rainfall. During a storm, uncontrolled flows may overload the drainage system and cause flooding. Due to increased velocities, sewer pipe wear is increased dramatically and results in network deterioration. In a combined sewer system, the wastewater treatment plant may also experience significant increases in flows during storms, thereby losing its treatment efficiency.

A simple means of controlling excessive water runoff is by controlling excessive flows at their origin (manholes). **John Meunier Inc.** manufactures the **HYDROVEX® VHV / SVHV** line of vortex flow regulators to control stormwater flows in sewer networks, as well as manholes.


The vortex flow regulator design is based on the fluid mechanics principle of the forced vortex. This grants flow regulation without any moving parts, thus reducing maintenance. The operation of the regulator, depending on the upstream head and discharge, switches between orifice flow (gravity flow) and vortex flow. Although the concept is quite simple, over 12 years of research have been carried out in order to get a high performance.

The **HYDROVEX® VHV / SVHV** Vertical Vortex Flow Regulators (refer to **Figure 1**) are manufactured entirely of stainless steel, and consist of a hollow body (1) (in which flow control takes place) and an outlet orifice (7). Two rubber "O" rings (3) seal and retain the unit inside the outlet pipe. Two stainless steel retaining rings (4) are welded on the outlet sleeve to ensure that there is no shifting of the "O" rings during installation and use.

1. BODY
2. SLEEVE
3. O-RING
4. RETAINING RINGS
(SQUARE BAR)
5. ANCHOR PLATE
6. INLET
7. OUTLET ORIFICE

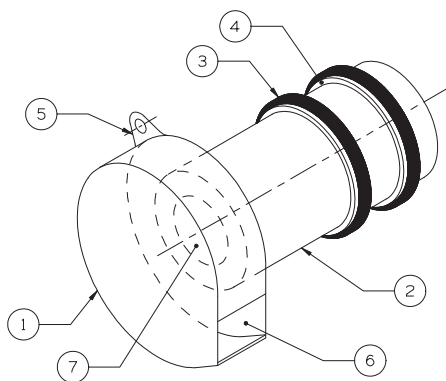

VHV

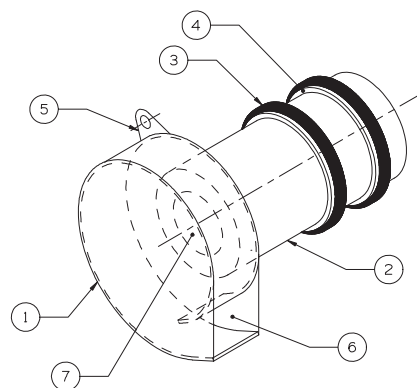

SVHV

FIGURE 1: HYDROVEX® VHV-SVHV VERTICAL VORTEX FLOW REGULATORS

ADVANTAGES

- The **HYDROVEX® VHV / SVHV** line of flow regulators are manufactured entirely of stainless steel, making them durable and corrosion resistant.
- Having no moving parts, they require minimal maintenance.
- The geometry of the **HYDROVEX® VHV / SVHV** flow regulators allows a control equal to an orifice plate, having a cross section area 4 to 6 times smaller. This decreases the chance of blockage of the regulator, due to sediments and debris found in stormwater flows. **Figure 2** illustrates the comparison between a regulator model 100 SVHV-2 and an equivalent orifice plate. One can see that for the same height of water, the regulator controls a flow approximately four times smaller than an equivalent orifice plate.
- Installation of the **HYDROVEX® VHV / SVHV** flow regulators is quick and straightforward and is performed after all civil works are completed.
- Installation requires no special tools or equipment and may be carried out by any contractor.
- Installation may be carried out in existing structures.

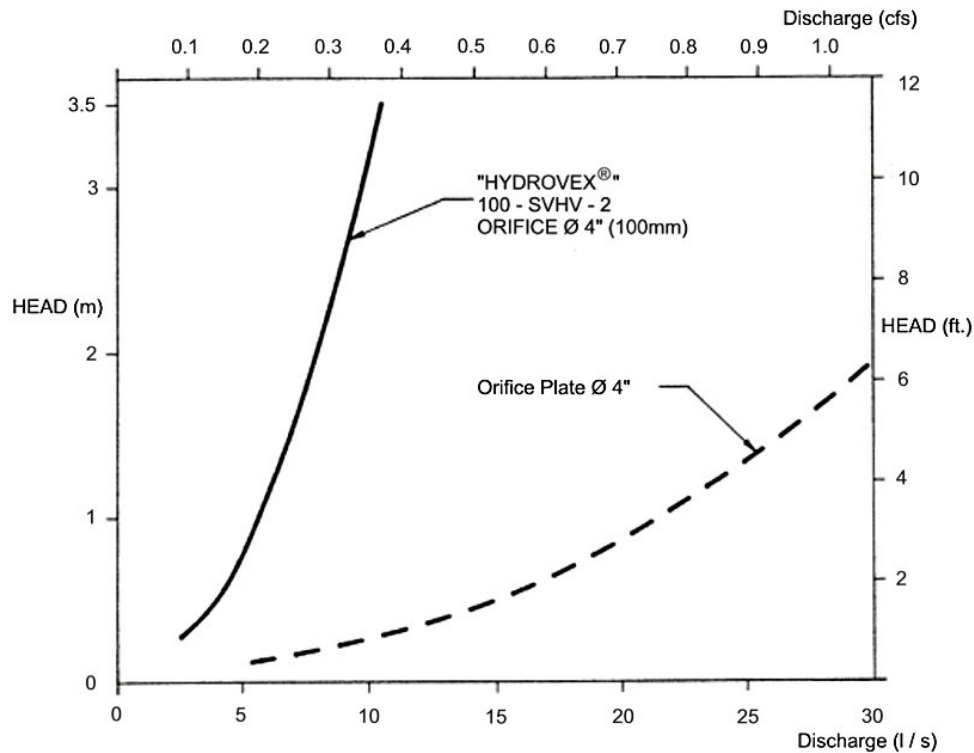


FIGURE 2: DISCHARGE CURVE SHOWING A HYDROVEX® FLOW REGULATOR VS AN ORIFICE PLATE

SELECTION

Selection of a **VHV** or **SVHV** regulator can be easily made using the selection charts found at the back of this brochure (see **Figure 3**). These charts are a graphical representation of the maximum upstream water pressure (head) and the maximum discharge at the manhole outlet. The maximum design head is the difference between the maximum upstream water level and the invert of the outlet pipe. All selections should be verified by John Meunier Inc. personnel prior to fabrication.

Example:

- ✓ Maximum design head 2m (6.56 ft.)
- ✓ Maximum discharge 6 L/s (0.2 cfs)
- ✓ Using **Figure 3** - VHV model required is a **75 VHV-1**

INSTALLATION REQUIREMENTS

All **HYDROVEX® VHV / SVHV** flow regulators can be installed in circular or square manholes. **Figure 4** gives the various minimum dimensions required for a given regulator. ***It is imperative to respect the minimum clearances shown to ensure easy installation and proper functioning of the regulator.***

SPECIFICATIONS

In order to specify a **HYDROVEX®** regulator, the following parameters must be defined:

- The model number (ex: 75-VHV-1)
- The diameter and type of outlet pipe (ex: 6" diam. SDR 35)
- The desired discharge (ex: 6 l/s or 0.21 CFS)
- The upstream head (ex: 2 m or 6.56 ft.) *
- The manhole diameter (ex: 36" diam.)
- The minimum clearance "H" (ex: 10 inches)
- The material type (ex: 304 s/s, 11 Ga. standard)

* *Upstream head is defined as the difference in elevation between the maximum upstream water level and the invert of the outlet pipe where the **HYDROVEX®** flow regulator is to be installed.*

PLEASE NOTE THAT WHEN REQUESTING A PROPOSAL, WE SIMPLY REQUIRE THAT YOU PROVIDE US WITH THE FOLLOWING:

- *project design flow rate*
- *pressure head*
- *chamber's outlet pipe diameter and type*



Typical VHV model in factory


OPTIONS



VHV-1-O (standard model with odour control inlet)



FV – SVHV (mounted on sliding plate)

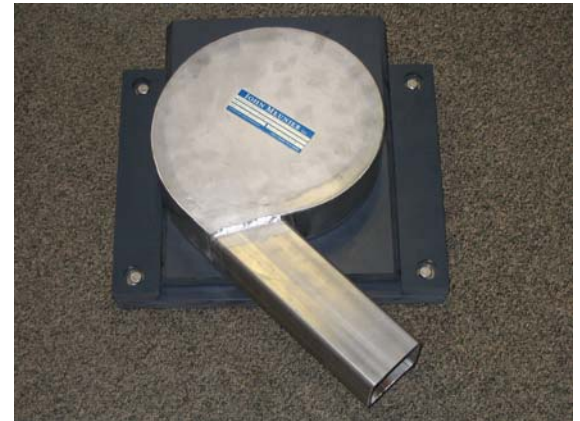

FV – VHV-O (mounted on sliding plate with odour control inlet)



VHV with Gooseneck assembly in existing chamber without minimum release at the bottom



VHV with air vent for minimal slopes



VHV Vertical Vortex Flow Regulator

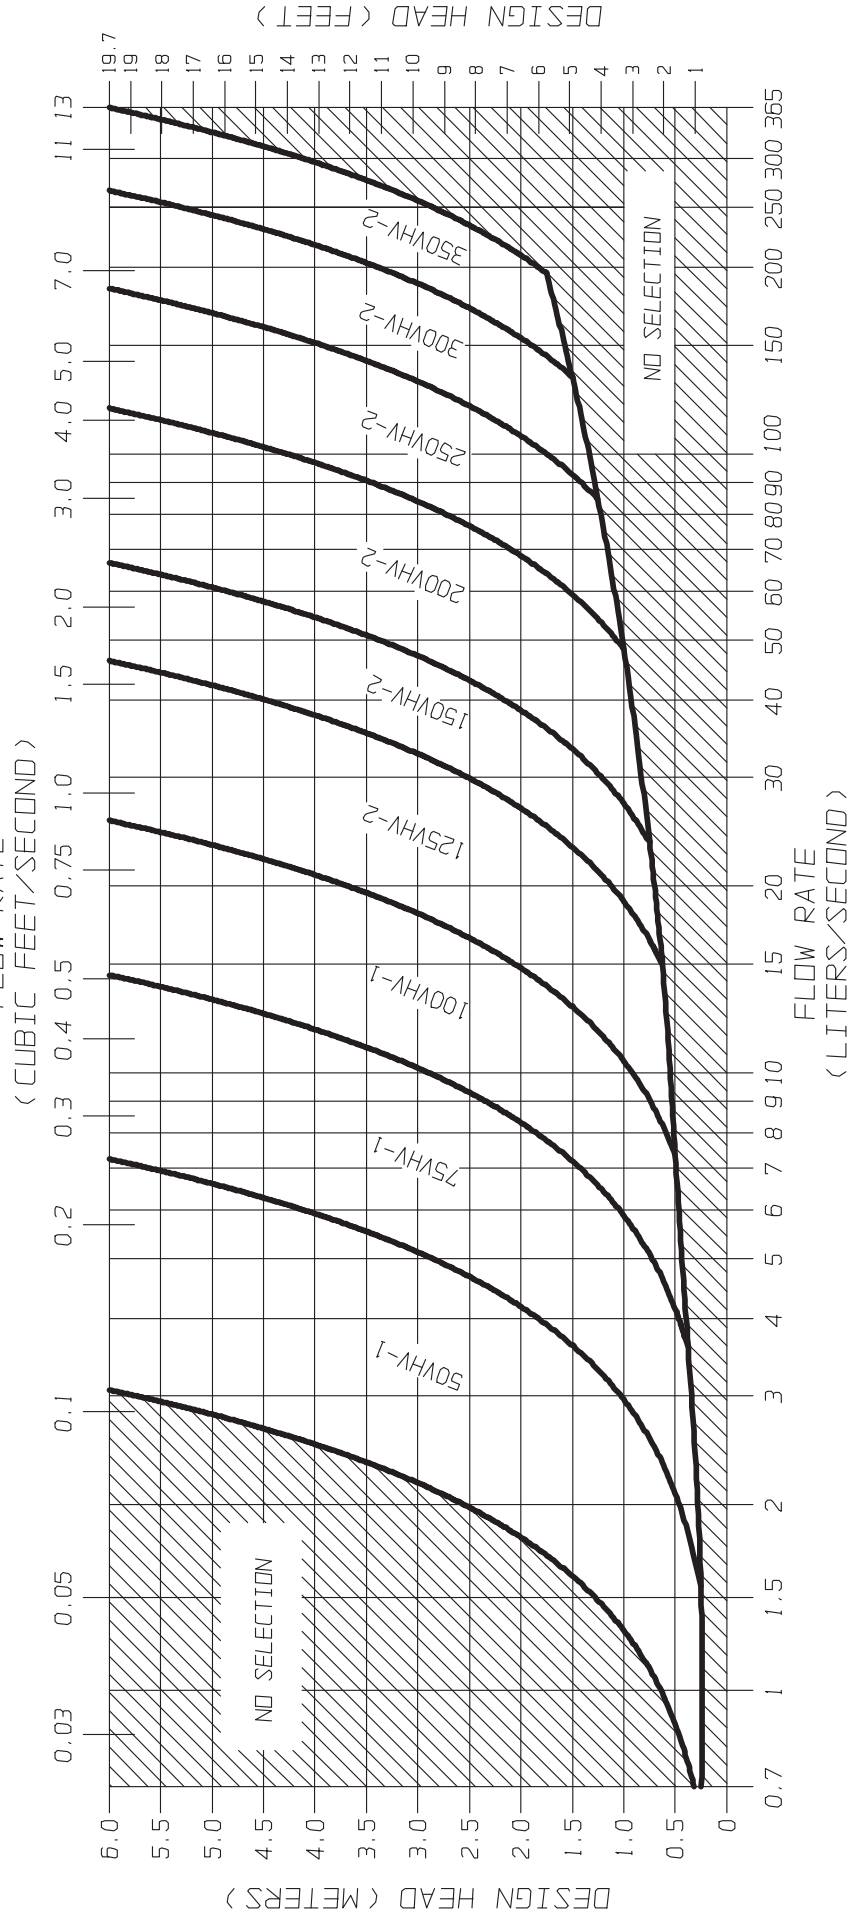


FIGURE 3 - VHV

JOHN MEUNIER



SVHV Vertical Vortex Flow Regulator


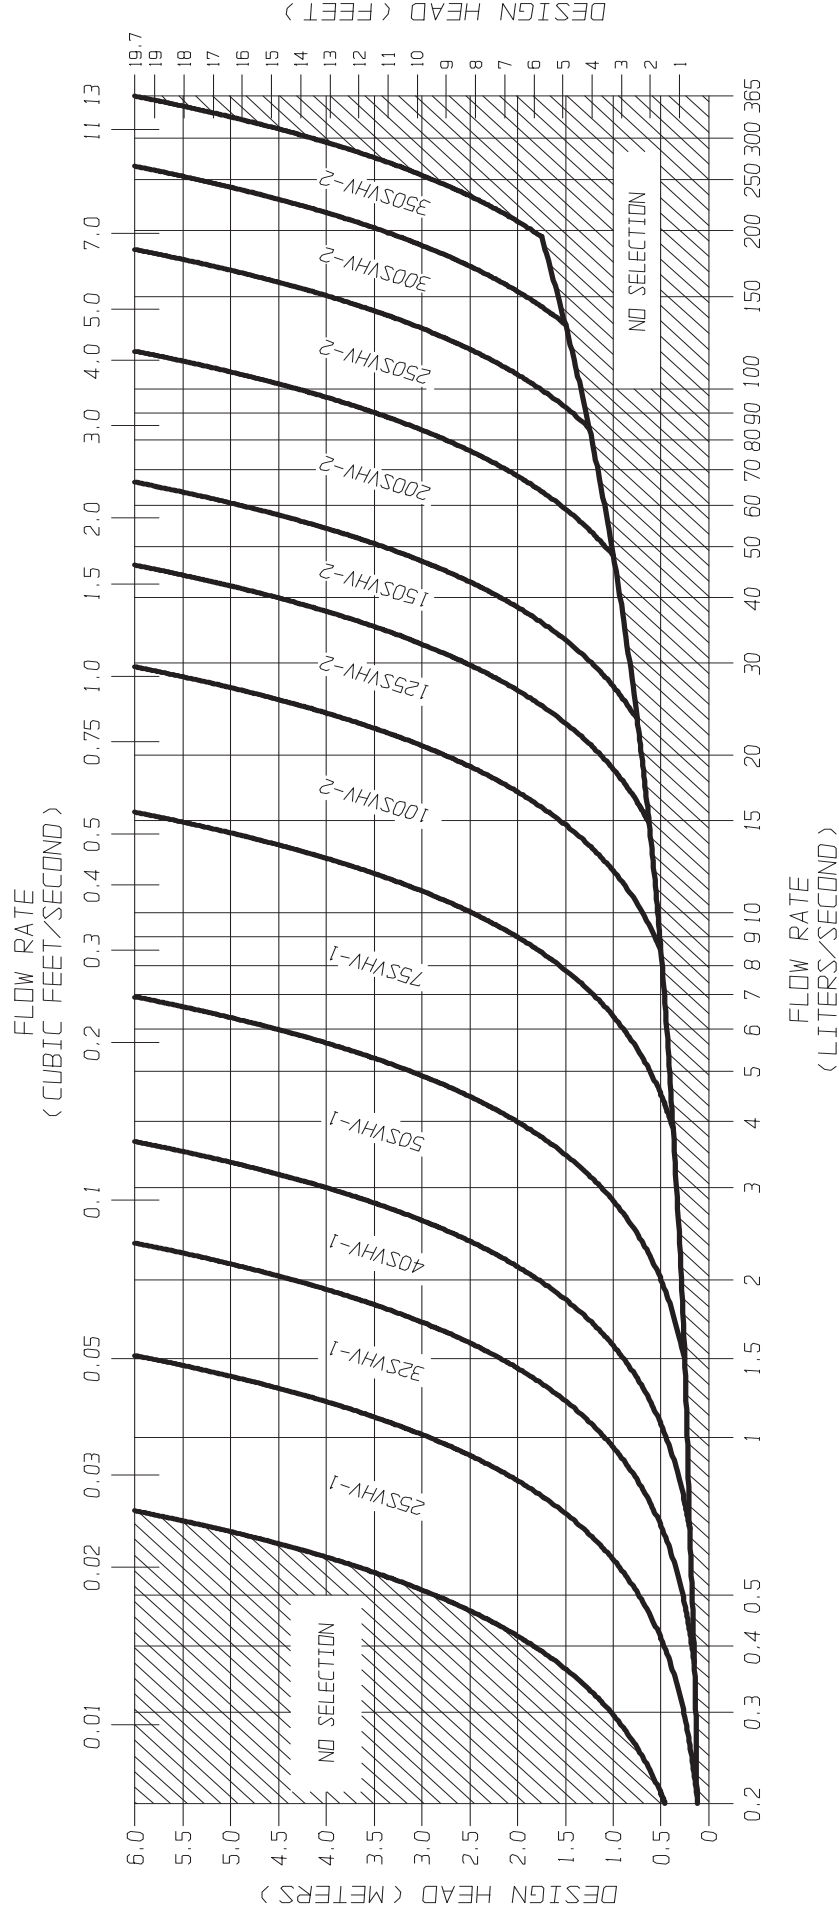


FIGURE 3 - SVHV

JOHN MEUNIER



FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL VHV)

Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	900	36	150	6	200	8
125VHV-2	275	11	900	36	150	6	200	8
150VHV-2	350	14	900	36	150	6	225	9
200VHV-2	450	18	1200	48	200	8	300	12
250VHV-2	575	23	1200	48	250	10	350	14
300VHV-2	675	27	1600	64	250	10	400	16
350VHV-2	800	32	1800	72	300	12	500	20

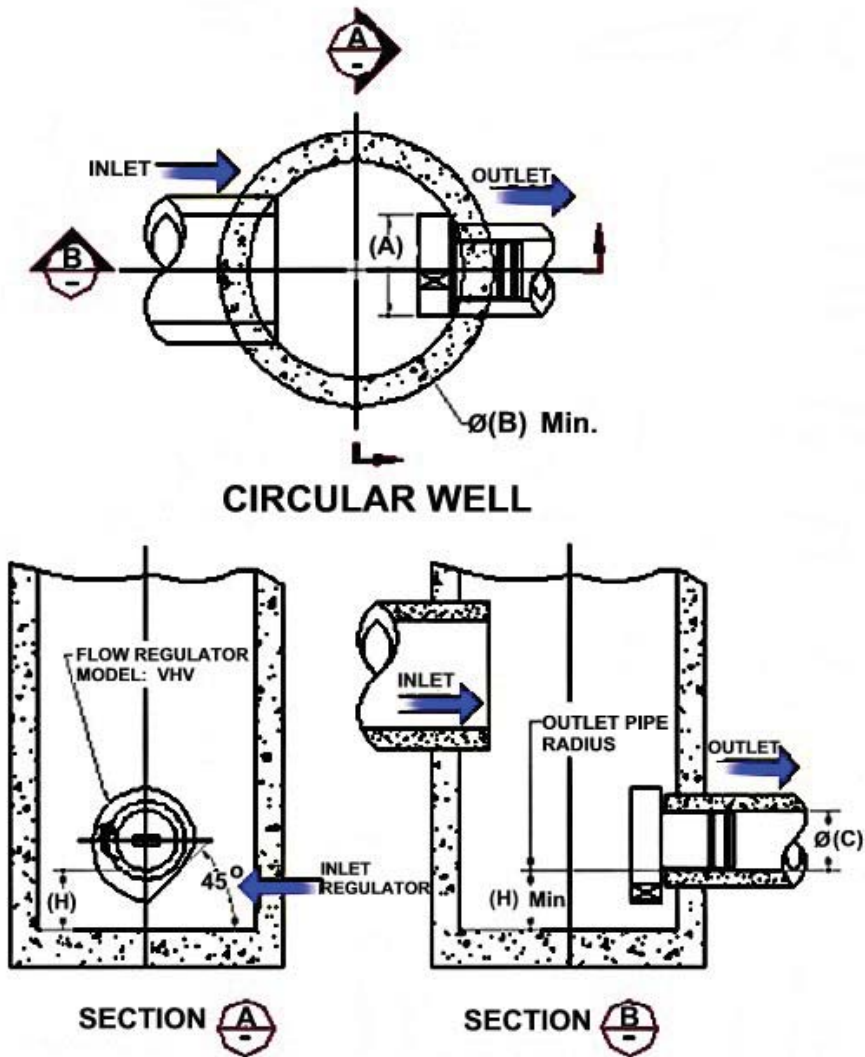

FLOW REGULATOR TYPICAL INSTALLATION IN CIRCULAR MANHOLE
FIGURE 4 (MODEL SVHV)


Model Number	Regulator Diameter		Minimum Manhole Diameter		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150	6	150	6
75 SVHV-1	375	15	900	36	150	6	275	11
100 SVHV-2	275	11	900	36	150	6	250	10
125 SVHV-2	350	14	900	36	150	6	300	12
150 SVHV-2	425	17	1200	48	150	6	350	14
200 SVHV-2	575	23	1600	64	200	8	450	18
250 SVHV-2	700	28	1800	72	250	10	550	22
300 SVHV-2	850	34	2400	96	250	10	650	26
350 SVHV-2	1000	40	2400	96	250	10	700	28

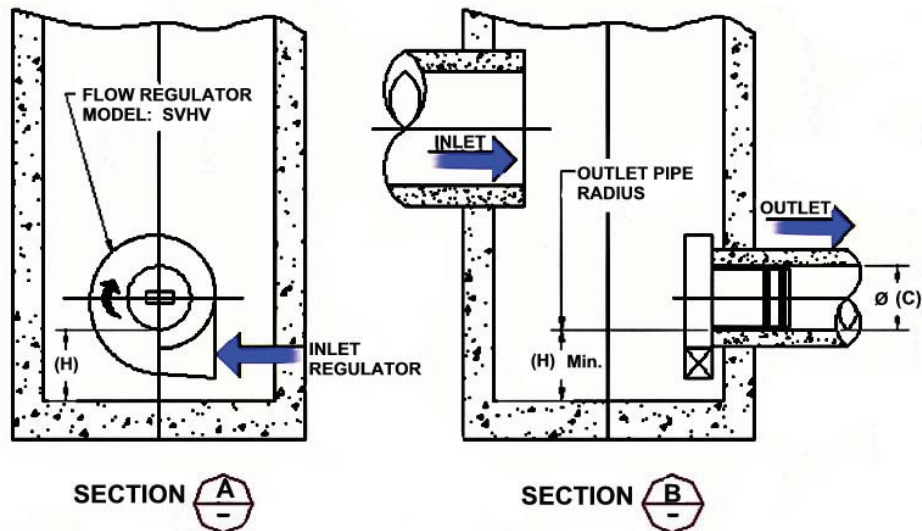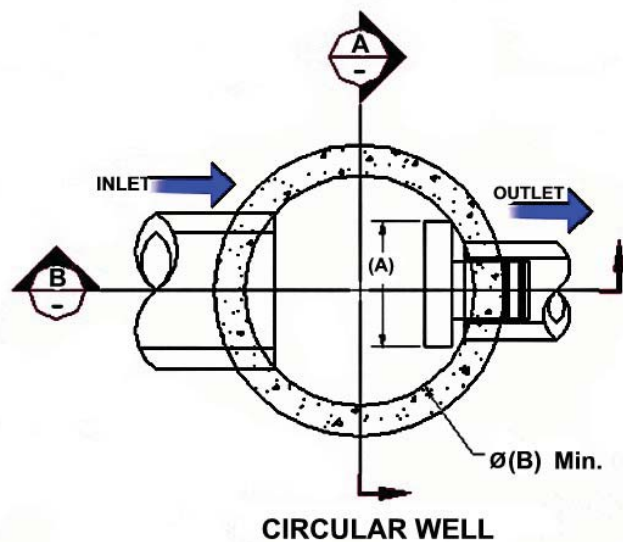


FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL VHV)

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
50VHV-1	150	6	600	24	150	6	150	6
75VHV-1	250	10	600	24	150	6	150	6
100VHV-1	325	13	600	24	150	6	200	8
125VHV-2	275	11	600	24	150	6	200	8
150VHV-2	350	14	600	24	150	6	225	9
200VHV-2	450	18	900	36	200	8	300	12
250VHV-2	575	23	900	36	250	10	350	14
300VHV-2	675	27	1200	48	250	10	400	16
350VHV-2	800	32	1200	48	300	12	500	20

NOTE: *In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.*

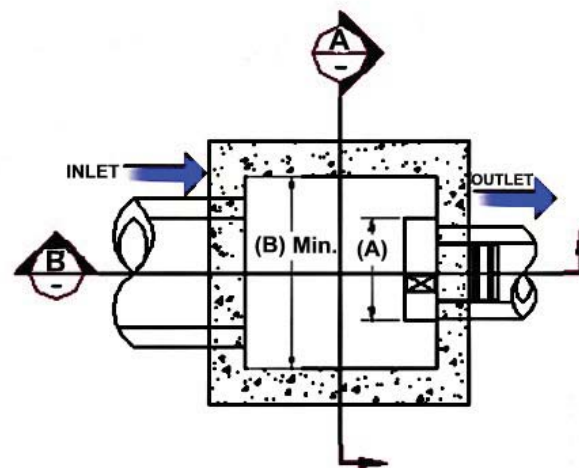


SQUARE / RECTANGULAR WELL

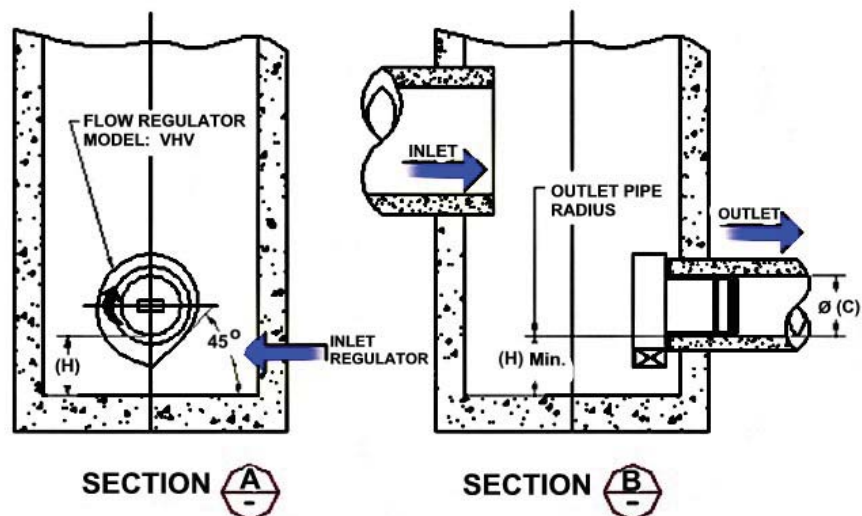


FLOW REGULATOR TYPICAL INSTALLATION IN SQUARE MANHOLE
FIGURE 4 (MODEL SVHV)

Model Number	Regulator Diameter		Minimum Chamber Width		Minimum Outlet Pipe Diameter		Minimum Clearance	
	A (mm)	A (in.)	B (mm)	B (in.)	C (mm)	C (in.)	H (mm)	H (in.)
25 SVHV-1	125	5	600	24	150	6	150	6
32 SVHV-1	150	6	600	24	150	6	150	6
40 SVHV-1	200	8	600	24	150	6	150	6
50 SVHV-1	250	10	600	24	150	6	150	6
75 SVHV-1	375	15	600	24	150	6	275	11
100 SVHV-2	275	11	600	24	150	6	250	10
125 SVHV-2	350	14	600	24	150	6	300	12
150 SVHV-2	425	17	600	24	150	6	350	14
200 SVHV-2	575	23	900	36	200	8	450	18
250 SVHV-2	700	28	900	36	250	10	550	22
300 SVHV-2	850	34	1200	48	250	10	650	26
350 SVHV-2	1000	40	1200	48	250	10	700	28


NOTE: *In the case of a square manhole, the outlet flow pipe must be centered on the wall to ensure enough clearance for the unit.*

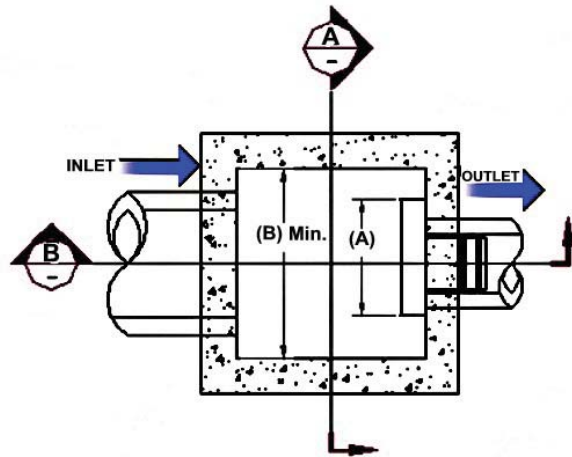

SQUARE / RECTANGULAR WELL

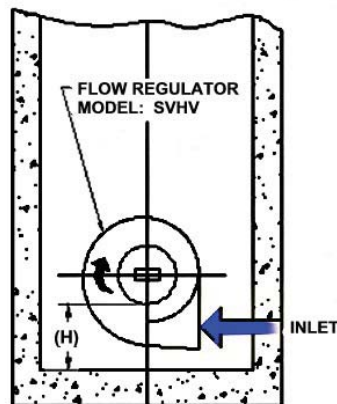

SECTION A

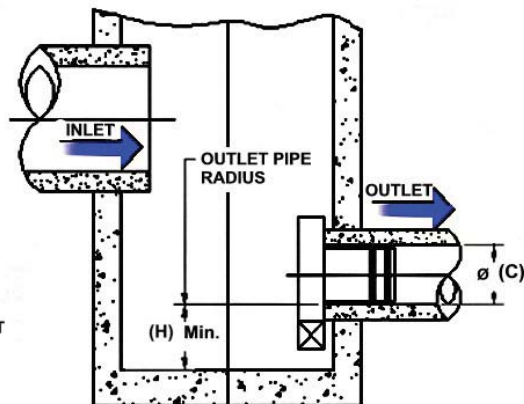

SECTION B

INSTALLATION

The installation of a **HYDROVEX®** regulator may be undertaken once the manhole and piping is in place. Installation consists of simply fitting the regulator into the outlet pipe of the manhole. **John Meunier Inc.** recommends the use of a lubricant on the outlet pipe, in order to facilitate the insertion and orientation of the flow controller.

MAINTENANCE

HYDROVEX® regulators are manufactured in such a way as to be maintenance free; however, a periodic inspection (every 3-6 months) is suggested in order to ensure that neither the inlet nor the outlet has become blocked with debris. The manhole should undergo periodically, particularly after major storms, inspection and cleaning as established by the municipality

GUARANTY

The **HYDROVEX®** line of **VHV / SVHV** regulators are guaranteed against both design and manufacturing defects for a period of 5 years. Should a unit be defective, **John Meunier Inc.** is solely responsible for either modification or replacement of the unit.

John Meunier Inc.

ISO 9001 : 2008

Head Office

4105 Sartelon
Saint-Laurent (Quebec) Canada H4S 2B3
Tel.: 514-334-7230 www.johnmeunier.com
Fax: 514-334-5070 cs@johnmeunier.com

Ontario Office

2000 Argentia Road, Plaza 4, Unit 430
Mississauga (Ontario) Canada L5N 1W1
Tel.: 905-286-4846 www.johnmeunier.com
Fax: 905-286-0488 ontario@johnmeunier.com

USA Office

2209 Menlo Avenue
Glenside, PA USA 19038
Tel.: 412-417-6614 www.johnmeunier.com
Fax: 215-885-4741 aste@johnmeunier.com





Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control for Roof Drains

ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)



For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.

Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
[5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

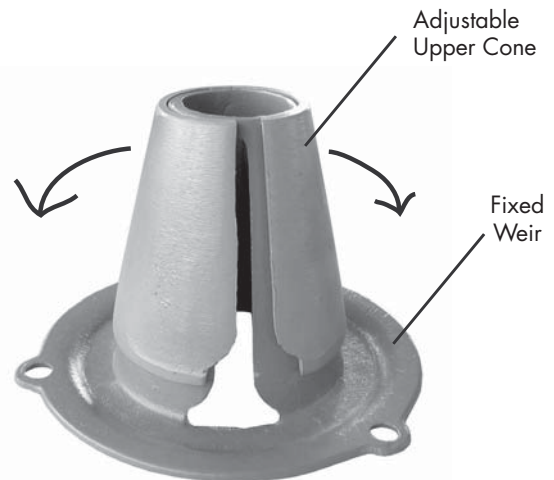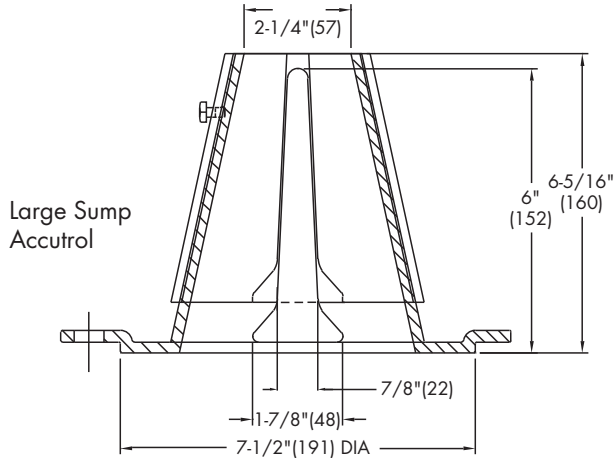

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____

Contractor _____

Job Location _____

Contractor's P.O. No. _____

Engineer _____

Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com

Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca

Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com




A Watts Water Technologies Company

**RD-200**

Tag: _____

Small Sump Roof Drain**Components:****B3****B3-FLG****B3-DM****FC-2**

SPECIFICATION: Watts Drainage Products RD-200 epoxy coated cast iron small sump roof drain with wide serrated flashing flange, flashing clamp device with integral gravel stop and selflocking polyethylene (standard) dome strainer.

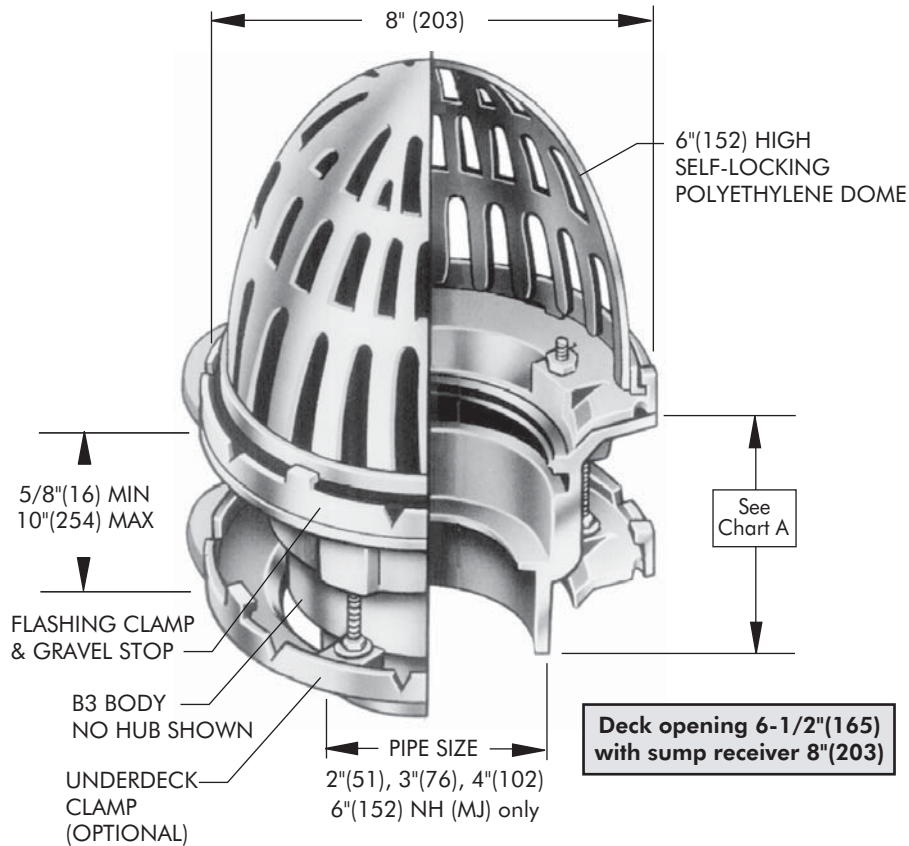**Chart A**

Free Area Sq. In.		Std.	P	T	X	60/61
	Pipe Size	No Hub	Push On	Female Thread	Inside Caulk	PVC/ ABS
35	2"(51)	3-5/8"(92)	4-1/4"(108)	4-1/4"(108)	4-1/2"(114)	3-3/4"(95)
	3"(76)	3-5/8"(92)	4-1/4"(108)	4-1/4"(108)	4-1/2"(114)	3-3/4"(95)
	4"(102)	3-5/8"(92)	4-1/4"(108)	4-1/4"(108)	4-1/2"(114)	4"(102)
	6"(152)	3-1/2"(89)				

* Underdeck Clamp (-BED and -D options) only available in 2"(51), 3"(76), 4"(102) pipe sizes.

** Side Outlet (-SO) option only available in 2"(51), 3"(76), 4"(102) pipe sizes.
Underdeck Clamp (-BED and -D options) are not available when -SO is selected.

Order Code: RD-200 ☐ ☐ - ☐ ☐**Ex. RD-202P-K****Pipe Sizing (Select One)**

Suffix	Description	
2	2"(51) Pipe Size	<input type="checkbox"/>
3	3"(76) Pipe Size	<input type="checkbox"/>
4	4"(102) Pipe Size	<input type="checkbox"/>
6	6"(152) Pipe Size	<input type="checkbox"/>

Outlet Type (Select One)

Suffix	Description	
NH	No Hub (MJ)	<input type="checkbox"/>
P	Push On	<input type="checkbox"/>
T	Threaded Outlet	<input type="checkbox"/>
X	Inside Caulk	<input type="checkbox"/>

Options (Select One or More)

Suffix	Description	
-A	Accutrol weir (specify #1-6 slots)	<input type="checkbox"/>
-B	Sump Receiver Flange	<input type="checkbox"/>
-BED	Sump Receiver, Adj. Ext., Deck Clamp*	<input type="checkbox"/>
-C	Secondary Membrane Clamp	<input type="checkbox"/>
-D	Underdeck Clamp*	<input type="checkbox"/>
-E	Adjustable Extension	<input type="checkbox"/>
-GSS	Stainless Steel Ballast Guard	<input type="checkbox"/>
-K	Ductile Iron Dome	<input type="checkbox"/>
-K80	Aluminum Dome	<input type="checkbox"/>
-L	Vandal Resistant Dome	<input type="checkbox"/>
-R	2" High External Water Dam	<input type="checkbox"/>
-SO	Side Outlet**	<input type="checkbox"/>
-W	Adj. Water Level Regulator	<input type="checkbox"/>
-W-1	Waterproofing Flange	<input type="checkbox"/>
-Z	Extended Integral Wide Flange	<input type="checkbox"/>
-5	Sediment Bucket	<input type="checkbox"/>
-12	Galvanized Dome	<input type="checkbox"/>
-13	All Galvanized	<input type="checkbox"/>
-83	Mesh Covered Dome	<input type="checkbox"/>
-113M	Special Epoxy from 3M Range	<input type="checkbox"/>

Optional Body Material (NH Only)

Suffix	Description	
-60	PVC Body w/Socket Outlet	<input type="checkbox"/>
-61	ABS Body w/Socket Outlet	<input type="checkbox"/>

Job Name _____ Contractor _____



Job Location _____ Contractor's P.O. No. _____

Engineer _____ Representative _____

WATTS Drainage reserves the right to modify or change product design or construction without prior notice and without incurring any obligation to make similar changes and modifications to products previously or subsequently sold. See your WATTS Drainage representative for any clarification. Dimensions are subject to manufacturing tolerances.

CANADA: 5435 North Service Road, Burlington, ON, L7L 5H7 TEL: 905-332-6718 TOLL-FREE: 1-888-208-8927 Website: www.wattsdrainage.ca

© Watts Drainage 2004

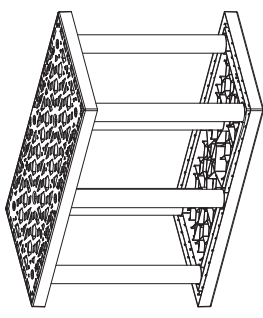
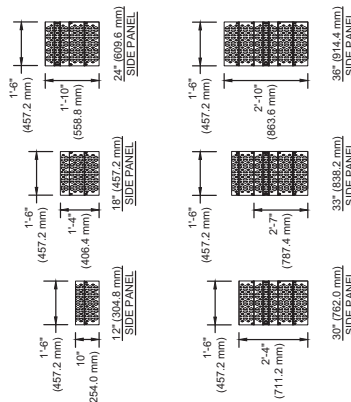


NOTES:
 1. SIDE PANELS TO BE INSTALLED ALONG SYSTEM PERIMETER, UNLESS OTHERWISE SPECIFIED.
 2. ALL HEIGHTS TO BE CUT FROM A 36" (914.4 mm) SIDE PANEL AT PRE-SCRIBED LOCATIONS, EXCEPT 33" (838.2 mm) & 12" (304.8 mm) SIDE PANEL.

SIDE PANEL DETAIL

STORMTANK® MODULE				
NAME	HEIGHT (mm)	CAPACITY (m ³)	VOID RATIO	NOMINAL WEIGHT (kg)
ST-12	12" (304.8)	4.22 cf (0.1194)	93.70%	17.56 lbs. (7.965)
ST-18	18" (457.2)	6.44 cf (0.1824)	95.50%	22.70 lbs. (10.29)
ST-24	24" (609.6)	8.66 cf (0.2452)	96.00%	26.30 lbs. (11.92)
ST-30	30" (762.0)	10.88 cf (0.3081)	96.50%	29.50 lbs. (13.38)
ST-33	33" (838.2)	11.99 cf (0.3395)	96.90%	29.82 lbs. (13.53)
ST-36	36" (914.4)	13.10 cf (0.3710)	97.00%	33.10 lbs. (15.01)

MODULE DETAIL

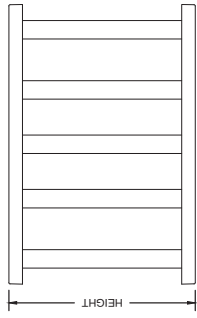

- NOTES:
- REFERENCE CURRENT INSTALLATION INSTRUCTIONS FOR PROPER ASSEMBLY AND INSTALLATION PRACTICES.
 - SIDE PANELS REQUIRED AROUND THE PERIMETER OF THE INSTALLATION ONLY, UNLESS OTHERWISE NOTED.
 - SIDE PANELS ARE TO BE CUT FROM A 36" PANEL AT THE PRE-SCRIBED LOCATIONS.

D 2/17/17		ST-12 MODULE ADDED, METRIC DIMENSIONS UPDATED		CGB
C 9/12/13		NOTE REVISION, FORMATTING UPDATE & DWG. NO. UPDATE		JKB
B 9/11/12		FORMATTING & DWG. NO. UPDATE		JKB
A 4/5/12		INITIAL RELEASE		PK
REV	DATE	RECORD OF CHANGES		BY
		This is the property of Brentwood Industries, Inc. It may not be reproduced or used for any purpose other than those expressly authorized by Brentwood Industries. It shall be returned immediately upon request of Brentwood Industries.		


BRENTWOOD
 610 Morgantown Road
 Reading, PA 19811 U.S.A.
 Phone: (610) 374-5109
 www.brentwoodindustries.com

STORMTANK
 MODULE


Project Name
 MODULE DETAIL

Title

Drawn by
 B. LINE
 Date
 4/5/12
 Sheet
 1 of 2
 NTS

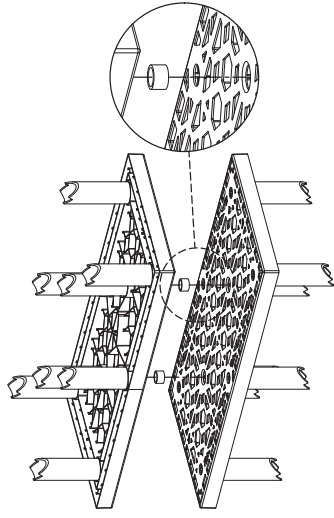

STACKING PIN DETAIL

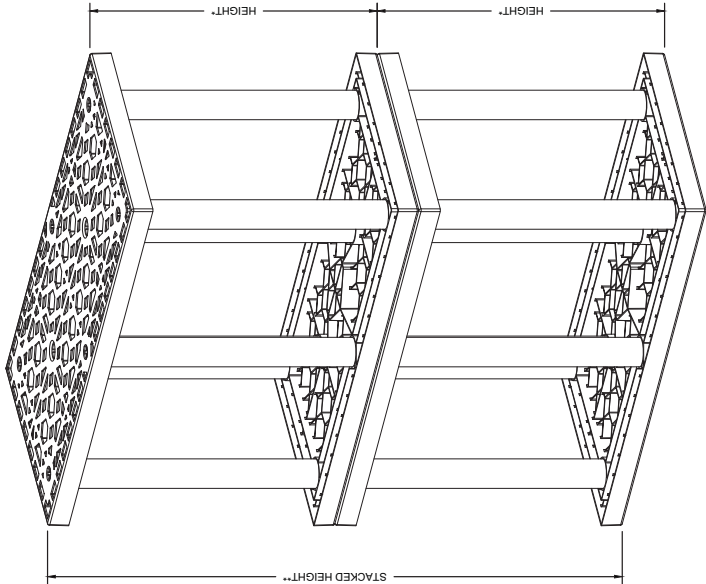

MODULE DOUBLE STACK DETAIL

DOUBLE STACK CONFIGURATIONS:						
SYSTEM HEIGHT (mm)	ST-18	ST-24	ST-30	ST-33	ST-36	CAPACITY (m ³)
42" (1,067)	1	1	-	-	-	15.08 cf (0.4270)
48" (1,219)	1	-	1	-	-	17.30 cf (0.4899)
51" (1,295)	1	-	-	1	-	18.42 cf (0.5216)
54" (1,372)	1	-	-	-	1	19.50 cf (0.5522)
57" (1,448)	-	1	-	1	-	20.64 cf (0.5845)
60" (1,524)	-	1	-	-	1	21.75 cf (0.6159)
63" (1,600)	-	-	1	1	-	22.86 cf (0.6473)
66" (1,676)	-	-	-	2	-	23.97 cf (0.6788)
69" (1,753)	-	-	-	1	1	25.08 cf (0.7101)
72" (1,829)	-	-	-	-	2	26.20 cf (0.7419)

- NOTES:
- REFERENCE CURRENT INSTALLATION INSTRUCTIONS FOR PROPER ASSEMBLY AND INSTALLATION PRACTICES.
 - STACKING PINS REQUIRED BETWEEN MODULE LAYERS. FOR ALL STACKED SYSTEMS (SEE DETAIL).

D	2/17/17	ST-12 MODULE ADDED, METRIC DIMENSIONS UPDATED	CGB	
C	9/12/13	NOTE REVISION, FORMATTING UPDATE & DWG. NO. UPDATE	JKB	
B	9/11/12	FORMATTING & DWG. NO. UPDATE	JKB	PK
A	4/5/12	INITIAL RELEASE	ELL	PK
REV	DATE	RECORD OF CHANGES	BY	APPROV.
This is the property of Brentwood Industries, Inc. It may not be reproduced or used for any purpose other than those expressly authorized by Brentwood Industries. It shall be returned immediately upon request of Brentwood Industries.				

BRENTWOOD
 610 Morgantown Road
 Reading, PA 19811 U.S.A.
 Phone: (610) 374-5109
 www.brentwoodindustries.com

Project Name	MODULE DOUBLE STACK DETAIL
Title	
Drawn by	DATE
CHECKED BY	DATE
DATE	DATE
Sheet	2 of 2
NTS	

STORMTANK
 MODULE

STEP 1:


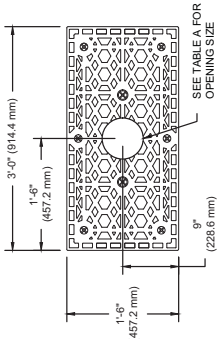


TABLE A: OBSERVATION PORT DIMENSION		
PORT SIZE	OPEN SIZE	RISE PIPE DIA.
6"	7" (177.8 mm)	6" (152.4 mm)
8"	9" (228.6 mm)	8" (203.2 mm)
10"	11" (279.4 mm)	10" (254.0 mm)


LAYOUT & CUT OPENING INTO THE CENTER OF THE TOP PLATEN FOR BRENTWOOD OBSERVATION PORT.

STEP 4:




MARK & CUT FLANGE PLATE FLUSH WITH MODULE SIDE WHEN MODULE IS ON THE PERIMETER OF THE SYSTEM.

STEP 2:

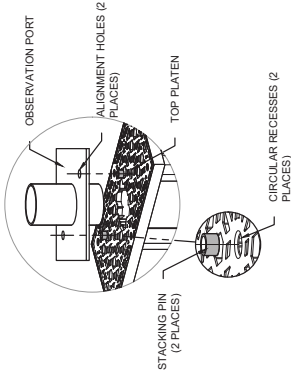


ALIGN PORT PLATE WITH TOP PANEL. INSERT THE TOP PLATEN INTO THE CIRCULAR RECESSES IN THE TOP PLATE OF THE STORMTANK MODULE. INSERT THE SHORT SIDE OF THE PORT PIPE STUB INTO THE PLATEN ALIGNING THE PORT PLATE ALIGNMENT HOLES WITH THE STACKING PINS.

STEP 5:

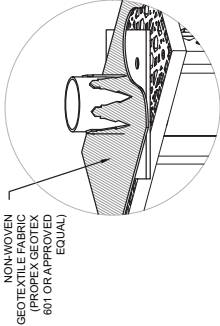


INSTALL GEOTEXTILE. WRAP SPECIFIED GEOTEXTILE FABRIC AROUND ENTIRE INSTALLATION OF STORMTANK MODULES. CUT "X" PATTERN INTO GEOTEXTILE FABRIC AT OBSERVATION PORT AND PEEL EDGES OUT.

STEP 3:



STEP 6:



NOTES:
a. REFERENCE CURRENT INSTALLATION INSTRUCTIONS FOR PROPER INSTALLATION PRACTICES.



610 Morgantown Road
Reading, PA 19811 U.S.A.
Phone: (610) 374-5109
www.brentwoodindustries.com

F	2/17/17	METRIC DIMENSIONS UPDATED	COB
E	11/10/14	GEOTEXTILE PRODUCT SPECIFIED	COB
D	9/9/13	UPDATED DRAWING FORMAT	JAB
C	9/7/12	UPDATED DRAWING FORMAT	BLL PK
B	3/27/12	REMOVE 6" DIA. PORT CALLOUT	BLL PK
A	1/11/12	INITIAL RELEASE	BLL PK
REV	DATE	RECORD OF CHANGES	BY
This is the property of Brentwood Industries, Inc. It may not be reproduced or used for any purpose other than those expressly authorized by Brentwood Industries. It shall be returned immediately upon request of Brentwood Industries.			

Project Name: **OBSERVATION PORT INSTALLATION DETAIL**
Title: **DETAIL**

STORMTANK
MODULE

Drawn By: **BLINE**
Checked By: **NTS**
Scale: **1 of 1**
Date: **1/11/12**
Sheet: **NTS**



Contents

1.0	Introduction
2.0	Product Information
3.0	Manufacturing Standards
4.0	Structural Response
5.0	Foundation
6.0	System Materials
7.0	Connections
8.0	Pretreatment
9.0	Additional Considerations
10.0	Inspection & Maintenance
11.0	System Sizing
12.0	Detail Drawings
13.0	Specifications
14.0	Appendix – Bearing Capacity Tables

General Notes

1. Brentwood recommends that the installing contractor contact either Brentwood or the local distributor prior to installation of the system to schedule a pre-construction meeting. This meeting will ensure that the installing contractor has a firm understanding of the installation instructions.
2. All systems must be designed and installed to meet or exceed Brentwood's minimum requirements. Although Brentwood offers support during the design, review, and construction phases of the Module system, it is the ultimate responsibility of the Engineer of Record to design the system in full compliance with all applicable engineering practices, laws, and regulations.
3. Brentwood requires a minimum cover of 24" (610 mm) and/or a maximum Module invert of 11' (3.35 m). Additionally, a minimum 6" (152 mm) leveling bed, 12" (305 mm) side backfill, and 12" (305 mm) top backfill are required on every system.
4. Brentwood recommends a minimum bearing capacity and subgrade compaction for all installations. If site conditions are found not to meet any design requirements during installation, the Engineer of Record must be contacted immediately.
5. All installations require a minimum two layers of geotextile fabric. One layer is to be installed around the Modules, and another layer is to be installed between the stone/soil interfaces.
6. Stone backfilling is to follow all requirements of the most current installation instructions.
7. The installing contractor must apply all protective measures to prevent sediment from entering the system during and after installation per local, state, and federal regulations.
8. The StormTank® Module carries a Limited Warranty, which can be accessed at www.brentwoodindustries.com.

1.0 Introduction



About Brentwood

Brentwood is a global manufacturer of custom and proprietary products and systems for the construction, consumer, medical, power, transportation, and water industries. A focus on plastics innovation, coupled with diverse production capabilities and engineering expertise, has allowed Brentwood to build a strong reputation for thermoplastic molding and solutions development.

Brentwood's product and service offerings continue to grow with an ever-increasing manufacturing presence. By emphasizing customer service and working closely with clients throughout the design, engineering, and manufacturing phases of each project, Brentwood develops forward-thinking strategies to create targeted, tailored solutions.

StormTank® Module

The StormTank Module is a strong, yet lightweight, alternative to other subsurface systems and offers the largest void space (up to 97%) of any subsurface stormwater storage unit on the market. The Modules are simple to assemble on site, limiting shipping costs, installation time, and labor. Their structural PVC columns pressure fit into the polypropylene top/bottom platens, with side panels inserted around the perimeter of the system. This open design and lack of internal walls make the Module system easy to clean compared to other subsurface box structures. When properly designed, applied, installed, and maintained, the Module system has been engineered to achieve a 50-year lifespan.

Technical Support

Brentwood's knowledgeable distributor network and in-house associates emphasize customer service and support by partnering with customers to extend the process beyond physical material supply. These trained specialists are available to assist in the review of proposed systems, conversions of alternatively designed systems, or to resolve any potential concerns before, during, and after the design process. To provide the best assistance, it is recommended that associates be provided with a site plan and cross-sections that include grading, drainage structures, dimensions, etc.

2.0 Product Information

Applications

The Module system can be utilized for detention, infiltration, capture and reuse, and specialty applications across a wide range of industries, including the commercial, residential, and recreational segments. The product’s modular design allows the system to be configured in almost any shape (even around utilities) and to be located under almost any pervious or impervious surface.

Module Selection

Brentwood manufactures the Module in five different heights (Table 1) that can be stacked uniformly up to two Modules high. This allows for numerous height configurations up to 6’ (1.83 m) tall. The Modules can be buried up to a maximum invert of 11’ (3.35 m) and require a minimum cover of 24” (610 mm) for load rating. When selecting the proper Module, it is important to consider the minimum required cover, any groundwater or limiting zone restrictions, footprint requirements, and all local, state, and federal regulations.

Table 1: Nominal StormTank® Module Specifications



	ST-18	ST-24	ST-30	ST-33	ST-36
Height	18" (457 mm)	24" (610 mm)	30" (762 mm)	33" (838 mm)	36" (914 mm)
Void Space	95.5%	96.0%	96.5%	96.9%	97.0%
Module Storage Capacity	6.54 ft³ (0.18 m³)	8.64 ft³ (0.24 m³)	10.86 ft³ (0.31 m³)	11.99 ft³ (0.34 m³)	13.10 ft³ (0.37 m³)
Min. Installed Capacity*	9.15 ft³ (0.26 m³)	11.34 ft³ (0.32 m³)	13.56 ft³ (0.38 m³)	14.69 ft³ (0.42 m³)	15.80 ft³ (0.45 m³)
Weight	22.70 lbs (10.30 kg)	26.30 lbs (11.93 kg)	29.50 lbs (13.38 kg)	31.3 lbs (14.20 kg)	33.10 lbs (15.01 kg)

*Min. Installed Capacity includes the leveling bed, Module, and top backfill storage capacity for one Module. Stone storage capacity is based on 40% void space. **Side backfill storage is not included.**

3.0 Manufacturing Standards

Brentwood selects material based on long-term performance needs. To ensure long-term performance and limit component deflection over time (creep), Brentwood selected polyvinyl chloride (PVC) for the Module's structural columns and a virgin polypropylene (PP) blend for the top/bottom and side panels. PVC provides the largest creep resistance of commonly available plastics, and therefore, provides the best performance under loading conditions. Materials like polyethylene (HDPE) and recycled PP have lower creep resistance and are not recommended for load-bearing products and applications.

Materials:

Brentwood's proprietary PVC and PP copolymer resins have been chosen specifically for utilization in the StormTank® Module. The PVC is blended in house by experts and is a 100% blend of post-manufacturing/pre-consumer recycled material. Both materials exhibit structural resilience and naturally resist the chemicals typically found in stormwater runoff.

Methods:

Injection Molding

The Module's top/bottom platens and side panels are injection molded, using proprietary molds and materials. This allows Brentwood to manufacture a product that meets structural requirements while maintaining dimensional control, molded-in traceability, and quality control.

Extrusion

Brentwood's expertise in PVC extrusion allows the structural columns to be manufactured in house. The column extrusion includes the internal structural ribs required for lateral support.

Quality Control

Brentwood maintains strict quality control in order to ensure that materials and the final product meet design requirements. This quality assurance program includes full material property testing in accordance with American Society for Testing and Materials (ASTM) standards, full-part testing, and process testing in order to quantify product performance during manufacturing. Additionally, Brentwood conducts secondary finished-part testing to verify that design requirements continue to be met post-manufacturing.

All Module parts are marked with traceability information that allows for tracking of manufacturing. Brentwood maintains equipment at all manufacturing locations, as well as at its corporate testing lab, to ensure all materials and products meet all requirements.



4.0 Structural Response

Structural Design

The Module has been designed to resist loads calculated in accordance with the American Association of State Highway and Transportation Officials' (AASHTO) Load and Resistance Factor Design (LRFD) Bridge Design manual. This fully factored load includes a multiple presence factor, dynamic load allowance, and live load factor to account for real-world situations. This loading was considered when Brentwood developed both the product and installation requirements. The developed minimum cover ensures the system maintains an adequate resistance factor for the design truck (HS-20) and HS-25 loads.

Full-Scale Product Testing

Engineers at Brentwood's in-house testing facility have completed full-scale vertical and lateral tests on the Module to evaluate product response. To date, Brentwood continues in-house testing in order to evaluate long-term creep effects.

Fully Installed System Testing

Brentwood's dedication to providing a premier product extends to fully installed testing. Through a partnership with Queen's University's GeoEngineering Centre in Kingston, Ontario, Brentwood has conducted full-scale installation tests of single- and double-stacked Module systems to analyze short- and long-term performance. Testing includes short-term ultimate limit state testing under fully factored AASHTO loads and minimum installation cover, lateral load testing, long-term performance and lifecycle testing utilizing time-temperature superposition, and load resistance development. Side backfill material tests were also performed to compare the usage of sand, compacted stone, and uncompacted stone.



5.0 Foundation

The foundation (subgrade) of the subsurface storage structure may be the most important part of the Module system installation as this is the location where the system applies the load generated at the surface. If the subgrade lacks adequate support or encounters potential settlement, the entire system could be adversely affected. Therefore, when implementing an underground storage solution, it is imperative that a geotechnical investigation be performed to ensure a strong foundation.

Considerations & Requirements:

Bearing Capacity

The bearing capacity is the ability of the soil to resist settlement. In other words, it is the amount of weight the soil can support. This is important versus the native condition because the system is replacing earth, and even though the system weighs less than the earth, the additional load displacement of the earth is not offset by the difference in weight.

Using the Loading and Resistance Factor Design (LRFD) calculation for bearing capacity, Brentwood has developed a conservative minimum bearing capacity table (see Appendix). The Engineer of Record shall reference this table to assess actual cover versus the soil bearing required for each unit system.

Limiting Zones

Limiting zones are conditions in the underlying soils that can affect the maximum available depth for installation and can reduce the strength and stability of the underlying subgrade. The three main forms of limiting zones are water tables, bedrock, and karst topography. It is recommended that a system be offset a minimum of 12" (305 mm) from any limiting zones.

Compaction


Soil compaction occurs as the soil particles are pressed together and pore space is eliminated. By compacting the soils to 95% (as recommended by Brentwood), the subgrade strength will increase, in turn limiting both the potential for the soil to move once installed and for differential settlement to occur throughout the system. If designing the specific compaction requirement, settlement should be limited to less than 1" (25 mm) through the entire subgrade and should not exceed a 1/2" (13 mm) of differential settlement between any two adjacent units within the system over time.

Mitigation

If a minimum subgrade bearing capacity cannot be achieved because of weak soil, a suitable design will need to be completed by a Geotechnical Engineer. This design may include the over-excavation of the subgrade and an engineered fill or slurry being placed. Additional material such as geogrid or other products may also be required. Please contact a Geotechnical Engineer prior to selecting products or designing the subgrade.



Soil Profile

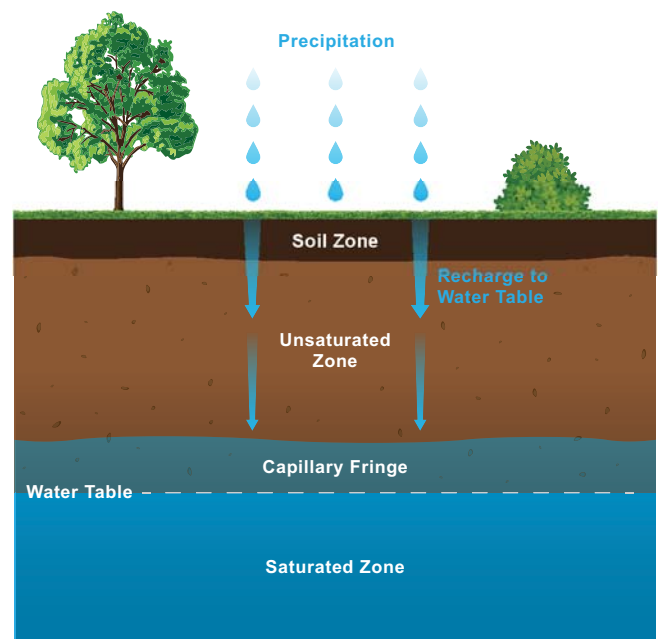

Water Table Zones

6.0 System Materials

Geotextile Fabric

The 6-ounce geotextile fabric is recommended to be installed between the soil and stone interfaces around the Modules to prevent soil migration.

Leveling Bed

The leveling bed is constructed of 6"-thick (152 mm) angular stone (Table 2). The bed has not been designed as a structural element but is utilized to provide a level surface for the installation of the system and provide an even distribution of load to the subgrade.

Stone Backfill

The stone backfill is designed to limit the strain on the product through displacement of load and ensure the product's longevity. Therefore, a minimum of 12"-wide (305 mm) angular stone must be placed around all sides of the system. In addition, a minimum layer of 12" (305 mm) angular stone is required on top of the system. All material is to be placed evenly in 12" (305 mm) lifts around and on top of the system and aligned with a vibratory plate compactor.

Table 2: Approved Backfill Material

Material Location	Description	AASHTO M43 Designation	ASTM D2321 Class	Compaction/Density
Finished Surface	Topsoil, hardscape, stone, concrete, or asphalt per Engineer of Record	N/A	N/A	Prepare per engineered plans
Suitable Compactable Fill	Well-graded granular soil/aggregate, typically road base or earthen fill (maximum 4" particle size)	56, 57, 6, 67, 68	I & II III (Earth Only)	Place in maximum 12" lifts to a minimum 90% standard proctor density
Top Backfill	Crushed angular stone placed between Modules and road base or earthen fill	56, 57, 6, 67, 68	I & II	Plate vibrate to provide evenly distributed layers
Side Backfill	Crushed angular stone placed between earthen wall and Modules	56, 57, 6, 67, 68	I & II	Place and plate vibrate in uniform 12" lifts around the system
Leveling Bed	Crushed angular stone placed to provide level surface for installation of Modules	56, 57, 6, 67, 68	I & II	Plate vibrate to achieve level surface

Impermeable Liner

In designs that prevent runoff from infiltrating into the surrounding soil (detention or reuse applications) or groundwater from entering the system, an impermeable liner is required. When incorporating a liner as part of the system, Brentwood recommends using a manufactured product such as a PVC liner. This can be installed around the Modules themselves or installed around the excavation (to gain the benefit of the void space in the stone) and should include an underdrain system to ensure the basin fully drains. This liner is installed with a layer of geotextile fabric on both sides to prevent puncture, in accordance with manufacturer recommendations.

7.0 Connections

Stormwater runoff must be able to move readily in and out of the StormTank® Module system. Brentwood has developed numerous means of connecting to the system, including inlet/outlet ports and direct abutment to a catch basin or endwall. All methods of connection should be evaluated as each one may offer a different solution. Brentwood has developed drawings to assist with specific installation methods, and these are available at www.brentwoodindustries.com.

Inlet/Outlet and Pipe Connections

To facilitate easy connection to the system, Brentwood manufactures two inlet/outlet ports. They are 12" (305 mm) and 14" (356 mm), respectfully, and utilize a flexible coupling connection to the adjoining pipe.

Another common installation method is to directly connect the pipe to the system. In order to do this, an opening is cut into the side panels, the pipe is inserted, and then the system is wrapped in geotextile fabric. When utilizing this connection method, the pipe must be located a minimum of 3" (76 mm) from the bottom of the system. This provides adequate clearance for the bottom platen and the required strength in the remaining side panel. To maintain the required clearances or reduce pipe size, it may be necessary to connect utilizing a manifold system.

Direct Abutment

The system can also be connected by directly abutting Modules to a concrete catch basin or endwall. This allows for a seamless connection of structures in close proximity to the system and eliminates the need for numerous pipe connections. When directly abutting one of these structures, remove any side panels that fully abut the structure, and make sure it is flush with the system to prevent material migration into the structure.


Underdrain

Underdrains are typically utilized in detention applications to ensure the system fully drains since infiltration is limited or prohibited. The incorporation of an underdrain in a detention application will require an impermeable liner between the stone-soil interface.

Cleanout Ports

Brentwood understands the necessity to inspect and clean a subsurface system and has designed the Module without any walls to allow full access. Brentwood offers three different cleanout/observation ports for utilization with the system. The ports are made from PVC, provide an easy means of connection, and are available in 6" (152 mm), 8" (203 mm) and 10" (254 mm) diameters. The 10" (254 mm) port is sized to allow access to the system by a vacuum truck suction hose for easy debris removal.

It is recommended that ports be located a maximum of 30' (9.14 m) on center to provide adequate access, ensure proper airflow, and allow the system to completely fill.

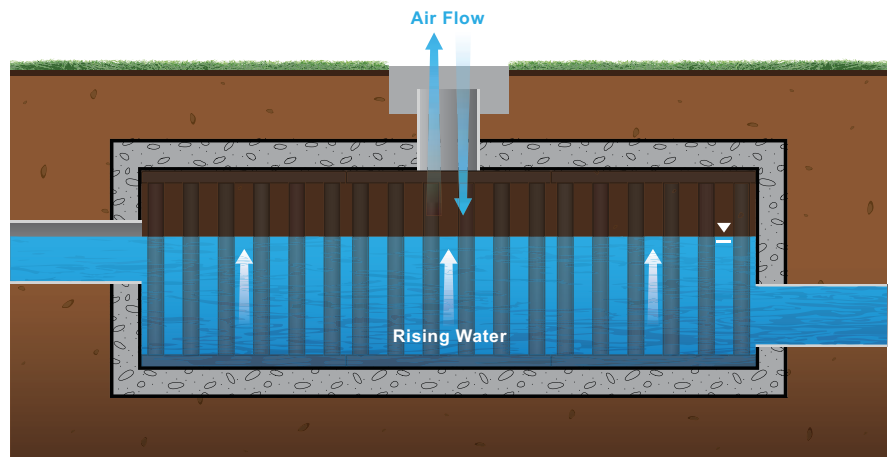

Ventilation and Air Flow

8.0 Pretreatment

Removing pollutants from stormwater runoff is an important component of any stormwater management plan. Pretreatment works to prevent water quality deterioration and also plays an integral part in allowing the system to maintain performance over time and increase longevity. Treatment products vary in complexity, design, and effectiveness, and therefore, should be selected based on specific project requirements.

Typical Stormwater System



StormTank[®] Shield

Brentwood's StormTank Shield provides a low-cost solution for stormwater pretreatment. Designed to improve sumped inlet treatment, the Shield reduces pollutant discharge through gross sediment removal and oil/water separation. For more information, please visit www.brentwoodindustries.com.


Debris Row (Easy Cleanout)

An essential step of designing, installing, and maintaining a subsurface system is preventing debris from entering the storage. This can be done by incorporating debris rows (or bays) at the inlets of the system to prevent debris from entering the rest of the system.

The debris row is built into the system utilizing side panels with a 12" (305 mm) segment of geotextile fabric. This allows for the full basin capacity to be utilized while storing any debris in an easy-to-remove location. To calculate the number of side panels required to prevent backing up, the opening area of the side panels on the area above the geotextile fabric has been calculated and compared to the inflow pipe diameter.

Debris row cleanout is made easy by including 10" (254 mm) suction ports, based on the length of the row, and a 6" (152 mm) saddle connection to the inflow pipe. If the system is directly abutting a catch basin, the saddle connection is not required, and the flush hose can be inserted through the catch basin. Debris is then flushed from the inlet toward the suction ports and removed.

Brentwood has developed drawings and specifications that are available at www.brentwoodindustries.com to illustrate the debris row configuration and layouts.

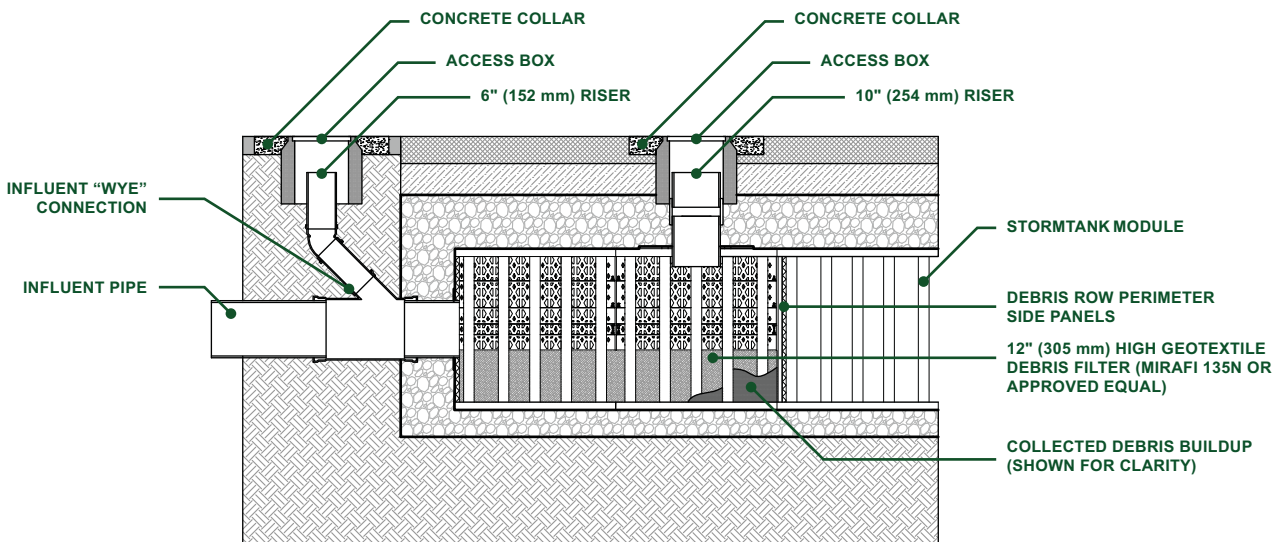

Debris Row Section Detail

9.0 Additional Considerations

Many variable factors, such as the examples below, must be taken into consideration when designing a StormTank® Module system. As these considerations require complex calculations and proper planning, please contact Brentwood or your local distributor to discuss project-specific requirements.

Adaptability

The Modules can be arranged in custom configurations to meet tight site constraints and to provide different horizontal and edge configurations. Modules can also be stacked, to a maximum 2 units tall, to meet capacity needs and can be buried to a maximum invert of 11' (3.35 m) to allow for a stacked system or deeper burial.

Adjacent Structures

The location of adjacent structures, especially the location of footings and foundations, must be taken into consideration as part of system design. The foundation of a building or retaining wall produces a load that is transmitted to a footing and then applied to the surface below. The footing is intended to distribute the line load of the wall over a larger area without increasing the larger wall's thickness. The reason this is important is because the load the footing is applying to the earth is distributed through the earth and could potentially affect a subsurface system as either a vertical load to the top of the Module or a lateral load to the side of the Module.


Based on this increased loading, it is recommended that the subsurface system either maintain a distance away from the foundation, footing equal to the height between the Module invert and structure invert of the system, or the foundation or footing extend at a minimum to the invert of the subsurface system. By locating the foundation away from the system or equal to the invert, the loading generated by the structure does not get transferred onto the system. It is recommended that all adjacent structures be completed prior to the installation of the Modules to prevent construction loads from being imparted on the system.

Adjacent Excavation

The subsurface system must be protected before, during, and after the installation. Once a system is installed, it is important to remember that excavation adjacent to the system could potentially cause the system to become unstable. The uniform backfilling will evenly distribute the lateral loads to the system and prohibit the system from becoming unstable and racking from unequal loads. However, it is recommended that any excavation adjacent to a system remain a minimum distance away from the system equal to the invert. This will provide a soil load that is equal to the load applied by the opposite side of the installation. If the excavation is to exceed the invert of the system, additional analysis may be necessary.

Sloped Finished Grade

Much like adjacent excavation, a finished grade with a differential cover could potentially cause a subsurface system to become disproportionately loaded. For example, if one side of the system has 10' (3.05 m) of cover and the adjacent side has 24" (610 mm) of cover, the taller side will generate a higher lateral load, and the opposite side may not have an equal amount of resistance to prevent a racking of the system. Additional evaluation may be required when working on sites where the final grade around a system exceeds 5%.

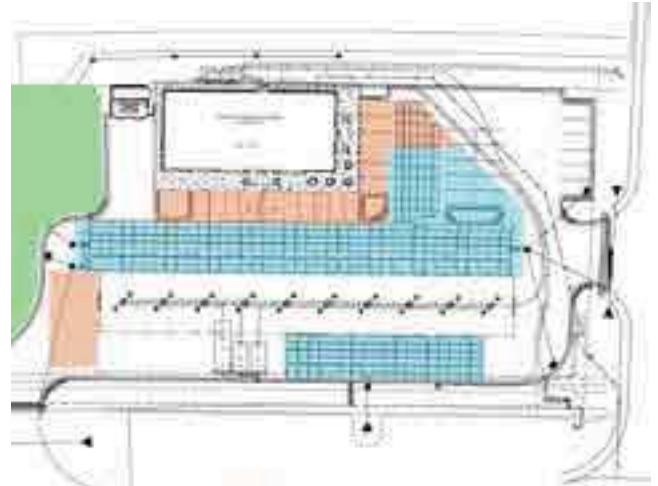

Site Plan Module Layout Adaptability
(StormTank Modules shown in blue)

10.0 Inspection & Maintenance

Description

Proper inspection and maintenance of a subsurface stormwater storage system are vital to ensuring proper product functioning and system longevity. It is recommended that during construction the contractor takes the necessary steps to prevent sediment from entering the subsurface system. This may include the installation of a bypass pipe around the system until the site is stabilized. The contractor should install and maintain all site erosion and sediment per Best Management Practices (BMP) and local, state, and federal regulations.

Once the site is stabilized, the contractor should remove and properly dispose of erosion and sediment per BMP and all local, state, and federal regulations. Care should be taken during removal to prevent collected sediment or debris from entering the stormwater system. Once the controls are removed, the system should be flushed to remove any sediment or construction debris by following the maintenance procedure outlined below.

During the first service year, a visual inspection should be completed during and after each major rainfall event, in addition to semi-annual inspections, to establish a pattern of sediment and debris buildup. Each stormwater system is unique, and multiple criteria can affect maintenance frequency. For example, whether or not a system design includes inlet protection or a pretreatment device has a substantial effect on the system's need for maintenance. Other factors include where the runoff is coming from (hardscape, gravel, soil, etc.) and seasonal changes like autumn leaves and winter salt.

During and after the second year of service, an established annual inspection frequency, based on the information collected during the first year, should be followed. At a minimum, an inspection should be performed semi-annually. Additional inspections may be required at the change of seasons for regions that experience adverse conditions (leaves, cinders, salt, sand, etc).

Maintenance Procedures

Inspection:

1. Inspect all observation ports, inflow and outflow connections, and the discharge area.
2. Identify and log any sediment and debris accumulation, system backup, or discharge rate changes.
3. If there is a sufficient need for cleanout, contact a local cleaning company for assistance.

Cleaning:

1. If a pretreatment device is installed, follow manufacturer recommendations.
2. Using a vacuum pump truck, evacuate debris from the inflow and outflow points.
3. Flush the system with clean water, forcing debris from the system.
4. Repeat steps 2 and 3 until no debris is evident.

11.0 System Sizing

System Sizing Calculation

This section provides a brief description of the process required to size the StormTank® Module system. If you need additional assistance in determining the required number of Modules or assistance with the proposed configuration, it is recommended that you contact Brentwood or your local distributor. Additionally, Brentwood's volume calculator can help you to estimate the available storage volumes with and without stone storage. This tool is available at www.brentwoodindustries.com.

1. Determine the required storage volume (Vs):

It is the sole responsibility of the Engineer of Record to calculate the storage volume in accordance with all local, state, and federal regulations.

2. Determine the required number of Modules (N):

If the storage volume does not include stone storage, take the total volume divided by the selected Module storage volume. If the stone storage is to be included, additional calculations will be required to determine the available stone storage for each configuration.

3. Determine the required volume of stone (Vstone):

The system requires a minimum 6" (152 mm) leveling bed, 12" (305 mm) backfill around the system, and 12" (305 mm) top backfill utilizing 3/4" (19 mm) angular clean stone. Therefore, take the area of the system times the leveling bed and the top backfill. Once that value is determined, add the volume based on the side backfill width times the height from the invert of the Modules to the top of the Modules.


4. Determine the required excavation volume (Vexc):

Utilizing the area of the system, including the side backfill, multiply by the depth of the system including the leveling bed. It is noted that this calculation should also include any necessary side pitch or benching that is required for local, state, or federal safety standards.

5. Determine the required amount of geotextile (G):

The system utilizes a multiple layer system of geotextile fabric. Therefore, two calculations are required to determine the necessary amount of geotextile. The first layer surrounds the entire system (including all backfill), and the second layer surrounds the Module system only. It is recommended that an additional 20% be included for waste and overlap.

11.1 Storage Volume

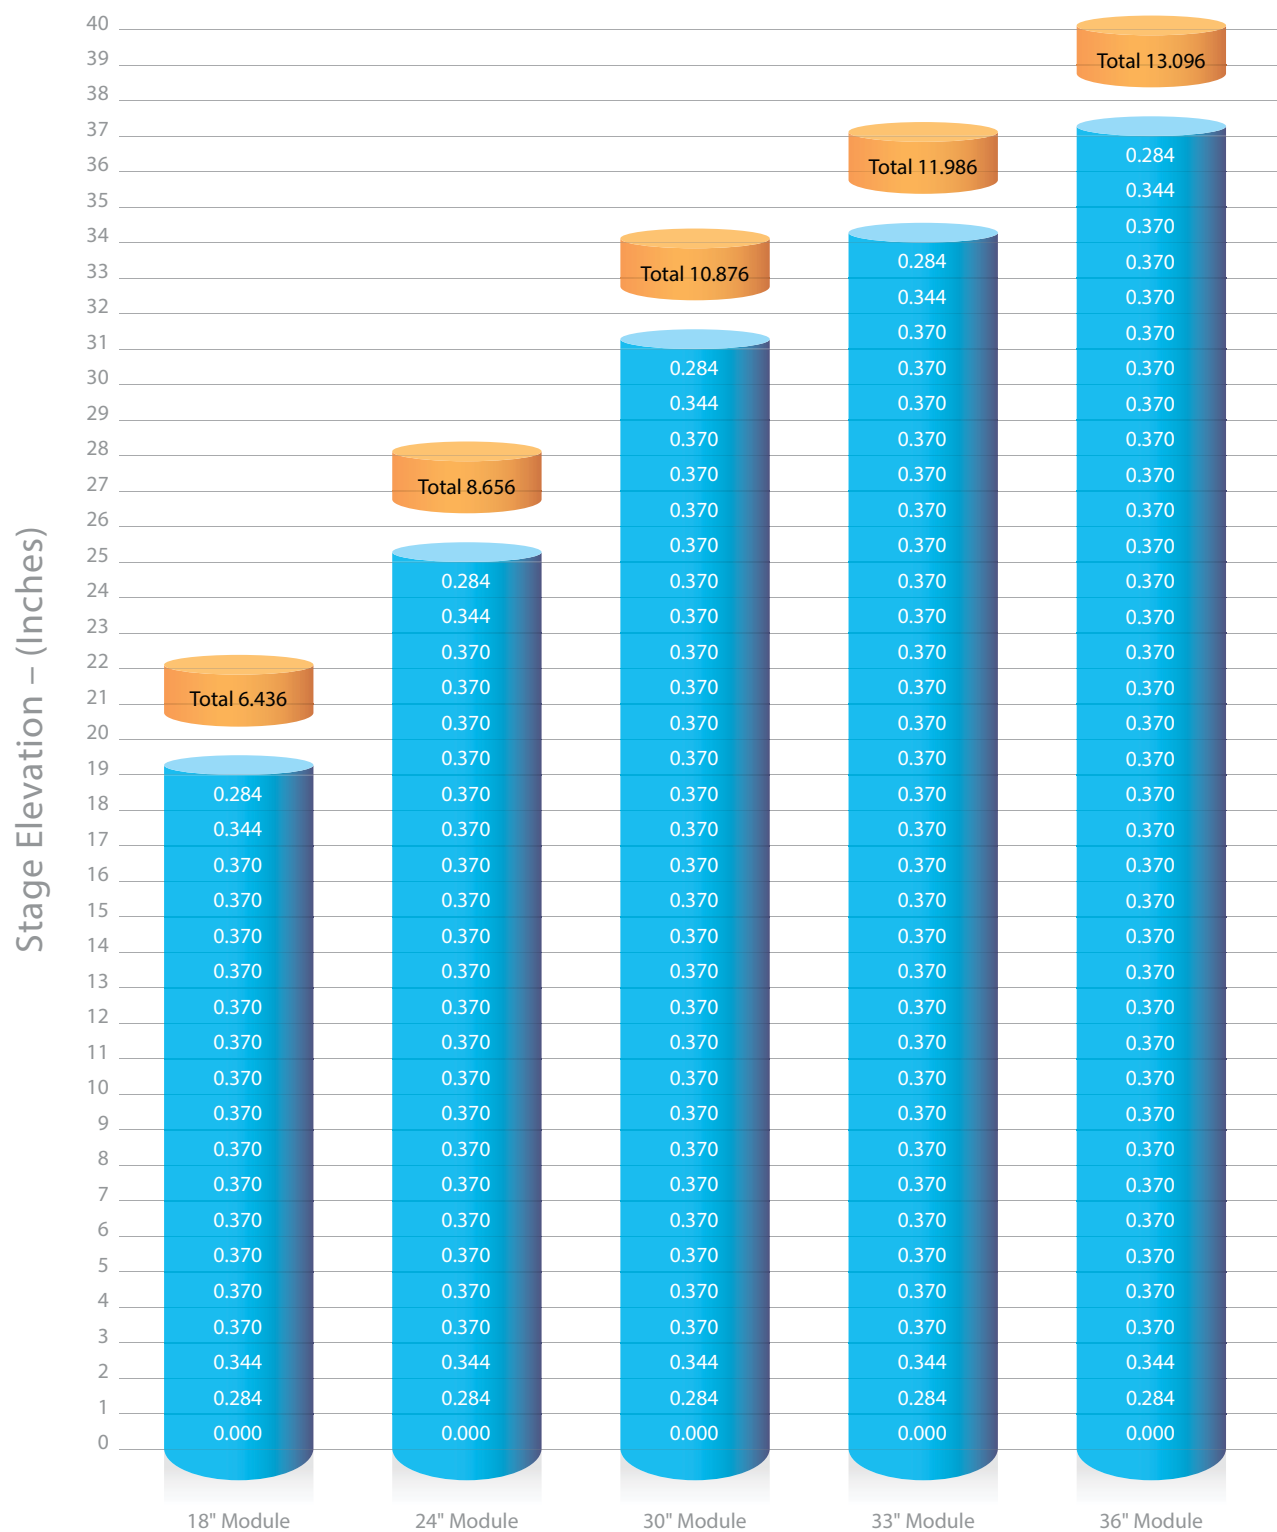

Module Height

11.2 Material Quantity Worksheet

Project Name:

By:

Location:

Date:

System Requirements

Required Storage

ft³ (m³)

Number of Modules

Each

Module Storage

ft³ (m³)

Stone Storage

ft³ (m³)

Module Footprint

ft² (m²) Number of Modules x 4.5 ft² (0.42 m²)

System Footprint w/ Stone

ft² (m²) Module Footprint + 1 ft (0.3048 m) to each edge

Stone

Tons (kg) Leveling Bed + Side Backfill + Top Backfill

Volume of Excavation

yd³ (m³) System Footprint w/ Stone x Total Height

Area of Geotextile

yd² (m²) Wrap around Modules + Wrap around Stone/Soil Interface

System Cost






	Quantity		Unit Price		Total
Modules	<input type="text"/> ft ³ (m ³)	X	\$ <input type="text"/> ft ³ (m ³)	=	\$ <input type="text"/>
Stone	<input type="text"/> Tons (kg)	X	\$ <input type="text"/> Tons (kg)	=	\$ <input type="text"/>
Excavation	<input type="text"/> yd ³ (m ³)	X	\$ <input type="text"/> yd ³ (m ³)	=	\$ <input type="text"/>
Geotextile	<input type="text"/> yd ² (m ²)	X	\$ <input type="text"/> yd ² (m ²)	=	\$ <input type="text"/>
Subtotal =					\$ <input type="text"/>
Tons =					\$ <input type="text"/>

Material costs may not include freight.

Please contact Brentwood or your local distributor for this information.

12.0 Detail Drawings

Brentwood has developed numerous drawings for utilization when specifying a StormTank® Module system. Below are some examples of drawings available at www.brentwoodindustries.com.

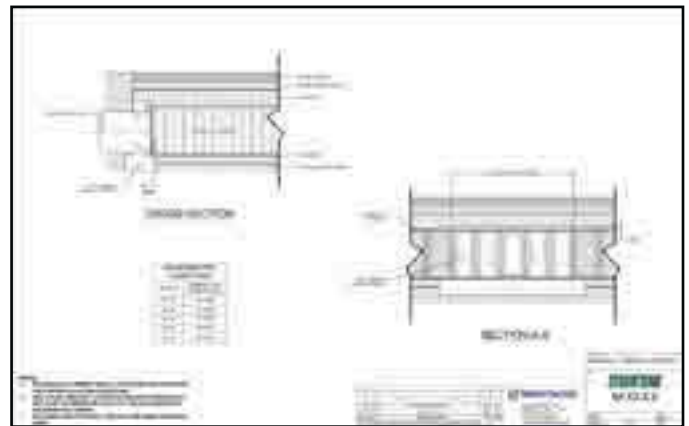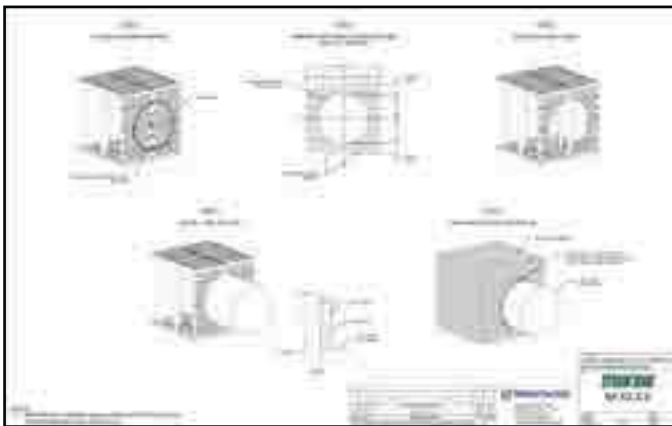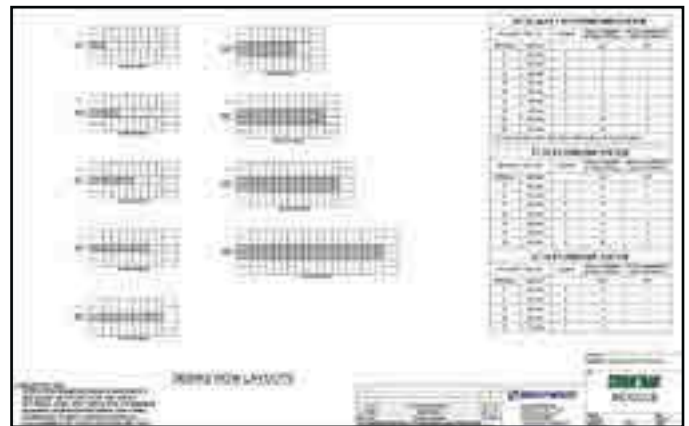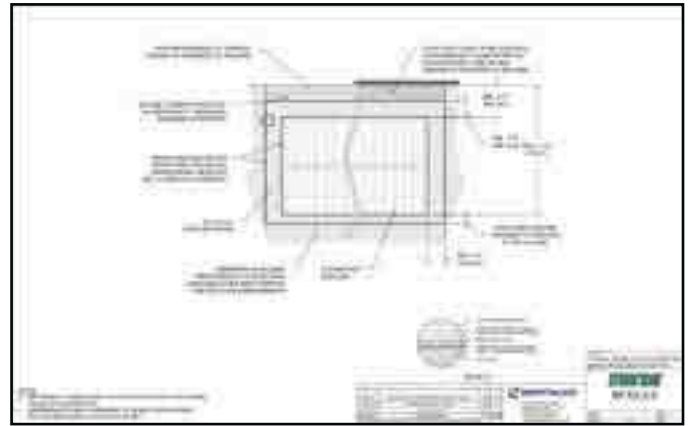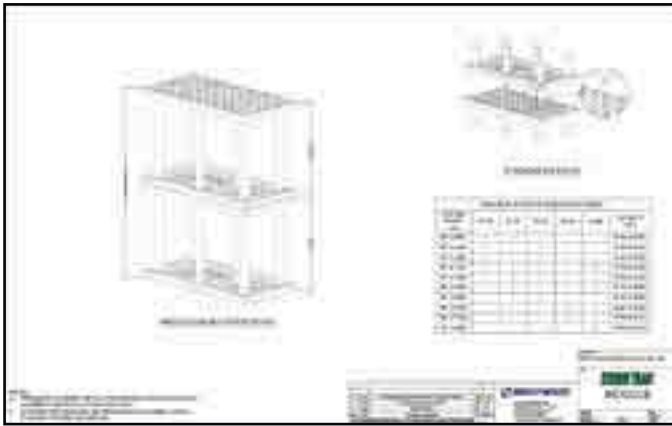

13.0 Specifications

1) General

- a) This specification shall govern the implementation, performance, material, and fabrication pertaining to the subsurface stormwater storage system. The subsurface stormwater storage system shall be manufactured by Brentwood Industries, Inc., 500 Spring Ridge Drive, Reading, PA 19610 (610.374.5109), and shall adhere to the following specification at the required storage capacities.
- b) All work is to be completed per the design requirements of the Engineer of Record and to meet or exceed the manufacturer's design and installation requirements.

2) Subsurface Stormwater Storage System Modules

- a) The subsurface stormwater storage system shall be constructed from virgin polypropylene and 100% recycled PVC to meet the following requirements:
 - i) High-Impact Polypropylene Copolymer Material
 - (1) Injection molded, polypropylene, top/bottom platens and side panels formed to a dimension of 36" (914 mm) long by 18" (457 mm) wide [nominal].
 - ii) 100% Recycled PVC Material
 - (1) PVC conforming to ASTM D-1784 Cell Classification 12344 b-12454 B.
 - (2) Extruded, rigid, and 100% recycled PVC columns sized for applicable loads as defined by Section 3 of the AASHTO LRFD Bridge Design Specifications and manufactured to the required length per engineer-approved drawings.
 - iii) Platens and columns are assembled on site to create Modules, which can be uniformly stacked up to two Modules high, in vertical structures of variable height (custom for each project).
 - iv) Modular stormwater storage units must have a minimum 95% void space and be continuously open in both length and width, with no internal walls or partitions.

3) Submittals

- a) Only systems that are approved by the engineer will be allowed.
- b) At least 10 days prior to bid, submit the following to the engineer to be considered for pre-qualification to bid:
 - i) A list of materials to be provided for work under this article, including the name and address of the materials producer and the location from which the materials are to be obtained.
 - ii) Three hard copies of the following:
 - (1) Shop drawings.
 - (2) Specification sheets.
 - (3) Installation instructions.
 - (4) Maintenance guidelines.
- c) Subsurface Stormwater Storage System Component Samples for review:
 - i) Subsurface stormwater storage system Modules provide a single 36" (914 mm) long by 18" (457 mm) wide, height as specified, unit of the product for review.
 - ii) Sample to be retained by owner.
- d) Manufacturers named as acceptable herein are not required to submit samples.

4) Structural Design

- a) The structural design, backfill, and installation requirements shall ensure the loads and load factors specified in the AASHTO LRFD Bridge Design Specifications, Section 3 are met.
- b) Product shall be tested under minimum installation criteria for short-duration live loads that are calculated to include a 20% increase over the AASHTO Design Truck standard with consideration for impact, multiple vehicle presences, and live load factor.
- c) Product shall be tested under maximum burial criteria for long-term dead loads.
- d) The engineer may require submission of third-party test data and results in accordance with items 4b and 4c to ensure adequate structural design and performance.

14.0 Appendix - Bearing Capacity Tables

Cover		HS-25 (Unfactored)		HS-25 (Factored)	
English (in)	Metric (mm)	English (ksf)	Metric (kPa)	English (ksf)	Metric (kPa)
24	610	1.89	90.45	4.75	227.43
25	635	1.82	86.96	4.53	216.90
26	660	1.75	83.78	4.34	207.80
27	686	1.69	80.88	4.16	199.18
28	711	1.63	78.24	3.99	191.04
29	737	1.58	75.82	3.84	183.86
30	762	1.54	73.62	3.70	177.16
31	787	1.50	71.60	3.57	170.93
32	813	1.46	69.75	3.45	165.19
33	838	1.42	68.06	3.34	159.92
34	864	1.39	66.51	3.24	155.13
35	889	1.36	65.10	3.14	150.34
36	914	1.33	63.80	3.05	146.03
37	940	1.31	62.62	2.97	142.20
38	965	1.29	61.54	2.90	138.85
39	991	1.26	60.55	2.83	135.50
40	1,016	1.25	59.65	2.76	132.15
41	1,041	1.23	58.54	2.70	129.28
42	1,067	1.21	58.09	2.67	127.84
43	1,092	1.20	57.42	2.60	124.49
44	1,118	1.19	56.81	2.55	122.09
45	1,143	1.18	56.26	2.50	119.70
46	1,168	1.16	55.77	2.46	117.79
47	1,194	1.16	55.33	2.42	115.87
48	1,219	1.15	54.94	2.39	114.43
49	1,245	1.14	54.59	2.36	113.00
50	1,270	1.13	54.29	2.33	111.56
51	1,295	1.13	54.03	2.30	110.12
52	1,321	1.12	53.80	2.27	108.69
53	1,346	1.12	53.62	2.25	107.73
54	1,372	1.12	53.46	2.23	106.77
55	1,397	1.11	53.34	2.21	105.82
56	1,422	1.11	53.24	2.19	104.86
57	1,448	1.11	53.18	2.17	103.90
58	1,473	1.11	53.14	2.16	103.42
59	1,499	1.11	53.12	2.14	102.46
60	1,524	1.11	53.13	2.13	101.98
61	1,549	1.11	53.16	2.12	101.51
62	1,575	1.11	53.21	2.11	101.03
63	1,600	1.11	53.28	2.10	100.55
64	1,626	1.11	53.37	2.09	100.07
65	1,651	1.12	53.48	2.08	99.59
66	1,676	1.12	53.61	2.08	99.59
67	1,702	1.12	53.75	2.07	99.11
68	1,727	1.13	53.91	2.07	99.11
69	1,753	1.13	54.08	2.06	98.63

Cover		HS-25 (Unfactored)		HS-25 (Factored)	
English (in)	Metric (mm)	English (ksf)	Metric (kPa)	English (ksf)	Metric (kPa)
70	1,778	1.13	54.26	2.06	98.63
71	1,803	1.14	54.46	2.06	98.63
72	1,829	1.14	54.67	2.06	98.63
73	1,854	1.15	54.90	2.06	98.63
74	1,880	1.15	55.13	2.06	98.63
75	1,905	1.16	55.38	2.06	98.63
76	1,930	1.16	55.64	2.06	98.63
77	1,956	1.17	55.90	2.06	98.63
78	1,981	1.17	56.18	2.06	98.63
79	2,007	1.18	56.46	2.07	99.11
80	2,032	1.19	56.76	2.07	99.11
81	2,057	1.19	57.06	2.07	99.11
82	2,083	1.20	57.37	2.08	99.59
83	2,108	1.20	57.69	2.08	99.59
84	2,134	1.21	58.02	2.09	100.07
85	2,159	1.22	58.35	2.09	100.07
86	2,184	1.23	58.69	2.10	100.55
87	2,210	1.23	59.04	2.11	101.03
88	2,235	1.24	59.39	2.11	101.03
89	2,261	1.25	59.75	2.12	101.51
90	2,286	1.26	60.11	2.13	101.98
91	2,311	1.26	60.48	2.13	101.98
92	2,337	1.27	60.86	2.14	102.46
93	2,362	1.28	61.24	2.15	102.94
94	2,388	1.29	61.62	2.16	103.42
95	2,413	1.30	62.01	2.17	103.90
96	2,438	1.30	62.41	2.18	104.38
97	2,464	1.31	62.81	2.19	104.86
98	2,489	1.32	63.21	2.20	105.34
99	2,515	1.33	63.62	2.21	105.82
100	2,540	1.34	64.03	2.22	106.29
101	2,565	1.35	64.45	2.23	106.77
102	2,591	1.35	64.87	2.24	107.25
103	2,616	1.36	65.29	2.25	107.73
104	2,642	1.37	65.72	2.27	108.69
105	2,667	1.38	66.15	2.28	109.17
106	2,692	1.39	66.58	2.29	109.65
107	2,718	1.40	67.02	2.30	110.12
108	2,743	1.41	67.45	2.31	110.60
109	2,769	1.42	67.90	2.33	111.56
110	2,794	1.43	68.34	2.34	112.04
111	2,819	1.44	68.79	2.35	112.52
112	2,845	1.45	69.24	2.36	113.00
113	2,870	1.46	69.69	2.38	113.96
114	2,896	1.47	70.15	2.39	114.43



BRENTWOOD INDUSTRIES, INC.

brentwoodindustries.com

stormtank@brentw.com

+1.610.374.5109





Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix C: Sanitary Sewer Calculation Sheet and Water Pressure Loss Calculation Sheet

841 Grenon Avenue, City Of Ottawa, Ontario

Notes:

Sanitary Sewer Design Calculations

841 Grenon Avenue, City Of Ottawa, Ontario

Location			Residential Flow								Commercial/Institutional			Infiltration		Flow	Sanitary Sewer Design							
STREET	From	To	No. of Single Dwellings	No. of Row/Semi Dwellings	Pop.	Area, A	Tributary		Peaking Factor	Res. Flow, Q _(p)	Area	Tributary Area, A	Com. Flow, Q _(p)	Total Tributary Area	Infiltration Flow	Peak Design Flow	Length, L	Diameter, d _{nom} *	Slope, s	Pipe Capacity, Q _i	Full Flow Velocity, v _f	Design peak Velocity V _p	Percent of Capacity	
							Pop.	Area																
	MH	MH					[no.]	[ha]																
										[L/s]	[ha]	[Sq.m]	[L/s]	[ha]	[L/s]	[L/s]	[m]	[mm]	[%]	[L/s]	[m/s]	[m/s]	[%]	
Prior to Development																								
Grenon	1	2	1	45	125	1.19	125	1.19	4.22	1.71	0.00	0.00	0.000	1.19	0.39	2.10	31	225	2.61%	72.54	1.82	0.82	2.9%	
Grenon	2	3	4	0	14	0.26	139	1.45	4.20	1.89	0.00	0.00	0.000	1.45	0.48	2.37	111	225	2.72%	74.05	1.86	0.88	3.2%	
Grenon	3	4	3	20	64	0.62	203	2.07	4.15	2.72	0.00	0.00	0.000	2.07	0.68	3.41	101	225	2.82%	75.40	1.90	0.99	4.5%	
Grenon	4	5	1	0	3	0.19	206	2.26	4.14	2.77	0.17	0.17	0.081	2.42	0.80	3.65	330	225	2.80%	75.13	1.89	1.00	4.9%	
After Development																								
Grenon	1	2	1	45	125	1.19	125	1.19	4.00	1.62	0.00	0.00	0.000	1.19	0.39	2.01	31	225	2.61%	72.54	1.82	0.82	2.8%	
Grenon	2	3	4	0	14	0.26	139	1.45	4.00	1.80	0.00	0.00	0.000	1.45	0.48	2.27	111	225	2.72%	74.05	1.86	0.86	3.1%	
Grenon	2	3	0	0	54	0.00	193	1.45	4.00	2.50	0.00	0.00	0.000	1.45	0.48	2.97	111	225	2.72%	74.05	1.86	0.93	4.0%	
Grenon	3	4	3	20	64	0.62	257	2.07	4.11	3.42	0.00	0.00	0.000	2.07	0.68	4.10	101	225	2.82%	75.40	1.90	1.04	5.4%	
Grenon	4	5	1	0	3	0.19	260	2.26	4.10	3.46	0.17	0.17	0.081	2.43	0.80	4.34	330	225	2.80%	75.13	1.89	1.06	5.8%	
Notes:																								
Q = Average daily flow per capita					280 L/day per capita					Project: Building Investments and Dev.										Min Velocity of flow > 0.6m/s Max Velocity of flow > 3m/s				
Q _{ext.} = Unit peak extraneous flow					0.33 L/s per gross ha.																			
Pop. Single Family					3.4 Persons					Location 841 Grenon Avenue City Of Ottawa, Ontario														
Pop. Semi-Detached & Row House					2.7 Persons																			
Commercial/institutional consumption rate					28000 L/gross ha/day					Design by: SD										Date: January 8, 2020				
					0.324 L/ha/s																			
Commercial peak factor					1.5					Checked by: SD										Rev. 2				
Commercial peak flow					0.486 L/ha/s																			
																				Kollaard Associates File #: 180966				

DRAWING NUMBER:
180966 – SAN FIG

SANITARY_CATCHMENT_FIGURE



KEY PLAN
N.T.S.

1	sd	08/JAN/2020	RESPONSE TO REVIEW COMMENTS
REV	BY	DATE	DESCRIPTION



Kollaard Associates
Engineers

P.O. BOX 189, 210 PRESCOTT ST (613) 860-0923
KEMPVILLE, ONTARIO
K0C 1J0 FAX (613) 258-0475 info@kollaard.ca
http://www.kollaard.ca

CLIENT:

BUILDING INVESTMENT INC.
205 – 1320 CARLING AVENUE
OTTAWA ONTARIO

PROJECT:

RESIDENTIAL APARTMENT DEVELOPMENT

LOCATION:

841, 845 AND 855(A) GRENON
AVENUE
OTTAWA, ONTARIO

DESIGNED BY:

SD

DATE:
OCT 21 2019


DRAWN BY:

SD

SCALE:
1:1500

KOLLAARD FILE NUMBER:

180966

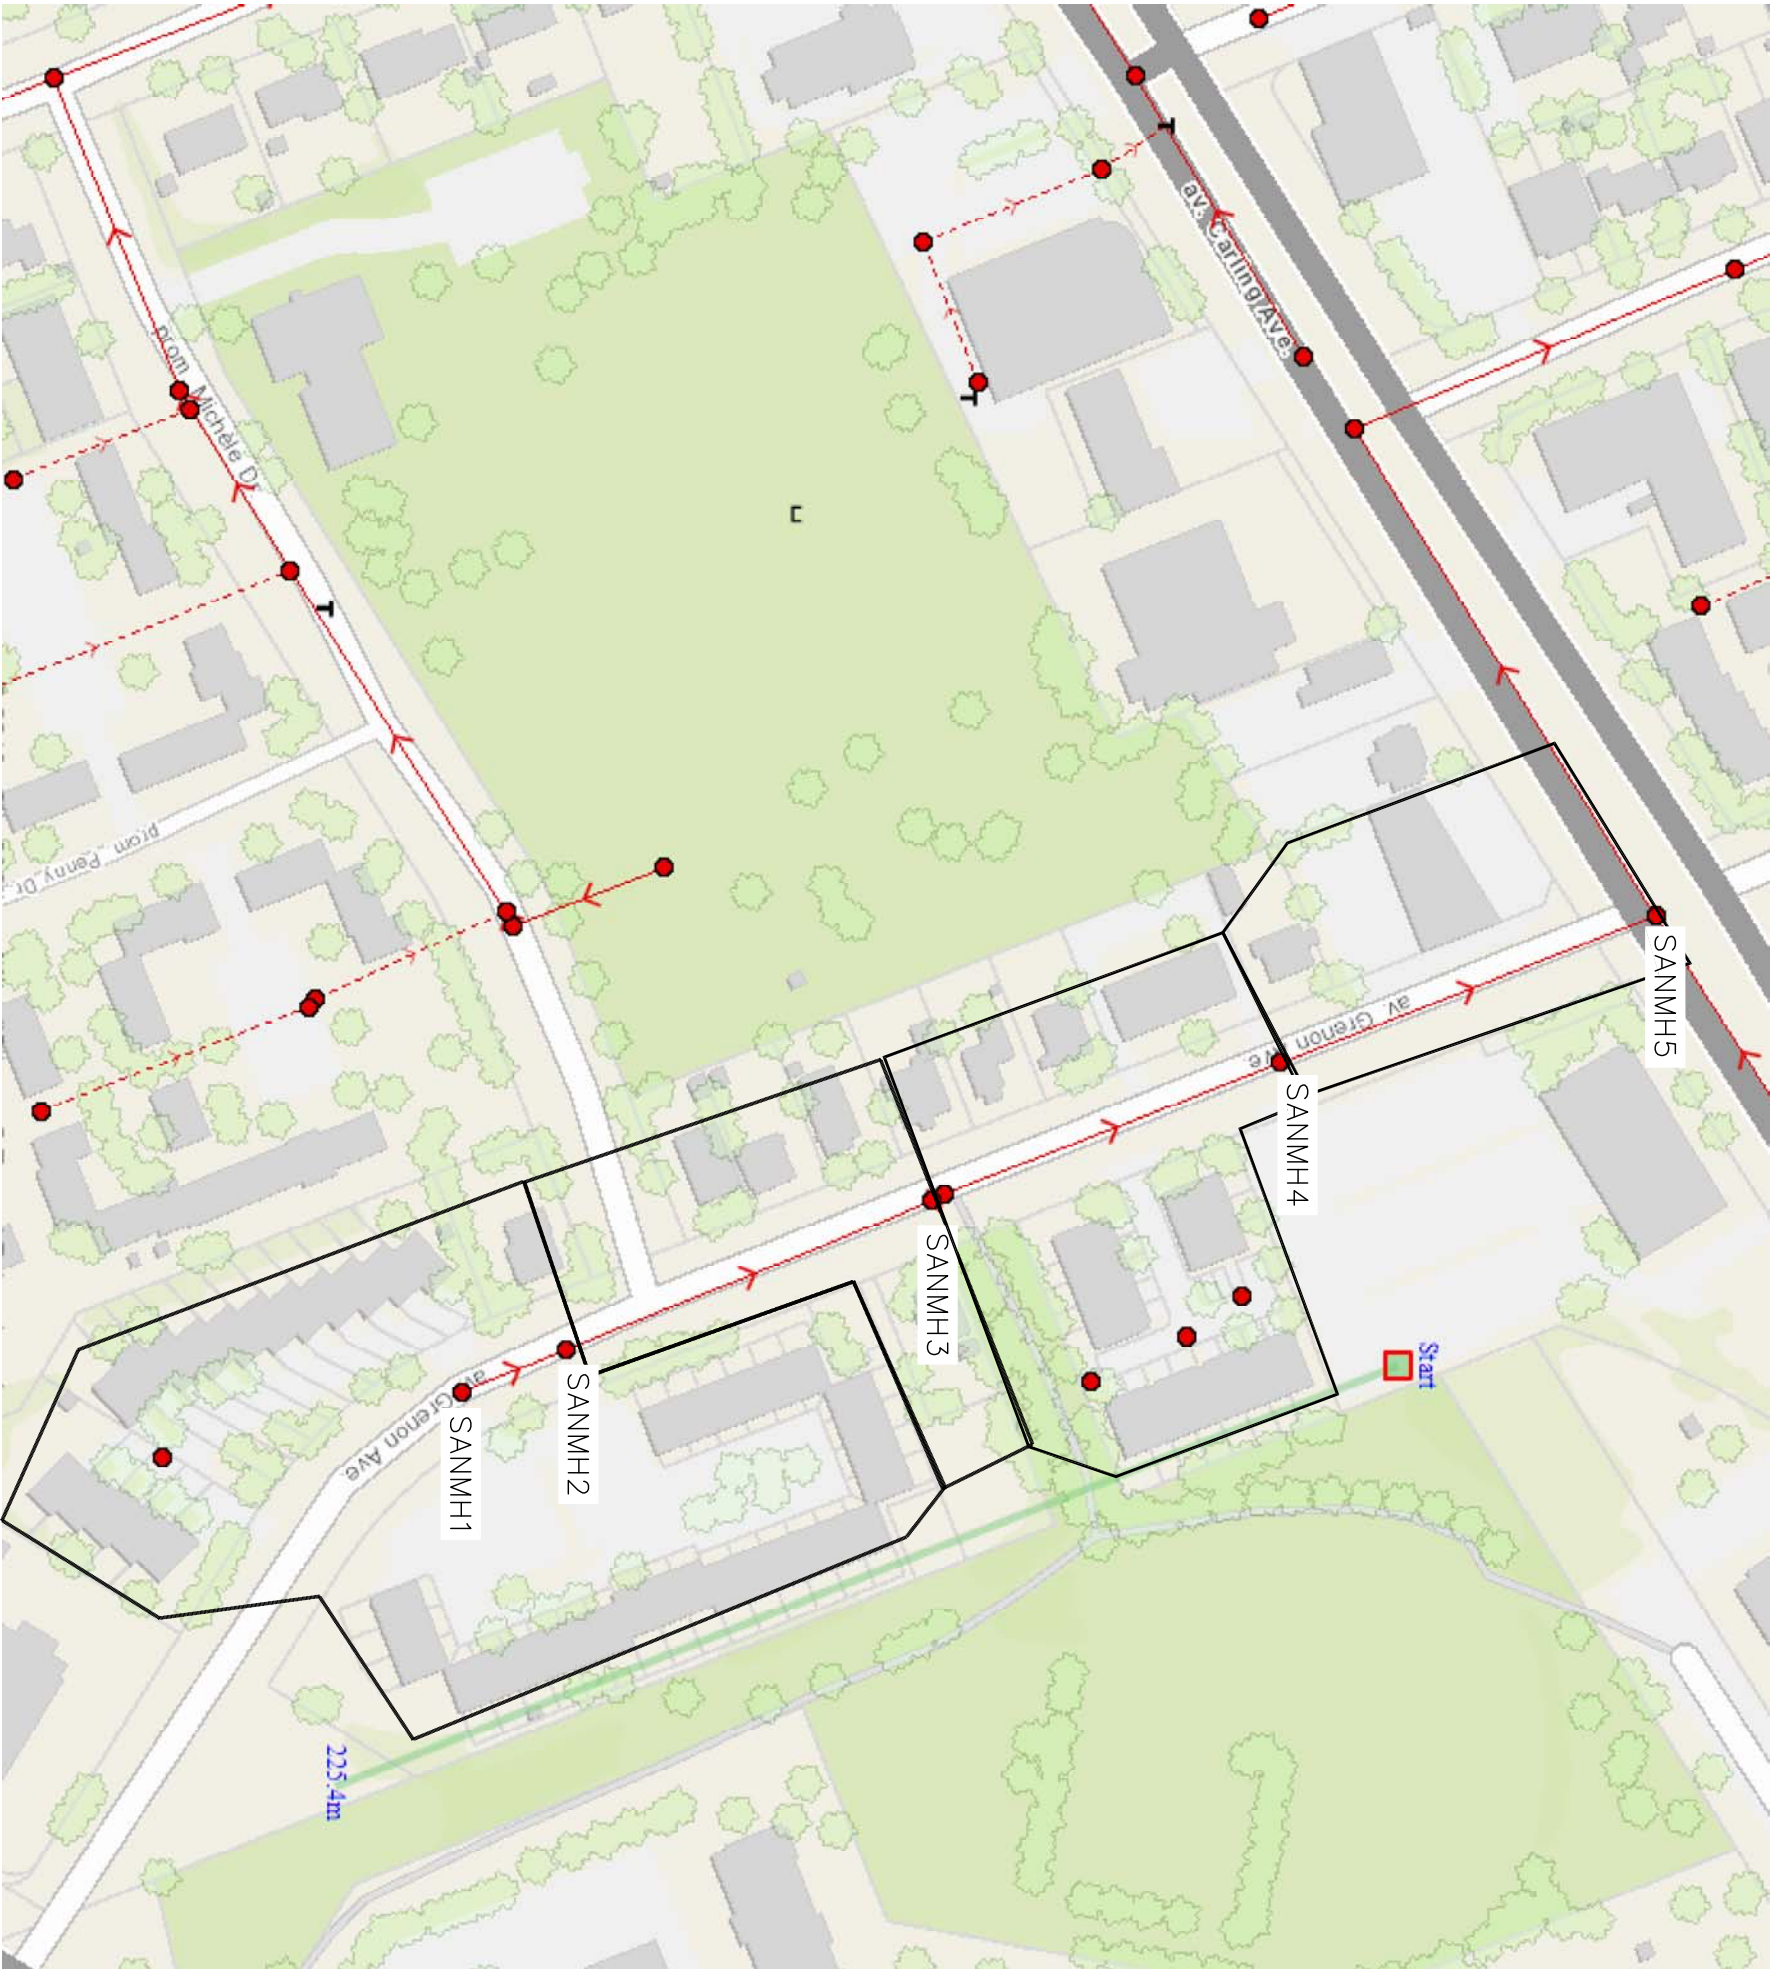

DOWNSTREAM SANITARY SEWER DESIGN SKETCH

SCALE = 1:1500

APPENDIX C: WATER PRESSURE LOSS CALCULATION SHEET

Client: Building Investments Inc.
Job No.: 180966
Location: 841 Grenon Ave
Date: January 8, 2020

Average Daily Water Demand	0.220 L/s	0.000220 m ³ /s	13.2 L/min
Max Daily Demand	0.550 L/s	0.000550 m ³ /s	33 L/min
Max Hourly Demand	1.200 L/s	0.001200 m ³ /s	72 L/min
Fire demand	133.3 L/s	0.133300 m ³ /s	7998 L/min
Water Density	999.7 kg/m ³		
Gravity	9.806 m/s ²		
g	9.8030582 kN/m ²		
S			
ν	= 1.31E-06 [m ² /s]	Kinematic Viscosity of Water @ 10° C	
Roughness Factor	0.0015 mm		

Water Flow Analysis

Pipe Sections			Grade Elevation		Hydraulic Grade line							
Start	Along	End	Start m	End* m	Start** m	End m	Ps kPa	Pe kPa	Q m³/sec	V m/sec	D m	A m²
Calculation of Available Pressure Using 50 mm Diameter Pipe Starting at Minimum HGL and Max Hourly Demand												
Grenon	Service	4 Storey Residential	70	73.8	107.2	107.0	365	326	0.0012	0.611	0.05	0.0020
Grenon	Service	4 Storey Residential	70	85.3	107.2	107.0	365	213	0.0012	0.611	0.05	0.0020
Calculation of Available Pressure Using 150 mm Diameter Pipe Starting at Minimum HGL and Max Hourly Demand												
Grenon	Service	4 Storey Residential	70	73.8	107.2	107.2	365	328	0.0012	0.064	0.15	0.0188
Grenon	Service	4 Storey Residential	70	85.3	107.2	107.2	365	215	0.0012	0.064	0.15	0.0188
Calculation of Maximum Pressure Using 150 mm Diameter Pipe Resulting From Maximum HGL and Average Daily Flow Demand												
Grenon	Service	4 Storey Residential	70	73.8	115.7	115.7	448	411	0.0002	0.012	0.15	0.0188
Grenon	Service	4 Storey Residential	70	85.3	115.7	115.7	448	298	0.0002	0.012	0.15	0.0188
Calculation of Available Pressure Using 150 mm Diameter Pipe Starting at Minimum HGL and Average Daily Flow Demand												
Grenon	Service	4 Storey Residential	70	73.8	107.2	107.2	365	328	0.0002	0.012	0.15	0.0188
Grenon	Service	4 Storey Residential	70	85.3	107.2	107.2	365	215	0.0002	0.012	0.15	0.0188
Calculation of Residual Pressure Using 150 mm Diameter Pipe During Fire Flow Conditions												
Grenon	Service	4 Storey Residential	70	71.5	96.5	83.6	260	119	0.1333	7.074	0.15	0.0188
Grenon	Service	4 Storey Residential	70	73.8	96.5	83.6	260	96	0.1333	7.074	0.15	0.0188

Start Elevation Corresponds to Approximate Elevation of Watermain in Street = 70 metres.

*End Elevation Correspond as follows: 73.8 - Ground Floor
85.3 - Fixtures in 4th floor
71.5 - Mechanical Room, Water Entry Point.

**Start HGL Correspond as follows: 107.23 - Minimum HGL provided by Boundary Conditions
115.7 - Maximum HGL provided by Boundary Conditions
96.5 - HGL resulting from Combined Fireflow (FUS) and MaxDay

Ps	Pressure at Start	= (HGL - Start Elevation) x Specific Gravity of Water
Pe	Pressure at End	= (HGL - End Elevation) x Specific Gravity of Water
Q	Flow Rate	
V	Flow Velocity	
D	Pipe Diameter	
A	Pipe Area	



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix D: Fire Flow Calculations and Boundary Conditions

- Fire Flow Requirements – FUS (Technical Bulletin ISTB-2018-02)



Kollaard Associates

Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario K0G 1J0

Civil • Geotechnical •
Structural • Environmental •
Hydrogeology

(613) 860-0923

FAX: (613) 258-0475

APPENDIX C: CALCULATION OF FIRE FLOW REQUIREMENTS - 854 Grenon Avenue Calculation Based on Fire Underwriters Survey, 1999 and Ottawa Technical Bulletin ISTB-2018-02

Proposed Building:

4 storey wood frame 33 unit residential building with basement more than 50 Percent below grade.

Minimum 1 hr fire resistive rating between each unit. Minimum 2 hrs fire resistive rating on ceilings

Poured Concrete Up To Second Floor Slab.

- 1) An estimate of the Fire Flow required for a given fire area may be estimated by:

$$F = 220 \times C \times \sqrt{A}$$

where

F = required fire flow in litres per minute

A = Second Floor Slab provides a Fire wall between 1st floor and upper 3 floors

Therefore consider total floor area of upper three floors only.

C = coefficient related to the type of construction:

1.5 for wood construction (structure essentially combustible)

1.0 for ordinary construction (brick or other masonry walls, combustible floor and interior)

0.8 for noncombustible construction (unprotected metal structural components, masonry or metal walls)

0.6 for fire-resistive construction (fully protected frame, floors, roof)

Area of floors 2, 3 and 4 = 567 m²

$$A = \frac{1701}{m^2}$$

$$C = \frac{1.0}{m^2}$$

$$F = \frac{9,073}{L/min}$$

Rounded to nearest 1000 =

9,000

- 2) The value obtained in 1. may be reduced by as much as 25% for occupancies having a low

Non-combustible = -25%

Limited Combustible = -15%

Combustible = 0%

Free Burning = 15%

Rapid Burning = 25%

L/min

Reduction due to low occupancy hazard = -15% x 9,000 =

= 7,650 L/min

- 3) The value above may be reduced by up to 50% for automatic sprinkler system

Reduction due to automatic sprinkler system = -30% x 7,650 =

-2,295

- 4) The value obtained in 2. may be increased for structures exposed within 45 metres by the fire

Separation (metres)	Condition	Max Charge*
0m to 3.0m	1	25%
3.1m to 10.0m	2	20%
10.1m to 20.0m	3	15%
20.1m to 30.0m	4	10%
30.1m to 45.0m	5	5%
45.1m to	6	0%

Charge for separation has been modified by Technical Bulletin ISTB-2018-02 based on construction and Length-Height Ratio

Exposures	Distance(m)	Condition	Charge
Side 1 (north)	20.6	4	10%
Side 2 (south)	7.2	2	19%
Front (west)	32.2	5	5%
Back (east)	46.0	6	0%
			34%

Increase due to separation =

34% x 7,650 =

2,601 L/min

The fire flow requirement is =

7,650

Reduction due to Sprinkler = -2,295

Increase due to Separation = 2,601

7,956

The Total fire flow requirement is =

8,000 L/min

or 133.3 L/sec



Kollaard Associates

Engineers

210 Prescott Street, Unit 1

P.O. Box 189

Kemptville, Ontario K0G 1J0

Civil • Geotechnical •
Structural • Environmental •
Materials Testing •

(613) 860-0923

FAX: (613) 258-0475

Kollaard File # 180966 Page 1

December 18, 2018

Mark Fraser – Project Manager
Planning Infrastructure & Economic Development Department
Planning Services.

Re: Boundary Conditions - 841 Grenon Avenue

Kollaard Associates Inc has been retained by Nick Legault of Building Investments Inc. to complete the Site Servicing Plan and Site Servicing Report for the proposed residential development at 841 Grenon Avenue, Ottawa.

Could you provide us with the boundary conditions for the property based on the following information.

Type of Development: 4 storey, 33 Unit Residential Building – Sprinklered with minimum 1 hr fire rating on floor and wall assemblies. Using Technical Bulletin ISTB-2018-02 and ISO construction classes for building as provided in the technical bulletin, the exterior of the building will be constructed of non-combustible assemblies with a fire-resistance rating of 1 hour or longer and as such can be considered to be ordinary construction type (C = 1.0)

Location of Services: 841 Grenon Avenue

Amount of Fire Flow: 116.7 L/s (See attached fire flow requirements)

Average daily water demand: 0.25 L/s

Maximum daily water demand: 0.62 L/s

Maximum Hourly water demand: 1.37 L/s

Please note:

Fire flow is based on FUS calculations and takes into account the methodology provided in Technical Bulletin ISTB-2018-02


Design calculation spread sheets for FUS, and Water are attached

A sketch is attached showing proposed connection location

If there are any questions related to the above please contact the undersigned.

Sincerely,
KOLLAARD ASSOCIATES INC.

Steven deWit, P.Eng.

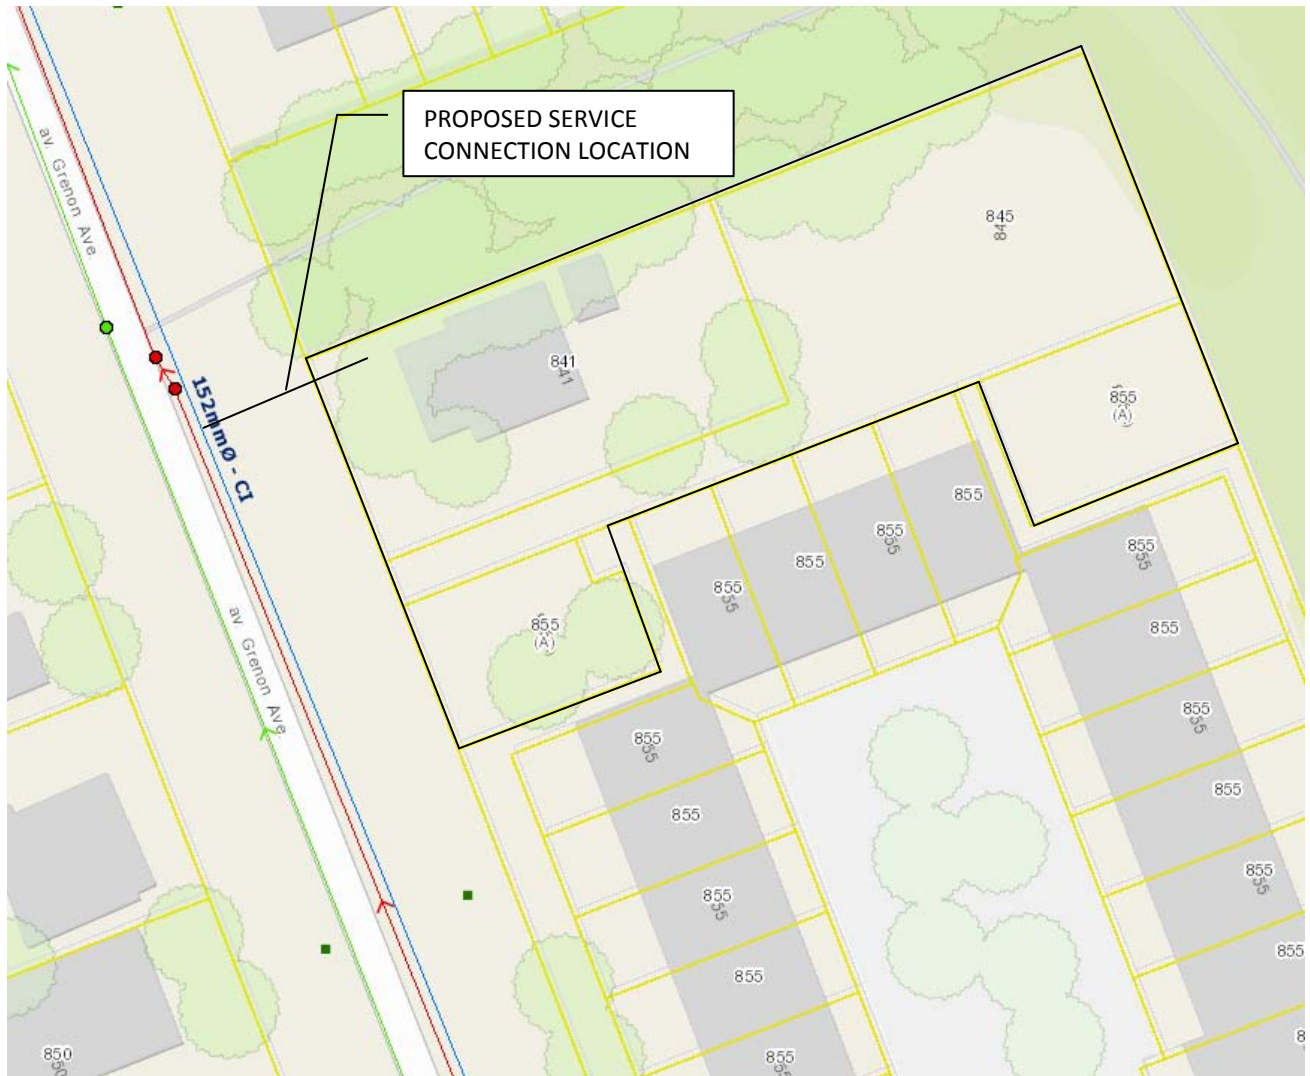

Subject: RE: 841 Grenon Avenue - Boundary Conditions Request

From: "Fraser, Mark" <Mark.Fraser@ottawa.ca>

Date: 20/12/2018, 4:06 p.m.

To: Steve deWit <steve@kollaard.ca>

Hi Steve,

The following are boundary conditions, HGL, for hydraulic analysis at 841 Grenon (zone 1W) assumed to be connected to the 152mm on Grenon (see attached PDF for location).

Minimum HGL = 107.2m

Maximum HGL = 115.7m

MaxDay + FireFlow (117 L/s) = 96.5m

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of water mains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

If you have any questions please let me know.

Regards,

Mark Fraser

Project Manager, Planning Services

Development Review West Branch

City of Ottawa | Ville d'Ottawa

Planning, Infrastructure and Economic Development Department

110 Laurier Avenue West, 4th Floor, Ottawa ON, K1P 1J1

Tel: 613.580.2424 ext. 27791

Fax: 613-580-2576

Mall: Code 01-14

Email: Mark.Fraser@ottawa.ca

**Please consider your environmental responsibility before printing this e-mail*

This message, including any document or file attached, is intended only for the addressee and may contain privileged and/or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

From: Steve deWit <steve@kollaard.ca>

Sent: December 18, 2018 2:24 PM

To: Fraser, Mark <Mark.Fraser@ottawa.ca>

Subject: 841 Grenon Avenue - Boundary Conditions Request

Good Afternoon Mark

Please see attached PDF letter requesting boundary conditions for 841 Grenon Ave.

Thank you

--

Steven deWit, P.Eng.

Kollaard Associates Inc

210 Prescott Street, Unit 1

P.O. Box 189

Kemptville, Ontario

K0G 1J0 CANADA

t: 613.860.0923 f: 613.258.0475

c: 613.223.4049

www.kollaard.ca

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Boundary Condition for 841 Grenon



Legend

Pipe Ownership

Ownership

— Private

— Public


Pipe Ownership

Ownership

— Private

Public



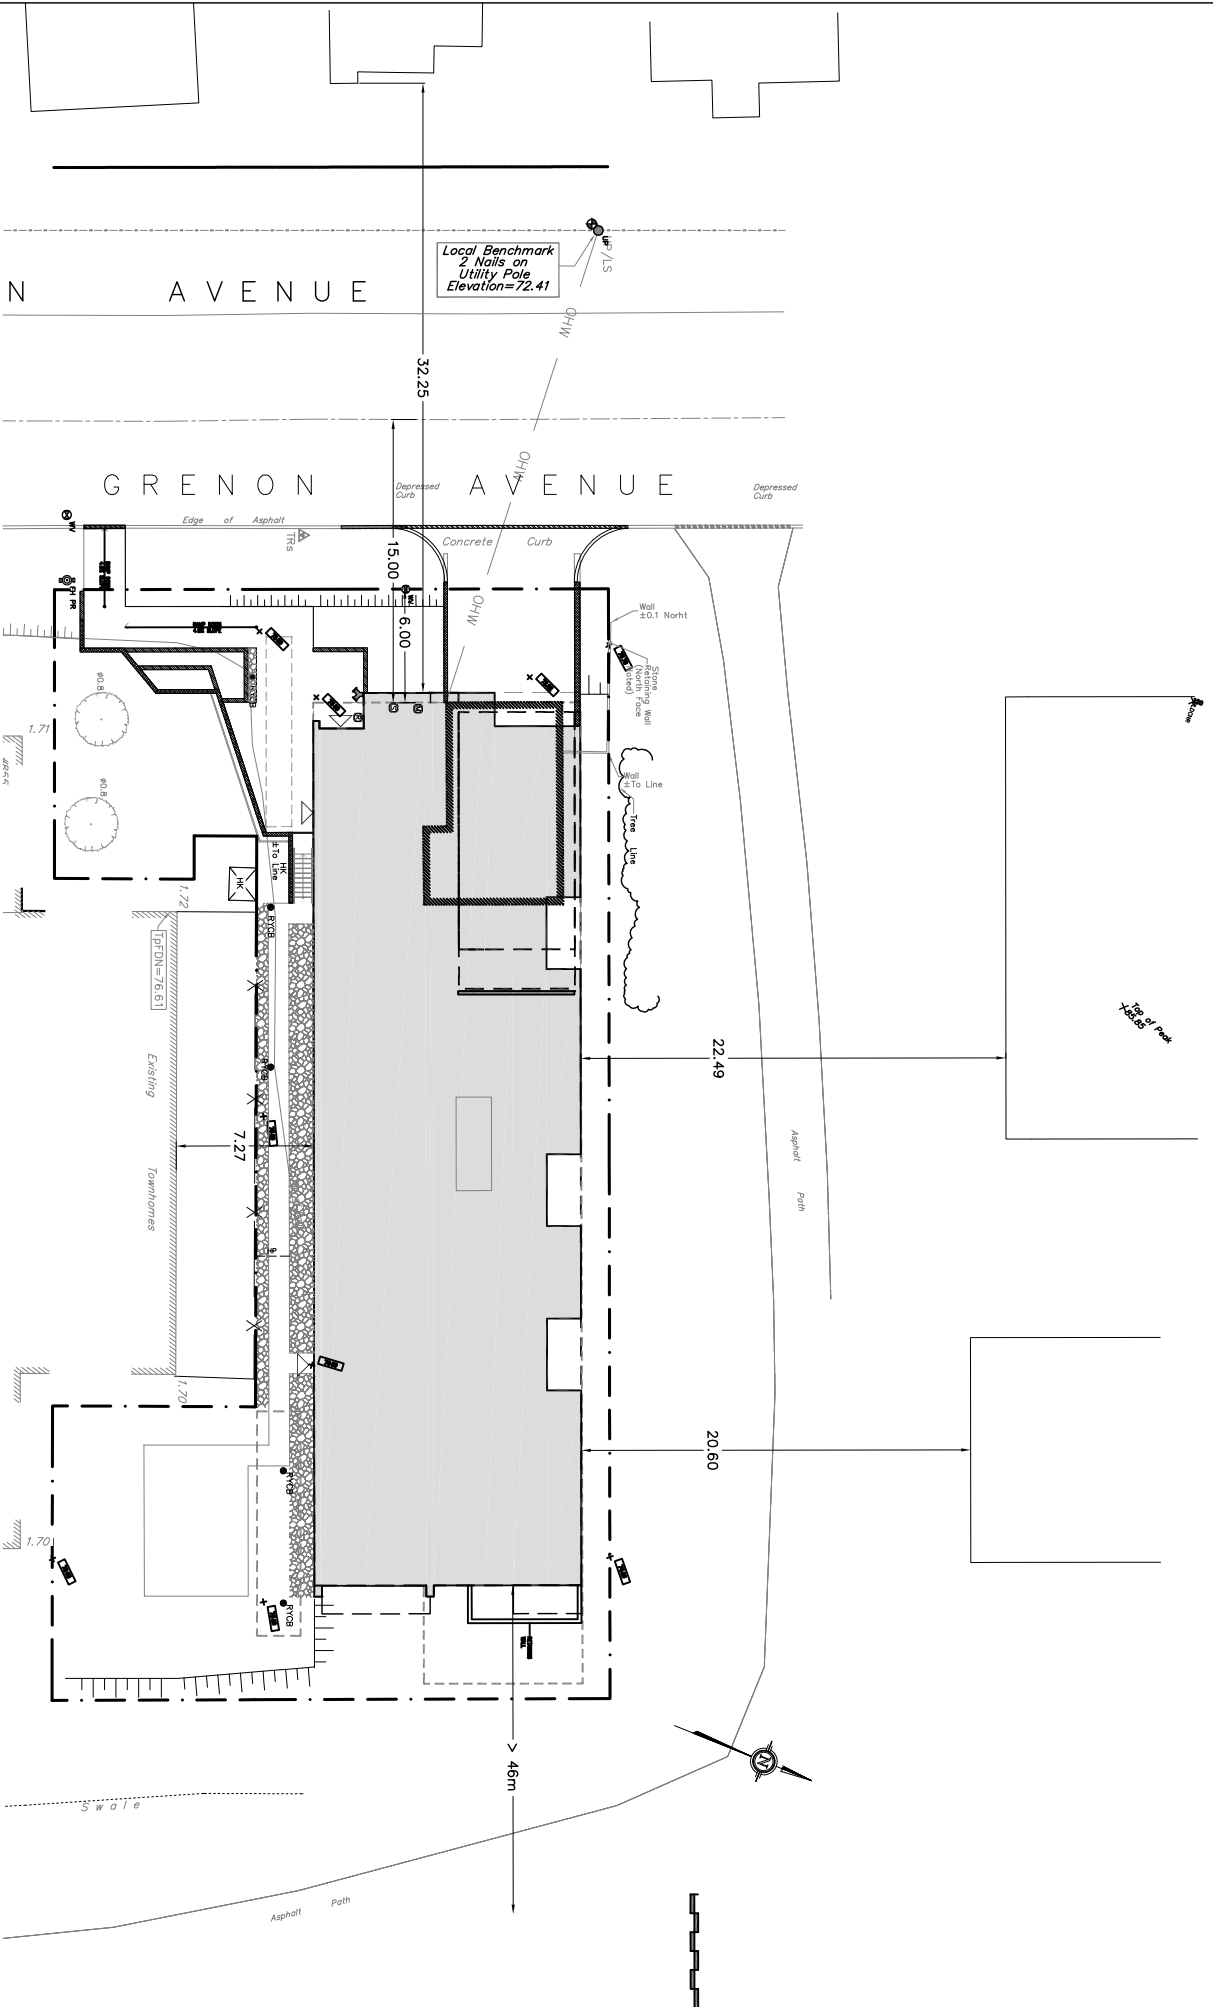

<p>Kollard Associates Engineers</p> <p>P.O. BOX 189, 210 PRESCOTT ST KEMPVILLE, ONTARIO K0G 1J0 FAX (613) 298-0475 http://www.kollard.ca</p>	<p>CLIENT: BUILDING INVESTMENTS INC. Nick Legault, CEO</p> <p>PROJECT: RESIDENTIAL APARTMENT BUILDING</p> <p>LOCATION: 841, 845 and 855(A) GRENON AVENUE, CITY OF OTTAWA, ON.</p>	<p>DESIGNED BY: SD</p> <p>DATE: AUG. 2, 2019</p>	<p>KOLLAARD FILE NUMBER: 180966</p>
<p>REVISION: RESPONSE TO COMMENTS 8 JAN. 2020</p>	<p>DRAWING NAME: FUS EXPOSURE DISTANCES</p>	<p>DRAWING NUMBER: 180966-FUS</p>	



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix E: Drawings

- 180966– PRE – PRE-DEVELOPMENT DRAINAGE
- 180966– POST – POST-DEVELOPMENT DRAINAGE
- 180966– SER – Site Servicing Plan
- 180966– GRD – Site Grading Plan
- 180966– ER – Sediment and Erosion Control




METRES

GENERAL NOTES:

1. All dimensions and all nature of alterations are in writing and signed by the Contractor.
2. This is not a legal survey. Boundary and topographic information must be obtained from a licensed surveyor.
3. The contract is based on FABRI, SMITH & JOHNSON, INC. File No. 15-19096.
4. Contractor is responsible for location and protection of utilities. Contractor is responsible for the location and protection of all existing structures. Contractor to verify exact locations of services and report any discrepancies to Fabrian Associates Inc., prior to construction.
5. Any changes made to this plan must be verified and approved by the Engineer.
6. Clean/Contractor is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit is obtained.
7. The proposed grades have been set and verified for site grading control only. The grade areas of the building footprint should be verified by the Contractor prior to construction.
8. The Contractor is responsible for obtaining all necessary geotechnical personnel after completion of the excavation.
9. The Contractor is responsible for obtaining all necessary recommendations with respect to the site-grade conditions prior to founding installation.
10. The Contractor is responsible for preparing an erosion and sediment control plan to the satisfaction of the City of Olney, appropriate to the site conditions, prior to undertaking any site work.
11. The Contractor is responsible for obtaining all necessary permits during all phases of the preparation and construction in accordance with the current Building and Planning Practices for the City of Olney.
12. The Contractor is responsible for obtaining all necessary permits for installing their efforts across member/catheters tie to prevent settlement from existing structures and install and maintain a minimum 24" clearance from existing structures.
13. All materials and construction to be in accordance with City of Olney standards and Olney Municipal Ordinance and Specification for the construction of the project.
14. The Contractor is responsible for obtaining all necessary permits for the minimum 24" clearance of cover for water services, for sewerage, stormwater, fire hydrant, and installation of disturbed areas and erosion control.
15. The contract is based on FABRI, SMITH & JOHNSON, INC. File No. 15-19096.
16. Design and Geotechnical Report File No. 15-09366 (dated January 15, 2015).

No.	REVISION	DATE	BY
5	PER CIVIC REVIEW COMMENTS	2020/01/08	UL
4	REVISED IN ACCORDANCE WITH REVISED SITE PLAN	2019/10/21	UL
3	PER REVIEW COMMENTS/SITE PLAN REVISIONS	2019/08/06	UL
2	ISSUED SPA SUBMISSION	2019/07/23	UL
1	ISSUED FOR CLIENT REVIEW	2019/01/24	UL
0	PRELIMINARY	2018/12/13	UL
#	REVISION ITEM / DESCRIPTION	REV. DATE	



P.O. BOX 189, 210 PRESCOTT ST
KEMPTVILLE, ONTARIO
K0G 1J0 FAX (613) 258-0475
<http://www.kollard.ca>


BUILDING INVESTMENTS INC.
Nick Legault, CEO
205-1320 Carling Ave
Ottawa, ON, K1Z7K8
Tel 613-853-4833
email nlegault@Buildinginvestments.ca

PROJECT:

RESIDENTIAL APARTMENT BUILDING

LOCATION:

841, 845 and 855(A) GRENON AVENUE
CITY OF OTTAWA, ON.


	LICENSED PROFESSIONAL ENGINEER (January 08, 2008) S.E. deMott 100079612	
	PROVINCE OF ONTARIO	DATE: DEC. 12, 2018
SHEET 2/2	DRAWN BY: ML APPROVED BY: SD	DESIGNED BY: SD CHECKED BY:

DRAWING No: 180966-GRD

DRAWING NAME: SITE GRADING PLAN


#17891

D07-12-19-0018

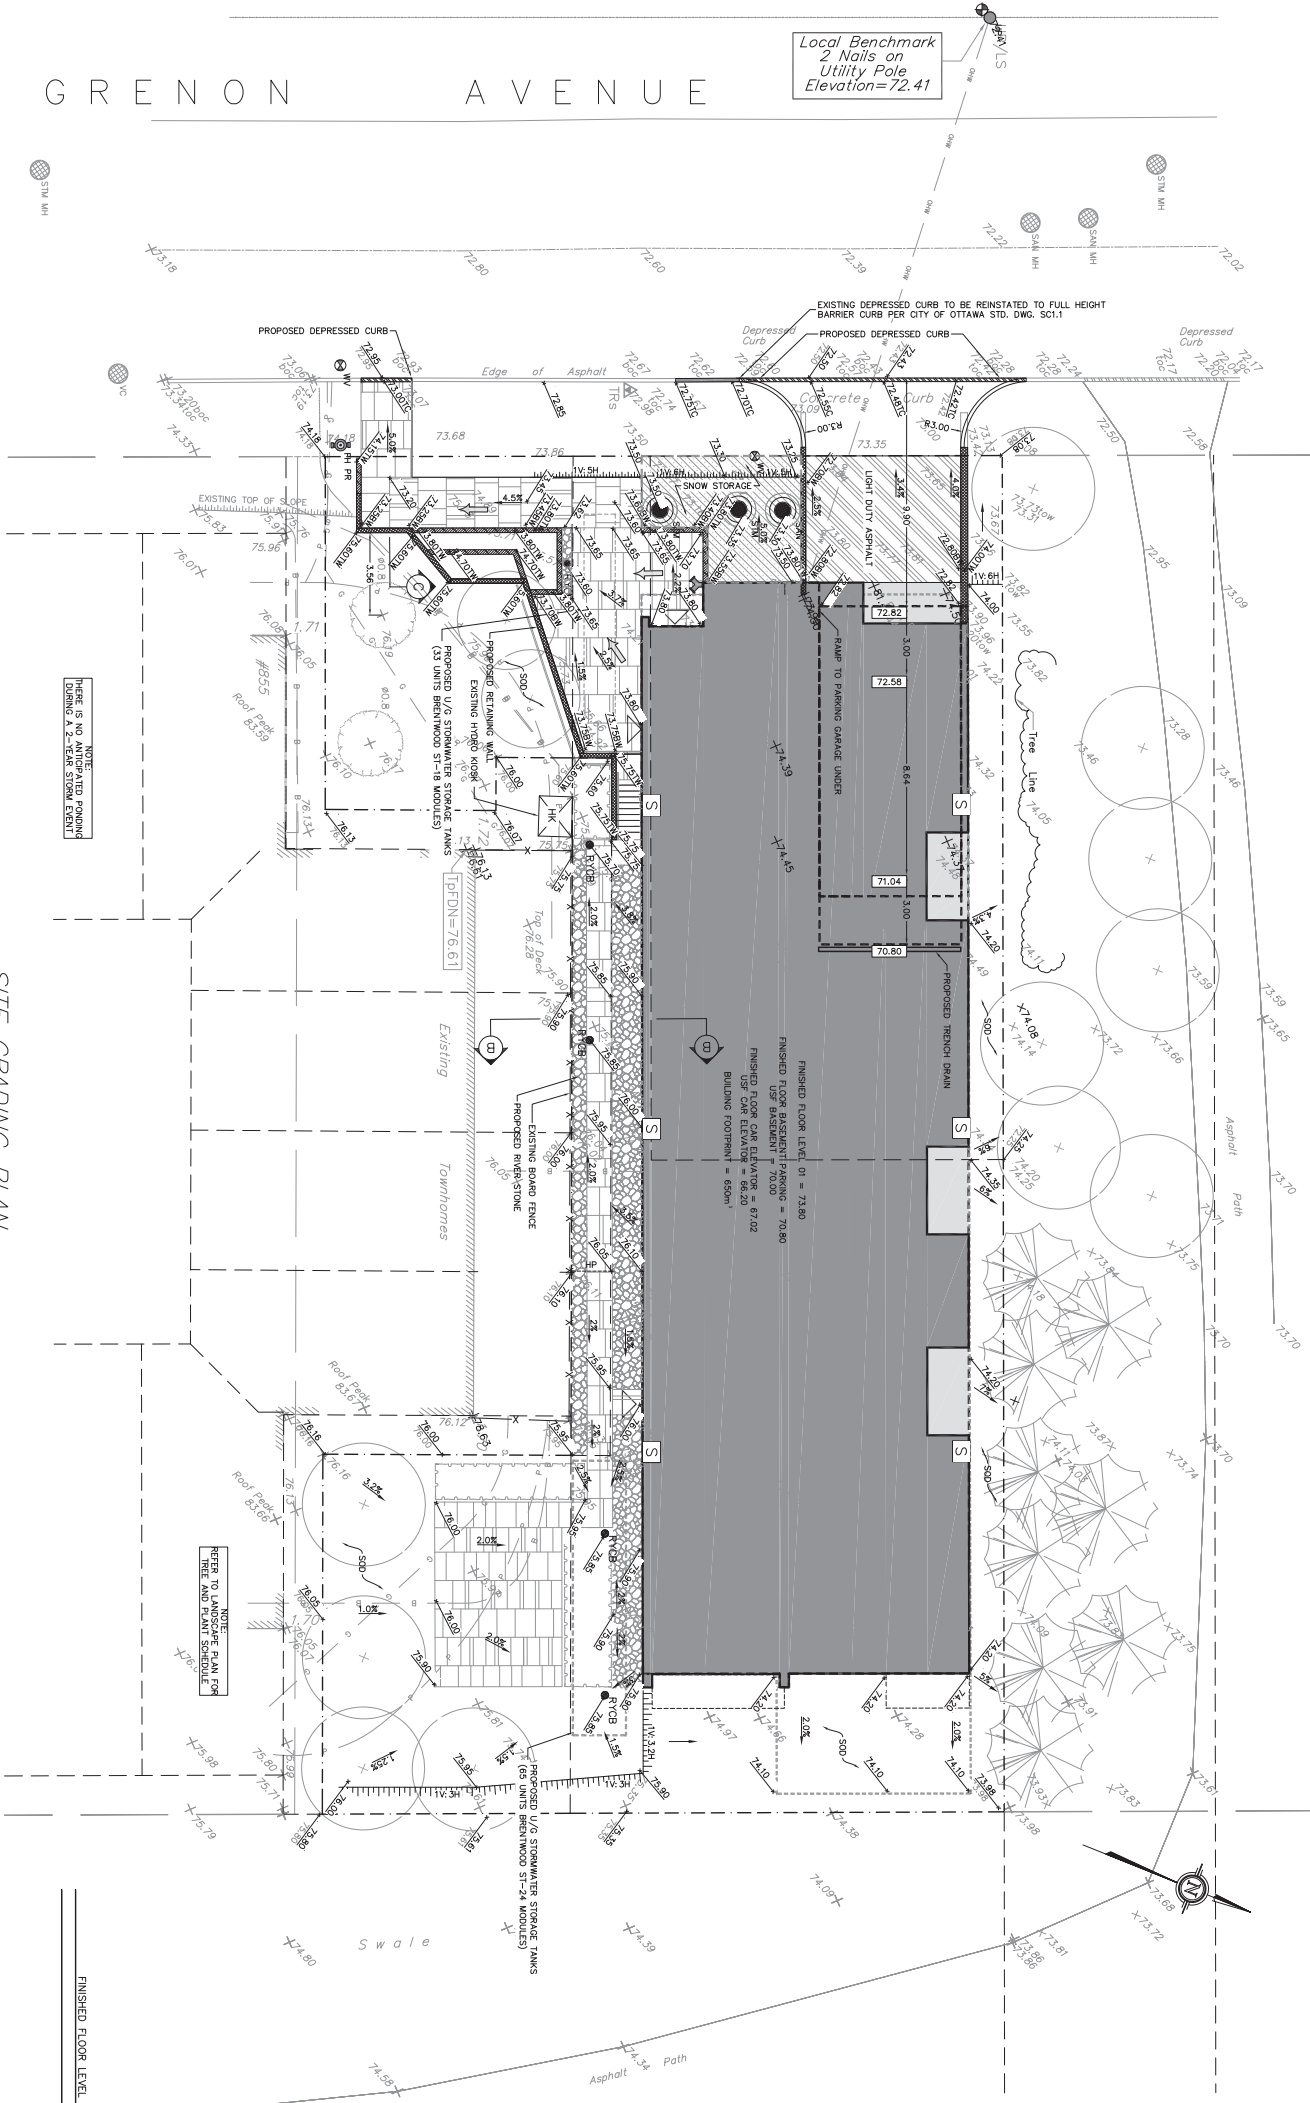


SITE GRADING PLAN
SCALE = 1:150

SCALE = 1:150

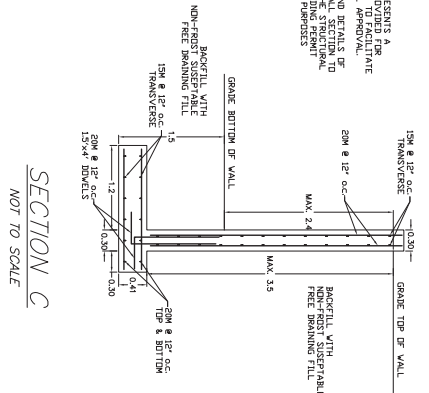

SECTION C
NOT TO SCALE

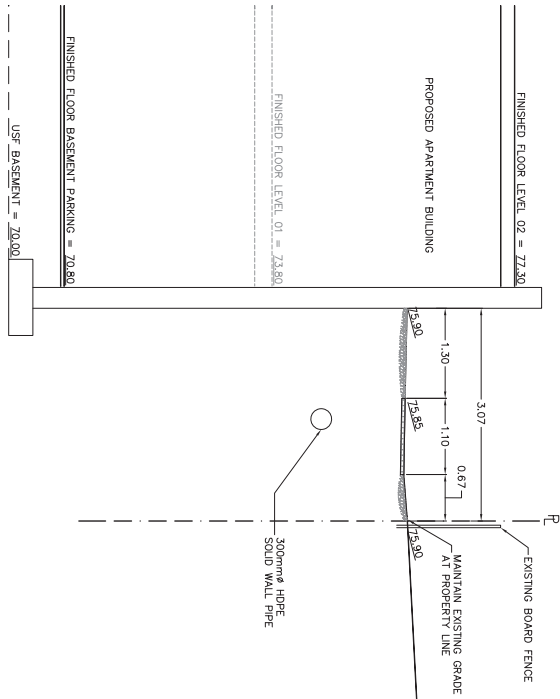


SECTION B-B


NOT TO SCALE

ADDITIONAL NOTES:

1. THE FIRE ON DEMAND BASED ON FUS WAS CALCULATED ASSUMING THE FOLLOWING:
 - POURED CONCRETE CONSTRUCTION UP TO THE LEVEL OF THE SECOND FLOOR (SECOND FLOOR IS POURED CONCRETE)
 - EXTERIOR WALLS ARE NON-COMBUSTIBLE CONSTRUCTION
 - INTERIOR WOOD FRAME CONSTRUCTION
 - AUTOMATIC SPRINKLERS IN BUILDING
 - SEPARATION DISTANCES AS INDICATED ON DRAWING 180966-FUS



LEGEND	
	EXISTING ELEVATION
	PROPOSED/ELEVATION
	DRAINAGE SLOPE
	WATERMAIN
	STORM SEWER
	SANITARY SEWER
	TOP OF SLOPE
	PROPERTY LINE
	OVERHEAD WIRE
	STRUCTURAL RETAINING WALL
	LANDSCAPE RETAINING WALL
	SILTY FENCE
	OVERLAND FLOW ROUTE
	EXISTING UTILITY POLE
	EXISTING FIRE HYDRANT
	EXISTING WATER VALVE
	PROPOSED FIRE HYDRANT
	PROPOSED FIRE DEPARTMENT CONNECTION
	PROPOSED WATER VALVE
	WATER METER
	REMOTE WATER METER
	SUMP AND SUMP PUMP LOCATION
	PROPOSED SUMP LOCATION
	EXISTING STORM MANHOLE
	EXISTING SANITARY MANHOLE
	EXISTING VALVE CHAMBER
	EXISTING CATCH BASIN
	PROPOSED CATCH BASIN/MANHOLE
	PROPOSED STORM MANHOLE
	PROPOSED SANITARY MANHOLE
	PROPOSED CATCH BASIN
	PROPOSED REAR-YARD CATCH BASIN
	TEMPORARY BENCHMARK
	ITEM TO BE REMOVED

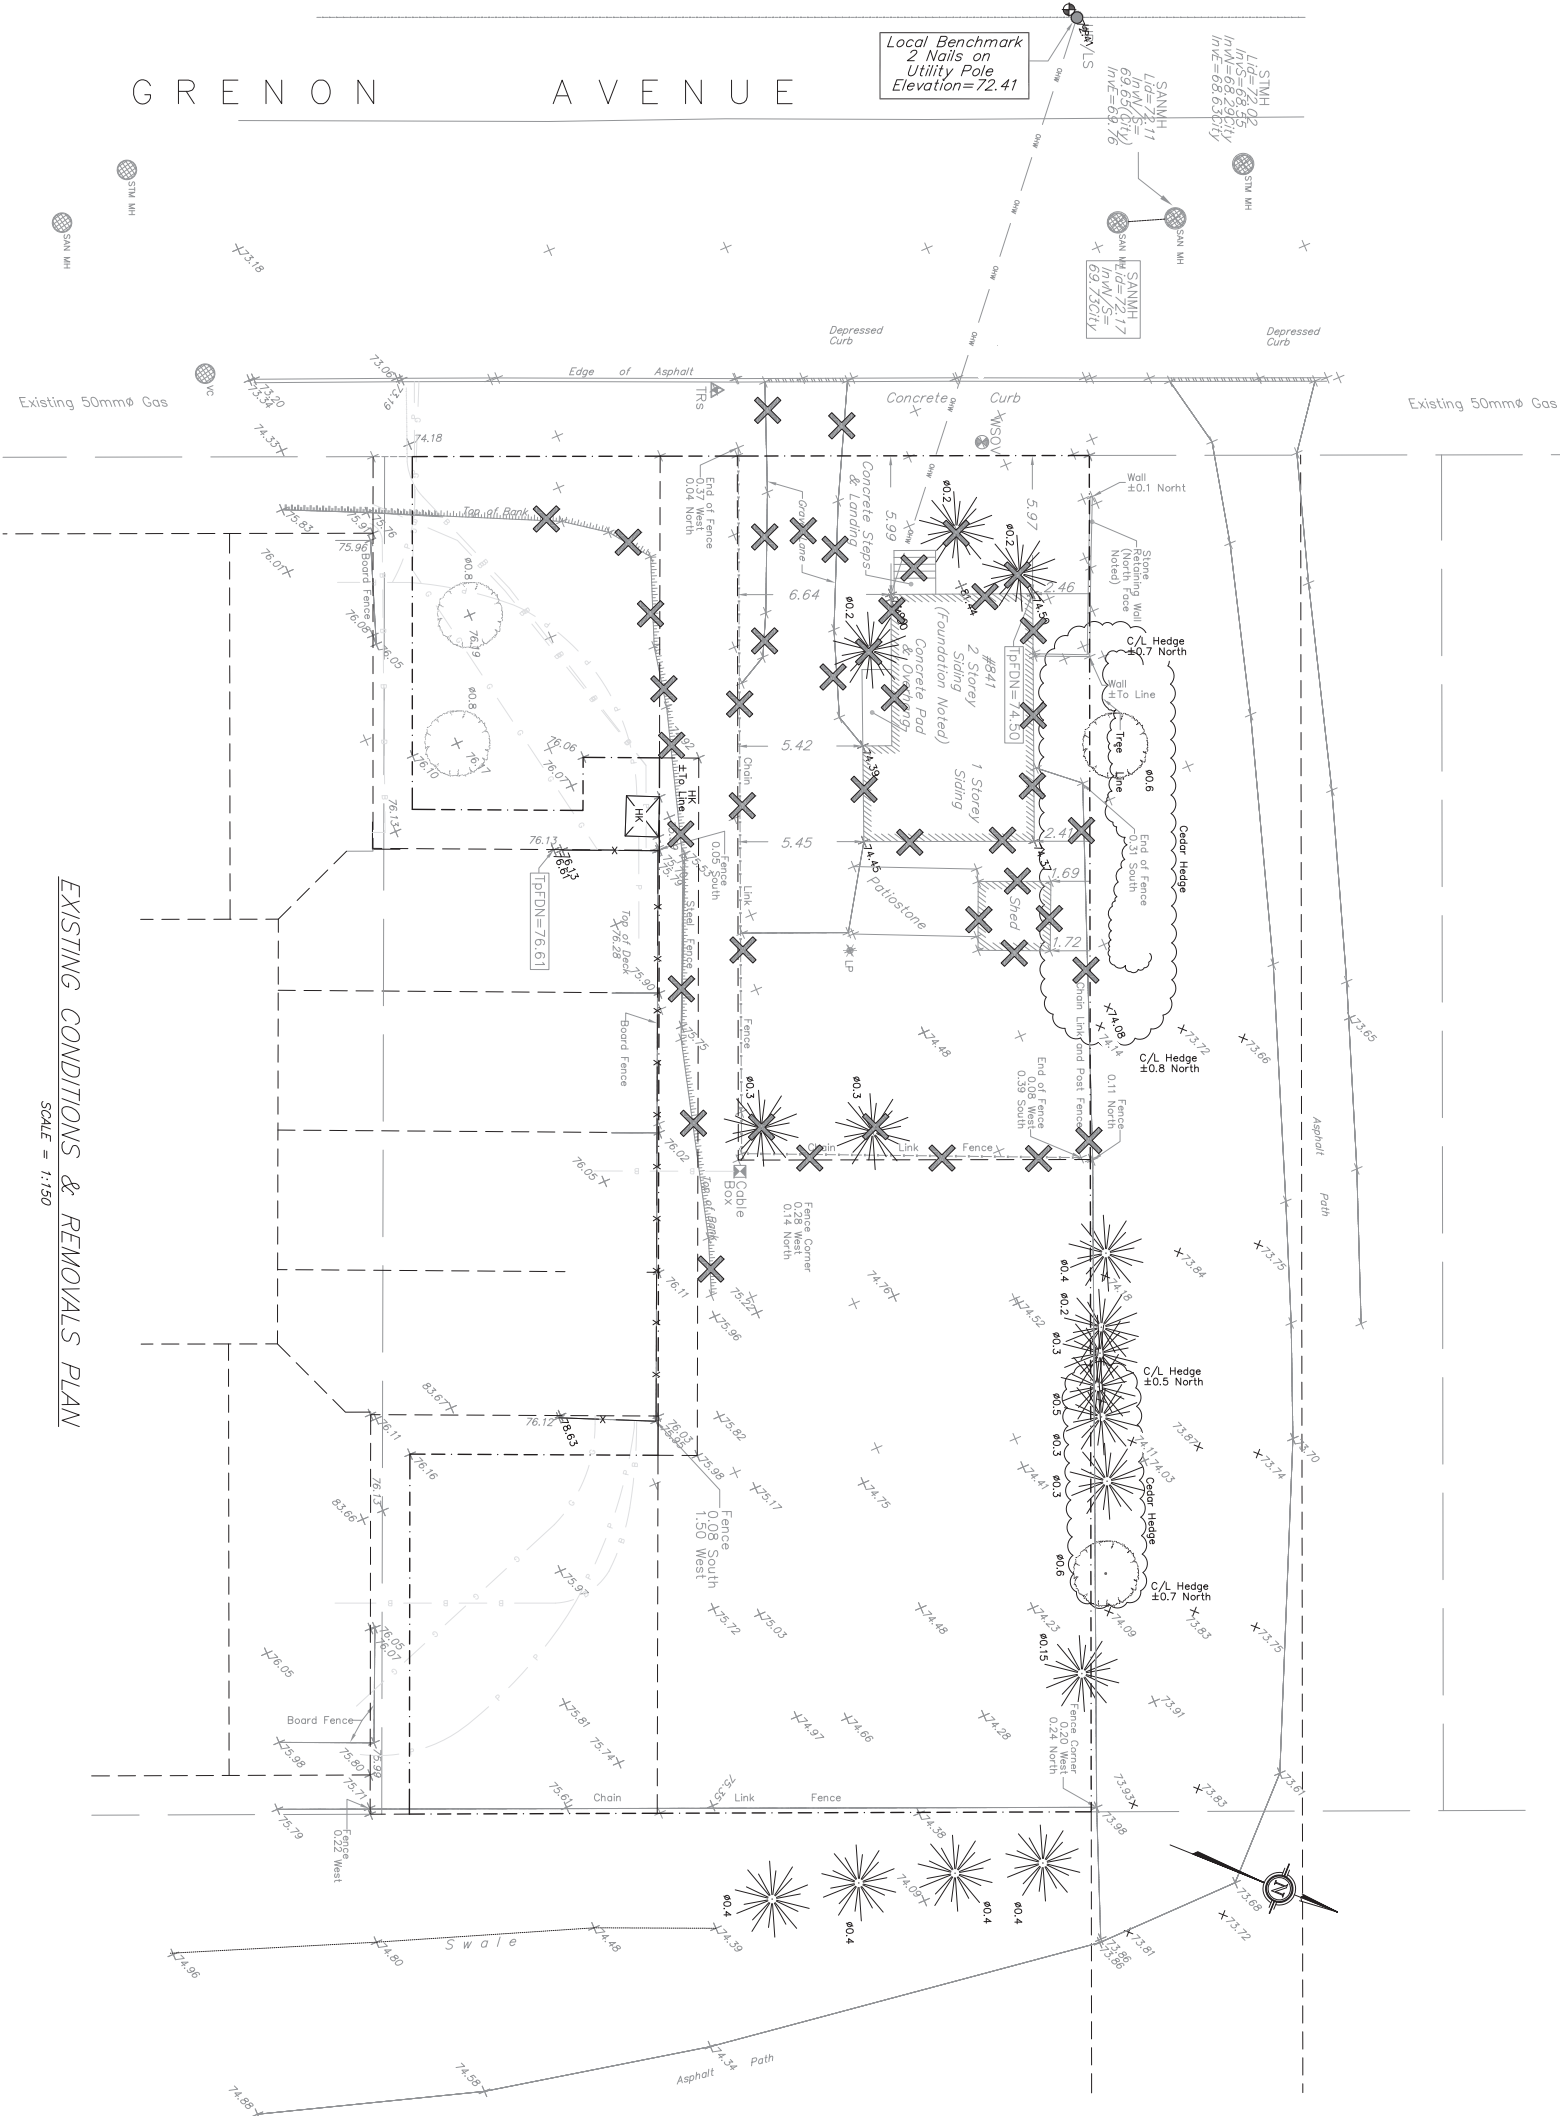

EXISTING CONDITIONS & REMOVALS PLAN

SCALE = 1:150



Kollaard Associates
Engineers
(613) 860-0923
info@kollaard.ca

CLIENT: BUILDING INVESTMENTS INC.
Nick Legault, CEO
2075 KENNEDY RD. UNIT 104
OTTAWA, ONTARIO K1A 1A9
Tel 613-853-4833
email: nlegault@buildinginvestments.ca

PROJECT: RESIDENTIAL APARTMENT BUILDING

LOCATION: 841, 845 and 855(A) GRENON AVENUE,
CITY OF OTTAWA, ON.

DESIGNED BY:	CHECKED BY:
ML	SD
DATE:	DEC. 12, 2018
SKETCH BY:	

DRAWING No: 180966-EX

DRAWING NAME:




- GENERAL NOTES:




- EROSION AND SEDIMENT CONTROL NOTES:

- ### MINIMUM EROSION AND SEDIMENT CONTROL PLAN REQUIREMENTS:

- email nlegault@BuildingInvestments.ca



#17891



- Specifications: sewer and wastewater material types: disinfection, provide minimum 2.4 metres of cover for water services, cathodic protection, City of Ottawa insulation specifications for wastewater, pipe bedding, reinstatement of disturbed areas and leakage testing.
15. Refer to Kollford File 180966 for Stormwater Management Design and Geotechnical Report File No. 180966 (dated January 13, 2019).

Kollard Associates
Engineers

<http://www.kollard.ca>

email niegault@BuildingInvestments.co

LOCATION:

CITY OF OTTAWA, ON.



DRAWING NAME:

#1891




DATA COLLECTION: 1992-2001



- [illegible]

NO.	REVISION	DATE	BY
3	PER CITY REVIEW COMMENTS	2009/07/08	ML
2	REVISED IN ACCORDANCE WITH REVISED SITE PLAN	2010/10/21	ML
1	PER CITY REVIEW COMMENTS	2010/08/06	ML
0	PRELIMINARY	2010/12/13	ML
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

 **Kollard Associates**
Engineers


(613) 860-0923
info@kollard.ca

P.O. BOX 189, 210 PRESCOTT ST.
KEMPVILLE, ONTARIO
K0G 1J0 FAX (613) 258-0475
http://www.kollard.ca

BUILDING INVESTMENTS INC.
Nick Legault, CEO
205-1320 Carling Ave
Ottawa, ON, K1Z7K8
Tel 613-853-4833
email nlegault@BuildingInvestments.ca

RESIDENTIAL APARTMENT BUILDING

841, 845 and 855(A) GRENON AVENUE
CITY OF OTTAWA, ON.

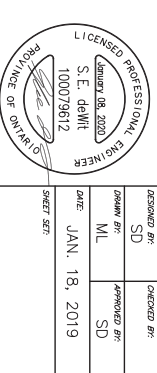

180966-POST

POST-DEVELOPMENT CATCHMENT AREAS





Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix F: Correspondence

Hi Laurel,

This is a follow-up to the pre-application consultation meeting regarding a proposed development at **841 Grenon Avenue**. Please forward the below information to the applicant:

General:

- Please be advised that as the subject site is comprised of 4 separate parcels of land the approval exemption under O.Reg. 525/98 would not apply and an Environmental Compliance Approval (ECA) would be required.

Ontario Regulation 525/98:

3. Subsection 53(1) and (3) of the Act do not apply to the use, operation, establishment, alteration, extension or replacement of or a change in a storm water management facility that,

(a) is designed to service one lot or parcel of land;

(b) discharges into a storm sewer that is not a combined sewer;

(c) does not service industrial land or a structure located on industrial land; and

(d) is not located on industrial land.

If the parcels are consolidated into one parcel the noted approval exemption would apply subject to confirmation that there is no external drainage from the adjacent lands.

- Any easements on the subject site shall be identified and respected by any development proposal and shall adhere to the conditions identified in the easement agreement. All easements shall be shown on the engineering plans.
- Please provide an **Existing Conditions/Removals Plan** as part of the engineering drawing set.
- As per the *City of Ottawa Slope Stability Guidelines for Development Applications (Section 5.8)* an engineering report prepared by a qualified geotechnical engineer licensed in the province of Ontario is required to be provided for any retaining walls proposed greater than 1m in height that establishes that the retaining wall will have a FS of 1.5 or greater against global instability and considered stable from a global stability perspective. Retaining wall design drawings are required to be provided in addition to the report
- Please note that servicing and site works shall be in accordance with the following documents:
 - Ottawa Sewer Design Guidelines (October 2012)
 - Technical Bulletin PIEDTB-2016-01
 - Technical Bulletins ISTB-2018-01, ISTB-2018-02 and ISTB-2018-03.
 - Ottawa Design Guidelines – Water Distribution (2010)
 - Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
 - City of Ottawa Accessibility Design Standards (2012)
 - Ottawa Standard Tender Documents (latest version)
 - Ontario Provincial Standards for Roads & Public Works (2013)

Disclaimer:

The City of Ottawa does not guarantee the accuracy or completeness of the data and information contained on the above image(s) and does not assume any responsibility or liability with respect to any damage or loss arising from the use or interpretation of the image(s) provided. This image is for schematic purposes only.

Stormwater Management Criteria:

- In the absence of area specific SWM criteria please control post-development runoff from the subject site, up to and including the 100-year storm event, to a pre-development **2-year allowable release rate** calculated using an allowable runoff coefficient (C) determined using the smaller of a runoff coefficient of 0.5 or the **actual pre-development existing site runoff coefficient** (Cl.8.3.7.3), and a computed time of concentration (T_c) using an appropriate method to justify the parameter selection (*T_c of 20 minutes should be used for all pre-development calculations without engineering justification; T_c of 10 minutes shall be used for all post-development calculations*).
- Please be aware that the receiving storm system is uncontrolled and therefore subject to surcharge conditions. This condition may impact any proposed underground storage system. It shall be demonstrated at that time that the downstream storm system does not backup into the site and fill the underground storage before it can be utilized as available internal site drainage.
- As stormwater treatment is not addressed offsite (ultimate outlet is the Ottawa River), onsite measures may be requested/required. Please consult with the local conservation authority (RVCA) regarding water quality criteria prior to submission of a Site Plan Control Proposal application to establish the water quality control criteria for the site.
- As per *Technical Bulletin PIEDTB-2016-01 section 8.3.11.1 (p.12 of 14)* **there shall be no surface ponding on private parking areas during the 2-year storm rainfall event**. Depending on the SWM strategy proposed underground or additional underground storage may be required to satisfy this requirement.
- When using the modified rational method to calculate the storage requirements for the site any underground storage (pipe storage etc.) should not be included in the overall available storage. The modified rational method assumes that the restricted flow rate is constant throughout the storm which underestimates the storage requirement prior to the 1:100 year head elevation being reached. Please note that if you wish to utilize any underground storage as available storage, the $Q_{(release)}$ must be modified to compensate for the lack of head on the orifice. An assumed average release rate equal to 50% of the peak allowable rate shall be applied. Otherwise, disregard the underground storage as available storage or provide modeling to support SWM strategy.
- Please note that the minimum orifice dia. for a plug style ICD is 83mm and the minimum flow rate from a vortex ICD is 6 L/s in order to reduce the likelihood of plugging.
- Emergency overland flow shall be directed to Grenon Ave.
- Please ensure that the proposed elevation at the front property line through the proposed private approach is a minimum 30cm higher (vertical clearance above the spill elevation) than the established spill elevation on Grenon Ave. to ensure that during extreme events and if a catchbasin becomes blocked, the major system on Grenon Ave. will spill to the next downstream roadway segment and not back onto the subject site property down into the underground parking garage.
- Post-development site grading shall match existing property line grades in order to minimize disruption to the adjacent residential properties.
- Please provide a **Pre-Development Drainage Area Plan** to define the pre-development drainage areas/patterns. How much of the subject site drains to Grenon Ave. and how much of the site drains overland to the rear of the property under pre-development conditions?

Storm Sewer:

- A 525mm dia. concrete storm sewer is located within Grenon Ave.

- A storm sewer monitoring maintenance hole is required to be installed at the property line (inside the property, not in a parking area) as per City of Ottawa Sewer-Use By-Law 2003-514 (14) *Monitoring Devices*.

Sanitary:

- A 225mm dia. sanitary sewer is located with Grenon Ave.
- **Analysis and demonstration that there is sufficient/adequate residual capacity to accommodate any increase in wastewater flows in the receiving and downstream wastewater system is required to be provided.**
- Please review the wastewater design flow parameters in *Technical Bulletin PIEDTB-2018-01*.
- A sanitary sewer monitoring maintenance hole is required to be installed just outside of the sewer easement to satisfy *Sewer-Use By-Law 2003-514 (14) Monitoring Devices*.

Water:

- A 152mm dia. watermain is located in Grenon Ave.
- Please review Technical Bulletin ISTB-2018-0, maximum fire flow hydrant capacity is provided in Section 3 Table 1 of Appendix I. The City will not accept the installation of a new public hydrant to support this development.
- As per City of Ottawa By-Law 2013-360 Section 75 *Every person applying for a Water Connection Permit shall be required to pay a Frontage Charge if applicable. A Watermain Frontage Fee* appears to be applicable to the subject site. A fee of approx. **\$5,568.90** (29.31m x \$190/m) would be required to be provided prior to registration of the Site Plan Agreement. (The exact fee amount will be confirmed by ROW Approval Unit once an application has been submitted).
- Residential buildings with a basic day demand greater than 50m³/day are required to be connection to a minimum of two water services separated by an isolation valve to avoid a vulnerable service area as per the *Ottawa Design Guidelines - Water Distribution, WDG001, July 2010 Clause 4.3.1 Configuration*. The basic day demand is anticipated to exceed 50m³/day therefore 2 water service are required.
- The subject site is located within the 1W Pressure Zone.
- Please provide the following information to the City of Ottawa via email to request water distribution network boundary conditions for the subject site. Please note that once this information has been provided to the City of Ottawa it takes approximately 5-10 business days to receive boundary conditions.
 - Type of Development
 - Site Address
 - A plan showing the proposed water service connection location.
 - **Average Daily Demand** (L/s)
 - **Maximum Daily Demand** (L/s)
 - **Peak Hour Demand** (L/s)
 - **Fire Flow** (L/min)

[Fire flow demand requirements shall be based on Fire Underwriters Survey (FUS) Water Supply for Public Fire Protection 1999]

Exterior Site Lighting:

- Please note that any proposed light fixtures (both pole-mounted and wall mounted) must be part of the approved Site Plan. All external light fixtures must meet the criteria for Full Cut-off Classification as recognized by the

Illuminating Engineering Society of North America (IESNA or IES), and must result in minimal light spillage onto adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable spillage). In order to satisfy these criteria, the please provide the City with a **Site Lighting Plan, Photometric Plan and Certification (Statement) Letter** from an acceptable professional engineer stating that the design is compliant.

Snow Storage:

- Any portion of the subject property which is intended to be used of permanent or temporary snow storage shall be as shown on the approved site plan and grading plan. Snow storage shall not interfere with approved grading and drainage patterns or servicing. Snow storage areas shall be setback from the property lines, foundations, fencing or landscaping a minimum of 1.5m. Snow storage areas shall not occupy driveways, aisles, required parking spaces or any portion of a road allowance. If snow is to be removed from the site please indicate this on the plan(s).

Permits and Approvals:

- The consultant shall determine if this project will be subject to an Environmental Compliance Approval (ECA) for Private Sewage Works. It shall be determined if the exemptions set out under Ontario Regulation 525/98: *Approval Exemptions* are satisfied.

Capital Works:

- No **Capital Construction** works are currently planned for Grenon Ave.

Phase One Environmental Site Assessment:

- A Phase 1 ESA is required to be completed in accordance with Ontario Regulation 153/04 in support this development proposal to determine the potential for site contamination.

Geotechnical Investigation:

- A Geotechnical Study shall be prepared in support of this development proposal.
- The geotechnical engineer of record shall review the proximity of the existing townhome foundations to the proposed underground parking garage and provide recommendations to ensure the existing units not compromised during construction. There is concern that the foundations of these existing units could be undermined and compromised during construction due to the proximity of the proposed underground parking garage.

Please note that these comments are considered preliminary based on the information available to date and therefore maybe amended as additional details become available and presented to the City.

If you have any questions or require any clarification please let me know.

Regards,

Mark Fraser

Project Manager, Planning Services

Development Review West Branch

City of Ottawa | Ville d'Ottawa

Planning, Infrastructure and Economic Development Department

110 Laurier Avenue West. 4th Floor, Ottawa ON, K1P 1J1

[Tel:613.580.2424](tel:613.580.2424) ext. 27791

Fax: 613-580-2576

Mail: Code 01-14

Email: Mark.Fraser@ottawa.ca

*Please consider your environmental responsibility before printing this e-mail

This message, including any document or file attached, is intended only for the addressee and may contain privileged and /or confidential information. Any person is strictly prohibited from reading, using, disclosing or copying this message. If you received this message in error, please notify the sender and delete the message. Thank you.

Subject: RE: Storm Water Control Requirements for 841 Grenon Avenue

From: Eric Lalande <eric.lalande@rvca.ca>

Date: 07/08/2019, 2:55 p.m.

To: 'Steve deWit' <steve@kollaard.ca>

Hi Steve,

The RVCA typically requires 80% TSS removal for water quality control, given that the site is intended to be entirely rooftop and landscaped area, with all parking internal to the building, the RVCA will not have any concerns from a water quality requirements perspective. The RVCA does encourage opportunities for best management practices and improved infiltration on-site.

I trust this addresses your question below.

Thank you,

Eric Lalande, MCIP, RPP
Planner, Rideau Valley Conservation Authority
613-892-3571 x1137

From: Steve deWit <steve@kollaard.ca>

Sent: Wednesday, August 07, 2019 2:12 PM

To: Eric Lalande <eric.lalande@rvca.ca>

Subject: Storm Water Control Requirements for 841 Grenon Avenue

Good Afternoon Eric.

As per our conversation, we are completing the stormwater management design for a proposed residential development at 841 Grenon Avenue.

All of the parking will be inside the building. The exterior of the building will have some interlock stone paving for sidewalks and patio while the rest will be landscaped / grass surfaces.

I have attached the current site plan received from the Architect (and building drawings included in the pdf) for your reference.

Thank you

--

Steven deWit, REng.
Kollaard Associates Inc
210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0 CANADA
t: 613.860.0923 f: 613.258.0475
c: 613.223.4049
www.kollaard.ca



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix G: Servicing Guidelines Checklist

4.1 General Content

- ☒ Executive Summary (for larger reports only).

Comments: N/A

- ☒ Date and revision number of the report.

Comments: Refer to cover page of the Servicing & Stormwater Management Report- Dated January 8, 2020 Rev 3

- ☒ Location map and plan showing municipal address, boundary, and layout of proposed development.

Comments: Refer to drawings 180966-SER and 180966-GRD in appendix E of the SSMR

- ☒ Plan showing the site and location of all existing services.

Comments: Refer to drawing 180966-SER in appendix E of the SSMR.

- ☒ Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.

Comments: Refer to Architectural Site plan by Project1 Studio Incorporated, and Topographic Plan of Survey by Farley Smith & Denis Surveying Ltd.

- ☒ Summary of Pre-consultation Meetings with City and other approval agencies.

Comments: Pre-Consultation Meeting with City had taken place August 23, 2018 Included in Appendix F of the SSMR

- ☒ Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.

Comments: Conformance to City of Ottawa Guidelines, No higher level studies applicable

- ☒ Statement of objectives and servicing criteria.

Comments: Refer to section 2.0 of the SSMR for Storm, Section 3 for Sanitary and Section 4 for Water.

- ☒ Identification of existing and proposed infrastructure available in the immediate area.

Comments: Refer to drawing 180966-SER for location, size and depth. Drawing located in appendix E of the SSMR.

- ☒ Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).

Comments: *N/A Discharge to City of Ottawa Storm Sewer System*

- ☒ Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.

Comments: *There is no Master Grading Plan - Refer to grading plan 180966-GRD located in appendix E of the SSMR.*

- ☒ Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.

Comments: *N/A*

- ☒ Proposed phasing of the development, if applicable.

Comments: *N/A*

- ☒ Reference to geotechnical studies and recommendations concerning servicing.

Comments: *Reference Geotechnical Report Kollaard Project # 180966 Rev. 1 dated August 7, 2019*

- ☒ All preliminary and formal site plan submissions should have the following information:

- ☒ Metric scale
- ☒ North arrow (including construction North)
- ☒ Key plan
- ☒ Name and contact information of applicant and property owner
- ☒ Property limits including bearings and dimensions
- ☒ Existing and proposed structures and parking areas
- ☒ Easements, road widening and rights-of-way
- ☒ Adjacent street names

Comments: *Refer to drawings in appendix E of the SSMR*

4.2 Development Servicing Report: Water

- ☒ Confirm consistency with Master Servicing Study, if available

Comments: N/A
- ☒ Availability of public infrastructure to service proposed development

Comments: Refer to Section 3 and 4 of the SSMR.
- ☒ Identification of system constraints

Comments: Yes - boundary conditions were received. Boundary Conditions can be found in appendix D of of the SSMR - Also response from City including System Constraints
- ☒ Identify boundary conditions

Comments: Boundary Conditions can be found in appendix D of the SSMR
- ☒ Confirmation of adequate domestic supply and pressure

Comments: Refer to Section 4.0 - Watermain Design of the SSMR.
- ☒ Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.

Comments: Refer to Appendix D of the SSMR and Section 4.0
- ☒ Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.

Comments: Pressure Reducing Valves not Required. Booster pump required to service top floor. See section 4.0 of the SSMR
- ☒ Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design

Comments: No phasing involved with this project
- ☒ Address reliability requirements such as appropriate location of shut-off valves

Comments: N/A
- ☒ Check on the necessity of a pressure zone boundary modification.

Comments: The water pressure available at the site is above the minimum residual pressure at the ground floor level - Section 4.0 of the SSMR

- ☒ Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range

Comments: Refer to Section 4.0 - Watermain Design in the SSMR

- ☒ Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.

Comments: 4 storey residential building serviced by mm waterservice, refer to Drawing 180966-SER in appendix E of the SSMR

- ☒ Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.

Comments: N/A

- ☒ Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.

Comments: Refer to Section 4.0 - Watermain Design in the SSMR

- ☒ Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.

Comments: Refer to appendix D of the SSMR

4.3 Development Servicing Report: Wastewater

- ☒ Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).

Comments: Refer to Section 3.0 of the SSMR.

- ☒ Confirm consistency with Master Servicing Study and/or justifications for deviations.

Comments: No Master Servicing Study, Design Conformance with Ottawa Sewer Design Guidelines.

- ☒ Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.

Comments: There are no local conditions of this nature. Refer to Section 3.0 of the SSMR.

- ☒ Description of existing sanitary sewer available for discharge of wastewater from proposed development.

Comments: Refer to drawing 180966-SER is appendix E of the SSMR.

- ☒ Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)

Comments: Refer to Section 3.0 of the SSMR

- ☒ Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.

Comments: N/A

- ☒ Special considerations such as contamination, corrosive environment etc.

Comments: N/A

4.4 Development Servicing Report: Stormwater

- ☒ Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)

Comments: Refer to Section 2.0 of the SSMR.

- ☒ Analysis of available capacity in existing public infrastructure.

Comments: Refer to Section 2.0 of the SSMR - Stormwater runoff to be controlled to less than existing predevelopment conditions in accordance with conditions provided by City.

- ☒ A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.

Comments: Refer to drawings 180966 PRE - Pre-Development and 180966-POST - Post Development Drainage in Appendix E of the SSMR.

- ☒ Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.

Comments: Refer to Section 2.0 of the SSMR.

- ☒ Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.

Comments: Refer to Section 2.0 of the SSMR.

- ☒ Description of the stormwater management concept with facility locations and descriptions with references and supporting information.

Comments: Refer to Section 2.0 and Appendix A and B of the SSMR

- ☒ Set-back from private sewage disposal systems.

Comments: N/A

- ☒ Watercourse and hazard lands setbacks.

Comments: N/A

- ☒ Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.

Comments: An MECP ECA is required provided the storm water management system is accommodating off site drainage

- ☒ Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.

Comments: N/A - no master servicing study available

- ☒ Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).

Comments: Refer to Appendix A of the SSMR and Section 2 of SSMR

- ☒ Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.

Comments: N/A

- ☒ Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.

Comments: Refer to Appendix A of the SSMR and Section 2 of SSMR

- ☒ Any proposed diversion of drainage catchment areas from one outlet to another.

Comments: N/A

- ☒ Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.

Comments: N/A - Refer to Drawing 180966 - SER - Appendix E of the SSMR

- ☒ If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.

Comments: Quantity control is provided. Refer to section 2 of the SSMR

- ☒ Identification of potential impacts to receiving watercourses

Comments: No Potential Impacts

- ☒ Identification of municipal drains and related approval requirements.

Comments: No municipal drains

- ☒ Descriptions of how the conveyance and storage capacity will be achieved for the development.

Comments: Refer to section 2 of the SSMR

- ☒ 100 year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.

Comments: 100 year flood levels and major flow routing is shown on drawing 180966-GRD in appendix E of the SSMR.

- ☒ Inclusion of hydraulic analysis including hydraulic grade line elevations.

Comments: N/A

- ☒ Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.

Comments: Refer to Section 5.0 of the SSMR

- ☒ Identification of floodplains - proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.

Comments: N/A

- ☒ Identification of fill constraints related to floodplain and geotechnical investigation.

Comments: N/A

4.5 Approval and Permit Requirements: Checklist

The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:

- ☒ Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.

Comments: Consultation with RVCA is included in Appendix F

- ☒ Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.

Comments: Required due to Offsite drainage

- ☒ Changes to Municipal Drains.

Comments: N/A

- ☒ Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)

Comments: N/A

4.6 Conclusion Checklist

- ☒ Clearly stated conclusions and recommendations

Comments: Refer to Section 6.0 of the SSMR

- ☒ Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.

Comments: -comments are received response letter provided addressing each comment individually

- ☒ All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario

Comments: Signed and Stamped.



Kollaard Associates

Engineers

January 8, 2020

Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966

Appendix H: Additional Material



Kollaard Associates

Engineers

January 8, 2020


Servicing and Stormwater Management Report

Building Investments Inc.

841, 845, 855(A) Grenon Avenue, Ottawa, ON

File No. 180966


Aerial Photograph Obtained from Google Earth Pro showing pre-development condition of site for documentation purposes to aid in the understanding of the context of the site prior to development.

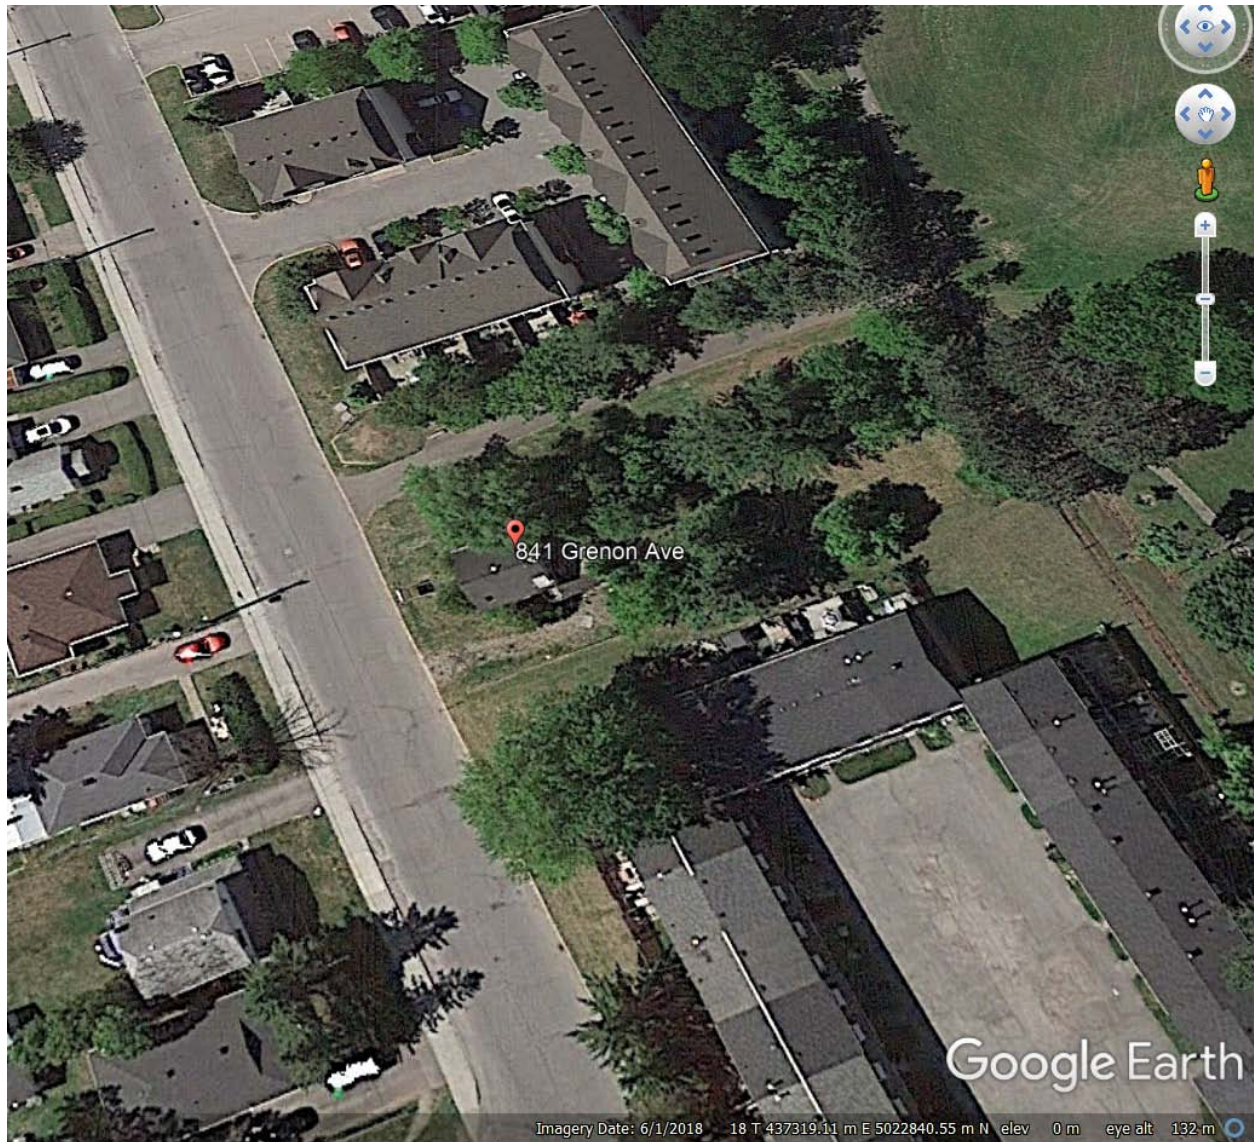

Belk.
236-0111

Draw 731-9531
L-1. 189/62

7. Улучшение

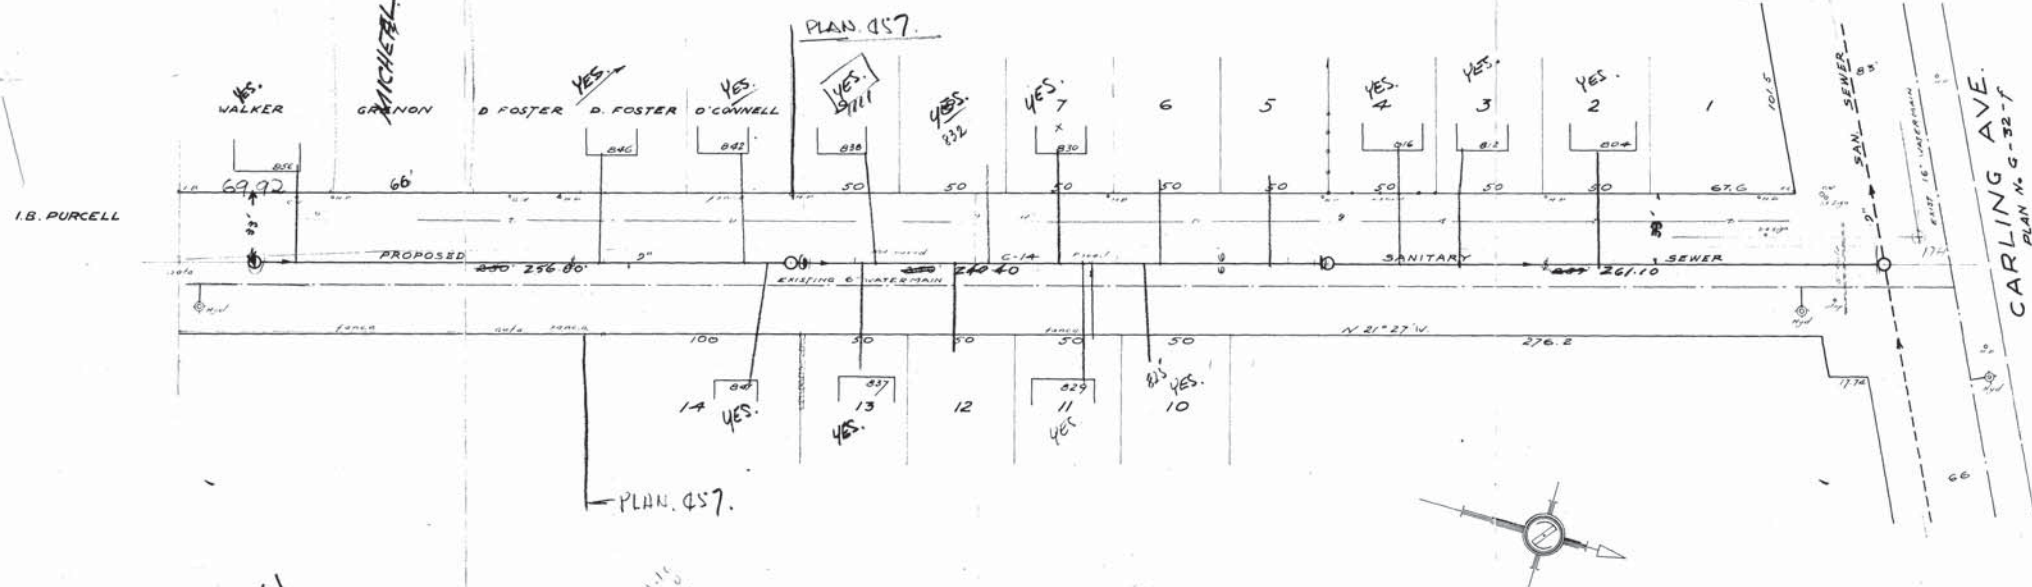
$$\begin{array}{r} 261.1 \\ 240.4 \\ 256.8 \\ \hline 758.3 \end{array}$$
$$\begin{array}{r} 894 \\ 754 \\ \hline 3 \end{array}$$

8270

NOTES:

REG'D PLAN No. 457
T.P. "O" IN "OTTAWA" TOP HYD N/CARLING
OPP GRENON ELEV = 230.62 BK 3024

SA-571
 Ret: May 10/60.

REVISIONS			
DATE	DESCRIPTION	DRW. BY	APPR. BY

	Perlite	6.6.6.2	Other Comp.
240	2350	232.94	
	2300	227.16	2.27.31
	2250	228.14	2.28.31
	2200	223.44	2.23.71
	6135	231.74	2.31.51
	6100	231.64	
	5150	232.14	2.32.61
	5100	234.64	2.34.61
	4150	235.74	2.35.31
	3185	232.64	2.32.97
230	3150	232.97	
	2300	232.87	2.32.71
	2250	232.07	2.32.26
	2200	232.57	2.32.46
	1635	244.77	2.44.61
	1635	244.77	2.44.61

Work Commenced Oct 18/62
Work Completed Nov 1/62
Contractor H. M. Grant
Inspector A. H. May 17th Nov
Instrument man R. Cook
Finish Measurements
B.R. 3124
Pg. 58
Date Nov 24/62

ROAD	ELEVATIONS	DESIGNED BY	DATE
GRADE		ROAD GRADE	W.D. - 26 1912
		2 - 5' 0"	
SURFACE			
		STORM SEWER	1
INVERT			
STATION		SAN SEWER	APRIL 5, 1902
		P. Chase	

CITY OF OTTAWA
PLANNING AND WORKS DEPARTMENT
SEWERAGE AND DRAINAGE BR.
GRENON AVE.
CARLING AVE TO S/END

<i>R. Richard</i>	DRAWN BY	SCALES
Senior Design Engineer	A 1/8" = 1'	NOR. 1" = 50'
<i>F.A.</i>	CHECKED BY	VER. 1" = 6'
Engineer-in-Charge of Surveying & Mapping	DATE	PLAN
<i>J. H. King</i>	SEPT. 6 1961	No.
Engineer-in-Charge	SURVEY BOOK	G-32-b
P.E. AYERS DENY	BOOK	

655

TOPOGRAPHIC PLAN OF SURVEY OF

PART OF LOT 14
REGISTERED PLAN 457
CITY OF OTTAWA

FARLEY, SMITH & DENIS SURVEYING LTD. 2018

Scale 1: 200



Metric Note

Distances and coordinates on this plan are in metres and can be converted to feet by dividing by 0.3048.

Bearing Note

Bearings are astronomic and are referred to the Easterly limit of Grenon Avenue having a bearing of N 21° 58' 05" W as shown on Plan 4R-19561.

Elevation Notes

1. Elevations shown are geodetic.
2. It is the responsibility of the user of this information to verify that the job benchmark has not been altered or disturbed and that its relative elevation and description agrees with the information shown on this drawing.

Utility Notes

1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation.
2. Only visible surface utilities were located.
3. Underground utility data derived from City of Ottawa utility sheet reference: 1555 (Sheet 1 & 2 of 3).
4. Sanitary and storm sewer grades and inverts were derived/compiled from: Field measurement and City of Ottawa Utility Plans.
5. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

Notes & Legend

■	Survey Monument Found
□	Survey Monument Set
SSIB	Standard Iron Bar
IB	Short Standard Iron Bar
P1	Iron Bar
P2	Plan 4R-19561
P3	Plan 5R-3632
1692/FSD	Plan by (1692) Dated June 15, 2011 (file No. 149-11)
AOG	Farley, Smith & Denis Surveying Ltd.
NTS	Annis, O'Sullivan & Vollebakk Ltd
WSOV	Not To Scale
WV	Water Shut off Valve
LP	Water Valve
UP+LS	Lamp Post
UP	Utility Pole & Light Standard
CK	Utility Pole
HK	Cable Kiosk
SANMH	Hydro Kiosk
STMH	Sanitary Sewer Manhole
Inv	Storm Sewer Manhole
Inv(CITY)	Invert
toc	Invert Per City of Ottawa Utility Plans
tw	Top of Curb Elevation
tpFDN	Top of Wall Elevation
DN	Top of Foundation Elevation
SE	Diameter
W	North Invert Elevation
S	South Invert Elevation
E	East Invert Elevation
W	West Invert Elevation
—	Denotes Existing Building
—	Overhead Wires
—	Approximate Location of Underground Bell
—	Approximate Location of Underground Hydro
—	Approximate Location of Underground Gas
○	Deciduous Tree
✱	Coniferous Tree

Surveyor's Certificate

I certify that:

1. This survey and plan are correct and in accordance with the Surveys Act, the Surveyors Act and the Regulations made under them.
2. The survey was completed on the 5th day of December, 2018.

Dec. 21/18
Date

Daniel Robinson
Ontario Land Surveyor

FARLEY, SMITH & DENIS SURVEYING LTD.


ONTARIO LAND SURVEYORS
CANADA LAND SURVEYORS


190 COLONNADE ROAD, OTTAWA, ONTARIO K2E 7J5
TEL. (613) 727-8226 FAX. (613) 727-1826

FILE No.: 652-18


TOPOGRAPHIC DATA WAS COLLECTED UNDER WINTER CONDITIONS. SNOW COVER AND ICE PRECLUDE DETERMINING LOCATION AND ELEVATION OF SOME TOPOGRAPHICAL DATA THAT IS OTHERWISE VISIBLE.

WARNING NO PERSON MAY COPY, REPRODUCE, DISTRIBUTE OR ALTER THIS PLAN IN WHOLE OR IN PART WITHOUT THE WRITTEN PERMISSION OF FARLEY, SMITH & DENIS SURVEYING LTD. © FARLEY, SMITH & DENIS SURVEYING LTD., 2018.

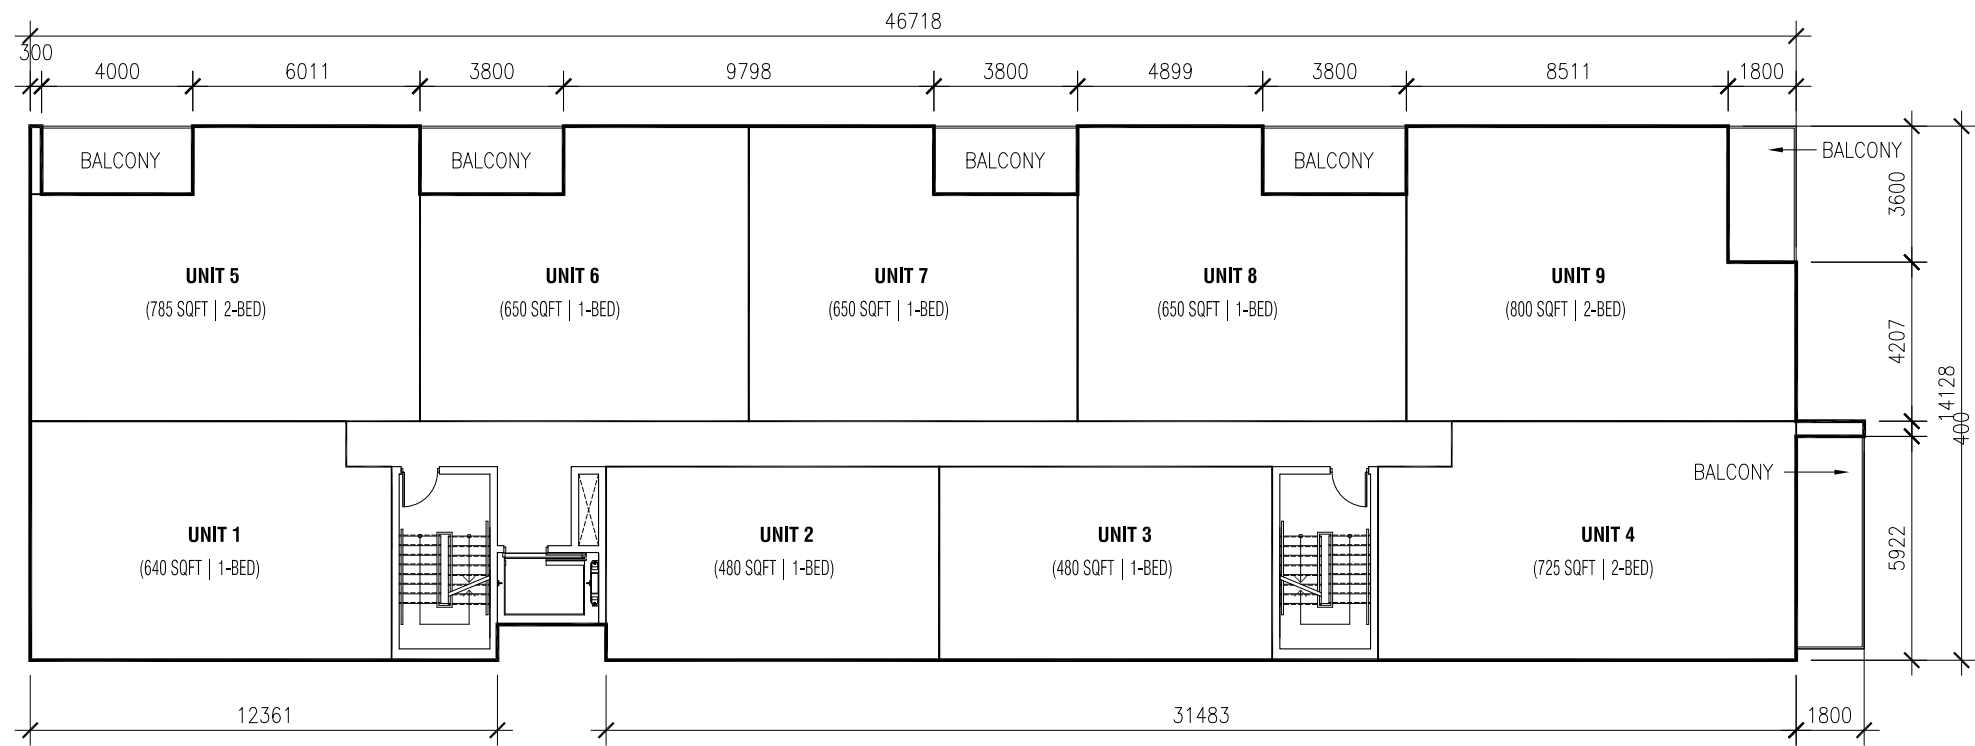

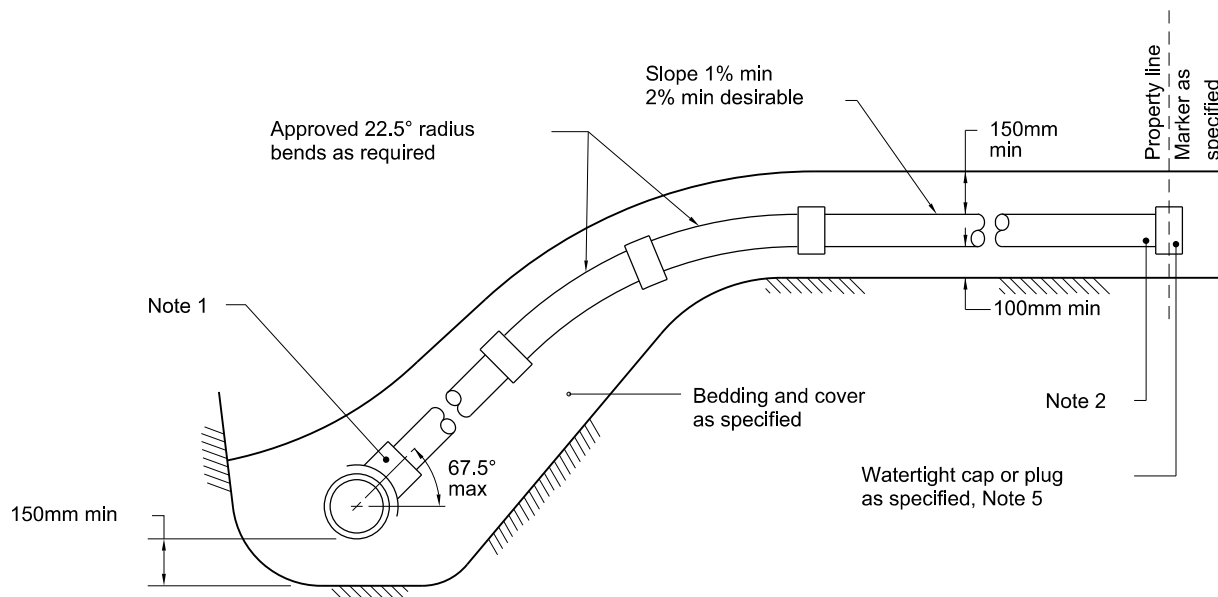

CONNECTION WITHOUT VERTICAL RISER

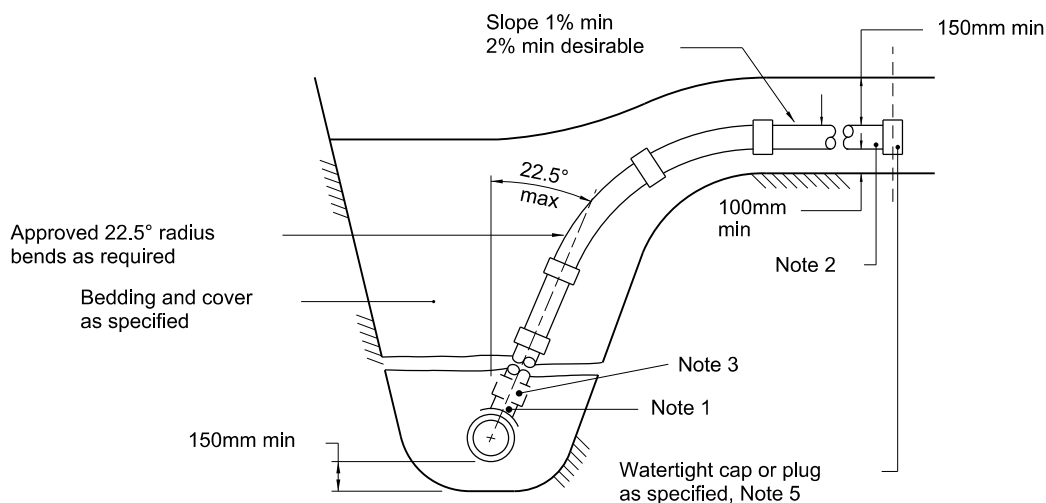

VERTICAL RISER

NOTES:

1. ALL DIAMETERS OF SERVICE CONNECTIONS THAT HAVE NOMINAL DIAMETERS NO GREATER THAN 50% OF THE NOMINAL DIAMETER OF THE RIGID SEWER PIPE SHALL BE MADE USING A BELL END INSERT AS PER S11.2 OR AN APPROVED RUBBER GASKETED INSERT, INSTALLED ABOVE THE SPRING LINE.
2. SANITARY SERVICES TO BE 135mm AND STORM SERVICES TO BE 100mm FOR NEW RESIDENCES UNLESS SPECIFIED OTHERWISE. SERVICE PIPE AND RADIUS BENDS TO BE APPROVED CSA B182.2, SDR28 PRODUCTS UNLESS SPECIFIED OTHERWISE.
3. APPROVED CONTROLLED SETTLEMENT JOINTS OPTIONAL FOR SERVICE CONNECTIONS TO MAIN SEWERS UP TO 5m DEEP. WHERE APPROVED, CONNECTIONS TO SEWERS OVER 5m DEEP REQUIRE APPROVED CONTROLLED SETTLEMENT JOINTS.
4. VERTICAL RISER SHALL BE SAME AS SERVICE PIPE UNLESS OTHERWISE SPECIFIED.
5. CAP OR PLUG AT THE PROPERTY LINE SHALL BE ADEQUATELY BRACED TO WITHSTAND TESTING PRESSURE.
6. FOR NEW CONSTRUCTION, INSERTS MUST BE INSTALLED ON THE MAIN PIPE BEFORE THAT PIPE IS LAID.
7. APPROVED CUT-IN TOOL MUST BE USED FOR FIELD MADE CONNECTIONS.
8. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.



SEWER SERVICE CONNECTIONS FOR RIGID MAIN SEWER PIPE (MODIFIED OPSD-1006.010)

DATE: MARCH 2006

REV. DATE: MARCH 2011

DWG. No.: S11

4R19561

03943-0042

03943-0085

BKL 10/1

PLAN OF SURVEY OF
PART OF LOT 19
CONCESSION 2 (Ottawa Front)
Geographic Township of Nepean
PART OF LOT 14
REGISTERED PLAN 457
NOW ALL IN THE CITY OF OTTAWA

Surveyed by
ANNIS, O'SULLIVAN, VOLLEBEKK LTD.

Scale 1 : 150

Metric

DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND
CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

Surveyor's Certificate

- I CERTIFY THAT:
1. This survey and plan are correct and in accordance with the Surveys Act, the Surveyors Act and the Land Titles Act and the regulations made under them.
 2. The survey was completed on June 16, 2004.

June 28, 2004
Date

E. H. Herweyer
E. H. HERWEYER
ONTARIO LAND SURVEYOR

Notes & Legend

- Denotes Survey Monument Planted.
- +— Denotes Survey Monument Found.
- SSIB Standard Iron Bar.
- SSIB Short Standard Iron Bar.
- IB Iron Bar.
- Wt. Witness.
- (PI) Plan 4R-14541.
- (AOO) Annis, O'Sullivan, Vollebekk Ltd.
- BF Board Fence.
- CLF Chain Link Fence.

Bearings are astronomic derived from the westerly limit of Lot 20
Concession 2 (O.F.) shown to be N82°04'05"W on Plan 5R-3632.

I REQUIRE THIS PLAN TO BE
DEPOSITED UNDER THE
LAND TITLES ACT.
DATE JUNE 28, 2004

E. H. Herweyer
E. H. HERWEYER
ONTARIO LAND SURVEYOR

PLAN 4R-19561


RECEIVED AND DEPOSITED
DATED JUNE 28, 2004

DRAG TRICKOVIC
ASSISTANT DEPUTY LAM
REGISTRAR

LAND REGISTRAR FOR THE
LAND TITLES DIVISION OF
OTTAWA-CARLETON NO. 4.

SCHEDULE			
PART	LOT	REGISTERED PLAN/ CONCESSION	P.J.N.
1			
2	PART OF 14	457	ALL OF 03943-0085
3			
4			
5	PART OF 14	457	PART OF 03943-0084
6	PART OF LOT 19	CONCESSION 2 (OTTAWA FRONT)	

Parts 1 to 6 (Both Inclusive): Subject-To Easement Inst.'s L7198683
and L7198695.

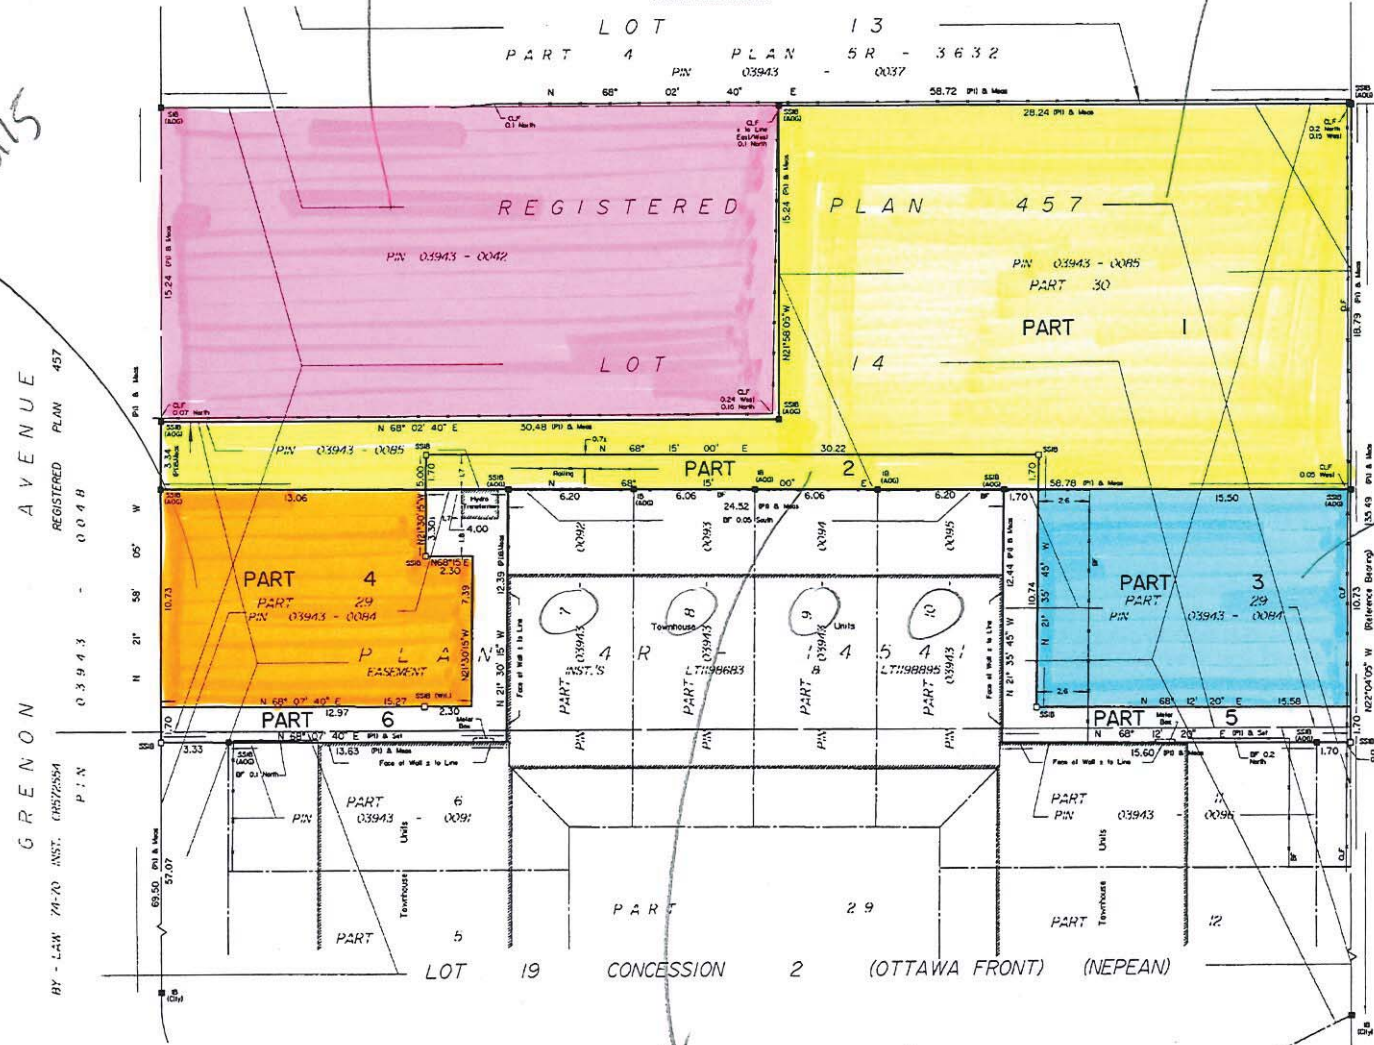

LOT 20 CONCESSION 2 (OTTAWA FRONT) (NEPEAN)

PART 3 PLAN 5R-3632

PIN 03943-0037

03943-0114

ANNIS, O'SULLIVAN, VOLLEBEKK LTD.
Ontario Land Surveyors
11 CONQUEST GATE, SUITE 900, NEPEAN, ONTARIO K2E 7S6
TEL: 613-727-0850 FAX: 613-727-1079 Job No. 5108-04

PROPERTY DESCRIPTION: PT LT 14 PLAN 457 AS IN CR321404 OTTAWA

PROPERTY REMARKS:

ESTATE/QUALIFIER:
FEE SIMPLE
LT CONVERSION QUALIFIED

RECENTLY:
FIRST CONVERSION FROM BOOK BK338

PIN CREATION DATE:
1993/08/09

OWNERS' NAMES
ELEVLI, MUSTAFA

CAPACITY SHARE

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
<p>**EFFECTIVE 2000/07/29 THE NOTATION OF THE "BLOCK IMPLEMENTATION DATE" OF 1993/08/09 ON THIS PIN**</p> <p>**WAS REPLACED WITH THE "PIN CREATION DATE" OF 1993/08/09**</p> <p>** PRINTOUT INCLUDES ALL DOCUMENT TYPES AND DELETED INSTRUMENTS SINCE 1993/07/27 **</p> <p>**SUBJECT, ON FIRST REGISTRATION UNDER THE LAND TITLES ACT, TO:</p> <p>** SUBSECTION 44(1) OF THE LAND TITLES ACT, EXCEPT PARAGRAPH 11, PARAGRAPH 14, PROVINCIAL SUCCESSION DUTIES *</p> <p>** AND ESCHEATS OR FORFEITURE TO THE CROWN.</p> <p>** THE RIGHTS OF ANY PERSON WHO WOULD, BUT FOR THE LAND TITLES ACT, BE ENTITLED TO THE LAND OR ANY PART OF</p> <p>** IT THROUGH LENGTH OF ADVERSE POSSESSION, PRESCRIPTION, MISDESCRIPTION OR BOUNDARIES SETTLED BY</p> <p>** CONVENTION.</p> <p>** ANY LEASE TO WHICH THE SUBSECTION 70(2) OF THE REGISTRY ACT APPLIES.</p> <p>**DATE OF CONVERSION TO LAND TITLES: 1993/08/09 **</p>						
CR321404	1954/05/18	TRANSFER		*** COMPLETELY DELETED ***	DINELLE, ELZEAR ARTHUR DINELLE, JEANNETTE	
OC7422	2001/10/11	CHARGE		*** COMPLETELY DELETED *** DINELLE, ELZEAR ARTHUR DINELLE, JEANNETTE DINELLE, ELZEAR ARTHUR DINELLE, JEANNETTE NOELLA	THE BANK OF NOVA SCOTIA	
OC14783	2001/11/02	TRANSFER		*** COMPLETELY DELETED *** DINELLE, ELZEAR ARTHUR DINELLE, JEANNETTE	1470303 ONTARIO INC.	
REMARKS: PLANNING ACT STATEMENTS						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
OC14784	2001/11/02	CHARGE		*** COMPLETELY DELETED *** 1470303 ONTARIO INC.	HOME TRUST COMPANY	
OC14785	2001/11/02	CHARGE		*** COMPLETELY DELETED *** 1470303 ONTARIO INC.	MANTHORP, EDWARD	
OC14786	2001/11/02	NOTICE		*** COMPLETELY DELETED *** 1470303 ONTARIO INC.	MANTHORP, EDWARD	
	REMARKS: OC14785					
OC18954	2001/11/19	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE BANK OF NOVA SCOTIA		
	REMARKS: RE: OC7422					
OC175814	2003/03/05	NOTICE		*** COMPLETELY DELETED *** 1470303 ONTARIO INC.	MANTHORP, EDWARD	
	REMARKS: OC14785					
OC529758	2005/11/02	DISCH OF CHARGE		*** COMPLETELY DELETED *** MANTHORP, EDWARD		
	REMARKS: RE: OC14785					
OC529887	2005/11/02	TRANSFER	\$170,000	1470303 ONTARIO INC.	ELEVLI, MUSTAFA	C
OC529888	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	HOME TRUST COMPANY	
OC529889	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC529890	2005/11/02	NO ASSGN RENT GEN		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC582410	2006/04/18	DISCH OF CHARGE		*** COMPLETELY DELETED *** HOME TRUST COMPANY		
	REMARKS: RE: OC14784					
OC1324436	2012/01/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** MANTHORP, EDWARD		
	REMARKS: OC529889.					
OC1421920	2012/10/23	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	DYNASTY FLOORING LTD.	

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
OC1429619	2012/11/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** HOME TRUST COMPANY		
	REMARKS: OC529888.					
OC1719082	2015/09/03	CHARGE	\$315,000	ELEVLI, MUSTAFA	COMPUTERSHARE TRUST COMPANY OF CANADA	C
OC1719315	2015/09/04	DISCH OF CHARGE		*** COMPLETELY DELETED *** DYNASTY FLOORING LTD.		
	REMARKS: OC1421920.					

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

PROPERTY DESCRIPTION:

PART OF LOT 14 PLAN 457, OTTAWA, PARTS 1 AND 2 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 7 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 8 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 9 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 10 PLAN 4R14541 AS IN OC362453.

PROPERTY REMARKS:

THE FOLLOWING REMARK HAS BEEN ADDED ON 2004/08/13 AT 09:03 BY MONICA WASAG : PLANNING ACT CONSENT AS IN OC362453.

ESTATE/QUALIFIER:

FEE SIMPLE
LT CONVERSION QUALIFIED

RECENTLY:

DIVISION FROM 03943-0043

PIN CREATION DATE:

1999/06/23

OWNERS' NAMES

ELEVLI, MUSTAFA

CAPACITY SHARE

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/CHKD
<p>**EFFECTIVE 2000/07/29 THE NOTATION OF THE "BLOCK IMPLEMENTATION DATE" OF 1993/08/09 ON THIS PIN**</p> <p>**WAS REPLACED WITH THE "PIN CREATION DATE" OF 1999/06/23**</p> <p>** PRINTOUT INCLUDES ALL DOCUMENT TYPES AND DELETED INSTRUMENTS SINCE 1999/06/23 **</p> <p>**SUBJECT, ON FIRST REGISTRATION UNDER THE LAND TITLES ACT, TO:</p> <p>** SUBSECTION 44(1) OF THE LAND TITLES ACT, EXCEPT PARAGRAPH 11, PARAGRAPH 14, PROVINCIAL SUCCESSION DUTIES *</p> <p>** AND ESCHEATS OR FORFEITURE TO THE CROWN.</p> <p>** THE RIGHTS OF ANY PERSON WHO WOULD, BUT FOR THE LAND TITLES ACT, BE ENTITLED TO THE LAND OR ANY PART OF</p> <p>** IT THROUGH LENGTH OF ADVERSE POSSESSION, PRESCRIPTION, MISDESCRIPTION OR BOUNDARIES SETTLED BY</p> <p>** CONVENTION.</p> <p>** ANY LEASE TO WHICH THE SUBSECTION 70(2) OF THE REGISTRY ACT APPLIES.</p> <p>**DATE OF CONVERSION TO LAND TITLES: 1993/08/09 **</p>						
N537640	1990/06/06	CHARGE		*** DELETED AGAINST THIS PROPERTY ***	THE TORONTO-DOMINION BANK	
LT987365	1996/07/12	NOTICE		*** DELETED AGAINST THIS PROPERTY *** SAVASTA, SERAFINO MAZZA, RINO	THE TORONTO-DOMINION BANK	
REMARKS: N537640						
LT1160776	1998/11/02	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.(AS TO FIRSTLY DESCRIBED LANDS) POPE, NICHOLAS, (AS TO ALL OTHER LANDS)	ACRO CAPITAL INC.	

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1160779	1998/11/02	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	ACRO CAPITAL INC.	
		REMARKS: LT1160776				
4R14541	1999/03/01	PLAN REFERENCE				C
LT1198683	1999/05/28	TRANSFER EASEMENT	\$1	DEVMAX INC.	BELL CANADA	C
LT1198895	1999/05/31	TRANSFER EASEMENT	\$1	DEVMAX INC.	ROGERS OTTAWA LIMITED/LIMITEE	C
		REMARKS: PARTS 1 TO 30 ON 4R-14541.				
LT1199081	1999/05/31	NOTICE		DEVMAX INC.	DEVMAX INC.	C
		REMARKS: PARTS 1 TO 30 ON 4R-14541, PLANNING ACT CONSENT.				
LT1200524	1999/06/03	NOTICE		DEVMAX INC.	THE REGIONAL MUNICIPALITY OF OTTAWA-CARLETON	C
LT1201367	1999/06/09	POSTPONEMENT		*** DELETED AGAINST THIS PROPERTY *** ACRO CAPITAL INC.	ROGERS OTTAWA LIMITED/LIMITEE	
		REMARKS: LT1160776 TO LT1198895 PARTS 1 TO 30 4R-14541				
LT1201368	1999/06/09	POSTPONEMENT		*** DELETED AGAINST THIS PROPERTY *** ACRO CAPITAL INC.	BELL CANADA	
		REMARKS: LT1160776 TO LT1198683 PARTS 1 TO 30 4R-14541				
LT1201369	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201370	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
		REMARKS: PLANNING ACT CONSENT				
LT1201370A	1999/06/09	APL ANNEX REST COV		DEVMAX INC.	DEVMAX INC.	C
		REMARKS: NO EXPIRY				
LT1201371	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
		REMARKS: PLANNING ACT CONSENT				
LT1201372	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
		REMARKS: NO EXPIRY				
LT1201373	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: PLANNING ACT CONSENT						
LT1201374	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: PLANNING ACT CONSENT						
LT1201375	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201376	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201377	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201378	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201379	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201380	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201381	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: DELETED BY LOUIS MIRA ON SEPTEMBER 02, 2016 AS PER OC456681. PLANNING ACT CONSENT						
LT1201382	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201383	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201384	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201385	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1201386	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201387	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201388	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201389	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201390	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201391	1999/06/09	TRANSFER REMARKS: PLANNING ACT STATEMENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201392	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201393	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201394	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201395	1999/06/09	TRANSFER REMARKS: PLANNING ACT STATEMENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201396	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201397	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1201398	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201399	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201400	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201401	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201402	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201403	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201404	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201405	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201406	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201407	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201408	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201409	1999/06/09	TRANSFER REMARKS: PLANNING ACT CONSENT		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
LT1201410	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: NO EXPIRY						
LT1201411	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201412	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201413	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201414	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201415	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201416	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201417	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201418	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201419	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PLANNING ACT CONSENT						
LT1201420	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201421	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	
REMARKS: PART 27 ON 4R-14541 PLANNING ACT CONSENT						
LT1201422	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.

NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1201423	1999/06/09	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	DEVMAX INC.	C
REMARKS: PLANNING ACT STATEMENT						
LT1201424	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		
REMARKS: NO EXPIRY						
LT1201527	1999/06/09	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
LT1201528	1999/06/09	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: LT1201527-RENTS						
LT1201529	1999/06/09	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: SECURITY INTEREST-LT1201527						
LT1201757	1999/06/10	POSTPONEMENT		*** DELETED AGAINST THIS PROPERTY *** ACRO CAPITAL INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: LT1160776 TO LT1201527						
LT1220574	1999/08/16	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
LT1220575	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: CHARGE NO. LT1220574.						
LT1220576	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: LT1220574, SECURITY INTEREST						
LT1220577	1999/08/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** ACRO CAPITAL INC.		
REMARKS: RE: LT1160776						
LT1221224	1999/08/18	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE TORONTO-DOMINION BANK		
REMARKS: RE: N537640						
LT1240945	1999/11/01	CHARGE		*** COMPLETELY DELETED ***		

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1240946	1999/11/01	NOTICE		DEVMAX INC. *** COMPLETELY DELETED *** DEVMAX INC.	ACRO CAPITAL INC. ACRO CAPITAL INC.	
		REMARKS: CHARGE NO. LT1240945 - RENTS				
LT1248027	1999/11/30	CHARGE		*** COMPLETELY DELETED *** DEVMAX INC.	ACRO CAPITAL INC.	
LT1248028	1999/11/30	NOTICE		*** COMPLETELY DELETED *** DEVMAX INC.	ACRO CAPITAL INC.	
		REMARKS: 1248027.				
LT1269233	2000/03/14	DISCH OF CHARGE		*** COMPLETELY DELETED *** ACRO CAPITAL INC.		
		REMARKS: RE: LT1248027				
LT1270023	2000/03/20	DISCH OF CHARGE		*** COMPLETELY DELETED *** ACRO CAPITAL INC.		
		REMARKS: RE: LT1240945				
LT1361705	2001/02/15	CHARGE		*** COMPLETELY DELETED *** DEVMAX INC.	WOOD PROFILES LIMITED	
LT1361706	2001/02/15	NOTICE		*** COMPLETELY DELETED *** DEVMAX INC	WOOD PROFILES LIMITED	
		REMARKS: LT1361705				
LT1362386	2001/02/19	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE EQUITABLE TRUST COMPANY		
		REMARKS: RE: LT1201527				
OC17603	2001/11/14	CHARGE		*** COMPLETELY DELETED *** DEVMAX INC.	TCC MORTGAGE HOLDINGS INC.	
OC17604	2001/11/14	NOTICE		*** COMPLETELY DELETED *** DEVMAX INC.	TCC MORTGAGE HOLDINGS INC.	
		REMARKS: CHARGE NO. OC17603 ASSIGNMENT OF RENTS				
OC17605	2001/11/14	DISCH OF CHARGE		*** COMPLETELY DELETED *** WOOD PROFILES LIMITED		
		REMARKS: RE: LT1361705				

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
OC29083	2001/12/19	CHARGE		*** COMPLETELY DELETED *** DEVMAX INC.	BLATT, LINDA LIDSKY, MELISSA BROWN, MERRALIN TOBE, ARTHUR TOBE, BLOSSOM MAPLE TRUST COMPANY	
OC219864	2003/07/15	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, NAT SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT	
OC220833	2003/07/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** BLATT, LINDA LIDSKY, MELISSA BROWN, MERRALIN TOBE, ARTHUR TOBE, BLOSSOM MAPLE TRUST COMPANY		
		REMARKS: RE: OC29083				
OC221370	2003/07/17	DISCHARGE INTEREST		*** COMPLETELY DELETED ***	THE EQUITABLE TRUST COMPANY	
		REMARKS: RE: LT1201529				
OC222854	2003/07/21	DISCH OF CHARGE		*** COMPLETELY DELETED *** TCC MORTGAGE HOLDINGS INC.		
		REMARKS: RE: OC17603				
OC345526	2004/06/23	TRANSMISSION CHARGE		*** DELETED AGAINST THIS PROPERTY *** CANCILLA, NAT	CANCILLA, PAUL CANCILLA, ANTHONY	
		REMARKS: OC219864				
4R19561	2004/06/28	PLAN REFERENCE				C
OC360376	2004/07/26	APL ANNEX REST COV		DEVMAX INC.		C
		REMARKS: NO EXPIRY				

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
OC362453	2004/07/29	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	1470303 ONTARIO INC.	
OC368194	2004/08/12	LR'S ORDER		*** COMPLETELY DELETED *** LAND REGISTRAR		
REMARKS: LT987365						
OC377122	2004/08/31	DISCH OF CHARGE		*** COMPLETELY DELETED *** BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, PAUL SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT CANCILLA, ANTHONY		
REMARKS: RE: OC219864						
OC390194	2004/10/06	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE EQUITABLE TRUST COMPANY		
REMARKS: RE: LT1220574						
OC390195	2004/10/06	DISCHARGE INTEREST		*** COMPLETELY DELETED ***	THE EQUITABLE TRUST COMPANY	
REMARKS: RE: LT1220576						
OC521406	2005/10/12	LR'S ORDER		*** COMPLETELY DELETED *** LAND REGISTRAR		
REMARKS: DELETING NOTICE LT1220575 PURSUANT TO CHARGE LT1220574 DISCHARGED BY DISCHARGE OF CHARGE OC390194 DELETING POSTPONEMENT LT1201367 PURSUANT TO CHARGE LT1160776 DISCHARGED BY DISCHARGE OF CHARGE LT1220577						
OC529887	2005/11/02	TRANSFER	\$170,000	1470303 ONTARIO INC.	ELEVLI, MUSTAFA	C
OC529888	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	HOME TRUST COMPANY	
OC529889	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC529890	2005/11/02	NO ASSGN RENT GEN		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
 NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
OC1324436	2012/01/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** MANTHORP, EDWARD		
		REMARKS: OC529889.				
OC1421920	2012/10/23	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	DYNASTY FLOORING LTD.	
OC1429619	2012/11/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** HOME TRUST COMPANY		
		REMARKS: OC529888.				
OC1719082	2015/09/03	CHARGE	\$315,000	ELEVLI, MUSTAFA	COMPUTERSHARE TRUST COMPANY OF CANADA	C
OC1719315	2015/09/04	DISCH OF CHARGE		*** COMPLETELY DELETED *** DYNASTY FLOORING LTD.		
		REMARKS: OC1421920.				

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

PROPERTY DESCRIPTION: PART OF LOT 14 PLAN 457, OTTAWA, PART 3 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.

PROPERTY REMARKS: PLANNING ACT CONSENT AS IN OC362453.

ESTATE/QUALIFIER: FEE SIMPLE
LT CONVERSION QUALIFIED

RECENTLY: DIVISION FROM 03943-0084

PIN CREATION DATE:
2004/08/13

OWNERS' NAMES ELEVLI, MUSTAFA

CAPACITY SHARE

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/CHKD
** PRINTOUT INCLUDES ALL DOCUMENT TYPES AND DELETED INSTRUMENTS SINCE 2004/08/13 **						
**SUBJECT, ON FIRST REGISTRATION UNDER THE LAND TITLES ACT, TO:						
** SUBSECTION 44(1) OF THE LAND TITLES ACT, EXCEPT PARAGRAPH 11, PARAGRAPH 14, PROVINCIAL SUCCESSION DUTIES *						
** AND ESCHEATS OR FORFEITURE TO THE CROWN.						
** THE RIGHTS OF ANY PERSON WHO WOULD, BUT FOR THE LAND TITLES ACT, BE ENTITLED TO THE LAND OR ANY PART OF						
** IT THROUGH LENGTH OF ADVERSE POSSESSION, PRESCRIPTION, MISDESCRIPTION OR BOUNDARIES SETTLED BY						
** CONVENTION.						
** ANY LEASE TO WHICH THE SUBSECTION 70(2) OF THE REGISTRY ACT APPLIES.						
**DATE OF CONVERSION TO LAND TITLES: 1993/08/09 **						
LT1198683	1999/05/28	TRANSFER EASEMENT	\$1	DEVMAX INC.	BELL CANADA	C
LT1198895	1999/05/31	TRANSFER EASEMENT	\$1	DEVMAX INC.	ROGERS OTTAWA LIMITED/LIMITEE	C
REMARKS: PARTS 1 TO 30 ON 4R-14541.						
LT1199081	1999/05/31	NOTICE		DEVMAX INC.	DEVMAX INC.	C
REMARKS: PARTS 1 TO 30 ON 4R-14541, PLANNING ACT CONSENT.						
LT1200524	1999/06/03	NOTICE		DEVMAX INC.	THE REGIONAL MUNICIPALITY OF OTTAWA-CARLETON	C
LT1201367	1999/06/09	POSTPONEMENT		*** DELETED AGAINST THIS PROPERTY *** ACRO CAPITAL INC.	ROGERS OTTAWA LIMITED/LIMITEE	
REMARKS: LT1160776 TO LT1198895 PARTS 1 TO 30 4R-14541						
LT1201370A	1999/06/09	APL ANNEX REST COV		DEVMAX INC.	DEVMAX INC.	C
REMARKS: NO EXPIRY						
LT1201372	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: NO EXPIRY						
LT1201374	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: PLANNING ACT CONSENT						
LT1201376	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201378	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201380	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201382	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201384	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201386	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201388	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201390	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201392	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201394	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201396	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201398	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201400	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.

NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1201402	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201404	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201406	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201408	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201410	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201412	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201414	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201416	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201418	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201420	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201422	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201424	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1220574	1999/08/16	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
LT1220575	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: CHARGE NO. LT1220574.						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1220576	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: LT1220574, SECURITY INTEREST						
OC219864	2003/07/15	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, NAT SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT	
OC345526	2004/06/23	TRANSMISSION CHARGE		*** DELETED AGAINST THIS PROPERTY *** CANCILLA, NAT	CANCILLA, PAUL CANCILLA, ANTHONY	
REMARKS: OC219864						
4R19561	2004/06/28	PLAN REFERENCE				C
OC360376	2004/07/26	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
OC362453	2004/07/29	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	1470303 ONTARIO INC.	
OC377122	2004/08/31	DISCH OF CHARGE		*** COMPLETELY DELETED *** BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, PAUL SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT CANCILLA, ANTHONY		
REMARKS: RE: OC219864						
OC390194	2004/10/06	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE EQUITABLE TRUST COMPANY		
REMARKS: RE: LT1220574						
OC390195	2004/10/06	DISCHARGE INTEREST		*** COMPLETELY DELETED ***		

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
 NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: RE: LT1220576					THE EQUITABLE TRUST COMPANY	C
OC521406	2005/10/12	LR'S ORDER		*** COMPLETELY DELETED *** LAND REGISTRAR		
REMARKS: DELETING NOTICE LT1220575 PURSUANT TO CHARGE LT1220574 DISCHARGED BY DISCHARGE OF CHARGE OC390194 DELETING POSTPONEMENT LT1201367 PURSUANT TO CHARGE LT1160776 DISCHARGED BY DISCHARGE OF CHARGE LT1220577						
OC529887	2005/11/02	TRANSFER	\$170,000	1470303 ONTARIO INC.	ELEVLI, MUSTAFA	
OC529888	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	HOME TRUST COMPANY	
OC529889	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC529890	2005/11/02	NO ASSGN RENT GEN		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC1324436	2012/01/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** MANTHORP, EDWARD		
REMARKS: OC529889.						
OC1421920	2012/10/23	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	DYNASTY FLOORING LTD.	
OC1429619	2012/11/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** HOME TRUST COMPANY		
REMARKS: OC529888.						
OC1719082	2015/09/03	CHARGE	\$315,000	ELEVLI, MUSTAFA	COMPUTERSHARE TRUST COMPANY OF CANADA	C
OC1719315	2015/09/04	DISCH OF CHARGE		*** COMPLETELY DELETED *** DYNASTY FLOORING LTD.		
REMARKS: OC1421920.						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

PROPERTY DESCRIPTION: PART OF LOT 14 PLAN 457, OTTAWA, PART 4 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.

PROPERTY REMARKS: PLANNING ACT CONSENT AS IN OC362453.

ESTATE/QUALIFIER:
FEE SIMPLE
LT CONVERSION QUALIFIED

RECENTLY:
DIVISION FROM 03943-0084

PIN CREATION DATE:
2004/08/13

OWNERS' NAMES
ELEVLI, MUSTAFA

CAPACITY SHARE

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/CHKD
** PRINTOUT INCLUDES ALL DOCUMENT TYPES AND DELETED INSTRUMENTS SINCE 2004/08/13 **						
**SUBJECT, ON FIRST REGISTRATION UNDER THE LAND TITLES ACT, TO:						
** SUBSECTION 44(1) OF THE LAND TITLES ACT, EXCEPT PARAGRAPH 11, PARAGRAPH 14, PROVINCIAL SUCCESSION DUTIES *						
** AND ESCHEATS OR FORFEITURE TO THE CROWN.						
** THE RIGHTS OF ANY PERSON WHO WOULD, BUT FOR THE LAND TITLES ACT, BE ENTITLED TO THE LAND OR ANY PART OF						
** IT THROUGH LENGTH OF ADVERSE POSSESSION, PRESCRIPTION, MISDESCRIPTION OR BOUNDARIES SETTLED BY						
** CONVENTION.						
** ANY LEASE TO WHICH THE SUBSECTION 70(2) OF THE REGISTRY ACT APPLIES.						
**DATE OF CONVERSION TO LAND TITLES: 1993/08/09 **						
LT1198683	1999/05/28	TRANSFER EASEMENT	\$1	DEVMAX INC.	BELL CANADA	C
LT1198895	1999/05/31	TRANSFER EASEMENT	\$1	DEVMAX INC.	ROGERS OTTAWA LIMITED/LIMITEE	C
REMARKS: PARTS 1 TO 30 ON 4R-14541.						
LT1199081	1999/05/31	NOTICE		DEVMAX INC.	DEVMAX INC.	C
REMARKS: PARTS 1 TO 30 ON 4R-14541, PLANNING ACT CONSENT.						
LT1200524	1999/06/03	NOTICE		DEVMAX INC.	THE REGIONAL MUNICIPALITY OF OTTAWA-CARLETON	C
LT1201367	1999/06/09	POSTPONEMENT		*** DELETED AGAINST THIS PROPERTY *** ACRO CAPITAL INC.	ROGERS OTTAWA LIMITED/LIMITEE	
REMARKS: LT1160776 TO LT1198895 PARTS 1 TO 30 4R-14541						
LT1201370A	1999/06/09	APL ANNEX REST COV		DEVMAX INC.	DEVMAX INC.	C
REMARKS: NO EXPIRY						
LT1201372	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: NO EXPIRY						
LT1201374	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: PLANNING ACT CONSENT						
LT1201376	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201378	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201380	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201382	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201384	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201386	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201388	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201390	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201392	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201394	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201396	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201398	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
LT1201400	1999/06/09	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1201402	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201404	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201406	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201408	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201410	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201412	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201414	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201416	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201418	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201420	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201422	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1201424	1999/06/09	APL ANNEX REST COV REMARKS: NO EXPIRY		DEVMAX INC.		C
LT1220574	1999/08/16	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
LT1220575	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: CHARGE NO. LT1220574.						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
 NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
LT1220576	1999/08/16	NOTICE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	THE EQUITABLE TRUST COMPANY	
REMARKS: LT1220576, SECURITY INTEREST						
OC219864	2003/07/15	CHARGE		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, NAT SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT	
OC345526	2004/06/23	TRANSMISSION CHARGE		*** DELETED AGAINST THIS PROPERTY *** CANCILLA, NAT	CANCILLA, PAUL CANCILLA, ANTHONY	
REMARKS: OC219864						
4R19561	2004/06/28	PLAN REFERENCE				C
OC360376	2004/07/26	APL ANNEX REST COV		DEVMAX INC.		C
REMARKS: NO EXPIRY						
OC362453	2004/07/29	TRANSFER		*** DELETED AGAINST THIS PROPERTY *** DEVMAX INC.	1470303 ONTARIO INC.	
OC377122	2004/08/31	DISCH OF CHARGE		*** COMPLETELY DELETED *** BOLTON, PATRICIA SCHNIER, ROBERTA CANCILLA, PAUL SUTHERLAND, RONALD BEAN, MAUREEN MCLENNAN HOLDCO INC. BRENDON, RUPERT CANCILLA, ANTHONY		
REMARKS: RE: OC219864						
OC390194	2004/10/06	DISCH OF CHARGE		*** COMPLETELY DELETED *** THE EQUITABLE TRUST COMPANY		
REMARKS: RE: LT1220576						
OC390195	2004/10/06	DISCHARGE INTEREST		*** COMPLETELY DELETED ***		

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
 NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

REG. NUM.	DATE	INSTRUMENT TYPE	AMOUNT	PARTIES FROM	PARTIES TO	CERT/ CHKD
REMARKS: RE: LT1220576					THE EQUITABLE TRUST COMPANY	
OC521406	2005/10/12	LR'S ORDER		*** COMPLETELY DELETED *** LAND REGISTRAR		
REMARKS: DELETING NOTICE LT1220575 PURSUANT TO CHARGE LT1220574 DISCHARGED BY DISCHARGE OF CHARGE OC390194 DELETING POSTPONEMENT LT1201367 PURSUANT TO CHARGE LT1160776 DISCHARGED BY DISCHARGE OF CHARGE LT1220577						
OC529887	2005/11/02	TRANSFER	\$170,000	1470303 ONTARIO INC.	ELEVLI, MUSTAFA	C
OC529888	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	HOME TRUST COMPANY	
OC529889	2005/11/02	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC529890	2005/11/02	NO ASSGN RENT GEN		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	MANTHORP, EDWARD	
OC1324436	2012/01/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** MANTHORP, EDWARD		
REMARKS: OC529889.						
OC1421920	2012/10/23	CHARGE		*** COMPLETELY DELETED *** ELEVLI, MUSTAFA	DYNASTY FLOORING LTD.	
OC1429619	2012/11/16	DISCH OF CHARGE		*** COMPLETELY DELETED *** HOME TRUST COMPANY		
REMARKS: OC529888.						
OC1719082	2015/09/03	CHARGE	\$315,000	ELEVLI, MUSTAFA	COMPUTERSHARE TRUST COMPANY OF CANADA	C
OC1719315	2015/09/04	DISCH OF CHARGE		*** COMPLETELY DELETED *** DYNASTY FLOORING LTD.		
REMARKS: OC1421920.						

NOTE: ADJOINING PROPERTIES SHOULD BE INVESTIGATED TO ASCERTAIN DESCRIPTIVE INCONSISTENCIES, IF ANY, WITH DESCRIPTION REPRESENTED FOR THIS PROPERTY.
NOTE: ENSURE THAT YOUR PRINTOUT STATES THE TOTAL NUMBER OF PAGES AND THAT YOU HAVE PICKED THEM ALL UP.

CANADA
PROVINCE OF ONTARIO

I, **Jean Paul Guertin**
of the City of **Ottawa**
in the County of **Carleton**
do hereby make oath and say:

To Whom: (Complainant) **Barrister-at-law**
executed by **Jakub Ostrowski and Yvette Ostrowski**
Duplicate duly signed, sealed and
two of - - - the parties thereto.

2. THAT the said Instrument and Duplicate were executed by the said parties at the City of **Ottawa** in the County of **Carleton** of the full age of twenty-one years.

3. THAT I know the said parties and that they are of **Carleton**.

4. THAT I am a subscribing witness to the said Instrument and Duplicate.

SWORN before me at the City of **Ottawa** County of **Carleton** in the County of **Carleton** at this day of **May** in the year of our Lord, 19 **54**.

[Signature]

THE REGISTRY ACT
AFFIDAVIT AS TO MARRIAGE STATUS
My Commission expires, Oct. 20, 1955

TO WIT:

In the within instrument named make oath and say:
THAT at the time of the execution and delivery by me of the within instrument I was (married), (unmarried), (a widow), and of the full age of twenty-one years at the time of the execution and delivery by me of the within instrument I was legally married to her dower and was of the full age of twenty-one years or more at the time of the execution and delivery of the within instrument, I was legally married to the person named therein as my husband, and

he was of the full age of twenty-one years.
SWORN before me at the day of this A.D. 19

A Commissioner for taking Affidavits, etc.

Dated May 14th A.D. 1954

JAKUB OSTROWSKI
(also known as Jacob Ostrowski)
ELZEAR ARTHUR DINKLE
and **JEANETTE DINKLE**
Ottawa, Ont.

Deed of Land
SITUATE
in the City of Ottawa
[Signature]
John A. Thompson, Esq., Notary Public, Ottawa, Ont.

GURRIN & GURRIN
Barristers
18 Rideau St.
Ottawa, Ont.

REP. REGISTRAR

1. I certify that the within instrument is a duplicate of the original instrument registered in the Registry Office of the Province of Ontario on the 14th day of May, 1954.

FOR THE REGISTRAR OF THE REGISTRY OFFICE OF THE PROVINCE OF ONTARIO
AT 2.42 O'CLOCK
18 DAY OF May 1954
NUMBER 321404

This Indenture,

made in duplicate the 14th day of May
in the year of our Lord one thousand nine hundred and fifty-four
in pursuance of the Short Forms of Conveyances Act.

Between

JAYUB OSTROWSKI, (also known as Jacob Ostrowski)
of the City of Ottawa, Premier, and YVETTE
OSTROWSKI, his wife, as joint tenants and not
as tenants in common.

hereinafter called the Grantor s of the FIRST PART
ELIZABETH ARTHUR DINEEN of the City of
Ottawa, Bookkeeper, and JEANNE DINEEN,
his wife, as joint tenants.

hereinafter called the Grantee s of the SECOND PART

~~Wife of the Grantee~~ of the THIRD PART

Witnesseth that in consideration of other good and valuable consideration
and the sum of Two (\$2.00) ----- dollar s of

lawful money of Canada now paid by the said Grantee s to the said Grantor s (the receipt
whereof is hereby by them acknowledged) the s of the said Grantee s
GRANT unto the said Grantee s / in fee simple

ALL and Singular that certain parcel or tract of land and premises, situate, lying and
being in the Township of Nepean, in the County of Carleton and being
composed of part of lot 14 according to plan drawn by S.E. Farley,
P.L.S., and dated March 31, 1946 and registered on May 6th, 1946 as
Number 457, which said part may be more particularly described as
follows: COMMENCING at the northwest corner of said lot 14; thence
Easterly and along the northerly boundary of said lot 14, a distance
of 100' more or less to the Northwest corner of the lands described
in Deed registered in the Registry Office for the County of Carleton
as Number 56224; thence Southerly and along the boundary of the
lands described in deed registered as number 56224 as aforesaid,
50'; thence Westerly and parallel to the southerly boundary of said
lot 14 a distance of 100' more or less to the westerly boundary of
said lot 14; thence Northerly and along the westerly boundary of
said lot 14 a distance of 50' to the point of commencement. (now
within the limits of the City of Ottawa).

Transfer/Deed of Land

Do Process Software Ltd. • (416) 322-8111
File No. 14959

A

FOR OFFICE USE ONLY

1198683

RECEIVED
OTTAWA-CARLETON (4)

99 MAY 28 15 : 06

GAIL BOUNSAI
CERTIFICATION OFFICER

(1) Registry ☐ Land Titles ☒ (2) Page 1 of 3 pages
(3) Property Identifier(s) 03943-0043 (LT) Property
(4) Consideration ONE Dollars \$ 1.00
(5) Description This is a: Property Division ☒ Property Consolidation ☐
Part of Lot 19, Concession 2, Ottawa Front
Part of Lot 14, Plan 457
In the City of Ottawa, Regional Municipality of Ottawa-Carleton
designated as Parts 1 to 30 on Plan T4S41
Land Titles Office at Ottawa (No.4)

Executions
EXECUTIONS CLEAR

(6) This Document Contains (a) Redescription New Easement Plan/Sketch ☒ (b) Schedule for: Description ☐ Additional Parties ☐ Other ☒ (7) Interest/State Transferred Description/State Transfer of Easement

(8) Transferor(s) The transferor hereby transfers the land to the transferee as described in the schedule for the purpose of the transfer.

Name(s)
DEYMAX INC.

Signature(s)
PER: [Signature]
Nicholas Pope, President
1999 05 26
I hereby authorize to bind the Corporation.

(9) Spouse(s) of Transferor(s) I hereby consent to this transaction
Name(s)
Signature(s)
Date of Signature
Y M D

(10) Transferor(s) Address
for Service
P.O. Box 67021, 340 Richmond Road, Ottawa, ON K2G 4E4

(11) Transferee(s)
BELL CANADA

Date of Birth
Y M D

(12) Transferee(s) Address
for Service
65 Middle Street, Trenton, Ontario K5V 3Z5

(13) Transferor(s) The transferor verifies that to the best of the transferor's knowledge and belief, this transfer does not contravene section 50 of the Planning Act.
Date of Signature
Y M D

Signature
Solicitor for Transferor(s) I have explained the effect of section 50 of the Planning Act to the transferor and I have made inquiries of the transferor to determine that this transfer does not contravene that section and based on the information supplied by the transferor, to the best of my knowledge and belief, this transfer does not contravene that section. I am an Ontario solicitor in good standing.
Signature
Date of Signature
Y M D

Planning Act - OPTIONAL

(14) Solicitor for Transferee(s) I have investigated the title to this land and to adjoining land where relevant and I am satisfied that the title records reveal no contravention as set out in subclause 50 (22) (c) (i) of the Planning Act and that to the best of my knowledge and belief the transferor for the transferor(s) and I am an Ontario solicitor in good standing.
Name and Address of Solicitor
Signature
Date of Signature
Y M D

(15) Assessment Roll Number of Property
CY Mun Map Sub. Par.
06 14 095 303 24000

(16) Municipal Address of Property

(17) Document Prepared by:

885 Grenon Avenue
Ottawa, Ontario
K1B 6G1
R.O. Box 399

D. Kenneth Gibson
Gibson & Augustine
Constitution Square
Suite 1520, 360 Albert St.
Ottawa, Ontario
K1R 7X7

FOR OFFICE USE ONLY

Fees and Tax	
Registration Fee	50
Land Transfer Tax	
Total	

Additional Property Identifier(s) and/or Other Information

WHEREAS the Transferee is the owner in fee simple of those lands and premises (the "Transferee's lands") being composed of Parts of Town Lots 5 and 6 on the North side of Adelaide Street West according to the Plan of the Town of York and designated as Parts 1 and 2, Plan 653R-345, City of Toronto, Municipality of Toronto,

WHEREAS the Transferor is the owner in fee simple of lands described as part of Lot 19, Concession 2, Ottawa Front, and part of Lot 14, Plan 457 in the City of Ottawa, Regional Municipality of Ottawa-Carleton (the Property);

designated the 43 PARCELS to 30 on Plan 1451, said titles at Ottawa No. 4

appertain to the Transferor's lands, a free and unencumbered Easement (the "Easement") in perpetuity upon, over, in, under and across lands more particularly described in box 5 on Page 1 attached (the "Easement Lands"):

1. the right to construct, operate, maintain, maintain, repair, replace, renew, or make additions at all times to telecommunications facilities (the "Facilities") or any part thereof forming part of continuous lines between the Transferee's lands and other lands including, without limitation, all necessary cable and wires (both buried and aerial), conduits, conduit structures, markers, poles, anchors, guys, maintenance holes, fixtures, equipment, and all appurtenances thereto.
2. the right of free and unimpeded access at all times to the Transferee, its contractors, agents, employees, vehicles, equipment, and supplies to and over the Easement Lands,
3. the right of free and unimpeded access at all times to the Easement Lands from and over the Property or abutting road allowances or abutting rights of way for the purpose of exercising the rights hereby granted,
4. the right to remove, trim, sever, or fell any obstructions such as trees, roots, brush, stumps, boulders or rock encountered during the course of construction or subsequent maintenance of the Facilities.

THE TRANSFEROR shall:

1. have the right to fully use and enjoy the Easement Lands provided that without the prior written consent of the Transferor, such consent not to be unreasonably withheld, the Transferor shall not place any buildings or other structures or dig, drill, pave or excavate within the Easement Lands.
2. have the right to normal cultivation for farming purposes of the Easement Lands.
3. have the right to install a private tile drainage system on the Property for the purpose of improving the agricultural productivity of the Property and where such installation would cross through the Easement Lands, the Transferor shall at its own expense, where such installation requires it, physically expose and raise or lower the Facilities to the extent necessary to accomplish such installation.

THE TRANSFEREE shall:

1. be responsible for any damage caused at any time by its agents or employees to the Property. When practical, the Transferee, after any of its activities, shall restore the Property appropriately. The subsequent maintenance of the Property shall be the responsibility of the Transferee.
2. indemnify and save the Transferee harmless from all actions, causes of actions, suits, claims and demands of every nature and kind whatsoever which may be made against the Transferee relating to or arising out of the placement of the Facilities by the Transferee, for which the Transferee, in law, is responsible. However in no event shall the Transferee be liable for any indirect, special, incidental or consequential damages even if it has been advised of the possibility thereof.
3. at its sole discretion, be permitted to attach, or permit the attachment of, wires, cables and equipment of any other company or company for the purposes, only of supplying a service to the public.

NOTWITHSTANDING any rule of law or equity and even though any of the Facilities may become annexed or affixed to the Essement Lands, title to the Facilities shall nevertheless remain in the Truststate.

"THIS AGREEMENT" including all rights, privileges, and benefits herein contained shall extend to, be binding upon, and enure to the benefit of, the parties hereto and their respective heirs, executors, administrators, successors, and assigns.

TITLE TRANSFERREE, in the event it grants a release of Essement, may abandon the Facilities annexed/affixed to the Essement Lands at its option.

~~AND FURTHER Mortgagee in Mortgage Charge Number _____ in consideration~~
of the sum of One Dollar (\$1.00), the receipt and sufficiency whereof is hereby acknowledged, joins herein for the purpose of
consenting hereto and agrees to the rights, privileges and Easement hereby granted. The Mortgagee hereby postpones its interest in
the Easement Lands under Mortgage/Charge Number _____ to the rights, privileges and
Easement granted to the Transferee hereunder and covenants that the Transferee shall have quiet possession of the rights, privileges
and Easement hereby granted.

~~THE MORTGAGEE certifies that the Mortgagee is at least eighteen years old.~~

Message (name)

Per:

Points of Significance

Date of Signature

FOR OFFICE
USE ONLY

(3) Property Identifier(s) 03943-0043 (L7) Block Property

Additional: See Schedule ☐

(4) Consideration

ONE Dollars \$ 1.00

(6) Description This is a: Property ☐ Division ☐ Property ☐ Consolidation ☐

Part of Lot 19, Concession 2, (Ottawa Front, Nepean), and Part of Lot 14, Plan 457, in the City of Ottawa, Regional Municipality of Ottawa-Carleton, designated as Parts 1 to 30 (both inclusive) on Plan 4R-14541;

FOR OFFICE USE ONLY

1198895
RECEIVED
OTTAWA-CARLETON (4)
03 MAY 31 03 51
SUSAN WEBB
CERTIFICATION OFFICER

New Property Identifier(s)
Additional: See Schedule ☐

Executions
EXCUTIONS CLEAR
Additional: See Schedule ☐

(5) This Document Contains New Easement ☒ Plan/Sketch

(b) Schedule for: Description ☐ Particular ☐ Other ☐

(7) Interest/Estate Transferred
Easement ☐

(8) Transferor(s) The transferor hereby transfers the land to the transferee as described in the Schedule for the purpose of the transfer.

Name(s)
DEYMAX INC.

~~DEYMAX~~ have authority to bind the Corporation

Signature:
Name: Nicholas Pope, President
Date of Signature: 1999 05 26
Name:
Date of Signature: 1999

(9) Spouse(s) or Transferor(s) I hereby consent to the transaction
Name(s)
Signature(s)

Date of Signature
M D

(10) Transferor(s) Address for Service
288 Parnell Avenue, Ottawa, Ontario, K1Z 5J8

(11) Transferor(s)

ROGERS OTTAWA LIMITED PARTNERSHIP

Date of Birth
M D

(12) Transferee(s) Address for Service
475 Richmond Road, Ottawa, Ontario, K2A 3Y8

(13) Transferee(s) The transferor certifies that to the best of the transferor's knowledge and belief, this transfer does not contravene section 50 of the Planning Act.

Date of Signature
M D

Signature
M D

Signature
Solicitor for Transferor(s) I have explained the effect of section 50 of the Planning Act to the transferor and I have made inquiries of the transferor to determine that this transfer does not contravene that section and based on the information supplied by the transferor, to the best of my knowledge and belief, this transfer does not contravene that section. I am an Ontario solicitor in good standing.

Signature
M D

(14) Solicitor for Transferor(s) I have investigated the title to this land and to adjoining land where relevant and I am satisfied that the title records reveal no contravention as set out in subsection 50 (22) (c) (ii) of the Planning Act and that to the best of my knowledge and belief, this transferor is a solicitor in good standing.

Signature
M D

Name and Address of Solicitor

Signature
M D

(16) Assessment Roll Number of Property
06 14 095 303 24000

(16) Municipal Address of Property

(17) Document Prepared by:

855 Grenon Avenue,
Ottawa, Ontario
K2B 6G1

Solway, Wright
900-427 Laurier Avenue West
Ottawa, Ontario
K1R 7Y2
BOX 313-314

FOR OFFICE USE ONLY

Fees and Tax	
Registration Fee	50
Land Transfer Tax	275
Total	

Additional Property Identifier(s) and/or Other Information

TRANSFER OF EASEMENT
[BLANKET]

The Transferor hereby transfers to the Transferee, its successors and assigns, to be used and enjoyed as appurtenant to the Transferee's lands described herein and the other lands comprising the distribution system of the Transferee from time to time, the free, uninterrupted and unobstructed right and easement in perpetuity as follows:

TO ENTER on and construct, install, place, lay, erect, reconstruct, relocate, repair, replace, operate, maintain, inspect and remove all such lines of coaxial and other cables, and all necessary poles, wires, main and service cables (both underground and aerial), conductors, conduits, amplifiers, pedestals, apparatus, fixtures and equipment and all appurtenances thereto (all or any part of which are herein called the "Works") as the Transferee may from time to time or at any time hereafter deem requisite, in, upon, over, under, along and across the said lands (herein called the "Site"), for the purpose of furnishing telecommunication services, including but not restricted to, cable television, cable radio and data transmission services, to the premises of persons who request the same from time to time on the Site and lands in the vicinity thereof.

TOGETHER WITH the right and licence of free, uninterrupted, unimpeded and unobstructed access to the Transferee, its servants, agents, contractors and subcontractors together with vehicles, supplies, machinery and equipment at all times and for all purposes necessary for or incidental to the exercise and enjoyment of the rights and easements hereby transferred, to and from, on and over the Site and such portions of the lands of the Transferor adjacent thereto.

The rights and easements herein transferred are subject to the following terms and conditions which are hereby mutually agreed to by the Transferor and the Transferee:

1. The Transferor shall be responsible for any damage to the Works whether caused directly or indirectly by the acts or omissions of the Transferor or of any persons acting under the authority of the Transferor.
2. The Transferee shall be responsible for any damage caused to the property and lands of the Transferor by its servants, agents, contractors or subcontractors, and shall as far as possible replace at its own expense any soil or turf removed in connection with any of the work above referred to.
3. The Transferor covenants that in the event any part of the Works are required to be relocated by the Transferor, the Transferor shall indemnify the Transferee for the cost of such relocation.
4. The Transferor shall not cover or otherwise interfere with the Works and shall not excavate, drill, install, erect, build or permit to be excavated, drilled, installed, erected or built, in, on, over, under or through the said lands any pit, well, building, structure or other obstruction of any nature without the prior written consent of the Transferee, but otherwise the Transferor shall have the right fully to use and enjoy the said lands, subject always to and so as not to interfere with the rights and easements hereby transferred. Before the commencement of any work which may affect the Works, the Transferor shall advise the Transferee and the Transferee shall attend at the Site to locate the Works.
5. The Transferor shall maintain those parts of the Site occupied by the Works and unoccupied by any dwelling units, (such part to be defined as a strip of land on either side of and measured perpendicular to the

Additional Property Identifier(s) and/or Other Information

centre of the Works which is the lesser of the actual distance to any building or four (4) feet), free of any other buildings, structures or other obstructions of any nature whatsoever, including new shade or ornamental trees.

6. Notwithstanding any rule of law or equity, the Works shall at all times remain the property of the Transferee notwithstanding that the same may be annexed or affixed to the said lands.
7. The Transferor and Transferee acknowledge that residential dwelling units have been or will be constructed on the Site, and that part of the Works have been or will be located on that portion of the Site unoccupied by any dwelling units, and part in horizontal and/or vertical service spaces in the dwelling units from which individual service drops will be made. The Transferor shall provide unobstructed conduits in the horizontal and/or vertical service spaces, and where necessary, related facilities such as pull boxes, outlet boxes, electrical outlets and 120 volt/15 amp, AC current for amplifiers, in locations and in a manner approved by the Transferee. The Transferee shall have access to those parts of the Works located in the horizontal and/or vertical service spaces during daylight hours only, except in case of an emergency.
8. The Transferor and Transferee acknowledge that the Site may be registered as a condominium under the provisions of the Condominium Act. The Transferor agrees that the declaration and description shall be drafted such that the Works shall be excluded from the Units and will form part of the common elements of the condominium.
9. The rights and easements hereby transferred are and shall be of the same force and effect to all intents and purposes as a covenant running with the land, and this Transfer of Easement including all the covenants and conditions herein contained shall extend to, be binding upon and enure to the benefit of the parties hereto and their respective successors and assigns.
10. All covenants herein contained shall be construed to be several as well as joint, and wherever the singular or masculine is used, it shall be construed as if the plural or the feminine or the neuter, as the case may be, had been used where the context or the parties hereto so require, and the rest of the sentence shall be construed as if the grammatical and terminological changes thereby rendered necessary had been made.

The applicant(s) hereby applies to the Land Registrar.

yyyy mm dd Page 1 of 4

Properties

PIN	Description	Estate/Qualifier	Fee	Simple Lt Conversion	Qualified	<input checked="" type="checkbox"/> Redescription
03943 - 0085 LT	PART OF LOT 14, PLAN 457, CITY OF OTTAWA, DESIGNATED AS PARTS 1 AND 2 ON PLAN 4R-19561					
	RESERVING AN UNOBSTRUCTED RIGHT OF WAY IN PERPETUITY OVER PART 2 ON PLAN 4R-19561 IN FAVOUR OF THE OWNER OR OWNERS FROM TIME TO TIME OF PART LOT 19, CONCESSION 2, (OTTAWA FRONT), GEOGRAPHIC TOWNSHIP OF NEPEAN, CITY OF OTTAWA, BEING PIN 03943-0092, DESIGNATED AS PART 7 ON PLAN 4R-14541 FOR ACCESS PURPOSES;					
	RESERVING AN UNOBSTRUCTED RIGHT OF WAY IN PERPETUITY OVER PART OF LOT 14, PLAN 4M-457, BEING PIN 03943-0085, DESIGNATED AS PART 2 ON PLAN 4R-19561, IN FAVOUR OF THE OWNER OR OWNERS FROM TIME TO TIME OF PART OF LOT 19, CONCESSION 2, (OTTAWA FRONT) GEOGRAPHIC TOWNSHIP OF NEPEAN, CITY OF OTTAWA, BEING PIN 03943-0093, DESIGNATED AS PART 8 ON PLAN 4R-14541, FOR ACCESS PURPOSES;					
	RESERVING AN UNOBSTRUCTED RIGHT OF WAY IN PERPETUITY OVER PART OF LOT 14, PLAN 4M-457, BEING PIN 03943-0085, DESIGNATED AS PART 2 ON PLAN 4R-19561 IN FAVOUR OF THE OWNER OR OWNERS FROM TIME TO TIME OF PART OF LOT 19, CONCESSION 2 (OTTAWA FRONT), GEOGRAPHIC TOWNSHIP OF NEPEAN, CITY OF OTTAWA, BEING PIN 03943-0094, DESIGNATED AS PART 9 ON PLAN 4R-14541, FOR ACCESS PURPOSES;					
	RESERVING AN UNOBSTRUCTED RIGHT OF WAY IN PERPETUITY OVER PART OF LOT 14, PLAN 4M-457, BEING PIN 03943-0085, DESIGNATED AS PART 2 ON PLAN 4R-19561 IN FAVOUR OF THE OWNER OR OWNERS FROM TIME TO TIME OF PART OF LOT 19, CONCESSION 2 (OTTAWA FRONT) GEOGRAPHIC TOWNSHIP OF NEPEAN, CITY OF OTTAWA, BEING PIN 03943-0095, DESIGNATED AS PART 10 ON PLAN 4R-14541, FOR ACCESS PURPOSES.					

Address OTTAWA

PIN 03943 - 0084 LT Estate/Qualifier Fee Simple Lt Conversion Qualified ☒ Split

Description PART OF LOT 19, CONCESSION 2, OTTAWA FRONT, NEPEAN AND PART OF LOT 14 PLAN 457, OTTAWA, DESIGNATED AS PARTS 3 AND 4 ON PLAN 4R-19561.

Address OTTAWA

Consideration

Consideration \$0.00

Transferor(s)

The transferor(s) hereby transfers the land to the transferee(s).

Name DEVMAX INC.

Address for Service 3-230 Nepean Street
Ottawa, Ontario

I, Nicholas Pope, have the authority to bind the corporation.
This document is not authorized under Power of Attorney by this party.

Transferee(s)

Name	Capacity	Share
1470303 ONTARIO INC.		
Address for Service 3-230 Nepean Street Ottawa, Ontario	Beneficial Owner	

The applicant(s) hereby applies to the Land Registrar.

yyyy mm dd Page 2 of 4

Statements

A consent from the CITY OF OTTAWA has been obtained for this severance and contains the following conditions: 1) Notwithstanding the provisions of Section 50(12) of the Planning Act, R.S.O. 1990, c.P. 13, it is hereby stipulated that on any subsequent conveyance or other transaction involving this parcel of land, Section 50(3) or Section 50(5) of the Planning Act will apply. 2) That the Owner convey the severed land to the abutting land owner to the north, municipally known as 841 Grenon Avenue. 3) That the Owner make the appropriate applications under the Land Titles Act to register on the title of the property the following covenant/notices that shall run with the land and bind future owners on subsequent transfers: "This parcel of land cannot be conveyed by itself without a further Planning Act Consent and is considered to have merged in Title with the abutting land to the north, known as 841 Grenon Avenue". 4) That the Owner file with the Committee a copy of the Registered Plan prepared by an Ontario Land Surveyor registered in the Province of Ontario, and signed by the Registrar, confirming the frontage and area of the severed land. The Reference Plan must conform substantially to the sketch filed with the Application for Consent. 5) That upon completion of the conditions as outlined above, and within a one-year period from the date of this Decision, the Owner(s) file with the Committee, the "electronic registration in preparation documents" for the conveyance and grant of easement/right-of-way for which the consent is required.

Schedule: DEVMAX INC. is transferring a 100% interest in the property being formerly part of the Common Area of 855 Grenon Avenue, Ottawa.

Signed By

Daniel Lewis McCowell	1520-360 Albert St. Ottawa K1R 7X7	acting for Transferor(s)	Signed	2004 07 29
Tel	613-238-8865			
Fax	6132388880			
Daniel Lewis McCowell	1520-360 Albert St. Ottawa K1R 7X7	acting for Transferee(s)	Signed	2004 07 29
Tel	613-238-8865			
Fax	6132388880			

Submitted By

GIBSON & MACLAREN LLP	1520-360 Albert St. Ottawa K1R 7X7			2004 08 12
Tel	613-238-8865			
Fax	6132388880			

Fees/Taxes/Payment

Statutory Registration Fee	\$60.00
Land Transfer Tax	\$0.00
Total Paid	\$60.00

The applicant(s) hereby applies to the Land Registrar.

yyyy mm dd Page 1 of 4

Properties

PIN 03943 - 0042 LT **Interest/Estate** Fee Simple
Description PT LT 14 PLAN 457 AS IN CR321404 OTTAWA
Address 00841 GRENON AVENUE
 OTTAWA

PIN 03943 - 0085 LT **Interest/Estate** Fee Simple
Description PART OF LOT 14 PLAN 457, OTTAWA, PARTS 1 AND 2 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 7PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PL AN 4R19561 IN FAVOUR OF PART 8 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 9PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PL AN 4R19561 IN FAVOUR OF PART 10 PLAN 4R14541 AS IN OC362453.
 OTTAWA

Address 03943 - 0114 LT **Interest/Estate** Fee Simple
Description PART OF LOT 14 PLAN 457, OTTAWA, PART 3 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.
 OTTAWA

Address 03943 - 0115 LT **Interest/Estate** Fee Simple
Description PART OF LOT 14 PLAN 457, OTTAWA, PART 4 PLAN 4R19561. SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.
 OTTAWA

Consideration

Consideration \$170,000.00

Transferor(s)

The transferor(s) hereby transfers the land to the transferee(s).

Name 1470303 ONTARIO INC.
Address for Service c/o Michael J. McLAUGHLIN, Barrister
 & Solicitor, 3000-210 Gladstone
 Avenue Ottawa, Ontario K2P 0Y6

I, Nicholas Pope, have the authority to bind the corporation.
 This document is not authorized under Power of Attorney by this party.

Transferee(s)

Name ELEVL, MUSTAFA
Date of Birth 1966 01 01
Address for Service 841 Grenon Avenue
 Ottawa ON K2B 6G1

Capacity**Share**

STATEMENT OF THE TRANSFEROR (S): The transferor(s) verifies that to the best of the transferor's knowledge and belief, this transfer does not contravene the Planning Act.

STATEMENT OF THE SOLICITOR FOR THE TRANSFEROR (S): I have explained the effect of the Planning Act to the transferor(s) and I have made inquiries of the transferor(s) to determine that this transfer does not contravene that Act and based on the information supplied by the transferor(s), to the best of my knowledge and belief, this transfer does not contravene that Act. I am an Ontario solicitor in good standing.

STATEMENT OF THE SOLICITOR FOR THE TRANSFEEE (S): I have investigated the title to this land and to adjoining land where relevant and I am satisfied that the title records reveal no contravention as set out in the Planning Act, and to the best of my knowledge and belief this transfer does not contravene the Planning Act. I act independently of the solicitor for the transferor(s) and I am an Ontario solicitor in good standing.

Signed By

Michael John McLaughlin 3000-210 Gladstone Ave. acting for Transferor(s) Signed 2005 11 02
 Ottawa K2P 0Y6

The applicant(s) hereby applies to the Land Registrar.

yyyy mm dd Page 2 of 4

Signed By

Tel	613-236-1007		
Fax	6132364422		
Michael Lawrence Wong	200-2650 Queensview Drive	acting for Transferee(s)	Signed 2005 11 02
	Ottawa K2B 8H6		
Tel	613-820-6067		
Fax	6138208818		

Submitted By

MICHAEL L. WONG	200-2650 Queensview Drive	2005 11 02
	Ottawa K2B 8H6	
Tel	613-820-6067	
Fax	6138208818	

Fees/Taxes/Payment

Statutory Registration Fee	\$60.00
Land Transfer Tax	\$1,425.00
Total Paid	\$1,485.00

File Number

Transferee Client File Number : MLW96204

LAND TRANSFER TAX STATEMENTS

In the matter of the conveyance of: 03943 - 0042 PT LT 14 PLAN 457 AS IN CR321404 OTTAWA

03943 - 0085 PART OF LOT 14 PLAN 457, OTTAWA, PARTS 1 AND 2 PLAN 4R19561, SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 7 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PL. AN 4R19561 IN FAVOUR OF PART 8 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PLAN 4R19561 IN FAVOUR OF PART 9 PLAN 4R14541 AS IN OC362453. SUBJECT TO A RIGHT OF WAY OVER PART 2 PL. AN 4R19561 IN FAVOUR OF PART 10 PLAN 4R14541 AS IN OC362453.

03943 - 0114 PART OF LOT 14 PLAN 457, OTTAWA, PART 3 PLAN 4R19561, SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.

03943 - 0115 PART OF LOT 14 PLAN 457, OTTAWA, PART 4 PLAN 4R19561, SUBJECT TO AN EASEMENT IN FAVOUR OF BELL CANADA AS IN LT1198683. SUBJECT TO AN EASEMENT IN FAVOUR OF ROGERS OTTAWA LIMITED/LIMITEE AS IN LT1198895.

BY: 1470303 ONTARIO INC.
TO: ELEVLI, MUSTAFA

1. ELEVLI, MUSTAFA

I am

- ☐ (a) A person in trust for whom the land conveyed in the above-described conveyance is being conveyed;
- ☐ (b) A trustee named in the above-described conveyance to whom the land is being conveyed;
- ☒ (c) A transferee named in the above-described conveyance;
- ☐ (d) The authorized agent or solicitor acting in this transaction for _____ described in paragraph(s) () above.
- ☐ (e) The President, Vice-President, Manager, Secretary, Director, or Treasurer authorized to act for _____ described in paragraph(s) () above.
- ☐ (f) A transferee described in paragraph(i) and am making these statements on my own behalf and on behalf of _____ who is my spouse described in paragraph() and as such, I have personal knowledge of the facts herein deposed to.
- ☐ (g) A transferee described in paragraph(i) and am making these statements on my own behalf and on behalf of _____ who is my same-sex partner described above in paragraph(s) ().

3. The total consideration for this transaction is allocated as follows:

(a) Monies paid or to be paid in cash	170,000.00
(b) Mortgages (i) assumed (show principal and interest to be credited against purchase price)	0.00
(ii) Given Back to Vendor	0.00
(c) Property transferred in exchange (detail below)	0.00
(d) Fair market value of the land(s)	0.00
(e) Liens, legacies, annuities and maintenance charges to which transfer is subject	0.00
(f) Other valuable consideration subject to land transfer tax (detail below)	0.00
(g) Value of land, building, fixtures and goodwill subject to land transfer tax (total of (a) to (f))	170,000.00
(h) VALUE OF ALL CHATTELS - items of tangible personal property	0.00
(i) Other considerations for transaction not included in (g) or (h) above	0.00
(j) Total consideration	170,000.00

PROPERTY Information Record

A. Nature of Instrument:	Transfer				
LRO	4	Registration No.	OC529887	Date:	2005/11/02
B. Property(s):	PIN 03943 – 0042	Address	00841 GRENON AVENUE OTTAWA	Assessment	–
	PIN 03943 – 0085	Address	OTTAWA	Assessment	–
	PIN 03943 – 0114	Address	OTTAWA	Assessment	–
	PIN 03943 – 0115	Address	OTTAWA	Assessment	–
C. Address for Service:	841 Grenon Avenue Ottawa ON K2B 6G1				
D. (i) Last Conveyance(s):	PIN 03943 – 0042	Registration No.	OC14783		
	PIN 03943 – 0085	Registration No.	OC362453		
	PIN 03943 – 0114	Registration No.	OC362453		
	PIN 03943 – 0115	Registration No.	OC362453		

LAND TRANSFER TAX STATEMENTS

(ii) Legal Description for Property Conveyed: Same as in last conveyance? Yes ☒ No ☐ Not known ☐

E. Tax Statements Prepared By:

Michael Lawrence Wong

200-2650 Queensview Drive

Ottawa K2B 8H6