


MAINSTREET

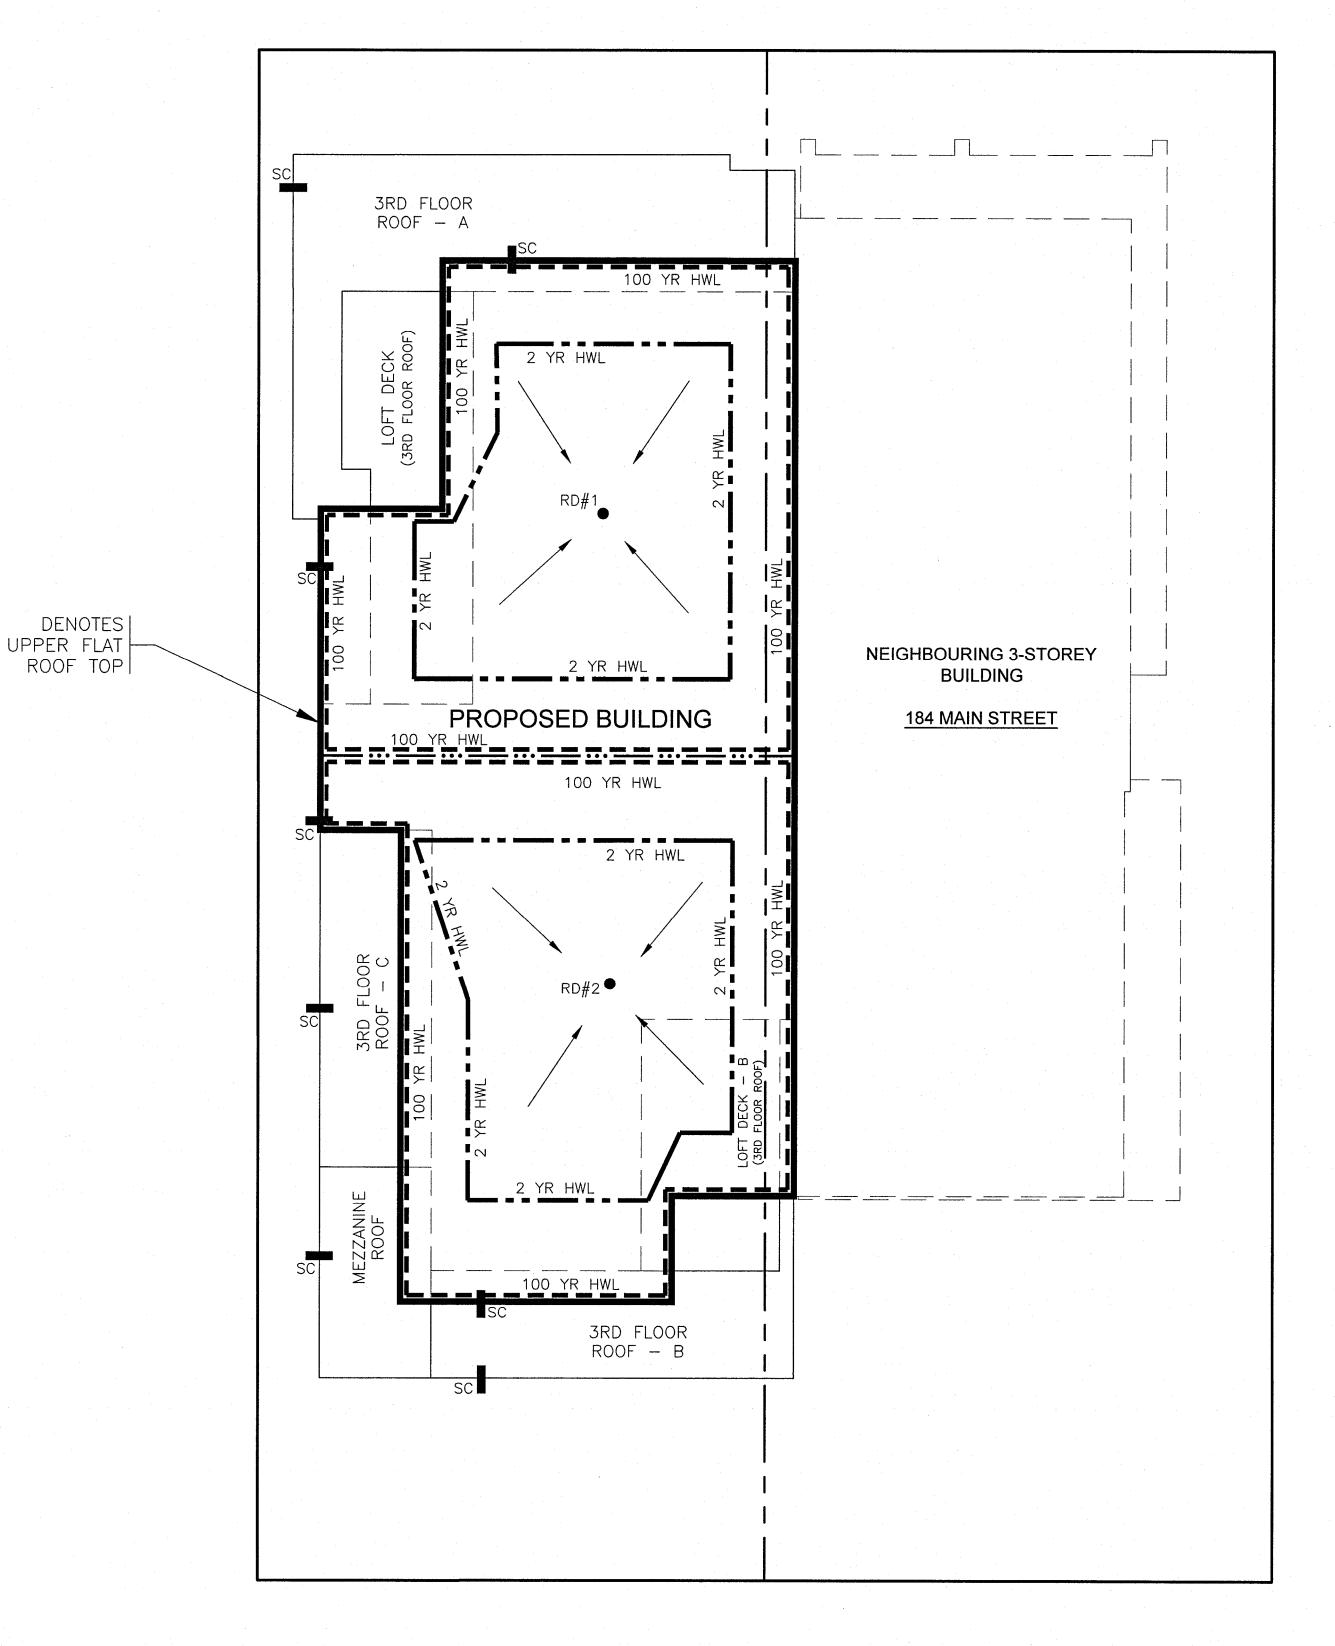

NOTES

1. STORMWATER MANAGEMENT NOTES

ROOF DRAIN DETAILS

MODEL TYPE: WATTS MODEL "ADJUSTABLE ACCUTROL WEIR" (MODEL No. RD-100A-ADJ), (WEIR OPENING EXPOSED IS: CLOSED) TO PERMIT A RELEASE FLOW RATE OF 5.0 US GAL/MIN. OR 0.32 L/s UNDER A HEAD OF 100mm AND AT MAXIMUM FLOW RATE OF 5.0 US GAL/MIN. OR 0.32 L/s UNDER A HEAD OF UP TO

NUMBER OF CONTROL DEVICES: 1 CONTROLLED ROOF DRAIN PER DESIGNATED ROOF AREA FOR SWM ATTENUATION

MAXIMUM FLOW PER ROOF DRAIN: 5.0 U.S. GAL/MIN. OR 0.32 L/s.

TOTAL FLOW FROM FLAT ROOFTOP OF BUILDING AT MAXIMUM HEAD OF 150mm PER DRAIN AT THE (2) PROPOSED DRAINS = 0.64 L/s

DEPTH AND VOLUME:

ROOF DRAIN ID &	NUMBER OF ROOF DRAINS	WATTS ROOF DRAIN MODEL ID (WEIR OPENING)	CONTROLLED FLOW PER DRAIN (L/s)		APPROXIMATE PONDING DEPTH ABOVE DRAINS (m)		STORAGE VOLUME REQUIRED (m³)		MAX. STORAGE
DRAINAGE AREA (ha)			2 YR	100 YR	2 YR	100 YR	2 YR	100 YR	AVAILABLE (m³)
RD-1 (0.0082 ha)	1	RD-100-A-ADJ (CLOSED)	0.32	0.32	0.10	0.15	0.92	3.46	3.96
RD-2 (0.0080 ha)	. 1	RD-100-A-ADJ (CLOSED)	0.32	0.32	0.10	0.15	0.87	3.35	3.95
TOTAL ROOF (0.0162 ha)	2		0.64	0.64	-	-	1.79	6.81	7.91

SCUPPER LOCATION: AS SHOWN ON THIS DRAWING

2 YEAR ELEVATION: 100mm ABOVE THE ROOF DRAIN FOR ROOF AREA #1 AND #2

100 YEAR ELEVATION: 150mm ABOVE THE ROOF DRAIN FOR ROOF AREA #1 AND #2

- EACH ROOF DRAIN SHALL BE SIZED FOR A (MAX) RELEASE RATE OF 5.0 U.S. GAL/MIN. OR 0.32 L/s. UNDER A HEAD OF 150mm. THE OWNER'S MECHANICAL ENGINEER SHALL SPECIFY THE REQUIRED ROOF DRAIN TYPE AND MODEL No. AND PROVIDE THE NECESSARY INFORMATION TO THE CITY OF OTTAWA FOR THEIR RECORDS TO ENSURE PROPER RELEASE RATE FOR STORMWATER MANAGEMENT COMPLIANCE.

- ROOF PITCH IS ASSUMED TO HAVE 2.0% (MIN.) SLOPE.

- ROOF SCUPPERS ARE RECOMMENDED TO BE INSTALLED 0mm ABOVE EDGE OF ROOFTOP ELEVATION FOR EMERGENCY OVERFLOW PURPOSES AT ROOF AREA #1 AND #2 AT PERIMETER OF BUILDING.


- SEE STORM DRAINAGE REPORT No. R-822-100 DATED OCTOBER 2022 FOR DETAILS ALSO.

2. PROPOSED ROOF DRAINS AND SCUPPER LOCATIONS SHOWN ON THIS PLAN SHALL BE REVIEWED BY THE OWNER AND OWNER'S BUILDING DESIGNER FOR APPROVAL.

3. THE OWNER'S BUILDING DESIGNER AND STRUCTURAL ENGINEER SHALL ENSURE THAT THE ADDITIONAL STORMWATER STORAGE VOLUME FROM STORMWATER MANAGEMENT MEASURES ARE ACCOUNTED FOR IN THE STRUCTURAL DESIGN OF AND WATERPROOFING OF ROOF AREA #1 AND #2 AND ANY OF THE SUPPORTING STRUCTURES THAT MAY BE AFFECTED BY THE STORED WATER.

4. ROOF DRAIN #1 AND #2 INCLUSIVE SHALL OUTLET INTO THE DESIGNATED 150mm@ PVC STORMWATER PIPE AS SHOWN ON THE PROPOSED GRADING AND SERVICING PLAN (DWG No. 822-100, G-1).

5. FOR GRADING AND SERVICING DETAILS OF THIS SITE, REFER TO DWG. No. 822-100, G-1.

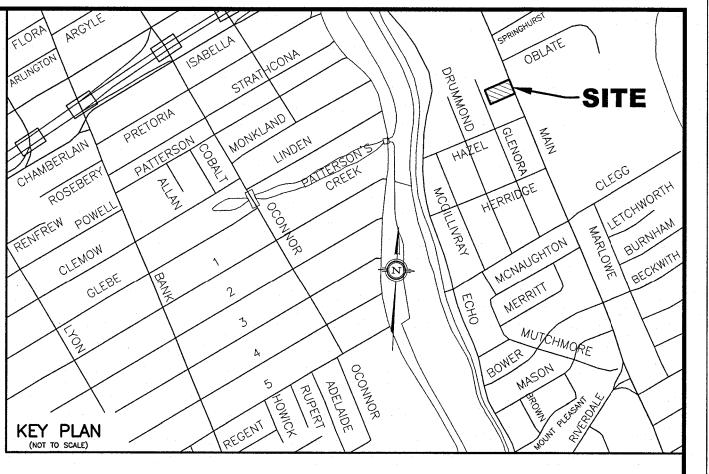

LEGEND

100 YR HIGH WATER LEVEL

2 YR HIGH WATER LEVEL

PROPOSED HIGH RIDGE LINE

PROPOSED ROOF DRAIN NUMBER AND LOCATION

PROPOSED ROOF SCUPPER LOCATION

PROPOSED GENERAL DIRECTION OF LOT GRADING AND SURFACE FLOW

Adjustable Accutrol Weir

Adjustable Flow Control for Roof Drains

ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)


For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol.


The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per Inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.

Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2°of head will be restricted to 2-1/2 gpm per Inch of head.

Therefore, at 3° of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be: [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

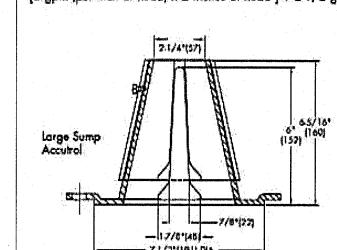



BLE 1. Adjustoble			al Ciana	. Data	Data California			
The second	NODIO I*	ACCUM 24	Name and Address of the Owner, where	محبوب والمراجعية	3011111GS	47		
Netr Opening Exposed		Flow R	ote (gal	ons per	minute)			
Fully Exposed	5	10	15	20	25	30		
2/4	S	10	1275	17.5	21,25	25		
1/2	:5	10	125	15	17.5	20		
1/4	5	10	11.25	12.5	13.75	15		

ABLE 1. Adju	slable /	Acculm	ol Flow	Rate:	Sollings	i.
	10	2"	3"	4.	F	67
Wetr Opening Exposed		Flow Ru	ote (gal	ons per	minutel	
Fully Exposed	\$	10	15	20	25	30
2/4	: S	10	12.75	17.5	21,25	25
1/3	5	10	125	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Ound	្ន	5	5	5	5	5

-	.					
1						
26						
1000						
1	12					
596						
	1					
-						
1						
_	1					
1						
_						

REVISIONS AS PER ARCHITECT'S REVISED SITE PLAN OF FEB. 23, 2023 AND CITY'S REVIEW COMMENTS OF JAN. 13, 2023 03/01/23 ISSUED FOR SITE PLAN APPLICATION 10/14/22



SCALE			DESIGN	T.L.M.	PROJECT
0 0.75	2.25	.3.75m	CHECKED T.L.M.		
	1:75 HORIZONTAL	.	DRAWN BY	P.M.	
			CHECKED	T.L.M.	DRAWING
	•		APPROVED	· · · · · · · · · · · · · · · · · · ·	

T.L.M.

180 MAIN STREET PART OF LOT 4 IN BLOCK A REGISTERED PLAN 102 CITY OF OTTAWA

PROPOSED ROOFTOP STORMWATER MANAGEMENT PLAN

T.L. MAK ENGINEERING CONSULTANTS LTD. CONSULTING ENGINEERS

AUGUST 2022 822-100

SWM-1