


METRIC
DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

CAUTION
THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.

Limit of Proposed Road Cuts
- Existing Water Service to be Confirmed to be Blanked at the Main at Time of Construction.
- 40mm Lift of HMA Superpave 12.5mm PG 58-34 Level B Asphalt to be Placed to Cover the Extent of the Road Cuts if 3 or More Road Cuts are Located Within 12m of Each Other.
- The Extent of the Resurfacing Must Be to the Nearest Lane Line, Centreline, or Curb of Each Road Cut.

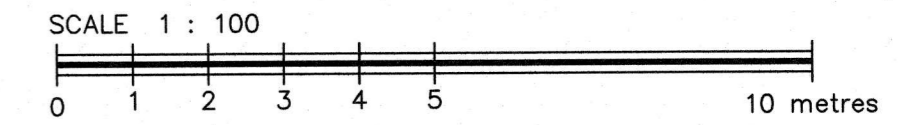


- NOTES**
- ONE - 2 STOREY SEMI-DETACHED DWELLING TO BE CONSTRUCTED. DWELLING TO BE CONSTRUCTED USING CONTINUOUS INSULATED CONCRETE FORMS (CIF) ON ALL FLOORS AND AS SUCH DOES NOT HAVE A DEFINED TOP OF FOUNDATION WALL.
 - LOT DIMENSIONS AND EXISTING CONDITIONS ARE AS SHOWN ON TOPOGRAPHIC SURVEY BY FAIRHALL, MOFFATT & WOODLAND LIMITED O.L.S., DATED JANUARY 25, 2023, REF. 28 - 330973.
 - EXCAVATE AND DISPOSE OF ALL EXCESS EXCAVATED MATERIAL, SUCH AS ASPHALT, CURBING AND DEBRIS, OFF SITE OR AS DIRECTED BY THE ENGINEER.
 - BUILDER TO VERIFY LOCATION OF ALL UNDERGROUND UTILITIES AND SERVICES PRIOR TO CONSTRUCTION AND TO VERIFY INVERT ELEVATIONS OF SEWER STUBS AND TO VERIFY MINIMUM SEPARATION DISTANCES.
 - EXISTING ASPHALT DRIVEWAY TO BE REMOVED AND REPLACED WITH SOFT SURFACE WHERE APPLICABLE.
 - ALL SERVICES ARE TO BE EXPOSED AND GRADES DETERMINED IN THE FIELD BEFORE COMMENCING NEW CONNECTIONS.
 - INSTALL SEWER SERVICES PRIOR TO GRADE EXCAVATION TO VERIFY PROPOSED UNDERSIDE OF FOOTING ELEVATION.
 - WATER AND SEWER WORK AND MATERIALS TO BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
 - SANITARY/STORM SERVICE LATERAL TO CONNECT TO SANITARY/STORM MAIN IN ACCORDANCE WITH CITY STANDARD S11 FOR CONNECTION TO RIGID SEWER MAIN. CONNECTION VIA CORING IS REQUIRED, AS PER CITY STANDARD S11.2, WHERE SERVICE LATERAL DIAMETER IS GREATER THAN 50% OF THE DIAMETER OF THE RIGID SEWER MAIN.
 - INVERT ELEVATION FOR SANITARY SERVICE TO BE 300MM BELOW USF AT DWELLING OR SLEEVED.
 - PROPOSED SEWER LATERAL AND WATER SERVICE LATERAL TO BE SLEEVED UNDER EACH PORCH. PROPOSED STORM LATERAL TO BE SLEEVED THROUGH FOUNDATION WALL.
 - BACKWATER VALVES ARE TO BE INSTALLED AS PER CITY STANDARDS S14 AND S14.1 OR S14.2.
 - INSTALLATION OF REMOTE WATER METER PER CITY OF OTTAWA STANDARDS.
 - CONNECTION TO EXISTING WATER BY CITY OF OTTAWA FORCES.
 - MINIMUM COVERAGE FOR ALL SEWER LATERALS AND LEADS SHALL BE 2.0m FROM THE FINISHED GRADE UNLESS INSULATION IS PROVIDED AS PER CITY STANDARD W22.
 - EAVES TROUGHING WILL BE INSTALLED. EAVES TROUGH DOWNSPOUTS TO BE DISCHARGED TOWARD THE STREET AND SPLASH PAD TO BE INSTALLED WHEN DOWNSPOUT IS LESS THAN 1.5m FROM PROPERTY LIMIT.
 - GRADING IN GRASSED AREAS IS TO BE BETWEEN 2% AND 7% UNTERRACED. GRADES IN EXCESS OF 7% WILL REQUIRE TERRACING AT A MAXIMUM OF 3H:1V.
 - WATER SERVICE MUST HAVE A MINIMUM 2.4m OF COVER OR INSULATED AS PER CITY STANDARD W22.
 - ANY PROPOSED WINDOW WELLS ARE TO BE DRAINED THROUGH GRAVEL TOWARD WEeping TILES. DIRECT CONNECTIONS TO WEeping TILES ARE PROHIBITED.
 - WATERMAIN DEPTH IS TO BE VERIFIED IN THE FIELD. 0.30 MINIMUM SEPARATION BETWEEN EXISTING WATERMAIN AND PROPOSED SEWER LATERALS. IF 0.30 MINIMUM SEPARATION CANNOT BE MET BASED ON FINDINGS, UNSHRINKABLE FILL IS TO BE USED UPON COORDINATION WITH CITY INSPECTOR.
 - EXISTING WATER SERVICE TO BE BLANKED AT THE MAIN.
 - EXISTING SEWER LATERALS ARE TO BE DECOMMISSIONED AT THE PROPERTY LIMIT AS PER CITY OF OTTAWA STANDARD S11.4.
 - SUMP PIT AND PUMP TO BE INSTALLED FOR EACH UNIT.
 - ANY PROPOSED SWALES ARE TO BE A MINIMUM 0.30m FROM ALL PROPERTY LINES.
 - GRADING TO MATCH EXISTING GRADES AROUND PERIMETER OF LOT. NO CHANGE TO EXISTING DRAINAGE PATTERNS ARE PROPOSED.
 - NO EXCESS DRAINAGE WILL BE DIRECTED TOWARD NEIGHBOURING PROPERTIES DURING OR AFTER CONSTRUCTION.
 - ALL CATCH BASINS AND MAINTENANCE HOLES ARE TO BE PROTECTED DURING CONSTRUCTION ACTIVITIES BY INSTALLING SEDIMENT BARRIERS.
 - THE CONTRACTOR WILL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATER COURSE DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES BY ANY APPLICABLE REGULATORY AGENCY.
 - PROPOSED SERVICES ARE TO BE LOCATED OUTSIDE OF A TREE'S CRITICAL ROOT ZONE (CRZ). THE RADIUS OF THE CRITICAL ROOT ZONE (CRZ) IS CALCULATED BY MULTIPLYING THE DIAMETER OF THE TREE TRUNK AT BREAST HEIGHT BY A FACTOR OF 10. THIS AREA, CENTRED AROUND THE BASE OF THE TREE, IS TO BE PROTECTED BEFORE AND AFTER CONSTRUCTION. PLEASE NOTE THAT A TREE PERMIT IS REQUIRED TO REMOVE ANY TREES LOCATED IN THE RIGHT-OF-WAY. VISIT OTTAWA.CA/URBANTREE OR PHONE 311 AND TO APPLY FOR A DISTINCTIVE TREE PERMIT OR FOR MORE INFORMATION REGARDING THE URBAN TREE CONSERVATION BY-LAW.
 - ALL TREES ON THE SUBJECT PROPERTY AND RIGHT-OF-WAY (STREET) SHALL BE PROTECTED AS PER THE MUNICIPAL TREES AND NATURAL AREAS PROTECTION BY-LAWS AND THE URBAN TREES CONSERVATION BY-LAW, AS AMENDED FROM TIME TO TIME.
 - ALL TREES WITHIN THE STREET RIGHT OF WAY TO BE PROTECTED AND MAINTAINED BEFORE AND AFTER CONSTRUCTION.
 - ALL TREES WITHIN THE STREET RIGHT OF WAY TO BE PROTECTED AND MAINTAINED BEFORE AND AFTER CONSTRUCTION.
 - LONG RADIUS BENDS IN SERVICE LATERALS ARE RECOMMENDED. OTHERWISE, A MAXIMUM OF TWO 22.5 DEGREE BENDS ARE PERMITTED FOR EACH SERVICE LATERAL. BOTH BENDS MUST BE LOCATED A MINIMUM 1.0m WITHIN THE PROPERTY BOUNDARY AND MUST BE SEPARATED BY A MINIMUM OF 1.0m. ALL BENDS MUST BE A MINIMUM OF 1.0m FROM ANY VALVE INCLUDING WATER SHUT OFF VALVE.

TOTAL SERVICING MATERIALS - EACH UNIT - (Minimum Lengths)

WATER SUPPLY - 16±m. 19mm dia. SOFT K COPPER
SANITARY SEWER - 19±m. 125mm dia. P.V.C. SDR 28
STORM SEWER - 22±m. 100mm dia. P.V.C. SDR 28

Job Benchmark
Fire Hydrant -
Top of Spindle
Elevation=94.78

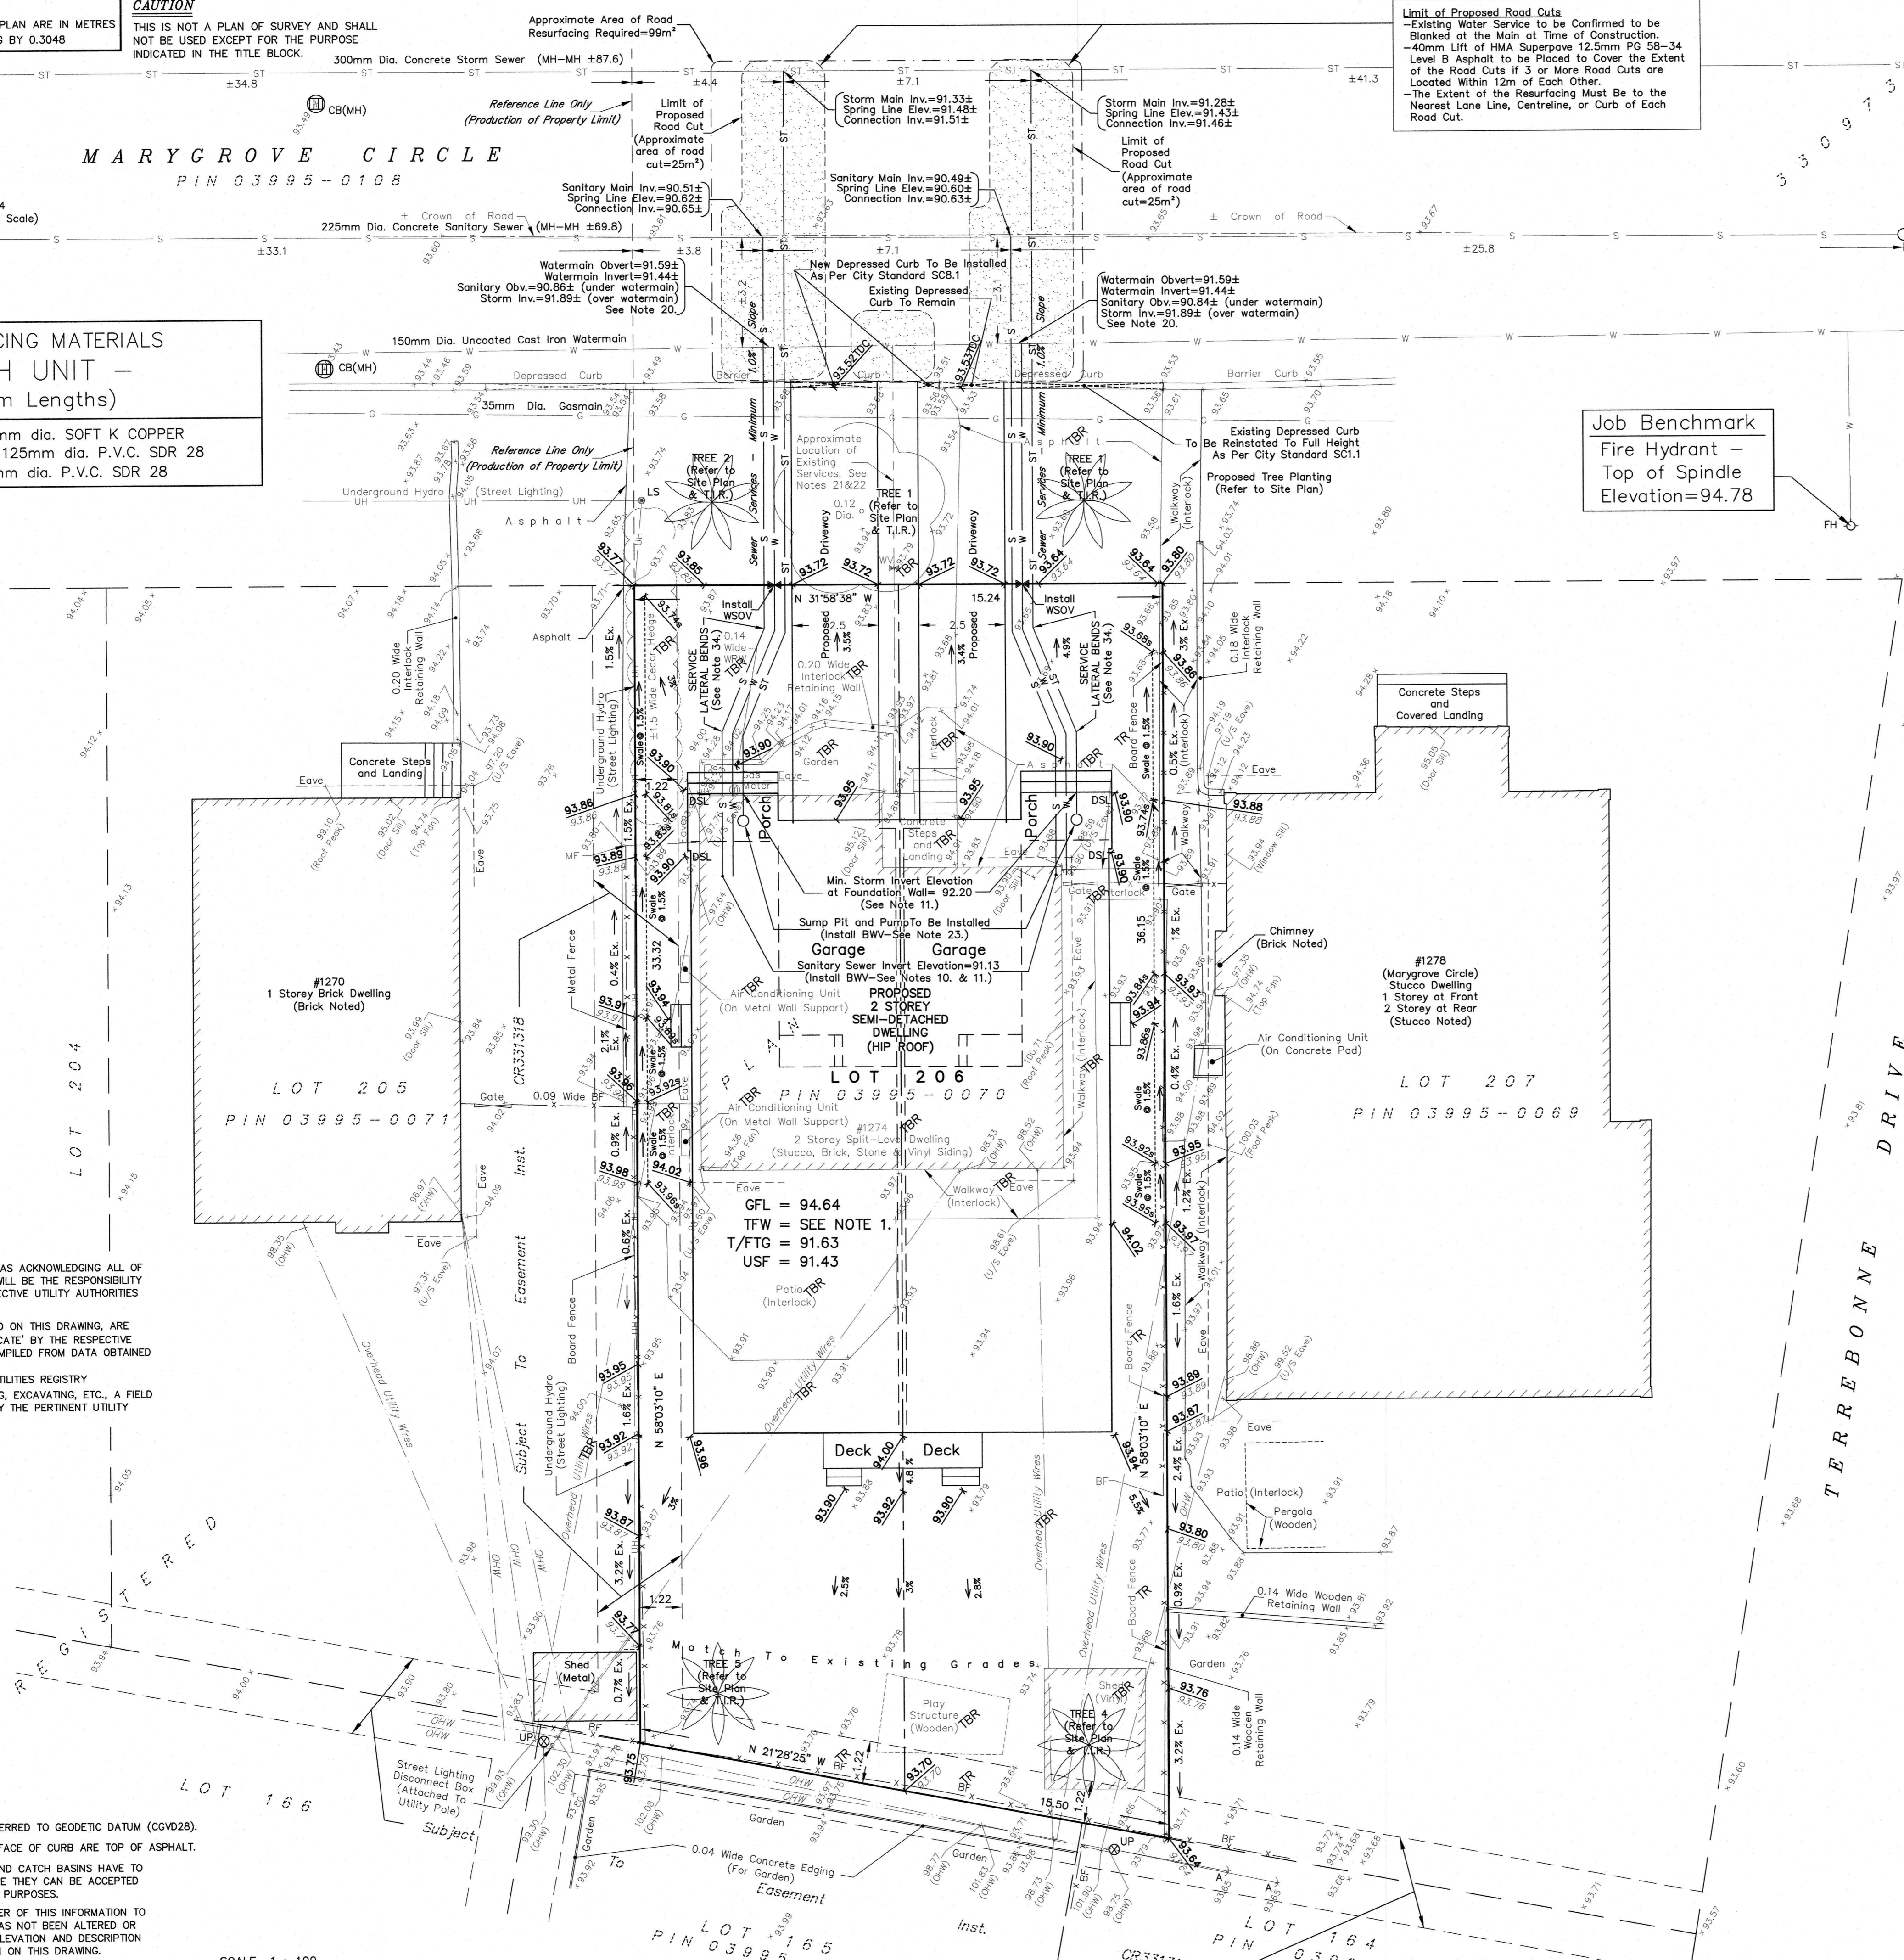

- UTILITY NOTES**
- THIS DRAWING CANNOT BE ACCEPTED AS ACKNOWLEDGING ALL OF THE UNDERGROUND UTILITIES AND IT WILL BE THE RESPONSIBILITY OF THE USER TO CONTACT THE RESPECTIVE UTILITY AUTHORITIES FOR CONFIRMATION OR LOCATION.
 - UNDERGROUND UTILITIES, AS REPORTED ON THIS DRAWING, ARE NOT BASED ON AN ACTUAL FIELD LOCATE BY THE RESPECTIVE UTILITY AGENCIES BUT HAVE BEEN COMPILED FROM DATA OBTAINED FROM THE FOLLOWING SOURCE:
 - CITY OF OTTAWA PUBLIC UTILITIES REGISTRY
 - BEFORE ANY WORK INVOLVING PROBING, EXCAVATING, ETC., A FIELD LOCATION OF UNDERGROUND PLANT BY THE PERTINENT UTILITY AUTHORITY IS MANDATORY.

- ELEVATION NOTES**
- ELEVATIONS SHOWN HEREON ARE REFERRED TO GEODETIC DATUM (CGVD28).
 - EXISTING ELEVATIONS SHOWN ALONG FACE OF CURB ARE TOP OF ASPHALT.
 - ELEVATIONS FOR MANHOLE COVERS AND CATCH BASINS HAVE TO BE INDEPENDENTLY CONFIRMED BEFORE THEY CAN BE ACCEPTED FOR FINAL DESIGN OR CONSTRUCTION PURPOSES.
 - IT IS THE RESPONSIBILITY OF THE USER OF THIS INFORMATION TO VERIFY THAT THE JOB BENCHMARK HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREE WITH THE INFORMATION SHOWN ON THIS DRAWING.

- LEGEND**
- ← DIRECTION OF DRAINAGE
 - 99.99 - PROPOSED GRADE
 - 99.99 - EXISTING GRADE
 - 99.99s - SWALE GRADE
 - GFL - GROUND FLOOR LEVEL
 - T/FTG - TOP OF FOOTING
 - USF - UNDERSIDE OF FOOTING
 - TBR - TO BE REMOVED
 - TR - TO REMAIN
 - BWV - BACKWATER VALVE
 - WRW - WOOD RETAINING WALL
 - TDC - TOP OF DEPRESSED CURB
 - WSOV - WATER SHUT OFF VALVE
 - DSL - DOWNSPOUT LOCATION
 - PIN - PROPERTY IDENTIFIER NUMBER
 - DIA - DIAMETER
 - OBV - OVERT
 - INV - INVERT
 - EX - EXISTING
 - PROP. - PROPOSED
 - FDN. - FOUNDATION
 - U/S - UNDERSIDE
 - C/L - CENTRELINE
 - CITY - CITY OF OTTAWA
 - MF - METAL FENCE
 - BF - BOARD FENCE
 - ASP - ASPHALT
 - T.I.R. - TREE INFORMATION REPORT
 - LS - LAMP STANDARD
 - OHW - OVERHEAD UTILITY WIRES
 - CB - CATCH BASIN
 - OH - MANHOLE
 - WV - WATER VALVE
 - UP - UTILITY POLE
 - A - ANCHOR
 - GM - GAS METER
 - W - WATERMAIN
 - OHW - OVERHEAD UTILITY WIRES
 - G - GAS MAIN
 - S - SANITARY SEWER
 - ST - STORM SEWER
 - UH - UNDERGROUND HYDRO
 - X-X - FENCE
 - SW - SWALE
 - DT - DECIDUOUS TREE
 - PT - PROPOSED TREE PLANTING
 - FH - FIRE HYDRANT
 - TERRACE SLOPE - 3:1 MAX.

Normal High Ground Water Table (NHGW) Elevation relative to the Underside of Footing (USF) Elevation for Infill Projects


The relationship between the proposed Underside of Footing (USF) elevation and the Normal High Ground Water Table (NHGW) elevation for the residential unit(s) has not been verified and is to be determined prior to or at the time of footing/foundation excavation as per the City of Ottawa - Building Code Services requirements.

If it is determined that the footing(s) will be below the NHGW elevation, it is the responsibility of the owner to mitigate this situation by either raising the footing elevation above the NHGW elevation or demonstrate the use of appropriate foundation water proofing methods as per current building code requirements, as amended. The owner must apply for and receive any applicable permits before proceeding with the aforementioned works.

Fairhall, Moffatt & Woodland Limited assumes no responsibility or liability for impact on footings and/or basement drainage or possible damages due to this design arrangement received January 12, 2024.

REVISIONS	
1. FEB. 09, 2023	REVISED REAR DECK AS PER DESIGNER'S INSTRUCTIONS
2. JAN. 12, 2024	REVISED PER CITY AND DESIGNER'S COMMENTS.

© COPYRIGHT 2024. REPRODUCTION, ALTERATION OR DISTRIBUTION OF THIS PLAN WITHOUT THE WRITTEN CONSENT OF FAIRHALL, MOFFATT & WOODLAND LIMITED IS PROHIBITED.

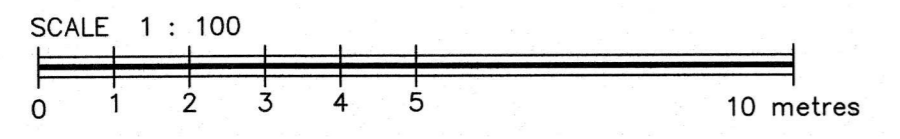

Fairhall Moffatt & Woodland
L I M I T E D
ONTARIO LAND SURVEYORS

Surveying and Land Information Services
100-600 TERRY FOX DRIVE, KANATA, ONTARIO K2L 4B6
TEL: (613) 591-2800 FAX: (613) 591-1465
www.fmw.on.ca

Job No. AC28000
Date: January 25, 2023
Reference No. 28(a) - 330973
Drawing Name: s:\085\AC28000\DWG\sg280ac.dwg (cvt)

LOT 206 REGISTERED PLAN 330973 CITY OF OTTAWA (#1274 Marygrove Circle)
GRADE AND SERVICES PLAN

