



BLANCHARD LETENDRE
ENGINEERING

ADEQUACY OF SITE SERVICING REPORT

**Project Address –1274 Marygrove Circle
Ottawa, ON**

Client: Oleksandr Patsukevych

**By Blanchard Letendre Engineering Ltd.
Date – January 30, 2024
Our File Reference: 23-172**

TABLE OF CONTENTS

Table of Contents	2
1. Introduction	3
1.1. Site Description.....	3
1.2. Proposed Development	3
2. Water Supply	3
3. Sanitary sewage	6
4. Storm sewage.....	7
Conclusion	7
Appendix A – Fire Flow Calculation.....	8
Appendix B – Boundary Conditions.....	9
Appendix C – Sanitary flow calculation.....	10

1. INTRODUCTION

Blanchard Letendre Engineering Ltd. (BLEL) was retained by Oleksandr Patsukevych to prepare a site servicing adequacy report for their proposed semi-detached building on the property located on 1274 Marygrove Circle in the City of Ottawa, Ontario.

This report will address the servicing (water, sanitary) requirements associated with the proposed development in response to the request of the City of Ottawa Planning department due to a rezoning application.

1.1. SITE DESCRIPTION

The existing site is located at 1274 Marygrove Circle, a short street ending with a cul-de-sac. The subject property measures a total area of approximately 0.05.ha.

Currently, the subject property features an existing single family home, which will be demolished and the proposed building will be constructed

1.2. PROPOSED DEVELOPMENT

The proposed development will be a 2-unit semi-detached building with a HIP roof and 2 regular garages, based on the site plan and conceptual floor plans by the owner's designer, Vince Catelli.

The site is fronting 225mm diameter concrete sanitary sewer, a 152mm diameter uncoated cast iron watermain and 300mm diameter concrete storm sewer on Marygrove Circle.

The site is proposed to be serviced from existing municipal water and sanitary services on Marygrove Circle Street.

2. WATER SUPPLY

2.1. Existing Residential Water Demand:

The water is distributed from the grid not far from the proposed development to Clyde Ave and runs from a feeder main on Maitland Ave, to Prom. Terrebonne Dr and finally to Marygrove circle.

The existing water demand is calculated based on the City of Ottawa Water Distribution Design Guidelines for an average house as follow:

- Residential occupancy = 3.4 persons per single family home unit (Table 4.1)

Total occupancy = 3.4 persons

- Residential Average Daily Demand = 280 L/c/d. (Table 4.2)
- Average daily demand of 280 L/c/day x 3.4 persons = 952 Liters/day or 0.011 L/s.
- Maximum Daily Demand (factor of 2.5) is 0.011 L/s x 2.5 = 0.028 L/s
- Peak hourly demand (factor of 2.2) = 0.028 L/s x 2.2 = 0.061 L/s

2.2. Proposed Residential Water Demand

The water demand is calculated based on the City of Ottawa Water Distribution Design Guidelines as follow:

- Residential occupancy = 2.7 persons per semi-detached unit (Table 4.1)
- 2x unit x 2.7pers./unit = 5.4 persons

Total occupancy = 5.4 persons rounded up to 6 persons

- Residential Average Daily Demand = 280 L/c/d. (Table 4.2)
- Average daily demand of 280 L/c/day x 6 persons = 1680 Liters/day or 0.019 L/s.
- Maximum Daily Demand (factor of 2.5) is 0.019 L/s x 2.5 = 0.049 L/s
- Peak hourly demand (factor of 2.2) = 0.049 L/s x 2.2 = 0.11 L/s

The difference in maximum daily demand = 0.11 L/s - 0.061 L/s = 0.05 L/s is negligible.

2.3. Fire Fighting Requirements:

Water demand for firefighting was calculated using both the OBC method and the 1999 FUS method, though the OBC method is proposed to govern the design. The proposed building is defined as two semi-detached units, with both Areas having a footprint of approximately 160 sqm each. The fire flow requirement was calculated treating the entire development as a single building, which is more conservative than considering individual developments with a fire separation.

The fire flow for one area was calculated as 2700L/m. A copy of the calculation can be found in Appendix A.

2.4. Water Boundary Conditions:

The above calculated residential water supply requirement and Fire Fighting Requirement were provided to the City of Ottawa for boundary conditions. The following are boundary conditions, (Provided by the City of Ottawa) HGL, for hydraulic analysis at 1274 Marygrove Circle assumed to be connected to the 152 mm watermain on Marygrove Circle.

Minimum HGL = 126.7m

Maximum HGL = 133.0m

MaxDay + FireFlow (48 L/s) = 93.5m



The proposed development will have an underside of footing of 91.43m. The maximum and minimum HGL in the main at the proposed connection will be 41.57m (59.11 psi) and 35.27m (50.15 psi). The available pressure range exceeds the city's minimum 50psi, but does not exceed 70 psi and therefore pressure reducing valves are not required.

The building is proposed to be serviced with two 19mm diameter HDPE water service (1 for each unit) connecting to the water main on Marygrove Circle. Using the Hazen Williams Equation:

$$h_f = \frac{10.67 \times Q^{1.85} \times L}{C^{1.85} \times d^{4.87}}$$

Where:

hf	Head loss over the length of pipe (m)
Q	Volumetric flow rate (m ³ /s)
L	Length of pipe (m)
C	Pipe roughness coefficient
d	Pipe diameter (m)

The pressure loss as a result of servicing this development was determined to be 0.36psi, which is negligible.

2.5. Water Main Capacity

Fire hydrant flow and pressure tests were provided by the City of Ottawa for one hydrant. The Hydrant is located on the intersection of Marygrove Circle and Prom.Terrebone Dr. Available fire flow is at a pressure of 20psi with a flow of 48L/s (2880 L/m). There are at least one additional hydrant within 135m and another within 95m.

With a static pressure of 20psi, the available fire flow from the single nearest hydrant is not enough to meet the FUS 2020 recommended fire flow.

A copy of fire hydrant flow can be found in Appendix B.

The available fire flow is 2880 L/min, which exceeds the required 1800L/min by the OBC method. A recalculation of the city's boundary conditions to determine the elevation head under MaxDay+FireFlow, or reverting to the OBC method is recommended.

3. SANITARY SEWAGE

3.1. Existing Sanitary Sewage Calculation:

The existing sanitary sewer on Marygrove Circle discharges into the one in Prom. Terrebonne Dr. The existing sanitary sewer on Terrebonne Drive also receives effluent from Maitland Ave Prom. Cameo and Greyrock Cres. The total upstream resident count has been estimated at 502 people with an average daily sewage generation of 1.63L/s.

An infiltration allowance of 0.33L/s/ha has been considered. With an approximate area of 7.61ha, the extraneous flow will be 2.51L/s. The total average flow was calculated as 4.14L/s.

A peaking factor of PF=3.97 was calculated using the Harmon Equation. The peak flow is therefore 16.44 L/s.

3.2. Proposed Sanitary Sewage Calculation:

The design population will be the same as determined in the domestic water servicing section above. The design population of the building was determined to be 6 people.

The sanitary sewage flows were calculated in accordance with Chapter 5 of the MOE's 2008 Design Guidelines for Sewage Works. A per capita sewage flow of 280L/person/day was assumed. The total domestic sewage flow for 6 people is 0.024L/s. The peak factor, using the Harmon Formula, was found to be 4.5* use 4 maximum, for a peak sewage flow of approximately 0.1 L/s.

An extraneous flow allowance of 0.33 L/s/ha was assumed. With a site 0.05ha in size, the extraneous flow is 0.017 L/s, for a total design flow of 0.117L/s.

The total average daily demand for the site plus upstream domestic sewage generation is 1.64L/s and a population of 505 residents. The infiltration allowance remains 2.51L/s.

The peak factor is not affected. The proposed peak flow is therefore still 16.48m, after rounding up.

3.3. Domestic Sanitary Service:

This building is proposed to be served by two 135mm diameter PVC sanitary services (1 for each unit). With a slope of 2%, the sanitary service for each unit will have a capacity of approximately 19 L/s.

A copy of the sanitary flows can be found in Appendix C.

3.4. City Sanitary Sewer Capacity:

The existing sanitary sewer on Terrbonne Drive is a 300mm concrete pipe with a slope of 0.65% which has a capacity of 81.33 L/s as per appendix 6A of the city's sewer design guidelines. The proposed development will therefore have negligible impact on the city's sanitary sewers.

4. STORM SEWAGE

Each unit is proposed to have foundation drainage outletting to the storm sewer using a private storm service.

The proposed development will increase the imperviousness of the island. It is assumed that the site storm will be dealt with using lot level controls, designed by others. Therefore, there will be no impact on nearby storm sewers.

The site grading has been designed by Fairhall Moffat & Woodland Limited, and demonstrates that the site drainage will be split between Marygrove Circle and an easement along the rear property line. No details of downspout locations are available at this time.

A storm water brief has been prepared by Blanchard Letendre Engineering under a separate cover. The most recent version of the report is dated December 6th, 2023.

CONCLUSION

1. There is an adequate water supply for domestic use and firefighting.
2. The existing water pressure is adequate for the proposed development.
3. Since it is estimated that the water pressure is less than 80 psi, pressure reducing valves are not required.
4. The proposed water service connection is adequately sized to serve the development.
5. The expected sanitary sewage flow will be adequately handled by the proposed sanitary sewer service connection.
6. The expected sanitary sewage flow will be adequately handled by the by the existing sanitary sewers on Marygrove Circle
7. The increase in sanitary flows contributing to the existing municipal sanitary sewer on Prom. Terrebonne is expected to have a negligible impact.

For any comment or clarification please contact the undersigned.
Should you have any question, do not hesitate to let us know.

Yours truly,

Blanchard Letendre Engineering Ltd.,

Michael Jans, P.Eng.



APPENDIX A – FIRE FLOW CALCULATION

OBC Fire protection calculations
Water supply for fire-fighting

Project 1274 Marygrove
 Date January 30, 2024
 Method Ontario building code 2012
 Designed by M. Jans

$Q = K \times V \times Stot$

where :

Q = minimum supply of water in liters

K = water supply coefficient from table 1

V = total building volume in cubic meters

Stot = total of spatial coefficient values from the property line exposures on all sides as obtained from the formula :

$Stot = 1.0 + (S_{side\ 1} + S_{side\ 2} + S_{side\ 3} + \dots)$

K	18	(from table 1)
V	320	(total building volume in cu.m)
Stot	1.95	(from figure 1)
Q	11232	Litres

	approx.	from fig.1
Snorth	16.0m	0
Seast	4.2m	0.5
Ssouth	5.5m	0.45
Swest	30.0m	0

2700 L/min (if Q<108,000L)

Table 1					
Water Supply Coefficient - K					
Type of Construction	Classification by Group or Division in Accordance with Table 3.1.2.1. of the Building Code				
	A-2 B-1 B-2 B-3 C D	A-4 F-3	A-1 A-3	E F-2	F-1
Building is of noncombustible construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2., including loadbearing walls, columns and arches.	10	12	14	17	23
Building is of noncombustible construction or of heavy timber construction conforming to Article 3.1.4.6. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	16	19	22	27	37
Building is of combustible construction with fire separations and fire-resistance ratings provided in accordance with Subsection 3.2.2., including loadbearing walls, columns and arches. Noncombustible construction may be used in lieu of fire-resistance rating where permitted in Subsection 3.2.2.	18	22	25	31	41
Building is of combustible construction. Floor assemblies are fire separations but with no fire-resistance rating. Roof assemblies, mezzanines, loadbearing walls, columns and arches do not have a fire-resistance rating.	23	28	32	39	53
Column 1	2	3	4	5	6

OBC Fire protection calculations
Water supply for fire-fighting

Project 1274 Marygrove
Date January 30, 2024
Method Ontario building code 2012

Table 2	
Part 3 Buildings under the Building Code	Required Minimum Water Supply Flow Rate, L/min
One-storey building with building area not exceeding 600 m ²	1 800
All other buildings	2 700 (if Q ≤ 108 000 L) ⁽¹⁾ 3 600 (if Q > 108 000 L and ≤ 135 000 L) ⁽¹⁾ 4 500 (if Q > 135 000 L and ≤ 162 000 L) ⁽¹⁾ 5 400 (if Q > 162 000 L and ≤ 190 000 L) ⁽¹⁾ 6 300 (if Q > 190 000 L and ≤ 270 000 L) ⁽¹⁾ 9 000 (if Q > 270 000 L) ⁽¹⁾

Notes to Table 2:

(1) Q = KVS_{tot} as referenced in Paragraph 3(a)

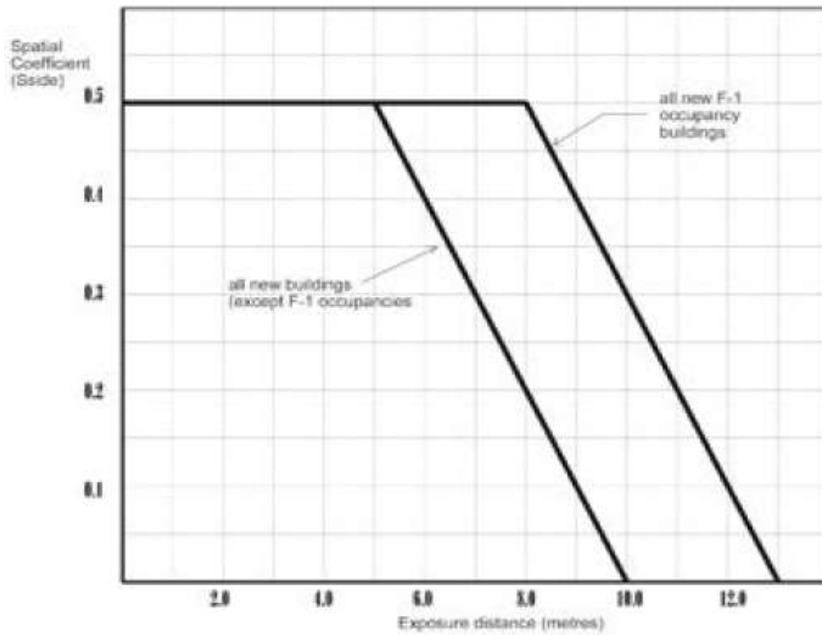


Figure 1
Spatial Coefficient vs Exposure Distance

APPENDIX B – BOUNDARY CONDITIONS

Alae El Hatimi

From: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Sent: Tuesday, May 23, 2023 2:25 PM
To: Alae El Hatimi
Subject: RE: 23-172_1274 Marygrove Circle_Adequacy report
Attachments: 1274 Marygrove Circle May 2023.pdf

Hi Alae,

Please see boundary conditions below. As the required fire flow cannot be achieved, a multi-hydrant analysis will be required.

The following are boundary conditions, HGL, for hydraulic analysis at 1274 Marygrove Circle (zone 2W2C) with assumed to be connected to the 152 mm watermain on Marygrove Circle (see attached PDF for location).

All Connections:

Minimum HGL: 126.7 m

Maximum HGL: 133.0 m

Available fire flow at 20 psi: 48 L/s, assuming ground elevation of 93.5 m

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Regards,

Shika Rathnasooriya, P.Eng

Project Manager

Planning, Real Estate and Economic Development Department - West Branch

City of Ottawa

110 Laurier Avenue West Ottawa, ON

613.580.2424 ext. 23433

From: Alae El Hatimi <alae@blengineering.ca>
Sent: May 17, 2023 1:28 PM
To: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Cc: Damien Letendre <damiel@blengineering.ca>; Michael Jans <michael@blengineering.ca>; sashaandco@hotmail.com; Vince Catalli <vincecatalli@hotmail.com>; Watson, Kieran <kieran.watson@ottawa.ca>
Subject: RE: 23-172_1274 Marygrove Circle_Adequacy report

APPENDIX C – SANITARY FLOW CALCULATION



Cumulative Sanitary Flow

Existing					
Street	nb. Units	nb.hectars	nb.ppl	average daily flow Litre/Day	L/s
Av.Maitland	28	3.74	224.4	62832	0.727222
Prom cameo	34	2.52	151.2	52416	0.606667
	20	0.6	36.0		
Marygrove Circle	17		45.9	12852	0.14875
grayrock cres	15	0.75	45	12600	0.145833
Total		7.61	502.5	140700	1.628472

Proposed					
Street	nb. Units	nb.hectars	nb.ppl	average daily flow Litre/Day	L/s
Av.Maitland	28	3.74	224.4	62832	0.727222
Prom cameo	34	2.52	151.2	52416	0.606667
	20	0.6	36.0		
Marygrove Circle	18		48.6	13608	0.1575
grayrock cres	15	0.75	45	12600	0.145833
Total			505.2	141456	1.637222


APPENDIX D – CIVIL DESIGN BY FAIRHALL MOFFAT WOODLAND



METRIC
DISTANCES AND ELEVATIONS SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

CAUTION
THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED EXCEPT FOR THE PURPOSE INDICATED IN THE TITLE BLOCK.

Limit of Proposed Road Cuts
- Existing Water Service to be Confirmed to be Blanked at the Main at Time of Construction.
- 40mm Lift of HMA Superpave 12.5mm PG 58-34 Level B Asphalt to be Placed to Cover the Extent of the Road Cuts if 3 or More Road Cuts are Located Within 12m of Each Other.
- The Extent of the Resurfacing Must Be to the Nearest Lane Line, Centreline, or Curb of Each Road Cut.

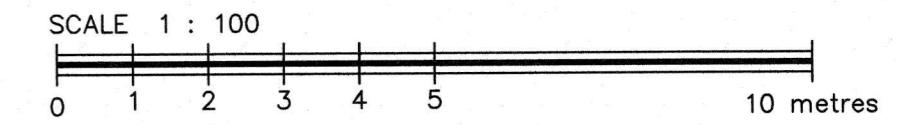


- NOTES**
- ONE - 2 STOREY SEMI-DETACHED DWELLING TO BE CONSTRUCTED. DWELLING TO BE CONSTRUCTED USING CONTINUOUS INSULATED CONCRETE FORMS (CIF) ON ALL FLOORS AND AS SUCH DOES NOT HAVE A DEFINED TOP OF FOUNDATION WALL.
 - LOT DIMENSIONS AND EXISTING CONDITIONS ARE AS SHOWN ON TOPOGRAPHIC SURVEY BY FAIRHALL, MOFFATT & WOODLAND LIMITED O.L.S., DATED JANUARY 25, 2023, REF. 28 - 330973.
 - EXCAVATE AND DISPOSE OF ALL EXCESS EXCAVATED MATERIAL, SUCH AS ASPHALT, CURBING AND DEBRIS, OFF SITE OR AS DIRECTED BY THE ENGINEER.
 - BUILDER TO VERIFY LOCATION OF ALL UNDERGROUND UTILITIES AND SERVICES PRIOR TO CONSTRUCTION AND TO VERIFY INVERT ELEVATIONS OF SEWER STUBS AND TO VERIFY MINIMUM SEPARATION DISTANCES.
 - EXISTING ASPHALT DRIVEWAY TO BE REMOVED AND REPLACED WITH SOFT SURFACE WHERE APPLICABLE.
 - ALL SERVICES ARE TO BE EXPOSED AND GRADES DETERMINED IN THE FIELD BEFORE COMMENCING NEW CONNECTIONS.
 - INSTALL SEWER SERVICES PRIOR TO GRADE EXCAVATION TO VERIFY PROPOSED UNDERSIDE OF FOOTING ELEVATION.
 - WATER AND SEWER WORK AND MATERIALS TO BE IN ACCORDANCE WITH CITY OF OTTAWA STANDARDS.
 - SANITARY/STORM SERVICE LATERAL TO CONNECT TO SANITARY/STORM MAIN IN ACCORDANCE WITH CITY STANDARD S11 FOR CONNECTION TO RIGID SEWER MAIN. CONNECTION VIA CORING IS REQUIRED, AS PER CITY STANDARD S11.2, WHERE SERVICE LATERAL DIAMETER IS GREATER THAN 50% OF THE DIAMETER OF THE RIGID SEWER MAIN.
 - INVERT ELEVATION FOR SANITARY SERVICE TO BE 300MM BELOW USF AT DWELLING OR SLEEVED.
 - PROPOSED SEWER LATERAL AND WATER SERVICE LATERAL TO BE SLEEVED UNDER EACH PORCH. PROPOSED STORM LATERAL TO BE SLEEVED THROUGH FOUNDATION WALL.
 - BACKWATER VALVES ARE TO BE INSTALLED AS PER CITY STANDARDS S14 AND S14.1 OR S14.2.
 - INSTALLATION OF REMOTE WATER METER PER CITY OF OTTAWA STANDARDS.
 - CONNECTION TO EXISTING WATER BY CITY OF OTTAWA FORCES.
 - MINIMUM COVERAGE FOR ALL SEWER LATERALS AND LEADS SHALL BE 2.0m FROM THE FINISHED GRADE UNLESS INSULATION IS PROVIDED AS PER CITY STANDARD W22.
 - EAVES TROUGHING WILL BE INSTALLED. EAVES TROUGH DOWNSPOUTS TO BE DISCHARGED TOWARD THE STREET AND SPLASH PAD TO BE INSTALLED WHEN DOWNSPOUT IS LESS THAN 1.5m FROM PROPERTY LIMIT.
 - GRADING IN GRASSED AREAS IS TO BE BETWEEN 2% AND 7% UNTERRACED. GRADES IN EXCESS OF 7% WILL REQUIRE TERRACING AT A MAXIMUM OF 3H:1V.
 - WATER SERVICE MUST HAVE A MINIMUM 2.4m OF COVER OR INSULATED AS PER CITY STANDARD W22.
 - ANY PROPOSED WINDOW WELLS ARE TO BE DRAINED THROUGH GRAVEL TOWARD WEeping TILES. DIRECT CONNECTIONS TO WEeping TILES ARE PROHIBITED.
 - WATERMAIN DEPTH IS TO BE VERIFIED IN THE FIELD. 0.30 MINIMUM SEPARATION BETWEEN EXISTING WATERMAIN AND PROPOSED SEWER LATERALS. IF 0.30 MINIMUM SEPARATION CANNOT BE MET BASED ON FINDINGS, UNSHINKABLE FILL IS TO BE USED UPON COORDINATION WITH CITY INSPECTOR.
 - EXISTING WATER SERVICE TO BE BLANKED AT THE MAIN.
 - EXISTING SEWER LATERALS ARE TO BE DECOMMISSIONED AT THE PROPERTY LIMIT AS PER CITY OF OTTAWA STANDARD S11.4.
 - SUMP PIT AND PUMP TO BE INSTALLED FOR EACH UNIT.
 - ANY PROPOSED SWALES ARE TO BE A MINIMUM 0.30m FROM ALL PROPERTY LINES.
 - GRADING TO MATCH EXISTING GRADES AROUND PERIMETER OF LOT. NO CHANGE TO EXISTING DRAINAGE PATTERNS ARE PROPOSED.
 - NO EXCESS DRAINAGE WILL BE DIRECTED TOWARD NEIGHBOURING PROPERTIES DURING OR AFTER CONSTRUCTION.
 - ALL CATCH BASINS AND MAINTENANCE HOLES ARE TO BE PROTECTED DURING CONSTRUCTION ACTIVITIES BY INSTALLING SEDIMENT BARRIERS.
 - THE CONTRACTOR WILL IMPLEMENT BEST MANAGEMENT PRACTICES, TO PROVIDE FOR PROTECTION OF THE AREA DRAINAGE SYSTEM AND THE RECEIVING WATER COURSE DURING CONSTRUCTION ACTIVITIES. THE CONTRACTOR ACKNOWLEDGES THAT FAILURE TO IMPLEMENT APPROPRIATE EROSION AND SEDIMENT CONTROL MEASURES MAY BE SUBJECT TO PENALTIES BY ANY APPLICABLE REGULATORY AGENCY.
 - PROPOSED SERVICES ARE TO BE LOCATED OUTSIDE OF A TREE'S CRITICAL ROOT ZONE (CRZ). THE RADIUS OF THE CRITICAL ROOT ZONE (CRZ) IS CALCULATED BY MULTIPLYING THE DIAMETER OF THE TREE TRUNK AT BREAST HEIGHT BY A FACTOR OF 10. THIS AREA, CENTRED AROUND THE BASE OF THE TREE, IS TO BE PROTECTED BEFORE AND AFTER CONSTRUCTION. PLEASE NOTE THAT A TREE PERMIT IS REQUIRED TO REMOVE ANY TREES LOCATED IN THE RIGHT-OF-WAY. VISIT OTTAWA.CA/URBANTREE OR PHONE 311 AND TO APPLY FOR A DISTINCTIVE TREE PERMIT OR FOR MORE INFORMATION REGARDING THE URBAN TREE CONSERVATION BY-LAW.
 - ALL TREES ON THE SUBJECT PROPERTY AND RIGHT-OF-WAY (STREET) SHALL BE PROTECTED AS PER THE MUNICIPAL TREES AND NATURAL AREAS PROTECTION BY-LAWS AND THE URBAN TREES CONSERVATION BY-LAW, AS AMENDED FROM TIME TO TIME.
 - ALL TREES WITHIN THE STREET RIGHT OF WAY TO BE PROTECTED AND MAINTAINED BEFORE AND AFTER CONSTRUCTION.
 - ALL TREES WITHIN THE STREET RIGHT OF WAY TO BE PROTECTED AND MAINTAINED BEFORE AND AFTER CONSTRUCTION.
 - LONG RADIUS BENDS IN SERVICE LATERALS ARE RECOMMENDED. OTHERWISE, A MAXIMUM OF TWO 22.5 DEGREE BENDS ARE PERMITTED FOR EACH SERVICE LATERAL. BOTH BENDS MUST BE LOCATED A MINIMUM 1.0m WITHIN THE PROPERTY BOUNDARY AND MUST BE SEPARATED BY A MINIMUM OF 1.0m. ALL BENDS MUST BE A MINIMUM OF 1.0m FROM ANY VALVE INCLUDING WATER SHUT OFF VALVE.

TOTAL SERVICING MATERIALS - EACH UNIT - (Minimum Lengths)

WATER SUPPLY - 16±m. 19mm dia. SOFT K COPPER
SANITARY SEWER - 19±m. 125mm dia. P.V.C. SDR 28
STORM SEWER - 22±m. 100mm dia. P.V.C. SDR 28

Job Benchmark
Fire Hydrant -
Top of Spindle
Elevation=94.78

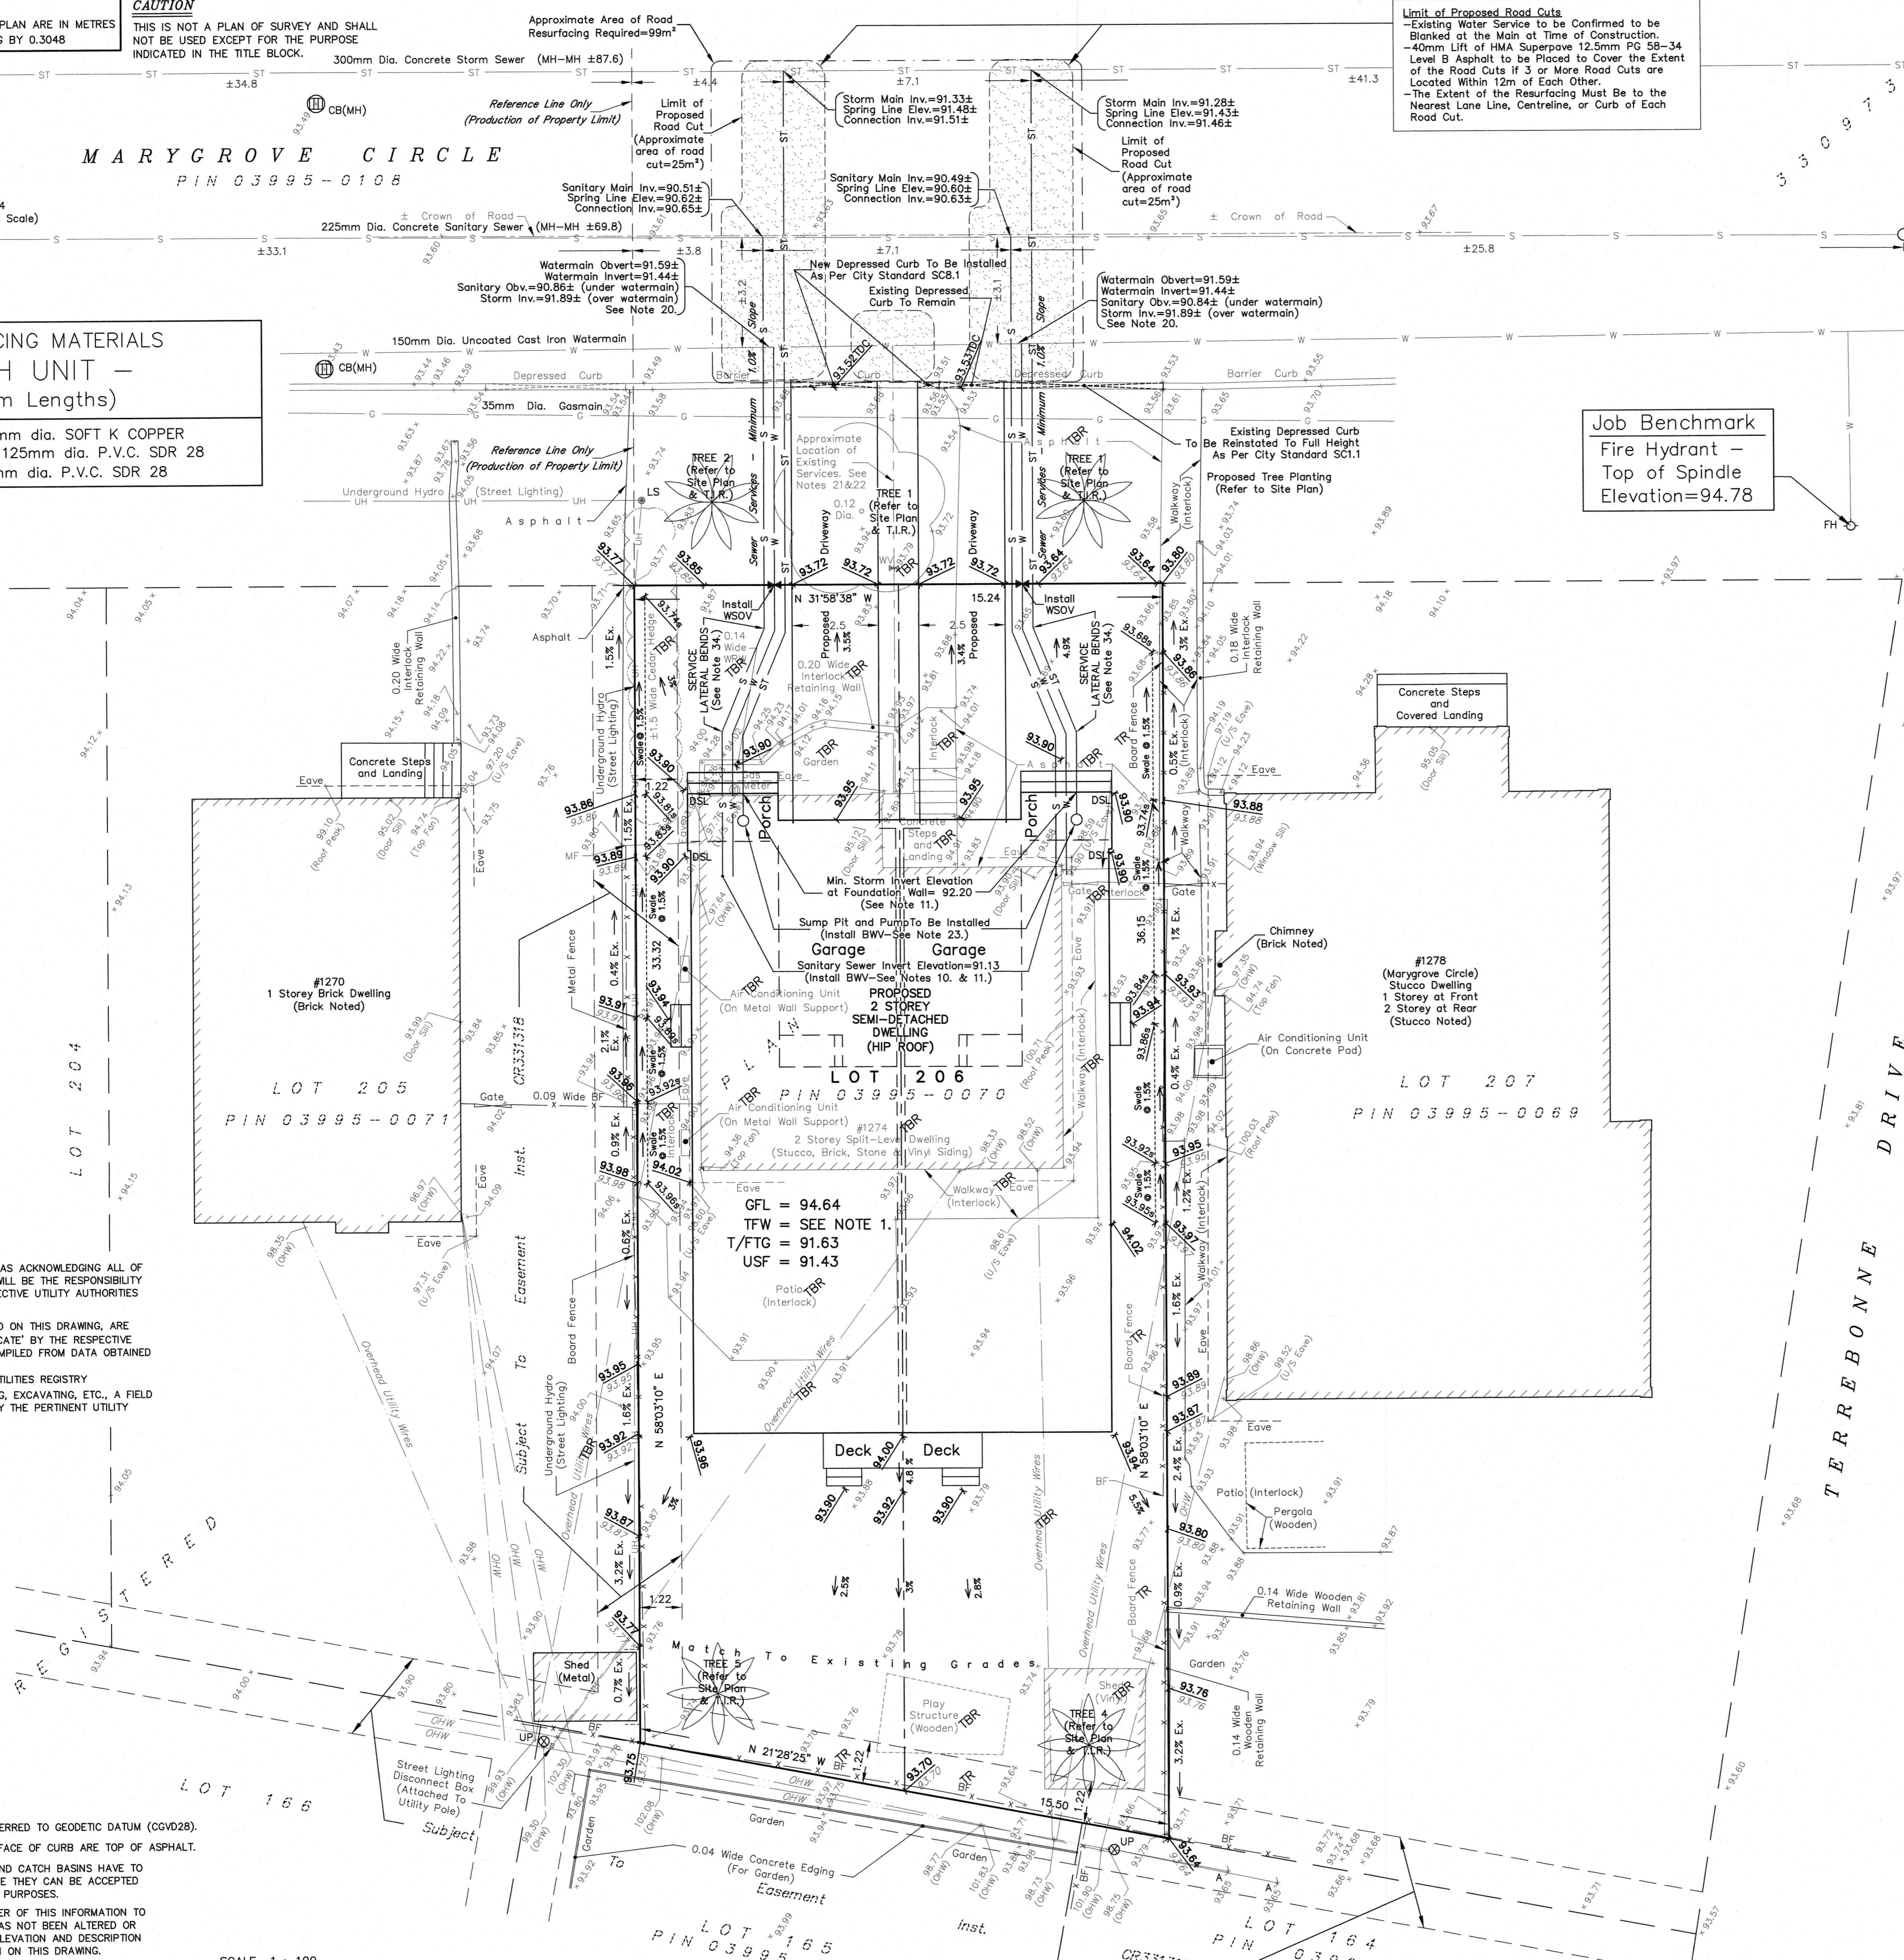

- UTILITY NOTES**
- THIS DRAWING CANNOT BE ACCEPTED AS ACKNOWLEDGING ALL OF THE UNDERGROUND UTILITIES AND IT WILL BE THE RESPONSIBILITY OF THE USER TO CONTACT THE RESPECTIVE UTILITY AUTHORITIES FOR CONFIRMATION OR LOCATION.
 - UNDERGROUND UTILITIES, AS REPORTED ON THIS DRAWING, ARE NOT BASED ON AN ACTUAL 'FIELD LOCATE' BY THE RESPECTIVE UTILITY AGENCIES BUT HAVE BEEN COMPILED FROM DATA OBTAINED FROM THE FOLLOWING SOURCE:
 - CITY OF OTTAWA PUBLIC UTILITIES REGISTRY
 - BEFORE ANY WORK INVOLVING PROBING, EXCAVATING, ETC., A FIELD LOCATION OF UNDERGROUND PLANT BY THE PERTINENT UTILITY AUTHORITY IS MANDATORY.

- ELEVATION NOTES**
- ELEVATIONS SHOWN HEREON ARE REFERRED TO GEODETIC DATUM (CGVD28).
 - EXISTING ELEVATIONS SHOWN ALONG FACE OF CURB ARE TOP OF ASPHALT.
 - ELEVATIONS FOR MANHOLE COVERS AND CATCH BASINS HAVE TO BE INDEPENDENTLY CONFIRMED BEFORE THEY CAN BE ACCEPTED FOR FINAL DESIGN OR CONSTRUCTION PURPOSES.
 - IT IS THE RESPONSIBILITY OF THE USER OF THIS INFORMATION TO VERIFY THAT THE JOB BENCHMARK HAS NOT BEEN ALTERED OR DISTURBED AND THAT ITS RELATIVE ELEVATION AND DESCRIPTION AGREE WITH THE INFORMATION SHOWN ON THIS DRAWING.

- LEGEND**
- ← DIRECTION OF DRAINAGE
 - 99.99 - PROPOSED GRADE
 - 99.99 - EXISTING GRADE
 - 99.99s - SWALE GRADE
 - GFL - GROUND FLOOR LEVEL
 - T/FTG - TOP OF FOOTING
 - USF - UNDERSIDE OF FOOTING
 - TBR - TO BE REMOVED
 - TR - TO REMAIN
 - BWV - BACKWATER VALVE
 - WRW - WOOD RETAINING WALL
 - TDC - TOP OF DEPRESSED CURB
 - WSOV - WATER SHUT OFF VALVE
 - DSL - DOWNSPOUT LOCATION
 - PIN - PROPERTY IDENTIFIER NUMBER
 - DIA - DIAMETER
 - OBV - OVERT
 - INV - INVERT
 - EX - EXISTING
 - PROP. - PROPOSED
 - FDN. - FOUNDATION
 - U/S - UNDERSIDE
 - C/L - CENTRELINE
 - CITY - CITY OF OTTAWA
 - MF - METAL FENCE
 - BF - BOARD FENCE
 - ASP - ASPHALT
 - T.I.R. - TREE INFORMATION REPORT
 - LS - LAMP STANDARD
 - OHW - OVERHEAD UTILITY WIRES
 - CB - CATCH BASIN
 - OH - MANHOLE
 - WV - WATER VALVE
 - UP - UTILITY POLE
 - A - ANCHOR
 - GM - GAS METER
 - W - WATERMAIN
 - OHW - OVERHEAD UTILITY WIRES
 - G - GAS MAIN
 - S - SANITARY SEWER
 - ST - STORM SEWER
 - UH - UNDERGROUND HYDRO
 - X-X - FENCE
 - SW - SWALE
 - DT - DECIDUOUS TREE
 - PT - PROPOSED TREE PLANTING
 - FH - FIRE HYDRANT
 - TS - TERRACE SLOPE - 3:1 MAX.

Normal High Ground Water Table (NHGW) Elevation relative to the Underside of Footing (USF) Elevation for Infill Projects


The relationship between the proposed Underside of Footing (USF) elevation and the Normal High Ground Water Table (NHGW) elevation for the residential unit(s) has not been verified and is to be determined prior to or at the time of footing/foundation excavation as per the City of Ottawa - Building Code Services requirements.

If it is determined that the footing(s) will be below the NHGW elevation, it is the responsibility of the owner to mitigate this situation by either raising the footing elevation above the NHGW elevation or demonstrate the use of appropriate foundation water proofing methods as per current building code requirements, as amended. The owner must apply for and receive any applicable permits before proceeding with the aforementioned works.

Fairhall, Moffatt & Woodland Limited assumes no responsibility or liability for impact on footings and/or basement drainage or possible damages due to this design arrangement received January 12, 2024.

REVISIONS	
1.	FEB. 09, 2023 REVISED REAR DECK AS PER DESIGNER'S INSTRUCTIONS
2.	JAN. 12, 2024 REVISED PER CITY AND DESIGNER'S COMMENTS.

© COPYRIGHT 2024. REPRODUCTION, ALTERATION OR DISTRIBUTION OF THIS PLAN WITHOUT THE WRITTEN CONSENT OF FAIRHALL, MOFFATT & WOODLAND LIMITED IS PROHIBITED.

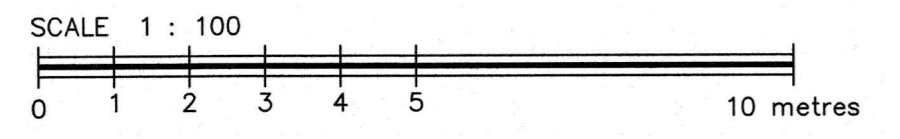

Fairhall Moffatt & Woodland
L I M I T E D
ONTARIO LAND SURVEYORS


Surveying and Land Information Services
100-600 TERRY FOX DRIVE, KANATA, ONTARIO K2L 4B6
TEL: (613) 591-2800 FAX: (613) 591-1465
www.fmw.on.ca

Job No. AC28000
Date January 25, 2023
Reference No. 28(a) - 330973
Drawing Name s:\085\AC28000\DWG sg280ac.dwg (cfr)

LOT 206 REGISTERED PLAN 330973 CITY OF OTTAWA (#1274 Marygrove Circle)
GRADE AND SERVICES PLAN

THIS IS NOT A VALID COPY UNLESS EMBOSSED WITH SEAL

APPENDIX E – ARCHITECTURAL SKETCHES

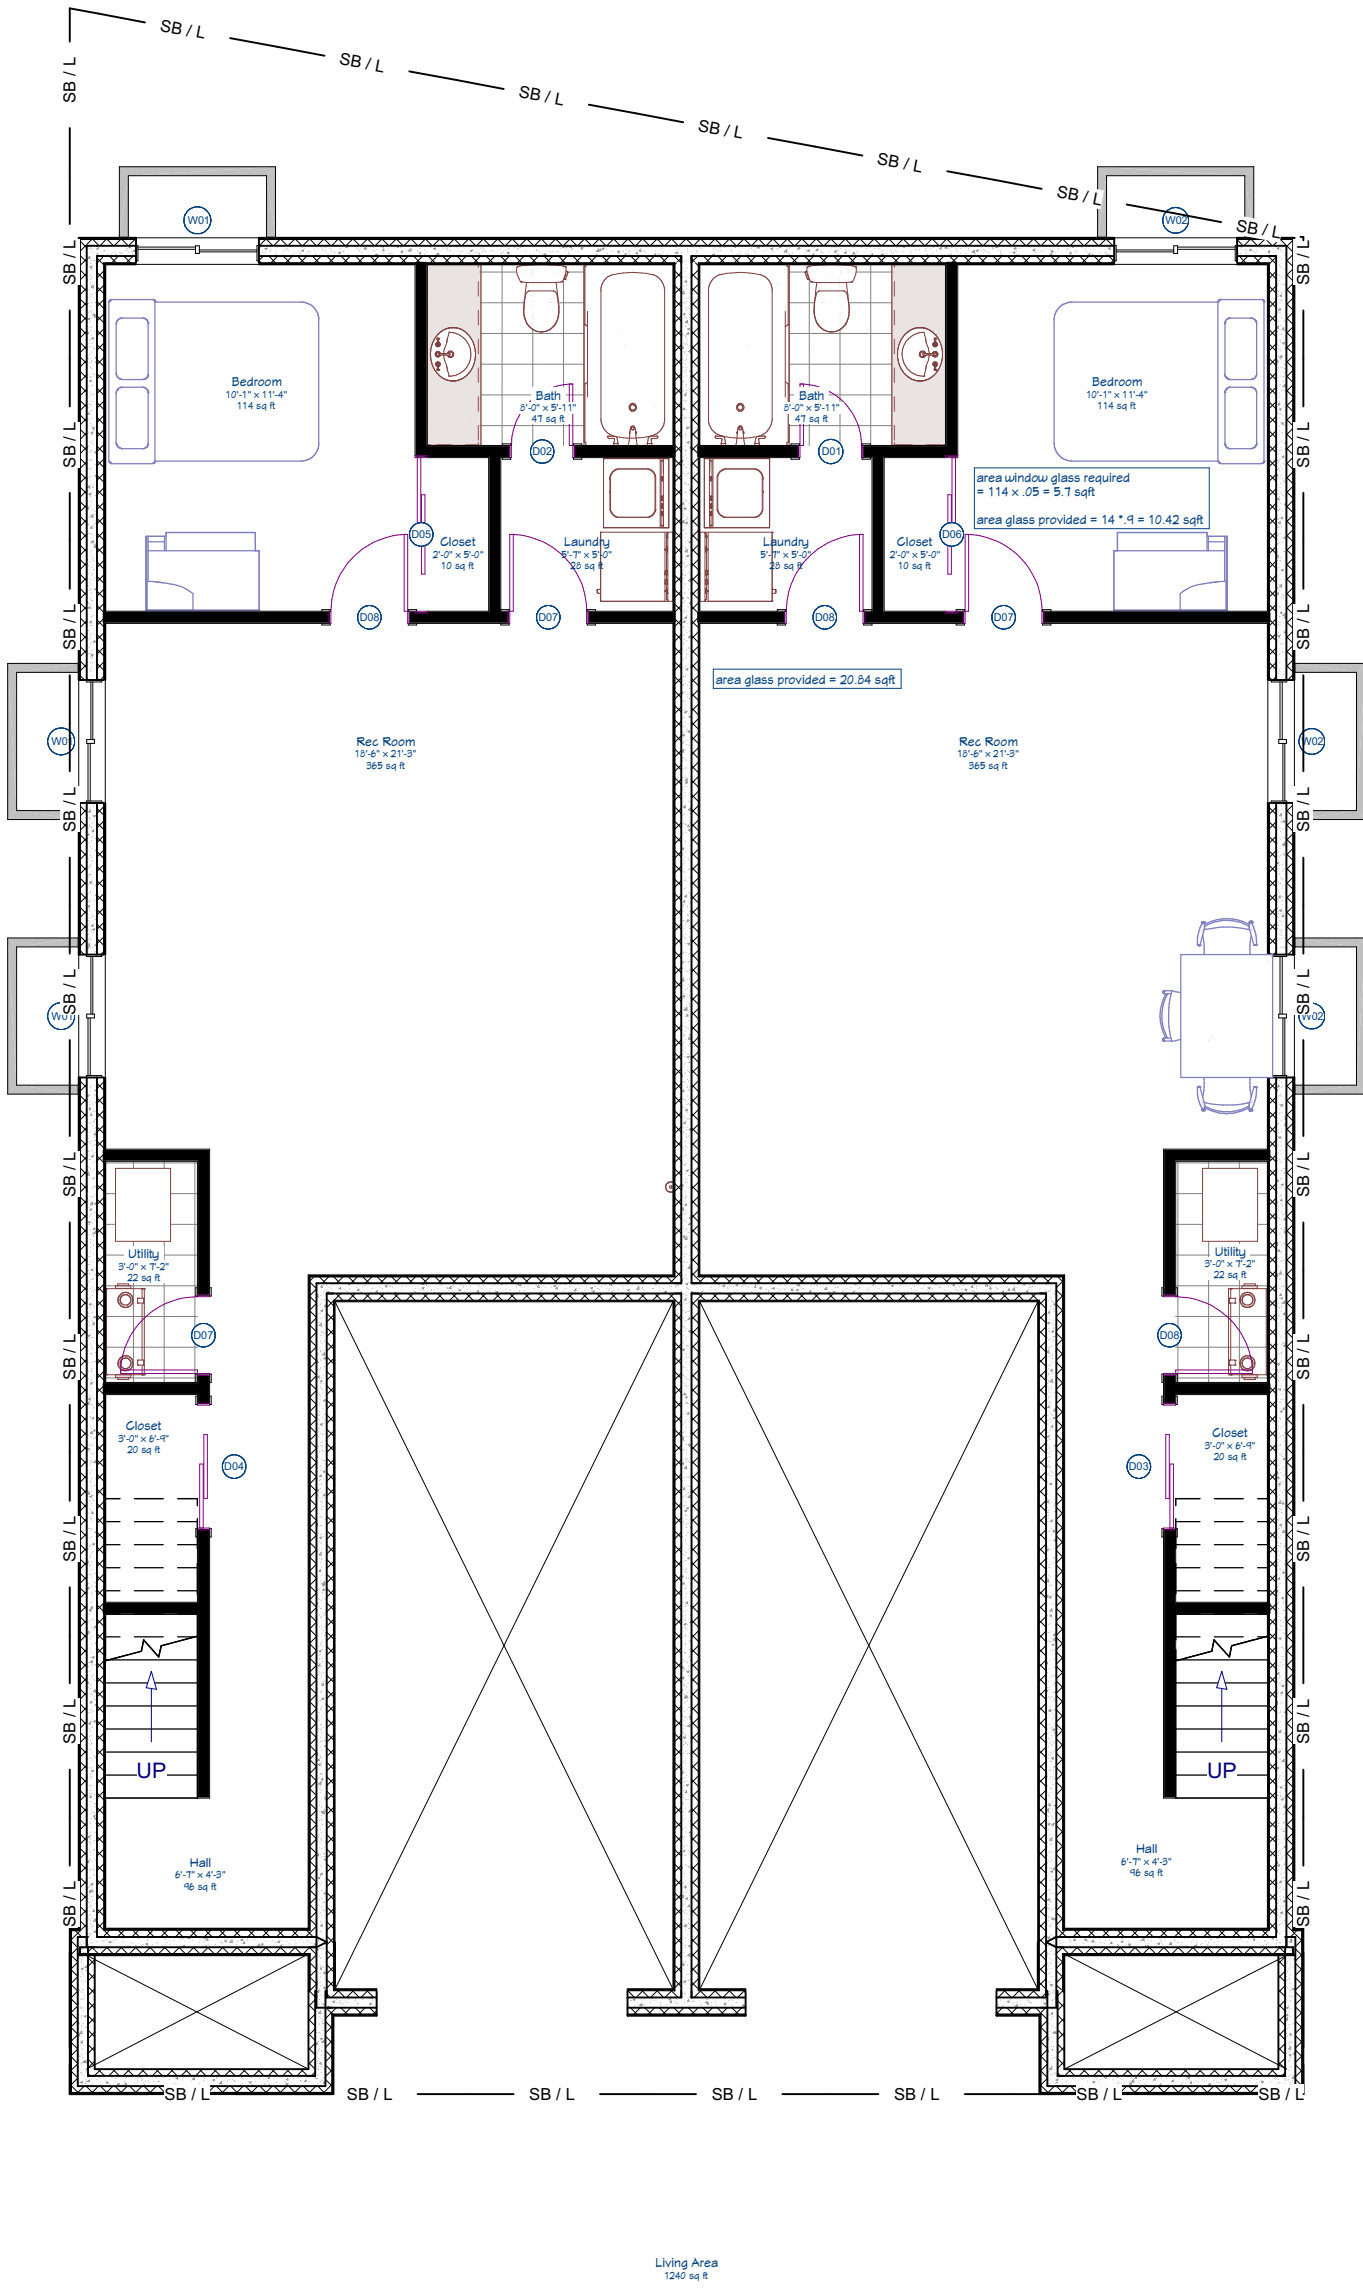



TYPICAL ELEVATION
1:75




TYPICAL ELEVATION
1:75

FRONT & REAR
ELEVATIONS
1:75




projection
 11.22 m to property line
 2 m projection
 10.11 m to property line
 9.01 m to property line

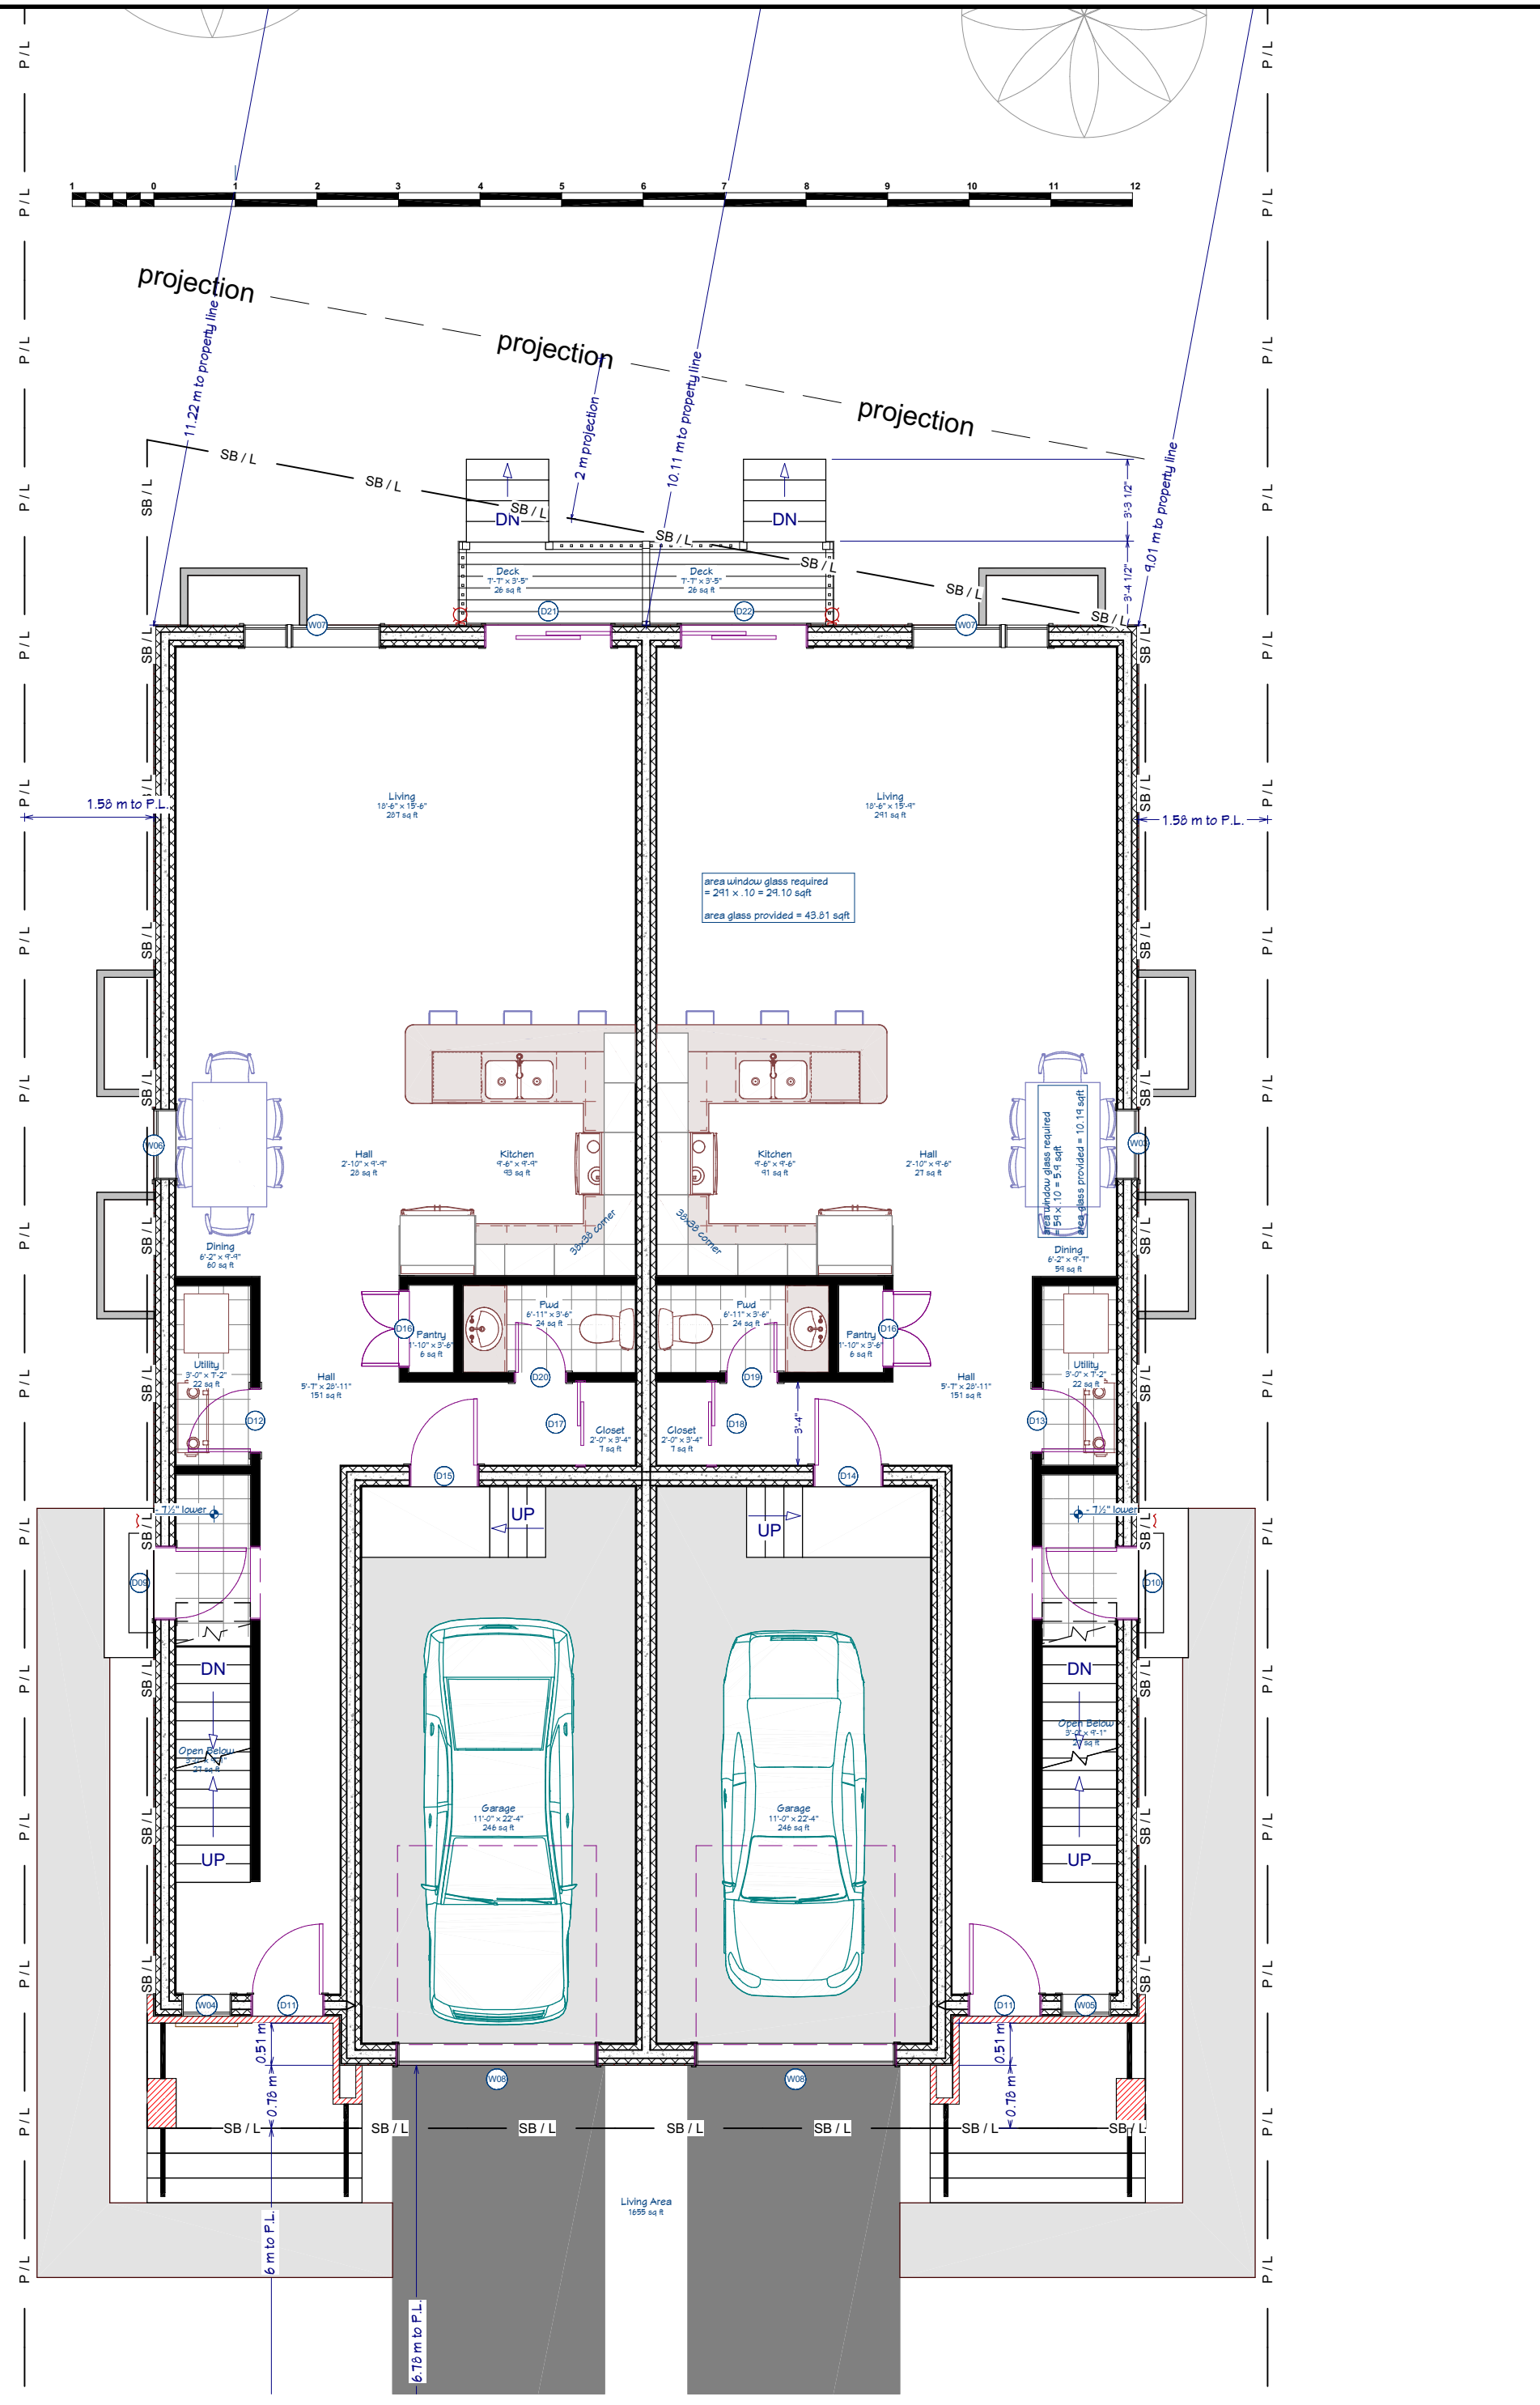

area window glass required = $291 \times .10 = 29.10$ sqft
 area glass provided = 43.81 sqft

area window glass required = $591 \times .10 = 59.1$ sqft
 area glass provided = 10.19 sqft

GROUND LEVEL PLAN
 1:75

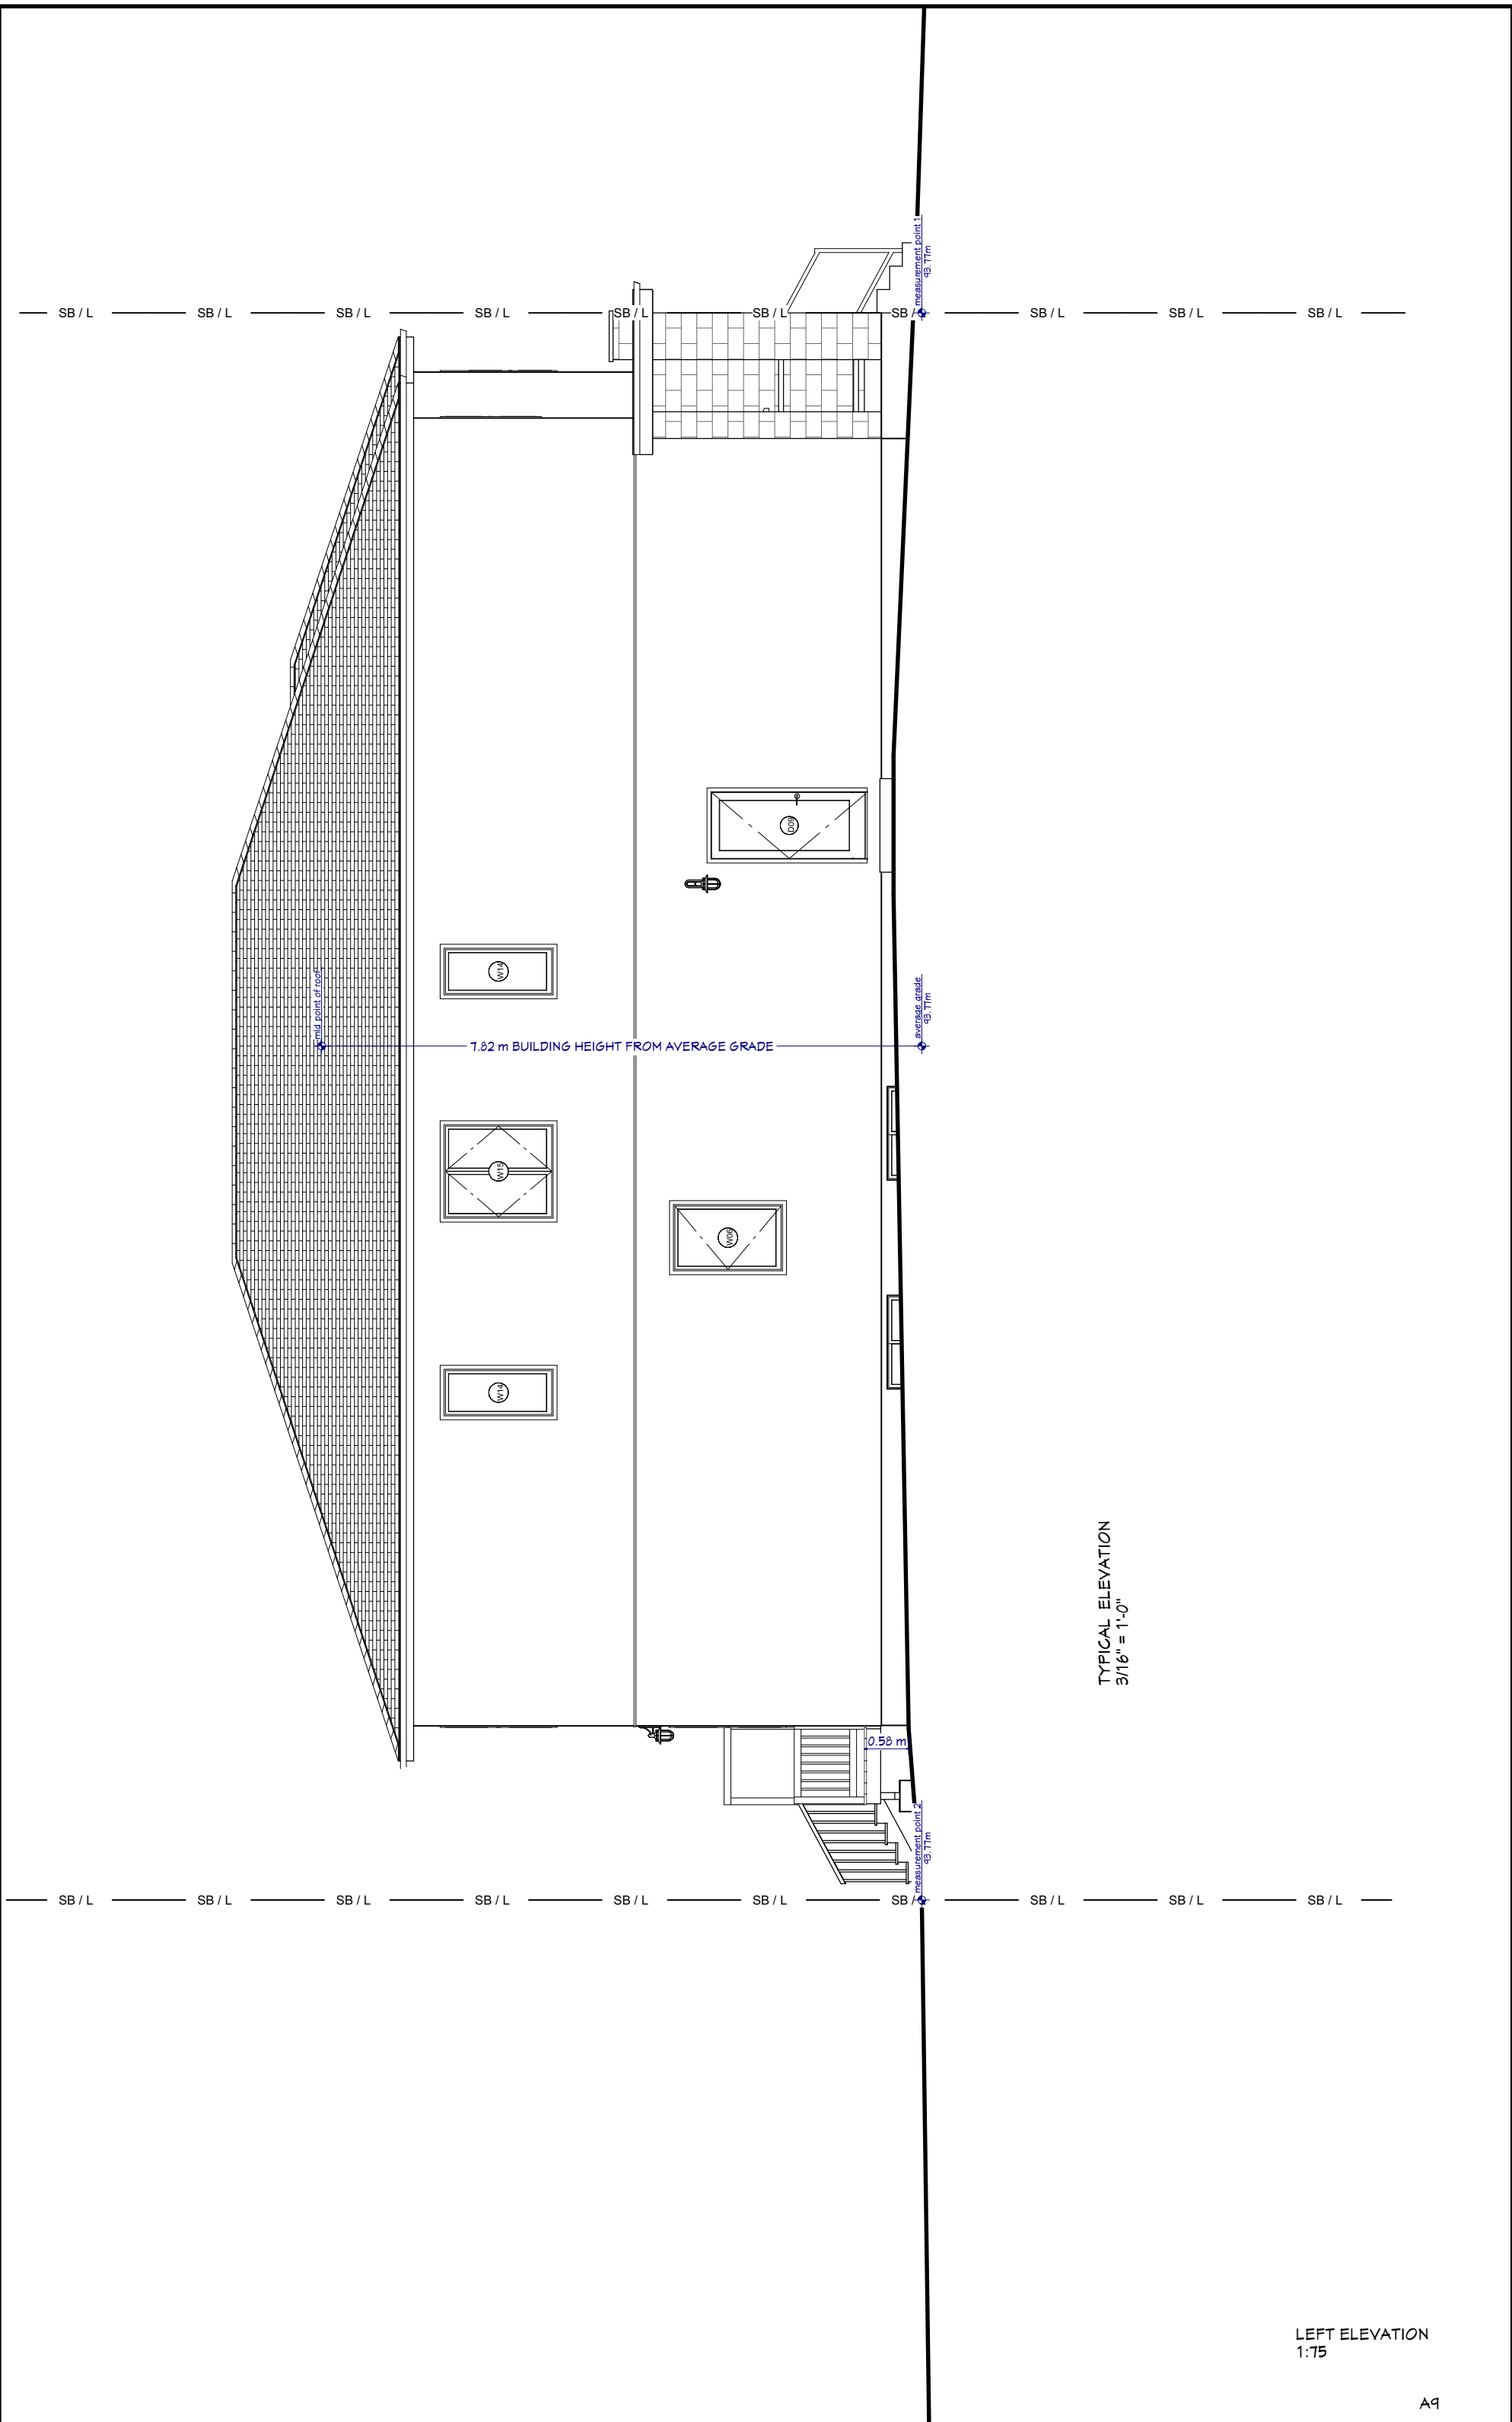


TYPICAL ELEVATION
3/16" = 1'-0"



LEFT ELEVATION
1:75





PERSPECTIVES
NTS

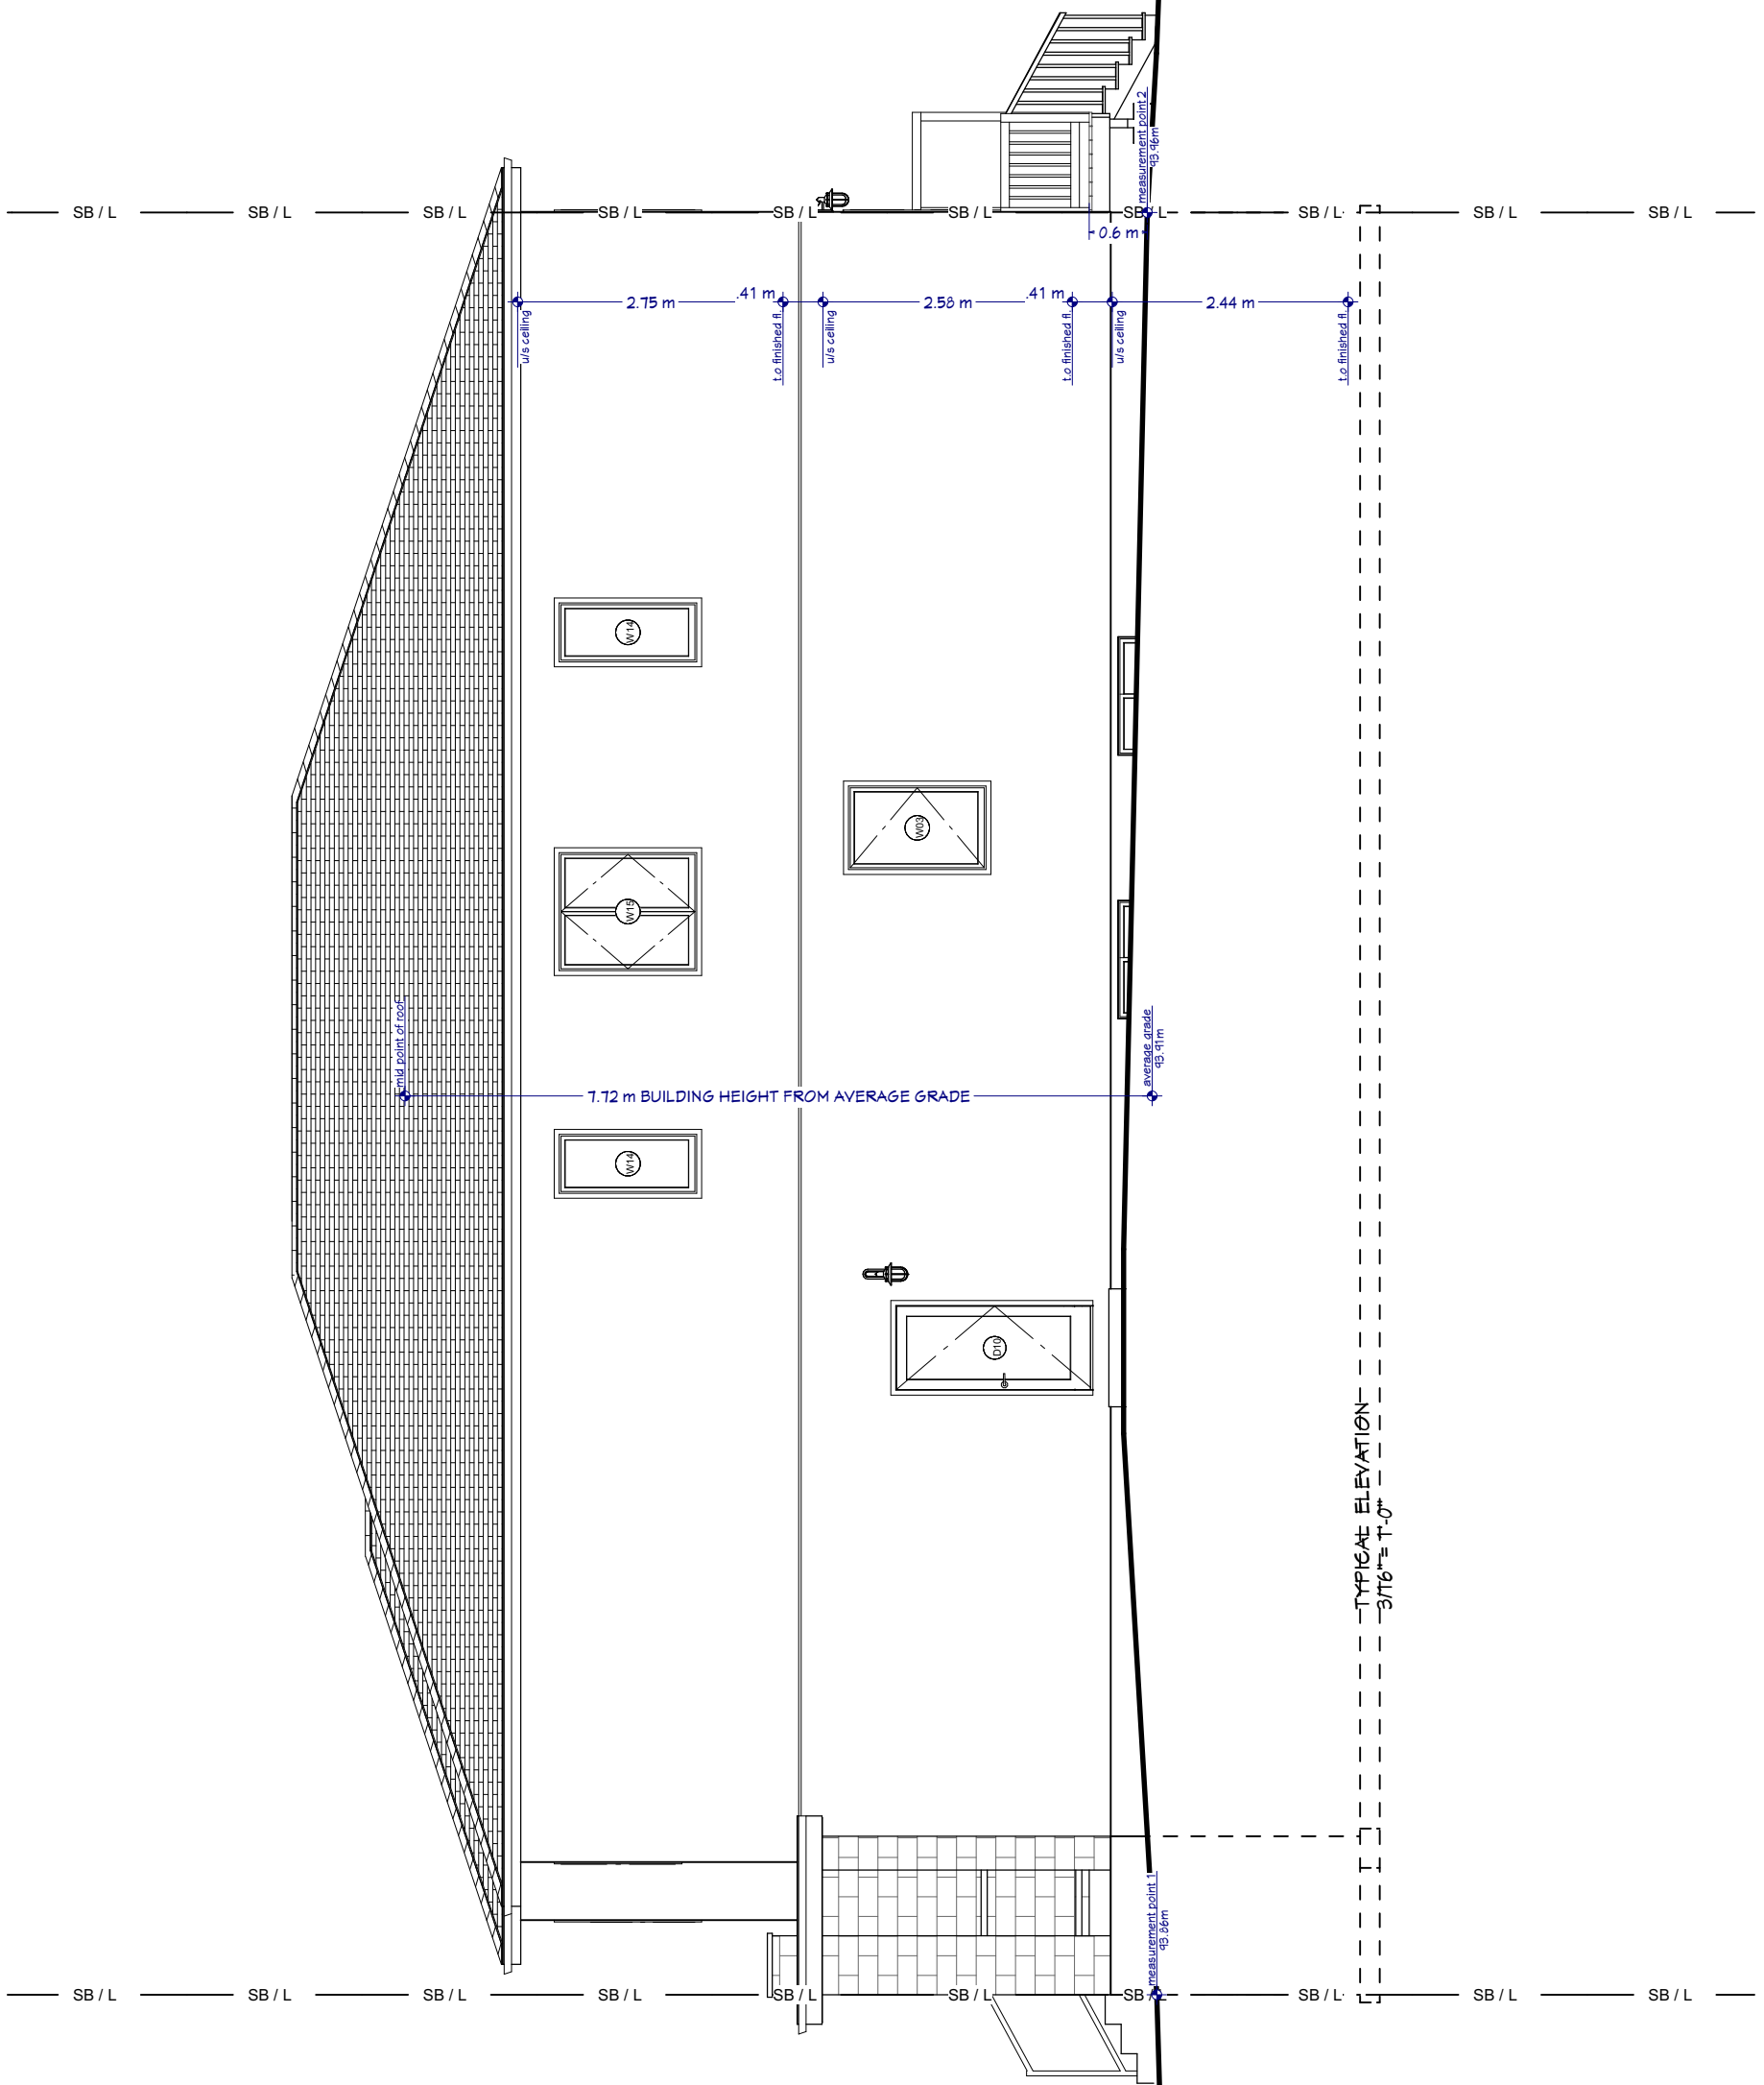

RIGHT ELEVATION
1:75

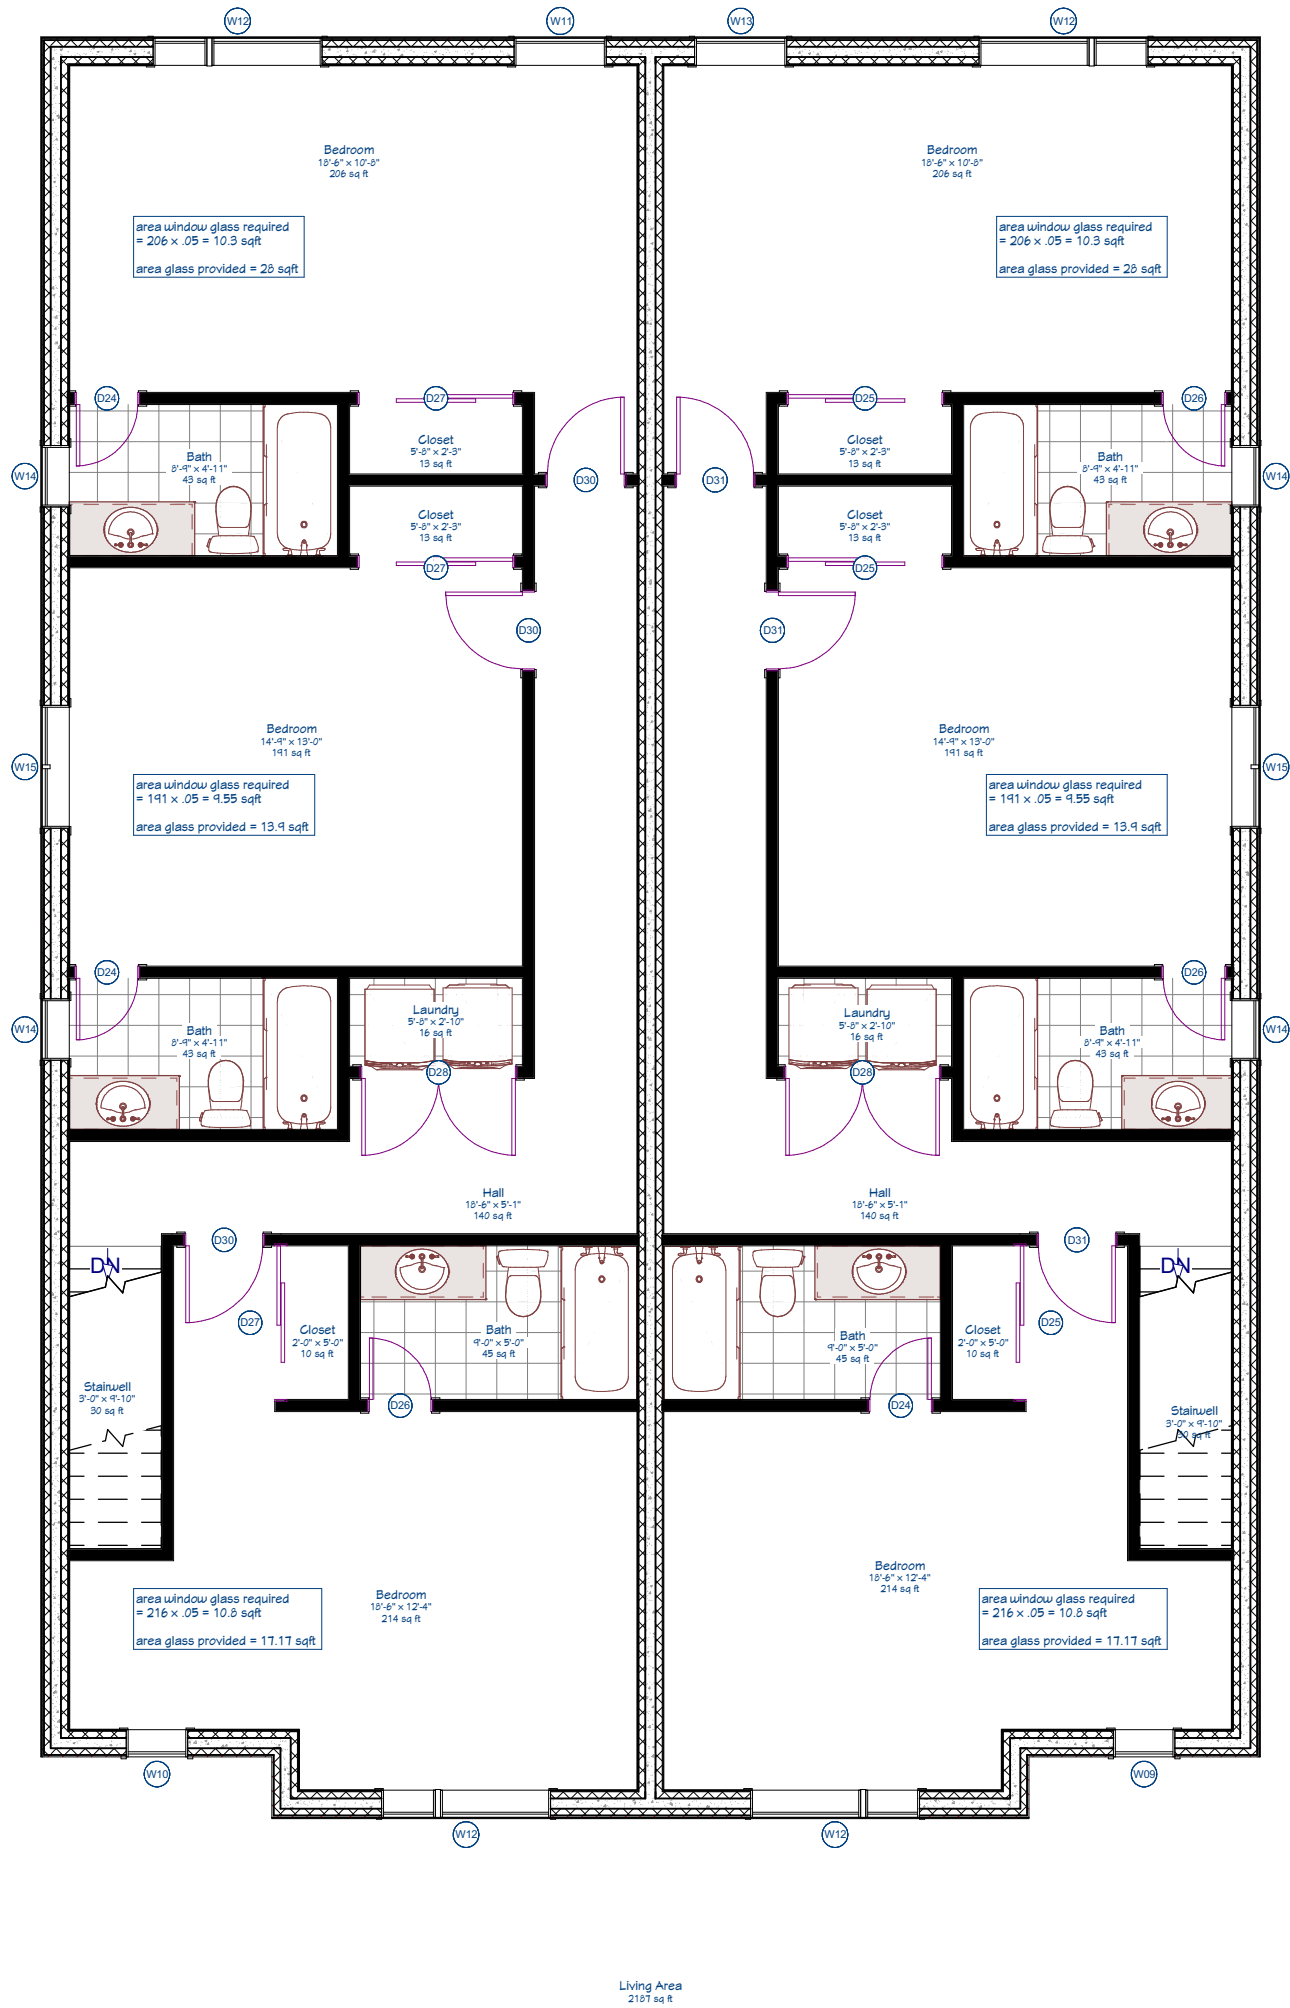

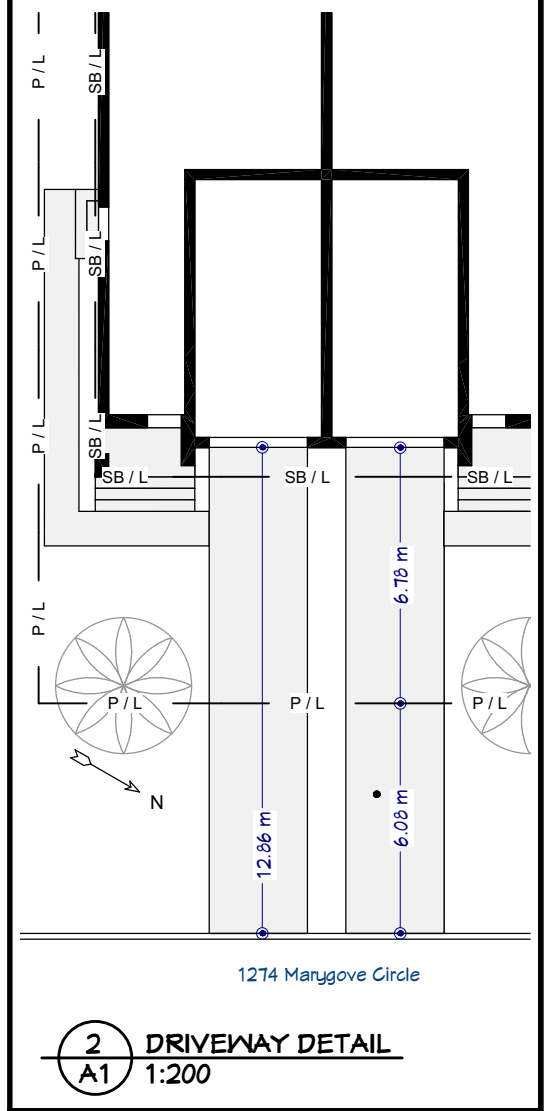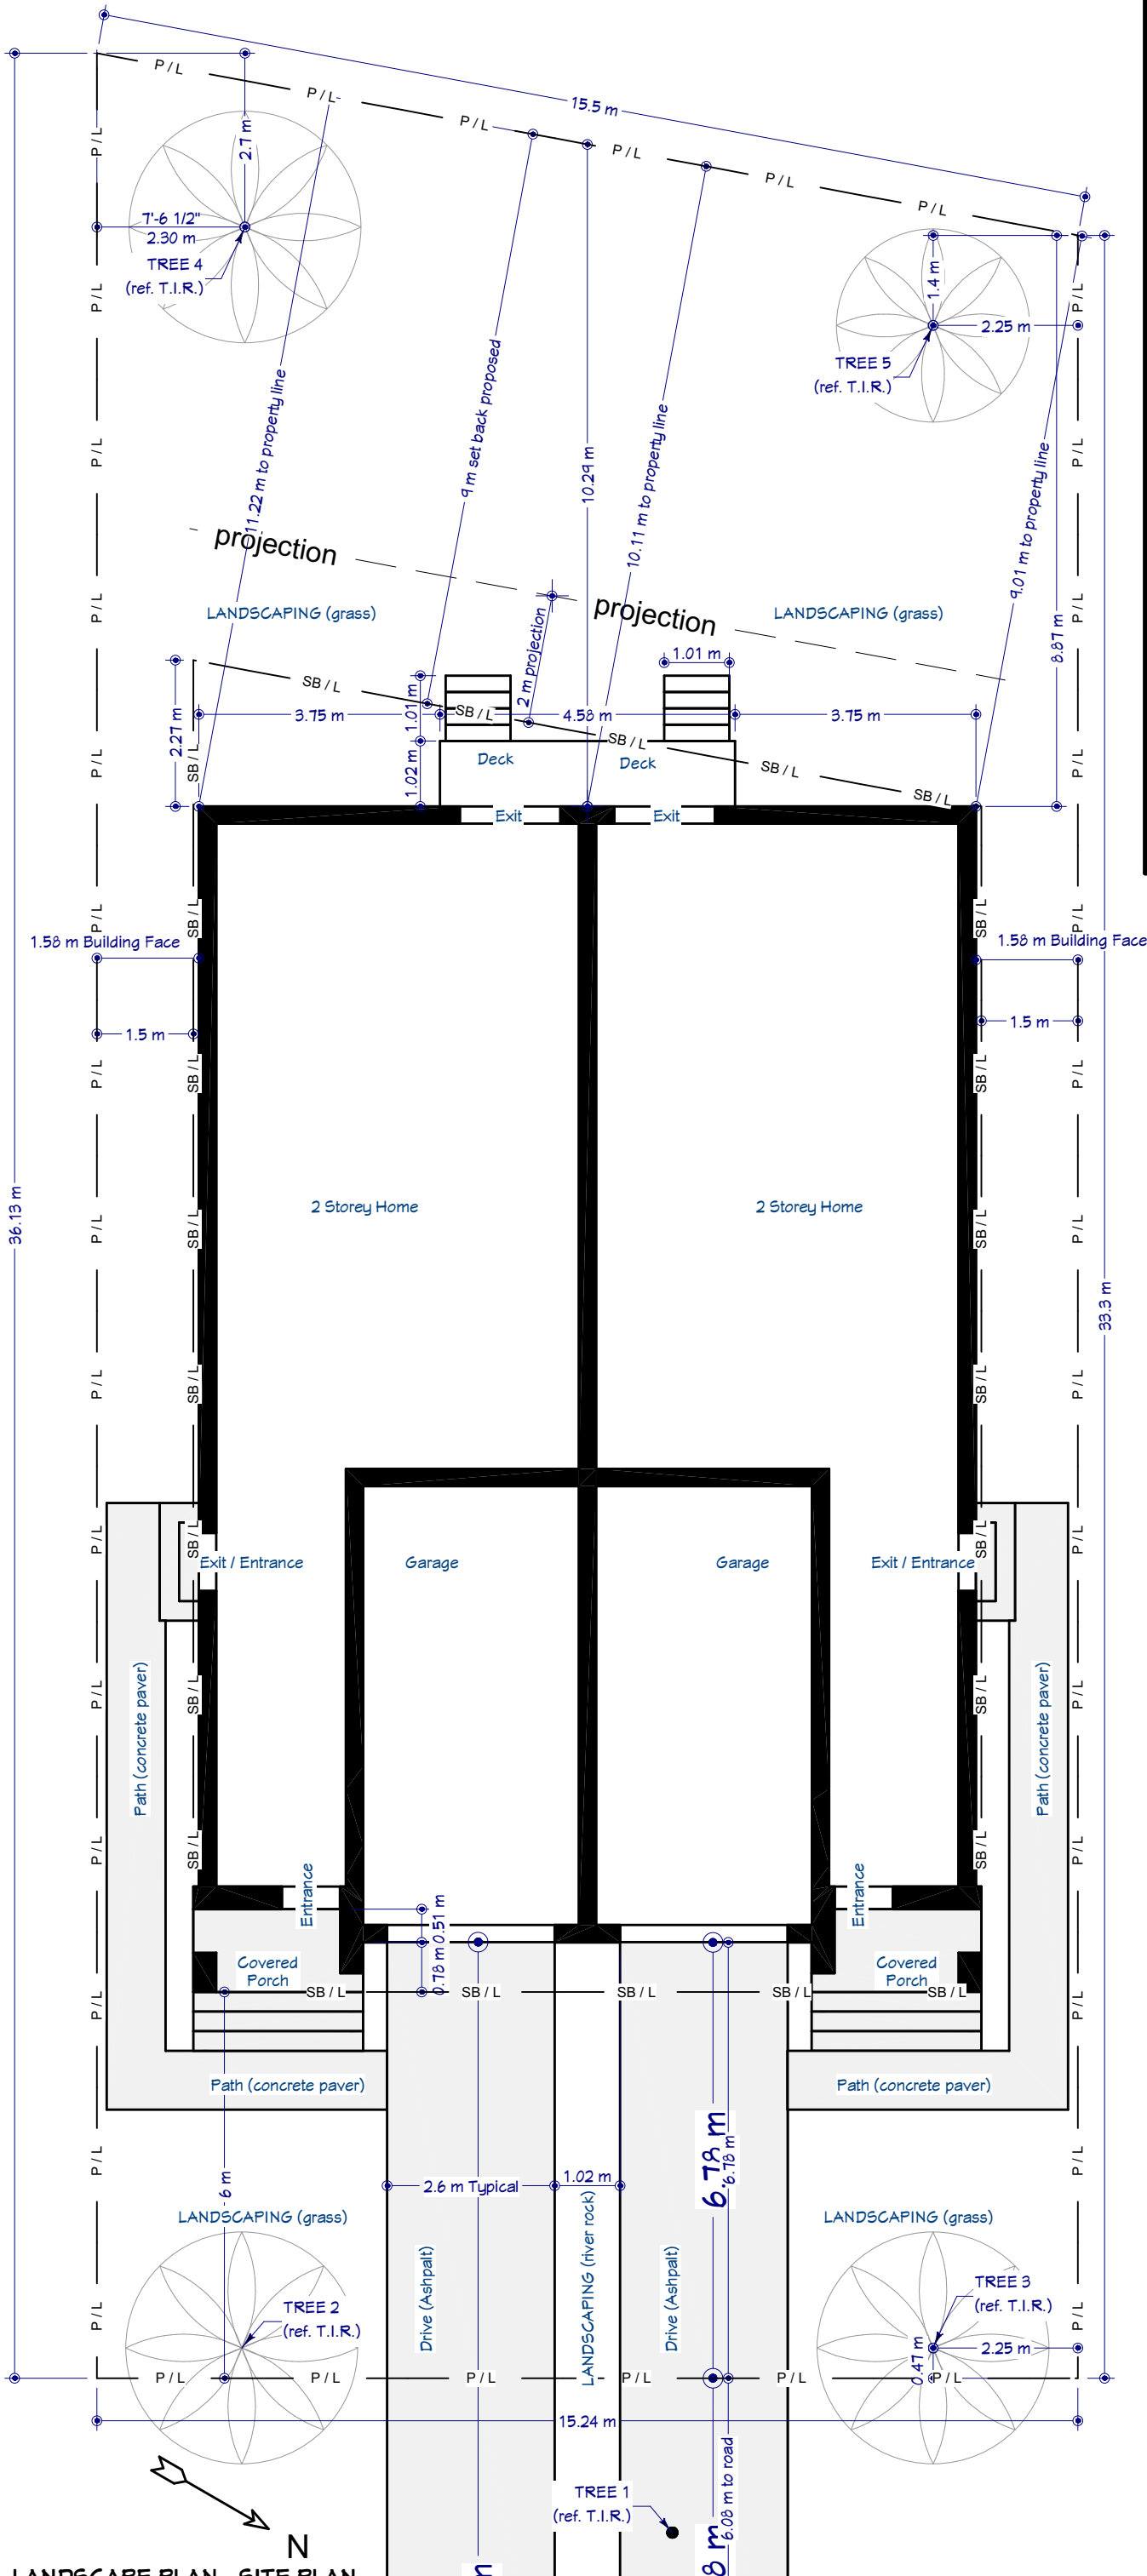

2 DRIVEWAY DETAIL
A1 1:200

LOT DATA

AREA LOT	= 529 m ²
AREA BUILDING FOOTPRINT	= 210.89 m ²
AREA FRONT YARD	= 99.0 m ²
AREA REAR YARD	= 156.81 m ²
AREA DRIVEWAY	= 35.21 m ²
FRONT YARD GREEN AREA	= 38.42 m ²
REAR YARD COVERAGE	= 30 %
DRIVEWAY COVERAGE	= 36 %
FRONT YARD GREEN AREA COVERAGE	= 39 %

SEVERED LOT DATA "LOT LEFT"

AREA LOT	= 269.91 m ²
AREA BUILDING FOOTPRINT	= 105.45 m ²
AREA FRONT YARD	= 49.5 m ²
AREA REAR YARD	= 83.94 m ²
AREA DRIVEWAY	= 17.6 m ²
FRONT YARD GREEN AREA	= 19.21 m ²
REAR YARD COVERAGE	= 31 %
DRIVEWAY COVERAGE	= 36 %
FRONT YARD GREEN AREA COVERAGE	= 39 %

SEVERED LOT DATA "LOT RIGHT"

AREA LOT	= 259.13 m ²
AREA BUILDING FOOTPRINT	= 105.45 m ²
AREA FRONT YARD	= 50 m ²
AREA REAR YARD	= 73.16 m ²
AREA DRIVEWAY	= 17.6 m ²
FRONT YARD GREEN AREA	= 19.21 m ²
REAR YARD COVERAGE	= 28 %
DRIVEWAY COVERAGE	= 36 %
FRONT YARD GREEN AREA COVERAGE	= 39 %

DESIGNED BUILDING HEIGHT

DESIGNED BUILDING HEIGHT	= 7.72m (left)
	7.82m (right)
average	= 7.72 + 7.82 / 2 = 7.77m

T.I.R. = TREE INFORMATION REPORT

1 LANDSCAPE PLAN - SITE PLAN
A1 1:100