




# GEMTEC

[www.gemtec.ca](http://www.gemtec.ca)

**Hydrogeological Investigation &  
Terrain Analysis  
Proposed Residential Severance  
930 Smith Road  
Ottawa, Ontario**



# GEMTEC

[www.gemtec.ca](http://www.gemtec.ca)

Submitted to:

Hierarchy Development and Design Inc.  
1836 Maple Grove Road  
Ottawa, Ontario  
K2S 0M7

**Hydrogeological Investigation &  
Terrain Analysis  
Proposed Residential Severance  
930 Smith Road  
Ottawa, Ontario**

May 15, 2024 – Rev 1  
Project: 100812.001



|   |    |
|---|----|
| TABLE OF CONTENTS   | 2  |
| LIST OF APPENDICES  | 3  |
| 1.0 INTRODUCTION  | 4  |
| 2.0 TERRAIN ANALYSIS  | 4  |
| 2.1 Site Geology  | 4  |
| 2.2 Subsurface Conditions   | 5  |
| 2.2.1 Topsoil   | 5  |
| 2.2.2 Silty Sand  | 6  |
| 2.2.3 Silty Clay  | 6  |
| 2.2.4 Glacial Till  | 6  |
| 2.2.5 Auger Refusal   | 7  |
| 2.2.6 Groundwater Levels  | 7  |
| 2.2.7 Hydraulic Test Results  | 7  |
| 2.3 MECP Water Well Records   | 8  |
| 2.4 Topography and Drainage   | 8  |
| 3.0 GROUNDWATER QUALITY AND QUANTITY  | 9  |
| 3.1 Homeowner Well Water Quality Sampling   | 9  |
| 3.2 Test Well Construction  | 11 |
| 3.3 Groundwater Quantity  | 13 |
| 3.3.1 Pumping Test Details  | 13 |
| 3.3.2 Pumping Test Analysis   | 14 |
| 3.4 Groundwater Quality   | 15 |
| 3.4.1 Summary of Water Quality Exceedances for Deep Bedrock Aquifer                     | 17 |
| 3.4.2 Summary of Water Quality Exceedances for Gravel/Shallow Bedrock Interface Aquifer | 17 |
| 3.4.3 Bacteriological Results   | 17 |
| 3.4.4 Chemical Results  | 18 |
| 4.0 SEPTIC IMPACT ASSESSMENT  | 19 |
| 4.1 Sewage Disposal Systems   | 20 |
| 4.1.1 Class IV Septic Sewage Disposal Systems   | 20 |
| 4.2 Three-Step Assessment: Step 1 - Lot Size Considerations                             | 21 |
| 4.3 Three-Step Assessment: Step 2 – System Isolation Considerations                     | 21 |
| 4.4 Three-Step Assessment: Step 3 - Nitrate Dilution Calculations                       | 21 |
| 4.5 Background Nitrate Concentrations   | 23 |
| 4.6 Surface Water Impacts   | 23 |
| 5.0 CONCLUSIONS   | 24 |

|     |                                       |    |
|-----|---------------------------------------|----|
| 5.1 | Hydrogeological Conceptual Model..... | 24 |
| 5.2 | Water Quality.....                    | 26 |
| 6.0 | RECOMMENDATIONS.....                  | 27 |
| 6.1 | Water Supply Recommendation.....      | 27 |
|     | Septic System Recommendations.....    | 29 |
| 7.0 | CLOSURE.....                          | 29 |
| 8.0 | REFERENCES.....                       | 30 |

## LIST OF TABLES

|         |  |    |
|---------|--|----|
| Table 1 | – Summary of Grain Size Distribution Test (Weathered Crust)..... | 6  |
| Table 2 | – Summary of Grain Size Distribution Test (Glacial Till).....    | 7  |
| Table 3 | – Groundwater Depth and Elevation.....                           | 7  |
| Table 4 | – Summary of Falling Head and Rising Head Test Results.....      | 8  |
| Table 5 | – Well Construction Details – Sampled Private Wells.....         | 9  |
| Table 6 | – Homeowner Interviews.....                                      | 10 |
| Table 7 | – Well Construction Details – Test Wells.....                    | 11 |
| Table 8 | – Pumping Test Details.....                                      | 13 |
| Table 9 | – Water Quality Sampling Summary.....                            | 15 |

## LIST OF APPENDICES

|            |  |
|------------|--|
| APPENDIX A | Concept Plan   |
| APPENDIX B | Borehole Logs  |
| APPENDIX C | Grain Size Curves                                      |
| APPENDIX D | Hydraulic Conductivity Testing                         |
| APPENDIX E | MECP Water Well Records                                |
| APPENDIX F | Water Quality Results and Laboratory Certificate Forms |
| APPENDIX G | Pumping Tests Analysis                                 |
| APPENDIX H | Nitrate Dilution Calculations                          |

## 1.0 INTRODUCTION

GEMTEC Consulting Engineers and Scientists (GEMTEC) Limited was retained by Hierarchy Development and Design Inc. (HDD) to complete a hydrogeological investigation and terrain analysis in support of a residential development located at 930 Smith Road, Ottawa, Ontario. The Site Plan, Figure 1 is provided following the text of this report.

It is understood that the existing site located at 930 Smith Road, herein referred to as the 'Site', has a total area of approximately 5.46 hectares. Based on the Concept Plan provided (Appendix A), a total of seven residential lots are proposed.

The Site consists of agricultural lands and sparse tree and bush cover. The Site is bounded to the east and south by Smith Road, and residential dwelling to the north and west.

The objective of the investigation presented herein is:

- To demonstrate that the construction of any new well on the severed parcels is in accordance with the MECP;
- To demonstrate that the quality of the well water meets the Ontario Drinking Water Standards and maximum treatable limits prescribed in Ontario Ministry of Environment, Conservation and Parks (MECP) Procedure D-5-5;
- To demonstrate that the quantity of water meets the MECP requirements; and,
- To demonstrate the septic impact assessment meets the MECP requirements.

The hydrogeological investigation and terrain analysis was completed in general accordance with the City of Ottawa Hydrogeological and Terrain Analysis Guidelines (City of Ottawa, 2021), technical consultation with City of Ottawa hydrogeologist Michel Kearney on June 21, 2022 and City of Ottawa review comments titled "Phase 3 Pre-Consultation: Review Feedback, Proposed Zoning By-law Amendment and Consent Application – 930 Smith Road" and dated May 10, 2024.

This report is subject to the *Conditions and Limitations of This Report* provided following the text of this report, which are considered an integral part of this report.

## 2.0 TERRAIN ANALYSIS

### 2.1 Site Geology

Surficial geology maps (Ontario Geologic Survey, 2010) indicate that the site is split diagonally by a fluvial terrace, which is aligned in the northeast-southwest direction. The northeast section of the site is mapped as coarse-textured glaciomarine deposits of sand, gravel and minor silt and clay. The southwest section of the site is mapped as fine-textured glaciomarine deposits of

silt and clay, and minor sand and gravel. Drift thickness mapping indicate the overburden soils range from 10 to 25 meters thick (Gao et al, 2006).

Paleozoic bedrock geology maps (Armstrong and Dodge 2007) indicate the bedrock geology beneath the subject site consists of shale and minor limestone of the Billings Formation from the Upper Ordovician Period. Underlying the Upper Ordovician Period formations are the Simcoe Group of the of the Middle Ordovician, and the Beekmantown Group of the Lower Ordovician. The Simcoe Formation consists broadly of limestone, dolostone, shale and sandstone units. The Beekmantown Group consists of the Oxford Formation, which is described as a dolostone with shaly and sandy interbeds, which is underlain by the March Formation, an interbedded grey quartz sandstone, dolomitic quartz sandstone, and blue-grey sandy dolostone and dolostone.

Available karst mapping (Brunton and Dodge, 2008), does not indicate any areas of any inferred or potential karstic features.

## **2.2 Subsurface Conditions**

The subsurface conditions at the site were characterized as part of the geotechnical investigation of the site (GEMTEC, 2024). A total of four boreholes (numbered 21-01, 21-02A, 21-02B, and 21-03) were advanced.

The boreholes were advanced to depths ranging from about 6.7 to 8.8 metres below ground surface. Samples of the soils encountered were recovered using a 50-millimetre diameter split barrel sampler. Well screens were sealed in the overburden at all borehole locations (except borehole 20-02B) to measure the groundwater levels and for hydraulic conductivity testing.

Descriptions of the subsurface conditions logged in the boreholes are provided on the Record of Borehole sheets in Appendix B. The approximate locations of the test holes are shown on the Detailed Site Plan, Figure 2.

The groundwater conditions described in this report refer only to those observed at the place and time of observation noted in the report. These conditions may vary seasonally or because of construction activities in the area.

The following presents a summary of the subsurface conditions encountered in the boreholes advanced during the geotechnical investigation (GEMTEC, 2024).

### **2.2.1 Topsoil**

A layer of topsoil was encountered at the ground surface at the borehole locations with a thickness ranging from about 130 to 180 millimetres.

### 2.2.2 Silty Sand

A native deposit of silty sand was encountered below the topsoil in borehole 21-02A and 21-02B with a thickness of about 150 millimetres.

### 2.2.3 Silty Clay

Native deposits of silty clay were encountered in all of the boreholes. The silty clay was not fully penetrated in all the boreholes but was proven to depths ranging from about 5.3 to 8.8 metres below ground surface.

The upper part of the silty clay in the boreholes is weathered to a grey-brown crust. The weathered silty clay crust has a thickness ranging from about 2.8 to 5.2 metres and extends to depths ranging from about 3.1 to 5.3 metres below the existing ground surface.

Grain size distribution tests were undertaken on one sample of the weathered silty clay crust from borehole 21-01. The results are provided in Appendix C and are summarized in Table 1.

**Table 1 – Summary of Grain Size Distribution Test (Weathered Crust)**

| Location | Sample Number | Sample Depth (metres) | Gravel (%) | Sand (%) | Silt (%) | Clay (%) |
|----------|---------------|-----------------------|------------|----------|----------|----------|
| 21-01    | 3             | 1.5 – 2.1             | 0          | 1        | 21       | 78       |

Below the weathered zone, the silty clay is grey in colour. The silty clay was not fully penetrated in all the boreholes but was proven to depths ranging from about 5.3 to 8.8 metres below ground surface.

### 2.2.4 Glacial Till

A deposit of glacial till was encountered below the silty clay in borehole 21-03. The glacial till was not fully penetrated in the borehole but was proven to depth of about 6.1 metres below ground surface.

The glacial till is a heterogeneous mixture of all grain sizes, which at this site, can be described as grey silty sand with some gravel and clay. Although not encountered in the borehole directly, the glacial till deposits in this area are known to contain cobbles and boulders.

One grain size distribution test was undertaken on a sample of the glacial till from borehole 21-03. The results are provided in Appendix C and are summarized in Table 2.

**Table 2 – Summary of Grain Size Distribution Test (Glacial Till)**

| Location | Sample Number | Sample Depth (metres) | Gravel (%) | Sand (%) | Silt (%) | Clay (%) |
|----------|---------------|-----------------------|------------|----------|----------|----------|
| 21-03    | 8             | 5.3 – 5.9             | 16         | 44       | 24       | 16       |

### 2.2.5 Auger Refusal

Auger refusal was encountered in borehole 21-02A at a depth of about 8.2 metres below ground surface (elevation of about 72.7 metres, geodetic).

### 2.2.6 Groundwater Levels

Well screens were installed in the overburden at boreholes 21-01, 21-02A, and 21-03. The groundwater levels measured in the wells are summarized in Table 3.

**Table 3 – Groundwater Depth and Elevation**

| Borehole No. | Ground Surface Elevation (metres) | Groundwater Depth (metres) | Groundwater Elevation (metres) | Date of Reading    |
|--------------|-----------------------------------|----------------------------|--------------------------------|--------------------|
| 21-01        | 78.94                             | 3.7                        | 75.2                           | September 13, 2021 |
| 21-02A       | 80.95                             | 2.1                        | 78.9                           | September 13, 2021 |
| 21-03        | 80.08                             | > 6.1                      | < 74.0                         | September 13, 2021 |

The groundwater levels may be higher during wet periods of the year such as the early spring or following periods of precipitation. Based on the groundwater levels measured on September 13, 2021, the overburden groundwater flow direction is to the south, following topography.

### 2.2.7 Hydraulic Test Results

The results of the hydraulic testing carried out in select monitoring wells are provided in Appendix D. A summary of the recovery measurements made during the hydraulic testing carried out by introducing/removing a slug into the well screens is provided in Table 4.

**Table 4 – Summary of Falling Head and Rising Head Test Results**

| Borehole | Borehole Depth (metres) | Geological Material Tested | Static Groundwater Depth (metres) | Falling Head Test <sup>1</sup> | Calculated <i>k</i> Falling Head (m/s) <sup>2</sup> |
|----------|-------------------------|----------------------------|-----------------------------------|--------------------------------|---|
| 21-01    | 7.32                    | Silty clay                 | 3.7                               | 73% in 90 minutes              | 1 x 10 <sup>-7</sup>                                |
| 21-02A   | 8.18                    | Silty clay                 | 3.0                               | 7% in 60 minutes               | 3 x 10 <sup>-8</sup>                                |
| 21-03    | 6.10                    | Silty clay                 | dry                               | -                              | -   |

Notes:

1. Falling head test were completed by inserting a slug with a known displacement (0.60 metre). The water level was monitored manually using a water level meter and electronically using a VanEssen Diver Datalogger, recording at 0.5 minute intervals.
2. The hydraulic conductivities were calculated using the Hvorslev solution in an unconfined aquifer.
3. The recovery in the monitoring wells was too slow to complete a rising head test.

The falling head tests (i.e. inserting a slug) recorded a recovery of about 73 percent at 21-01 and about 7 percent at 21-02A. Considering this to be slow to very slow recovery of groundwater levels the rising head tests were not performed at these two test locations. Based on the low permeability silty clay at the screened interval at monitoring wells 21-01 and 21-02A, the minimal recovery is reasonable for the encountered soil type.

In areas within the site where a saturated granular soil layer is encountered, higher hydraulic conductivity values should be expected.

### 2.3 MECP Water Well Records

A search of the Ministry of Environment, Conservation and Parks (MECP) water well records (<https://www.ontario.ca/environment-and-energy/map-well-records>) returned 55 water well records within 500 metres of the Site, refer to Site Location Plan (Figure 1). A summary of the relevant well construction details from the 55 water well records is provided in Appendix E. The well depths range from 13.7 to 61.1 metres below ground surface, with an average well depth of 23.3 metres. The depth to bedrock ranges from 12.2 to 37.5 meters below ground surface, with an average value of 20.2 metres.

The bedrock lithology is generally classified as shale, slate, and limestone in the MECP well records, with most records indicating shale or slate. It is noted that the MECP well records provide a general description of the bedrock encountered, and given the similarities between some geologic units, e.g. slate and shale, the well records may not be suitable to distinguish between geologic formations of the water supply aquifer.

### 2.4 Topography and Drainage

Topographic mapping data indicates that elevations across the Site range from approximately 71 to 80 metres above sea level. The Site elevation generally increases from the south to north

and has a topographic low point in the southwest corner of the site. The drainage of the subject is expected to follow topography and drain generally to the south.

### 3.0 GROUNDWATER QUALITY AND QUANTITY

The hydrogeological investigation was carried out in accordance with MECP Procedure D-5-5, Technical Guideline for Private Wells: Water Supply Assessment, to determine the quantity and quality of groundwater available for domestic water supply. The results of the groundwater supply investigation are summarized in the following sections.

#### 3.1 Homeowner Well Water Quality Sampling

Between 2022 and 2023, GEMTEC completed homeowner questionnaires and water quality sampling from several residential dwellings located within 100 meters of the Site (Figure 1). The wells identified as PW-903 (well tag # 1515221), PW-939 (well tag # 1511704), PW-1014 (well tag # 1512793), and PW-959 (No well tag #) were sampled as part of this assessment based on homeowner availability, relative proximity, comparable surrounding land-use, and comparable geological setting. It should be noted that none of the private wells had well tags affixed to the steel casings and the well tag numbers were obtained from a search of MECP well records. The available water well records for the private wells sampled are provided in Appendix E and a summary of the well construction details are provided in Table 5.

**Table 5 – Well Construction Details – Sampled Private Wells**

|  | PW939         | PW903          | PW1014        |
|--|---------------|----------------|---------------|
| Well Tag Number <sup>1</sup>                   | 1515221       | 1511704        | 1512793       |
| Date of Drilling                               | Oct. 26, 1971 | Sept. 24, 1975 | April 5, 1965 |
| Depth to Bedrock (m)                           | 18.3          | 13.7           | 25.9          |
| Length of Well Casing Below Ground Surface (m) | 18.3          | 13.1           | 25.9          |
| Static Water Level (m btoc) <sup>2</sup>       | 8.22          | 0.30           | 4.57          |
| Depth Water Found <sup>3</sup> (m)             | 20.4          | 15.8           | 26.5          |
| Total Well Depth (m)                           | 20.4          | 15.8           | 26.5          |



|  | PW939       | PW903      | PW1014      |
|--|-------------|------------|-------------|
| Open Interval (m)                        | 2.10        | 2.70       | 0.61        |
| Bedrock Aquifer Description <sup>4</sup> | Brown Slate | Grey Slate | Brown Slate |

Notes:

1. No well tag affixed to steel casing, well ID's based on MECP well record database.
2. 'mbtoc' – Meters below top of casing. Water levels reported on the water well record.
3. Water found depth as reported on MECP water well record. Corresponds to the depth below ground surface of the water bearing fractures encountered at the time of drilling.
4. The bedrock aquifer is defined as the geologic unit corresponding with the major water bearing zones encountered at time of drilling.

The groundwater samples were collected from the pressure tank bypass after running the cold-water tap for a minimum of 10 minutes. Water quality samples were submitted for laboratory analysis of 'subdivision package' parameters on February 2, 2022 and April 7, 2022. The field and laboratory water quality results are provided in Appendix F.

In addition to the sampled wells, homeowner interviews were also completed at three homeowners on private services within 500m of the site were interviewed; relevant interview notes are provided in Table 6 below.

**Table 6 – Homeowner Interviews**

| Test Well ID | Homeowner Water Quality Rating <sup>1</sup> | Water Quantity Comments                 | Water Quality / Septic Comments  |
|--------------|---|---|--|
| PW-903       | Good  | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• Sulfur smell</li> <li>• Water filtration system in place</li> </ul>                   |
| PW-939       | Good  | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• Sulfur Smell</li> <li>• Water filtration system in place</li> </ul>                   |
| PW-1014      | Poor  | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• Water filtration and chlorination system in place.</li> <li>• Sulfur smell</li> </ul> |
| PW-959       | Fair  | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• Sulfur smell</li> <li>• No treatment systems</li> </ul>                               |

| Test Well ID | Homeowner Water Quality Rating <sup>1</sup> | Water Quantity Comments                 | Water Quality / Septic Comments  |
|--------------|---|---|--|
| PW-900       | Very Good                                   | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• High sulfur</li> <li>• Aerator and filtration system in place</li> </ul>        |
| PW-908       | Very Good                                   | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• No treatment systems in place</li> </ul>  |
| PW-917       | Poor  | No reported groundwater quantity issues | <ul style="list-style-type: none"> <li>• Sulfur and bacteria presence</li> <li>• Chlorination system in place</li> </ul> |

Notes: Water quality rating based on a scale of 1 (poor), 2 (fair), 3 (good), 4 (very good), and 5 (excellent).

Two homeowners rated their groundwater quality as ‘poor’ with one indicate possible bacteria presence, although no justification or additional information was provided. Six of the seven homeowners interviewed reported sulfur smell in their groundwater.

### 3.2 Test Well Construction

A total of six test wells were utilized in the hydrogeological investigation, consisting of five on-site and one off-site test well. The six test wells can be separated into two categories: three deep test wells completed in the bedrock aquifer (PW21-01, TW22-01 and TW22-02) and three test wells completed in the interface aquifer consisting of gravel overburden and/or upper bedrock (TW22-03, TW22-04 and TW24-05). The MECF water well records for the test wells utilized for the hydrogeological investigation are provided in Appendix E, and the construction details are summarized in Table 7. The locations of the water wells are provided on the Detailed Site Plan (Figure 2).

**Table 7 – Well Construction Details – Test Wells**

|                      | PW21-01<br>(A313191) | TW22-01<br>(A342174) | TW22-02<br>(A342173) | TW22-03<br>(-) <sup>1</sup> | TW22-04<br>(A342479) | TW24-05<br>(A395575) |
|----------------------|----------------------|----------------------|----------------------|-----------------------------|----------------------|----------------------|
| Date of Drilling     | Jan 7, 2021          | Jan 13, 2022         | Jan 21, 2022         | unknown                     | Aug 17, 2022         | December 07, 2024    |
| Depth to Bedrock (m) | 17.7                 | 18.3                 | 17.1                 | -                           | 13.7                 | 18.6                 |

|   | PW21-01<br>(A313191) | TW22-01<br>(A342174) | TW22-02<br>(A342173) | TW22-03<br>(-) <sup>1</sup>           | TW22-04<br>(A342479)     | TW24-05<br>(A395575)                      |
|---|----------------------|----------------------|----------------------|---------------------------------------|--------------------------|---|
| Length of Well Casing Above Ground Surface <sup>2</sup> (m) | 0.63                 | 0.66                 | 0.66                 | 0.56                                  | 0.76                     | 0.61                                      |
| Length of Well Casing Below Ground Surface (m)              | 19.5                 | 21.3                 | 20.1                 | 18.2                                  | 13.1                     | 18.9                                      |
| Static Water Level (m btoc) <sup>3</sup>                    | 8.7                  | 9.5                  | 11.1                 | 9.0                                   | 3.4                      | 8.8                                       |
| Depth Water Found <sup>4</sup> (m)                          | 120                  | 89.6                 | 98.8                 | -                                     | 12.8                     | 19.8                                      |
| Total Well Depth (m)  | 122                  | 91.4                 | 101                  | 20.0                                  | 14.9                     | 24.4                                      |
| Open Interval (m)   | 19.5 – 122           | 21.3 – 91.4          | 20.1 - 101           | 18.2 – 20.0 (slotted screen)          | 13.1 – 14.9              | 18.9 – 24.4                               |
| Bedrock Aquifer Description <sup>5</sup>                    | Limestone            | Limestone            | Limestone            | Gravel / Bedrock Aquifer <sup>6</sup> | Gravel / Bedrock Aquifer | Gravel / Black Shale Aquifer <sup>7</sup> |

Notes:

1. No Water well record is available for the TW22-3, well construction details based on well camera inspection completed by Air Rock Drilling Ltd.
2. As measured by GEMTEC staff during on site investigations if available.
3. 'mbtoc' – Meters below top of casing.
4. Water found depth as reported on MECP water well record. Corresponds to the depth below ground surface of the water bearing fractures encountered at the time of drilling.
5. The bedrock aquifer is defined as the geologic unit corresponding with the major water bearing zones encountered at time of drilling.
6. TW22-03 assumed to be completed in the gravel/bedrock interface aquifer based on observed slotted screen and geological information from TW22-02 located approximately 50 metres from TW22-03.
7. TW24-05 was hydro fractured is assumed to be receiving water from the gravel/bedrock interface aquifer.

### 3.3 Groundwater Quantity

#### 3.3.1 Pumping Test Details

Constant rate pumping tests were completed in all six on-site test wells. The three deep test wells (PW21-01, TW22-01, and TW22-02) sustained pumping rates of 44 to 96 litres per minute over a six-hour period with minimal drawdown, i.e., less than 14% of available drawdown. Due to Ontario Drinking Water Quality Standards (ODWQS) maximum acceptable concentration exceedances, discussed in section 3.4 below, the deep-water supply aquifer is not proposed as the preferred water supply aquifer and as such, aquifer properties are not discussed in detail.

Three on-site test wells were completed in the proposed water supply aquifer, TW22-03, TW22-04 and TW22-05, screened across the overburden gravel and / or upper bedrock aquifer.

Constant rate pumping tests were completed in all three test wells. The water from the pumping test was discharged to the ground surface approximately 10 metres away from the test well such that the discharge flow was away from the well head. Water level and flow rate measurements were taken at regular intervals throughout the pumping test. Water levels were also taken during the recovery phase of the pumping test (after the pump was turned off) until the well to reached 95% recovery (compensated for barometric pressure). The pumping test drawdown and recovery graph is provided in Appendix G.

A summary of the pumping test details is provided in Table 8 below.

**Table 8 – Pumping Test Details**

| Parameter                                      | PW21-01<br>(A313191) | TW22-01<br>(A342174) | TW22-02<br>(A342173) | TW22-03<br>(No Tag #) | TW22-04<br>(A342479) | TW24-05<br>(A395575) |
|--|----------------------|----------------------|----------------------|-----------------------|----------------------|----------------------|
| Date   | Nov 18,<br>2021      | Feb 1,<br>2021       | Feb 2,<br>2021       | April 28,<br>2022     | Sep 1,<br>2022       | Jan 18,<br>2024      |
| Duration<br>(minutes)                          | 360                  | 360                  | 360                  | 360                   | 450                  | 360                  |
| Flow Rate<br>(litres per<br>minute)            | 45                   | 44                   | 96                   | 23                    | 15                   | 19                   |
| Static Water<br>Level (m<br>TOC <sup>1</sup> ) | 9.32                 | 9.45                 | 10.77                | 8.97                  | 2.76                 | 8.78                 |
| Static Water<br>Level (m<br>BGS <sup>2</sup> ) | 8.69                 | 8.79                 | 10.11                | 8.40                  | 2.00                 | 8.28                 |

| Parameter                               | PW21-01<br>(A313191) | TW22-01<br>(A342174) | TW22-02<br>(A342173) | TW22-03<br>(No Tag #) | TW22-04<br>(A342479) | TW24-05<br>(A395575) |
|---|----------------------|----------------------|----------------------|-----------------------|----------------------|----------------------|
| Available Drawdown <sup>3</sup> (m)     | 109.6                | 79.6                 | 87.9                 | 11.6                  | 9.2                  | 15.12                |
| Water Level at End of Pumping (m TOC)   | 14.11                | 20.59                | 8.55                 | 18.94                 | 7.11                 | 11.34                |
| Pumping Duration (hours)                | 6                    | 6                    | 6                    | 6                     | 7.5                  | 6                    |
| Observed Drawdown at End of Pumping (m) | 4.79                 | 11.14                | 2.22                 | 9.97                  | 4.35                 | 3.06                 |
| Percent Drawdown Utilized (%)           | 4                    | 14                   | 3                    | 86                    | 47                   | 20                   |

Notes:

1. TOC = top of casing;
2. BGS = below ground surface
3. Available drawdown (water column above pump) assumes pump is set 3 metres above bottom of the well for deep test wells PW21-01, TW22-01 and TW22-2 and 1 metre for test wells TW22-03, TW22-04, and TW24-05.

Test wells TW22-03 and TW22-05 were pumped at rates of at least 18.75 litres per minute, which is the minimum pumping rate to meet peak demands for a four-bedroom dwelling (i.e. 3.75 litres x number of bedrooms plus one = 18.75 litres per minute). Test well TW22-04 was pumped at a rate of 15 litres per minute, which meets peak demand requirements for a 3-bedroom dwelling. To account for the lower pumping rate, the pumping test of TW22-04 was extended to 7.5 hours, such that an equivalent groundwater volume could be pumped when compared to a six hour test at a rate of 18.75 litres per minute.

### 3.3.2 Pumping Test Analysis

The pumping test for wells completed in the proposed water supply aquifer were analyzed and the transmissivity of the water supply aquifer was estimated from the pumping test drawdown data using Aqtesolv (Version 4.5), a commercially available software program from HydroSOLVE Inc. The results of the Aqtesolv analyses are provided in Appendix G.

The Papadopulous-Cooper and Theis Recovery analyses estimate the transmissivity of the water supply aquifer to be 3.8 and 0.8 m<sup>2</sup>/day respectively for TW22-03. The Papadopulous-Cooper methodology accounts for wellbore storage, that was evident at the start of the pumping test. The maximum drawdown of the well was approximately 9.9 meters following 6 hours of

pumping at a flow rate of 27 litres per minute, with 1.0 meters of available drawdown remaining. The well recovered to 95% within 1 hour of pump shut off.

The Theis and Theis Recovery analyses estimate the transmissivity of the water supply aquifer to be 2.8 and 1.9 m<sup>2</sup>/day respectively for TW22-04. The maximum drawdown of the well was approximately 4.35 meters following 7.5 hours of pumping at a flow rate of 15 litres per minute, with 4.85 meters of available drawdown remaining. The well recovered to 95% within 11 hours of pump shut off.

The Cooper-Jacob and Theis Recovery analyses indicate that the transmissivity of the water supply aquifer is calculated to be 8.2 m<sup>2</sup>/day and 2.4 m<sup>2</sup>/day, respectively for TW24-05. The maximum drawdown of the well was approximately 3.06 metres following 6 hours of pumping at a flow rate of 19 litres per minute, with 12 metres of available drawdown remaining. The well recovered to 95% within 30 minutes of pump shut off. Based on these results, the test wells are capable of repeat pumping at pumping rates of at least 15 litres per minute.

It is noted that the pumping test results from both test wells TW22-04 and TW24-05 have decreasing drawdowns towards the end of the pumping tests indicating potential ‘recharge’ conditions. This is inferred to be groundwater contribution from the overlying gravel layer, of variable thickness, over the upper fractured bedrock. The conceptual model indicates that the upper fractured bedrock is connected to the overburden gravel layer atop the bedrock and given the test wells are completed into the rock, groundwater contribution from the gravel layer is expected and can be observed as ‘recharge’ during the pumping test.

### 3.4 Groundwater Quality

In addition to the homeowner water quality sampling discussed in section 3.1, the groundwater quality assessment included sampling from the six test wells: PW21-01, TW22-01, TW22-02, TW22-03, TW22-04 and TW24-05. A summary of the groundwater quality sampling events and parameters analyzed are provided in Table 9 below.

**Table 9 – Water Quality Sampling Summary**

| Test Well ID | Date of Sampling | Exceedances  | Aquifer Type |
|--------------|------------------|--|--------------|
| PW21-01      | Nov 18, 2021     | Hardness, Sulphide   | Deep Bedrock |
| TW22-01      | Feb 1, 2021      | Hardness, Sulphide, Turbidity, Organic Nitrogen, Color, pH, Fluoride, Aluminum, Iron | Deep Bedrock |

| Test Well ID | Date of Sampling | Exceedances   | Aquifer Type                        |
|--------------|------------------|---|-------------------------------------|
| TW22-02      | Feb 2, 2021      | Hardness, pH,<br>Sulphide, Fluoride,<br>Aluminum                | Deep Bedrock                        |
| TW22-03      | April 28, 2022   | Iron, Sulphide,<br>Hardness, Turbidity,<br>Colour, pH, Aluminum | Gravel                              |
| TW22-04      | Dec 19, 2023     | Hardness, pH,<br>Sulphide                                       | Gravel-Shallow<br>Bedrock Interface |
| TW24-05      | Jan 24, 2024     | Hardness, pH,<br>Sulphide                                       | Gravel-Shallow<br>Bedrock Interface |

Deep bedrock wells PW21-01, TW22-01 and TW22-02 are not considered representative of the proposed water supply aquifer, which is anticipated to be the shallow bedrock-gravel interface water bearing zone. Furthermore, TW22-03 was not further developed and tested, because the age and construction details of the well is currently unknown and not considered to be representative of future on-site wells. It is noted that excluding exceedances in turbidity and turbidity-related exceedances such as color, aluminum and iron (Table 9), TW22-03 displayed similar water quality when compared to TW22-04 and TW24-05. TW22-03 is not further discussed in the following sections.

The water quality sample for PW21-01, TW22-01, TW22-02 and TW22-04 were collected from the discharge hose at the middle and end of the 6-hour pumping tests and submitted for analysis of subdivision package parameters and unfiltered and filtered trace metals (PW21-01 excepted). TW24-05 was not sampled after 6-hours of pumping due to elevated turbidity levels. TW22-04 was further developed for 1 week and resampled on December 19, 2023, while TW24-05 was further developed for 2 days and resampled on January 24, 2024. For the additional well development, test wells TW22-04 and TW24-05 were pumped at the same rates as during the pumping tests, approx 15 l/min for TW22-04 and 19 l/min for TW24-05.

The Laboratory Certificates of Analysis are provided in Appendix F. Field measurements of temperature, pH, electrical conductivity, total dissolved solids, turbidity, filtered colour, unfiltered colour and total chlorine were measured at the time of sampling. A summary of the measured field parameters is provided in Appendix F.

### 3.4.1 Summary of Water Quality Exceedances for Deep Bedrock Aquifer

Based on the lab results, elevated fluoride concentrations were identified in two of the three deep bedrock test wells, TW22-01 and TW22-02 with concentrations ranging from 2.6 to 3.3 mg/L (Appendix F). The fluoride concentrations exceed the ODWQS maximum acceptable concentration of 1.5 mg/L and as such, the deep bedrock water supply is not suitable for consumption. The deep aquifer also exceeded the operational guideline for hardness, and esthetic objectives of sulphide, colour, and iron.

These exceedances are not further discussed as the deep aquifer is not considered to be representative of the proposed water supply aquifer for the development.

### 3.4.2 Summary of Water Quality Exceedances for Gravel/Shallow Bedrock Interface Aquifer

As previously mentioned, the gravel/shallow bedrock interface water bearing unit is the proposed water supply aquifer. The ODWQS exceedances and notable parameters of this aquifer are discussed in detail below, based on water quality samples collected from on-site test wells TW22-04 and TW24-05 and technically representative homeowner wells PW903, PW939 and PW1014.

### 3.4.3 Bacteriological Results

Total and free chlorine measurements at the time of bacteriological sampling confirmed that total and free chlorine concentrations in the groundwater were non-detectable.

The shallow test wells TW22-04 and TW24-05 had elevated turbidity levels at the time of sampling, which may interfere with bacteriological analyses. Bacteriological testing was not completed on TW22-04 and TW24-05 during the pumping test due to elevated turbidity levels. Following further development and re-sampling, water quality results for TW22-04 reported non-detectable concentrations of E.coli, fecal coliform, and total coliform, while TW24-05 had non-detectable concentrations of E.coli and fecal coliform with total coliform count of 1 CFU/100mL.

Although the total coliform concentrations exceed the ODWWS maximum acceptable concentration of 0 CFU/100mL, the total coliform concentrations detected meet the MECF Procedure D-5-5 limit of less than 6 counts per 100 mL for Total Coliform bacteria, with non-detectable indicator species of e.coli and fecal coliform. Further, testing of neighbouring existing water well users did not identify and bacteriological exceedances through sampling and homeowner interviews.

Based on the bacteriological testing, the water is suitable for consumption.



### 3.4.4 Chemical Results

The results of the chemical testing on the water samples indicate that hardness is below the operational guideline for hardness and the warning level for persons on sodium restricted diets exceeded the ODWQS but is well within the aesthetic objective.

Aesthetic objective exceedances from private wells and on-site test wells include iron, sulphide, pH, aluminum, turbidity, and colour. The above noted exceedances are discussed in the following sections:

#### 3.4.4.1 Hardness

Hardness exceedances for TW22-04 and TW24-05 were reported to be 6.7 and 31.7 mg/L as CaCO<sub>3</sub>, respectively, which is below the ODWQS operational guideline of 80 – 100mg/L. Hardness levels between 80 and 100 mg/L as calcium carbonate (CaCO<sub>3</sub>) are considered to provide an acceptable balance between corrosion and incrustation. Water with hardness below 80 mg/L may cause accelerated corrosion of water pipes.

#### 3.4.4.2 Sulphide

Sulphide concentrations ranged from 0.05 mg/L to 4.61 mg/L in the on-site shallow test wells and private wells sampled. PW-939, PW-1014, TW22-03, TW22-4 and TW24-05 exceed the ODWQS aesthetic guideline of 0.05 mg/L as hydrogen sulphide. Sulphide can be related to an unpleasant odour and taste, and can produce black stains on laundered items, pipes, and fixtures. Although ingestion of large quantities of hydrogen sulphide can produce toxic effects on humans, it is not likely that an individual would ingest a harmful dose in drinking water because of the taste and odour.

Low levels of sulphide can be removed effectively using aeration (oxidation with filtration) or chlorinating the water followed by sand or multimedia filtration. According to the MECP Procedures D-5-5: Private Wells: Water Supply Assessment, there is no maximum treatable limit for sulphide.

#### 3.4.4.3 Turbidity

Turbidity was reported to be 93.9 NTU in TW22-04, after 6 hours of continuous pumping, which exceeds the ODWQS aesthetic guideline of 5 NTU. Field measured turbidity was reported to be 99.6 NTU and 152 NTU in TW22-04 and TW24-05 respectively, after 6 hours of pumping. The elevated turbidity concentrations may be the result of naturally occurring sediments around the interval of the borehole open to the aquifer.

Following further well development, the turbidity concentrations decreased to 0.5 NTU and 1.4 NTU, at TW22-04 and TW24-05 respectively.

#### 3.4.4.4 Colour

Colour was reported to be 11 TCU and 27 TCU in TW22-03 and TW22-04 respectively after 6 hours of pumping, which exceeds the ODWQS aesthetic objective of 5 TCU, and the maximum concentration considered reasonably treatable of 7 TCU. The elevated colour is attributed to the elevated turbidity.

Following further development, color was reported to be 2 TCU at TW22-04 and TW24-05.

#### 3.4.4.5 pH

The pH ranges from 8.4 to 9.4 in the on-site test wells and private wells sampled. TW22-04, T24-05, PW-903 and PW-1014 exceed the ODWQS operational guideline objective of 8.5. The primary objective of controlling pH is to produce water that is not corrosive and does not produce incrustation. At pH levels above 8.5, incrustation and bitter tastes may occur. Additionally, a decrease in efficiency of chlorine disinfection and alum coagulation can occur. Treatment methods for high pH include pH adjustment using sulfuric acid.

Although the MECP Procedure D-5-5 does not have a maximum acceptable concentration or treatability limit for pH, the Guidelines for Canadian Drinking Water Quality indicate an acceptable pH range of 7.0 to 10.5 for drinking water and to control leaching of metals from materials (Health Canada, 2015).

#### 3.4.4.6 Aluminum

Aluminum was reported to be 0.762 mg/L at TW22-04 after 6 hours of pumping, which exceeds the ODWQS operational guideline of 0.1 mg/L. The elevated aluminum can be attributed to elevated turbidity at the time of sampling. Aluminum is commonly found in water as fine particles of alumino-silicate clay, which can be removed in coagulation/filtration.

Following further development and sampling, aluminum was reported to be 0.047 mg/L and 0.05 mg/L at TW22-04 and TW24-05, respectively which is below to aesthetic objective of 0.1 mg/L.

#### 3.4.4.7 Sodium

Sodium concentration of 110 mg/L and 85.5 mg/L was identified at TW22-04 and TW24-05. Sodium exceeds warning level for persons on sodium restricted diets of 20 mg/L. Sodium is well within the aesthetic objective of 200 mg/L. The local medical officer of health should be notified.

### 4.0 SEPTIC IMPACT ASSESSMENT

The potential risk to groundwater resources on and off the subject site was assessed in accordance with MECP Procedure D-5-4: Technical Guideline for Individual Site Sewage

Systems: Water Quality Impact Risk Assessment. To evaluate the groundwater impacts, the Three-Step Assessment Process outlining in MECP D-5-4 was followed.

#### **4.1 Sewage Disposal Systems**

This section discusses the results of the terrain evaluation as they relate to the feasibility of installing sewage disposal systems on the subject site for onsite wastewater treatment and disposal.

It should be noted that the following information is provided for general guidance purposes only and that all septic systems installed on the subject site should be designed on a lot-by-lot basis using a lot specific investigation involving test holes to determine the actual subsurface conditions at the location of the proposed septic system. In all cases, the septic system design must conform to the Ontario Building Code (OBC) requirements.

##### **4.1.1 Class IV Septic Sewage Disposal Systems**

This section discusses the results of the terrain evaluation as they relate to the feasibility of installing Class IV septic sewage disposal systems on the subject site.

The septic system envelope area (septic envelope) represents the area on a lot set aside for the construction of the leaching bed and is for the leaching bed only. It does not include that area required for the septic tank or the isolation/separation distances required by the Ontario Building Code (OBC). The size of the septic system envelope is a function of the percolation rate of the native soil in the vicinity of the septic envelope (or the fill used for the construction of a septic bed) and the daily effluent loading to the septic bed.

The maximum expected septic system envelope required to service a single-family dwelling at this site is calculated to be 750 m<sup>2</sup>, assuming a design flow of 3,000 litres/day and a loading rate of 4 L/m<sup>2</sup>/day (fully raised beds over clay soils).

A 750 m<sup>2</sup> septic envelope corresponds to 16% area cover based on the smallest proposed lot size of 4,613 m<sup>2</sup> (0.46 hectare). Typical septic envelope dimensions would be 30 metres in length by 25 metres in width. The septic system envelope should be readily accommodated on the lot sizes that are proposed. Prior to establishing the actual septic envelope (leaching bed) location on any particular lot, test holes should be excavated to determine the actual subsurface conditions in the area of the proposed leaching bed.

The septic leaching bed design must ensure that the bottom of the absorption trenches is at least 0.9 metres above low permeability soils (such as silty clay), bedrock, and the seasonally high groundwater table. Based on the low permeability clay soils, it is expected that all of the septic leaching beds at this site will be fully raised.

#### **4.2 Three-Step Assessment: Step 1 - Lot Size Considerations**

Lot sizes of 1.0 hectares or larger are assumed to be sufficient for attenuative processes to reduce nitrate-nitrogen to acceptable concentrations in groundwater below adjacent properties. The retained land parcel is less than 1.0 hectares in size, and therefore does not satisfy the MECP D-5-4 lot size requirements, and as such, GEMTEC has carried on with steps 2 of the MECP process.

#### **4.3 Three-Step Assessment: Step 2 – System Isolation Considerations**

Where proposed lot sizes are less than 1.0 hectares, the risk of sewage effluent contamination must be assessed. As per Procedure D-5-4, it is required to:

- Evaluate the most probable groundwater receiver for sewage effluent; and,
- Define the most probable lower hydraulic or physical boundary of the groundwater receiving the sewage effluent.

The groundwater supply aquifer is considered to be isolated if separated from surficial sources by a 10 metres thick, low permeability layer with a hydraulic conductivity less than  $1 \times 10^{-5}$  m/s that is laterally continuous for 100 metres from the Site.

The boreholes advanced as part of the geotechnical investigation (GEMTEC, 2023) identified low permeability units of silty clay underlying the Site to depths of up to 8.3 metres below ground surface. Hydraulic testing performed in monitoring wells installed in boreholes 21-01 and 21-02 that are screened through the silty clay, estimated the hydraulic conductivity to be  $3 \times 10^{-7}$  m/s and  $3 \times 10^{-8}$  m/s respectively.

Test wells advanced on-site indicate that the overburden thickness ranged from 12.2 metres to 18.3 metres and MECP water well records within 500 metres of the Site indicate overburden thickness ranges from 12.2 to 37.5 metres. Based on TW22-04 located at the southern end of the Site, the thickness of clay decreases to approximately 5.2 metres and is underlain by “sand and boulders” to a depth of 10.3 metres, which is interpreted to be glacial till based on geotechnical boreholes advanced on-site (GEMTEC, 2023).

The proposed water supply aquifer is considered to be at least partially isolated from surficial impacts based on the presence of 5+ metres of low permeability clay. Given the underlying glacial till at the southern portion of the Site has not been assessed, nitrate dilution calculations were carried out to confirm the acceptability of septic impacts for the proposed severed lots.

#### **4.4 Three-Step Assessment: Step 3 - Nitrate Dilution Calculations**

Where it cannot be demonstrated that the effluent is hydrogeologically isolated from the water supply aquifer, the risk of individual septic systems will be assessed using nitrate-nitrogen contaminant loading for commercial/industrial properties. The maximum allowable concentration

of nitrate in the groundwater at the boundaries of the subject property is 10 milligrams per litre as per the Ministry of the Environment, Conservation and Parks guideline D-5-4, dated August 1996.

The nitrate concentration at the Site boundaries was calculated using the following information:

- Site area of 54,592 m<sup>2</sup>;
- Hard surface area of 5,459 m<sup>2</sup> (estimated to be 10% of total Site area, which accounts for house and driveway footprint)
- Infiltration factors and water holding capacity of soils (WHC) based on information obtained from Table 3.1 of the Ministry of Environment Stormwater Management Planning and Design Manual, dated March 2003;
- Soil Factor of 0.15, which represents combination of clay and some loam;
- Cover Factor of 0.1 which represents cultivated lands;
- Topography Factor of 0.17, representative of rolling land with an average slope of 10 m/km.
- Water holding capacity: 75 mm for urban lawns / shallow rooted crops, clay;
- An annual water surplus of 0.380 metres/year for soils with a water holding capacity of 75 mm; and,
  - Ottawa International Airport Weather Station (1939-2020). Water surplus datasheet provided in Appendix H.
- Negligible background nitrate concentration in the receiving aquifer.

The predictive assessment is conducted using a mass balance calculation to determine the sewage loading for nitrate at the property boundary (see equation below).

$$C_{Nitrate} = \frac{Mass}{Volume} = \frac{Annual\ Nitrate\ Loading(grams/year)}{Annual\ Dilution\ Volume(cubic\ metres/year)} = \frac{grams}{cubic\ metre} = \frac{mg}{L}$$

The nitrate dilution calculations are provided in Appendix H. The calculated nitrate concentration at the Site boundary, assuming seven residential lots was calculated to be 9.83 mg/L. The Site can support up to seven residential lots. The total site area was considered for the proposed residential lots.

The nitrate impact assessment for the Site meets the acceptable nitrate impact requirement of 10 mg/L established by the MECP. The background nitrate concentration is considered to be negligible based on non-detectable (<0.20 mg/L) nitrate concentrations in the receiving aquifer.

#### **4.5 Background Nitrate Concentrations**

The nitrate concentrations were measured in the low permeability overburden soils (MW21-1 and MW21-2), the receiving gravel / upper bedrock aquifer (PW939, PW903, PW1014, TW22-03 and TW22-04) and deep bedrock aquifer (PW21-01, TW21-01 and TW21-02). The nitrate concentrations in the receiving gravel / upper bedrock aquifer and deep bedrock aquifer ranged from non-detectable (<0.1 mg/l) to 0.2 mg/L. The nitrate concentrations in on-site monitoring wells were 5.8 mg/L and 6.6 mg/L in MW21-1 and 0.3 mg/L in MW21-2. The locations of the private wells, test wells and monitoring wells are displayed on Figure 1 - Site Plan.

The elevated nitrate in MW21-1 is likely associated with the historic use of fertilizers, as the Site is crop covered. This is supported by the low nitrate concentrations (0.3 mg/L) in MW21-2, which is located on the upgradient portion of the Site (refer to Figure 2). Further, MW21-2 is located immediately downgradient of multiple residential properties serviced with on-site septic systems and does not have elevated nitrate concentrations.

The elevated nitrate concentrations in MW21-1 are not considered to be representative of the nitrate concentrations in the receiving aquifer, taken to be the gravel / upper bedrock aquifer, as MW21-1 is completed in low permeability silty clay. Down gradient shallow water supply wells TW22-04 (14.9 metres deep) and PW903 (15.8 metres deep), had low nitrate concentrations measured to be 0.2 mg/L and <0.1 mg/L respectively.

#### **4.6 Surface Water Impacts**

The discussion provided herein, in relation to surface water impacts to adjacent surface water features, is concerned primarily with septic effluent discharging from on-site septic systems. Phosphorus is known to be the primary contaminant of concern for aquatic systems impacted by septic effluent. As such, the discussion provided below is focused on the potential for phosphorus to impact adjacent surface water features.

Phosphorus attenuation in septic system leaching fields utilizes a combination of biotic and abiotic process including sorption/precipitation reactions, plant uptake, and mineralization/immobilization by microbes, however the dominant attenuation mechanisms are sorption/precipitation mechanisms (Wilhelm, et al., 1996). A 30-metre setback is considered to be sufficient for phosphorous attenuation.

The closest surface water feature to the site is McKinnons Creek, located east of the Site (Figure 1). McKinnons Creek is greater than 30 metres from the proposed septic systems (refer to Concept Plan in Appendix A) and as such, no impacts to surface water features from the proposed on-site septic systems are anticipated.

## 5.0 CONCLUSIONS

Based on the results of this investigation, the following conclusions and professional opinions are provided:

### 5.1 Hydrogeological Conceptual Model

- The soils encountered generally consist of a thin layer of topsoil underlain by low permeability silty clay, glacial till and gravel above shale bedrock. The silty clay was not fully penetrated by the geotechnical boreholes on site but was proven to range from 5.3 to 8.3 metres below ground surface in test wells.
- The proposed water supply aquifer is the overburden – bedrock interface aquifer, consisting of a gravel layer of variable thickness and extent over upper fractured bedrock.
  - The thickness and extent of the gravel layer is expected to vary across the Site, as not all well records indicate the presence of gravel above the bedrock. A review of available water well records indicate that many neighbouring water wells are completed in interface aquifer (i.e., gravel and / or upper fractured bedrock).
  - The deeper bedrock aquifer is not considered suitable due to ODWQS maximum acceptable concentration exceedances of fluoride.
- The proposed water supply aquifer is not considered to be highly vulnerable to contamination from surficial sources, e.g. septic system effluent, agricultural, or road salt.
  - On-site test wells do not display evidence of impacts from surficial sources i.e. low to non-detectable nitrate concentrations, E.coli, fecal coliform, tannins and lignins or organic nitrogen, and low chloride and sodium concentrations.
  - No notable surface impacts (e.g., septic, road salt or softener salt) observed in the two neighbouring private wells within 100 meters of the Site, which have favourable water quality.
  - The gravel / upper bedrock interface aquifer is expected to be overlain by greater than five meters of low permeability silty clay material, based on the conditions logged during the on-site borehole drilling and water well records of the on-site test wells.
  - Slug testing was performed in monitoring wells installed in boreholes 21-01 and 21-02, which are screened through the silty clay overburden unit reported hydraulic conductivity values of  $3 \times 10^{-7}$  m/s and  $3 \times 10^{-8}$  m/s.
  - Elevated nitrate concentrations in on-site monitoring well MW21-01 are likely related to on-site agricultural activities rather than septic systems, given the low nitrate concentrations in upgradient MW21-02, located immediately downgradient



of existing residential septic systems. Further, downgradient water supply wells TW22-04, TW24-05 and PW903 had low to non-detectable nitrate concentrations (<0.1 mg/L to 0.2 mg/L).

- Off-site groundwater impacts from the proposed seven residential lots are not anticipated, as the calculated nitrate concentration of 9.83 mg/L is within the maximum allowable nitrate concentration of 10 mg/L at the property boundary, as required by MECP Procedure D-5-4.
  - The Site can support a maximum of seven residential lots based on the nitrate dilution calculations.
  - The Site is considered to be partially isolated from surficial sources given the presence of greater than five metres of low permeability ( $< 10^{-5}$  m/s) silty clay soils.
  - Proposed septic systems are expected to be fully raised and sized to accommodate sand mantle over clay soils, allowing for treatment of septic effluent.
- Off-site surface water impacts from the proposed on-site septic systems are not anticipated as the closest surface water feature, McKinnons Creek is located greater than 30 metres from the proposed on-site septic systems.
- The quantity of groundwater available from the proposed water supply aquifer (TW22-04 and TW24-05) is sufficient for residential use and will sustain repeated pumping at the test rate and duration at 24-hour intervals over the long term.
  - TW22-05 was initially unable to meet the MECP Procedure D-5-5 minimum required flow rate and was hydrofractured by a licensed well technician. Following hydrofracking, the well yield in TW24-05 was increased to approx. 19 litres per minute. Hydrofracking may be required to enhance the productivity of low-yield wells. Test wells TW22-03 sustained pumping rates of 23 litres per minute and TW22-05 sustained pumping rates of 18.8 litres per minute, both suitable to supply a 4-bedroom dwelling.
  - TW22-04 sustained a constant pumping rate of 15 litres per minute over a 7.5 hour period. The pumping rate of 15 litres per minute is sufficient to meet peak demands for a 3-bedroom dwelling and supplemental storage may be required to meet peak demands in a 4-bedroom home. The pumping test of TW22-04 was extended from 6 to 7.5 hours such that the total water withdrawal was equivalent to a pumping test completed at 18.8 litres per minute, confirming that all on-site wells meet the minimum daily water demand requirements to support a 4-bedroom dwelling.



- TW22-03 was able to sustain pumping rates of 23 litres per minute over a six hour period; however, the well may not be sustainable at the pumping rate over the long term due to the limited available drawdown of approx. one metre at the end of the pumping test. Nonetheless, TW22-03 is not considered to be technically representative of future water supply wells, as the previously constructed well is likely screened solely across the gravel layer.
- Based on homeowner interviews of seven neighbouring properties, no water quantity issues were reported. It should be noted that neighbouring properties are developed at a higher density than the proposed development and as such, unacceptable groundwater interference between on-site or neighbouring well users is not anticipated.
- Where future well yields are only 15 litres per minute, supplemental storage may be required to meet peak demands in houses greater than 3 bedrooms.
- The well yields determined in the course of the investigation are representative of the yields which residents of the development are likely to obtain from their wells in the long term.
- Interference between drinking water wells is expected to be acceptable under typical usage for residential developments.
  - Maximum drawdown of 0.2 metres observed in observations well during pumping (0.2 metre drawdown in TW22-03 and negligible drawdown in TW22-04 during pumping of TW24-05). Negligible interference between on-site and neighbouring test wells is anticipated.
  - Homeowner interviews of neighbouring lot owners, which are developed at a higher density of 0.14 hectares per lot did not report any water quantity issues. In comparison, the smallest proposed lot size is 0.46 hectares.

## 5.2 Water Quality

- The results of the physical, chemical and bacteriological groundwater indicate that the water quality in the proposed water supply aquifer (gravel / upper bedrock) meets the ODWQS maximum acceptable concentrations and maximum concentrations considered to be reasonably treatable.
  - Aesthetic objective and operational guideline exceedances of: pH, hardness, and sulphide. Unpleasant odour and taste, and black stains on laundered items, pipes, and fixtures may be encountered due to the sulphide and pH exceedances.
  - Turbidity, colour and aluminum aesthetic objective and operational guideline exceedances were encountered following well drilling; however, it was

demonstrated that through extended well development, turbidity and associated colour and aluminum could be reduced to within ODWQS aesthetic objective and operational guideline limits.

- Homeowner interviews of 7 neighbouring well owners did not indicate any water quality issues attributed to elevated turbidity suggesting that newly constructed wells, once fully developed, will meet aesthetic objectives for turbidity.

## 6.0 RECOMMENDATIONS

The following recommendations regarding well construction specifications and water quality treatment are provided below.

### 6.1 Water Supply Recommendation

- Any new water well should be constructed in accordance with local and MECP regulations (O.Reg 903).
- Test wells TW22-04 and TW24-05 are considered technically representative of future water supply wells.
  - Different methodologies were used in the construction of TW22-04 and TW22-05, both of which straddle the bedrock interface. A local well driller should be retained who has experience drilling and grouting wells within the bedrock interface. Future well casings should straddle the bedrock interface, ranging from approximately 0.6 metres above to 0.3 metres below the bedrock surface.
  - Hydrofracking may be required to increase well production.
  - Extended well development will be required to reduce turbidity and associated colour and aluminum to acceptable levels.
  - Future wells should not extend greater than six metres into bedrock, as wells completed at greater depths may encounter fluoride concentrations above the ODWQS maximum acceptable concentrations.
  - Where lower well yields are encountered (i.e., yields of approx 15 litres per minute), supplemental storage may be required for houses that are greater than 3-bedrooms.
- As per the City of Ottawa review comments (May 10, 2024), in order to ensure compliance with the report recommendations, 0.3 m reserves are required in front of each lot. A **Well Inspection Report** will be required for each lot prepared by a Qualified Professional and should include the following information:

- The well grouting inspection should be conducted under the supervision and sealed by a licensed professional engineer or professional geoscientist, qualified to practice geoscience.
- Confirm that the well construction meets O.Reg 903 requirements and recommendations within this report, specifically that the well casing straddles the bedrock interface, ranging from approximately 0.6 metres above to 0.3 metres below the bedrock interface and that the well is not drilled more than six metres into bedrock.
- Confirm that the well yield is at least 18.75 litres per minute, and if not, demonstrate that adequate supplemental storage can be accommodated based on the size of the proposed dwelling. The determination of well yield should also indicate whether hydrofracking was completed.
- Extended well development should be anticipated to reduce turbidity and associated colour concentrations to acceptable levels. Newly drilled wells should be pumped until a Qualified Professional has confirmed that the field measured turbidity and colour are below their respective ODWQS aesthetic objectives of 5 NTU and 7 TCU respectively. The instruments used shall be described and calibration records provided.
- The separation distance between drinking water wells and on site or neighbouring septic systems should be at least 15 metres and up to 18 metres to account for fully raised septic beds. Future water supply wells should be located upgradient from septic beds.
- Any unused on-site test wells should be abandoned by a licensed well technician in accordance with O.Reg 903. Test wells not used for future residential use should be abandoned, including TW22-01 (tag # A342174), TW22-02 (tag # A342173) and TW22-03 (no tag #). If test wells TW22-04 (tag # A342479) and TW22-05 (tag # A395575) are not utilized by future lot owners, they should be abandoned.
- A water quality treatment specialist should be consulted by future owners for the implementation of any treatment systems. The following treatment systems may be considered for future property owners:
  - Sulphide can be treated at low concentrations via aeration (oxidation with filtration) or chlorination followed by sand or multimedia filtration.
  - pH levels over 8.5 may be treated through pH adjustment using sulfuric acid.
  - No treatment is recommended for hardness as the water is naturally soft. To note, water with hardness below 80 mg/L may cause accelerated corrosion of water pipes.

- It is recommended that the property owners construct, maintain and test their drinking water well in accordance with the Ministry of the Environment and Climate Change document “Water Supply Wells - Requirements and Best Management Practices, Revised April 2015”.

The following recommendations are provided regarding septic system design:

### Septic System Recommendations

- The proposed lots will be serviced by individual Class IV septic sewage disposal systems designed according to the Ontario Building Code. A site-specific visit should be conducted on the lot for septic system design requirements.
- The septic system should be designed and installed by a licensed contractor in accordance with Ontario Building Code (Part 8) specifications. It is recommended that septic systems be located a minimum of 15 metres (or up to 18 metres for fully raised septic beds) from any on-site or neighbouring water supply wells.
- It is recommended that the property owners construct, maintain and check their onsite septic system in accordance with the Ontario Building Code and best management practices (Ministry of Municipal Affairs and Housing, 2021). The homeowner shall consult the following guides available at: <https://www.oowa.org/homeowner-resources/>.

## 7.0 CLOSURE

We trust this report provides sufficient information for your present purposes. The report is subject to the *Conditions and Limitations of This Report*, provided following the text of this report. If you have any questions concerning this report, please do not hesitate to contact our office.



Samuel Esenwa, B.Sc., G.I.T.  
Environmental Scientist



Andrius Paznekas, M.Sc., P.Geo.  
Hydrogeologist



## 8.0 REFERENCES

Armstrong, D.K. and Dodge, J.E.P. 2007. Paleozoic geology of southern Ontario; Ontario Geological Survey, Miscellaneous Release--Data 219

Brunton, F.R. and Dodge, J.E.P. 2008. Karst of southern Ontario and Manitoulin Island; Ontario Geological Survey, Groundwater Resources Study 5.

City of Ottawa, 2021. Hydrogeological and Terrain Analysis Guidelines.

Gao, C., Shirota, J., Kelly, R.I., Brunton, F.R. and van Haaften, S. 2006. Bedrock topography and overburden thickness mapping, southern Ontario; Ontario Geological Survey, Miscellaneous Release—Data 207.

GEMTEC. 2024. Geotechnical Investigation, Residential Development, 930 Smith Road, Ottawa, Ontario. Project reference 100812.001, dated March 14, 2024.

Ontario Geological Survey. 2010. Surficial geology of Southern Ontario. Ontario Geological Survey, Miscellaneous Release-Data 128-Revision 1.

Ontario Geological Survey. 2011. 1:250 000 scale bedrock geology of Ontario. Ontario Geological Survey, Miscellaneous Release-Data 126-Revision 1.

Ontario Ministry of the Environment and Climate Change. 1996. Procedure D-5-5, Technical Guideline for Private Wells: Water Supply Assessment. August 1996.

Ontario Ministry of the Environment and Climate Change. 1996. Procedure D-5-4, Technical Guideline for Individual On-Site Sewage Systems: Water Quality Impact Risk Assessment. August 1996.

Health Canada. 2015. Guideline Technical Document – pH. *Guidelines for Canadian Drinking Water Quality*. Health Canada. Retrieved from <https://www.canada.ca/en/health-canada/services/publications/healthy-living/guidelines-canadian-drinking-water-quality-guideline-technical-document-ph.html>.

1. **Standard of Care:** GEMTEC has prepared this report in a manner consistent with generally accepted engineering or environmental consulting practice in the jurisdiction in which the services are provided at the time of the report. No other warranty, expressed or implied is made.
2. **Copyright:** The contents of this report are subject to copyright owned by GEMTEC, save to the extent that copyright has been legally assigned by us to another party or is used by GEMTEC under license. To the extent that GEMTEC owns the copyright in this report, it may not be copied without our prior written agreement for any purpose other than the purpose indicated in this report. The methodology (if any) contained in this report is provided to the Client in confidence and must not be disclosed or copied to third parties without the prior written agreement of GEMTEC. Disclosure of that information may constitute an actionable breach of confidence or may otherwise prejudice our commercial interests.
3. **Complete Report:** This report is of a summary nature and is not intended to stand alone without reference to the instructions given to GEMTEC by the Client, communications between GEMTEC and the Client and to any other reports prepared by GEMTEC for the Client relative to the specific site described in the report. In order to properly understand the suggestions, recommendations and opinions expressed in this report, reference must be made to the whole of the report. GEMTEC can not be responsible for use of portions of the report without reference to the entire report.
4. **Basis of Report:** This Report has been prepared for the specific site, development, design objectives and purposes that were described to GEMTEC by the Client. The factual data, interpretations and recommendations pertain to a specific project as described in this report and are not applicable to any other project or site location. The applicability and reliability of any of the findings, recommendations, suggestions, or opinions expressed in the document, subject to the limitations provided herein, are only valid to the extent that this report expressly addresses the proposed development, design objectives and purposes. Any change of site conditions, purpose or development plans may alter the validity of the report and GEMTEC cannot be responsible for use of this report, or portions thereof, unless GEMTEC is requested to review any changes and, if necessary, revise the report.
5. **Time Dependence:** If the proposed project is not undertaken by the Client within 18 months following the issuance of this report, or within the timeframe understood by GEMTEC to be contemplated by the Client, the guidance and recommendations within the report should not be considered valid unless reviewed and amended or validated by GEMTEC in writing.
6. **Use of This Report:** The information, recommendations and opinions expressed in this report are for the sole benefit of the Client. No other party may use or rely on this report or any portion thereof without GEMTEC's express written consent. If the report was prepared to be included for a specific permit application process, then upon the reasonable request of the client, GEMTEC may authorize in writing the use of this report by the regulatory agency as an Approved User for the specific and identified purpose of the applicable permit review process.

Contractors bidding on, or undertaking the work, should rely on their own investigations, as well as their own interpretations of the factual data presented in the report, as to how subsurface conditions may affect their work, including but not limited to proposed construction techniques, schedule, safety and equipment capabilities.
7. **No Legal Representations:** GEMTEC makes no representations whatsoever concerning the legal significance of its findings, or as to other legal matters touched on in this report, including but not limited to, ownership of any property, or the application of any law to the facts set forth herein. With respect to regulatory compliance issues, regulatory statutes are subject to interpretation and change. Such interpretations and regulatory changes should be reviewed with legal counsel.



8. **Decrease in property value:** GEMTEC shall not be responsible for any decrease, real or perceived, of the property or site's value or failure to complete a transaction, as a consequence of the information contained in this report.
9. **Reliance on Provided Information:** The evaluation and conclusions contained in this report have been prepared on the basis of conditions in evidence at the time of site inspections and on the basis of information provided to us. We have relied in good faith upon representations, information and instructions provided by the Client and others concerning the site. Accordingly, we cannot accept responsibility for any deficiency, misstatement or inaccuracy contained in this report as a result of misstatements, omissions, misrepresentations, or fraudulent acts of the Client or other persons providing information relied on by us. We are entitled to rely on such representations, information and instructions and are not required to carry out investigations to determine the truth or accuracy of such representations, information and instructions.
10. **Investigation Limitations:** Site investigation programs are a professional estimate of the scope of investigation required to provide a general profile of subsurface conditions but even a comprehensive investigation, sampling and testing program may fail to detect all or certain subsurface conditions.

The data derived from the site investigation program and subsequent laboratory testing are interpreted by trained personnel and extrapolated across the site to form an inferred geological representation and an engineering opinion is rendered about overall subsurface conditions and their likely behaviour with regard to the proposed development. Conditions between and beyond the borehole/test hole locations may differ from those encountered at the borehole/test hole locations and the actual conditions at the site might differ from those inferred to exist, since no subsurface exploration program, no matter how comprehensive, can reveal all subsurface details and anomalies. Accordingly, GEMTEC does not warrant or guarantee the exactness of the subsurface descriptions.

Soil and groundwater conditions shown in the factual data and described in the report are the observed conditions at the time of their determination or measurement. Unless otherwise noted, those conditions form the basis of the recommendations in the report. Groundwater conditions may vary between and beyond reported locations and can be affected by annual, seasonal and meteorological conditions. The condition of the soil, rock and groundwater may be significantly altered by construction activities (traffic, excavation, groundwater level lowering, pile driving, blasting, etc.) on the site or on adjacent sites. Excavation may expose the soils to changes due to wetting, drying or frost. Unless otherwise indicated the soil must be protected from these changes during construction.

In addition, fill of variable physical and chemical composition can be present over portions of the site or on adjacent properties. The professional services retained for this project include only the geotechnical aspects of the subsurface conditions at the site, unless otherwise specifically stated and identified in the report. The presence or implication(s) of possible surface and/or subsurface contamination resulting from previous activities or uses of the site and/or resulting from the introduction onto the site of materials from off-site sources are outside the terms of reference for this project and have not been investigated or addressed.


11. **Sample Disposal:** GEMTEC will dispose of all uncontaminated soil and/or rock samples 60 days following issue of this report or, upon written request of the Client, will store uncontaminated samples and materials at the Client's expense. In the event that actual contaminated soils, fills or groundwater are encountered or are inferred to be present, all contaminated samples shall remain the property and responsibility of the Client for proper disposal.
12. **Follow-Up and Construction Services:** All details of the design were not known at the time of submission of GEMTEC's report. GEMTEC should be retained to review the final design, project plans and documents prior to construction, to confirm that they are consistent with the intent of GEMTEC's report.  
During construction, GEMTEC should be retained to perform sufficient and timely observations of encountered conditions to confirm and document that the subsurface conditions do not

materially differ from those interpreted conditions considered in the preparation of GEMTEC's report and to confirm and document that construction activities do not adversely affect the suggestions, recommendations and opinions contained in GEMTEC's report. Adequate field review, observation and testing during construction are necessary for GEMTEC to be able to provide letters of assurance, in accordance with the requirements of many regulatory authorities. In cases where this recommendation is not followed, GEMTEC's responsibility is limited to interpreting accurately the information encountered at the borehole locations, at the time of their initial determination or measurement during the preparation of the Report.

13. **Changed Conditions:** Where conditions encountered at the site differ significantly from those anticipated in this report, either due to natural variability of subsurface conditions or construction activities, it is a condition of this report that GEMTEC be notified of any changes and be provided with an opportunity to review or revise the recommendations within this report. Recognition of changed soil and rock conditions requires experience and it is recommended that GEMTEC be employed to visit the site with sufficient frequency to detect if conditions have changed significantly.
14. **Drainage:** Drainage of subsurface water is commonly required either for temporary or permanent installations for the project. Improper design or construction of drainage or dewatering can have serious consequences. GEMTEC takes no responsibility for the effects of drainage unless specifically involved in the detailed design and construction monitoring of the system.




N:\PROJECTS\1008001\100812.001\106\_DRAFTING\1 - DRAWINGS\HYDRO 2024\100812.001 - HYDROSP\_R1\_2024\_02.DWG

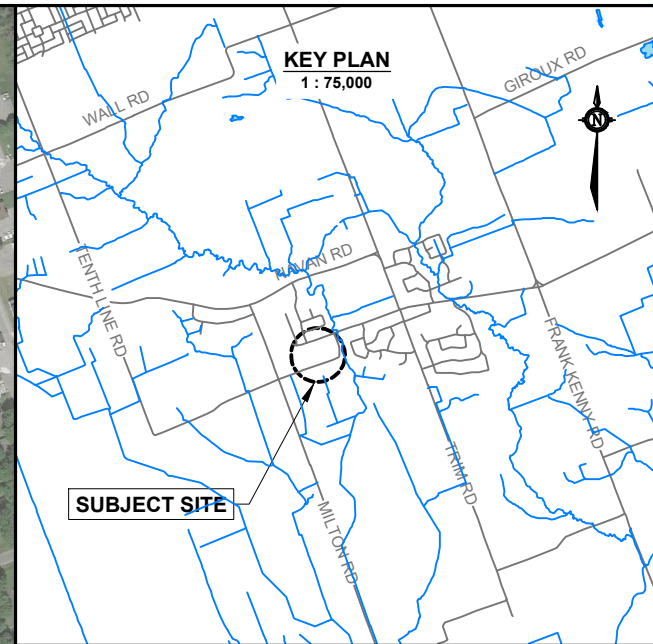

**LEGEND**

- BH # — BOREHOLE ID
- XX.XX — GROUND SURFACE ELEVATION, IN METRES GEODETIC DATUM
- ⊙ BOREHOLE
- ⊕ TEST WELL
- ⊙ SAMPLED HOMEOWNER WELL
- ⊕ MECP WELL
- APPROXIMATE SITE BOUNDARY
- ⊖ STUDY AREA (500 m RADIUS AROUND THE SITE BOUNDARY)

GENERAL NOTE(S)  
 1. Coordinate system: NAD83, UTM ZONE 18N.  
 2. Geographic dataset source: Ontario GeoHub.  
 3. Contains information licensed under the Open Government Licence – Ontario.



DRAWING SITE PLAN

CLIENT HIERARCHY DEVELOPMENT AND DESIGN

PROJECT HYDROGEOLOGICAL INVESTIGATION  
 930 SMITH ROAD  
 NAVAN, ONTARIO

|               |                 |
|---------------|-----------------|
| DRAWN BY S.L. | CHECKED BY A.P. |
|---------------|-----------------|

|                        |                |
|------------------------|----------------|
| PROJECT NO. 100812.001 | REVISION NO. 1 |
|------------------------|----------------|

|                 |                     |
|-----------------|---------------------|
| DATE MARCH 2024 | FIGURE NO. FIGURE 1 |
|-----------------|---------------------|

**GEMTEC**  
 CONSULTING ENGINEERS AND SCIENTISTS

32 Steacie Drive  
 Ottawa, ON, K2K 2A9  
 Tel: (613) 836-1422  
 www.gemtec.ca  
 ottawa@gemtec.ca



N:\PROJECTS\1008001\100812\001\06\_DRAFTING\1\_DRAWINGS\HYDRO\2024\100812\001\_HYDROSP\_R1\_2024\_02.DWG




**LEGEND**

- BH # — BOREHOLE ID
- XX.XX — GROUND SURFACE ELEVATION, IN METRES GEODETIC DATUM
- ⊙ BOREHOLE
- ⊕ TEST WELL
- ⊙ SAMPLED HOMEOWNER WELL
- APPROXIMATE SITE BOUNDARY
- STUDY AREA (1 km RADIUS AROUND THE SITE BOUNDARY)

GENERAL NOTE(S)

1. Coordinate system: NAD83, UTM ZONE 18N.
2. Geographic dataset source: Ontario GeoHub.
3. Contains information licensed under the Open Government Licence – Ontario.

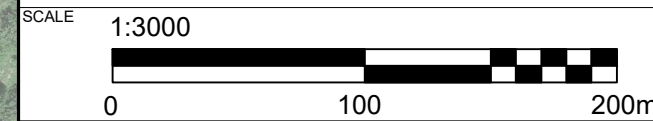

DRAWING  
**DETAILED SITE PLAN**

CLIENT  
**HIERARCHY DEVELOPMENT AND DESIGN**

PROJECT  
**HYDROGEOLOGICAL INVESTIGATION  
930 SMITH ROAD  
NAVAN, ONTARIO**

|                         |                           |
|-------------------------|---------------------------|
| DRAWN BY<br><b>S.L.</b> | CHECKED BY<br><b>A.P.</b> |
|-------------------------|---------------------------|

|                                  |                          |
|----------------------------------|--------------------------|
| PROJECT NO.<br><b>100812.001</b> | REVISION NO.<br><b>1</b> |
|----------------------------------|--------------------------|

|                           |                               |
|---------------------------|-------------------------------|
| DATE<br><b>MARCH 2024</b> | FIGURE NO.<br><b>FIGURE 2</b> |
|---------------------------|-------------------------------|

**GEMTEC**  
CONSULTING ENGINEERS  
AND SCIENTISTS

32 Steacie Drive  
Ottawa, ON, K2K 2A9  
Tel: (613) 836-1422  
www.gemtec.ca  
ottawa@gemtec.ca





## **APPENDIX A**

### Concept Plan



**GENERAL NOTES:**  
1. DO NOT SCALE DIMENSIONS.  
2. ALL DIMENSIONS ON THIS REPORT ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING. ANY DIMENSIONS SHOWN ON THIS REPORT ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
3. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
4. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
5. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
6. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
7. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
8. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
9. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.  
10. ALL DIMENSIONS ARE TO BE TAKEN FROM THE REPORT AND NOT FROM THE ORIGINAL DRAWING.

CONSULTANT'S STAMP

INFO  
STAMP

INFO  
STAMP  
NORTH ARROW


|      |          |          |
|------|----------|----------|
| NO 1 | REVISION | 02/21/23 |
| NO 2 | REVISION | 03/29/23 |

CONSULTANTS

PROJECT  
430 SMITH RD  
NAVAN ON  
OTTAWA

DRAWING TITLE  
SITE PLAN

SCALE  
NOT TO SCALE  
DATE  
03/29/23  
SHEET  
AO 1  
FILE NUMBER  
20-0711

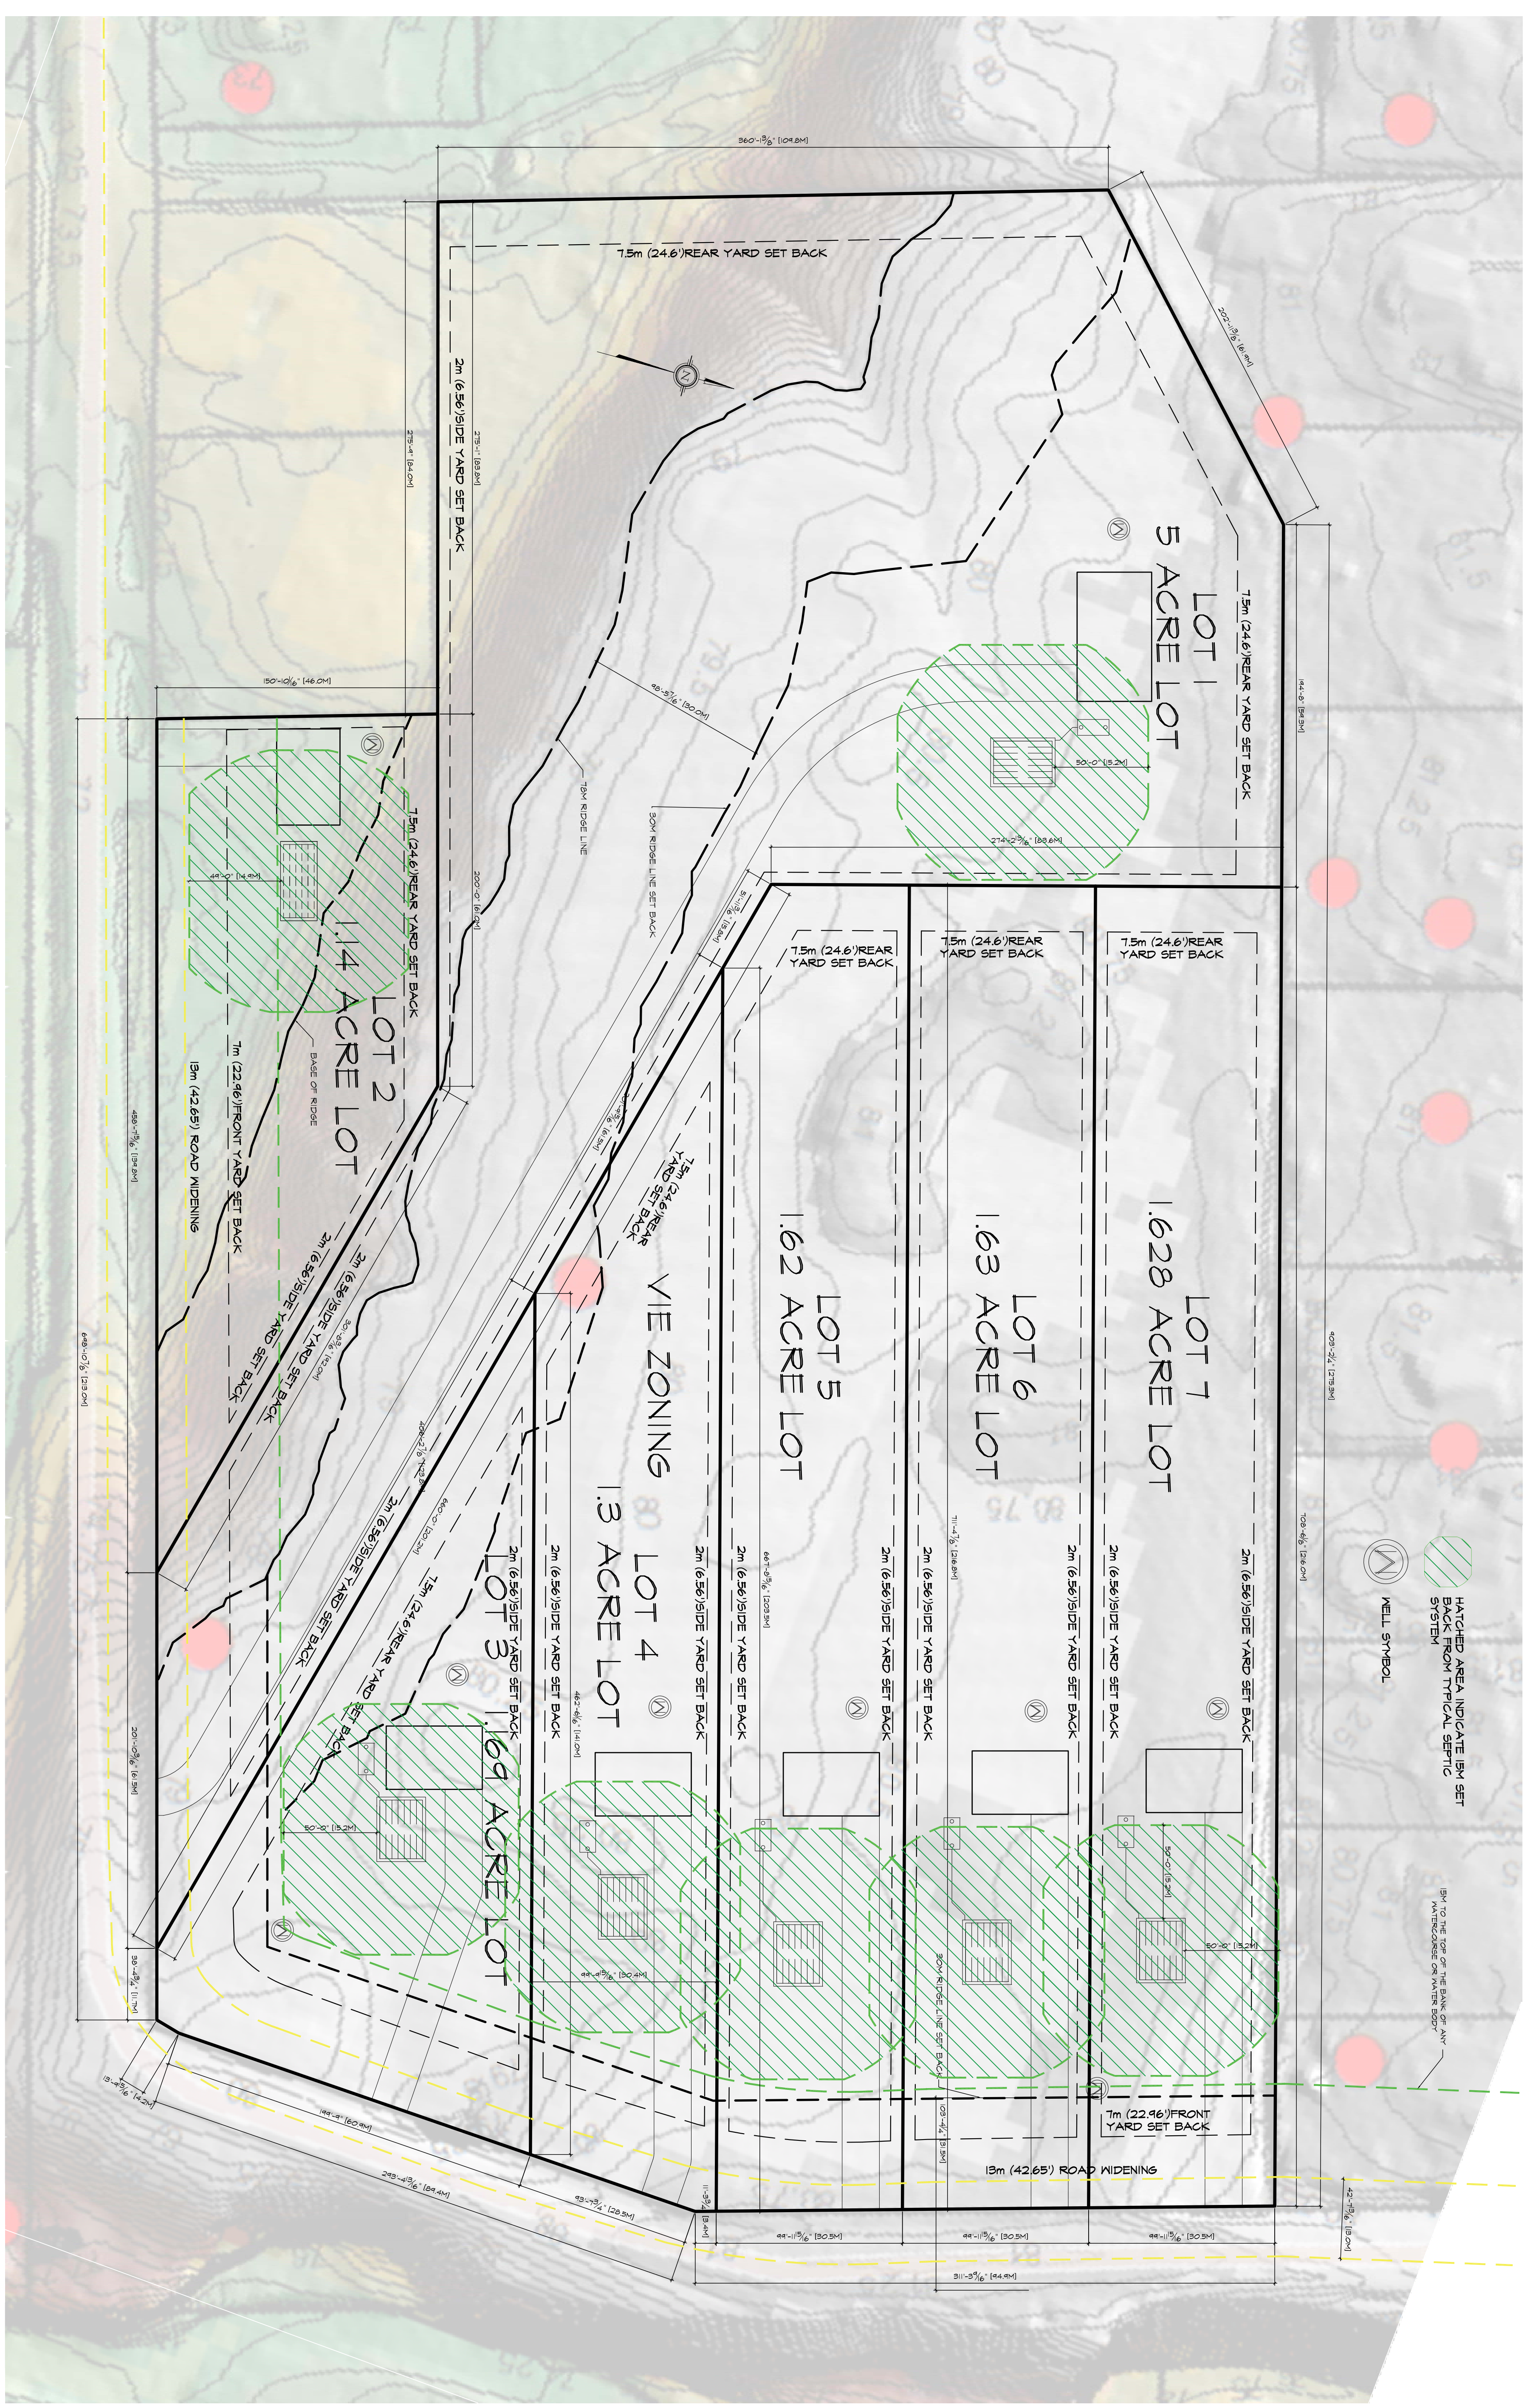

SITE PLAN






## **APPENDIX B**

### Borehole Logs

# RECORD OF BOREHOLE 21-01

CLIENT: Hierarchy Development & Design Inc.  
 PROJECT: Geotechnical Investigation, Proposed Lot Severances, 830 Smith Road, Ottawa, Ontario  
 JOB#: 100812.001  
 LOCATION: See Site Plan, Figure 1

SHEET: 1 OF 1  
 DATUM: CGVD28  
 BORING DATE: Aug 12 2021

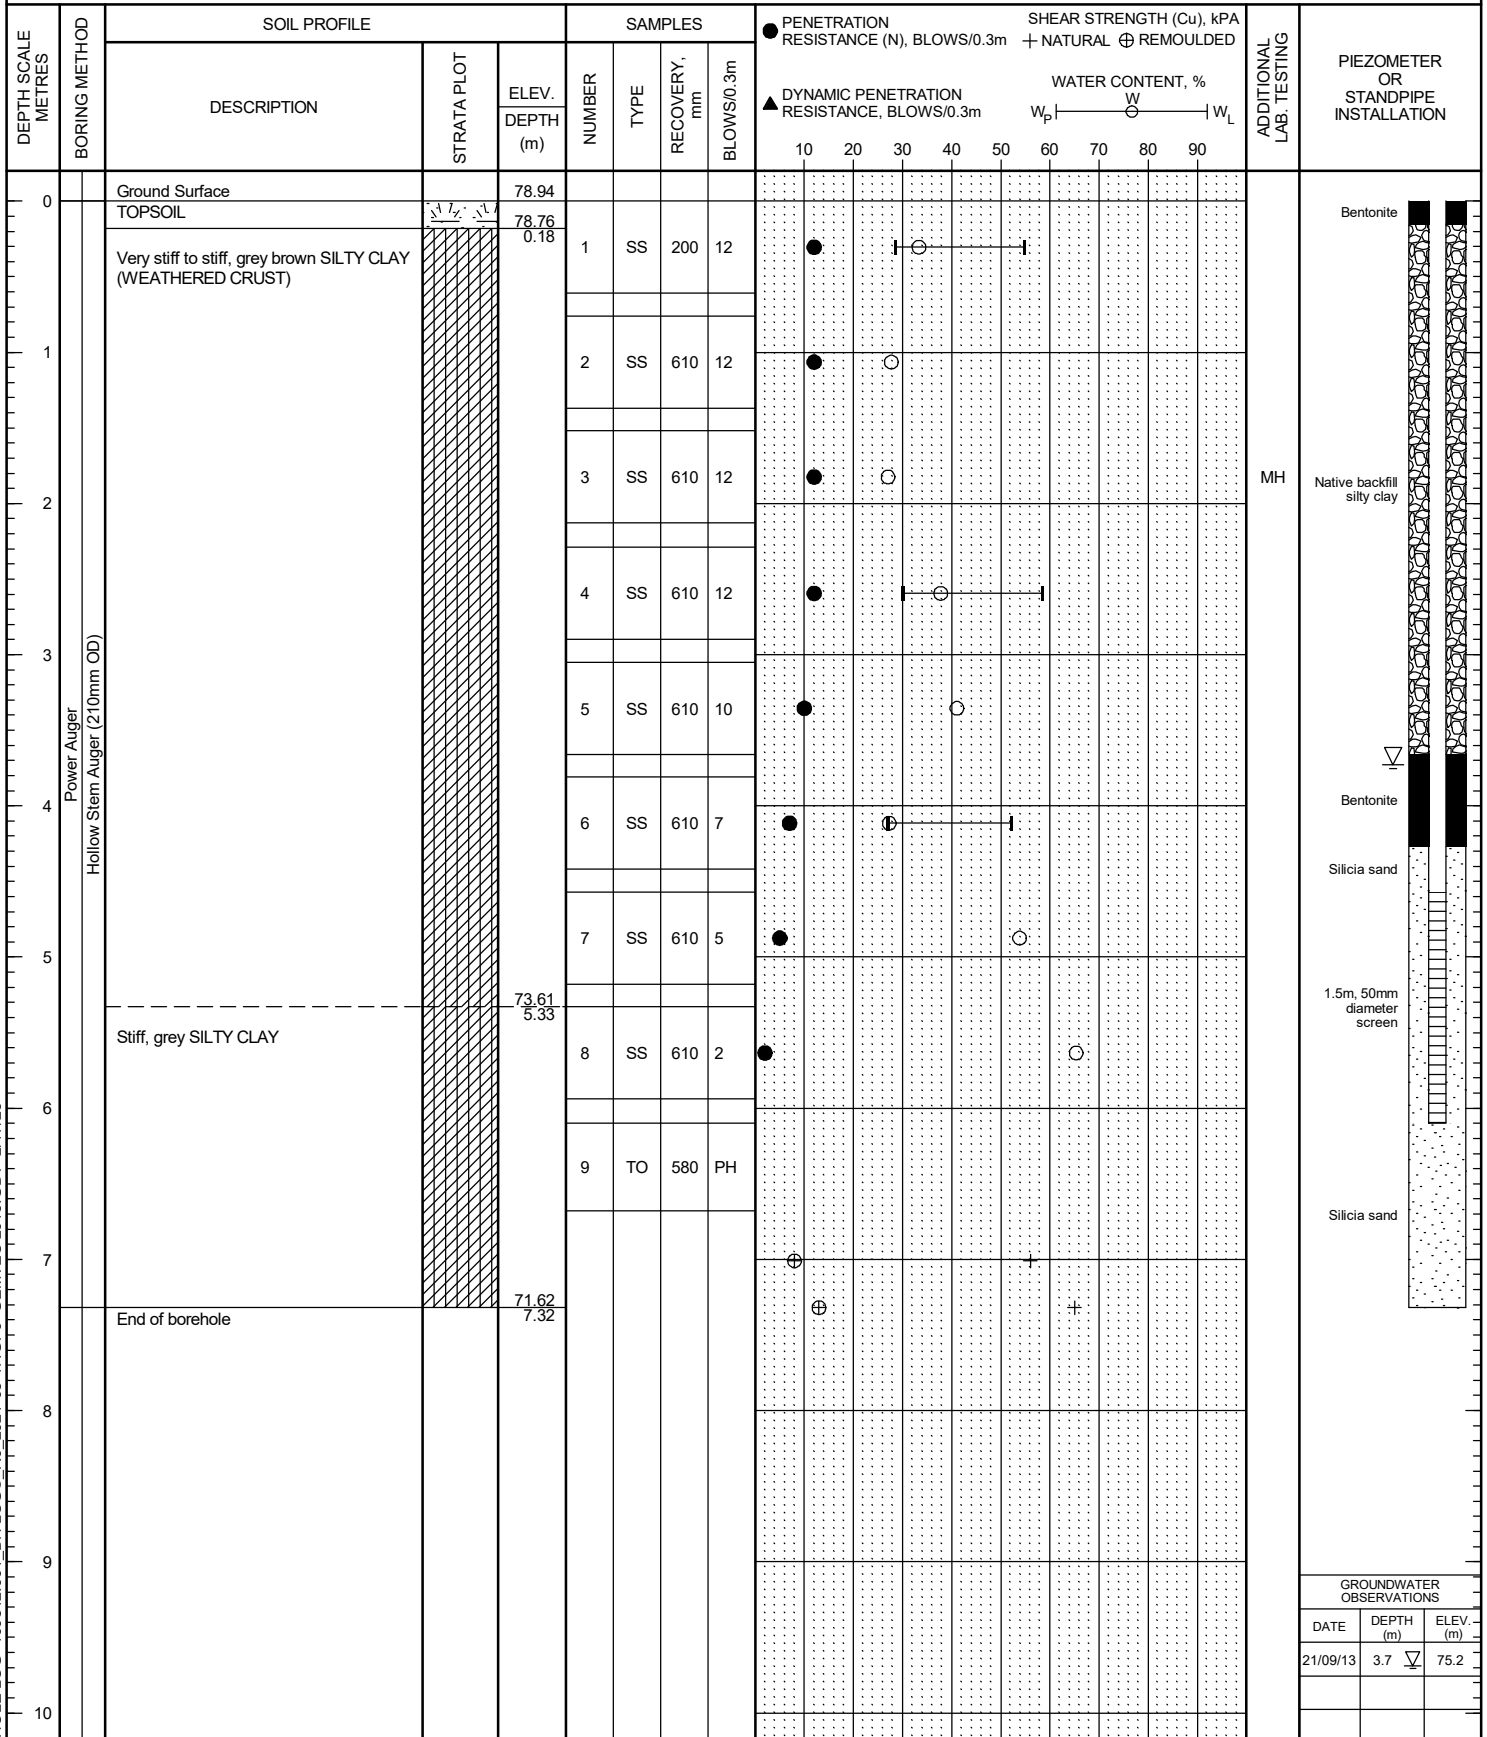

GEO - BOREHOLE LOG, 100812.001, BH LOGS, R0, 2021-08-17, GPJ, GEMTEC 2018, GDT, 2/17/23


| GROUNDWATER OBSERVATIONS |           |           |
|--------------------------|-----------|-----------|
| DATE                     | DEPTH (m) | ELEV. (m) |
| 21/09/13                 | 3.7       | 75.2      |
|                          |           |           |
|                          |           |           |

# RECORD OF BOREHOLE 21-02A

CLIENT: Hierarchy Development & Design Inc.  
 PROJECT: Geotechnical Investigation, Proposed Lot Severances, 830 Smith Road, Ottawa, Ontario  
 JOB#: 100812.001  
 LOCATION: See Site Plan, Figure 1

SHEET: 1 OF 1  
 DATUM: CGVD28  
 BORING DATE: Aug 12 2021

| DEPTH SCALE METRES | BORING METHOD                               | SOIL PROFILE   |             | SAMPLES         |        |      |              | PENETRATION RESISTANCE (N), BLOWS/0.3m |  | SHEAR STRENGTH (Cu), kPA |                       | ADDITIONAL LAB. TESTING | PIEZOMETER OR STANDPIPE INSTALLATION |                                 |  |
|--------------------|---|--|-------------|-----------------|--------|------|--------------|--|--|--------------------------|-----------------------|-------------------------|--------------------------------------|---------------------------------|--|
|                    |   | DESCRIPTION  | STRATA PLOT | ELEV. DEPTH (m) | NUMBER | TYPE | RECOVERY, mm | BLOWS/0.3m                             | ▲ DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m | ●                        | ⊕ NATURAL ⊕ REMOULDED |                         |                                      | WATER CONTENT, %<br>Wp   W   Wl |  |
| 0                  | Power Auger<br>Hollow Stem Auger (210mm OD) | Ground Surface   |             | 80.95           |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
|                    |   | TOPSOIL  |             | 80.82           |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
|                    |   | Very loose to loose, brown SILTY SAND                        |             | 0.13            | 1      | SS   | 560          | 4                                      | ●  |                          |                       |                         |                                      |                                 |  |
|                    |   | Very stiff to stiff, grey brown SILTY CLAY (WEATHERED CRUST) |             | 0.28            |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
| 1                  |   |  |             |                 | 2      | SS   | 610          | 8                                      | ●  |                          |                       |                         |                                      |                                 |  |
| 2                  |   |  |             |                 | 3      | SS   | 610          | 6                                      | ●  |                          |                       |                         |                                      |                                 |  |
| 3                  |   |  |             |                 | 4      | SS   | 610          | 4                                      | ●  |                          |                       |                         |                                      |                                 |  |
|                    |   | Firm grey SILTY CLAY to CLAYEY SILT                          |             | 77.90<br>3.05   |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
| 4                  |   |  |             |                 | 5      | SS   | 610          | 2                                      | ●  |                          |                       |                         |                                      |                                 |  |
| 5                  |   |  |             |                 | 6      | SS   | 610          | WH                                     |  |                          |                       |                         |                                      |                                 |  |
| 6                  | 7   |  |             |                 | SS     | 610  | WH           |  |  |                          |                       |                         |                                      |                                 |  |
| 7                  | 8   |  |             |                 | SS     | 560  | WH           |  |  |                          |                       |                         |                                      |                                 |  |
| 8                  |   |  |             |                 |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
| 9                  |   |  |             |                 |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
| 10                 |   |  |             |                 |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |
|                    |   | End of borehole<br>Auger refusal                             |             | 72.77<br>8.18   |        |      |              |  |  |                          |                       |                         |                                      |                                 |  |

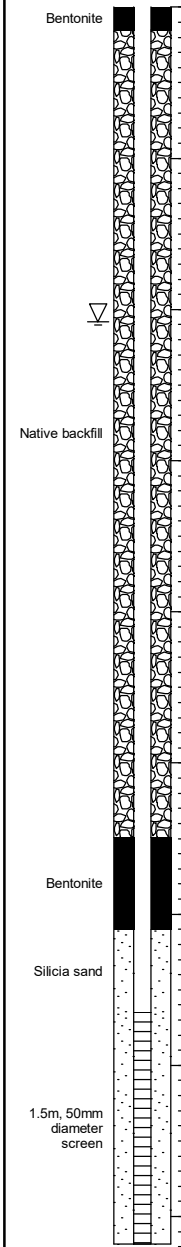

| GROUNDWATER OBSERVATIONS |           |           |
|--------------------------|-----------|-----------|
| DATE                     | DEPTH (m) | ELEV. (m) |
| 21/09/13                 | 2.1       | 78.9      |
|                          |           |           |
|                          |           |           |

GEO - BOREHOLE LOG - 100812.001 - BH LOGS - R0 - 2021-08-17 - GPJ - GEMTEC 2018.GDT - 2/17/23







LOGGED: A.N.  
 CHECKED: W.A.M.


# RECORD OF BOREHOLE 21-02B

CLIENT: Hierarchy Development & Design Inc.  
 PROJECT: Geotechnical Investigation, Proposed Lot Severances, 830 Smith Road, Ottawa, Ontario  
 JOB#: 100812.001  
 LOCATION: See Site Plan, Figure 1

SHEET: 1 OF 1  
 DATUM: CGVD28  
 BORING DATE: Aug 12 2021

| DEPTH SCALE METRES | BORING METHOD                               | SOIL PROFILE   |  |               | SAMPLES |      |              |            | PENETRATION RESISTANCE (N), BLOWS/0.3m     |    | SHEAR STRENGTH (Cu), kPA |    | ADDITIONAL LAB. TESTING | PIEZOMETER OR STANDPIPE INSTALLATION |
|--------------------|---|--|--|---------------|---------|------|--------------|------------|--|----|--------------------------|----|-------------------------|--------------------------------------|
|                    |   | DESCRIPTION  | STRATA PLOT  | ELEV.         | NUMBER  | TYPE | RECOVERY, mm | BLOWS/0.3m | DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m |    | WATER CONTENT, %         |    |                         |                                      |
|                    |   |  |  | DEPTH (m)     |         |      |              |            | 10   | 20 | 30                       | 40 |                         |                                      |
| 0                  | Power Auger<br>Hollow Stem Auger (210mm OD) | Ground Surface   |  | 80.95         |         |      |              |            |  |    |                          |    |                         |                                      |
|                    |   | TOPSOIL  |   | 80.82         |         |      |              |            |  |    |                          |    |                         |                                      |
|                    |   | Very loose to loose, brown SILTY SAND                                    |   | 80.43<br>0.28 |         |      |              |            |  |    |                          |    |                         |                                      |
| 1                  |   | Very stiff to stiff, grey brown silty clay (WEATHERED CRUST)             |   |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 2                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 3                  |   | Firm grey SILTY CLAY   |  | 77.90<br>3.05 |         |      |              |            |  |    |                          |    |                         |                                      |
| 4                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 5                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 6                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 7                  |   | End of borehole<br>Note: Soil stratigraphy inferred from Borehole 21-02A |  | 74.30<br>6.65 | 1       | TO   | 550          | PH         |  |    |                          |    |                         |                                      |
| 8                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 9                  |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |
| 10                 |   |  |  |               |         |      |              |            |  |    |                          |    |                         |                                      |

Backfilled with auger cuttings



GEO - BOREHOLE LOG, 100812.001, BH LOGS, R0, 2021-08-17, GPJ, GEMTEC 2018, GDT, 2/17/23




# RECORD OF BOREHOLE 21-03

CLIENT: Hierarchy Development & Design Inc.  
 PROJECT: Geotechnical Investigation, Proposed Lot Severances, 830 Smith Road, Ottawa, Ontario  
 JOB#: 100812.001  
 LOCATION: See Site Plan, Figure 1

SHEET: 1 OF 1  
 DATUM: CGVD28  
 BORING DATE: Aug 12 2021

| DEPTH SCALE METRES | BORING METHOD                               | SOIL PROFILE   |             |                 | SAMPLES |      |              |            | PENETRATION RESISTANCE (N), BLOWS/0.3m     |  | SHEAR STRENGTH (Cu), kPA |                | ADDITIONAL LAB. TESTING | PIEZOMETER OR STANDPIPE INSTALLATION |  |
|--------------------|---|--|-------------|-----------------|---------|------|--------------|------------|--|--|--------------------------|----------------|-------------------------|--------------------------------------|--|
|                    |   | DESCRIPTION  | STRATA PLOT | ELEV. DEPTH (m) | NUMBER  | TYPE | RECOVERY, mm | BLOWS/0.3m | DYNAMIC PENETRATION RESISTANCE, BLOWS/0.3m |  | WATER CONTENT, %         |                |                         |                                      |  |
|                    |   |  |             |                 |         |      |              |            |  |  |                          | W <sub>p</sub> | W                       | W <sub>L</sub>                       |  |
| 0                  | Power Auger<br>Hollow Stem Auger (210mm OD) | Ground Surface   |             | 80.08           |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   | TOPSOIL  |             | 79.90           |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   | Very stiff to stiff, grey brown SILTY CLAY (WEATHERED CRUST)                               |             | 0.18            | 1       | SS   | 400          | 14         |  |  |                          |                |                         |                                      |  |
| 1                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 2                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 3                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 4                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
|                    |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 5                  |   | Stiff to firm, grey SILTY CLAY   |             | 75.20<br>4.88   | 7       | SS   | 610          | 2          |  |  |                          |                |                         |                                      |  |
|                    |   | Compact, grey SILTY SAND, some gravel, some clay, with cobbles and boulders (GLACIAL TILL) |             | 74.75<br>5.33   | 8       | SS   | 225          | 28         |  |  |                          |                |                         |                                      |  |
| 6                  |   | End of borehole  |             | 73.98<br>6.10   |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 7                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 8                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 9                  |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |
| 10                 |   |  |             |                 |         |      |              |            |  |  |                          |                |                         |                                      |  |

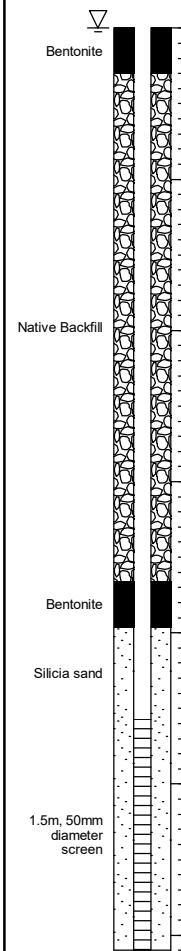


| GROUNDWATER OBSERVATIONS |           |           |
|--------------------------|-----------|-----------|
| DATE                     | DEPTH (m) | ELEV. (m) |
| 21/09/13                 | 0.0       | ▽ 80.1    |
|                          |           |           |
|                          |           |           |

GEO - BOREHOLE LOG, 100812.001, BH LOGS, R0, 2021-08-17, GPJ, GEMTEC 2018, GDT, 2/17/23



## **APPENDIX C**

### Grain Size Curves

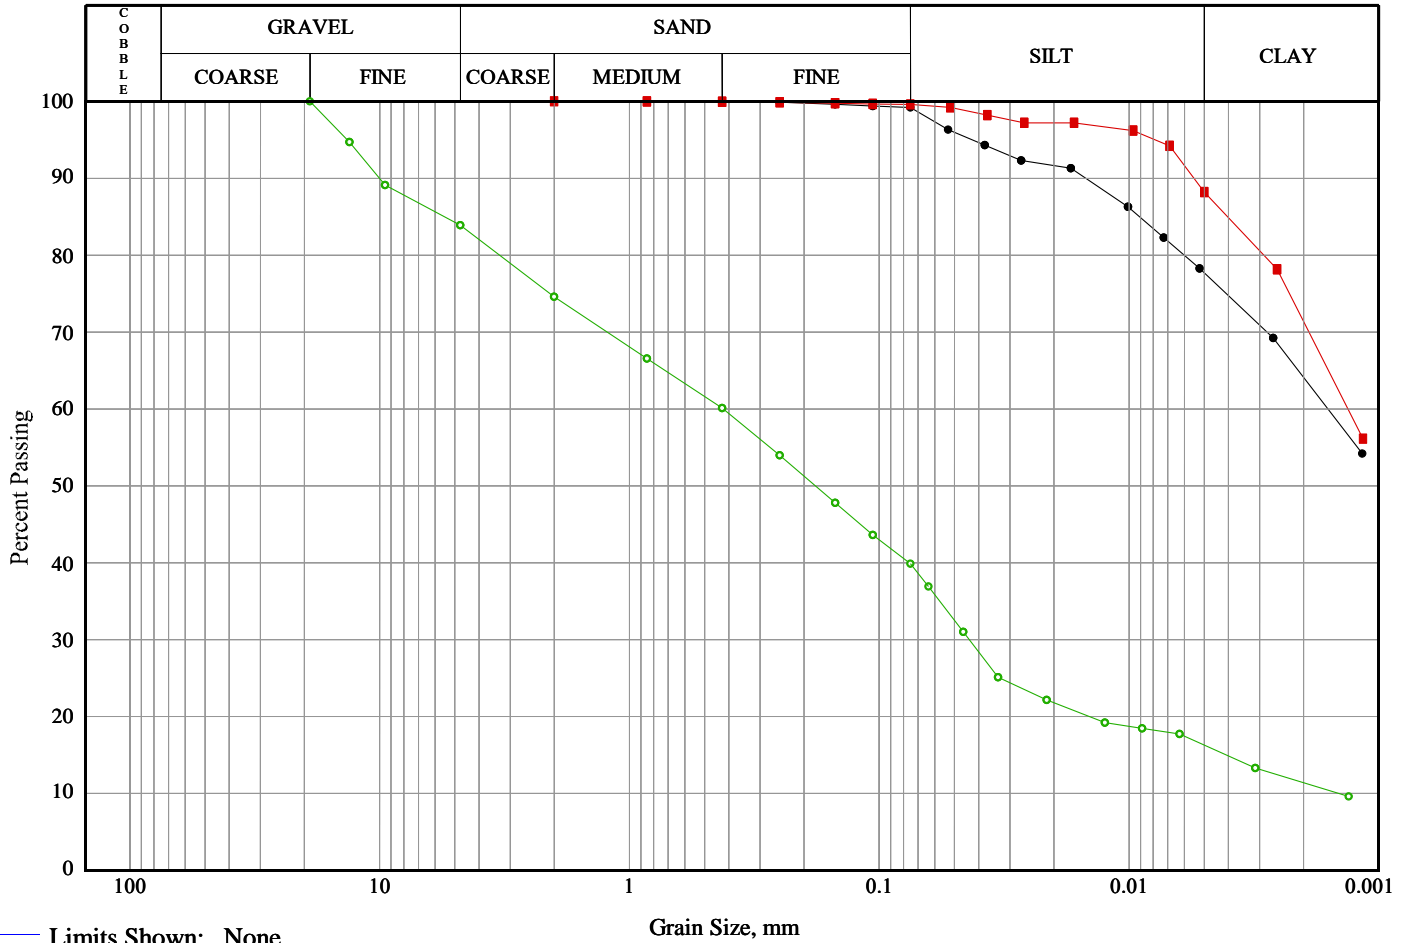

| Line Symbol | Sample                      | Borehole/ Test Pit | Sample Number | Depth     | % Cob.+ Gravel | % Sand | % Silt | % Clay |
|-------------|-----------------------------|--------------------|---------------|-----------|----------------|--------|--------|--------|
| —●—         | SILT CLAY (WEATHERED CRUST) | 21-01              | SA 3          | 1.52-2.13 | 0.0            | 0.8    | 21.5   | 77.7   |
| —■—         | SILTY CLAY                  | 21-02A             | SA 7          | 6.09-6.71 | 0.0            | 0.4    | 11.4   | 88.2   |
| —○—         | GLACIAL TILL                | 21-03              | SA 8          | 5.33-5.94 | 16.1           | 44.0   | 23.6   | 16.3   |

| Line Symbol | CanFEM Classification               | USCS Symbol | D <sub>10</sub> | D <sub>15</sub> | D <sub>30</sub> | D <sub>50</sub> | D <sub>60</sub> | D <sub>85</sub> | % 5-75µm |
|-------------|-------------------------------------|-------------|-----------------|-----------------|-----------------|-----------------|-----------------|-----------------|----------|
| —●—         | Silty clay , trace sand             | N/A         | ---             | ---             | ---             | ---             | 0.00            | 0.01            | 20.9     |
| —■—         | Clay , some silt , trace sand       | N/A         | ---             | ---             | ---             | ---             | 0.00            | 0.00            | 11.4     |
| —○—         | Silty sand , some gravel, some clay | N/A         | 0.00            | 0.00            | 0.04            | 0.18            | 0.42            | 5.51            | 23.6     |




## **APPENDIX D**

### Hydraulic Conductivity Testing


# Slug Test Results

**FIGURE D1**

Monitoring Well 21-1 Falling Head (FH) Test

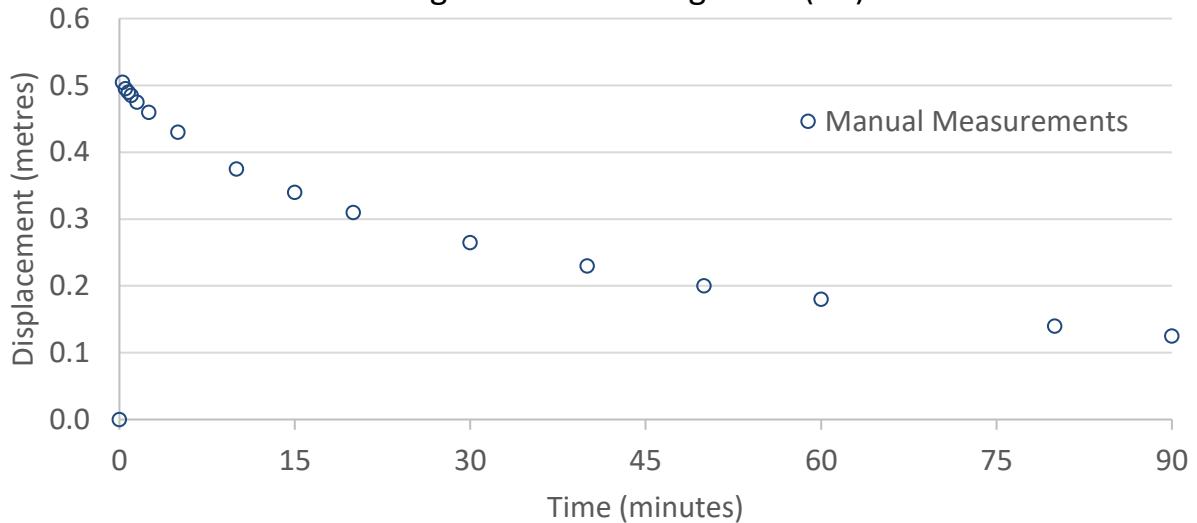

Monitoring Well 21-1 FH: Hvorslev Analysis

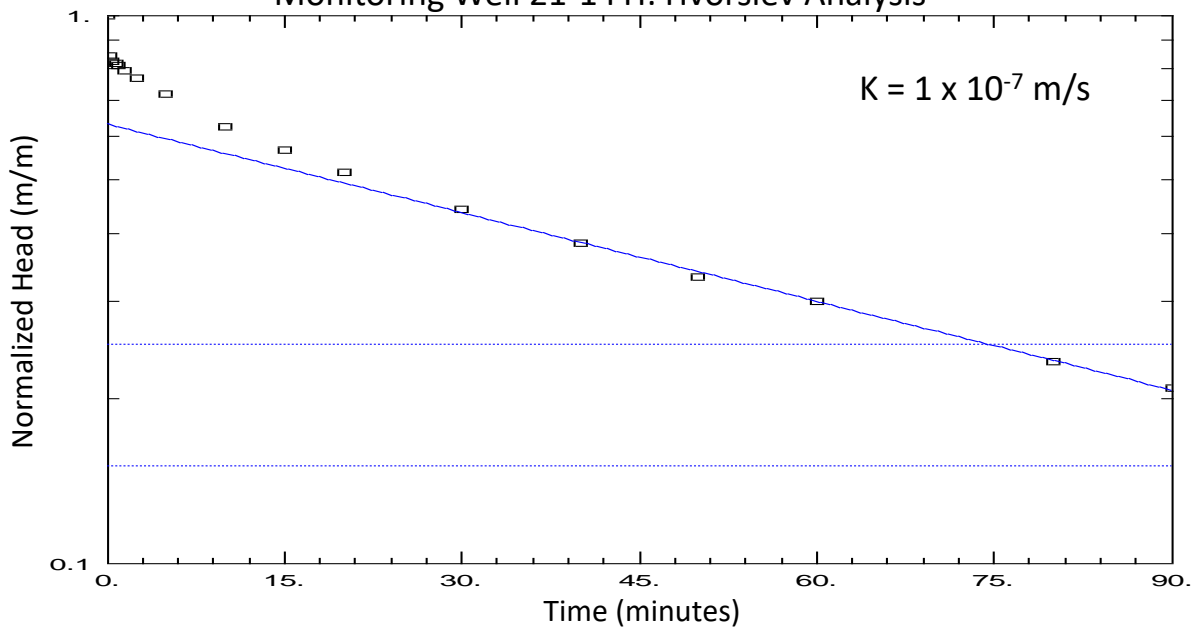

Well Data:

Displacement observed (slug size): 0.51 metres (0.60 m)  
 Well Depth: 7.32 metres  
 Screen Length: 3.05 metres  
 Well Radius: 0.0255 metres

Aquifer Data

Saturated Thickness: 3.59 metres  
 Anisotropy Ratio ( $K_z/K_r$ ): 0.1  
 Aquifer Model: Unconfined, Hvorslev  
 Static Water Level: 3.73 metres bgs



**GEMTEC**  
 CONSULTING ENGINEERS  
 AND SCIENTISTS


Date: Jan. 31, 2023

Project: 100812.001


# Slug Test Results

**FIGURE D2**

Monitoring Well 21-2A Falling Head (FH) Test

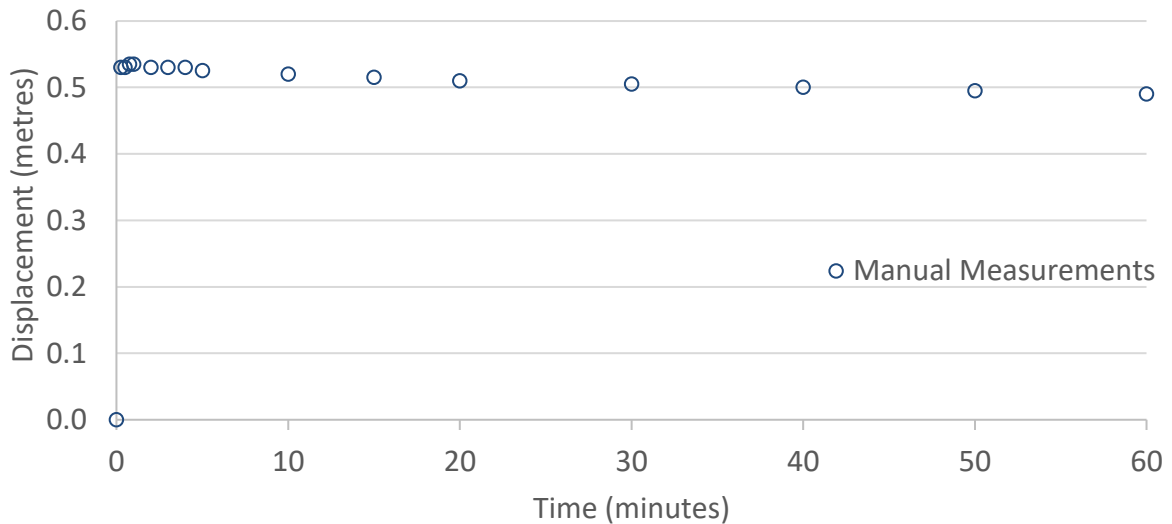

Monitoring Well 21-2A FH: Hvorslev Analysis

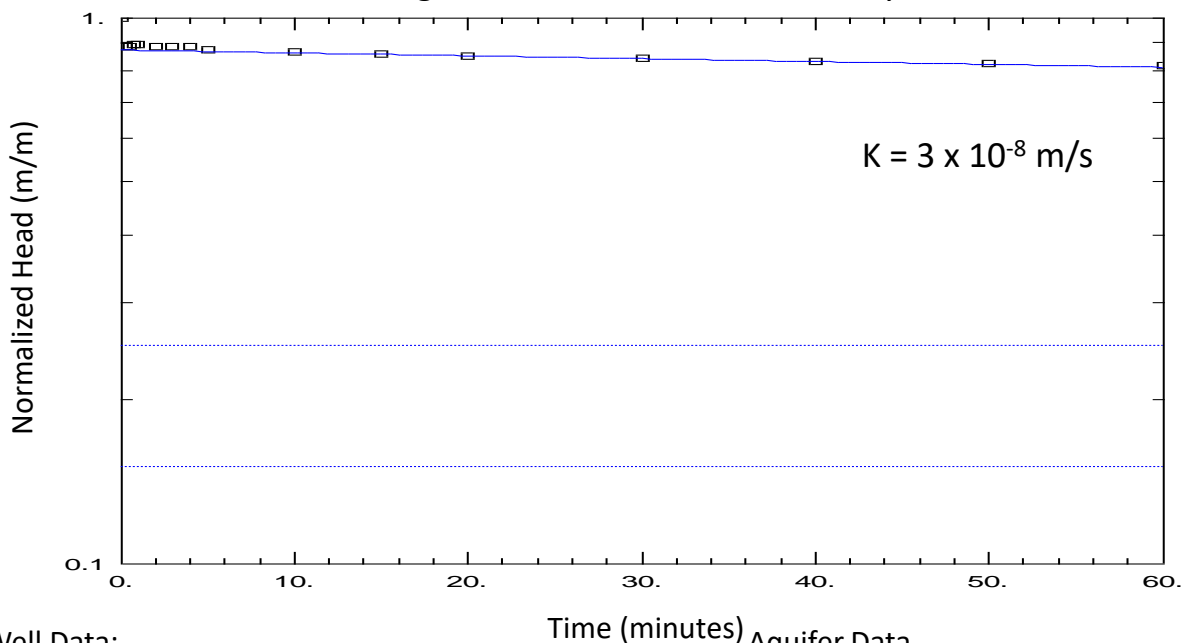

Well Data:

Displacement observed (slug size): 0.53 metres (0.60 m)  
 Well Depth: 8.18 metres  
 Screen Length: 1.52 metres  
 Well Radius: 0.0255 metres

Time (minutes)

Aquifer Data

Saturated Thickness: 6.10 metres  
 Anisotropy Ratio ( $K_z/K_r$ ): 0.1  
 Aquifer Model: Unconfined, Hvorslev  
 Static Water Level: 2.08 metres bgs



**GEMTEC**

CONSULTING ENGINEERS  
AND SCIENTISTS

Date: Jan. 31, 2023

Project: 100812.001



## **APPENDIX E**

### MECP Water Well Records

**MECP Water Well Record Compilation  
(930 Smith Road- 500 m search radius)**

| WELL ID | Completed  | Depth (m) | Depth to Bedrock (m) | Static Water Level (m bgs) | Water Found (m bgs) | Water Detail | Well Use |
|---------|------------|-----------|----------------------|----------------------------|---------------------|--------------|----------|
| 1511160 | 3/4/1971   | 29        | 20.1                 | 7.9                        | 29                  | FR           | DO       |
| 1511703 | 12/7/1971  | 19.8      | 17.7                 | 8.5                        | 19.8                | FR           | DO       |
| 1511704 | 10/28/1971 | 20.4      | 18.3                 | 8.2                        | 20.4                | FR           | DO       |
| 1511705 | 10/26/1971 | 20.4      | 18.3                 | 8.2                        | 20.4                | FR           | DO       |
| 1511706 | 10/6/1971  | 18.6      | 16.8                 | 8.2                        | 18.6                | UK           | DO       |
| 1512324 | 5/17/1972  | 24.4      | 20.4                 | 6.1                        | 24.4                | FR           | DO       |
| 1512338 | 5/9/1972   | 20.4      | 18.3                 | 6.1                        | 18.3                | FR           | DO       |
| 1512340 | 5/3/1972   | 21.3      | 18.3                 | 6.1                        | 19.8                | FR           | DO       |
| 1512345 | 10/17/1972 | 20.1      | 19.8                 | 6.1                        | 20.1                | FR           | DO       |
| 1512410 | 11/15/1972 | 20.7      | 19.2                 | 6.1                        | 20.7                | FR           | DO       |
| 1512423 | 2/11/1972  | 21.3      | 20.1                 | 7.6                        | 21.3                | UK           | DO       |
| 1512424 | 12/19/1972 | 18        | 16.8                 | 6.1                        | 18                  | FR           | DO       |
| 1512425 | 12/12/1972 | 19.8      | 19.2                 | 6.1                        | 19.8                | FR           | DO       |
| 1512426 | 12/14/1972 | 20.4      | -                    | 6.1                        | 20.4                | FR           | DO       |
| 1512427 | 11/1/1972  | 21.3      | 18                   | 7.6                        | 21.3                | FR           | DO       |
| 1512428 | 10/26/1972 | 21.3      | 18.9                 | 6.1                        | 21.3                | FR           | DO       |
| 1512429 | 7/19/1972  | 18.9      | 18.3                 | 7.6                        | 18.9                | FR           | DO       |
| 1512430 | 2/10/1972  | 22.9      | 20.7                 | 7.6                        | 21.3                | UK           | DO       |
| 1512431 | 2/7/1972   | 22.9      | 20.4                 | 7.6                        | 22.9                | FR           | DO       |
| 1512432 | 10/20/1972 | 20.7      | 20.1                 | 6.1                        | 20.7                | FR           | DO       |
| 1512433 | 7/20/1972  | 18.6      | 18.3                 | 7.6                        | 18.3                | FR           | DO       |
| 1512793 | 4/5/1965   | 26.5      | 25.9                 | 4.6                        | 26.5                | FR           | DO       |
| 1512794 | 9/2/1965   | 28.3      | 12.2                 | 0.9                        | 28.3                | FR           | DO       |
| 1512795 | 8/27/1968  | 18.3      | -                    | 9.4                        | 18.3                | FR           | DO       |
| 1514500 | 3/29/1974  | 13.7      | 12.2                 | 0.9                        | 13.7                | FR           | DO       |
| 1515205 | 7/17/1975  | 15.8      | 14.6                 | 2.4                        | 15.8                | FR           | DO       |
| 1515221 | 11/24/1975 | 15.8      | 13.7                 | 0.3                        | 15.8                | FR           | DO       |
| 1515471 | 3/18/1976  | 21.9      | 17.4                 | 7.3                        | 21.9                | FR           | DO       |
| 1517593 | 8/18/1981  | 16.8      | -                    | 10.4                       | 16.5                | FR           | DO       |
| 1517830 | 6/10/1982  | 26.2      | 25.6                 | 19.8                       | 25.9                | FR           | DO       |
| 1517832 | 6/30/1982  | 24.1      | -                    | 11.9                       | -                   | #N/A         | DO       |
| 1517833 | 7/2/1982   | 21.9      | -                    | 8.8                        | 21.9                | FR           | DO       |
| 1517916 | 8/13/1982  | 25        | -                    | 10.7                       | 25                  | FR           | DO       |
| 1518048 | 10/27/1982 | 22.9      | -                    | 7.6                        | 22.9                | FR           | DO       |
| 1518052 | 10/27/1982 | 25.9      | -                    | 12.2                       | 25.9                | FR           | DO       |
| 1518054 | 10/21/1982 | 26.8      | -                    | 16.8                       | 26.8                | FR           | DO       |
| 1519284 | 8/7/1984   | 19.5      | 17.4                 | 8.5                        | 19.2                | SU           | DO       |
| 1519631 | 10/14/1980 | 22.6      | 19.8                 | 6.7                        | 21.6                | SU           | DO       |
| 1519988 | 12/12/1984 | 24.4      | 23.8                 | 10.7                       | 23.8                | FR           | DO       |
| 1522522 | 6/30/1988  | 22.6      | -                    | 9.8                        | 22.6                | SU           | DO       |
| 1522998 | 10/27/1988 | 15.2      | -                    | 7.6                        | 15.2                | FR           | DO       |
| 1524312 | 1/23/1990  | 29.3      | 19.2                 | 8.5                        | 27.4                | FR           | DO       |
| 1525585 | 8/1/1991   | 30.5      | 22.9                 | 7.6                        | 29.6                | FR           | DO       |
| 1525782 | 8/19/1991  | 29.9      | 19.5                 | 13.7                       | 20.4                | FR           | DO       |
| 1526061 | 11/28/1991 | 22.9      | 22.3                 | 8.5                        | 22.9                | SU           | DO       |
| 1527019 | 11/20/1992 | 21.9      | 21.9                 | 10.7                       | 21.9                | SU           | DO       |
| 1527222 | 7/8/1993   | 18.3      | 18.3                 | 9.1                        | 16.5                | UK           | DO       |
| 1528725 | 3/17/1995  | 29.6      | 29.6                 | 13.7                       | -                   | SU           | DO       |
| 1529701 | 10/2/1997  | 32        | 32                   | 13.7                       | 21.6                | SU           | DO       |
| 1529702 | 9/25/1997  | 61.6      | 61.6                 | 12.2                       | 39.6, 53.3          | FR           | DO       |
| 1534079 | 8/21/2003  | 37.5      | 37.5                 | 12.2                       | 34.4, 35.1          | UK           | DO       |
| 1536075 | 11/7/2005  | 22.7      | 22.7                 | 10.1                       | 18.9                | FR           | DO       |
| 7294262 | 8/31/2017  | -         | -                    | -                          | -                   | -            | -        |
| 7311540 | 5/17/2018  | -         | -                    | -                          | -                   | -            | -        |
| 7363368 | 7/10/2020  | -         | -                    | -                          | -                   | -            | -        |

<https://www.ontario.ca/page/map-well-records>

**LEGEND**

|                   |                 |
|-------------------|-----------------|
| -                 | Not Available   |
| <b>"Well Use"</b> |                 |
| DO                | Domestic        |
| ST                | Livestock       |
| IR                | Irrigation      |
| IN                | Industrial      |
| CO                | Commercial      |
| MN                | Municipal       |
| PS                | Public          |
| AC                | Cooling and A/C |
| NU                | Not Used        |
| OT                | Other           |
| TH                | Test Hole       |
| DE                | Dewatering      |
| MO                | Monitoring      |
| MT                | Monitoring Test |

**"Water Detail"**

|    |
|----|
| FR |
| SA |
| SU |
| MN |
| UK |
| GS |
| IR |





**PRIVATE WELL RECORDS**



We Tag#: A313191 nt Below) A313191

Measurements recorded in: Metric Imperial

Page of

Well Owner's Information

First Name: John Boisvert, Last Name/Organization: John Boisvert, E-mail Address: [blank], Well Constructed by Well Owner: [checked]

Mailing Address (Street Number/Name): 1836 Maple Grove Road, Municipality: Stittsville, Province: ON, Postal Code: K2S 0M7, Telephone No. (inc. area code): [blank]

Well Location: Address of Well Location (Street Number/Name): 865 Meteor Ave, Township: Cumberland, Lot: 10, Concession: 9, County/District/Municipality: Ottawa Carleton, City/Town/Village: Navan, Province: Ontario, Postal Code: [blank]

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m) From, Depth (m) To. Rows include Clay, Gravel, Limestone, etc. Includes handwritten note: \*H/O - JASON MOORE\*

Annular Space table with columns: Depth Set at (m) From, Depth Set at (m) To, Type of Sealant Used (Material and Type), Volume Placed (m³). Rows include Neat cement and Bentonite slurry.

Method of Construction and Well Use checkboxes. Includes handwritten note: SURGED.

Construction Record - Casing table with columns: Inside Diameter (cm), Open Hole OR Material, Wall Thickness (cm), Depth (m) From, Depth (m) To. Rows include Steel and Open Hole.


Construction Record - Screen table with columns: Outside Diameter (cm), Material, Slot No., Depth (m) From, Depth (m) To.

Water Details and Hole Diameter tables. Water found at Depth: 394 m, 0 m, 64 m. Hole Diameter: 93.4 cm, 64 cm.

Well Contractor and Well Technician Information: Business Name of Well Contractor: Air Rock Drilling Co. Ltd., Well Contractor's Licence No.: 7881, Business Address: 8659 Franktown Road, Municipality: Richmond.

Province: ON, Postal Code: K0A 2Z0, Business E-mail Address: air-rock@sympatico.ca, Bus. Telephone No.: 6138382170, Name of Well Technician: Hanna, Jeremy, Well Technician's Licence No.: 13632, Date Submitted: 2021 01 31.

Results of Well Yield Testing table with columns: Draw Down, Recovery, Time (min), Water Level (m), Time (min), Water Level (m). Includes handwritten notes: Not tested, 28.8', 300, 10, 4 hrs + 0 min, 65', 250', 10.

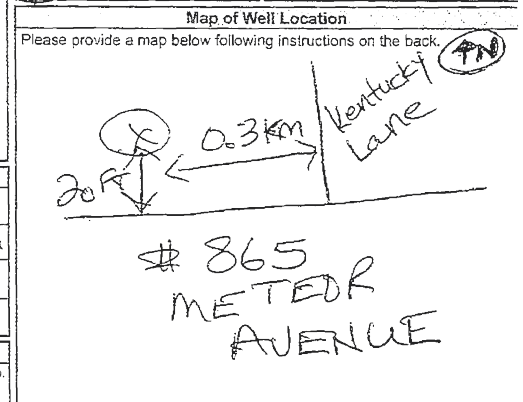

Comments: 1 HP @ 10 GPM set at 250 Feet. Well owner's information package delivered: 2021 01 07, Date Work Completed: 2021 01 04, Ministry Use Only: Audit No. 2355241, Received.



# WATER WELL RECORD

1511704

Water management in Ontario 1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1511704  
5601513

MUNICIP.

15011

CON.

abn

09

|                                       |   |  |                   |
|---------------------------------------|---|--|-------------------|
| COUNTY OR DISTRICT<br><b>Carleton</b> | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE<br><b>Cumberland</b> | CON., BLOCK, TRACT, SURVEY, ETC.<br><b>9</b> | LOT<br><b>010</b> |
|---------------------------------------|---|--|-------------------|

DATE COMPLETED 48-53  
DAY **28** MO. **10** YR. **71**

[Redacted] **Orleans, Ont.**

|                    |                |                |                   |                |                 |
|--------------------|----------------|----------------|-------------------|----------------|-----------------|
| 10<br><b>29250</b> | 11<br><b>4</b> | 12<br><b>4</b> | 13<br><b>0268</b> | 14<br><b>4</b> | 15<br><b>25</b> |
|--------------------|----------------|----------------|-------------------|----------------|-----------------|

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |    |
|----------------|----------------------|-----------------|---------------------|--------------|----|
|                |                      |                 |                     | FROM         | TO |
| blue           | clay                 |                 |                     | 0            | 55 |
| grey           | quick sand           |                 |                     | 55           | 60 |
| brown slate    |                      |                 |                     | 60           | 67 |

|    |    |    |    |    |    |    |    |    |    |
|----|----|----|----|----|----|----|----|----|----|
| 31 | 32 | 33 | 34 | 35 | 36 | 37 | 38 | 39 | 40 |
|----|----|----|----|----|----|----|----|----|----|

#### 41 WATER RECORD

| WATER FOUND AT - FEET | KIND OF WATER                               |                                  |                                    |                                    |
|-----------------------|---|----------------------------------|------------------------------------|------------------------------------|
| 0067                  | 1 <input checked="" type="checkbox"/> FRESH | 2 <input type="checkbox"/> SALTY | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |
| 15-18                 | 1 <input type="checkbox"/> FRESH            | 2 <input type="checkbox"/> SALTY | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |
| 20-23                 | 1 <input type="checkbox"/> FRESH            | 2 <input type="checkbox"/> SALTY | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |
| 25-28                 | 1 <input type="checkbox"/> FRESH            | 2 <input type="checkbox"/> SALTY | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |
| 30-33                 | 1 <input type="checkbox"/> FRESH            | 2 <input type="checkbox"/> SALTY | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |

#### 51 CASING & OPEN HOLE RECORD

| INSIDE DIAM. INCHES | MATERIAL                                    | WALL THICKNESS INCHES | DEPTH - FEET |       |
|---------------------|---|-----------------------|--------------|-------|
|                     |   |                       | FROM         | TO    |
| 06                  | 1 <input checked="" type="checkbox"/> STEEL | 250                   | 0            | 0062  |
| 17-18               | 1 <input type="checkbox"/> STEEL            |                       |              | 20-23 |
| 24-25               | 1 <input type="checkbox"/> STEEL            |                       |              | 27-30 |

#### 52 SCREEN RECORD


|                               |                        |              |       |
|-------------------------------|------------------------|--------------|-------|
| SIZE(S) OF OPENING (SLOT NO.) | 31-33 DIAMETER         | 34-38 LENGTH | 39-40 |
|                               | INCHES                 | FEET         |       |
| MATERIAL AND TYPE             | DEPTH TO TOP OF SCREEN |              |       |
|                               | INCHES                 | FEET         |       |

#### 61 PLUGGING & SEALING RECORD

| DEPTH SET AT - FEET |       | MATERIAL AND TYPE (CEMENT GROUT, LEAD PACKER, ETC.) |
|---------------------|-------|---|
| FROM                | TO    |   |
| 10-13               | 14-17 |   |
| 18-21               | 22-25 |   |
| 26-29               | 30-33 |   |

#### 71 PUMPING TEST

|                                    |  |   |                                     |             |
|------------------------------------|--|---|-------------------------------------|-------------|
| PUMPING TEST METHOD                | 10 PUMPING RATE                              | 11-14 DURATION OF PUMPING                     | 15-16 HOURS                         | 17-18 MINS. |
| 1 <input type="checkbox"/> PUMP    | 2 <input checked="" type="checkbox"/> BAILER | 0008 GPM                                      | 02                                  | 00          |
| STATIC LEVEL                       | 25 WATER LEVELS DURING                       | 1 <input checked="" type="checkbox"/> PUMPING | 2 <input type="checkbox"/> RECOVERY |             |
| 19-21                              | 22-24  | 25-28   | 29-31                               | 32-34       |
| 027 FEET                           | 050 FEET                                     | 040 FEET                                      | 050 FEET                            | 050 FEET    |
| IF FLOWING, GIVE RATE              | 38-41 PUMP INTAKE SET AT                     | 42 WATER AT END OF TEST                       |                                     |             |
|                                    | 50 GPM                                       | 1 <input checked="" type="checkbox"/> CLEAR   | 2 <input type="checkbox"/> CLOUDY   |             |
| RECOMMENDED PUMP TYPE              | RECOMMENDED PUMP SETTING                     | 43-45 RECOMMENDED PUMPING FEET RATE           | 46-49                               |             |
| 1 <input type="checkbox"/> SHALLOW | 2 <input checked="" type="checkbox"/> DEEP   | 050   | 0006 GPM                            |             |
| 50-53                              | 200.3 GPM./FT. SPECIFIC CAPACITY             |   |                                     |             |

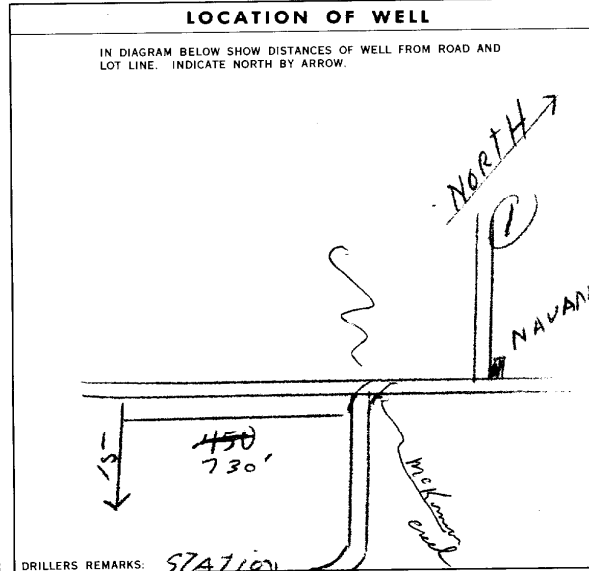

#### FINAL STATUS OF WELL

|  |   |
|--|---|
| 1 <input checked="" type="checkbox"/> WATER SUPPLY | 5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY |
| 2 <input type="checkbox"/> OBSERVATION WELL        | 6 <input type="checkbox"/> ABANDONED, POOR QUALITY        |
| 3 <input type="checkbox"/> TEST HOLE               | 7 <input type="checkbox"/> UNFINISHED                     |
| 4 <input type="checkbox"/> RECHARGE WELL           |   |

#### WATER USE

|  |  |
|--|--|
| 1 <input checked="" type="checkbox"/> DOMESTIC | 5 <input type="checkbox"/> COMMERCIAL                  |
| 2 <input type="checkbox"/> STOCK               | 6 <input type="checkbox"/> MUNICIPAL                   |
| 3 <input type="checkbox"/> IRRIGATION          | 7 <input type="checkbox"/> PUBLIC SUPPLY               |
| 4 <input type="checkbox"/> INDUSTRIAL          | 8 <input type="checkbox"/> COOLING OR AIR-CONDITIONING |
| 9 <input type="checkbox"/> OTHER               | 9 <input type="checkbox"/> NOT USED                    |

#### METHOD OF DRILLING

|  |                                    |
|--|------------------------------------|
| 1 <input checked="" type="checkbox"/> CABLE TOOL | 6 <input type="checkbox"/> BORING  |
| 2 <input type="checkbox"/> ROTARY (CONVENTIONAL) | 7 <input type="checkbox"/> DIAMOND |
| 3 <input type="checkbox"/> ROTARY (REVERSE)      | 8 <input type="checkbox"/> JETTING |
| 4 <input type="checkbox"/> ROTARY (AIR)          | 9 <input type="checkbox"/> DRIVING |
| 5 <input type="checkbox"/> AIR PERCUSSION        |                                    |

#### CONTRACTOR

|  |  |
|--|--|
| NAME OF WELL CONTRACTOR<br><b>G. Charbonneau, Diamond &amp; Cable Drilling, 1504</b> | LICENCE NUMBER   |
| ADDRESS<br><b>R. R. 2, Box 194, Orleans, Ont.</b>                                    |  |
| NAME OF DRILLER OR BORER<br><b>Leo Bourgeois</b>                                     | LICENCE NUMBER   |
| SIGNATURE OF CONTRACTOR<br><i>G. Charbonneau</i>                                     | SUBMISSION DATE<br>DAY <b>26</b> MO. <b>10</b> YR. <b>71</b> |


#### OFFICE USE ONLY

|                    |               |                     |       |
|--------------------|---------------|---------------------|-------|
| DATA SOURCE        | 58 CONTRACTOR | 59-62 DATE RECEIVED | 63-68 |
| 1                  | 1504          | 070472              |       |
| DATE OF INSPECTION | INSPECTOR     |                     |       |
|                    |               |                     |       |
| REMARKS:           |               |                     |       |
|                    |               |                     |       |

316/6e



1512793

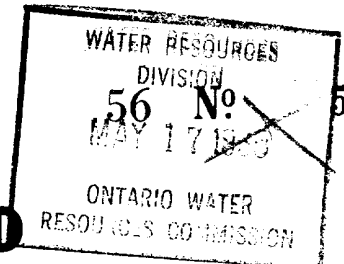

UTM 11B 2 4659210 E

15 R 50 2 9 3 4 2 N The Ontario Water Resources Commission Act

Elev. 5 R 98 8 2

# WATER WELL RECORD

Basin 2 S 1 Russell Township, Village, Town or City Twp. of Cumberland

Con. 9 Lot 10 Date completed April 5, 1965 (day month year)

Address Navan, Ont.

### Casing and Screen Record

Inside diameter of casing 5 1/4  
Total length of casing 85'  
Type of screen  
Length of screen  
Depth to top of screen  
Diameter of finished hole 5 1/4

### Pumping Test

Static level 15'  
Test-pumping rate 15 G.P.M.  
Pumping level 25'  
Duration of test pumping 3 hrs.  
Water clear or cloudy at end of test Clear  
Recommended pumping rate 6 G.P.M.  
with pump setting of 25' feet below ground surface

### Well Log

### Water Record

| Overburden and Bedrock Record | From ft. | To ft. | Depth(s) at which water(s) found | Kind of water (fresh, salty, sulphur) |
|-------------------------------|----------|--------|----------------------------------|---------------------------------------|
| Yellow sand                   | 0        | 2      |                                  |                                       |
| Blue clay                     | 2        | 40     |                                  |                                       |
| Boulder & sand                | 40       | 85     |                                  |                                       |
| Brown slate                   | 85       | 87     | 87                               | Fresh                                 |

For what purpose(s) is the water to be used? Domestic

Is well on upland, in valley, or on hillside? Upland

Drilling or Boring Firm G. Charbonneau, Diamond & Cable Drilling,

Address RR #1, Box 194, Orleans, Ont.

Licence Number 1331

Name of Driller or Borer Bruck Stacey

Address RR #1, Jasper, Ont.


Date April 5, 1965

*Gérard Charbonneau*  
(Signature of Licensed Drilling or Boring Contractor)

Form 7 15M-60-4138

### Location of Well

In diagram below show distances of well from road and lot line. Indicate north by arrow.

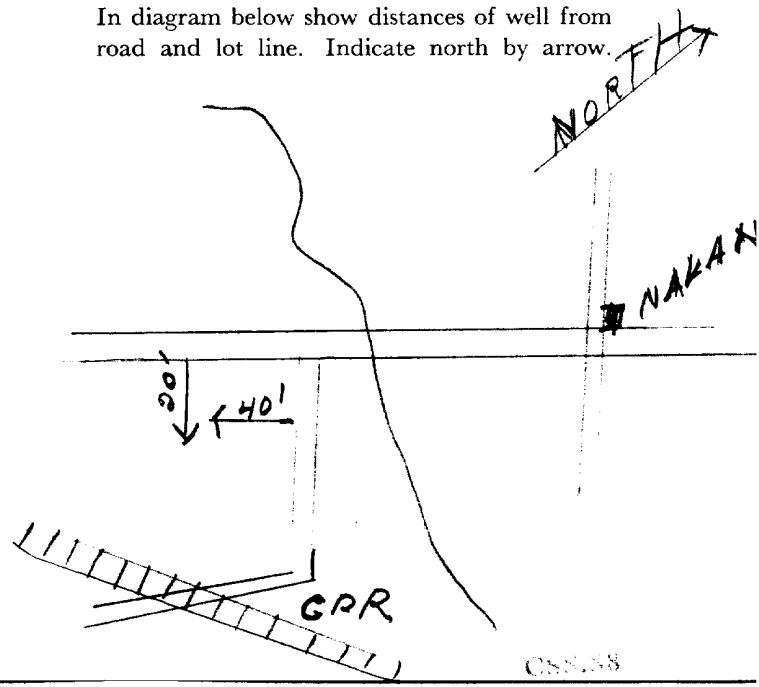



Ontario

# WATER WELL RECORD

31 1/2

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11 1515221 15011 CON. CBN 09

|   |   |  |                          |
|---|---|--|--------------------------|
| COUNTY OR DISTRICT<br><b>Compton</b>                      | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE<br><b>Cumberland</b> | CON. BLOCK, TRACT, SURVEY, ETC.<br><b>IX</b> | LOT<br><b>011</b>        |
| DATE COMPLETED<br>DAY <b>24</b> MO <b>11</b> YR <b>75</b> |   |  |                          |
| ADDRESS<br><b>Orleans, Ontario</b>                        |   | RC<br><b>4</b>                               | ELEVATION<br><b>0242</b> |
| BASIN CODE<br><b>4 26</b>                                 |   |  |                          |

| LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS) |                      |                 |                     |              |    |
|--|----------------------|-----------------|---------------------|--------------|----|
| GENERAL COLOUR   | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |    |
|  |                      |                 |                     | FROM         | TO |
| brown  | hardpan              |                 |                     | 0            | 40 |
| grey   | gravel               |                 |                     | 40           | 45 |
| grey   | slate                |                 |                     | 45           | 52 |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |
|  |                      |                 |                     |              |    |

31 0040614 0045211 0052219

32

41 WATER RECORD

| WATER FOUND AT - FEET | KIND OF WATER                               |                                    |                                    |  |
|-----------------------|---|------------------------------------|------------------------------------|--|
| 10-13                 | 1 <input checked="" type="checkbox"/> FRESH | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |  |
| 15-18                 | 1 <input type="checkbox"/> FRESH            | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |  |
| 20-23                 | 1 <input type="checkbox"/> FRESH            | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |  |
| 25-28                 | 1 <input type="checkbox"/> FRESH            | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |  |
| 30-33                 | 1 <input type="checkbox"/> FRESH            | 3 <input type="checkbox"/> SULPHUR | 4 <input type="checkbox"/> MINERAL |  |

51 CASING & OPEN HOLE RECORD


| INSIDE DIAM. INCHES | MATERIAL                                    | WALL THICKNESS INCHES | DEPTH - FEET |      |
|---------------------|---|-----------------------|--------------|------|
|                     |   |                       | FROM         | TO   |
| 6 1/2               | 1 <input checked="" type="checkbox"/> STEEL | 188                   | 0            | 0043 |
| 06                  | 2 <input type="checkbox"/> GALVANIZED       |                       |              |      |
|                     | 3 <input type="checkbox"/> CONCRETE         |                       |              |      |
|                     | 4 <input type="checkbox"/> OPEN HOLE        |                       |              |      |
| 17-18               | 1 <input type="checkbox"/> STEEL            |                       | 20-23        |      |
|                     | 2 <input type="checkbox"/> GALVANIZED       |                       |              |      |
|                     | 3 <input type="checkbox"/> CONCRETE         |                       |              |      |
|                     | 4 <input type="checkbox"/> OPEN HOLE        |                       |              |      |
| 24-25               | 1 <input type="checkbox"/> STEEL            |                       | 27-30        |      |
|                     | 2 <input type="checkbox"/> GALVANIZED       |                       |              |      |
|                     | 3 <input type="checkbox"/> CONCRETE         |                       |              |      |
|                     | 4 <input type="checkbox"/> OPEN HOLE        |                       |              |      |

61 PLUGGING & SEALING RECORD

| DEPTH SET AT - FEET | MATERIAL AND TYPE | (CEMENT GROUT, LEAD PACKER, ETC.) |
|---------------------|-------------------|-----------------------------------|
| 10-13               | 14-17             |                                   |
| 18-21               | 22-25             |                                   |
| 26-29               | 30-33             | 80                                |

71 PUMPING TEST

|  |   |  |
|--|---|--|
| PUMPING TEST METHOD<br>1 <input checked="" type="checkbox"/> PUMP 2 <input type="checkbox"/> BAILER    | PUMPING RATE<br>GPM <b>0020</b>   | DURATION OF PUMPING<br>15-16 HOURS <b>01</b> 17-18 MINS <b>00</b>                    |
| WATER LEVEL END OF PUMPING<br><b>001</b> FEET  | WATER LEVELS DURING<br>15 MINUTES <b>001</b> FEET<br>30 MINUTES <b>001</b> FEET<br>45 MINUTES <b>001</b> FEET<br>60 MINUTES <b>001</b> FEET | 1 <input type="checkbox"/> PUMPING<br>2 <input checked="" type="checkbox"/> RECOVERY |
| IF FLOWING, GIVE RATE<br>GPM <b>030</b>  | PUMP INTAKE SET AT<br>FEET <b>012</b>   | WATER AT END OF TEST<br>FEET <b>6</b>  |
| RECOMMENDED PUMP TYPE<br>1 <input checked="" type="checkbox"/> SHALLOW 2 <input type="checkbox"/> DEEP | RECOMMENDED PUMP SETTING<br>GPM <b>30</b> FEET <b>030</b>   | RECOMMENDED PUMPING RATE<br>GPM <b>0015</b>  |

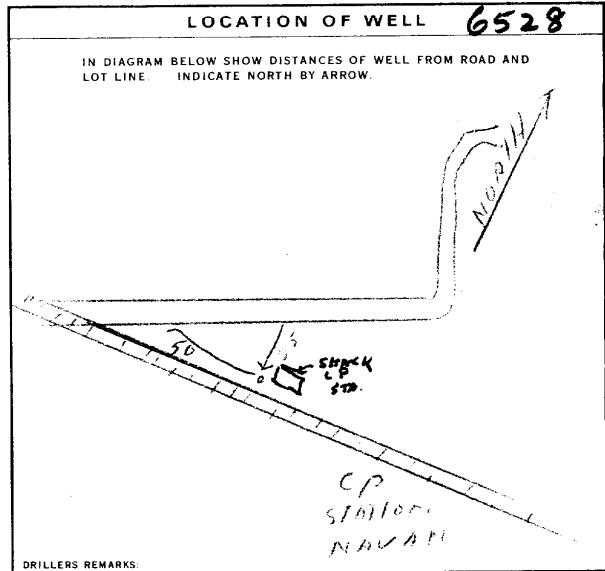

54 FINAL STATUS OF WELL  
1  WATER SUPPLY  
2  OBSERVATION WELL  
3  TEST HOLE  
4  RECHARGE WELL  
5  ABANDONED, INSUFFICIENT SUPPLY  
6  ABANDONED, POOR QUALITY  
7  UNFINISHED

55-56 WATER USE  
1  DOMESTIC  
2  STOCK  
3  IRRIGATION  
4  INDUSTRIAL  
5  OTHER  
6  COMMERCIAL  
7  MUNICIPAL  
8  PUBLIC SUPPLY  
9  COOLING OR AIR CONDITIONING  
10  NOT USED

57 METHOD OF DRILLING  
1  CABLE TOOL  
2  ROTARY (CONVENTIONAL)  
3  ROTARY (REVERSE)  
4  ROTARY (AIR)  
5  AIR PERCUSSION  
6  BORING  
7  DIAMOND  
8  JETTING  
9  DRIVING

CONTRACTOR NAME OF WELL CONTRACTOR  
**G. Charbonneau + Son Drilling Ltd. 1504**

CONTRACTOR ADDRESS  
**R.R. 2, Box 194, Orleans, Ont. K1G 1T1**

NAME OF DRILLER OR BORER  
**L. Bourgeois**

SIGNATURE OF CONTRACTOR  
*G. Charbonneau*

LICENCE NUMBER  
**1504**

LICENCE NUMBER  
**K1G 1T1**

SUBMISSION DATE  
DAY **24** MO **11** YR **75**

OFFICE USE ONLY

DATA SOURCE  
**1**

CONTRACTOR  
**1504**

DATE RECEIVED  
**030376**

DATE OF INSPECTION  
**1504**

INSPECTOR  
**R. Day**

REMARKS  
**P**

CLASSIFICATION  
**WI**



Ministry of the Environment Ontario

The Ontario Water Resources Act

# WATER WELL RECORD

1. PRINT ONLY IN SPACES PROVIDED  
2. CHECK  CORRECT BOX WHERE APPLICABLE

11

1518052

MUNICIPALITY 15.011

CON. CODE C0N

09

|   |   |  |
|---|---|--|
| COUNTY OR DISTRICT<br><b>BRUNSWICK COUNTY</b>             | TOWNSHIP, BOROUGH, CITY, TOWN, VILLAGE<br><b>COMBERLAND</b> | CON. BLOCK, TRACT, SURVEY ETC.<br><b>011</b> |
| DATE COMPLETED<br>DAY <b>27</b> MO <b>10</b> YR <b>82</b> |   |  |
| SPRING NO. <b>28999</b>                                   | RC <b>4</b>   | ELEVATION <b>0240</b>                        |
| RC <b>4</b>   | BASIN CODE <b>26</b>  |  |

### LOG OF OVERBURDEN AND BEDROCK MATERIALS (SEE INSTRUCTIONS)

| GENERAL COLOUR | MOST COMMON MATERIAL | OTHER MATERIALS | GENERAL DESCRIPTION | DEPTH - FEET |    |
|----------------|----------------------|-----------------|---------------------|--------------|----|
|                |                      |                 |                     | FROM         | TO |
| YELLOW         | SAND                 |                 |                     | 0            | 14 |
| BLUE           | CLAY                 |                 |                     | 14           | 59 |
| BLACK          | SAND                 | BOULDERS        |                     | 59           | 84 |
| BLACK          | GRAVEL               |                 |                     | 84           | 85 |

|    |         |         |            |         |
|----|---------|---------|------------|---------|
| 31 | 0014528 | 0059305 | 0084828/13 | 0085811 |
| 32 |         |         |            |         |

**41 WATER RECORD**

| WATER FOUND AT - FEET | KIND OF WATER   |
|-----------------------|---|
| 10-13                 | 1 <input checked="" type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR<br>2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL |
| 15-18                 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR<br>2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL            |
| 20-23                 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR<br>2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL            |
| 25-28                 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR<br>2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL            |
| 30-33                 | 1 <input type="checkbox"/> FRESH 3 <input type="checkbox"/> SULPHUR<br>2 <input type="checkbox"/> SALTY 4 <input type="checkbox"/> MINERAL            |

**51 CASING & OPEN HOLE RECORD**

| INSIDE DIAM. INCHES | MATERIAL  | WALL THICKNESS INCHES | DEPTH - FEET |
|---------------------|---|-----------------------|--------------|
| 10-11               | 1 <input checked="" type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE | 1.88                  | 0-85         |
| 17-18               | 1 <input type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE            |                       | 20-23        |
| 24-25               | 1 <input type="checkbox"/> STEEL<br>2 <input type="checkbox"/> GALVANIZED<br>3 <input type="checkbox"/> CONCRETE<br>4 <input type="checkbox"/> OPEN HOLE            |                       | 27-30        |

**SCREEN**


| SIZES OF OPENING (SLOT NO.) | DIAMETER | LENGTH |
|-----------------------------|----------|--------|
|                             | INCHES   | FEET   |
|                             |          | 41-44  |

**61 PLUGGING & SEALING RECORD**

| DEPTH SET AT - FEET | MATERIAL AND TYPE | (CEMENT GROUT LEAD PACKER, ETC.) |
|---------------------|-------------------|----------------------------------|
| FROM TO             |                   |                                  |
| 10-13               | 14-17             |                                  |
| 18-21               | 22-25             |                                  |
| 26-29               | 30-33             |                                  |

**71 PUMPING TEST**

|   |  |   |
|---|--|---|
| PUMPING TEST METHOD<br>1 <input type="checkbox"/> PUMP 2 <input checked="" type="checkbox"/> BAILER           | PUMPING RATE<br>972 GPM                | DURATION OF PUMPING<br>01 HOURS 45 MINS |
| STATIC LEVEL<br>040 FEET  | WATER LEVEL END OF PUMPING<br>080 FEET | WATER LEVELS DURING PUMPING             |
| 15 MINUTES<br>071 FEET  | 30 MINUTES<br>074 FEET                 | 45 MINUTES<br>080 FEET                  |
| 60 MINUTES<br>080 FEET  |  |   |
| RECOMMENDED PUMP TYPE<br><input checked="" type="checkbox"/> SHALLOW <input checked="" type="checkbox"/> DEEP | RECOMMENDED PUMP SETTING<br>082 FEET   | RECOMMENDED PUMPING RATE<br>0006 GPM    |

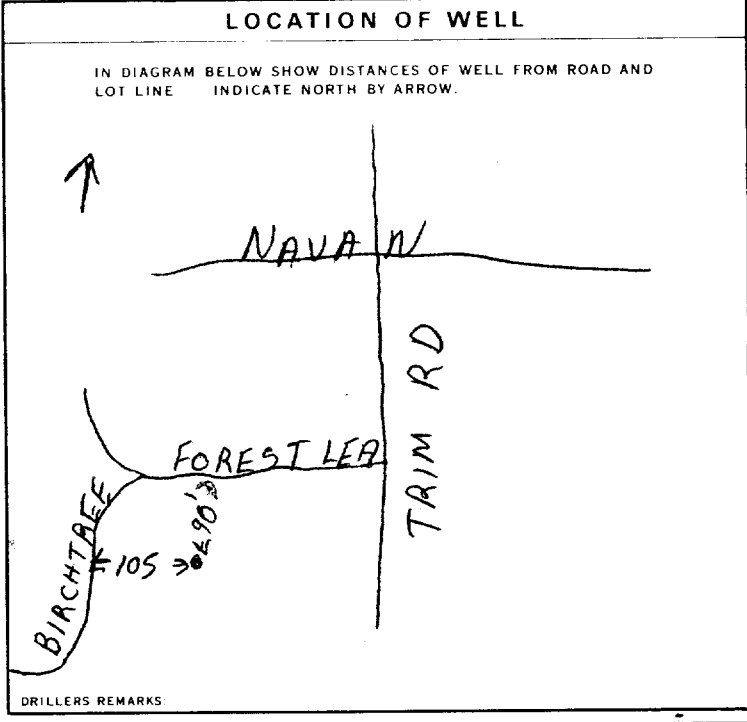

**FINAL STATUS OF WELL**

|  |   |
|--|---|
| 1 <input checked="" type="checkbox"/> WATER SUPPLY | 5 <input type="checkbox"/> ABANDONED, INSUFFICIENT SUPPLY |
| 2 <input type="checkbox"/> OBSERVATION WELL        | 6 <input type="checkbox"/> ABANDONED, POOR QUALITY        |
| 3 <input type="checkbox"/> TEST HOLE               | 7 <input type="checkbox"/> UNFINISHED                     |
| 4 <input type="checkbox"/> RECHARGE WELL           |   |

**WATER USE**

|  |  |
|--|--|
| 1 <input checked="" type="checkbox"/> DOMESTIC | 5 <input type="checkbox"/> COMMERCIAL                  |
| 2 <input type="checkbox"/> STOCK               | 6 <input type="checkbox"/> MUNICIPAL                   |
| 3 <input type="checkbox"/> IRRIGATION          | 7 <input type="checkbox"/> PUBLIC SUPPLY               |
| 4 <input type="checkbox"/> INDUSTRIAL          | 8 <input type="checkbox"/> COOLING OR AIR CONDITIONING |
| 9 <input type="checkbox"/> OTHER               | 9 <input type="checkbox"/> NOT USED                    |

**METHOD OF DRILLING**

|  |                                    |
|--|------------------------------------|
| 1 <input checked="" type="checkbox"/> CABLE TOOL | 6 <input type="checkbox"/> BORING  |
| 2 <input type="checkbox"/> ROTARY (CONVENTIONAL) | 7 <input type="checkbox"/> DIAMOND |
| 3 <input type="checkbox"/> ROTARY (REVERSE)      | 8 <input type="checkbox"/> JETTING |
| 4 <input type="checkbox"/> ROTARY (AIR)          | 9 <input type="checkbox"/> DRIVING |
| 5 <input type="checkbox"/> AIR PERCUSSION        |                                    |

**CONTRACTOR**

|   |  |
|---|--|
| NAME OF WELL CONTRACTOR<br><b>YVON GENIER WELL DRILLING</b> | LICENCE NUMBER<br><b>2351</b>                              |
| ADDRESS<br><b>RAY CASSELMAN ROAD - 1MO</b>                  |  |
| NAME OF DRILLER OR BORER<br><b>YVON GENIER</b>              | LICENCE NUMBER<br><b>2351</b>                              |
| SIGNATURE OF CONTRACTOR<br><i>Yvon Genier</i>               | SUBMISSION DATE<br>DAY <b>27</b> MO <b>10</b> YR <b>82</b> |

**OFFICE USE ONLY**

|                           |                           |                                  |
|---------------------------|---------------------------|----------------------------------|
| DATA SOURCE<br><b>1</b>   | CONTRACTOR<br><b>2351</b> | DATE RECEIVED<br><b>17 01 88</b> |
| DATE OF INSPECTION        | INSPECTOR<br><b>OP/Lm</b> |                                  |
| REMARKS<br><b>ccc. ps</b> |                           |                                  |

**ON-SITE DEEP BEDROCK TEST WELL RECORDS**



Measurements recorded in:  Metric  Imperial

A342173

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name: Last Name/Organization: E-mail Address:  Well Constructed by Well Owner

Mailing Address (Street Number/Name): 1836 Maple Grove Road  
Municipality: Stittsville  
Province: ON  
Postal Code: K2S 0M7  
Telephone No. (inc. area code):

Well Location

Address of Well Location (Street Number/Name): Smith Road (No civic)  
Township: Cumberland  
Lot: 9  
Concession: 10/11

County/District/Municipality: Ottawa Carleton  
City/Town/Village: Navan  
Province: Ontario  
Postal Code:

UTM Coordinates Zone: Easting: Northing: Municipal Plan and Sublot Number: Other:

NAD 83 18 465939 5029334

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m(ft))<br>From To |
|----------------|----------------------|-----------------|---------------------|--------------------------|
| Yellow         | Sand                 |                 |                     | 0' 6'                    |
| Blue           | Clay                 |                 |                     | 6' 50'                   |
|                | Gravel               |                 |                     | 50' 60'                  |
| Black          | Limestone            |                 |                     | 60' 220'                 |
| Grey & Black   | Limestone            |                 |                     | 220' 294'                |
| Grey & Black   | Limestone            |                 |                     | 294' 300'                |

Well # 1 22

Annular Space

| Depth Set at (m(ft))<br>From To | Type of Sealant Used<br>(Material and Type) | Volume Placed<br>(m <sup>3</sup> (ft <sup>3</sup> )) |
|---------------------------------|---|--|
| 70' 80'                         | Neat cement                                 | 15.6   |
| 80' 0'                          | Bentonite slurry                            | 21   |

Method of Construction

|  |                                  |  |   |                                     |
|--|----------------------------------|--|---|-------------------------------------|
| <input type="checkbox"/> Cable Tool                | <input type="checkbox"/> Diamond | <input type="checkbox"/> Public              | <input type="checkbox"/> Commercial                 | <input type="checkbox"/> Not used   |
| <input type="checkbox"/> Rotary (Conventional)     | <input type="checkbox"/> Jetting | <input checked="" type="checkbox"/> Domestic | <input type="checkbox"/> Municipal                  | <input type="checkbox"/> Dewatering |
| <input type="checkbox"/> Rotary (Reverse)          | <input type="checkbox"/> Driving | <input type="checkbox"/> Livestock           | <input type="checkbox"/> Test Hole                  | <input type="checkbox"/> Monitoring |
| <input type="checkbox"/> Boring                    | <input type="checkbox"/> Digging | <input type="checkbox"/> Irrigation          | <input type="checkbox"/> Cooling & Air Conditioning |                                     |
| <input checked="" type="checkbox"/> Air percussion |                                  | <input type="checkbox"/> Industrial          |   |                                     |
| <input type="checkbox"/> Other, specify            |                                  | <input type="checkbox"/> Other, specify      |   |                                     |

Other, specify: SURGED

Construction Record - Casing

| Inside Diameter<br>(cm(in)) | Open Hole OR Material<br>(Galvanized, Fibreglass, Concrete, Plastic, Steel) | Well Thickness<br>(cm(in)) | Depth (m(ft)) |      | Status of Well   |
|-----------------------------|---|----------------------------|---------------|------|--|
|                             |   |                            | From          | To   |  |
| 6 1/4"                      | Steel   | .188"                      | +2'           | 70'  | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify<br><input type="checkbox"/> Other, specify |
| 6"                          | Open Hole   |                            | 70'           | 300' |  |

Construction Record - Screen

| Outside Diameter<br>(cm/in) | Material<br>(Plastic, Galvanized, Steel) | Slot No. | Depth (m(ft)) |    |
|-----------------------------|--|----------|---------------|----|
|                             |  |          | From          | To |
|                             |  |          |               |    |

Water Details

| Water found at Depth (m(ft)) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify |
|------------------------------|---|
| 204 (m(ft))                  |   |
|                              |   |
|                              |   |

Hole Diameter

| Depth (m(ft)) | Diameter (cm(in)) |
|---------------|-------------------|
| 0' 70'        | 93/4"             |
| 70' 300'      | 6"                |


Well Contractor and Well Technician Information

Business Name of Well Contractor: Air Rock Drilling Co. Ltd.  
Well Contractor's Licence No.: 7881  
Business Address (Street Number/Name): 6059 Franktown Road  
Municipality: Richmond

Province: ON  
Postal Code: K0A 2Z0  
Business E-mail Address: air-rock@sympatico.ca  
Bus. Telephone No. (inc. area code): 613 8382170  
Name of Well Technician (Last Name, First Name): Hanna, Jeremy  
Well Technician's Licence No.: 13632  
Signature of Technician and/or Contractor: [Signature]  
Date Submitted: 02 28 2022

Results of Well Yield Testing

| After test of well yield, water was:<br><input type="checkbox"/> Clear and sand free<br><input type="checkbox"/> Other, specify | Draw Down    |                     | Recovery   |                     |
|---|--------------|---------------------|------------|---------------------|
|   | Time (min)   | Water Level (m(ft)) | Time (min) | Water Level (m(ft)) |
| <input checked="" type="checkbox"/> Not tested  |              |                     |            |                     |
| If pumping discontinued, give reason:   | Static Level | 31'4"               |            | 118'                |
|   | 1            | 42                  | 1          | 103                 |
| Pump intake set at (m(ft))  | 2            | 47.8                | 2          | 96.1                |
| Pumping rate (l/min / GPM)  | 3            | 52.7                | 3          | 98.4                |
|   | 4            | 56.8                | 4          | 83.6                |
| Duration of pumping   | 5            | 60.5                | 5          | 77.8                |
| Final water level end of pumping (m(ft))  | 10           | 73.9                | 10         | 56.3                |
|   | 15           | 83.1                | 15         | 42.8                |
| If flowing give rate (l/min/GPM)  | 20           | 90.1                | 20         | 38.6                |
| Recommended pump depth (m(ft))  | 25           | 96.7                | 25         | 35.9                |
| Recommended pump rate (l/min/GPM)   | 30           | 101                 | 30         | 33                  |
| Well production (l/min/GPM)   | 40           | 108                 | 40         | 31.4                |
|   | 50           | 114                 | 50         | 31.4                |
| Discontinued?<br><input checked="" type="checkbox"/> Yes <input type="checkbox"/> No  | 60           | 118'                | 60         | 31.4"               |

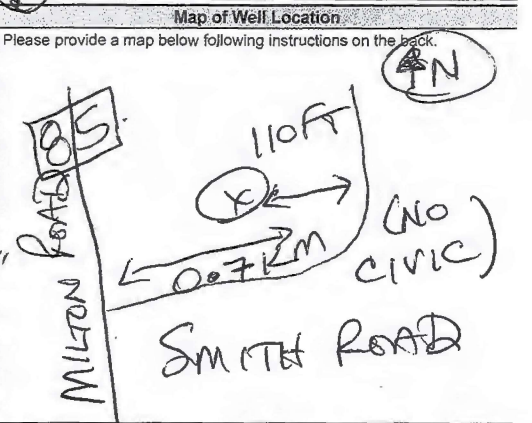

Comments: 3/4 HP 10 GPM Set @ 200 ft

| Well owner's information package delivered                          | Date Package Delivered | Ministry Use Only |
|---|------------------------|-------------------|
| <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No | 2022 01 21             | Audit No. 378976  |
|   | 2022 01 13             | Received          |



Measurements recorded in:  Metric  Imperial

A342174

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name: \_\_\_\_\_ Last Name/Organization: **John Boisvert** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **1836 Maple Grove Road** Municipality: **Stittsville** Province: **ON** Postal Code: **K2S 0M7** Telephone No. (inc. area code): \_\_\_\_\_

Well Location

Address of Well Location (Street Number/Name): **Smith Road (No civic)** Township: **Cumberland** Lot: **9** Concession: **10/11**

County/District/Municipality: **Ottawa Carleton** City/Town/Village: **Navan** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates: Zone: **18** Easting: **465956** Northing: **5029490** Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |
|----------------|----------------------|-----------------|---------------------|--------------|
|                |                      |                 |                     | From To      |
|                | Clay                 | Boulders        | Gravel              | 0' 58'       |
| Black          | Limestone            | (Soft)          |                     | 58' 220'     |
| Grey & Black   | Limestone            |                 |                     | 220' 324'    |
| Grey & Black   | Limestone            |                 |                     | 324' 330'    |

well 2 of 2

**Annular Space**

| Depth Set at (m/ft) | Type of Sealant Used (Material and Type) | Volume Placed (m³) |
|---------------------|--|--------------------|
| 56' 56'             | Neat cement                              | 15.6               |
| 56' 0'              | Bentonite slurry                         | 25.2               |

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Jetting  Rotary (Reverse)  Driving  Boring  Air percussion  Other, specify \_\_\_\_\_

**Well Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Cooling & Air Conditioning  Industrial  Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm) | Depth (m/ft) |      | Status of Well   |
|----------------------|--|---------------------|--------------|------|--|
|                      |  |                     | From         | To   |  |
| 6 1/4"               | Steel  | .188"               | +2'          | 66'  | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
| 6 1/8"               | Open Hole  |                     | 66'          | 330' |  |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |
|--------------------------|---------------------------------------|----------|--------------|
|                          |                                       |          | From To      |
|                          |                                       |          |              |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Hole Diameter                      |
|-----------------------------|--|------------------------------------|
|                             | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | Depth (m/ft) From To Diameter (cm) |
| 324 (m/ft)                  |  | 0' 66" 9 3/4"                      |
|                             |  | 66' 330" 6 1/8"                    |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No.: **C7881**

Business Address (Street Number/Name): **6659 Franktown Road** Municipality: **Richmond**

Province: **ON** Postal Code: **R9A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code): **6138382170** Name of Well Technician (Last Name, First Name): **Hanna, Jeremy**

Well Technician's Licence No.: **13632** Signature of Technician and/or Contractor: \_\_\_\_\_ Date: **2022 Oct 2 28**

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify **Not tested**

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): **280**

Pumping rate (l/min / GPM): **20 +**

Duration of pumping: **1 hrs + 0 min**

Final water level end of pumping (m/ft): **43.4"**

If flowing give rate (l/min/GPM): \_\_\_\_\_


Recommended pump depth (m/ft): **100'**

Recommended pump rate (l/min/GPM): **20 +**

Well production (l/min/GPM): **20 +**

Displaced?  Yes  No

| Time (min)   | Draw Down          |            | Recovery           |            |
|--------------|--------------------|------------|--------------------|------------|
|              | Water Level (m/ft) | Time (min) | Water Level (m/ft) | Time (min) |
| Static Level | <b>36.4"</b>       |            | <b>43.4"</b>       |            |
| 1            | <b>40.6</b>        | 1          | <b>40.6</b>        |            |
| 2            | <b>41.7</b>        | 2          | <b>38.8</b>        |            |
| 3            | <b>42.2</b>        | 3          | <b>37.6</b>        |            |
| 4            | <b>42.5</b>        | 4          | <b>36.8</b>        |            |
| 5            | <b>42.6</b>        | 5          | <b>36.4</b>        |            |
| 10           | <b>43</b>          | 10         | <b>36.4</b>        |            |
| 15           | <b>43.1</b>        | 15         | <b>36.4</b>        |            |
| 20           | <b>43.2</b>        | 20         | <b>36.4</b>        |            |
| 25           | <b>43.2</b>        | 25         | <b>36.4</b>        |            |
| 30           | <b>43.3</b>        | 30         | <b>36.4</b>        |            |
| 40           | <b>43.3</b>        | 40         | <b>36.4</b>        |            |
| 50           | <b>43.3</b>        | 50         | <b>36.4</b>        |            |
| 60           | <b>43.4"</b>       | 60         | <b>36.4"</b>       |            |

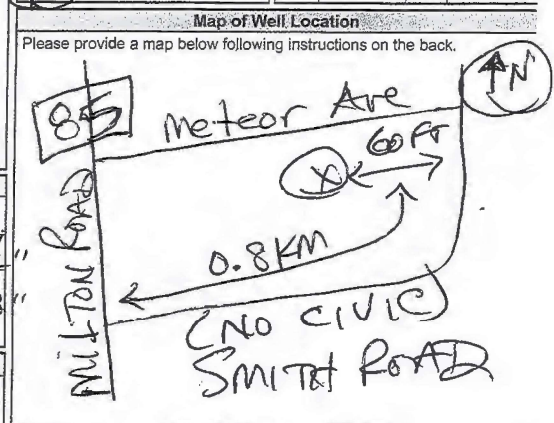

Comments: **LHP-20GPM Set @ 100'**

Well owner's information package delivered:  Yes  No

Date Package Delivered: **2022 Oct 18**

Work completed: **18**

Ministry Use Only

Audit No.: **378977**

Received: \_\_\_\_\_

**PROPOSED AQUIFER (SHALLOW BEDROCK-GRAVEL) TEST WELL RECORDS**



Measurements recorded in:  Metric  Imperial

A342479

Page of

Well Owner's Information

First Name, Last Name/Organization (John Boisvert), E-mail Address, Mailing Address (1836 Maple Grove Road), Municipality (Stittsville), Province (ON), Postal Code (K2S 0M7), Telephone No.

Well Location

Address of Well Location (Smith Road (No Civic)), Township (Cumberland), City/Town/Village (Navan), Province (Ontario), UTM Coordinates (Zone 18, Easting 465794, Northing 5029292)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth From, Depth To. Rows include Clay, Sand, Gravel, and Shale.

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used, Volume Placed (m<sup>3</sup>/ft<sup>3</sup>). Rows for Neat cement and Bentonite slurry.

Results of Well Yield Testing table with columns: Time (min), Water Level (m/ft), Recovery Time (min), Water Level (m/ft). Includes pumping rate and duration of pumping.

Method of Construction and Well Use checkboxes. Includes Cable Tool, Rotary, Boring, Air percussion, etc.

Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m/ft) From, To. Rows for Steel and Open Hole.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (m/ft) From, To.

Water Details and Hole Diameter tables. Water found at Depth (42 m/ft), Kind of Water (Fresh/Untested), Hole Diameter (Depth and Diameter).

Well Contractor and Well Technician Information. Business Name (Air Rock Drilling Co. Ltd.), Business Address (8859 Franktown Road), Province (ON), Postal Code (K0A 2Z0), Business E-mail Address (air-rock@sympatico.ca).

Well Technician's Licence No. (T3632), Signature of Technician and/or Contractor (Hanna, Jeremy), Date Submitted (2022 10 31).

Map of Well Location with handwritten notes: Milton Road, 100ft, 0.6km, SMITH ROAD, (NO CIVIC), AN, and pumping rate notes: 1/2HP-56PM Sel @ 40ft.

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name: \_\_\_\_\_ Last Name/Organization: **John Boisvert** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **1836 Maple Grove Road** Municipality: **Stittsville** Province: **ON** Postal Code: **K2S 0M7** Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): **Smith Road (No Civic)** Township: **Cumberland** Lot: **9** Concession: **10&11**

County/District/Municipality: **Ottawa Carleton** City/Town/Village: **Navan** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: **18** Easting: **465940** Northing: **5029489** Municipal Plan and Sublot Number: \_\_\_\_\_ Other: **TW# 5**

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

| General Colour | Most Common Material | Other Materials | General Description | Depth (m/ft) |
|----------------|----------------------|-----------------|---------------------|--------------|
|                |                      |                 |                     | From To      |
|                | Clay                 |                 |                     | 0' 20'       |
|                | Clay                 | + Gravel        | + Boulders          | 20' 61'      |
| Black          | Shale                |                 |                     | 61' 85'      |
| Black          | Shale                |                 |                     | 85' 80'      |

**\* TW# 5 \* HYDROFRACTURED**  
**\* DO NOT SET PUMP BELOW 70 FT \***

**Annular Space**

| Depth Set at (m/ft) | Type of Sealant Used | Volume Placed |
|---------------------|----------------------|---------------|
| From To             | (Material and Type)  | (m³/ft³)      |
| 20' 0'              | Neat cement          | 10.92         |

**Results of Well Yield Testing**

| Time (min)   | Draw Down          |            | Recovery           |            |
|--------------|--------------------|------------|--------------------|------------|
|              | Water Level (m/ft) | Time (min) | Water Level (m/ft) | Time (min) |
| Static Level | 26.9m              |            | 64.                |            |
| 1            | 34.4               | 1          | 57.                |            |
| 2            | 39.                | 2          | 53.                |            |
| 3            | 43.                | 3          | 49.                |            |
| 4            | 46.2               | 4          | 45.4               |            |
| 5            | 61.                | 5          | 36.2               |            |
| 10           | 64.                | 10         | 34.3               |            |
| 15           | 64.                | 15         | 22.4               |            |
| 20           |                    | 20         | 22.4               |            |
| 25           |                    | 25         |                    |            |
| 30           |                    | 30         |                    |            |
| 40           |                    | 40         |                    |            |
| 50           |                    | 50         |                    |            |
| 60           |                    | 60         |                    |            |

After test of well yield, water was:  
 Clear and sand free  
 Other, specify **Not tested**

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft): **60**

Pumping rate (l/min / GPM): **6**

Duration of pumping: **1** hrs + **0** min

Final water level end of pumping (m/ft): **64'**

If flowing give rate (l/min/GPM): \_\_\_\_\_

Recommended pump depth (m/ft): **70**

Recommended pump rate (l/min/GPM): **5**

Well production (l/min/GPM): **6**

Disinfected?  Yes  No

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify **HYDROFRACTURE**  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

| Inside Diameter (cm/in) | Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel) | Wall Thickness (cm/in) | Depth (m/ft) |     | Status of Well   |
|-------------------------|--|------------------------|--------------|-----|--|
|                         |  |                        | From         | To  |  |
| 6 1/4"                  | Steel  | .188"                  | 20'          | 20' | <input checked="" type="checkbox"/> Water Supply<br><input type="checkbox"/> Replacement Well<br><input type="checkbox"/> Test Hole<br><input type="checkbox"/> Recharge Well<br><input type="checkbox"/> Dewatering Well<br><input type="checkbox"/> Observation and/or Monitoring Hole<br><input type="checkbox"/> Alteration (Construction)<br><input type="checkbox"/> Abandoned, Insufficient Supply<br><input type="checkbox"/> Abandoned, Poor Water Quality<br><input type="checkbox"/> Abandoned, other, specify _____<br><input type="checkbox"/> Other, specify _____ |
| 6 1/4"                  | Steel  | .188"                  | 20'          | 62' |  |
| 6"                      | Open Hole  |                        | 62'          | 80' |  |

**Construction Record - Screen**

| Outside Diameter (cm/in) | Material (Plastic, Galvanized, Steel) | Slot No. | Depth (m/ft) |    |
|--------------------------|---------------------------------------|----------|--------------|----|
|                          |                                       |          | From         | To |
|                          |                                       |          |              |    |

**Water Details**

| Water found at Depth (m/ft) | Kind of Water: <input type="checkbox"/> Fresh <input checked="" type="checkbox"/> Untested | Depth (m/ft) | Diameter (cm/ft) |
|-----------------------------|--|--------------|------------------|
| 65.85                       | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | 0' 20'       | 9 3/4"           |
|                             | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | 20' 62'      | 6 1/4"           |
|                             | <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____                 | 62' 80'      | 6"               |

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Air Rock Drilling Co. Ltd.** Well Contractor's Licence No.: **C7881**

Business Address (Street Number/Name): **6533 Franktown Road** Municipality: **Richmond**

Province: **ON** Postal Code: **K0A 2Z0** Business E-mail Address: **air-rock@sympatico.ca**

Bus. Telephone No. (inc. area code): **813882170** Name of Well Technician (Last Name, First Name): **Hanna, Jeremmy**

Well Technician's Licence No.: **13632** Signature of Technician and/or Contractor: \_\_\_\_\_

**Map of Well Location**

Please provide a map below following instructions on the back.

**Test Well # 5**

Meteor Avenue

Milton Road

(No Civic) SMITH ROAD

100m

120ft

Test Well # 5

Comments: **1/2HP-5GPM @ 70 FT**

Well owners information package delivered: **2024/01/09**

Date Package Delivered: **2024/01/09**

Ministry Use Only: Audit No. **2408326**

Received: \_\_\_\_\_



## **APPENDIX F**

### Water Quality Results and Laboratory Certificate Forms

**Summary of Measured Field Parameters  
Private Wells**

| Well ID | Date of Sampling | Time Since Initiation of Pumping (hours) | Temp (°C) | pH (-) | EC <sup>1</sup> (mS/cm) | Turbidity <sup>2</sup> (NTU) | TDS <sup>3</sup> (ppm) | Chlorine (mg/L) | Colour (ACU <sup>4</sup> ) | Colour (TCU <sup>5</sup> ) |
|---------|------------------|--|-----------|--------|-------------------------|------------------------------|------------------------|-----------------|----------------------------|----------------------------|
| PW-939  | 2-Feb-22         | 0.16                                     | 10.2      | 8.71   | 373                     | 1.14                         | 242                    | <0.02           | <5                         | -                          |
| PW-1014 | 2-Feb-22         | 0.16                                     | 9.34      | 8.92   | 609                     | 3.19                         | 390                    | <0.02           | <5                         | -                          |
| PW-903  | 7-Apr-22         | 0.25                                     | 8.6       | 9.19   | 520                     | 0.82                         | 260                    | <0.02           | <5                         | -                          |
| PW-959  | 13-Oct-23        | 0.25                                     | 12.8      | 9.27   | 456                     | 1.39                         | 227                    | -               | <5                         | -                          |
| PW-900  | 13-Oct-23        | 0.25                                     | 11.8      | 9.75   | 463                     | 0.8                          | 231                    | -               | <5                         | -                          |
| PW-969  | 13-Oct-23        | 0.25                                     | 12.2      | 7.95   | 301                     | 0.79                         | 152                    | -               | <5                         | -                          |
| PW-908  | 13-Oct-23        | 0.25                                     | 11.1      | 9.45   | 476                     | 0.82                         | 234                    | -               | <5                         | -                          |

Notes:

1. EC: Electrical Conductivity
2. Turbidity is taken to be the average of three consecutive measurements.
3. TDS: Total Dissolved Solids (Calculated as  $0.5 \times \text{EC}$ )
4. ACU: Actual Colour Units (unfiltered)
5. TCU: True Colour Units (field-filtered using 0.45-micron filter)
6. '-': Not Measured
7. TW22-04 pumped at a rate of approx 15 litres per minute
8. TW24-05 pumped at a rate of approx 19 litres per minute

**Summary of Measured Field Parameters  
Test Wells**

| Well ID   | Date of Sampling   | Time Since Initiation of Pumping (hours) | Temp (°C) | pH (-) | EC <sup>1</sup> (mS/cm) | Turbidity <sup>2</sup> (NTU) | TDS <sup>3</sup> (ppm) | Chlorine (mg/L) | Colour (ACU <sup>4</sup> ) | Colour (TCU <sup>5</sup> ) |
|-----------|--------------------|--|-----------|--------|-------------------------|------------------------------|------------------------|-----------------|----------------------------|----------------------------|
| TW21-01   | 18-Nov-21          | 1  | 4.2       | 8.78   | 476                     | 9.92                         | 238                    | -               | -                          | -                          |
|           |                    | 2  | 9.4       | 8.69   | 478                     | 4.62                         | 238                    | -               | -                          | -                          |
|           |                    | 3  | 9.8       | 8.56   | 475                     | 4.82                         | 237                    | <0.02           | <5                         | <5                         |
|           |                    | 4  | 9.6       | 8.52   | 476                     | 4.63                         | 236                    | -               | -                          | -                          |
|           |                    | 5  | 9.5       | 8.54   | 476                     | 4.96                         | 237                    | -               | -                          | -                          |
|           |                    | 6  | 9.4       | 8.55   | 474                     | 3.9                          | 235                    | <0.02           | <5                         | <5                         |
| TW22-01   | 2-Feb-22           | 1  | 12.44     | 8.81   | 636                     | -                            | 406                    | -               | -                          | -                          |
|           |                    | 2  | 9.07      | 9.08   | 671                     | -                            | 429                    | -               | -                          | -                          |
|           |                    | 3  | 8.24      | 9.07   | 662                     | -                            | 424                    | <0.02           | -                          | -                          |
|           |                    | 4  | 7.92      | 9.07   | 763                     | -                            | 488                    | -               | -                          | -                          |
|           |                    | 5  | 8.33      | 9.12   | 793                     | -                            | 508                    | -               | -                          | -                          |
|           |                    | 6  | 8.18      | 9.08   | 818                     | -                            | 524                    | -               | -                          | -                          |
| TW22-02   | 1-Feb-22           | 1  | 6.38      | 9.3    | 766                     | 6.92                         | 491                    | -               | -                          | -                          |
|           |                    | 2  | -         | -      | -                       | -                            | -                      | -               | -                          | -                          |
|           |                    | 3  | 6.83      | 9.58   | 781                     | 4.65                         | 502                    | <0.02           | 24                         | <5                         |
|           |                    | 4  | 7.8       | 9.75   | 818                     | 6.61                         | 524                    | -               | -                          | -                          |
|           |                    | 5  | 6.83      | 9.75   | 838                     | 3.74                         | 536                    | -               | -                          | -                          |
|           |                    | 6  | 6.77      | 9.68   | 871                     | 3.71                         | 555                    | <0.02           | 51                         | <5                         |
| TW22-03   | 28-Apr-22          | 1  | 8.8       | 9.68   | 610                     | 39.7                         | 300                    | -               | -                          | -                          |
|           |                    | 2  | 10.2      | 9.57   | 580                     | 43.6                         | 300                    | -               | -                          | -                          |
|           |                    | 3  | 10        | 9.51   | 580                     | 50.9                         | 290                    | <0.02           | 371                        | <5                         |
|           |                    | 4  | -         | -      | -                       | -                            | -                      | -               | -                          | -                          |
|           |                    | 5  | 9.7       | 9.6    | 580                     | 71.5                         | 290                    | -               | -                          | -                          |
|           |                    | 6  | 9.7       | 9.47   | 570                     | 58.9                         | 280                    | <0.02           | <5                         | <5                         |
|           | 7-Apr-22           | 1  | 9.3       | 9.76   | 0.67                    | 15.3                         | 0.4                    | <0.02           | 0                          | <5                         |
| TW22-04   | 28-Apr-22          | 1  | 11.9      | 9.71   | 560                     | 1000                         | 280                    | -               | -                          | -                          |
|           |                    | 2  | 13.4      | 8.44   | 540                     | 377                          | 270                    | -               | -                          | -                          |
|           |                    | 3  | 12.3      | 9.27   | 540                     | 242                          | 270                    | <0.02           | >500                       | <5                         |
|           |                    | 4  | 13        | 9.21   | 530                     | 157                          | 270                    | -               | -                          | -                          |
|           |                    | 5  | 14        | 9.1    | 540                     | 134                          | 270                    | -               | -                          | -                          |
|           | 6                  | 13.5                                     | 9.23      | 540    | 99.6                    | 270                          | <0.02                  | >500            | <5                         |                            |
| 19-Dec-23 | 168 <sup>(7)</sup> | 10                                       | 9.34      | 482    | 2.33                    | 241                          | <0.02                  | <5              | <5                         |                            |
| TW24-05   | 18-Jan-24          | 1  | 11.9      | 9.71   | 560                     | 1000                         | 280                    | -               | -                          | -                          |
|           |                    | 2  | 13.4      | 8.44   | 540                     | 377                          | 270                    | -               | -                          | -                          |
|           |                    | 3  | 12.3      | 9.27   | 540                     | 242                          | 270                    | <0.02           | >500                       | <5                         |
|           |                    | 4  | 13        | 9.21   | 530                     | 157                          | 270                    | -               | -                          | -                          |
|           |                    | 5  | 14        | 9.1    | 540                     | 134                          | 270                    | -               | -                          | -                          |
|           | 6                  | 13.5                                     | 9.23      | 540    | 99.6                    | 270                          | <0.02                  | >500            | <5                         |                            |
| 24-Jan-24 | 48 <sup>(8)</sup>  | 11.59                                    | 8.14      | 459    | 0.38                    | 298                          | <0.02                  | <5              | <5                         |                            |

Notes:

1. EC: Electrical Conductivity
2. Turbidity is taken to be the average of three consecutive measurements.
3. TDS: Total Dissolved Solids (Calculated as  $0.5 \times \text{EC}$ )
4. ACU: Actual Colour Units (unfiltered)
5. TCU: True Colour Units (field-filtered using 0.45-micron filter)
6. '-': Not Measured
7. TW22-04 pumped at a rate of approx 15 litres per minute
8. TW24-05 pumped at a rate of approx 19 litres per minute



## Water Quality Summary Private Wells

| Parameters                        | Units    | PW-939              | PW-1014             | PW 903              | 959 Smith Road      | 900 Smith Road      | 969 Meteor Ave      | 908 Smith Ave       |
|-----------------------------------|----------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|
|                                   |          | Lab ID: 2206338-01  | Lab ID: 2206338-02  | Lab ID: 2215531-02  | 2341381-01          | 2341381-02          | 2341381-03          | 2341381-04          |
|                                   |          | 02/02/2022 12:00 PM | 02/02/2022 12:00 PM | 04/07/2022 12:20 PM | 10/13/2023 09:30 AM | 10/13/2023 10:20 AM | 10/13/2023 11:20 AM | 10/13/2023 12:20 PM |
| GEMTEC ASSIGNED WELL ID           |          | PW-939              | PW-1014             | PW-903              | PW-959              | PW-900              | PW-969              | PW-908              |
| <b>Microbiological Parameters</b> |          |                     |                     |                     |                     |                     |                     |                     |
| E. Coli                           | FU/100m  | ND (1)              | ND (1)              | ND (1)              | -                   | -                   | -                   | -                   |
| Fecal Coliforms                   | FU/100m  | ND (1)              | ND (1)              | ND (1)              | -                   | -                   | -                   | -                   |
| Total Coliforms                   | FU/100m  | ND (1)              | ND (1)              | 1                   | -                   | -                   | -                   | -                   |
| Heterotrophic Plate C             | CFU/mL   | ND (10)             | ND (10)             | -                   | -                   | -                   | -                   | -                   |
| <b>General Inorganics</b>         |          |                     |                     |                     |                     |                     |                     |                     |
| Alkalinity, total                 | mg/L     | 172                 | 241                 | 224                 | -                   | -                   | -                   | -                   |
| Ammonia as N                      | mg/L     | 0.53                | 0.31                | 0.47                | -                   | -                   | -                   | -                   |
| Dissolved Organic Car             | mg/L     | 1.1                 | ND (0.5)            | 1.6                 | -                   | -                   | -                   | -                   |
| Colour                            | TCU      | 3                   | 5                   | 6                   | 2                   | ND (2)              | 3                   | ND (2)              |
| Colour, apparent                  | ACU      | 5                   | 13                  | 9                   | 7                   | 3                   | 18                  | 8                   |
| Conductivity                      | uS/cm    | 384                 | 572                 | 462                 | -                   | -                   | -                   | -                   |
| Hardness                          | mg/L     | 39.2                | 6.33                | 27.7                | -                   | -                   | -                   | -                   |
| pH                                | pH Units | 8.4                 | 9.0                 | 8.6                 | -                   | -                   | -                   | -                   |
| Phenolics                         | mg/L     | ND (0.001)          | ND (0.001)          | ND (0.001)          | -                   | -                   | -                   | -                   |
| Total Dissolved Solids            | mg/L     | 208                 | 324                 | 250                 | -                   | -                   | -                   | -                   |
| Sulphide                          | mg/L     | 1.12                | 4.61                | 0.90                | -                   | -                   | -                   | -                   |
| Tannin & Lignin                   | mg/L     | ND (0.1)            | ND (0.1)            | ND (0.1)            | -                   | -                   | -                   | -                   |
| Total Kjeldahl Nitroge            | mg/L     | 0.6                 | 0.3                 | 0.5                 | -                   | -                   | -                   | -                   |
| Organic Nitrogen                  | mg/L     | 0.07                | 0                   | 0.03                | -                   | -                   | -                   | -                   |
| Turbidity                         | NTU      | 1.2                 | 2.0                 | 0.8                 | 0.8                 | 0.4                 | 0.9                 | 1.0                 |
| <b>Anions</b>                     |          |                     |                     |                     |                     |                     |                     |                     |
| Chloride                          | mg/L     | 13                  | 39                  | 18                  | 40                  | 14                  | 11                  | 22                  |
| Fluoride                          | mg/L     | 0.6                 | 1.1                 | 0.7                 | 0.8                 | 0.5                 | 0.3                 | 0.8                 |
| Nitrate as N                      | mg/L     | ND (0.1)            | ND (0.1)            | ND (0.1)            | ND (0.1)            | ND (0.1)            | ND (0.1)            | ND (0.1)            |
| Nitrite as N                      | mg/L     | ND (0.05)           | ND (0.05)           | ND (0.05)           | -                   | -                   | -                   | -                   |
| Sulphate                          | mg/L     | ND (1)              | 3                   | 3                   | -                   | -                   | -                   | -                   |
| <b>Metals</b>                     |          |                     |                     |                     |                     |                     |                     |                     |
| Aluminum                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Antimony                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Arsenic                           | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Barium                            | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Beryllium                         | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Boron                             | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Cadmium                           | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Calcium                           | mg/L     | 7.0                 | 1.8                 | 7.5                 | -                   | -                   | -                   | -                   |
| Chromium                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Cobalt                            | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Copper                            | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Iron                              | mg/L     | ND (0.1)            | 0.2                 | 0.2                 | 0.1                 | ND (0.1)            | 0.4                 | ND (0.1)            |
| Lead                              | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Magnesium                         | mg/L     | 5.3                 | 0.4                 | 2.1                 | -                   | -                   | -                   | -                   |
| Manganese                         | mg/L     | ND (0.005)          | ND (0.005)          | 0.017               | -                   | -                   | -                   | -                   |
| Molybdenum                        | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Nickel                            | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Potassium                         | mg/L     | 5.2                 | 1.5                 | 3.2                 | -                   | -                   | -                   | -                   |
| Selenium                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Silver                            | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Sodium                            | mg/L     | 64.8                | 124                 | 86.0                | -                   | -                   | -                   | -                   |
| Strontium                         | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Thallium                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Tin                               | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Titanium                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Tungsten                          | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Uranium                           | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |
| Zinc                              | mg/L     | -                   | -                   | -                   | -                   | -                   | -                   | -                   |



**Water Quality Summary**  
**Deep Test Wells**

| Parameter                         | Units     | TW21-01 3hr<br>Lab ID: 2147532-01 | TW21-01 3hr<br>(Filtered)<br>Lab ID: 2147532-01 | TW21-01 6hr<br>Lab ID: 2147532-02 | TW21-01 6hr<br>(Filtered)<br>Lab ID: 2147532-02 | TW22-1 3hr<br>Lab ID: 2206352-01 | TW22-1 6hr<br>Lab ID: 2206352-02 | TW22-1 6hr<br>(Filtered)<br>Lab ID: 2206352-03 | TW22-1<br>Lab ID: 2208183-01 | TW22-2 3hr<br>Lab ID: 2206260-01 | TW22-2 6hr<br>Lab ID: 2206260-02 | TW22-2 6 hr<br>(Filtered)<br>Lab ID: 2206260-03 |
|-----------------------------------|-----------|-----------------------------------|---|-----------------------------------|---|----------------------------------|----------------------------------|--|------------------------------|----------------------------------|----------------------------------|---|
| Sample Date (m/d/y)               |           | 11/18/2021<br>11:40 AM            | 11/18/2021<br>11:40 AM                          | 11/18/2021<br>02:40 PM            | 11/18/2021<br>02:40 PM                          | 02/02/2022<br>11:20 AM           | 02/02/2022<br>02:20 PM           | 02/02/2022<br>02:20 PM                         | 02/14/2022<br>03:30 PM       | 02/01/2022<br>11:30 AM           | 02/01/2022<br>02:30 PM           | 02/01/2022<br>02:30 PM                          |
| GEMTEC ASSIGNED WELL ID           |           | PW21-1                            |   |                                   |   | TW22-1                           |                                  |  | TW22-2                       |                                  |                                  |   |
| <b>Microbiological Parameters</b> |           |                                   |   |                                   |   |                                  |                                  |  |                              |                                  |                                  |   |
| E. Coli                           | CFU/100mL | ND (1)                            | -   | ND (1)                            | ND (1)  | ND (10)                          | ND (10)                          | -  | -                            | ND (1)                           | ND (1)                           | -   |
| Fecal Coliforms                   | CFU/100mL | ND (1)                            | -   | ND (1)                            | ND (1)  | ND (10)                          | ND (10)                          | -  | -                            | ND (1)                           | ND (1)                           | -   |
| Total Coliforms                   | CFU/100mL | ND (1)                            | -   | ND (1)                            | ND (1)  | ND (10)                          | ND (10)                          | -  | -                            | ND (1)                           | ND (1)                           | -   |
| Heterotrophic Pla                 | CFU/mL    | -                                 | -   | -                                 | -   | 10                               | ND (10)                          | -  | -                            | ND (10)                          | ND (10)                          | -   |
| <b>General Inorganics</b>         |           |                                   |   |                                   |   |                                  |                                  |  |                              |                                  |                                  |   |
| Alkalinity, total                 | mg/L      | 224                               | -   | 223                               | 223   | 327                              | 353                              | -  | -                            | 319                              | 348                              | -   |
| Ammonia as N                      | mg/L      | 0.55                              | -   | 0.57                              | 0.57  | 0.37                             | 0.38                             | -  | -                            | 0.29                             | 0.30                             | -   |
| Dissolved Organic                 | mg/L      | 1.8                               | -   | 1.4                               | 1.4   | 1.5                              | 1.5                              | -  | -                            | 1.3                              | 0.7                              | -   |
| Colour                            | TCU       | 5                                 | -   | 4                                 | 4   | 9                                | 14                               | -  | -                            | 3                                | 3                                | -   |
| Colour, apparent                  | ACU       | 14                                | -   | 11                                | 11  | 764                              | 1000                             | -  | -                            | 24                               | 26                               | -   |
| Conductivity                      | uS/cm     | 508                               | -   | 476                               | 476   | 706                              | 828                              | -  | -                            | 816                              | 855                              | -   |
| Hardness                          | mg/L      | 45.7                              | -   | 45.6                              | 45.6  | 10.8                             | 13.6                             | -  | -                            | 10.7                             | 12.1                             | -   |
| pH                                | pH Units  | 8.4                               | -   | 8.3                               | 8.3   | 9.2                              | 9.1                              | -  | -                            | 9.0                              | 8.9                              | -   |
| Phenolics                         | mg/L      | ND (0.001)                        | -   | ND (0.001)                        | ND (0.001)                                      | ND (0.001)                       | ND (0.001)                       | -  | -                            | ND (0.001)                       | ND (0.001)                       | -   |
| Total Dissolved S                 | mg/L      | 264                               | -   | 250                               | 250   | 436                              | 472                              | -  | -                            | 452                              | 468                              | -   |
| Sulphide                          | mg/L      | 0.29                              | -   | 0.31                              | 0.31  | 1.77                             | 3.75                             | -  | -                            | 2.78                             | 3.08                             | -   |
| Tannin & Lignin                   | mg/L      | 0.2                               | -   | 0.2                               | 0.2   | 0.3                              | 0.3                              | -  | -                            | ND (0.1)                         | ND (0.1)                         | -   |
| Total Kjeldahl Nit                | mg/L      | 0.6                               | -   | 0.6                               | 0.6   | 0.5                              | 0.6                              | -  | -                            | 0.4                              | 0.4                              | -   |
| Organic Nitrogen                  | mg/L      | 0.05                              | -   | 0.03                              | 0.03  | 0.13                             | 0.22                             | -  | -                            | 0.11                             | 0.1                              | -   |
| Turbidity                         | NTU       | 1.5                               | -   | 0.8                               | 0.8   | 140                              | 190                              | -  | -                            | 4.0                              | 4.2                              | -   |
| <b>Anions</b>                     |           |                                   |   |                                   |   |                                  |                                  |  |                              |                                  |                                  |   |
| Chloride                          | mg/L      | 19                                | -   | 17                                | 17  | 28                               | 41                               | -  | -                            | 53                               | 55                               | -   |
| Fluoride                          | mg/L      | 0.6                               | -   | 0.6                               | 0.6   | 2.6                              | 3.0                              | -  | 3                            | 2.7                              | 3.3                              | -   |
| Nitrate as N                      | mg/L      | ND (0.1)                          | -   | ND (0.1)                          | ND (0.1)  | ND (0.1)                         | ND (0.1)                         | -  | -                            | ND (0.1)                         | ND (0.1)                         | -   |
| Nitrite as N                      | mg/L      | ND (0.05)                         | -   | ND (0.05)                         | ND (0.05)                                       | ND (0.05)                        | ND (0.05)                        | -  | -                            | ND (0.05)                        | ND (0.05)                        | -   |
| Sulphate                          | mg/L      | 5                                 | -   | 4                                 | 4   | ND (1)                           | 1                                | -  | -                            | 5                                | 7                                | -   |
| <b>Metals</b>                     |           |                                   |   |                                   |   |                                  |                                  |  |                              |                                  |                                  |   |
| Mercury                           | mg/L      | -                                 | -   | -                                 | -   | -                                | -                                | -  | -                            | -                                | ND (0.0001)                      | ND (0.0001)                                     |
| Aluminum                          | mg/L      | -                                 | -   | -                                 | 0.023   | -                                | 1.59                             | 0.282  | -                            | -                                | 0.194                            | 0.003   |
| Antimony                          | mg/L      | -                                 | -   | -                                 | ND (0.0005)                                     | -                                | ND (0.0005)                      | 0.0006   | -                            | -                                | ND (0.0005)                      | 0.0012  |
| Arsenic                           | mg/L      | -                                 | -   | -                                 | ND (0.001)                                      | -                                | ND (0.001)                       | ND (0.001)                                     | -                            | -                                | 0.002                            | 0.002   |
| Barium                            | mg/L      | -                                 | -   | -                                 | 0.241   | -                                | 0.277                            | 0.142  | -                            | -                                | 0.184                            | 0.169   |
| Beryllium                         | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.0005)                      | ND (0.0005)                                    | -                            | -                                | ND (0.0005)                      | ND (0.0005)                                     |
| Boron                             | mg/L      | -                                 | -   | -                                 | 0.31  | -                                | 0.45                             | 0.53   | -                            | -                                | 0.44                             | 0.53  |
| Cadmium                           | mg/L      | -                                 | -   | -                                 | ND (0.0001)                                     | -                                | ND (0.0001)                      | ND (0.0001)                                    | -                            | -                                | ND (0.0001)                      | ND (0.0001)                                     |
| Calcium                           | mg/L      | -                                 | -   | -                                 | -   | 2.7                              | 3.3                              | 2.0  | -                            | 2.7                              | 3.0                              | 2.9   |
| Chromium                          | mg/L      | -                                 | -   | -                                 | ND (0.001)                                      | -                                | ND (0.001)                       | ND (0.001)                                     | -                            | -                                | ND (0.001)                       | ND (0.001)                                      |
| Cobalt                            | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.0005)                      | ND (0.0005)                                    | -                            | -                                | ND (0.0005)                      | ND (0.0005)                                     |
| Copper                            | mg/L      | -                                 | -   | -                                 | ND (0.0005)                                     | -                                | ND (0.0005)                      | 0.0005   | -                            | -                                | ND (0.0005)                      | ND (0.0005)                                     |
| Iron                              | mg/L      | -                                 | ND (0.1)  | -                                 | ND (0.1)  | 1.3                              | 0.9                              | ND (0.1)                                       | -                            | 0.2                              | 0.2                              | ND (0.1)  |
| Lead                              | mg/L      | -                                 | -   | -                                 | ND (0.0001)                                     | -                                | 0.0005                           | ND (0.0001)                                    | -                            | -                                | ND (0.0001)                      | ND (0.0001)                                     |
| Magnesium                         | mg/L      | -                                 | 7.1   | -                                 | 7.0   | 1.0                              | 1.3                              | 0.6  | -                            | 1.0                              | 1.1                              | 0.9   |
| Manganese                         | mg/L      | -                                 | 0.007   | -                                 | 0.006   | 0.015                            | 0.017                            | ND (0.005)                                     | -                            | ND (0.005)                       | ND (0.005)                       | ND (0.005)                                      |
| Molybdenum                        | mg/L      | -                                 | -   | -                                 | -   | -                                | 0.0014                           | 0.0019   | -                            | -                                | 0.0014                           | 0.0018  |
| Nickel                            | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.001)                       | ND (0.001)                                     | -                            | -                                | ND (0.001)                       | ND (0.001)                                      |
| Potassium                         | mg/L      | -                                 | 7.8   | -                                 | 7.5   | 2.8                              | 3.1                              | 1.9  | -                            | 2.3                              | 2.6                              | 2.2   |
| Selenium                          | mg/L      | -                                 | -   | -                                 | ND (0.001)                                      | -                                | ND (0.001)                       | ND (0.001)                                     | -                            | -                                | 0.001                            | ND (0.001)                                      |
| Silver                            | mg/L      | -                                 | 80.4  | -                                 | 79.9  | -                                | ND (0.0001)                      | 0.0003   | -                            | -                                | ND (0.0001)                      | ND (0.0001)                                     |
| Sodium                            | mg/L      | -                                 | -   | -                                 | -   | 160                              | 173                              | 146  | -                            | 163                              | 184                              | 162   |
| Strontium                         | mg/L      | -                                 | -   | -                                 | -   | -                                | 0.21                             | 0.17   | -                            | -                                | 0.26                             | 0.28  |
| Thallium                          | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.001)                       | ND (0.001)                                     | -                            | -                                | ND (0.001)                       | ND (0.001)                                      |
| Tin                               | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.01)                        | ND (0.01)                                      | -                            | -                                | ND (0.01)                        | ND (0.01)                                       |
| Titanium                          | mg/L      | -                                 | -   | -                                 | -   | -                                | 0.083                            | ND (0.005)                                     | -                            | -                                | 0.008                            | ND (0.005)                                      |
| Tungsten                          | mg/L      | -                                 | -   | -                                 | -   | -                                | ND (0.01)                        | ND (0.01)                                      | -                            | -                                | ND (0.01)                        | ND (0.01)                                       |
| Uranium                           | mg/L      | -                                 | -   | -                                 | ND (0.0001)                                     | -                                | 0.0003                           | 0.0002   | -                            | -                                | 0.0003                           | 0.0004  |
| Vanadium                          | mg/L      | -                                 | -   | -                                 | -   | -                                | 0.0022                           | 0.0005   | -                            | -                                | ND (0.0005)                      | ND (0.0005)                                     |
| Zinc                              | mg/L      | -                                 | -   | -                                 | ND (0.005)                                      | -                                | 0.006                            | ND (0.005)                                     | -                            | -                                | ND (0.005)                       | ND (0.005)                                      |

**Water Quality Summary  
Proposed Water Supply Wells**

| Parameter                         | Units     | TW22-03             | TW22-03             | TW22-03 6hr         | TW22-03 6hr         | TW22-04 6hr         | TW22-04 6hr         | TW22-4              | TW24-5              | TW24-5 (Filtered)   |
|-----------------------------------|-----------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|
|                                   |           | Lab ID: 2209298-01  | Lab ID: 2215531-01  | Lab ID: 2218541-02  | (Filtered)          | Lab ID: 2236417-02  | (Filtered)          | Lab ID: 2351202-01  | Lab ID: 2404291-01  | Lab ID: 2404291-02  |
| Sample Date (m/d/y)               |           | 02/24/2022 10:55 AM | 04/07/2022 01:00 PM | 04/28/2022 03:15 PM | 04/28/2022 03:15 PM | 09/01/2022 04:00 PM | 09/01/2022 04:00 PM | 12/19/2023 02:30 PM | 01/24/2024 02:25 PM | 01/24/2024 02:25 PM |
| GEMTEC ASSIGNED WELL ID           |           | TW22-3              |                     |                     |                     | TW22-4              |                     |                     | TW24-5              |                     |
| <b>Microbiological Parameters</b> |           |                     |                     |                     |                     |                     |                     |                     |                     |                     |
| E. Coli                           | CFU/100mL | -                   | ND (1)              | ND (1)              | -                   | -                   | -                   | ND (1)              | ND (1)              | N/A                 |
| Fecal Coliforms                   | CFU/100mL | -                   | ND (1)              | ND (1)              | -                   | -                   | -                   | ND (1)              | 1                   | N/A                 |
| Total Coliforms                   | CFU/100mL | -                   | ND (1)              | ND (1)              | -                   | -                   | -                   | ND (1)              | ND (1)              | N/A                 |
| Heterotrophic                     | CFU/mL    | -                   | -                   | -                   | -                   | -                   | -                   | 10                  | ND (10)             | N/A                 |
| <b>General Inorganics</b>         |           |                     |                     |                     |                     |                     |                     |                     |                     |                     |
| Alkalinity, total                 | mg/L      | -                   | 227                 | 218                 | -                   | 239                 | -                   | 252                 | 189                 | N/A                 |
| Ammonia as N                      | mg/L      | -                   | 0.31                | 0.34                | -                   | 0.37                | -                   | 0.36                | 0.45                | N/A                 |
| Dissolved Orgar                   | mg/L      | -                   | 1.3                 | 1.8                 | -                   | 1.6                 | -                   | 0.8                 | 1.7                 | N/A                 |
| Colour                            | TCU       | -                   | 7                   | 11                  | -                   | 29                  | -                   | 2                   | 2                   | N/A                 |
| Colour, apparer                   | ACU       | -                   | 100                 | 289                 | -                   | 474                 | -                   | 5                   | 12                  | N/A                 |
| Conductivity                      | uS/cm     | -                   | 516                 | 544                 | -                   | 481                 | -                   | 516                 | 480                 | N/A                 |
| Hardness                          | mg/L      | -                   | 11.4                | 15.6                | -                   | 12.6                | -                   | 6.69                | 31.7                | N/A                 |
| pH                                | pH Units  | -                   | 9.2                 | 9.2                 | -                   | 8.9                 | -                   | 9.4                 | 8.8                 | N/A                 |
| Phenolics                         | mg/L      | -                   | ND (0.001)          | ND (0.001)          | -                   | ND (0.001)          | -                   | ND (0.001)          | ND (0.001)          | N/A                 |
| Total Dissolved                   | mg/L      | -                   | 304                 | 306                 | -                   | 308                 | -                   | 268                 | 248                 | N/A                 |
| Sulphide                          | mg/L      | -                   | 1.48                | 2.31                | -                   | 0.05                | -                   | 0.23                | 2.34                | N/A                 |
| Tannin & Lignin                   | mg/L      | -                   | ND (0.1)            | 1.5                 | -                   | 0.2                 | -                   | ND (0.1)            | 0.4                 | N/A                 |
| Total Kjeldahl N                  | mg/L      | -                   | 0.4                 | 0.4                 | -                   | 0.4                 | -                   | 0.3                 | 0.4                 | N/A                 |
| Organic Nitroge                   | mg/L      | -                   | 0.09                | 0.06                | -                   | 0.03                | -                   | 0                   | 0                   | -                   |
| Turbidity                         | NTU       | -                   | 18.1                | 54.6                | -                   | 93.9                | -                   | 0.5                 | 1.4                 | N/A                 |
| <b>Anions</b>                     |           |                     |                     |                     |                     |                     |                     |                     |                     |                     |
| Chloride                          | mg/L      | 22                  | 35                  | 39                  | -                   | 8                   | -                   | 15                  | 29                  | N/A                 |
| Fluoride                          | mg/L      | 1.3                 | 1.4                 | 1.3                 | -                   | 1.3                 | -                   | 1.1                 | 0.8                 | N/A                 |
| Nitrate as N                      | mg/L      | ND (0.1)            | ND (0.1)            | ND (0.1)            | -                   | 0.2                 | -                   | ND (0.1)            | ND (0.1)            | N/A                 |
| Nitrite as N                      | mg/L      | ND (0.05)           | ND (0.05)           | ND (0.05)           | -                   | ND (0.10)           | -                   | ND (0.05)           | ND (0.05)           | N/A                 |
| Sulphate                          | mg/L      | -                   | 2                   | 2                   | -                   | ND (1)              | -                   | ND (1)              | 8                   | N/A                 |
| <b>Metals</b>                     |           |                     |                     |                     |                     |                     |                     |                     |                     |                     |
| Mercury                           | mg/L      | -                   | -                   | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         |
| Aluminum                          | mg/L      | -                   | -                   | 0.573               | 0.007               | 0.762               | 0.028               | 0.047               | 0.050               | 0.023               |
| Antimony                          | mg/L      | -                   | -                   | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         |
| Arsenic                           | mg/L      | -                   | -                   | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          |
| Barium                            | mg/L      | -                   | -                   | 0.044               | 0.027               | 0.077               | 0.053               | 0.052               | 0.151               | 0.137               |
| Beryllium                         | mg/L      | -                   | -                   | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         |
| Boron                             | mg/L      | -                   | -                   | 0.33                | 0.33                | 0.44                | 0.46                | 0.36                | 0.27                | 0.24                |
| Cadmium                           | mg/L      | -                   | -                   | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         |
| Calcium                           | mg/L      | -                   | 3.3                 | 4.5                 | 1.7                 | 3.2                 | 1.4                 | 1.7                 | 8.2                 | 7.4                 |
| Chromium                          | mg/L      | -                   | -                   | 0.001               | ND (0.001)          | 0.001               | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          |
| Cobalt                            | mg/L      | -                   | -                   | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         |
| Copper                            | mg/L      | -                   | -                   | ND (0.0005)         | ND (0.0005)         | 0.0009              | 0.0013              | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         |
| Iron                              | mg/L      | -                   | 0.3                 | 0.9                 | ND (0.1)            | 1.1                 | ND (0.1)            | ND (0.1)            | ND (0.1)            | ND (0.1)            |
| Lead                              | mg/L      | -                   | -                   | 0.0001              | ND (0.0001)         | 0.0005              | ND (0.0001)         | 0.0002              | ND (0.0001)         | ND (0.0001)         |
| Magnesium                         | mg/L      | -                   | 0.8                 | 1.1                 | 0.5                 | 1.1                 | 0.5                 | 0.6                 | 2.8                 | 2.7                 |
| Manganese                         | mg/L      | -                   | 0.012               | 0.027               | ND (0.005)          | 0.026               | ND (0.005)          | ND (0.005)          | ND (0.005)          | ND (0.005)          |
| Molybdenum                        | mg/L      | -                   | -                   | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | 0.0005              | ND (0.0005)         |
| Nickel                            | mg/L      | -                   | -                   | ND (0.001)          | ND (0.001)          | 0.001               | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          |
| Potassium                         | mg/L      | -                   | 1.3                 | 1.4                 | 1.2                 | 1.6                 | 1.4                 | 1.6                 | 3.3                 | 3.3                 |
| Selenium                          | mg/L      | -                   | -                   | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          |
| Silver                            | mg/L      | -                   | -                   | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         |
| Sodium                            | mg/L      | 109                 | 106                 | 98.7                | 97.0                | 93.9                | 95.8                | 110                 | 85.5                | 85.4                |
| Strontium                         | mg/L      | -                   | -                   | 0.12                | 0.11                | 0.08                | 0.07                | 0.09                | 0.45                | 0.41                |
| Thallium                          | mg/L      | -                   | -                   | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          | ND (0.001)          |
| Tin                               | mg/L      | -                   | -                   | ND (0.01)           | ND (0.01)           | -                   | -                   | -                   | -                   | -                   |
| Titanium                          | mg/L      | -                   | -                   | 0.040               | ND (0.005)          | -                   | -                   | -                   | -                   | -                   |
| Tungsten                          | mg/L      | -                   | -                   | ND (0.01)           | ND (0.01)           | -                   | -                   | -                   | -                   | -                   |
| Uranium                           | mg/L      | -                   | -                   | ND (0.0001)         | ND (0.0001)         | 0.0001              | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         | ND (0.0001)         |
| Vanadium                          | mg/L      | -                   | -                   | 0.0016              | ND (0.0005)         | 0.0019              | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         | ND (0.0005)         |
| Zinc                              | mg/L      | -                   | -                   | ND (0.005)          | ND (0.005)          | ND (0.005)          | ND (0.005)          | ND (0.005)          | ND (0.005)          | ND (0.005)          |

## Certificate of Analysis

### GEMTEC Consulting Engineers and Scientists Limited

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 13240

Report Date: 24-Nov-2021  
Order Date: 19-Nov-2021

**Order #: 2147532**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID   | Comment  |
|------------|-------------|--|
| 2147532-01 | TW21-01 3hr | Comment: TW21-01 in this COC is identified PW21-01 in the report |
| 2147532-02 | TW21-01 6hr |  |

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis

Report Date: 24-Nov-2021

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 19-Nov-2021

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 22-Nov-21       | 22-Nov-21     |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 23-Nov-21       | 23-Nov-21     |
| Anions                      | EPA 300.1 - IC                         | 19-Nov-21       | 19-Nov-21     |
| Colour                      | SM2120 - Spectrophotometric            | 19-Nov-21       | 19-Nov-21     |
| Colour, apparent            | SM2120 - Spectrophotometric            | 19-Nov-21       | 19-Nov-21     |
| Conductivity                | EPA 9050A- probe @25 °C                | 22-Nov-21       | 22-Nov-21     |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 22-Nov-21       | 22-Nov-21     |
| E. coli                     | MOE E3407                              | 19-Nov-21       | 19-Nov-21     |
| Fecal Coliform              | SM 9222D                               | 19-Nov-21       | 19-Nov-21     |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 19-Nov-21       | 19-Nov-21     |
| pH                          | EPA 150.1 - pH probe @25 °C            | 22-Nov-21       | 22-Nov-21     |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 22-Nov-21       | 22-Nov-21     |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 19-Nov-21       | 19-Nov-21     |
| Sulphide                    | SM 4500SE - Colourimetric              | 22-Nov-21       | 22-Nov-21     |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 22-Nov-21       | 22-Nov-21     |
| Total Coliform              | MOE E3407                              | 19-Nov-21       | 19-Nov-21     |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 22-Nov-21       | 23-Nov-21     |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 22-Nov-21       | 22-Nov-21     |
| Turbidity                   | SM 2130B - Turbidity meter             | 19-Nov-21       | 19-Nov-21     |

Certificate of Analysis

Report Date: 24-Nov-2021

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 19-Nov-2021

Client PO:

Project Description: 100812.001

|  | Client ID:   | TW21-01 3hr     | TW21-01 6hr     | - | - |
|--|--------------|-----------------|-----------------|---|---|
|  | Sample Date: | 18-Nov-21 11:40 | 18-Nov-21 14:40 | - | - |
|  | Sample ID:   | 2147532-01      | 2147532-02      | - | - |
|  | MDL/Units    | Drinking Water  | Drinking Water  | - | - |

**Microbiological Parameters**

| Parameter       | MDL/Units   | 2147532-01 | 2147532-02 | - | - |
|-----------------|-------------|------------|------------|---|---|
| E. coli         | 1 CFU/100mL | ND [1]     | ND [1]     | - | - |
| Fecal Coliforms | 1 CFU/100mL | ND         | ND         | - | - |
| Total Coliforms | 1 CFU/100mL | ND [1]     | ND [1]     | - | - |

**General Inorganics**

| Parameter                | MDL/Units    | 2147532-01 | 2147532-02 | - | - |
|--------------------------|--------------|------------|------------|---|---|
| Alkalinity, total        | 5 mg/L       | 224        | 223        | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.55       | 0.57       | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.8        | 1.4        | - | - |
| Colour                   | 2 TCU        | 5          | 4          | - | - |
| Colour, apparent         | 2 ACU        | 14         | 11         | - | - |
| Conductivity             | 5 uS/cm      | 508        | 476        | - | - |
| Hardness                 | mg/L         | 45.7       | 45.6       | - | - |
| pH                       | 0.1 pH Units | 8.4        | 8.3        | - | - |
| Phenolics                | 0.001 mg/L   | <0.001     | <0.001     | - | - |
| Total Dissolved Solids   | 10 mg/L      | 264        | 250        | - | - |
| Sulphide                 | 0.02 mg/L    | 0.29       | 0.31       | - | - |
| Tannin & Lignin          | 0.1 mg/L     | 0.2        | 0.2        | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.6        | 0.6        | - | - |
| Turbidity                | 0.1 NTU      | 1.5        | 0.8        | - | - |

**Anions**

| Parameter    | MDL/Units | 2147532-01 | 2147532-02 | - | - |
|--------------|-----------|------------|------------|---|---|
| Chloride     | 1 mg/L    | 19         | 17         | - | - |
| Fluoride     | 0.1 mg/L  | 0.6        | 0.6        | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1       | <0.1       | - | - |
| Nitrite as N | 0.05 mg/L | <0.05      | <0.05      | - | - |
| Sulphate     | 1 mg/L    | 5          | 4          | - | - |

**Metals**

| Parameter | MDL/Units   | 2147532-01 | 2147532-02 | - | - |
|-----------|-------------|------------|------------|---|---|
| Aluminum  | 0.001 mg/L  | -          | 0.023      | - | - |
| Antimony  | 0.0005 mg/L | -          | <0.0005    | - | - |
| Arsenic   | 0.001 mg/L  | -          | <0.001     | - | - |
| Barium    | 0.001 mg/L  | -          | 0.241      | - | - |
| Boron     | 0.01 mg/L   | -          | 0.31       | - | - |
| Cadmium   | 0.0001 mg/L | -          | <0.0001    | - | - |
| Calcium   | 0.1 mg/L    | 6.7        | 6.7        | - | - |
| Chromium  | 0.001 mg/L  | -          | <0.001     | - | - |
| Copper    | 0.0005 mg/L | -          | <0.0005    | - | - |
| Iron      | 0.1 mg/L    | <0.1       | <0.1       | - | - |

Certificate of Analysis

Report Date: 24-Nov-2021

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 19-Nov-2021

Client PO:

**Project Description: 100812.001**

|           |                  | <b>Client ID:</b>   | TW21-01 3hr     | TW21-01 6hr     | - | - |
|-----------|------------------|---------------------|-----------------|-----------------|---|---|
|           |                  | <b>Sample Date:</b> | 18-Nov-21 11:40 | 18-Nov-21 14:40 | - | - |
|           |                  | <b>Sample ID:</b>   | 2147532-01      | 2147532-02      | - | - |
|           | <b>MDL/Units</b> |                     | Drinking Water  | Drinking Water  | - | - |
| Lead      | 0.0001 mg/L      |                     | -               | <0.0001         | - | - |
| Magnesium | 0.2 mg/L         |                     | 7.1             | 7.0             | - | - |
| Manganese | 0.005 mg/L       |                     | 0.007           | 0.006           | - | - |
| Potassium | 0.1 mg/L         |                     | 7.8             | 7.5             | - | - |
| Selenium  | 0.001 mg/L       |                     | -               | <0.001          | - | - |
| Sodium    | 0.2 mg/L         |                     | 80.4            | 79.9            | - | - |
| Uranium   | 0.0001 mg/L      |                     | -               | <0.0001         | - | - |
| Zinc      | 0.005 mg/L       |                     | -               | <0.005          | - | - |

Certificate of Analysis

Report Date: 24-Nov-2021

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 19-Nov-2021

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Aluminum                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Antimony                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Arsenic                           | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Barium                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Boron                             | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Cadmium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Chromium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Copper                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Lead                              | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |

Certificate of Analysis

Report Date: 24-Nov-2021

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 19-Nov-2021

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 618    | 5               | mg/L      | 614           |      |            | 0.7  | 10        |       |
| Fluoride                          | 0.16   | 0.1             | mg/L      | 0.17          |      |            | 4.5  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 158    | 1               | mg/L      | 153           |      |            | 3.3  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 290    | 5               | mg/L      | 293           |      |            | 1.1  | 14        |       |
| Ammonia as N                      | 0.070  | 0.01            | mg/L      | 0.052         |      |            | NC   | 17.7      |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      | ND            |      |            | NC   | 37        |       |
| Colour                            | 4      | 2               | TCU       | 4             |      |            | 0.0  | 12        |       |
| Colour, apparent                  | 14     | 2               | ACU       | 14            |      |            | 0.0  | 12        |       |
| Conductivity                      | 2680   | 5               | uS/cm     | 2760          |      |            | 2.8  | 5         |       |
| pH                                | 7.0    | 0.1             | pH Units  | 7.2           |      |            | 2.3  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 74.0   | 10              | mg/L      | 72.0          |      |            | 2.7  | 10        |       |
| Sulphide                          | 0.29   | 0.02            | mg/L      | 0.29          |      |            | 2.4  | 10        |       |
| Tannin & Lignin                   | 0.1    | 0.1             | mg/L      | 0.1           |      |            | 8.6  | 11        |       |
| Total Kjeldahl Nitrogen           | 0.60   | 0.1             | mg/L      | 0.63          |      |            | 5.0  | 16        |       |
| Turbidity                         | 1.6    | 0.1             | NTU       | 1.5           |      |            | 3.9  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Aluminum                          | 0.044  | 0.001           | mg/L      | 0.043         |      |            | 1.5  | 20        |       |
| Antimony                          | 0.0008 | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Arsenic                           | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Barium                            | 0.008  | 0.001           | mg/L      | 0.008         |      |            | 2.0  | 20        |       |
| Boron                             | 0.34   | 0.01            | mg/L      | 0.34          |      |            | 0.3  | 20        |       |
| Cadmium                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Calcium                           | 0.3    | 0.1             | mg/L      | 0.3           |      |            | 0.0  | 20        |       |
| Chromium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Copper                            | 0.0059 | 0.0005          | mg/L      | 0.0062        |      |            | 5.6  | 20        |       |
| Iron                              | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 20        |       |
| Lead                              | 0.0004 | 0.0001          | mg/L      | 0.0003        |      |            | 10.1 | 20        |       |
| Magnesium                         | ND     | 0.2             | mg/L      | ND            |      |            | NC   | 20        |       |
| Manganese                         | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 0.1    | 0.1             | mg/L      | ND            |      |            | NC   | 20        |       |
| Selenium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Sodium                            | 97.8   | 0.2             | mg/L      | 102           |      |            | 4.4  | 20        |       |
| Uranium                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Zinc                              | 0.009  | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        | BAC14 |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        | BAC14 |



Certificate of Analysis

Report Date: 24-Nov-2021

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 19-Nov-2021

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 9.71   | 1               | mg/L  | ND            | 97.1 | 85-115     |     |           |       |
| Fluoride                  | 1.01   | 0.1             | mg/L  | 0.17          | 84.6 | 79-121     |     |           |       |
| Nitrate as N              | 1.08   | 0.1             | mg/L  | ND            | 108  | 79-120     |     |           |       |
| Nitrite as N              | 1.02   | 0.05            | mg/L  | ND            | 102  | 84-117     |     |           |       |
| Sulphate                  | 161    | 1               | mg/L  | 153           | 85.5 | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.308  | 0.01            | mg/L  | 0.052         | 102  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 9.5    | 0.5             | mg/L  | ND            | 94.5 | 60-133     |     |           |       |
| Phenolics                 | 0.024  | 0.001           | mg/L  | ND            | 94.3 | 69-132     |     |           |       |
| Total Dissolved Solids    | 90.0   | 10              | mg/L  | ND            | 90.0 | 75-125     |     |           |       |
| Sulphide                  | 0.77   | 0.02            | mg/L  | 0.29          | 95.8 | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | 0.1           | 85.5 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.78   | 0.1             | mg/L  | 0.63          | 107  | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Aluminum                  | 85.9   | 0.001           | mg/L  | 43.2          | 85.4 | 80-120     |     |           |       |
| Antimony                  | 41.4   | 0.0005          | mg/L  | 0.353         | 82.1 | 80-120     |     |           |       |
| Arsenic                   | 48.5   | 0.001           | mg/L  | 0.468         | 96.1 | 80-120     |     |           |       |
| Barium                    | 51.0   | 0.001           | mg/L  | 8.29          | 85.5 | 80-120     |     |           |       |
| Boron                     | 43.1   | 0.01            | mg/L  | ND            | 86.2 | 80-120     |     |           |       |
| Cadmium                   | 40.3   | 0.0001          | mg/L  | 0.0012        | 80.7 | 80-120     |     |           |       |
| Calcium                   | 8370   | 0.1             | mg/L  | 312           | 80.5 | 80-120     |     |           |       |
| Chromium                  | 43.8   | 0.001           | mg/L  | 0.186         | 87.1 | 80-120     |     |           |       |
| Copper                    | 47.2   | 0.0005          | mg/L  | 6.23          | 82.0 | 80-120     |     |           |       |
| Iron                      | 2310   | 0.1             | mg/L  | 41.4          | 90.5 | 80-120     |     |           |       |
| Lead                      | 41.7   | 0.0001          | mg/L  | 0.332         | 82.7 | 80-120     |     |           |       |
| Magnesium                 | 8470   | 0.2             | mg/L  | 37.0          | 84.3 | 80-120     |     |           |       |
| Manganese                 | 43.4   | 0.005           | mg/L  | 1.09          | 84.5 | 80-120     |     |           |       |
| Potassium                 | 9220   | 0.1             | mg/L  | 94.7          | 91.3 | 80-120     |     |           |       |
| Selenium                  | 44.1   | 0.001           | mg/L  | 0.069         | 88.1 | 80-120     |     |           |       |
| Sodium                    | 8670   | 0.2             | mg/L  | ND            | 86.7 | 80-120     |     |           |       |
| Uranium                   | 41.6   | 0.0001          | mg/L  | 0.0207        | 83.2 | 80-120     |     |           |       |
| Zinc                      | 43.8   | 0.005           | mg/L  | 3.80          | 80.1 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 24-Nov-2021

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 19-Nov-2021

Client PO:

**Project Description: 100812.001**

**Qualifier Notes:**

*Sample Qualifiers :*

1 : A2C - Background counts greater than 200

*QC Qualifiers :*

BAC14 : A2C - Background counts greater than 200

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 15384

Report Date: 10-Feb-2022  
Order Date: 2-Feb-2022

**Order #: 2206260**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID               |
|------------|-------------------------|
| 2206260-01 | TW22-02 3hr             |
| 2206260-02 | TW22-02 6hr             |
| 2206260-03 | TW22-02 6 hr (Filtered) |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 3-Feb-22        | 3-Feb-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 3-Feb-22        | 3-Feb-22      |
| Anions                      | EPA 300.1 - IC                         | 2-Feb-22        | 2-Feb-22      |
| Colour                      | SM2120 - Spectrophotometric            | 2-Feb-22        | 3-Feb-22      |
| Colour, apparent            | SM2120 - Spectrophotometric            | 2-Feb-22        | 3-Feb-22      |
| Conductivity                | EPA 9050A- probe @25 °C                | 3-Feb-22        | 3-Feb-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 3-Feb-22        | 3-Feb-22      |
| E. coli                     | MOE E3407                              | 2-Feb-22        | 2-Feb-22      |
| Fecal Coliform              | SM 9222D                               | 2-Feb-22        | 2-Feb-22      |
| Heterotrophic Plate Count   | SM 9215C                               | 2-Feb-22        | 2-Feb-22      |
| Mercury by CVAA             | EPA 245.2 - Cold Vapour AA             | 7-Feb-22        | 7-Feb-22      |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 3-Feb-22        | 3-Feb-22      |
| pH                          | EPA 150.1 - pH probe @25 °C            | 3-Feb-22        | 3-Feb-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 3-Feb-22        | 3-Feb-22      |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 3-Feb-22        | 3-Feb-22      |
| Sulphide                    | SM 4500SE - Colourimetric              | 3-Feb-22        | 3-Feb-22      |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 7-Feb-22        | 7-Feb-22      |
| Total Coliform              | MOE E3407                              | 2-Feb-22        | 2-Feb-22      |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 4-Feb-22        | 7-Feb-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 3-Feb-22        | 4-Feb-22      |
| Turbidity                   | SM 2130B - Turbidity meter             | 3-Feb-22        | 3-Feb-22      |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

|                     |                 |                 |                            |   |
|---------------------|-----------------|-----------------|----------------------------|---|
| <b>Client ID:</b>   | TW22-02 3hr     | TW22-02 6hr     | TW22-02 6 hr<br>(Filtered) | - |
| <b>Sample Date:</b> | 01-Feb-22 11:30 | 01-Feb-22 14:30 | 01-Feb-22 14:30            | - |
| <b>Sample ID:</b>   | 2206260-01      | 2206260-02      | 2206260-03                 | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water  | Drinking Water             | - |

**Microbiological Parameters**

|                           |             |     |     |   |   |
|---------------------------|-------------|-----|-----|---|---|
| E. coli                   | 1 CFU/100mL | ND  | ND  | - | - |
| Fecal Coliforms           | 1 CFU/100mL | ND  | ND  | - | - |
| Total Coliforms           | 1 CFU/100mL | ND  | ND  | - | - |
| Heterotrophic Plate Count | 10 CFU/mL   | <10 | <10 | - | - |

**General Inorganics**

|                          |              |        |        |   |   |
|--------------------------|--------------|--------|--------|---|---|
| Alkalinity, total        | 5 mg/L       | 319    | 348    | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.29   | 0.30   | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.3    | 0.7    | - | - |
| Colour                   | 2 TCU        | 3      | 3      | - | - |
| Colour, apparent         | 2 ACU        | 24     | 26     | - | - |
| Conductivity             | 5 uS/cm      | 816    | 855    | - | - |
| Hardness                 | mg/L         | 10.7   | 12.1   | - | - |
| pH                       | 0.1 pH Units | 9.0    | 8.9    | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | <0.001 | - | - |
| Total Dissolved Solids   | 10 mg/L      | 452    | 468    | - | - |
| Sulphide                 | 0.02 mg/L    | 2.78   | 3.08   | - | - |
| Tannin & Lignin          | 0.1 mg/L     | <0.1   | <0.1   | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.4    | 0.4    | - | - |
| Turbidity                | 0.1 NTU      | 4.0    | 4.2    | - | - |

**Anions**

|              |           |       |       |   |   |
|--------------|-----------|-------|-------|---|---|
| Chloride     | 1 mg/L    | 53    | 55    | - | - |
| Fluoride     | 0.1 mg/L  | 2.7   | 3.3   | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | <0.1  | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | <0.05 | - | - |
| Sulphate     | 1 mg/L    | 5     | 7     | - | - |

**Metals**

|           |             |   |         |         |   |
|-----------|-------------|---|---------|---------|---|
| Mercury   | 0.0001 mg/L | - | <0.0001 | <0.0001 | - |
| Aluminum  | 0.001 mg/L  | - | 0.194   | 0.003   | - |
| Antimony  | 0.0005 mg/L | - | <0.0005 | 0.0012  | - |
| Arsenic   | 0.001 mg/L  | - | 0.002   | 0.002   | - |
| Barium    | 0.001 mg/L  | - | 0.184   | 0.169   | - |
| Beryllium | 0.0005 mg/L | - | <0.0005 | <0.0005 | - |
| Boron     | 0.01 mg/L   | - | 0.44    | 0.53    | - |
| Cadmium   | 0.0001 mg/L | - | <0.0001 | <0.0001 | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

|            | Client ID:   | TW22-02 3hr     | TW22-02 6hr     | TW22-02 6 hr (Filtered) | - |
|------------|--------------|-----------------|-----------------|-------------------------|---|
|            | Sample Date: | 01-Feb-22 11:30 | 01-Feb-22 14:30 | 01-Feb-22 14:30         | - |
|            | Sample ID:   | 2206260-01      | 2206260-02      | 2206260-03              | - |
|            | MDL/Units    | Drinking Water  | Drinking Water  | Drinking Water          | - |
| Calcium    | 0.1 mg/L     | 2.7             | 3.0             | 2.9                     | - |
| Chromium   | 0.001 mg/L   | -               | <0.001          | <0.001                  | - |
| Cobalt     | 0.0005 mg/L  | -               | <0.0005         | <0.0005                 | - |
| Copper     | 0.0005 mg/L  | -               | <0.0005         | <0.0005                 | - |
| Iron       | 0.1 mg/L     | 0.2             | 0.2             | <0.1                    | - |
| Lead       | 0.0001 mg/L  | -               | <0.0001         | <0.0001                 | - |
| Magnesium  | 0.2 mg/L     | 1.0             | 1.1             | 0.9                     | - |
| Manganese  | 0.005 mg/L   | <0.005          | <0.005          | <0.005                  | - |
| Molybdenum | 0.0005 mg/L  | -               | 0.0014          | 0.0018                  | - |
| Nickel     | 0.001 mg/L   | -               | <0.001          | <0.001                  | - |
| Potassium  | 0.1 mg/L     | 2.3             | 2.6             | 2.2                     | - |
| Selenium   | 0.001 mg/L   | -               | 0.001           | <0.001                  | - |
| Silver     | 0.0001 mg/L  | -               | <0.0001         | <0.0001                 | - |
| Sodium     | 0.2 mg/L     | 163             | 184             | 162                     | - |
| Strontium  | 0.01 mg/L    | -               | 0.26            | 0.28                    | - |
| Thallium   | 0.001 mg/L   | -               | <0.001          | <0.001                  | - |
| Tin        | 0.01 mg/L    | -               | <0.01           | <0.01                   | - |
| Titanium   | 0.005 mg/L   | -               | 0.008           | <0.005                  | - |
| Tungsten   | 0.01 mg/L    | -               | <0.01           | <0.01                   | - |
| Uranium    | 0.0001 mg/L  | -               | 0.0003          | 0.0004                  | - |
| Vanadium   | 0.0005 mg/L  | -               | <0.0005         | <0.0005                 | - |
| Zinc       | 0.005 mg/L   | -               | <0.005          | <0.005                  | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Mercury                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Aluminum                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Antimony                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Arsenic                           | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Barium                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Beryllium                         | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Boron                             | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Cadmium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Chromium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Cobalt                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Copper                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Lead                              | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Molybdenum                        | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Nickel                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Silver                            | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Strontium                         | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Thallium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Tin                               | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Titanium                          | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Tungsten                          | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Vanadium                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    |               |      |            |     |           |       |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 55.3   | 1               | mg/L      | 55.2          |      |            | 0.2  | 10        |       |
| Fluoride                          | 3.33   | 0.1             | mg/L      | 3.30          |      |            | 0.9  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 7.40   | 1               | mg/L      | 7.40          |      |            | 0.1  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 315    | 5               | mg/L      | 319           |      |            | 1.2  | 14        |       |
| Ammonia as N                      | 0.301  | 0.01            | mg/L      | 0.315         |      |            | 4.4  | 17.7      |       |
| Dissolved Organic Carbon          | 0.9    | 0.5             | mg/L      | 1.3           |      |            | 36.1 | 37        |       |
| Colour                            | 3      | 2               | TCU       | 3             |      |            | 0.0  | 12        |       |
| Colour, apparent                  | 27     | 2               | ACU       | 26            |      |            | 3.8  | 12        |       |
| Conductivity                      | 806    | 5               | uS/cm     | 816           |      |            | 1.1  | 5         |       |
| pH                                | 9.0    | 0.1             | pH Units  | 9.0           |      |            | 0.3  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 648    | 10              | mg/L      | 664           |      |            | 2.4  | 10        |       |
| Sulphide                          | ND     | 0.02            | mg/L      | ND            |      |            | NC   | 10        |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 11        |       |
| Total Kjeldahl Nitrogen           | 0.34   | 0.1             | mg/L      | 0.37          |      |            | 8.6  | 16        |       |
| Turbidity                         | 4.0    | 0.1             | NTU       | 4.0           |      |            | 0.5  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Mercury                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Aluminum                          | 0.219  | 0.001           | mg/L      | 0.291         |      |            | 28.5 | 20        | QR-05 |
| Antimony                          | 0.0007 | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Arsenic                           | 0.003  | 0.001           | mg/L      | 0.002         |      |            | 1.9  | 20        |       |
| Barium                            | 0.159  | 0.001           | mg/L      | 0.160         |      |            | 0.4  | 20        |       |
| Beryllium                         | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Boron                             | 0.44   | 0.01            | mg/L      | 0.44          |      |            | 2.1  | 20        |       |
| Cadmium                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Calcium                           | 2.6    | 0.1             | mg/L      | 2.7           |      |            | 2.9  | 20        |       |
| Chromium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Cobalt                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Copper                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Iron                              | 0.1    | 0.1             | mg/L      | 0.2           |      |            | 9.0  | 20        |       |
| Lead                              | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Magnesium                         | 0.9    | 0.2             | mg/L      | 1.0           |      |            | 5.9  | 20        |       |
| Manganese                         | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| Molybdenum                        | 0.0014 | 0.0005          | mg/L      | 0.0015        |      |            | 7.7  | 20        |       |
| Nickel                            | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 2.3    | 0.1             | mg/L      | 2.3           |      |            | 0.3  | 20        |       |
| Selenium                          | ND     | 0.001           | mg/L      | 0.002         |      |            | NC   | 20        |       |
| Silver                            | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Sodium                            | 168    | 0.2             | mg/L      | 163           |      |            | 3.0  | 20        |       |
| Thallium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Tin                               | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Titanium                          | 0.008  | 0.005           | mg/L      | 0.010         |      |            | 18.3 | 50        |       |
| Tungsten                          | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Uranium                           | 0.0004 | 0.0001          | mg/L      | 0.0005        |      |            | 1.9  | 20        |       |
| Vanadium                          | 0.0005 | 0.0005          | mg/L      | 0.0006        |      |            | 19.5 | 20        |       |
| Zinc                              | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    | ND            |      |            | NC   | 30        |       |



Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 63.1   | 1               | mg/L  | 55.2          | 79.0 | 77-123     |     |           |       |
| Fluoride                  | 4.18   | 0.1             | mg/L  | 3.30          | 87.5 | 79-121     |     |           |       |
| Nitrate as N              | 0.97   | 0.1             | mg/L  | ND            | 96.9 | 79-120     |     |           |       |
| Nitrite as N              | 0.835  | 0.05            | mg/L  | ND            | 83.5 | 84-117     |     |           | QM-07 |
| Sulphate                  | 17.1   | 1               | mg/L  | 7.40          | 97.1 | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.570  | 0.01            | mg/L  | 0.315         | 102  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 12.4   | 0.5             | mg/L  | 1.3           | 111  | 60-133     |     |           |       |
| Phenolics                 | 0.027  | 0.001           | mg/L  | ND            | 110  | 67-133     |     |           |       |
| Total Dissolved Solids    | 104    | 10              | mg/L  | ND            | 104  | 75-125     |     |           |       |
| Sulphide                  | 0.50   | 0.02            | mg/L  | ND            | 100  | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 96.8 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.22   | 0.1             | mg/L  | 0.37          | 92.3 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | 0.0033 | 0.0001          | mg/L  | ND            | 109  | 70-130     |     |           |       |
| Aluminum                  | 44.6   | 0.001           | mg/L  | ND            | 89.2 | 80-120     |     |           |       |
| Antimony                  | 48.8   | 0.0005          | mg/L  | 0.306         | 97.0 | 80-120     |     |           |       |
| Arsenic                   | 50.0   | 0.001           | mg/L  | 2.46          | 95.1 | 80-120     |     |           |       |
| Barium                    | 192    | 0.001           | mg/L  | 160           | 63.8 | 80-120     |     |           | QM-07 |
| Beryllium                 | 39.8   | 0.0005          | mg/L  | 0.0242        | 79.6 | 80-120     |     |           | QM-07 |
| Boron                     | 41.5   | 0.01            | mg/L  | ND            | 83.1 | 80-120     |     |           |       |
| Cadmium                   | 44.7   | 0.0001          | mg/L  | 0.0026        | 89.4 | 80-120     |     |           |       |
| Calcium                   | 12500  | 0.1             | mg/L  | 2700          | 97.7 | 80-120     |     |           |       |
| Chromium                  | 46.1   | 0.001           | mg/L  | 0.439         | 91.4 | 80-120     |     |           |       |
| Cobalt                    | 44.8   | 0.0005          | mg/L  | 0.0399        | 89.4 | 80-120     |     |           |       |
| Copper                    | 39.6   | 0.0005          | mg/L  | 0.422         | 78.4 | 80-120     |     |           | QM-07 |
| Iron                      | 2440   | 0.1             | mg/L  | 152           | 91.6 | 80-120     |     |           |       |
| Lead                      | 39.1   | 0.0001          | mg/L  | 0.0874        | 78.0 | 80-120     |     |           | QM-07 |
| Magnesium                 | 10700  | 0.2             | mg/L  | 951           | 97.6 | 80-120     |     |           |       |
| Manganese                 | 47.0   | 0.005           | mg/L  | 2.30          | 89.4 | 80-120     |     |           |       |
| Molybdenum                | 42.3   | 0.0005          | mg/L  | 1.50          | 81.7 | 80-120     |     |           |       |
| Nickel                    | 42.2   | 0.001           | mg/L  | 0.217         | 84.0 | 80-120     |     |           |       |
| Potassium                 | 12400  | 0.1             | mg/L  | 2330          | 100  | 80-120     |     |           |       |
| Selenium                  | 37.7   | 0.001           | mg/L  | 1.94          | 71.6 | 80-120     |     |           | QM-07 |
| Silver                    | 37.0   | 0.0001          | mg/L  | 0.0945        | 73.7 | 80-120     |     |           | QM-07 |
| Sodium                    | 9320   | 0.2             | mg/L  | ND            | 93.2 | 80-120     |     |           |       |
| Thallium                  | 41.3   | 0.001           | mg/L  | 0.016         | 82.5 | 80-120     |     |           |       |
| Tin                       | 42.2   | 0.01            | mg/L  | 0.22          | 84.1 | 80-120     |     |           |       |
| Titanium                  | 46.8   | 0.005           | mg/L  | ND            | 93.6 | 70-130     |     |           |       |
| Tungsten                  | 42.6   | 0.01            | mg/L  | 0.55          | 84.1 | 80-120     |     |           |       |
| Uranium                   | 42.4   | 0.0001          | mg/L  | 0.454         | 83.9 | 80-120     |     |           |       |
| Vanadium                  | 48.2   | 0.0005          | mg/L  | 0.619         | 95.2 | 80-120     |     |           |       |
| Zinc                      | 41.9   | 0.005           | mg/L  | 1.96          | 79.8 | 80-120     |     |           | QM-07 |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Qualifier Notes:**

*Sample Qualifiers :*

*QC Qualifiers :*

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

QR-05 : Duplicate RPDs higher than normally accepted. Remaining batch QA/QC was acceptable. May be sample effect.

QS-02 : Spike level outside of control limits. Analysis batch accepted based on other QC included in the batch.

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 15387

Report Date: 8-Feb-2022  
Order Date: 2-Feb-2022

**Order #: 2206338**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID |
|------------|-----------|
| 2206338-01 | PW-939    |
| 2206338-02 | PW-1014   |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 3-Feb-22        | 3-Feb-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 3-Feb-22        | 3-Feb-22      |
| Anions                      | EPA 300.1 - IC                         | 3-Feb-22        | 3-Feb-22      |
| Colour                      | SM2120 - Spectrophotometric            | 4-Feb-22        | 4-Feb-22      |
| Colour, apparent            | SM2120 - Spectrophotometric            | 4-Feb-22        | 4-Feb-22      |
| Conductivity                | EPA 9050A- probe @25 °C                | 3-Feb-22        | 3-Feb-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 3-Feb-22        | 3-Feb-22      |
| E. coli                     | MOE E3407                              | 3-Feb-22        | 3-Feb-22      |
| Fecal Coliform              | SM 9222D                               | 3-Feb-22        | 3-Feb-22      |
| Heterotrophic Plate Count   | SM 9215C                               | 3-Feb-22        | 3-Feb-22      |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 3-Feb-22        | 3-Feb-22      |
| pH                          | EPA 150.1 - pH probe @25 °C            | 3-Feb-22        | 3-Feb-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 3-Feb-22        | 3-Feb-22      |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 3-Feb-22        | 3-Feb-22      |
| Sulphide                    | SM 4500SE - Colourimetric              | 3-Feb-22        | 3-Feb-22      |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 7-Feb-22        | 7-Feb-22      |
| Total Coliform              | MOE E3407                              | 3-Feb-22        | 3-Feb-22      |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 4-Feb-22        | 7-Feb-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 3-Feb-22        | 4-Feb-22      |
| Turbidity                   | SM 2130B - Turbidity meter             | 3-Feb-22        | 3-Feb-22      |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

|  | Client ID:   | PW-939          | PW-1014         | - | - |
|--|--------------|-----------------|-----------------|---|---|
|  | Sample Date: | 02-Feb-22 12:00 | 02-Feb-22 12:00 | - | - |
|  | Sample ID:   | 2206338-01      | 2206338-02      | - | - |
|  | MDL/Units    | Drinking Water  | Drinking Water  | - | - |

**Microbiological Parameters**

| Parameter                 | MDL/Units   | PW-939 | PW-1014 | - | - |
|---------------------------|-------------|--------|---------|---|---|
| E. coli                   | 1 CFU/100mL | ND     | ND [1]  | - | - |
| Fecal Coliforms           | 1 CFU/100mL | ND     | ND      | - | - |
| Total Coliforms           | 1 CFU/100mL | ND     | ND [1]  | - | - |
| Heterotrophic Plate Count | 10 CFU/mL   | <10    | <10     | - | - |

**General Inorganics**

| Parameter                | MDL/Units    | PW-939 | PW-1014 | - | - |
|--------------------------|--------------|--------|---------|---|---|
| Alkalinity, total        | 5 mg/L       | 172    | 241     | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.53   | 0.31    | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.1    | <0.5    | - | - |
| Colour                   | 2 TCU        | 3      | 5       | - | - |
| Colour, apparent         | 2 ACU        | 5      | 13      | - | - |
| Conductivity             | 5 uS/cm      | 384    | 572     | - | - |
| Hardness                 | mg/L         | 39.2   | 6.33    | - | - |
| pH                       | 0.1 pH Units | 8.4    | 9.0     | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | <0.001  | - | - |
| Total Dissolved Solids   | 10 mg/L      | 208    | 324     | - | - |
| Sulphide                 | 0.02 mg/L    | 1.12   | 4.61    | - | - |
| Tannin & Lignin          | 0.1 mg/L     | <0.1   | <0.1    | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.6    | 0.3     | - | - |
| Turbidity                | 0.1 NTU      | 1.2    | 2.0     | - | - |

**Anions**

| Parameter    | MDL/Units | PW-939 | PW-1014 | - | - |
|--------------|-----------|--------|---------|---|---|
| Chloride     | 1 mg/L    | 13     | 39      | - | - |
| Fluoride     | 0.1 mg/L  | 0.6    | 1.1     | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1   | <0.1    | - | - |
| Nitrite as N | 0.05 mg/L | <0.05  | <0.05   | - | - |
| Sulphate     | 1 mg/L    | <1     | 3       | - | - |

**Metals**

| Parameter | MDL/Units  | PW-939 | PW-1014 | - | - |
|-----------|------------|--------|---------|---|---|
| Calcium   | 0.1 mg/L   | 7.0    | 1.8     | - | - |
| Iron      | 0.1 mg/L   | <0.1   | 0.2     | - | - |
| Magnesium | 0.2 mg/L   | 5.3    | 0.4     | - | - |
| Manganese | 0.005 mg/L | <0.005 | <0.005  | - | - |
| Potassium | 0.1 mg/L   | 5.2    | 1.5     | - | - |
| Sodium    | 0.2 mg/L   | 64.8   | 124     | - | - |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    |               |      |            |     |           |       |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 38.9   | 1               | mg/L      | 38.7          |      |            | 0.6  | 10        |       |
| Fluoride                          | 1.16   | 0.1             | mg/L      | 1.08          |      |            | 7.7  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 3.33   | 1               | mg/L      | 3.28          |      |            | 1.6  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 315    | 5               | mg/L      | 319           |      |            | 1.2  | 14        |       |
| Ammonia as N                      | 0.301  | 0.01            | mg/L      | 0.315         |      |            | 4.4  | 17.7      |       |
| Dissolved Organic Carbon          | 0.9    | 0.5             | mg/L      | 1.3           |      |            | 36.1 | 37        |       |
| Colour                            | 3      | 2               | TCU       | 3             |      |            | 0.0  | 12        |       |
| Colour, apparent                  | 5      | 2               | ACU       | 5             |      |            | 0.0  | 12        |       |
| Conductivity                      | 806    | 5               | uS/cm     | 816           |      |            | 1.1  | 5         |       |
| pH                                | 9.0    | 0.1             | pH Units  | 9.0           |      |            | 0.3  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 648    | 10              | mg/L      | 664           |      |            | 2.4  | 10        |       |
| Sulphide                          | ND     | 0.02            | mg/L      | ND            |      |            | NC   | 10        |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 11        |       |
| Total Kjeldahl Nitrogen           | 0.34   | 0.1             | mg/L      | 0.37          |      |            | 8.6  | 16        |       |
| Turbidity                         | 4.0    | 0.1             | NTU       | 4.0           |      |            | 0.5  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Calcium                           | 2.6    | 0.1             | mg/L      | 2.7           |      |            | 2.9  | 20        |       |
| Iron                              | 0.1    | 0.1             | mg/L      | 0.2           |      |            | 9.0  | 20        |       |
| Magnesium                         | 0.9    | 0.2             | mg/L      | 1.0           |      |            | 5.9  | 20        |       |
| Manganese                         | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 2.3    | 0.1             | mg/L      | 2.3           |      |            | 0.3  | 20        |       |
| Sodium                            | 168    | 0.2             | mg/L      | 163           |      |            | 3.0  | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    | ND            |      |            | NC   | 30        |       |



Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 47.9   | 1               | mg/L  | 38.7          | 91.8 | 77-123     |     |           |       |
| Fluoride                  | 1.93   | 0.1             | mg/L  | 1.08          | 84.9 | 79-121     |     |           |       |
| Nitrate as N              | 1.09   | 0.1             | mg/L  | ND            | 109  | 79-120     |     |           |       |
| Nitrite as N              | 0.956  | 0.05            | mg/L  | ND            | 95.6 | 84-117     |     |           |       |
| Sulphate                  | 13.2   | 1               | mg/L  | 3.28          | 98.7 | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.570  | 0.01            | mg/L  | 0.315         | 102  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 12.4   | 0.5             | mg/L  | 1.3           | 111  | 60-133     |     |           |       |
| Phenolics                 | 0.027  | 0.001           | mg/L  | ND            | 110  | 67-133     |     |           |       |
| Total Dissolved Solids    | 104    | 10              | mg/L  | ND            | 104  | 75-125     |     |           |       |
| Sulphide                  | 0.50   | 0.02            | mg/L  | ND            | 100  | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 96.8 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.22   | 0.1             | mg/L  | 0.37          | 92.3 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Calcium                   | 12500  | 0.1             | mg/L  | 2700          | 97.7 | 80-120     |     |           |       |
| Iron                      | 2440   | 0.1             | mg/L  | 152           | 91.6 | 80-120     |     |           |       |
| Magnesium                 | 10700  | 0.2             | mg/L  | 951           | 97.6 | 80-120     |     |           |       |
| Manganese                 | 47.0   | 0.005           | mg/L  | 2.30          | 89.4 | 80-120     |     |           |       |
| Potassium                 | 12400  | 0.1             | mg/L  | 2330          | 100  | 80-120     |     |           |       |
| Sodium                    | 9320   | 0.2             | mg/L  | ND            | 93.2 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 2-Feb-2022

Client PO:

**Project Description: 100812.001**

**Qualifier Notes:**

*Login Qualifiers :*

Container(s) - Labeled improperly/insufficient information - No project/sample time on bottles.

*Applies to samples: PW-939, PW-1014*

*Sample Qualifiers :*

1 : A2C - Background counts greater than 200

*QC Qualifiers :*

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 15383

Report Date: 10-Feb-2022  
Order Date: 2-Feb-2022

**Order #: 2206352**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID              |
|------------|------------------------|
| 2206352-01 | TW22-01 3hr            |
| 2206352-02 | TW22-01 6hr            |
| 2206352-03 | TW22-01 6hr (Filtered) |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 3-Feb-22        | 3-Feb-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 3-Feb-22        | 3-Feb-22      |
| Anions                      | EPA 300.1 - IC                         | 3-Feb-22        | 4-Feb-22      |
| Colour                      | SM2120 - Spectrophotometric            | 4-Feb-22        | 4-Feb-22      |
| Colour, apparent            | SM2120 - Spectrophotometric            | 4-Feb-22        | 4-Feb-22      |
| Conductivity                | EPA 9050A- probe @25 °C                | 3-Feb-22        | 3-Feb-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 3-Feb-22        | 3-Feb-22      |
| E. coli                     | MOE E3407                              | 3-Feb-22        | 3-Feb-22      |
| Fecal Coliform              | SM 9222D                               | 3-Feb-22        | 3-Feb-22      |
| Heterotrophic Plate Count   | SM 9215C                               | 3-Feb-22        | 3-Feb-22      |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 3-Feb-22        | 3-Feb-22      |
| pH                          | EPA 150.1 - pH probe @25 °C            | 3-Feb-22        | 3-Feb-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 3-Feb-22        | 3-Feb-22      |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 3-Feb-22        | 3-Feb-22      |
| Sulphide                    | SM 4500SE - Colourimetric              | 3-Feb-22        | 3-Feb-22      |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 7-Feb-22        | 7-Feb-22      |
| Total Coliform              | MOE E3407                              | 3-Feb-22        | 3-Feb-22      |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 4-Feb-22        | 7-Feb-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 7-Feb-22        | 8-Feb-22      |
| Turbidity                   | SM 2130B - Turbidity meter             | 3-Feb-22        | 3-Feb-22      |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

|                     |                 |                 |                           |   |
|---------------------|-----------------|-----------------|---------------------------|---|
| <b>Client ID:</b>   | TW22-01 3hr     | TW22-01 6hr     | TW22-01 6hr<br>(Filtered) | - |
| <b>Sample Date:</b> | 02-Feb-22 11:20 | 02-Feb-22 14:20 | 02-Feb-22 14:20           | - |
| <b>Sample ID:</b>   | 2206352-01      | 2206352-02      | 2206352-03                | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water  | Drinking Water            | - |

**Microbiological Parameters**

|                           |             |         |         |   |   |
|---------------------------|-------------|---------|---------|---|---|
| E. coli                   | 1 CFU/100mL | <10 [1] | <10 [1] | - | - |
| Fecal Coliforms           | 1 CFU/100mL | <10 [1] | <10 [1] | - | - |
| Total Coliforms           | 1 CFU/100mL | <10 [1] | <10 [1] | - | - |
| Heterotrophic Plate Count | 10 CFU/mL   | 10      | <10     | - | - |

**General Inorganics**

|                          |              |        |        |   |   |
|--------------------------|--------------|--------|--------|---|---|
| Alkalinity, total        | 5 mg/L       | 327    | 353    | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.37   | 0.38   | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.5    | 1.5    | - | - |
| Colour                   | 2 TCU        | 9      | 14     | - | - |
| Colour, apparent         | 2 ACU        | 764    | 1000   | - | - |
| Conductivity             | 5 uS/cm      | 706    | 828    | - | - |
| Hardness                 | mg/L         | 10.8   | 13.6   | - | - |
| pH                       | 0.1 pH Units | 9.2    | 9.1    | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | <0.001 | - | - |
| Total Dissolved Solids   | 10 mg/L      | 436    | 472    | - | - |
| Sulphide                 | 0.02 mg/L    | 1.77   | 3.75   | - | - |
| Tannin & Lignin          | 0.1 mg/L     | 0.3    | 0.3    | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.5    | 0.6    | - | - |
| Turbidity                | 0.1 NTU      | 140    | 190    | - | - |

**Anions**

|              |           |       |       |   |   |
|--------------|-----------|-------|-------|---|---|
| Chloride     | 1 mg/L    | 28    | 41    | - | - |
| Fluoride     | 0.1 mg/L  | 2.6   | 3.0   | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | <0.1  | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | <0.05 | - | - |
| Sulphate     | 1 mg/L    | <1    | 1     | - | - |

**Metals**

|           |             |     |         |         |   |
|-----------|-------------|-----|---------|---------|---|
| Aluminum  | 0.001 mg/L  | -   | 1.59    | 0.282   | - |
| Antimony  | 0.0005 mg/L | -   | <0.0005 | 0.0006  | - |
| Arsenic   | 0.001 mg/L  | -   | <0.001  | <0.001  | - |
| Barium    | 0.001 mg/L  | -   | 0.277   | 0.142   | - |
| Beryllium | 0.0005 mg/L | -   | <0.0005 | <0.0005 | - |
| Boron     | 0.01 mg/L   | -   | 0.45    | 0.53    | - |
| Cadmium   | 0.0001 mg/L | -   | <0.0001 | <0.0001 | - |
| Calcium   | 0.1 mg/L    | 2.7 | 3.3     | 2.0     | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

|            | Client ID:   | TW22-01 3hr     | TW22-01 6hr     | TW22-01 6hr<br>(Filtered) | - |
|------------|--------------|-----------------|-----------------|---------------------------|---|
|            | Sample Date: | 02-Feb-22 11:20 | 02-Feb-22 14:20 | 02-Feb-22 14:20           | - |
|            | Sample ID:   | 2206352-01      | 2206352-02      | 2206352-03                | - |
|            | MDL/Units    | Drinking Water  | Drinking Water  | Drinking Water            | - |
| Chromium   | 0.001 mg/L   | -               | <0.001          | <0.001                    | - |
| Cobalt     | 0.0005 mg/L  | -               | <0.0005         | <0.0005                   | - |
| Copper     | 0.0005 mg/L  | -               | <0.0005         | 0.0005                    | - |
| Iron       | 0.1 mg/L     | 1.3             | 0.9             | <0.1                      | - |
| Lead       | 0.0001 mg/L  | -               | 0.0005          | <0.0001                   | - |
| Magnesium  | 0.2 mg/L     | 1.0             | 1.3             | 0.6                       | - |
| Manganese  | 0.005 mg/L   | 0.015           | 0.017           | <0.005                    | - |
| Molybdenum | 0.0005 mg/L  | -               | 0.0014          | 0.0019                    | - |
| Nickel     | 0.001 mg/L   | -               | <0.001          | <0.001                    | - |
| Potassium  | 0.1 mg/L     | 2.8             | 3.1             | 1.9                       | - |
| Selenium   | 0.001 mg/L   | -               | <0.001          | <0.001                    | - |
| Silver     | 0.0001 mg/L  | -               | <0.0001         | 0.0003                    | - |
| Sodium     | 0.2 mg/L     | 160             | 173             | 146                       | - |
| Strontium  | 0.01 mg/L    | -               | 0.21            | 0.17                      | - |
| Thallium   | 0.001 mg/L   | -               | <0.001          | <0.001                    | - |
| Tin        | 0.01 mg/L    | -               | <0.01           | <0.01                     | - |
| Titanium   | 0.005 mg/L   | -               | 0.083           | <0.005                    | - |
| Tungsten   | 0.01 mg/L    | -               | <0.01           | <0.01                     | - |
| Uranium    | 0.0001 mg/L  | -               | 0.0003          | 0.0002                    | - |
| Vanadium   | 0.0005 mg/L  | -               | 0.0022          | 0.0005                    | - |
| Zinc       | 0.005 mg/L   | -               | 0.006           | <0.005                    | - |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Aluminum                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Antimony                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Arsenic                           | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Barium                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Beryllium                         | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Boron                             | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Cadmium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Chromium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Cobalt                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Copper                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Lead                              | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Molybdenum                        | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Nickel                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Silver                            | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Strontium                         | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Thallium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Tin                               | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Titanium                          | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Tungsten                          | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Vanadium                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    |               |      |            |     |           |       |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 38.9   | 1               | mg/L      | 38.7          |      |            | 0.6  | 10        |       |
| Fluoride                          | 1.16   | 0.1             | mg/L      | 1.08          |      |            | 7.7  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 3.33   | 1               | mg/L      | 3.28          |      |            | 1.6  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 315    | 5               | mg/L      | 319           |      |            | 1.2  | 14        |       |
| Ammonia as N                      | 0.301  | 0.01            | mg/L      | 0.315         |      |            | 4.4  | 17.7      |       |
| Dissolved Organic Carbon          | 0.9    | 0.5             | mg/L      | 1.3           |      |            | 36.1 | 37        |       |
| Colour                            | 3      | 2               | TCU       | 3             |      |            | 0.0  | 12        |       |
| Colour, apparent                  | 5      | 2               | ACU       | 5             |      |            | 0.0  | 12        |       |
| Conductivity                      | 806    | 5               | uS/cm     | 816           |      |            | 1.1  | 5         |       |
| pH                                | 9.0    | 0.1             | pH Units  | 9.0           |      |            | 0.3  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 648    | 10              | mg/L      | 664           |      |            | 2.4  | 10        |       |
| Sulphide                          | ND     | 0.02            | mg/L      | ND            |      |            | NC   | 10        |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 11        |       |
| Total Kjeldahl Nitrogen           | 0.49   | 0.1             | mg/L      | 0.55          |      |            | 11.4 | 16        |       |
| Turbidity                         | 4.0    | 0.1             | NTU       | 4.0           |      |            | 0.5  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Aluminum                          | 0.219  | 0.001           | mg/L      | 0.291         |      |            | 28.5 | 20        | QR-05 |
| Antimony                          | 0.0007 | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Arsenic                           | 0.003  | 0.001           | mg/L      | 0.002         |      |            | 1.9  | 20        |       |
| Barium                            | 0.159  | 0.001           | mg/L      | 0.160         |      |            | 0.4  | 20        |       |
| Beryllium                         | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Boron                             | 0.44   | 0.01            | mg/L      | 0.44          |      |            | 2.1  | 20        |       |
| Cadmium                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Calcium                           | 2.6    | 0.1             | mg/L      | 2.7           |      |            | 2.9  | 20        |       |
| Chromium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Cobalt                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Copper                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Iron                              | 0.1    | 0.1             | mg/L      | 0.2           |      |            | 9.0  | 20        |       |
| Lead                              | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Magnesium                         | 0.9    | 0.2             | mg/L      | 1.0           |      |            | 5.9  | 20        |       |
| Manganese                         | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| Molybdenum                        | 0.0014 | 0.0005          | mg/L      | 0.0015        |      |            | 7.7  | 20        |       |
| Nickel                            | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 2.3    | 0.1             | mg/L      | 2.3           |      |            | 0.3  | 20        |       |
| Selenium                          | ND     | 0.001           | mg/L      | 0.002         |      |            | NC   | 20        |       |
| Silver                            | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Sodium                            | 168    | 0.2             | mg/L      | 163           |      |            | 3.0  | 20        |       |
| Thallium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Tin                               | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Titanium                          | 0.008  | 0.005           | mg/L      | 0.010         |      |            | 18.3 | 50        |       |
| Tungsten                          | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Uranium                           | 0.0004 | 0.0001          | mg/L      | 0.0005        |      |            | 1.9  | 20        |       |
| Vanadium                          | 0.0005 | 0.0005          | mg/L      | 0.0006        |      |            | 19.5 | 20        |       |
| Zinc                              | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Fecal Coliforms                   | ND     | 10              | CFU/100mL | ND            |      |            | NC   | 30        | BAC09 |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    | 10            |      |            | NC   | 30        |       |



Certificate of Analysis

Report Date: 10-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 47.9   | 1               | mg/L  | 38.7          | 91.8 | 77-123     |     |           |       |
| Fluoride                  | 1.93   | 0.1             | mg/L  | 1.08          | 84.9 | 79-121     |     |           |       |
| Nitrate as N              | 1.09   | 0.1             | mg/L  | ND            | 109  | 79-120     |     |           |       |
| Nitrite as N              | 0.956  | 0.05            | mg/L  | ND            | 95.6 | 84-117     |     |           |       |
| Sulphate                  | 13.2   | 1               | mg/L  | 3.28          | 98.7 | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.570  | 0.01            | mg/L  | 0.315         | 102  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 12.4   | 0.5             | mg/L  | 1.3           | 111  | 60-133     |     |           |       |
| Phenolics                 | 0.027  | 0.001           | mg/L  | ND            | 110  | 67-133     |     |           |       |
| Total Dissolved Solids    | 104    | 10              | mg/L  | ND            | 104  | 75-125     |     |           |       |
| Sulphide                  | 0.50   | 0.02            | mg/L  | ND            | 100  | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 96.8 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.46   | 0.1             | mg/L  | 0.55          | 95.7 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Aluminum                  | 44.6   | 0.001           | mg/L  | ND            | 89.2 | 80-120     |     |           |       |
| Antimony                  | 48.8   | 0.0005          | mg/L  | 0.306         | 97.0 | 80-120     |     |           |       |
| Arsenic                   | 50.0   | 0.001           | mg/L  | 2.46          | 95.1 | 80-120     |     |           |       |
| Barium                    | 192    | 0.001           | mg/L  | 160           | 63.8 | 80-120     |     |           | QM-07 |
| Beryllium                 | 39.8   | 0.0005          | mg/L  | 0.0242        | 79.6 | 80-120     |     |           | QM-07 |
| Boron                     | 41.5   | 0.01            | mg/L  | ND            | 83.1 | 80-120     |     |           |       |
| Cadmium                   | 44.7   | 0.0001          | mg/L  | 0.0026        | 89.4 | 80-120     |     |           |       |
| Calcium                   | 12500  | 0.1             | mg/L  | 2700          | 97.7 | 80-120     |     |           |       |
| Chromium                  | 46.1   | 0.001           | mg/L  | 0.439         | 91.4 | 80-120     |     |           |       |
| Cobalt                    | 44.8   | 0.0005          | mg/L  | 0.0399        | 89.4 | 80-120     |     |           |       |
| Copper                    | 39.6   | 0.0005          | mg/L  | 0.422         | 78.4 | 80-120     |     |           | QM-07 |
| Iron                      | 2440   | 0.1             | mg/L  | 152           | 91.6 | 80-120     |     |           |       |
| Lead                      | 39.1   | 0.0001          | mg/L  | 0.0874        | 78.0 | 80-120     |     |           | QM-07 |
| Magnesium                 | 10700  | 0.2             | mg/L  | 951           | 97.6 | 80-120     |     |           |       |
| Manganese                 | 47.0   | 0.005           | mg/L  | 2.30          | 89.4 | 80-120     |     |           |       |
| Molybdenum                | 42.3   | 0.0005          | mg/L  | 1.50          | 81.7 | 80-120     |     |           |       |
| Nickel                    | 42.2   | 0.001           | mg/L  | 0.217         | 84.0 | 80-120     |     |           |       |
| Potassium                 | 12400  | 0.1             | mg/L  | 2330          | 100  | 80-120     |     |           |       |
| Selenium                  | 37.7   | 0.001           | mg/L  | 1.94          | 71.6 | 80-120     |     |           | QM-07 |
| Silver                    | 37.0   | 0.0001          | mg/L  | 0.0945        | 73.7 | 80-120     |     |           | QM-07 |
| Sodium                    | 9320   | 0.2             | mg/L  | ND            | 93.2 | 80-120     |     |           |       |
| Thallium                  | 41.3   | 0.001           | mg/L  | 0.016         | 82.5 | 80-120     |     |           |       |
| Tin                       | 42.2   | 0.01            | mg/L  | 0.22          | 84.1 | 80-120     |     |           |       |
| Titanium                  | 46.8   | 0.005           | mg/L  | ND            | 93.6 | 70-130     |     |           |       |
| Tungsten                  | 42.6   | 0.01            | mg/L  | 0.55          | 84.1 | 80-120     |     |           |       |
| Uranium                   | 42.4   | 0.0001          | mg/L  | 0.454         | 83.9 | 80-120     |     |           |       |
| Vanadium                  | 48.2   | 0.0005          | mg/L  | 0.619         | 95.2 | 80-120     |     |           |       |
| Zinc                      | 41.9   | 0.005           | mg/L  | 1.96          | 79.8 | 80-120     |     |           | QM-07 |

Certificate of Analysis

Report Date: 10-Feb-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 2-Feb-2022

Client PO:

**Project Description: 100812.001**

**Qualifier Notes:**

*Login Qualifiers :*

Sample - Filtered and preserved by Paracel upon receipt at the laboratory -  
*Applies to samples: TW22-1 6hr (Filtered)*

*Sample Qualifiers :*

1 : Bacteria sample was diluted due to suspended particulate matter.

*QC Qualifiers :*

BAC09 : Bacteria sample was diluted due to suspended particulate matter.

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

QR-05 : Duplicate RPDs higher than normally accepted. Remaining batch QA\QC was acceptable. May be sample effect.

QS-02 : Spike level outside of control limits. Analysis batch accepted based on other QC included in the batch.

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

subsampled from the generals bottle

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 15388

Report Date: 8-Feb-2022  
Order Date: 3-Feb-2022

**Order #: 2206385**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID |
|------------|-----------|
| 2206385-01 | MW21-01   |
| 2206385-02 | MW21-02   |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

Certificate of Analysis

Report Date: 08-Feb-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 3-Feb-2022

Client PO:

**Project Description: 100812.001**

**Analysis Summary Table**

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|----------|------------------------------|-----------------|---------------|
| Anions   | EPA 300.1 - IC               | 4-Feb-22        | 4-Feb-22      |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 3-Feb-2022

Client PO:

Project Description: 100812.001

|                     |                 |                 |   |   |
|---------------------|-----------------|-----------------|---|---|
| <b>Client ID:</b>   | MW21-01         | MW21-02         | - | - |
| <b>Sample Date:</b> | 03-Feb-22 08:59 | 03-Feb-22 09:40 | - | - |
| <b>Sample ID:</b>   | 2206385-01      | 2206385-02      | - | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water  | - | - |

**Anions**

|              |           |       |       |   |   |
|--------------|-----------|-------|-------|---|---|
| Nitrate as N | 0.1 mg/L  | 5.8   | 0.3   | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | <0.05 | - | - |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 3-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte       | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b> |        |                 |       |               |      |            |     |           |       |
| Nitrate as N  | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Nitrite as N  | ND     | 0.05            | mg/L  |               |      |            |     |           |       |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 3-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte       | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b> |        |                 |       |               |      |            |     |           |       |
| Nitrate as N  | 0.21   | 0.1             | mg/L  | 0.21          |      |            | 1.4 | 10        |       |
| Nitrite as N  | ND     | 0.05            | mg/L  | ND            |      |            | NC  | 10        |       |

Certificate of Analysis

Report Date: 08-Feb-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 3-Feb-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte       | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b> |        |                 |       |               |      |            |     |           |       |
| Nitrate as N  | 1.37   | 0.1             | mg/L  | 0.21          | 116  | 79-120     |     |           |       |
| Nitrite as N  | 0.876  | 0.05            | mg/L  | ND            | 87.6 | 84-117     |     |           |       |



Certificate of Analysis

Report Date: 08-Feb-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 3-Feb-2022

Client PO:

**Project Description: 100812.001**

**Qualifier Notes:**

None

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody:

Report Date: 17-Feb-2022  
Order Date: 15-Feb-2022

**Order #: 2208183**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Paracel ID | Client ID |  |
|------------|-----------|--|
| 2208183-01 | TW1       | Comment: TW1 in this COC is identified as TW22-1 in the report |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising shall be limited to the amount paid by you for this work, and that our employees or agents shall not under circumstances be liable to you in connection with this work

Certificate of Analysis  
Client: **GEMTEC Consulting Engineers and Scientists Limited**  
Client PO:

Report Date: 17-Feb-2022  
Order Date: 15-Feb-2022  
Project Description: **100812.001**

**Analysis Summary Table**

| Analysis | Method Reference/Description | Extraction Date | Analysis Date |
|----------|------------------------------|-----------------|---------------|
| Anions   | EPA 300.1 - IC               | 16-Feb-22       | 17-Feb-22     |

**Qualifier Notes:**

None

**Sample Data Revisions**

None

**Work Order Revisions/Comments:**

None

**Other Report Notes:**

- n/a: not applicable
- ND: Not Detected
- MDL: Method Detection Limit
- Source Result: Data used as source for matrix and duplicate samples
- %REC: Percent recovery.
- RPD: Relative percent difference.

Certificate of Analysis  
 Client: GEMTEC Consulting Engineers and Scientists Limited  
 Client PO:

Report Date: 17-Feb-2022  
 Order Date: 15-Feb-2022  
 Project Description: 100812.001

### Sample Results

| Fluoride   |           |             |       |     |        | Matrix: Drinking Water |
|------------|-----------|-------------|-------|-----|--------|------------------------|
| Parcel ID  | Client ID | Sample Date | Units | MDL | Result |                        |
| 2208183-01 | TW1       | 14-Feb-22   | mg/L  | 0.1 | 3.0    |                        |

### Laboratory Internal QA/QC

| Analyte                 | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Matrix Blank</b>     |        |                 |       |               |      |            |     |           |       |
| Fluoride                | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| <b>Matrix Duplicate</b> |        |                 |       |               |      |            |     |           |       |
| Fluoride                | ND     | 0.1             | mg/L  | ND            |      |            | NC  | 10        |       |
| <b>Matrix Spike</b>     |        |                 |       |               |      |            |     |           |       |
| Fluoride                | 0.97   | 0.1             | mg/L  | ND            | 97.5 | 83-117     |     |           |       |

## Certificate of Analysis

### GEMTEC Consulting Engineers and Scientists Limited

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100817.001  
Custody: 15630

Report Date: 13-Apr-2022  
Order Date: 7-Apr-2022

**Order #: 2215531**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID |  |
|------------|-----------|--|
| 2215531-01 | TW21-03   | Comment: TW21-03 in this COC is identified as TW22-3 in the report |
| 2215531-02 | PW-903    |  |

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis

Report Date: 13-Apr-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 7-Apr-2022

Client PO:

Project Description: 100817.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 8-Apr-22        | 8-Apr-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 13-Apr-22       | 13-Apr-22     |
| Anions                      | EPA 300.1 - IC                         | 11-Apr-22       | 11-Apr-22     |
| Colour                      | SM2120 - Spectrophotometric            | 8-Apr-22        | 8-Apr-22      |
| Colour, apparent            | SM2120 - Spectrophotometric            | 8-Apr-22        | 8-Apr-22      |
| Conductivity                | EPA 9050A- probe @25 °C                | 8-Apr-22        | 8-Apr-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 8-Apr-22        | 8-Apr-22      |
| E. coli                     | MOE E3407                              | 8-Apr-22        | 8-Apr-22      |
| Fecal Coliform              | SM 9222D                               | 8-Apr-22        | 8-Apr-22      |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 11-Apr-22       | 11-Apr-22     |
| pH                          | EPA 150.1 - pH probe @25 °C            | 8-Apr-22        | 8-Apr-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 12-Apr-22       | 12-Apr-22     |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 11-Apr-22       | 11-Apr-22     |
| Sulphide                    | SM 4500SE - Colourimetric              | 12-Apr-22       | 13-Apr-22     |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 12-Apr-22       | 13-Apr-22     |
| Total Coliform              | MOE E3407                              | 8-Apr-22        | 8-Apr-22      |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 8-Apr-22        | 8-Apr-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 11-Apr-22       | 12-Apr-22     |
| Turbidity                   | SM 2130B - Turbidity meter             | 8-Apr-22        | 8-Apr-22      |

Certificate of Analysis

Report Date: 13-Apr-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 7-Apr-2022

Client PO:

Project Description: 100817.001

|                     |                 |                 |   |   |
|---------------------|-----------------|-----------------|---|---|
| <b>Client ID:</b>   | TW21-03         | PW-903          | - | - |
| <b>Sample Date:</b> | 07-Apr-22 13:00 | 07-Apr-22 12:20 | - | - |
| <b>Sample ID:</b>   | 2215531-01      | 2215531-02      | - | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water  | - | - |

**Microbiological Parameters**

|                 |             |    |    |   |   |
|-----------------|-------------|----|----|---|---|
| E. coli         | 1 CFU/100mL | ND | ND | - | - |
| Fecal Coliforms | 1 CFU/100mL | ND | ND | - | - |
| Total Coliforms | 1 CFU/100mL | ND | 1  | - | - |

**General Inorganics**

|                          |              |        |        |   |   |
|--------------------------|--------------|--------|--------|---|---|
| Alkalinity, total        | 5 mg/L       | 227    | 224    | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.31   | 0.47   | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.3    | 1.6    | - | - |
| Colour                   | 2 TCU        | 7      | 6      | - | - |
| Colour, apparent         | 2 ACU        | 100    | 9      | - | - |
| Conductivity             | 5 uS/cm      | 516    | 462    | - | - |
| Hardness                 | mg/L         | 11.4   | 27.7   | - | - |
| pH                       | 0.1 pH Units | 9.2    | 8.6    | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | <0.001 | - | - |
| Total Dissolved Solids   | 10 mg/L      | 304    | 250    | - | - |
| Sulphide                 | 0.02 mg/L    | 1.48   | 0.90   | - | - |
| Tannin & Lignin          | 0.1 mg/L     | <0.1   | <0.1   | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.4    | 0.5    | - | - |
| Turbidity                | 0.1 NTU      | 18.1   | 0.8    | - | - |

**Anions**

|              |           |       |       |   |   |
|--------------|-----------|-------|-------|---|---|
| Chloride     | 1 mg/L    | 35    | 18    | - | - |
| Fluoride     | 0.1 mg/L  | 1.4   | 0.7   | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | <0.1  | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | <0.05 | - | - |
| Sulphate     | 1 mg/L    | 2     | 3     | - | - |

**Metals**

|           |            |       |       |   |   |
|-----------|------------|-------|-------|---|---|
| Calcium   | 0.1 mg/L   | 3.3   | 7.5   | - | - |
| Iron      | 0.1 mg/L   | 0.3   | 0.2   | - | - |
| Magnesium | 0.2 mg/L   | 0.8   | 2.1   | - | - |
| Manganese | 0.005 mg/L | 0.012 | 0.017 | - | - |
| Potassium | 0.1 mg/L   | 1.3   | 3.2   | - | - |
| Sodium    | 0.2 mg/L   | 106   | 86.0  | - | - |

Certificate of Analysis

Report Date: 13-Apr-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 7-Apr-2022

Client PO:

Project Description: 100817.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |



Certificate of Analysis

Report Date: 13-Apr-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 7-Apr-2022

Client PO:

Project Description: 100817.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 34.9   | 1               | mg/L      | 35.1          |      |            | 0.6  | 10        |       |
| Fluoride                          | 1.30   | 0.1             | mg/L      | 1.37          |      |            | 4.6  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 1.68   | 1               | mg/L      | 1.63          |      |            | 3.3  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 224    | 5               | mg/L      | 227           |      |            | 1.1  | 14        |       |
| Ammonia as N                      | 0.056  | 0.01            | mg/L      | 0.053         |      |            | 5.3  | 17.7      |       |
| Dissolved Organic Carbon          | 0.9    | 0.5             | mg/L      | 1.3           |      |            | 34.9 | 37        |       |
| Colour                            | 7      | 2               | TCU       | 7             |      |            | 0.0  | 12        |       |
| Colour, apparent                  | 100    | 2               | ACU       | 100           |      |            | 0.0  | 12        |       |
| Conductivity                      | 524    | 5               | uS/cm     | 516           |      |            | 1.5  | 5         |       |
| pH                                | 9.2    | 0.1             | pH Units  | 9.2           |      |            | 0.1  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 254    | 10              | mg/L      | 250           |      |            | 1.6  | 10        |       |
| Sulphide                          | 0.04   | 0.02            | mg/L      | 0.04          |      |            | 5.4  | 10        |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 11        |       |
| Total Kjeldahl Nitrogen           | 0.34   | 0.1             | mg/L      | 0.36          |      |            | 5.2  | 16        |       |
| Turbidity                         | 0.3    | 0.1             | NTU       | 0.3           |      |            | 3.3  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Calcium                           | 10.5   | 0.1             | mg/L      | 10.5          |      |            | 0.2  | 20        |       |
| Iron                              | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 20        |       |
| Magnesium                         | 2.6    | 0.2             | mg/L      | 2.6           |      |            | 1.8  | 20        |       |
| Manganese                         | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 0.9    | 0.1             | mg/L      | 0.9           |      |            | 4.1  | 20        |       |
| Sodium                            | 20.7   | 0.2             | mg/L      | 21.1          |      |            | 2.1  | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |

Certificate of Analysis

Report Date: 13-Apr-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 7-Apr-2022

Client PO:

Project Description: 100817.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 45.2   | 1               | mg/L  | 35.1          | 101  | 77-123     |     |           |       |
| Fluoride                  | 2.29   | 0.1             | mg/L  | 1.37          | 92.0 | 79-121     |     |           |       |
| Nitrate as N              | 1.15   | 0.1             | mg/L  | ND            | 115  | 79-120     |     |           |       |
| Nitrite as N              | 1.05   | 0.05            | mg/L  | ND            | 105  | 84-117     |     |           |       |
| Sulphate                  | 12.9   | 1               | mg/L  | 1.63          | 112  | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.305  | 0.01            | mg/L  | 0.053         | 101  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 12.6   | 0.5             | mg/L  | 1.3           | 112  | 60-133     |     |           |       |
| Phenolics                 | 0.026  | 0.001           | mg/L  | ND            | 103  | 67-133     |     |           |       |
| Total Dissolved Solids    | 92.0   | 10              | mg/L  | ND            | 92.0 | 75-125     |     |           |       |
| Sulphide                  | 0.52   | 0.02            | mg/L  | 0.04          | 96.6 | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 96.8 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.12   | 0.1             | mg/L  | 0.36          | 88.1 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Calcium                   | 18500  | 0.1             | mg/L  | 10500         | 79.9 | 80-120     |     |           | QM-07 |
| Iron                      | 2160   | 0.1             | mg/L  | 8.7           | 86.0 | 80-120     |     |           |       |
| Magnesium                 | 11800  | 0.2             | mg/L  | 2590          | 92.0 | 80-120     |     |           |       |
| Manganese                 | 48.6   | 0.005           | mg/L  | 3.94          | 89.3 | 80-120     |     |           |       |
| Potassium                 | 10200  | 0.1             | mg/L  | 872           | 93.6 | 80-120     |     |           |       |
| Sodium                    | 8700   | 0.2             | mg/L  | ND            | 87.0 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 13-Apr-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 7-Apr-2022

Client PO:

**Project Description: 100817.001**

**Qualifier Notes:**

*Sample Qualifiers :*

*QC Qualifiers :*

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 15431, 16849

Report Date: 5-May-2022  
Order Date: 29-Apr-2022

**Order #: 2218541**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID              |   |
|------------|------------------------|---|
| 2218541-02 | TW22-01 6hr            | Comment: TW22-01 in this COC is identified as TW22-03 in report |
| 2218541-03 | TW22-01 6hr (Filtered) |   |
| 2218541-04 | MW21-01                |   |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 3-May-22        | 3-May-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 29-Apr-22       | 29-Apr-22     |
| Anions                      | EPA 300.1 - IC                         | 29-Apr-22       | 29-Apr-22     |
| Colour                      | SM2120 - Spectrophotometric            | 29-Apr-22       | 29-Apr-22     |
| Colour, apparent            | SM2120 - Spectrophotometric            | 29-Apr-22       | 29-Apr-22     |
| Conductivity                | EPA 9050A- probe @25 °C                | 3-May-22        | 3-May-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 29-Apr-22       | 29-Apr-22     |
| E. coli                     | MOE E3407                              | 29-Apr-22       | 29-Apr-22     |
| Fecal Coliform              | SM 9222D                               | 29-Apr-22       | 29-Apr-22     |
| Mercury by CVAA             | EPA 245.2 - Cold Vapour AA             | 29-Apr-22       | 29-Apr-22     |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 2-May-22        | 2-May-22      |
| pH                          | EPA 150.1 - pH probe @25 °C            | 3-May-22        | 3-May-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 5-May-22        | 5-May-22      |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 2-May-22        | 2-May-22      |
| Sulphide                    | SM 4500SE - Colourimetric              | 29-Apr-22       | 29-Apr-22     |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 29-Apr-22       | 29-Apr-22     |
| Total Coliform              | MOE E3407                              | 29-Apr-22       | 29-Apr-22     |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 29-Apr-22       | 2-May-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 2-May-22        | 2-May-22      |
| Turbidity                   | SM 2130B - Turbidity meter             | 29-Apr-22       | 29-Apr-22     |

Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

|                     |                 |                           |                 |   |
|---------------------|-----------------|---------------------------|-----------------|---|
| <b>Client ID:</b>   | TW22-01 6hr     | TW22-01 6hr<br>(Filtered) | MW21-01         | - |
| <b>Sample Date:</b> | 28-Apr-22 15:15 | 28-Apr-22 15:15           | 28-Apr-22 15:58 | - |
| <b>Sample ID:</b>   | 2218541-02      | 2218541-03                | 2218541-04      | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water            | Drinking Water  | - |

**Microbiological Parameters**

|                 |             |        |   |   |   |
|-----------------|-------------|--------|---|---|---|
| E. coli         | 1 CFU/100mL | ND [1] | - | - | - |
| Fecal Coliforms | 1 CFU/100mL | ND     | - | - | - |
| Total Coliforms | 1 CFU/100mL | ND [1] | - | - | - |

**General Inorganics**

|                          |              |        |   |   |   |
|--------------------------|--------------|--------|---|---|---|
| Alkalinity, total        | 5 mg/L       | 218    | - | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.34   | - | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.8    | - | - | - |
| Colour                   | 2 TCU        | 11     | - | - | - |
| Colour, apparent         | 2 ACU        | 289    | - | - | - |
| Conductivity             | 5 uS/cm      | 544    | - | - | - |
| Hardness                 | mg/L         | 15.6   | - | - | - |
| pH                       | 0.1 pH Units | 9.2    | - | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | - | - | - |
| Total Dissolved Solids   | 10 mg/L      | 306    | - | - | - |
| Sulphide                 | 0.02 mg/L    | 2.31   | - | - | - |
| Tannin & Lignin          | 0.1 mg/L     | 1.5    | - | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.4    | - | - | - |
| Turbidity                | 0.1 NTU      | 54.6   | - | - | - |

**Anions**

|              |           |       |   |       |   |
|--------------|-----------|-------|---|-------|---|
| Chloride     | 1 mg/L    | 39    | - | -     | - |
| Fluoride     | 0.1 mg/L  | 1.3   | - | -     | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | - | 6.6   | - |
| Nitrite as N | 0.05 mg/L | <0.05 | - | <0.05 | - |
| Sulphate     | 1 mg/L    | 2     | - | -     | - |

**Metals**

|           |             |         |         |   |   |
|-----------|-------------|---------|---------|---|---|
| Mercury   | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Aluminum  | 0.001 mg/L  | 0.573   | 0.007   | - | - |
| Antimony  | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Arsenic   | 0.001 mg/L  | <0.001  | <0.001  | - | - |
| Barium    | 0.001 mg/L  | 0.044   | 0.027   | - | - |
| Beryllium | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Boron     | 0.01 mg/L   | 0.33    | 0.33    | - | - |
| Cadmium   | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Calcium   | 0.1 mg/L    | 4.5     | 1.7     | - | - |

Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

|            | MDL/Units   | TW22-01 6hr<br>28-Apr-22 15:15<br>2218541-02<br>Drinking Water | TW22-01 6hr<br>(Filtered)<br>28-Apr-22 15:15<br>2218541-03<br>Drinking Water | MW21-01<br>28-Apr-22 15:58<br>2218541-04<br>Drinking Water | - |
|------------|-------------|--|--|--|---|
| Chromium   | 0.001 mg/L  | 0.001  | <0.001   | -  | - |
| Cobalt     | 0.0005 mg/L | <0.0005  | <0.0005  | -  | - |
| Copper     | 0.0005 mg/L | <0.0005  | <0.0005  | -  | - |
| Iron       | 0.1 mg/L    | 0.9  | <0.1   | -  | - |
| Lead       | 0.0001 mg/L | 0.0001   | <0.0001  | -  | - |
| Magnesium  | 0.2 mg/L    | 1.1  | 0.5  | -  | - |
| Manganese  | 0.005 mg/L  | 0.027  | <0.005   | -  | - |
| Molybdenum | 0.0005 mg/L | <0.0005  | <0.0005  | -  | - |
| Nickel     | 0.001 mg/L  | <0.001   | <0.001   | -  | - |
| Potassium  | 0.1 mg/L    | 1.4  | 1.2  | -  | - |
| Selenium   | 0.001 mg/L  | <0.001   | <0.001   | -  | - |
| Silver     | 0.0001 mg/L | <0.0001  | <0.0001  | -  | - |
| Sodium     | 0.2 mg/L    | 98.7   | 97.0   | -  | - |
| Strontium  | 0.01 mg/L   | 0.12   | 0.11   | -  | - |
| Thallium   | 0.001 mg/L  | <0.001   | <0.001   | -  | - |
| Tin        | 0.01 mg/L   | <0.01  | <0.01  | -  | - |
| Titanium   | 0.005 mg/L  | 0.040  | <0.005   | -  | - |
| Tungsten   | 0.01 mg/L   | <0.01  | <0.01  | -  | - |
| Uranium    | 0.0001 mg/L | <0.0001  | <0.0001  | -  | - |
| Vanadium   | 0.0005 mg/L | 0.0016   | <0.0005  | -  | - |
| Zinc       | 0.005 mg/L  | <0.005   | <0.005   | -  | - |

Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |     |           |       |
| Chloride                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| Fluoride                          | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      |               |      |            |     |           |       |
| Sulphate                          | ND     | 1               | mg/L      |               |      |            |     |           |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |     |           |       |
| Alkalinity, total                 | ND     | 5               | mg/L      |               |      |            |     |           |       |
| Ammonia as N                      | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Dissolved Organic Carbon          | ND     | 0.5             | mg/L      |               |      |            |     |           |       |
| Colour                            | ND     | 2               | TCU       |               |      |            |     |           |       |
| Colour, apparent                  | ND     | 2               | ACU       |               |      |            |     |           |       |
| Conductivity                      | ND     | 5               | uS/cm     |               |      |            |     |           |       |
| Phenolics                         | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Total Dissolved Solids            | ND     | 10              | mg/L      |               |      |            |     |           |       |
| Sulphide                          | ND     | 0.02            | mg/L      |               |      |            |     |           |       |
| Tannin & Lignin                   | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Turbidity                         | ND     | 0.1             | NTU       |               |      |            |     |           |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |     |           |       |
| Mercury                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Aluminum                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Antimony                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Arsenic                           | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Barium                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Beryllium                         | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Boron                             | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Cadmium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Calcium                           | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Chromium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Cobalt                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Copper                            | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Iron                              | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Lead                              | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Molybdenum                        | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Nickel                            | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |               |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Silver                            | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |               |      |            |     |           |       |
| Strontium                         | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Thallium                          | ND     | 0.001           | mg/L      |               |      |            |     |           |       |
| Tin                               | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Titanium                          | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| Tungsten                          | ND     | 0.01            | mg/L      |               |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |               |      |            |     |           |       |
| Vanadium                          | ND     | 0.0005          | mg/L      |               |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |               |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |               |      |            |     |           |       |



Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>                     |        |                 |           |               |      |            |      |           |       |
| Chloride                          | 38.4   | 1               | mg/L      | 39.0          |      |            | 1.6  | 10        |       |
| Fluoride                          | 1.26   | 0.1             | mg/L      | 1.28          |      |            | 1.0  | 10        |       |
| Nitrate as N                      | ND     | 0.1             | mg/L      | ND            |      |            | NC   | 10        |       |
| Nitrite as N                      | ND     | 0.05            | mg/L      | ND            |      |            | NC   | 10        |       |
| Sulphate                          | 1.55   | 1               | mg/L      | 1.55          |      |            | 0.2  | 10        |       |
| <b>General Inorganics</b>         |        |                 |           |               |      |            |      |           |       |
| Alkalinity, total                 | 214    | 5               | mg/L      | 218           |      |            | 2.1  | 14        |       |
| Ammonia as N                      | 0.330  | 0.01            | mg/L      | 0.336         |      |            | 1.9  | 17.7      |       |
| Dissolved Organic Carbon          | 2.1    | 0.5             | mg/L      | 1.8           |      |            | 11.5 | 37        |       |
| Colour                            | 10     | 2               | TCU       | 11            |      |            | 9.5  | 12        |       |
| Colour, apparent                  | 288    | 2               | ACU       | 289           |      |            | 0.3  | 12        |       |
| Conductivity                      | 537    | 5               | uS/cm     | 544           |      |            | 1.3  | 5         |       |
| pH                                | 9.2    | 0.1             | pH Units  | 9.2           |      |            | 0.2  | 3.3       |       |
| Phenolics                         | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids            | 602    | 10              | mg/L      | 608           |      |            | 1.0  | 10        |       |
| Sulphide                          | 2.29   | 0.20            | mg/L      | 2.31          |      |            | 0.9  | 10        |       |
| Tannin & Lignin                   | 0.7    | 0.1             | mg/L      | 0.7           |      |            | 3.1  | 11        |       |
| Total Kjeldahl Nitrogen           | 0.32   | 0.1             | mg/L      | 0.38          |      |            | NC   | 16        |       |
| Turbidity                         | 54.4   | 0.1             | NTU       | 54.6          |      |            | 0.4  | 10        |       |
| <b>Metals</b>                     |        |                 |           |               |      |            |      |           |       |
| Mercury                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Aluminum                          | 0.050  | 0.001           | mg/L      | 0.050         |      |            | 1.3  | 20        |       |
| Antimony                          | 0.0008 | 0.0005          | mg/L      | 0.0009        |      |            | 13.1 | 20        |       |
| Arsenic                           | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Barium                            | 0.110  | 0.001           | mg/L      | 0.113         |      |            | 2.5  | 20        |       |
| Beryllium                         | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Boron                             | 0.46   | 0.01            | mg/L      | 0.47          |      |            | 2.3  | 20        |       |
| Cadmium                           | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Calcium                           | 9.7    | 0.1             | mg/L      | 9.8           |      |            | 0.5  | 20        |       |
| Chromium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Cobalt                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Copper                            | 0.0006 | 0.0005          | mg/L      | 0.0006        |      |            | 1.4  | 20        |       |
| Iron                              | 0.1    | 0.1             | mg/L      | 0.1           |      |            | 2.9  | 20        |       |
| Lead                              | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Magnesium                         | 10.0   | 0.2             | mg/L      | 10.3          |      |            | 2.2  | 20        |       |
| Manganese                         | 0.010  | 0.005           | mg/L      | 0.009         |      |            | 11.3 | 20        |       |
| Molybdenum                        | 0.0011 | 0.0005          | mg/L      | 0.0011        |      |            | 0.2  | 20        |       |
| Nickel                            | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Potassium                         | 11.2   | 0.1             | mg/L      | 11.2          |      |            | 0.0  | 20        |       |
| Selenium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Silver                            | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |       |
| Sodium                            | 240    | 0.2             | mg/L      | 235           |      |            | 2.5  | 20        |       |
| Thallium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |       |
| Tin                               | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Titanium                          | ND     | 0.005           | mg/L      | ND            |      |            | NC   | 50        |       |
| Tungsten                          | ND     | 0.01            | mg/L      | ND            |      |            | NC   | 20        |       |
| Uranium                           | 0.0002 | 0.0001          | mg/L      | 0.0002        |      |            | 7.7  | 20        |       |
| Vanadium                          | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |       |
| Zinc                              | 0.006  | 0.005           | mg/L      | ND            |      |            | NC   | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |       |

Certificate of Analysis

Report Date: 05-May-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 29-Apr-2022

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 50.0   | 1               | mg/L  | 39.0          | 110  | 77-123     |     |           |       |
| Fluoride                  | 2.17   | 0.1             | mg/L  | 1.28          | 89.4 | 79-121     |     |           |       |
| Nitrate as N              | 1.07   | 0.1             | mg/L  | ND            | 107  | 79-120     |     |           |       |
| Nitrite as N              | 0.968  | 0.05            | mg/L  | ND            | 96.8 | 84-117     |     |           |       |
| Sulphate                  | 12.1   | 1               | mg/L  | 1.55          | 105  | 74-126     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.592  | 0.01            | mg/L  | 0.336         | 102  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 11.9   | 0.5             | mg/L  | 1.8           | 100  | 60-133     |     |           |       |
| Phenolics                 | 0.024  | 0.001           | mg/L  | ND            | 97.7 | 67-133     |     |           |       |
| Total Dissolved Solids    | 106    | 10              | mg/L  | ND            | 106  | 75-125     |     |           |       |
| Sulphide                  | 0.51   | 0.02            | mg/L  | ND            | 102  | 79-115     |     |           |       |
| Tannin & Lignin           | 2.6    | 0.1             | mg/L  | 1.5           | 110  | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 2.20   | 0.1             | mg/L  | 0.38          | 91.0 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | 0.0035 | 0.0001          | mg/L  | ND            | 115  | 70-130     |     |           |       |
| Aluminum                  | 91.0   | 0.001           | mg/L  | 50.3          | 81.2 | 80-120     |     |           |       |
| Antimony                  | 35.4   | 0.0005          | mg/L  | 0.872         | 69.1 | 80-120     |     |           | QM-07 |
| Arsenic                   | 46.7   | 0.001           | mg/L  | 0.181         | 93.1 | 80-120     |     |           |       |
| Barium                    | 144    | 0.001           | mg/L  | 113           | 63.1 | 80-120     |     |           | QM-07 |
| Beryllium                 | 39.8   | 0.0005          | mg/L  | 0.0271        | 79.6 | 80-120     |     |           | QM-07 |
| Boron                     | 62.2   | 0.01            | mg/L  | 20.2          | 84.0 | 80-120     |     |           |       |
| Cadmium                   | 37.6   | 0.0001          | mg/L  | 0.0082        | 75.2 | 80-120     |     |           | QM-07 |
| Calcium                   | 17700  | 0.1             | mg/L  | 9790          | 79.6 | 80-120     |     |           | QM-07 |
| Chromium                  | 44.9   | 0.001           | mg/L  | 0.350         | 89.1 | 80-120     |     |           |       |
| Cobalt                    | 42.7   | 0.0005          | mg/L  | 0.0941        | 85.1 | 80-120     |     |           |       |
| Copper                    | 41.3   | 0.0005          | mg/L  | ND            | 82.7 | 80-120     |     |           |       |
| Iron                      | 2280   | 0.1             | mg/L  | 134           | 85.7 | 80-120     |     |           |       |
| Magnesium                 | 18600  | 0.2             | mg/L  | 10300         | 83.8 | 80-120     |     |           |       |
| Manganese                 | 54.0   | 0.005           | mg/L  | 8.90          | 90.1 | 80-120     |     |           |       |
| Molybdenum                | 42.4   | 0.0005          | mg/L  | 1.13          | 82.5 | 80-120     |     |           |       |
| Nickel                    | 40.8   | 0.001           | mg/L  | 0.293         | 81.0 | 80-120     |     |           |       |
| Potassium                 | 19900  | 0.1             | mg/L  | 11200         | 86.5 | 80-120     |     |           |       |
| Selenium                  | 45.3   | 0.001           | mg/L  | 0.160         | 90.2 | 80-120     |     |           |       |
| Silver                    | 41.3   | 0.0001          | mg/L  | 0.0251        | 82.6 | 80-120     |     |           |       |
| Sodium                    | 8560   | 0.2             | mg/L  | ND            | 85.6 | 80-120     |     |           |       |
| Thallium                  | 41.6   | 0.001           | mg/L  | 0.015         | 83.2 | 80-120     |     |           |       |
| Tin                       | 40.3   | 0.01            | mg/L  | 0.16          | 80.3 | 80-120     |     |           |       |
| Titanium                  | 45.7   | 0.005           | mg/L  | ND            | 91.4 | 70-130     |     |           |       |
| Tungsten                  | 42.6   | 0.01            | mg/L  | 0.38          | 84.5 | 80-120     |     |           |       |
| Uranium                   | 41.6   | 0.0001          | mg/L  | 0.177         | 82.8 | 80-120     |     |           |       |
| Vanadium                  | 46.1   | 0.0005          | mg/L  | 0.233         | 91.7 | 80-120     |     |           |       |
| Zinc                      | 42.0   | 0.005           | mg/L  | 1.88          | 80.2 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 05-May-2022

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 29-Apr-2022

Client PO:

**Project Description: 100812.001**

**Qualifier Notes:**

***Login Qualifiers :***

Container(s) - Labeled improperly/insufficient information - Collection time missing from chain of custody, time on bottle reads 15:58.

*Applies to samples: MW21-01*

Container and COC sample IDs don't match - Sample labelled as TW22-01, chain of custody reads TW22-01 6hr

*Applies to samples: TW22-01 6hr, TW22-01 6hr (Filtered)*

***Sample Qualifiers :***

1 : A2C - Background counts greater than 200

***QC Qualifiers :***

QM-07 : The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Brent Redmond

Client PO: Smith Road  
Project: 100812.001  
Custody: 17037

Report Date: 13-Sep-2022  
Order Date: 2-Sep-2022

**Order #: 2236417**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID              |
|------------|------------------------|
| 2236417-02 | TW22-04 6hr            |
| 2236417-03 | TW22-04 6hr (Filtered) |

Approved By:



Mark Foto, M.Sc.  
Lab Supervisor

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description           | Extraction Date | Analysis Date |
|-----------------------------|--|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5        | 6-Sep-22        | 6-Sep-22      |
| Ammonia, as N               | EPA 351.2 - Auto Colour                | 7-Sep-22        | 7-Sep-22      |
| Anions                      | EPA 300.1 - IC                         | 12-Sep-22       | 12-Sep-22     |
| Colour                      | SM2120 - Spectrophotometric            | 2-Sep-22        | 2-Sep-22      |
| Colour, apparent            | SM2120 - Spectrophotometric            | 2-Sep-22        | 2-Sep-22      |
| Conductivity                | EPA 9050A- probe @25 °C                | 6-Sep-22        | 6-Sep-22      |
| Dissolved Organic Carbon    | MOE E3247B - Combustion IR, filtration | 2-Sep-22        | 2-Sep-22      |
| Mercury by CVAA             | EPA 245.2 - Cold Vapour AA             | 6-Sep-22        | 6-Sep-22      |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                     | 2-Sep-22        | 6-Sep-22      |
| pH                          | EPA 150.1 - pH probe @25 °C            | 6-Sep-22        | 6-Sep-22      |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP          | 6-Sep-22        | 6-Sep-22      |
| Hardness                    | Hardness as CaCO <sub>3</sub>          | 2-Sep-22        | 6-Sep-22      |
| Sulphide                    | SM 4500SE - Colourimetric              | 2-Sep-22        | 2-Sep-22      |
| Tannin/Lignin               | SM 5550B - Colourimetric               | 2-Sep-22        | 6-Sep-22      |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration     | 2-Sep-22        | 6-Sep-22      |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion     | 2-Sep-22        | 6-Sep-22      |
| Turbidity                   | SM 2130B - Turbidity meter             | 2-Sep-22        | 2-Sep-22      |

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

|                     |                 |                           |   |   |
|---------------------|-----------------|---------------------------|---|---|
| <b>Client ID:</b>   | TW22-04 6hr     | TW22-04 6hr<br>(Filtered) | - | - |
| <b>Sample Date:</b> | 01-Sep-22 16:00 | 01-Sep-22 16:00           | - | - |
| <b>Sample ID:</b>   | 2236417-02      | 2236417-03                | - | - |
| <b>MDL/Units</b>    | Drinking Water  | Drinking Water            | - | - |

**General Inorganics**

|                          |              |        |   |   |   |
|--------------------------|--------------|--------|---|---|---|
| Alkalinity, total        | 5 mg/L       | 239    | - | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.37   | - | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.6    | - | - | - |
| Colour                   | 2 TCU        | 29     | - | - | - |
| Colour, apparent         | 2 ACU        | 474    | - | - | - |
| Conductivity             | 5 uS/cm      | 481    | - | - | - |
| Hardness                 | mg/L         | 12.6   | - | - | - |
| pH                       | 0.1 pH Units | 8.9    | - | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | - | - | - |
| Total Dissolved Solids   | 10 mg/L      | 308    | - | - | - |
| Sulphide                 | 0.02 mg/L    | 0.05   | - | - | - |
| Tannin & Lignin          | 0.1 mg/L     | 0.2    | - | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.4    | - | - | - |
| Turbidity                | 0.1 NTU      | 93.9   | - | - | - |

**Anions**

|              |           |           |   |   |   |
|--------------|-----------|-----------|---|---|---|
| Chloride     | 1 mg/L    | 8 [2]     | - | - | - |
| Fluoride     | 0.1 mg/L  | 1.3 [2]   | - | - | - |
| Nitrate as N | 0.1 mg/L  | 0.2 [2]   | - | - | - |
| Nitrite as N | 0.10 mg/L | <0.10 [2] | - | - | - |
| Sulphate     | 1 mg/L    | <1 [2]    | - | - | - |

**Metals**

|           |             |         |         |   |   |
|-----------|-------------|---------|---------|---|---|
| Mercury   | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Aluminum  | 0.001 mg/L  | 0.762   | 0.028   | - | - |
| Antimony  | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Arsenic   | 0.001 mg/L  | <0.001  | <0.001  | - | - |
| Barium    | 0.001 mg/L  | 0.077   | 0.053   | - | - |
| Beryllium | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Boron     | 0.01 mg/L   | 0.44    | 0.46    | - | - |
| Cadmium   | 0.0001 mg/L | <0.0001 | <0.0001 | - | - |
| Calcium   | 0.1 mg/L    | 3.2     | 1.4     | - | - |
| Chromium  | 0.001 mg/L  | 0.001   | <0.001  | - | - |
| Cobalt    | 0.0005 mg/L | <0.0005 | <0.0005 | - | - |
| Copper    | 0.0005 mg/L | 0.0009  | 0.0013  | - | - |
| Iron      | 0.1 mg/L    | 1.1     | <0.1    | - | - |

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

|            | MDL/Units   | Client ID:<br>TW22-04 6hr       | TW22-04 6hr<br>(Filtered) | - | - |
|------------|-------------|---------------------------------|---------------------------|---|---|
|            |             | Sample Date:<br>01-Sep-22 16:00 | 01-Sep-22 16:00           | - | - |
|            |             | Sample ID:<br>2236417-02        | 2236417-03                | - | - |
|            |             | Drinking Water                  | Drinking Water            | - | - |
| Lead       | 0.0001 mg/L | 0.0005                          | <0.0001                   | - | - |
| Magnesium  | 0.2 mg/L    | 1.1                             | 0.5                       | - | - |
| Manganese  | 0.005 mg/L  | 0.026                           | <0.005                    | - | - |
| Molybdenum | 0.0005 mg/L | <0.0005                         | <0.0005                   | - | - |
| Nickel     | 0.001 mg/L  | 0.001                           | <0.001                    | - | - |
| Potassium  | 0.1 mg/L    | 1.6                             | 1.4                       | - | - |
| Selenium   | 0.001 mg/L  | <0.001                          | <0.001                    | - | - |
| Silver     | 0.0001 mg/L | <0.0001                         | <0.0001                   | - | - |
| Sodium     | 0.2 mg/L    | 93.9                            | 95.8                      | - | - |
| Strontium  | 0.01 mg/L   | 0.08                            | 0.07                      | - | - |
| Thallium   | 0.001 mg/L  | <0.001                          | <0.001                    | - | - |
| Uranium    | 0.0001 mg/L | 0.0001                          | <0.0001                   | - | - |
| Vanadium   | 0.0005 mg/L | 0.0019                          | <0.0005                   | - | - |
| Zinc       | 0.005 mg/L  | <0.005                          | <0.005                    | - | - |

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Alkalinity, total         | ND     | 5               | mg/L  |               |      |            |     |           |       |
| Ammonia as N              | ND     | 0.01            | mg/L  |               |      |            |     |           |       |
| Dissolved Organic Carbon  | ND     | 0.5             | mg/L  |               |      |            |     |           |       |
| Colour                    | ND     | 2               | TCU   |               |      |            |     |           |       |
| Colour, apparent          | ND     | 2               | ACU   |               |      |            |     |           |       |
| Conductivity              | ND     | 5               | uS/cm |               |      |            |     |           |       |
| Phenolics                 | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Total Dissolved Solids    | ND     | 10              | mg/L  |               |      |            |     |           |       |
| Sulphide                  | ND     | 0.02            | mg/L  |               |      |            |     |           |       |
| Tannin & Lignin           | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Total Kjeldahl Nitrogen   | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Turbidity                 | ND     | 0.1             | NTU   |               |      |            |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | ND     | 0.0001          | mg/L  |               |      |            |     |           |       |
| Aluminum                  | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Antimony                  | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Arsenic                   | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Barium                    | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Beryllium                 | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Boron                     | ND     | 0.01            | mg/L  |               |      |            |     |           |       |
| Cadmium                   | ND     | 0.0001          | mg/L  |               |      |            |     |           |       |
| Calcium                   | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Chromium                  | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Cobalt                    | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Copper                    | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Iron                      | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Lead                      | ND     | 0.0001          | mg/L  |               |      |            |     |           |       |
| Magnesium                 | ND     | 0.2             | mg/L  |               |      |            |     |           |       |
| Manganese                 | ND     | 0.005           | mg/L  |               |      |            |     |           |       |
| Molybdenum                | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Nickel                    | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Potassium                 | ND     | 0.1             | mg/L  |               |      |            |     |           |       |
| Selenium                  | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Silver                    | ND     | 0.0001          | mg/L  |               |      |            |     |           |       |
| Sodium                    | ND     | 0.2             | mg/L  |               |      |            |     |           |       |
| Strontium                 | ND     | 0.01            | mg/L  |               |      |            |     |           |       |
| Thallium                  | ND     | 0.001           | mg/L  |               |      |            |     |           |       |
| Uranium                   | ND     | 0.0001          | mg/L  |               |      |            |     |           |       |
| Vanadium                  | ND     | 0.0005          | mg/L  |               |      |            |     |           |       |
| Zinc                      | ND     | 0.005           | mg/L  |               |      |            |     |           |       |



Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD   | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-------|-----------|-------|
| <b>General Inorganics</b> |        |                 |       |               |      |            |       |           |       |
| Ammonia as N              | 0.023  | 0.01            | mg/L  | 0.011         |      |            | NC    | 17.7      |       |
| Dissolved Organic Carbon  | 2.0    | 0.5             | mg/L  | 1.8           |      |            | 11.1  | 37        |       |
| Colour                    | 29     | 2               | TCU   | 29            |      |            | 0.0   | 12        |       |
| Colour, apparent          | 472    | 2               | ACU   | 474           |      |            | 0.4   | 12        |       |
| Phenolics                 | ND     | 0.001           | mg/L  | ND            |      |            | NC    | 10        |       |
| Total Dissolved Solids    | 462    | 10              | mg/L  | 468           |      |            | 1.3   | 10        |       |
| Sulphide                  | ND     | 0.02            | mg/L  | ND            |      |            | NC    | 10        |       |
| Tannin & Lignin           | 0.2    | 0.1             | mg/L  | 0.2           |      |            | 0.0   | 11        |       |
| Total Kjeldahl Nitrogen   | ND     | 0.1             | mg/L  | ND            |      |            | NC    | 16        |       |
| Turbidity                 | ND     | 0.1             | NTU   | ND            |      |            | NC    | 10        |       |
| <b>Metals</b>             |        |                 |       |               |      |            |       |           |       |
| Mercury                   | ND     | 0.0001          | mg/L  | ND            |      |            | NC    | 20        |       |
| Aluminum                  | 1.48   | 0.001           | mg/L  | 0.030         |      |            | 192.0 | 20        |       |
| Antimony                  | 0.0005 | 0.0005          | mg/L  | 0.0018        |      |            | 109.0 | 20        |       |
| Arsenic                   | ND     | 0.001           | mg/L  | ND            |      |            | NC    | 20        |       |
| Barium                    | 0.062  | 0.001           | mg/L  | 0.058         |      |            | 7.3   | 20        |       |
| Beryllium                 | ND     | 0.0005          | mg/L  | ND            |      |            | NC    | 20        |       |
| Boron                     | 0.41   | 0.01            | mg/L  | 0.31          |      |            | 27.9  | 20        |       |
| Cadmium                   | ND     | 0.0001          | mg/L  | ND            |      |            | NC    | 20        |       |
| Calcium                   | 94.4   | 0.1             | mg/L  | 46.4          |      |            | 68.1  | 20        |       |
| Chromium                  | 0.015  | 0.001           | mg/L  | ND            |      |            | NC    | 20        |       |
| Cobalt                    | 0.0013 | 0.0005          | mg/L  | ND            |      |            | NC    | 20        |       |
| Copper                    | 0.0026 | 0.0005          | mg/L  | 0.0015        |      |            | 52.9  | 20        |       |
| Iron                      | 2.3    | 0.1             | mg/L  | ND            |      |            | NC    | 20        |       |
| Lead                      | 0.0004 | 0.0001          | mg/L  | 0.0001        |      |            | NC    | 20        |       |
| Magnesium                 | 13.8   | 0.2             | mg/L  | 16.3          |      |            | 16.4  | 20        |       |
| Manganese                 | 0.044  | 0.005           | mg/L  | 0.006         |      |            | 149.0 | 20        |       |
| Molybdenum                | ND     | 0.0005          | mg/L  | 0.0032        |      |            | NC    | 20        |       |
| Nickel                    | 0.011  | 0.001           | mg/L  | ND            |      |            | NC    | 20        |       |
| Potassium                 | 3.5    | 0.1             | mg/L  | 7.4           |      |            | 70.0  | 20        |       |
| Selenium                  | ND     | 0.001           | mg/L  | 0.001         |      |            | NC    | 20        |       |
| Silver                    | ND     | 0.0001          | mg/L  | ND            |      |            | NC    | 20        |       |
| Sodium                    | 233    | 0.2             | mg/L  | 103           |      |            | 77.4  | 20        |       |
| Thallium                  | ND     | 0.001           | mg/L  | ND            |      |            | NC    | 20        |       |
| Uranium                   | 0.0001 | 0.0001          | mg/L  | 0.0009        |      |            | 159.0 | 20        |       |
| Vanadium                  | 0.0045 | 0.0005          | mg/L  | 0.0008        |      |            | 139.0 | 20        |       |
| Zinc                      | 0.008  | 0.005           | mg/L  | ND            |      |            | NC    | 20        |       |

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 0.279  | 0.01            | mg/L  | 0.011         | 108  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 13.3   | 0.5             | mg/L  | 1.8           | 115  | 60-133     |     |           |       |
| Phenolics                 | 0.026  | 0.001           | mg/L  | ND            | 104  | 67-133     |     |           |       |
| Total Dissolved Solids    | 104    | 10              | mg/L  | ND            | 104  | 75-125     |     |           |       |
| Sulphide                  | 0.48   | 0.02            | mg/L  | ND            | 96.8 | 79-115     |     |           |       |
| Tannin & Lignin           | 0.9    | 0.1             | mg/L  | ND            | 89.9 | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 1.87   | 0.1             | mg/L  | ND            | 93.6 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | 0.0027 | 0.0001          | mg/L  | ND            | 90.3 | 70-130     |     |           |       |
| Aluminum                  | 51.2   | 0.001           | mg/L  | ND            | 102  | 80-120     |     |           |       |
| Arsenic                   | 48.7   | 0.001           | mg/L  | ND            | 97.4 | 80-120     |     |           |       |
| Barium                    | 46.8   | 0.001           | mg/L  | ND            | 93.7 | 80-120     |     |           |       |
| Beryllium                 | 52.7   | 0.0005          | mg/L  | ND            | 105  | 80-120     |     |           |       |
| Boron                     | 48.6   | 0.01            | mg/L  | ND            | 97.2 | 80-120     |     |           |       |
| Cadmium                   | 48.1   | 0.0001          | mg/L  | ND            | 96.3 | 80-120     |     |           |       |
| Calcium                   | 9360   | 0.1             | mg/L  | ND            | 93.6 | 80-120     |     |           |       |
| Chromium                  | 50.2   | 0.001           | mg/L  | ND            | 100  | 80-120     |     |           |       |
| Cobalt                    | 51.8   | 0.0005          | mg/L  | ND            | 104  | 80-120     |     |           |       |
| Copper                    | 50.4   | 0.0005          | mg/L  | ND            | 101  | 80-120     |     |           |       |
| Iron                      | 2390   | 0.1             | mg/L  | ND            | 95.5 | 80-120     |     |           |       |
| Lead                      | 45.5   | 0.0001          | mg/L  | ND            | 91.0 | 80-120     |     |           |       |
| Magnesium                 | 10100  | 0.2             | mg/L  | ND            | 101  | 80-120     |     |           |       |
| Manganese                 | 49.4   | 0.005           | mg/L  | ND            | 98.8 | 80-120     |     |           |       |
| Molybdenum                | 43.6   | 0.0005          | mg/L  | ND            | 87.1 | 80-120     |     |           |       |
| Nickel                    | 50.5   | 0.001           | mg/L  | ND            | 101  | 80-120     |     |           |       |
| Potassium                 | 10200  | 0.1             | mg/L  | ND            | 102  | 80-120     |     |           |       |
| Selenium                  | 47.0   | 0.001           | mg/L  | ND            | 94.1 | 80-120     |     |           |       |
| Silver                    | 50.4   | 0.0001          | mg/L  | ND            | 101  | 80-120     |     |           |       |
| Sodium                    | 10200  | 0.2             | mg/L  | ND            | 102  | 80-120     |     |           |       |
| Thallium                  | 49.8   | 0.001           | mg/L  | ND            | 99.6 | 80-120     |     |           |       |
| Uranium                   | 48.4   | 0.0001          | mg/L  | ND            | 96.8 | 80-120     |     |           |       |
| Vanadium                  | 50.5   | 0.0005          | mg/L  | ND            | 101  | 80-120     |     |           |       |
| Zinc                      | 49.4   | 0.005           | mg/L  | ND            | 98.8 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 13-Sep-2022

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 2-Sep-2022

Client PO: Smith Road

Project Description: 100812.001

**Qualifier Notes:**

*Sample Qualifiers :*

2 : Subcontracted analysis - Eurofins Environment Testing

**Sample Data Revisions**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Samuel Esenwa

Client PO:  
Project: 100812.001  
Custody: 19515

Report Date: 18-Oct-2023  
Order Date: 13-Oct-2023

**Order #: 2341381**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID      |
|------------|----------------|
| 2341381-01 | 959 Smith Road |
| 2341381-02 | 900 Smith Road |
| 2341381-03 | 969 Meteor Ave |
| 2341381-04 | 908 Smith Ave  |

Approved By:



Dale Robertson, BSc  
Laboratory Director

Certificate of Analysis

Report Date: 18-Oct-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 13-Oct-2023

Client PO:

**Project Description: 100812.001**

**Analysis Summary Table**

| Analysis         | Method Reference/Description | Extraction Date | Analysis Date |
|------------------|------------------------------|-----------------|---------------|
| Anions           | EPA 300.1 - IC               | 16-Oct-23       | 16-Oct-23     |
| Colour           | SM2120 - Spectrophotometric  | 13-Oct-23       | 14-Oct-23     |
| Colour, apparent | SM2120 - Spectrophotometric  | 13-Oct-23       | 13-Oct-23     |
| Metals, ICP-MS   | EPA 200.8 - ICP-MS           | 13-Oct-23       | 13-Oct-23     |
| Turbidity        | SM 2130B - Turbidity meter   | 14-Oct-23       | 14-Oct-23     |

Certificate of Analysis

Report Date: 18-Oct-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 13-Oct-2023

Client PO:

Project Description: 100812.001

|                     |                 |                 |                 |                 |   |   |
|---------------------|-----------------|-----------------|-----------------|-----------------|---|---|
| <b>Client ID:</b>   | 959 Smith Road  | 900 Smith Road  | 969 Meteor Ave  | 908 Smith Ave   |   |   |
| <b>Sample Date:</b> | 13-Oct-23 09:30 | 13-Oct-23 10:20 | 13-Oct-23 11:20 | 13-Oct-23 12:20 | - | - |
| <b>Sample ID:</b>   | 2341381-01      | 2341381-02      | 2341381-03      | 2341381-04      |   |   |
| <b>Matrix:</b>      | Drinking Water  | Drinking Water  | Drinking Water  | Drinking Water  |   |   |
| <b>MDL/Units</b>    |                 |                 |                 |                 |   |   |

**General Inorganics**

|                  |         |     |     |     |     |   |   |
|------------------|---------|-----|-----|-----|-----|---|---|
| Colour, apparent | 2 ACU   | 7   | 3   | 18  | 8   | - | - |
| Colour           | 2 TCU   | 2   | <2  | 3   | <2  | - | - |
| Turbidity        | 0.1 NTU | 0.8 | 0.4 | 0.9 | 1.0 | - | - |

**Anions**

|              |          |      |      |      |      |   |   |
|--------------|----------|------|------|------|------|---|---|
| Chloride     | 1 mg/L   | 40   | 14   | 11   | 22   | - | - |
| Fluoride     | 0.1 mg/L | 0.8  | 0.5  | 0.3  | 0.8  | - | - |
| Nitrate as N | 0.1 mg/L | <0.1 | <0.1 | <0.1 | <0.1 | - | - |

**Metals**

|      |          |     |      |     |      |   |   |
|------|----------|-----|------|-----|------|---|---|
| Iron | 0.1 mg/L | 0.1 | <0.1 | 0.4 | <0.1 | - | - |
|------|----------|-----|------|-----|------|---|---|

Certificate of Analysis

Report Date: 18-Oct-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 13-Oct-2023

Client PO:

**Project Description: 100812.001**

**Method Quality Control: Blank**

| Analyte                   | Result | Reporting Limit | Units | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |      |            |     |           |       |
| Chloride                  | ND     | 1               | mg/L  |      |            |     |           |       |
| Fluoride                  | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Nitrate as N              | ND     | 0.1             | mg/L  |      |            |     |           |       |
| <b>General Inorganics</b> |        |                 |       |      |            |     |           |       |
| Colour                    | ND     | 2               | TCU   |      |            |     |           |       |
| Colour, apparent          | ND     | 2               | ACU   |      |            |     |           |       |
| Turbidity                 | ND     | 0.1             | NTU   |      |            |     |           |       |
| <b>Metals</b>             |        |                 |       |      |            |     |           |       |
| Iron                      | ND     | 0.1             | mg/L  |      |            |     |           |       |

Certificate of Analysis

Report Date: 18-Oct-2023

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 13-Oct-2023

Client PO:

 Project Description: **100812.001**
**Method Quality Control: Duplicate**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 39.5   | 1               | mg/L  | 39.6          |      |            | 0.3 | 20        |       |
| Fluoride                  | 0.84   | 0.1             | mg/L  | 0.81          |      |            | 4.5 | 20        |       |
| Nitrate as N              | ND     | 0.1             | mg/L  | ND            |      |            | NC  | 20        |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Colour                    | 2      | 2               | TCU   | 2             |      |            | 0.0 | 12        |       |
| Colour, apparent          | 7      | 2               | ACU   | 7             |      |            | 0.0 | 12        |       |
| Turbidity                 | 1.0    | 0.1             | NTU   | 1.0           |      |            | 5.1 | 10        |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Iron                      | ND     | 0.1             | mg/L  | ND            |      |            | NC  | 20        |       |



Certificate of Analysis

Report Date: 18-Oct-2023

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 13-Oct-2023

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte       | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b> |        |                 |       |               |      |            |     |           |       |
| Chloride      | 48.1   | 1               | mg/L  | 39.6          | 84.7 | 70-124     |     |           |       |
| Fluoride      | 1.51   | 0.1             | mg/L  | 0.81          | 70.2 | 70-130     |     |           |       |
| Nitrate as N  | 1.10   | 0.1             | mg/L  | ND            | 110  | 77-126     |     |           |       |
| <b>Metals</b> |        |                 |       |               |      |            |     |           |       |
| Iron          | 2470   | 0.1             | mg/L  | 36.4          | 97.2 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 18-Oct-2023

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 13-Oct-2023

Client PO:

Project Description: 100812.001

**Qualifier Notes:**

**Sample Data Revisions:**

None

**Work Order Revisions / Comments:**

None

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel Order Number

2341381

Chain Of Custody

Ontario Drinking Water Samples

No 19515

|                             |                                |                     |  |
|-----------------------------|--------------------------------|---------------------|--|
| Client Name: GEMTEC         | Project Ref: 100812.001        | Waterworks Name:    | Samples Taken By:  |
| Contact Name: SAMUEL ESENWA | Quote #:                       | Waterworks Number:  | Name: SIMON MALLOU   |
| Address:                    | PO #:                          | Address:            | Signature: MALLOU  |
| After Hours Contact:        | E-mail: samuel.esenwa@gemtc.ca | Public Health Unit: | Page 1 of 1  |
| Telephone: 873 688 7770     | Fax:                           | Public Health Unit: | Turn Around Time Required:<br><input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day |

| Samples Submitted Under: (Indicate ONLY one)   |  | Sample Type: R = Raw; T = Treated; D = Distribution; P = Plumbing   |                  | Source Type: G = Ground Water; S = Surface Water                    |          | Reportable: Requires AWQI reporting as per Regulation - Y = Yes; N = No |          | Required Analyses |                                      |                                     |                        |          |         |      |          |        |           |
|--|--|---|------------------|---|----------|---|----------|-------------------|--------------------------------------|-------------------------------------|------------------------|----------|---------|------|----------|--------|-----------|
| <input type="checkbox"/> ON REG 170/03   | <input type="checkbox"/> ON REG 319/08                 |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
| <input type="checkbox"/> ON REG 243/07   | <input checked="" type="checkbox"/> Other 0.Reg 169/03 |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
| Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No <input type="checkbox"/> N/A |  | Are these samples for human consumption?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No |                  | All information must be completed before samples will be processed. |          | SAMPLE COLLECTED  |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
| LOCATION NAME  | SAMPLE ID  | Sample Type: R/T/D/P  | Source Type: G/S | Reportable: Y/N   | Resample | DATE  | TIME     | # of Containers   | Free/Combined Chlorine Residual mg/L | Standing / Flushed: S / F (REG 243) | Total Coliform/E. Coll | Fluoride | Nitrate | iron | chloride | colour | turbidity |
| ← 959 Smith Road   |  | R   | G                |   | NO       | OCT 13 '23  | 9:30 AM  | 2                 |                                      |                                     |                        | ✓        | ✓       | ✓    | ✓        | ✓      | ✓         |
| ← 900 Smith Road   |  |   |                  |   |          |   | 10:20 AM |                   |                                      |                                     |                        | ✓        | ✓       | ✓    | ✓        | ✓      | ✓         |
| ← 969 Mckor Ave  |  |   |                  |   |          |   | 11:20 AM |                   |                                      |                                     |                        | ✓        | ✓       | ✓    | ✓        | ✓      | ✓         |
| ← 908 Smith Ave  |  |   |                  |   |          |   | 12:20 PM |                   |                                      |                                     |                        | ✓        | ✓       | ✓    | ✓        | ✓      | ✓         |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |
|  |  |   |                  |   |          |   |          |                   |                                      |                                     |                        |          |         |      |          |        |           |

Comments: \* Colour in ACU + TCU

Method of Delivery: Walk In

|                                       |                           |                       |   |
|---------------------------------------|---------------------------|-----------------------|---|
| Relinquished By (Sign): MALLOU        | Received By Driver/Depot: | Received at Lab: 1340 | Verified By: Hissal   |
| Relinquished By (Print): SIMON MALLOU | Date/Time:                | Date/Time: Oct 13/23  | Date/Time: Oct 13, 23   14:10                               |
| Date/Time: OCT 13 '23 1:30            | Temperature: °C           | Temperature: 11.5 °C  | pH Verified: <input checked="" type="checkbox"/> By: Hissal |

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO: Smith Road  
Project: 100812.001  
Custody: 18241

Report Date: 27-Dec-2023  
Order Date: 20-Dec-2023

**Order #: 2351202**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Parcel ID  | Client ID |
|------------|-----------|
| 2351202-01 | TW22-4    |

Approved By:



Dale Robertson, BSc

Laboratory Director

Certificate of Analysis

Report Date: 27-Dec-2023

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: Smith Road

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description       | Extraction Date | Analysis Date |
|-----------------------------|------------------------------------|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5    | 20-Dec-23       | 20-Dec-23     |
| Ammonia, as N               | EPA 351.2 - Auto Colour            | 21-Dec-23       | 21-Dec-23     |
| Anions                      | EPA 300.1 - IC                     | 20-Dec-23       | 20-Dec-23     |
| Colour                      | SM2120 - Spectrophotometric        | 20-Dec-23       | 20-Dec-23     |
| Colour, apparent            | SM2120 - Spectrophotometric        | 20-Dec-23       | 20-Dec-23     |
| Conductivity                | EPA 9050A- probe @25 °C            | 20-Dec-23       | 20-Dec-23     |
| Dissolved Organic Carbon    | MOE 3247B - Combustion IR          | 22-Dec-23       | 22-Dec-23     |
| E. coli                     | MOE E3407                          | 20-Dec-23       | 20-Dec-23     |
| Fecal Coliform              | SM 9222D                           | 20-Dec-23       | 20-Dec-23     |
| Heterotrophic Plate Count   | SM 9215C                           | 20-Dec-23       | 20-Dec-23     |
| Mercury by CVAA             | EPA 245.2 - Cold Vapour AA         | 21-Dec-23       | 21-Dec-23     |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                 | 21-Dec-23       | 21-Dec-23     |
| pH                          | EPA 150.1 - pH probe @25 °C        | 20-Dec-23       | 20-Dec-23     |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP      | 20-Dec-23       | 20-Dec-23     |
| Hardness                    | Hardness as CaCO <sub>3</sub>      | 21-Dec-23       | 21-Dec-23     |
| Sulphide                    | SM 4500SE - Colourimetric          | 20-Dec-23       | 20-Dec-23     |
| Tannin/Lignin               | SM 5550B - Colourimetric           | 22-Dec-23       | 22-Dec-23     |
| Total Coliform              | MOE E3407                          | 20-Dec-23       | 20-Dec-23     |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration | 21-Dec-23       | 22-Dec-23     |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion | 21-Dec-23       | 21-Dec-23     |
| Turbidity                   | SM 2130B - Turbidity meter         | 20-Dec-23       | 20-Dec-23     |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 20-Dec-2023

Client PO: Smith Road

Project Description: 100812.001

|                     |                 |   |   |   |   |
|---------------------|-----------------|---|---|---|---|
| <b>Client ID:</b>   | TW22-4          | - | - | - | - |
| <b>Sample Date:</b> | 19-Dec-23 14:30 | - | - | - | - |
| <b>Sample ID:</b>   | 2351202-01      | - | - | - | - |
| <b>Matrix:</b>      | Drinking Water  | - | - | - | - |
| <b>MDL/Units</b>    |                 |   |   |   |   |

**Microbiological Parameters**

|                           |             |    |   |   |   |   |
|---------------------------|-------------|----|---|---|---|---|
| E. coli                   | 1 CFU/100mL | ND | - | - | - | - |
| Total Coliforms           | 1 CFU/100mL | ND | - | - | - | - |
| Fecal Coliforms           | 1 CFU/100mL | ND | - | - | - | - |
| Heterotrophic Plate Count | 10 CFU/mL   | 10 | - | - | - | - |

**General Inorganics**

|                          |              |        |   |   |   |   |
|--------------------------|--------------|--------|---|---|---|---|
| Alkalinity, total        | 5 mg/L       | 252    | - | - | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.36   | - | - | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 0.8    | - | - | - | - |
| Colour, apparent         | 2 ACU        | 5      | - | - | - | - |
| Colour                   | 2 TCU        | 2      | - | - | - | - |
| Conductivity             | 5 uS/cm      | 516    | - | - | - | - |
| Hardness                 | 1 mg/L       | 7      | - | - | - | - |
| pH                       | 0.1 pH Units | 9.4    | - | - | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | - | - | - | - |
| Total Dissolved Solids   | 10 mg/L      | 268    | - | - | - | - |
| Sulphide                 | 0.02 mg/L    | 0.23   | - | - | - | - |
| Tannin & Lignin          | 0.1 mg/L     | <0.1   | - | - | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.3    | - | - | - | - |
| Turbidity                | 0.1 NTU      | 0.5    | - | - | - | - |

**Anions**

|              |           |       |   |   |   |   |
|--------------|-----------|-------|---|---|---|---|
| Chloride     | 1 mg/L    | 15    | - | - | - | - |
| Fluoride     | 0.1 mg/L  | 1.1   | - | - | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | - | - | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | - | - | - | - |
| Sulphate     | 1 mg/L    | <1    | - | - | - | - |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 20-Dec-2023

Client PO: Smith Road

Project Description: 100812.001

|                     |                 |   |   |   |   |
|---------------------|-----------------|---|---|---|---|
| <b>Client ID:</b>   | TW22-4          | - | - | - | - |
| <b>Sample Date:</b> | 19-Dec-23 14:30 | - | - | - | - |
| <b>Sample ID:</b>   | 2351202-01      | - | - | - | - |
| <b>Matrix:</b>      | Drinking Water  | - | - | - | - |
| <b>MDL/Units</b>    |                 |   |   |   |   |

**Metals**

| Element    | Result      | MDL     | Units | Notes | Notes | Notes |
|------------|-------------|---------|-------|-------|-------|-------|
| Mercury    | 0.0001 mg/L | <0.0001 | -     | -     | -     | -     |
| Aluminum   | 0.001 mg/L  | 0.047   | -     | -     | -     | -     |
| Antimony   | 0.0005 mg/L | <0.0005 | -     | -     | -     | -     |
| Arsenic    | 0.001 mg/L  | <0.001  | -     | -     | -     | -     |
| Barium     | 0.001 mg/L  | 0.052   | -     | -     | -     | -     |
| Beryllium  | 0.0005 mg/L | <0.0005 | -     | -     | -     | -     |
| Boron      | 0.01 mg/L   | 0.36    | -     | -     | -     | -     |
| Cadmium    | 0.0001 mg/L | <0.0001 | -     | -     | -     | -     |
| Calcium    | 0.1 mg/L    | 1.7     | -     | -     | -     | -     |
| Chromium   | 0.001 mg/L  | <0.001  | -     | -     | -     | -     |
| Cobalt     | 0.0005 mg/L | <0.0005 | -     | -     | -     | -     |
| Copper     | 0.0005 mg/L | <0.0005 | -     | -     | -     | -     |
| Iron       | 0.1 mg/L    | <0.1    | -     | -     | -     | -     |
| Lead       | 0.0001 mg/L | 0.0002  | -     | -     | -     | -     |
| Magnesium  | 0.2 mg/L    | 0.6     | -     | -     | -     | -     |
| Manganese  | 0.005 mg/L  | <0.005  | -     | -     | -     | -     |
| Molybdenum | 0.0005 mg/L | <0.0005 | -     | -     | -     | -     |
| Nickel     | 0.001 mg/L  | <0.001  | -     | -     | -     | -     |
| Potassium  | 0.1 mg/L    | 1.6     | -     | -     | -     | -     |
| Selenium   | 0.001 mg/L  | <0.001  | -     | -     | -     | -     |
| Silver     | 0.0001 mg/L | <0.0001 | -     | -     | -     | -     |
| Sodium     | 0.2 mg/L    | 110     | -     | -     | -     | -     |
| Strontium  | 0.01 mg/L   | 0.09    | -     | -     | -     | -     |
| Thallium   | 0.001 mg/L  | <0.001  | -     | -     | -     | -     |
| Uranium    | 0.0001 mg/L | <0.0001 | -     | -     | -     | -     |



Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: **Smith Road**

Project Description: **100812.001**

|                     |                 |   |   |   |   |
|---------------------|-----------------|---|---|---|---|
| <b>Client ID:</b>   | TW22-4          | - | - | - |   |
| <b>Sample Date:</b> | 19-Dec-23 14:30 | - | - | - | - |
| <b>Sample ID:</b>   | 2351202-01      | - | - | - |   |
| <b>Matrix:</b>      | Drinking Water  | - | - | - |   |
| <b>MDL/Units</b>    |                 |   |   |   |   |

**Metals**

|          |             |         |   |   |   |   |
|----------|-------------|---------|---|---|---|---|
| Vanadium | 0.0005 mg/L | <0.0005 | - | - | - | - |
| Zinc     | 0.005 mg/L  | <0.005  | - | - | - | - |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: **Smith Road**

Project Description: **100812.001**

**Method Quality Control: Blank**

| Analyte                   | Result | Reporting Limit | Units | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |      |            |     |           |       |
| Chloride                  | ND     | 1               | mg/L  |      |            |     |           |       |
| Fluoride                  | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Nitrate as N              | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Nitrite as N              | ND     | 0.05            | mg/L  |      |            |     |           |       |
| Sulphate                  | ND     | 1               | mg/L  |      |            |     |           |       |
| <b>General Inorganics</b> |        |                 |       |      |            |     |           |       |
| Alkalinity, total         | ND     | 5               | mg/L  |      |            |     |           |       |
| Ammonia as N              | ND     | 0.01            | mg/L  |      |            |     |           |       |
| Dissolved Organic Carbon  | ND     | 0.5             | mg/L  |      |            |     |           |       |
| Colour                    | ND     | 2               | TCU   |      |            |     |           |       |
| Colour, apparent          | ND     | 2               | ACU   |      |            |     |           |       |
| Conductivity              | ND     | 5               | uS/cm |      |            |     |           |       |
| Phenolics                 | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Total Dissolved Solids    | ND     | 10              | mg/L  |      |            |     |           |       |
| Sulphide                  | ND     | 0.02            | mg/L  |      |            |     |           |       |
| Tannin & Lignin           | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Total Kjeldahl Nitrogen   | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Turbidity                 | ND     | 0.1             | NTU   |      |            |     |           |       |
| <b>Metals</b>             |        |                 |       |      |            |     |           |       |
| Mercury                   | ND     | 0.0001          | mg/L  |      |            |     |           |       |
| Aluminum                  | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Arsenic                   | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Barium                    | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Beryllium                 | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Boron                     | ND     | 0.01            | mg/L  |      |            |     |           |       |
| Cadmium                   | ND     | 0.0001          | mg/L  |      |            |     |           |       |
| Calcium                   | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Chromium                  | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Cobalt                    | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Copper                    | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Iron                      | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Lead                      | ND     | 0.0001          | mg/L  |      |            |     |           |       |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: **Smith Road**

Project Description: **100812.001**

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|------|------------|-----|-----------|-------|
| Magnesium                         | ND     | 0.2             | mg/L      |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |      |            |     |           |       |
| Molybdenum                        | ND     | 0.0005          | mg/L      |      |            |     |           |       |
| Nickel                            | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Silver                            | ND     | 0.0001          | mg/L      |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |      |            |     |           |       |
| Strontium                         | ND     | 0.01            | mg/L      |      |            |     |           |       |
| Thallium                          | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |      |            |     |           |       |
| Vanadium                          | ND     | 0.0005          | mg/L      |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    |      |            |     |           |       |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 20-Dec-2023

Client PO: Smith Road

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                   | Result | Reporting Limit | Units    | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes |
|---------------------------|--------|-----------------|----------|---------------|------|------------|------|-----------|-------|
| <b>Anions</b>             |        |                 |          |               |      |            |      |           |       |
| Chloride                  | 6.10   | 1               | mg/L     | 5.97          |      |            | 2.3  | 20        |       |
| Fluoride                  | 0.59   | 0.1             | mg/L     | 0.59          |      |            | 0.4  | 20        |       |
| Nitrate as N              | 0.18   | 0.1             | mg/L     | 0.19          |      |            | 1.9  | 20        |       |
| Nitrite as N              | ND     | 0.05            | mg/L     | ND            |      |            | NC   | 20        |       |
| Sulphate                  | 27.3   | 1               | mg/L     | 27.0          |      |            | 0.8  | 20        |       |
| <b>General Inorganics</b> |        |                 |          |               |      |            |      |           |       |
| Alkalinity, total         | 281    | 5               | mg/L     | 282           |      |            | 0.4  | 14        |       |
| Ammonia as N              | 0.354  | 0.01            | mg/L     | 0.362         |      |            | 2.1  | 17.7      |       |
| Dissolved Organic Carbon  | 0.9    | 0.5             | mg/L     | 1.6           |      |            | 51.4 | 37        | QR-07 |
| Colour                    | 2      | 2               | TCU      | 2             |      |            | 0.0  | 12        |       |
| Colour, apparent          | 5      | 2               | ACU      | 5             |      |            | 0.0  | 12        |       |
| Conductivity              | 657    | 5               | uS/cm    | 668           |      |            | 1.7  | 5         |       |
| pH                        | 7.8    | 0.1             | pH Units | 7.8           |      |            | 0.5  | 3.3       |       |
| Phenolics                 | ND     | 0.001           | mg/L     | ND            |      |            | NC   | 10        |       |
| Total Dissolved Solids    | 52.0   | 10              | mg/L     | 56.0          |      |            | 7.4  | 10        |       |
| Sulphide                  | ND     | 0.02            | mg/L     | ND            |      |            | NC   | 10        |       |
| Tannin & Lignin           | ND     | 0.1             | mg/L     | ND            |      |            | NC   | 11        |       |
| Total Kjeldahl Nitrogen   | 0.24   | 0.1             | mg/L     | 0.27          |      |            | 10.3 | 16        |       |
| Turbidity                 | 0.5    | 0.1             | NTU      | 0.5           |      |            | 0.0  | 10        |       |
| <b>Metals</b>             |        |                 |          |               |      |            |      |           |       |
| Mercury                   | ND     | 0.0001          | mg/L     | ND            |      |            | NC   | 20        |       |
| Aluminum                  | 0.146  | 0.001           | mg/L     | 0.145         |      |            | 0.7  | 20        |       |
| Antimony                  | ND     | 0.0005          | mg/L     | ND            |      |            | NC   | 20        |       |
| Arsenic                   | 0.009  | 0.001           | mg/L     | 0.009         |      |            | 0.8  | 20        |       |
| Barium                    | 0.082  | 0.001           | mg/L     | 0.084         |      |            | 2.7  | 20        |       |
| Beryllium                 | ND     | 0.0005          | mg/L     | ND            |      |            | NC   | 20        |       |
| Boron                     | 0.02   | 0.01            | mg/L     | 0.03          |      |            | 1.9  | 20        |       |
| Cadmium                   | 0.0015 | 0.0001          | mg/L     | 0.0014        |      |            | 2.5  | 20        |       |
| Calcium                   | 194    | 0.1             | mg/L     | 195           |      |            | 0.2  | 20        |       |
| Chromium                  | 0.004  | 0.001           | mg/L     | 0.004         |      |            | 1.7  | 20        |       |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: **Smith Road**

Project Description: **100812.001**

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|-----|-----------|-------|
| Cobalt                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC  | 20        |       |
| Copper                            | 0.0685 | 0.0005          | mg/L      | 0.0692        |      |            | 1.1 | 20        |       |
| Iron                              | 9.0    | 0.1             | mg/L      | 9.1           |      |            | 1.6 | 20        |       |
| Lead                              | 0.142  | 0.0001          | mg/L      | 0.141         |      |            | 0.5 | 20        |       |
| Magnesium                         | 86.0   | 0.2             | mg/L      | 87.3          |      |            | 1.4 | 20        |       |
| Manganese                         | 0.191  | 0.005           | mg/L      | 0.194         |      |            | 1.5 | 20        |       |
| Molybdenum                        | 0.0011 | 0.0005          | mg/L      | 0.0011        |      |            | 0.6 | 20        |       |
| Nickel                            | 0.001  | 0.001           | mg/L      | 0.001         |      |            | 1.6 | 20        |       |
| Potassium                         | 6.3    | 0.1             | mg/L      | 6.7           |      |            | 5.8 | 20        |       |
| Selenium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC  | 20        |       |
| Silver                            | ND     | 0.0001          | mg/L      | ND            |      |            | NC  | 20        |       |
| Sodium                            | 92.9   | 0.2             | mg/L      | 94.9          |      |            | 2.1 | 20        |       |
| Thallium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC  | 20        |       |
| Uranium                           | 0.0015 | 0.0001          | mg/L      | 0.0015        |      |            | 1.3 | 20        |       |
| Vanadium                          | ND     | 0.0005          | mg/L      | ND            |      |            | NC  | 20        |       |
| Zinc                              | 0.727  | 0.005           | mg/L      | 0.746         |      |            | 2.6 | 20        |       |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL | ND            |      |            | NC  | 30        |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC  | 30        |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC  | 30        |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    | 10            |      |            | NC  | 30        |       |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 20-Dec-2023

Client PO: Smith Road

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 16.3   | 1               | mg/L  | 5.97          | 103  | 70-124     |     |           |       |
| Fluoride                  | 1.54   | 0.1             | mg/L  | 0.59          | 94.7 | 70-130     |     |           |       |
| Nitrate as N              | 1.28   | 0.1             | mg/L  | 0.19          | 109  | 77-126     |     |           |       |
| Nitrite as N              | 0.922  | 0.05            | mg/L  | ND            | 92.2 | 82-115     |     |           |       |
| Sulphate                  | 36.9   | 1               | mg/L  | 27.0          | 98.3 | 70-130     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 1.34   | 0.01            | mg/L  | 0.362         | 97.5 | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 10.2   | 0.5             | mg/L  | 0.9           | 93.3 | 60-133     |     |           |       |
| Phenolics                 | 0.026  | 0.001           | mg/L  | ND            | 106  | 67-133     |     |           |       |
| Total Dissolved Solids    | 80.0   | 10              | mg/L  | ND            | 80.0 | 75-125     |     |           |       |
| Sulphide                  | 0.45   | 0.02            | mg/L  | ND            | 89.2 | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 101  | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 1.18   | 0.1             | mg/L  | 0.27          | 90.9 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | 0.0026 | 0.0001          | mg/L  | ND            | 86.1 | 70-130     |     |           |       |
| Aluminum                  | 180    | 0.001           | mg/L  | 145           | 71.0 | 80-120     |     |           | QM-07 |
| Arsenic                   | 56.2   | 0.001           | mg/L  | 9.13          | 94.1 | 80-120     |     |           |       |
| Barium                    | 120    | 0.001           | mg/L  | 84.3          | 71.8 | 80-120     |     |           | QM-07 |
| Beryllium                 | 50.9   | 0.0005          | mg/L  | 0.0216        | 102  | 80-120     |     |           |       |
| Boron                     | 61.7   | 0.01            | mg/L  | 25.2          | 73.0 | 80-120     |     |           | QM-07 |
| Cadmium                   | 42.5   | 0.0001          | mg/L  | 1.43          | 82.1 | 80-120     |     |           |       |
| Calcium                   | 9130   | 0.1             | mg/L  | ND            | 91.3 | 80-120     |     |           |       |
| Chromium                  | 54.5   | 0.001           | mg/L  | 3.56          | 102  | 80-120     |     |           |       |
| Cobalt                    | 50.2   | 0.0005          | mg/L  | 0.0279        | 100  | 80-120     |     |           |       |
| Copper                    | 111    | 0.0005          | mg/L  | 69.2          | 82.6 | 80-120     |     |           |       |
| Iron                      | 10700  | 0.1             | mg/L  | 9100          | 65.5 | 80-120     |     |           | QM-07 |
| Lead                      | 38.5   | 0.0001          | mg/L  | ND            | 77.0 | 80-120     |     |           | QS-02 |
| Magnesium                 | 8930   | 0.2             | mg/L  | ND            | 89.3 | 80-120     |     |           |       |
| Manganese                 | 230    | 0.005           | mg/L  | 194           | 72.7 | 80-120     |     |           | QM-07 |
| Molybdenum                | 47.3   | 0.0005          | mg/L  | 1.07          | 92.4 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: **Smith Road**

Project Description: **100812.001**

**Method Quality Control: Spike**

| Analyte   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Nickel    | 50.8   | 0.001           | mg/L  | 1.01          | 99.7 | 80-120     |     |           |       |
| Potassium | 16400  | 0.1             | mg/L  | 6710          | 96.5 | 80-120     |     |           |       |
| Selenium  | 45.7   | 0.001           | mg/L  | 0.522         | 90.4 | 80-120     |     |           |       |
| Silver    | 48.9   | 0.0001          | mg/L  | 0.0128        | 97.8 | 80-120     |     |           |       |
| Sodium    | 8960   | 0.2             | mg/L  | ND            | 89.6 | 80-120     |     |           |       |
| Thallium  | 47.5   | 0.001           | mg/L  | 0.018         | 95.0 | 80-120     |     |           |       |
| Uranium   | 43.4   | 0.0001          | mg/L  | 1.52          | 83.8 | 80-120     |     |           |       |
| Vanadium  | 53.4   | 0.0005          | mg/L  | 0.200         | 106  | 80-120     |     |           |       |
| Zinc      | 42.7   | 0.005           | mg/L  | ND            | 85.4 | 80-120     |     |           |       |



Certificate of Analysis

Report Date: 27-Dec-2023

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 20-Dec-2023

Client PO: Smith Road

**Project Description: 100812.001**

**Qualifier Notes:**

**Sample Qualifiers :**

**QC Qualifiers:**

- QM-07 The spike recovery was outside acceptance limits for the MS and/or MSD. The batch was accepted based on other acceptable QC.
- QR-07 Duplicate result exceeds RPD limits due to non-homogeneity between multiple sample vials. Remainder of QA/QC is acceptable.
- QS-02 Spike level outside of control limits. Analysis batch accepted based on other QC included in the batch.

**Sample Data Revisions:**

None

**Work Order Revisions / Comments:**

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.



Parcel ID: 2351202



nt Blvd.  
IG 4J8  
labs.com  
m

|                                       |   |
|---------------------------------------|---|
| Parcel Order Number<br><b>2351202</b> | Chain Of Custody<br>Ontario Drinking Water Samples<br><b>No 18241</b> |
|---------------------------------------|---|

|  |   |                     |   |
|--|---|---------------------|---|
| Client Name: <b>C. P. Inc</b>          | Project Ref: <b>100812-001/ Smith Lodge</b> | Waterworks Name:    | Samples Taken By:   |
| Contact Name: <b>Andrius Paznickas</b> | Quote #:                                    | Waterworks Number:  | Name: <b>Samuel Sencus</b>  |
| Address:                               | PO #:                                       | Address:            | Signature: <i>[Signature]</i>   |
| After Hours Contact:                   | E-mail: <b>Andrius.Paznickas@gemtec.ca</b>  | Public Health Unit: | Page ___ of ___<br>Turn Around Time Required:<br><input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day |
| Telephone:                             | Fax:  |                     |   |

|   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
|---|-----------|--|------------------|-------------------|---|-----------------------------------|------------------------|-----|------|-----|-----------|----------|
| Samples Submitted Under: (Indicate ONLY one)<br><input type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well<br><input type="checkbox"/> ON REG 243/07 <input checked="" type="checkbox"/> Other <b>Reg 169/03</b> |           | Sample Type: R = Raw ; T = Treated ; D = Distribution ; P = Plumbing<br>Source Type: G = Ground Water ; S = Surface Water<br>Reportable: Requires AWQI reporting as per Regulation - Y = Yes; N = No |                  | Required Analyses |   |                                   |                        |     |      |     |           |          |
| Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A  |           | Sample Type: R/T/D/P<br>Source Type: G/S<br>Reportable: Y/N<br>Resample  | SAMPLE COLLECTED |                   | # of Containers<br>Free/Combined Chlorine Residual mg/L | Standing / Flushed: S/F (REG 243) | Total Coliform/E. Coli | HPC | Lead | THM | Turbidity | Bacteria |
| Are these samples for human consumption?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No   |           |  | DATE             | TIME              |   |                                   |                        |     |      |     |           |          |
| All information must be completed before samples will be processed.   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| LOCATION NAME   | SAMPLE ID |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 1   | 7W22-4    | R  | G/N              | 19-12-23          | 14:30   | 11                                |                        |     |      |     |           |          |
| 2   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 3   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 4   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 5   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 6   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 7   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 8   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 9   |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |
| 10  |           |  |                  |                   |   |                                   |                        |     |      |     |           |          |

|   |   |  |  |
|---|---|--|--|
| Comments: <b>Color in HCU &amp; FCU; trace oxidized metals</b><br><b>KEEP UNSUBMITTED SAMPLES ON HOLD</b> |   | Method of Delivery: <b>Wash Drop</b>   |  |
| Relinquished By (Sign): <i>[Signature]</i>  | Received By Driver/Depot: <b>Ston, 8:30</b> | Received at Lab: <b>SO</b>             | Verified By: <b>SO</b>   |
| Relinquished By (Print): <b>Samuel Sencus</b>   | Date/Time: <b>Dec 20/23 AM</b>              | Date/Time: <b>Dec 20, 2023 11:55am</b> | Date/Time: <b>Dec 20, 2023 11:20am</b>                         |
| Date/Time: <b>19-12-2023; 19:00</b>   | Temperature: <b>11.0</b> °C                 | Temperature: <b>5.8</b> °C             | pH Verified: <input checked="" type="checkbox"/> By: <b>SO</b> |

## Certificate of Analysis

**GEMTEC Consulting Engineers and Scientists Limited**

32 Steacie Drive  
Kanata, ON K2K 2A9  
Attn: Andrius Paznekas

Client PO:  
Project: 100812.001  
Custody: 19566

Report Date: 30-Jan-2024  
Order Date: 24-Jan-2024

**Order #: 2404291**

This Certificate of Analysis contains analytical data applicable to the following samples as submitted:

| Paracel ID | Client ID  |
|------------|--|
| 2404291-01 | TW24-4 Identified as TW24-5 and TW24-5 (Filtered) in the summary table |
| 2404291-02 | TW24-4 (Filtered)  |

Approved By:



Mark Foto, M.Sc.

Lab Supervisor

Certificate of Analysis

Report Date: 30-Jan-2024

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Analysis Summary Table**

| Analysis                    | Method Reference/Description       | Extraction Date | Analysis Date |
|-----------------------------|------------------------------------|-----------------|---------------|
| Alkalinity, total to pH 4.5 | EPA 310.1 - Titration to pH 4.5    | 25-Jan-24       | 25-Jan-24     |
| Ammonia, as N               | EPA 351.2 - Auto Colour            | 29-Jan-24       | 29-Jan-24     |
| Anions                      | EPA 300.1 - IC                     | 25-Jan-24       | 25-Jan-24     |
| Colour                      | SM2120 - Spectrophotometric        | 25-Jan-24       | 25-Jan-24     |
| Colour, apparent            | SM2120 - Spectrophotometric        | 25-Jan-24       | 25-Jan-24     |
| Conductivity                | EPA 9050A- probe @25 °C            | 25-Jan-24       | 25-Jan-24     |
| Dissolved Organic Carbon    | MOE 3247B - Combustion IR          | 30-Jan-24       | 30-Jan-24     |
| E. coli                     | MOE E3407                          | 25-Jan-24       | 25-Jan-24     |
| Fecal Coliform              | SM 9222D                           | 25-Jan-24       | 25-Jan-24     |
| Heterotrophic Plate Count   | SM 9215C                           | 25-Jan-24       | 25-Jan-24     |
| Mercury by CVAA             | EPA 245.2 - Cold Vapour AA         | 26-Jan-24       | 26-Jan-24     |
| Metals, ICP-MS              | EPA 200.8 - ICP-MS                 | 26-Jan-24       | 26-Jan-24     |
| pH                          | EPA 150.1 - pH probe @25 °C        | 25-Jan-24       | 25-Jan-24     |
| Phenolics                   | EPA 420.2 - Auto Colour, 4AAP      | 29-Jan-24       | 29-Jan-24     |
| Hardness                    | Hardness as CaCO <sub>3</sub>      | 26-Jan-24       | 26-Jan-24     |
| Sulphide                    | SM 4500SE - Colourimetric          | 25-Jan-24       | 25-Jan-24     |
| Tannin/Lignin               | SM 5550B - Colourimetric           | 25-Jan-24       | 25-Jan-24     |
| Total Coliform              | MOE E3407                          | 25-Jan-24       | 25-Jan-24     |
| Total Dissolved Solids      | SM 2540C - gravimetric, filtration | 25-Jan-24       | 26-Jan-24     |
| Total Kjeldahl Nitrogen     | EPA 351.2 - Auto Colour, digestion | 25-Jan-24       | 25-Jan-24     |
| Turbidity                   | SM 2130B - Turbidity meter         | 25-Jan-24       | 25-Jan-24     |

Certificate of Analysis

Report Date: 30-Jan-2024

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

|                     |                 |                   |   |   |   |   |
|---------------------|-----------------|-------------------|---|---|---|---|
| <b>Client ID:</b>   | TW24-4          | TW24-4 (Filtered) | - | - | - | - |
| <b>Sample Date:</b> | 24-Jan-24 14:25 | 24-Jan-24 14:25   | - | - | - | - |
| <b>Sample ID:</b>   | 2404291-01      | 2404291-02        | - | - | - | - |
| <b>Matrix:</b>      | Drinking Water  | Drinking Water    | - | - | - | - |
| <b>MDL/Units</b>    |                 |                   |   |   |   |   |

**Microbiological Parameters**

|                           |             |     |   |   |   |   |
|---------------------------|-------------|-----|---|---|---|---|
| E. coli                   | 1 CFU/100mL | ND  | - | - | - | - |
| Total Coliforms           | 1 CFU/100mL | 1   | - | - | - | - |
| Fecal Coliforms           | 1 CFU/100mL | ND  | - | - | - | - |
| Heterotrophic Plate Count | 10 CFU/mL   | <10 | - | - | - | - |

**General Inorganics**

|                          |              |        |   |   |   |   |
|--------------------------|--------------|--------|---|---|---|---|
| Alkalinity, total        | 5 mg/L       | 189    | - | - | - | - |
| Ammonia as N             | 0.01 mg/L    | 0.45   | - | - | - | - |
| Dissolved Organic Carbon | 0.5 mg/L     | 1.7    | - | - | - | - |
| Colour, apparent         | 2 ACU        | 12     | - | - | - | - |
| Colour                   | 2 TCU        | 2      | - | - | - | - |
| Conductivity             | 5 uS/cm      | 480    | - | - | - | - |
| Hardness                 | 1 mg/L       | 31.7   | - | - | - | - |
| pH                       | 0.1 pH Units | 8.8    | - | - | - | - |
| Phenolics                | 0.001 mg/L   | <0.001 | - | - | - | - |
| Total Dissolved Solids   | 10 mg/L      | 248    | - | - | - | - |
| Sulphide                 | 0.02 mg/L    | 2.34   | - | - | - | - |
| Tannin & Lignin          | 0.1 mg/L     | 0.4    | - | - | - | - |
| Total Kjeldahl Nitrogen  | 0.1 mg/L     | 0.4    | - | - | - | - |
| Turbidity                | 0.1 NTU      | 1.4    | - | - | - | - |

**Anions**

|              |           |       |   |   |   |   |
|--------------|-----------|-------|---|---|---|---|
| Chloride     | 1 mg/L    | 29    | - | - | - | - |
| Fluoride     | 0.1 mg/L  | 0.8   | - | - | - | - |
| Nitrate as N | 0.1 mg/L  | <0.1  | - | - | - | - |
| Nitrite as N | 0.05 mg/L | <0.05 | - | - | - | - |
| Sulphate     | 1 mg/L    | 8     | - | - | - | - |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

|                     |                 |                   |   |   |   |   |
|---------------------|-----------------|-------------------|---|---|---|---|
| <b>Client ID:</b>   | TW24-4          | TW24-4 (Filtered) | - | - | - | - |
| <b>Sample Date:</b> | 24-Jan-24 14:25 | 24-Jan-24 14:25   | - | - | - | - |
| <b>Sample ID:</b>   | 2404291-01      | 2404291-02        | - | - | - | - |
| <b>Matrix:</b>      | Drinking Water  | Drinking Water    | - | - | - | - |
| <b>MDL/Units</b>    |                 |                   |   |   |   |   |

**Metals**

| Element    | MDL/Units   | Sample 1 | Sample 2 | Result 1 | Result 2 | Result 3 | Result 4 |
|------------|-------------|----------|----------|----------|----------|----------|----------|
| Mercury    | 0.0001 mg/L | <0.0001  | <0.0001  | -        | -        | -        | -        |
| Aluminum   | 0.001 mg/L  | 0.050    | 0.023    | -        | -        | -        | -        |
| Antimony   | 0.0005 mg/L | <0.0005  | <0.0005  | -        | -        | -        | -        |
| Arsenic    | 0.001 mg/L  | <0.001   | <0.001   | -        | -        | -        | -        |
| Barium     | 0.001 mg/L  | 0.151    | 0.137    | -        | -        | -        | -        |
| Beryllium  | 0.0005 mg/L | <0.0005  | <0.0005  | -        | -        | -        | -        |
| Boron      | 0.01 mg/L   | 0.27     | 0.24     | -        | -        | -        | -        |
| Cadmium    | 0.0001 mg/L | <0.0001  | <0.0001  | -        | -        | -        | -        |
| Calcium    | 0.1 mg/L    | 8.2      | 7.4      | -        | -        | -        | -        |
| Chromium   | 0.001 mg/L  | <0.001   | <0.001   | -        | -        | -        | -        |
| Cobalt     | 0.0005 mg/L | <0.0005  | <0.0005  | -        | -        | -        | -        |
| Copper     | 0.0005 mg/L | <0.0005  | <0.0005  | -        | -        | -        | -        |
| Iron       | 0.1 mg/L    | <0.1     | <0.1     | -        | -        | -        | -        |
| Lead       | 0.0001 mg/L | <0.0001  | <0.0001  | -        | -        | -        | -        |
| Magnesium  | 0.2 mg/L    | 2.8      | 2.7      | -        | -        | -        | -        |
| Manganese  | 0.005 mg/L  | <0.005   | <0.005   | -        | -        | -        | -        |
| Molybdenum | 0.0005 mg/L | 0.0005   | <0.0005  | -        | -        | -        | -        |
| Nickel     | 0.001 mg/L  | <0.001   | <0.001   | -        | -        | -        | -        |
| Potassium  | 0.1 mg/L    | 3.3      | 3.3      | -        | -        | -        | -        |
| Selenium   | 0.001 mg/L  | <0.001   | <0.001   | -        | -        | -        | -        |
| Silver     | 0.0001 mg/L | <0.0001  | <0.0001  | -        | -        | -        | -        |
| Sodium     | 0.2 mg/L    | 85.5     | 85.4     | -        | -        | -        | -        |
| Strontium  | 0.01 mg/L   | 0.45     | 0.41     | -        | -        | -        | -        |
| Thallium   | 0.001 mg/L  | <0.001   | <0.001   | -        | -        | -        | -        |
| Uranium    | 0.0001 mg/L | <0.0001  | <0.0001  | -        | -        | -        | -        |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

|                     |                 |                   |   |   |   |
|---------------------|-----------------|-------------------|---|---|---|
| <b>Client ID:</b>   | TW24-4          | TW24-4 (Filtered) | - | - |   |
| <b>Sample Date:</b> | 24-Jan-24 14:25 | 24-Jan-24 14:25   | - | - | - |
| <b>Sample ID:</b>   | 2404291-01      | 2404291-02        | - | - |   |
| <b>Matrix:</b>      | Drinking Water  | Drinking Water    | - | - |   |
| <b>MDL/Units</b>    |                 |                   |   |   |   |

**Metals**

|          |             |         |         |   |   |   |   |
|----------|-------------|---------|---------|---|---|---|---|
| Vanadium | 0.0005 mg/L | <0.0005 | <0.0005 | - | - | - | - |
| Zinc     | 0.005 mg/L  | <0.005  | <0.005  | - | - | - | - |



Certificate of Analysis

Report Date: 30-Jan-2024

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                   | Result | Reporting Limit | Units | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |      |            |     |           |       |
| Chloride                  | ND     | 1               | mg/L  |      |            |     |           |       |
| Fluoride                  | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Nitrate as N              | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Nitrite as N              | ND     | 0.05            | mg/L  |      |            |     |           |       |
| Sulphate                  | ND     | 1               | mg/L  |      |            |     |           |       |
| <b>General Inorganics</b> |        |                 |       |      |            |     |           |       |
| Alkalinity, total         | ND     | 5               | mg/L  |      |            |     |           |       |
| Ammonia as N              | ND     | 0.01            | mg/L  |      |            |     |           |       |
| Dissolved Organic Carbon  | ND     | 0.5             | mg/L  |      |            |     |           |       |
| Colour                    | ND     | 2               | TCU   |      |            |     |           |       |
| Colour, apparent          | ND     | 2               | ACU   |      |            |     |           |       |
| Conductivity              | ND     | 5               | uS/cm |      |            |     |           |       |
| Phenolics                 | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Total Dissolved Solids    | ND     | 10              | mg/L  |      |            |     |           |       |
| Sulphide                  | ND     | 0.02            | mg/L  |      |            |     |           |       |
| Tannin & Lignin           | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Total Kjeldahl Nitrogen   | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Turbidity                 | ND     | 0.1             | NTU   |      |            |     |           |       |
| <b>Metals</b>             |        |                 |       |      |            |     |           |       |
| Mercury                   | ND     | 0.0001          | mg/L  |      |            |     |           |       |
| Aluminum                  | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Antimony                  | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Arsenic                   | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Barium                    | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Beryllium                 | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Boron                     | ND     | 0.01            | mg/L  |      |            |     |           |       |
| Cadmium                   | ND     | 0.0001          | mg/L  |      |            |     |           |       |
| Calcium                   | ND     | 0.1             | mg/L  |      |            |     |           |       |
| Chromium                  | ND     | 0.001           | mg/L  |      |            |     |           |       |
| Cobalt                    | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Copper                    | ND     | 0.0005          | mg/L  |      |            |     |           |       |
| Iron                      | ND     | 0.1             | mg/L  |      |            |     |           |       |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Blank**

| Analyte                           | Result | Reporting Limit | Units     | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------------------------------|--------|-----------------|-----------|------|------------|-----|-----------|-------|
| Lead                              | ND     | 0.0001          | mg/L      |      |            |     |           |       |
| Magnesium                         | ND     | 0.2             | mg/L      |      |            |     |           |       |
| Manganese                         | ND     | 0.005           | mg/L      |      |            |     |           |       |
| Molybdenum                        | ND     | 0.0005          | mg/L      |      |            |     |           |       |
| Nickel                            | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Potassium                         | ND     | 0.1             | mg/L      |      |            |     |           |       |
| Selenium                          | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Silver                            | ND     | 0.0001          | mg/L      |      |            |     |           |       |
| Sodium                            | ND     | 0.2             | mg/L      |      |            |     |           |       |
| Strontium                         | ND     | 0.01            | mg/L      |      |            |     |           |       |
| Thallium                          | ND     | 0.001           | mg/L      |      |            |     |           |       |
| Uranium                           | ND     | 0.0001          | mg/L      |      |            |     |           |       |
| Vanadium                          | ND     | 0.0005          | mg/L      |      |            |     |           |       |
| Zinc                              | ND     | 0.005           | mg/L      |      |            |     |           |       |
| <b>Microbiological Parameters</b> |        |                 |           |      |            |     |           |       |
| E. coli                           | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Total Coliforms                   | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL |      |            |     |           |       |
| Heterotrophic Plate Count         | ND     | 10              | CFU/mL    |      |            |     |           |       |

Certificate of Analysis

Report Date: 30-Jan-2024

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                   | Result | Reporting Limit | Units    | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|----------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |          |               |      |            |     |           |       |
| Chloride                  | 5.73   | 1               | mg/L     | 5.81          |      |            | 1.4 | 20        |       |
| Fluoride                  | 0.72   | 0.1             | mg/L     | 0.73          |      |            | 1.7 | 20        |       |
| Nitrate as N              | 0.21   | 0.1             | mg/L     | 0.21          |      |            | 0.2 | 20        |       |
| Nitrite as N              | ND     | 0.05            | mg/L     | ND            |      |            | NC  | 20        |       |
| Sulphate                  | 28.9   | 1               | mg/L     | 28.8          |      |            | 0.4 | 20        |       |
| <b>General Inorganics</b> |        |                 |          |               |      |            |     |           |       |
| Alkalinity, total         | 322    | 5               | mg/L     | 326           |      |            | 1.1 | 14        |       |
| Ammonia as N              | 0.234  | 0.01            | mg/L     | 0.232         |      |            | 1.0 | 17.7      |       |
| Dissolved Organic Carbon  | 1.3    | 0.5             | mg/L     | 1.3           |      |            | 1.2 | 37        |       |
| Colour                    | 2      | 2               | TCU      | 2             |      |            | 0.0 | 12        |       |
| Colour, apparent          | 42     | 2               | ACU      | 41            |      |            | 2.4 | 12        |       |
| Conductivity              | 1220   | 5               | uS/cm    | 1200          |      |            | 2.0 | 5         |       |
| pH                        | 7.7    | 0.1             | pH Units | 7.7           |      |            | 0.1 | 3.3       |       |
| Phenolics                 | ND     | 0.001           | mg/L     | ND            |      |            | NC  | 10        |       |
| Total Dissolved Solids    | 64.0   | 10              | mg/L     | 66.0          |      |            | 3.1 | 10        |       |
| Sulphide                  | 0.31   | 0.02            | mg/L     | 0.32          |      |            | 3.1 | 10        |       |
| Tannin & Lignin           | ND     | 0.1             | mg/L     | ND            |      |            | NC  | 11        |       |
| Total Kjeldahl Nitrogen   | 0.15   | 0.1             | mg/L     | 0.14          |      |            | 7.6 | 16        |       |
| Turbidity                 | 7.0    | 0.1             | NTU      | 7.2           |      |            | 1.7 | 10        |       |
| <b>Metals</b>             |        |                 |          |               |      |            |     |           |       |
| Mercury                   | ND     | 0.0001          | mg/L     | ND            |      |            | NC  | 20        |       |
| Aluminum                  | 0.001  | 0.001           | mg/L     | 0.001         |      |            | 0.9 | 20        |       |
| Antimony                  | ND     | 0.0005          | mg/L     | ND            |      |            | NC  | 20        |       |
| Arsenic                   | ND     | 0.001           | mg/L     | ND            |      |            | NC  | 20        |       |
| Barium                    | 0.124  | 0.001           | mg/L     | 0.118         |      |            | 5.1 | 20        |       |
| Beryllium                 | ND     | 0.0005          | mg/L     | ND            |      |            | NC  | 20        |       |
| Boron                     | 0.02   | 0.01            | mg/L     | 0.02          |      |            | 0.4 | 20        |       |
| Cadmium                   | ND     | 0.0001          | mg/L     | ND            |      |            | NC  | 20        |       |
| Calcium                   | 106    | 0.1             | mg/L     | 106           |      |            | 0.1 | 20        |       |
| Chromium                  | ND     | 0.001           | mg/L     | ND            |      |            | NC  | 20        |       |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Duplicate**

| Analyte                           | Result | Reporting Limit | Units     | Source Result | %REC | %REC Limit | RPD  | RPD Limit | Notes      |
|-----------------------------------|--------|-----------------|-----------|---------------|------|------------|------|-----------|------------|
| Cobalt                            | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |            |
| Copper                            | 0.0538 | 0.0005          | mg/L      | 0.0547        |      |            | 1.6  | 20        |            |
| Iron                              | 0.6    | 0.1             | mg/L      | 0.6           |      |            | 1.2  | 20        |            |
| Lead                              | 0.0003 | 0.0001          | mg/L      | 0.0003        |      |            | 17.8 | 20        |            |
| Magnesium                         | 25.0   | 0.2             | mg/L      | 25.9          |      |            | 3.7  | 20        |            |
| Manganese                         | 0.160  | 0.005           | mg/L      | 0.159         |      |            | 0.0  | 20        |            |
| Molybdenum                        | 0.0008 | 0.0005          | mg/L      | 0.0008        |      |            | 5.2  | 20        |            |
| Nickel                            | 0.002  | 0.001           | mg/L      | 0.002         |      |            | 0.6  | 20        |            |
| Potassium                         | 2.6    | 0.1             | mg/L      | 2.7           |      |            | 1.6  | 20        |            |
| Selenium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |            |
| Silver                            | ND     | 0.0001          | mg/L      | ND            |      |            | NC   | 20        |            |
| Sodium                            | 98.7   | 0.2             | mg/L      | 103           |      |            | 4.4  | 20        |            |
| Thallium                          | ND     | 0.001           | mg/L      | ND            |      |            | NC   | 20        |            |
| Uranium                           | 0.0002 | 0.0001          | mg/L      | 0.0002        |      |            | 5.2  | 20        |            |
| Vanadium                          | ND     | 0.0005          | mg/L      | ND            |      |            | NC   | 20        |            |
| Zinc                              | 0.020  | 0.005           | mg/L      | 0.020         |      |            | 0.4  | 20        |            |
| <b>Microbiological Parameters</b> |        |                 |           |               |      |            |      |           |            |
| E. coli                           | NDOGT  | 1               | CFU/100mL | ND            |      |            | NC   | 30        | BAC-NDOGTi |
| Total Coliforms                   | NDOGT  | 1               | CFU/100mL | ND            |      |            | NC   | 30        | BAC-NDOGTi |
| Fecal Coliforms                   | ND     | 1               | CFU/100mL | ND            |      |            | NC   | 30        |            |
| Heterotrophic Plate Count         | 30     | 10              | CFU/mL    | 70            |      |            | 80.0 | 30        | BAC04      |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: GEMTEC Consulting Engineers and Scientists Limited

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte                   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|---------------------------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| <b>Anions</b>             |        |                 |       |               |      |            |     |           |       |
| Chloride                  | 16.2   | 1               | mg/L  | 5.81          | 104  | 70-124     |     |           |       |
| Fluoride                  | 1.74   | 0.1             | mg/L  | 0.73          | 101  | 70-130     |     |           |       |
| Nitrate as N              | 1.28   | 0.1             | mg/L  | 0.21          | 107  | 77-126     |     |           |       |
| Nitrite as N              | 0.922  | 0.05            | mg/L  | ND            | 92.2 | 82-115     |     |           |       |
| Sulphate                  | 37.8   | 1               | mg/L  | 28.8          | 90.5 | 70-130     |     |           |       |
| <b>General Inorganics</b> |        |                 |       |               |      |            |     |           |       |
| Ammonia as N              | 1.26   | 0.01            | mg/L  | 0.232         | 103  | 81-124     |     |           |       |
| Dissolved Organic Carbon  | 11.0   | 0.5             | mg/L  | 1.4           | 95.9 | 60-133     |     |           |       |
| Phenolics                 | 0.026  | 0.001           | mg/L  | ND            | 106  | 67-133     |     |           |       |
| Total Dissolved Solids    | 104    | 10              | mg/L  | ND            | 104  | 75-125     |     |           |       |
| Sulphide                  | 0.75   | 0.02            | mg/L  | 0.32          | 85.8 | 79-115     |     |           |       |
| Tannin & Lignin           | 1.0    | 0.1             | mg/L  | ND            | 101  | 71-113     |     |           |       |
| Total Kjeldahl Nitrogen   | 1.12   | 0.1             | mg/L  | 0.14          | 98.3 | 81-126     |     |           |       |
| <b>Metals</b>             |        |                 |       |               |      |            |     |           |       |
| Mercury                   | 0.0028 | 0.0001          | mg/L  | ND            | 92.8 | 70-130     |     |           |       |
| Aluminum                  | 46.5   | 0.001           | mg/L  | 1.09          | 90.7 | 80-120     |     |           |       |
| Arsenic                   | 53.7   | 0.001           | mg/L  | 0.177         | 107  | 80-120     |     |           |       |
| Barium                    | 174    | 0.001           | mg/L  | 118           | 111  | 80-120     |     |           |       |
| Beryllium                 | 45.5   | 0.0005          | mg/L  | 0.0117        | 90.9 | 80-120     |     |           |       |
| Boron                     | 56.5   | 0.01            | mg/L  | 15.6          | 81.7 | 80-120     |     |           |       |
| Cadmium                   | 48.0   | 0.0001          | mg/L  | 0.0046        | 96.0 | 80-120     |     |           |       |
| Calcium                   | 9330   | 0.1             | mg/L  | ND            | 93.3 | 80-120     |     |           |       |
| Chromium                  | 49.6   | 0.001           | mg/L  | 0.047         | 99.2 | 80-120     |     |           |       |
| Cobalt                    | 47.1   | 0.0005          | mg/L  | 0.0720        | 94.1 | 80-120     |     |           |       |
| Copper                    | 94.8   | 0.0005          | mg/L  | 54.7          | 80.2 | 80-120     |     |           |       |
| Iron                      | 2850   | 0.1             | mg/L  | 580           | 90.9 | 80-120     |     |           |       |
| Lead                      | 42.9   | 0.0001          | mg/L  | 0.284         | 85.3 | 80-120     |     |           |       |
| Magnesium                 | 39300  | 0.2             | mg/L  | 28800         | 105  | 80-120     |     |           |       |
| Manganese                 | 203    | 0.005           | mg/L  | 159           | 87.4 | 80-120     |     |           |       |
| Molybdenum                | 43.4   | 0.0005          | mg/L  | 0.764         | 85.2 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 30-Jan-2024

 Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Method Quality Control: Spike**

| Analyte   | Result | Reporting Limit | Units | Source Result | %REC | %REC Limit | RPD | RPD Limit | Notes |
|-----------|--------|-----------------|-------|---------------|------|------------|-----|-----------|-------|
| Nickel    | 45.9   | 0.001           | mg/L  | 1.63          | 88.5 | 80-120     |     |           |       |
| Potassium | 12000  | 0.1             | mg/L  | 2680          | 92.9 | 80-120     |     |           |       |
| Selenium  | 47.2   | 0.001           | mg/L  | 0.080         | 94.2 | 80-120     |     |           |       |
| Silver    | 43.9   | 0.0001          | mg/L  | 0.0191        | 87.7 | 80-120     |     |           |       |
| Sodium    | 71800  | 0.2             | mg/L  | 61100         | 107  | 80-120     |     |           |       |
| Thallium  | 45.3   | 0.001           | mg/L  | 0.015         | 90.6 | 80-120     |     |           |       |
| Uranium   | 47.2   | 0.0001          | mg/L  | 0.150         | 94.0 | 80-120     |     |           |       |
| Vanadium  | 51.6   | 0.0005          | mg/L  | 0.0874        | 103  | 80-120     |     |           |       |
| Zinc      | 44.0   | 0.005           | mg/L  | 0.899         | 86.3 | 80-120     |     |           |       |

Certificate of Analysis

Report Date: 30-Jan-2024

Client: **GEMTEC Consulting Engineers and Scientists Limited**

Order Date: 24-Jan-2024

Client PO:

Project Description: 100812.001

**Qualifier Notes:**

**Login Qualifiers :**

Container(s) - Labeled improperly/insufficient information - Collection time on the bottles is PM; chain of custody reads as PM; report collection time as 14:25 as confirmed by the client.

Applies to Samples: TW24-4, TW24-4 (Filtered)

**Sample Qualifiers :**

**QC Qualifiers:**

BAC04 Duplicate QC data falls within method prescribed 95% confidence limits.  
BAC-NDOGTi NO DATA: Overgrown with Target.

**Sample Data Revisions:**

None

**Work Order Revisions / Comments:**

Missing times on all of the bottles

**Other Report Notes:**

n/a: not applicable

ND: Not Detected

MDL: Method Detection Limit

Source Result: Data used as source for matrix and duplicate samples

%REC: Percent recovery.

RPD: Relative percent difference.

NC: Not Calculated

Any use of these results implies your agreement that our total liability in connection with this work, however arising, shall be limited to the amount paid by you for this work, and that our employees or agents shall not under any circumstances be liable to you in connection with this work.





Parcel ID: 2404291



rent Blvd.  
11G 4J8  
7  
ellabs.com  
com

Parcel Order Number

2404291

Chain Of Custody

Ontario Drinking Water Samples

No 19566

|                      |                  |              |                            |                     |  |  |                    |
|----------------------|------------------|--------------|----------------------------|---------------------|--|--|--------------------|
| Client Name:         | GEMTEC           | Project Ref: | 100.912-001                | Waterworks Name:    |  | Samples Taken By:  |                    |
| Contact Name:        | Andrius Paznekas | Quote #:     |                            | Waterworks Number:  |  | Name:  | Luca Fiorindi      |
| Address:             |                  | PO #:        |                            | Address:            |  | Signature:   | <i>[Signature]</i> |
| After Hours Contact: |                  | E-mail:      | andrius.paznekas@gemtec.ca |                     |  | Page   | of                 |
| Telephone:           | 613-295-8425     | Fax:         |                            | Public Health Unit: |  | Turn Around Time Required:<br><input type="checkbox"/> 1 day <input type="checkbox"/> 2 day <input type="checkbox"/> 3 day <input checked="" type="checkbox"/> 4 day |                    |

|  |           |   |                  |      |  |  |  |  |  |
|--|-----------|---|------------------|------|--|--|--|--|--|
| Samples Submitted Under: (Indicate ONLY one)<br><input type="checkbox"/> ON REG 170/03 <input type="checkbox"/> ON REG 319/08 <input type="checkbox"/> Private Well<br><input type="checkbox"/> ON REG 243/07 <input checked="" type="checkbox"/> Other: reg 169/03  |           | Sample Type: R = Raw ; T = Treated ; D = Distribution ; P = Plumbing<br>Source Type: G = Ground Water ; S = Surface Water<br>Reportable: Requires AWQI reporting as per Regulation - Y = Yes ; N = No |                  |      |  | Required Analyses  |  |  |  |
| Have LSN forms been submitted to MOE/MOHLTC?: <input type="checkbox"/> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/> N/A<br>Are these samples for human consumption?: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No<br>All information must be completed before samples will be processed. |           | Sample Type: R/T/D/P<br>Source Type: G/S<br>Reportable: Y/N<br>Resample   | SAMPLE COLLECTED |      | # of Containers<br>Free/Combined Chlorine Residual mg/L<br>Standing / Flushed: S/F (REG 243)<br>Total Coliform/E. Coli<br>HPC<br>Lead<br>THM | <i>[Handwritten notes: Substrate, Trace Metals, Chloride &amp; DM]</i> |  |  |  |
| LOCATION NAME  | SAMPLE ID |   | DATE             | TIME |  |  |  |  |  |
| 1  | TW24-4    | R G N /   | 2024-01-24       | P.M. |  |  |  |  |  |
| 2  |           |   |                  |      |  |  |  |  |  |
| 3  |           |   |                  |      |  |  |  |  |  |
| 4  |           |   |                  |      |  |  |  |  |  |
| 5  |           |   |                  |      |  |  |  |  |  |
| 6  |           |   |                  |      |  |  |  |  |  |
| 7  |           |   |                  |      |  |  |  |  |  |
| 8  |           |   |                  |      |  |  |  |  |  |
| 9  |           |   |                  |      |  |  |  |  |  |
| 10   |           |   |                  |      |  |  |  |  |  |

|  |                           |                              |   |  |  |
|--|---------------------------|------------------------------|---|--|--|
| Comments: Please include colour in ACU & TCU |                           |                              | Method of Delivery: walking                             |  |  |
| Relinquished By (Sign):                      | Received By Driver/Depot: | Received at Lab:             | Verified By: SO   |  |  |
| Relinquished By (Print): Luca Fiorindi       | Date/Time:                | Date/Time: Jan 24, 2024 3:50 | Date/Time: Jan 24, 2024 4:24p                           |  |  |
| Date/Time: 2024-01-24                        | Temperature: °C           | Temperature: 25.3 °C         | pH Verified: <input checked="" type="checkbox"/> By: SO |  |  |



## **APPENDIX G**

### Pumping Tests Analysis



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-03

P-Test Date: Apr 28, 2022

Analysis Reviewed by: AP

Method: Manual Measurements


Analysis Date: Mar 14, 2024

Aquifer Thickness: 2.0 m

Discharge: Constant 27 L/min

Duration: 6 hours

## Pumping Test Data (TW22-03): Drawdown and Recovery

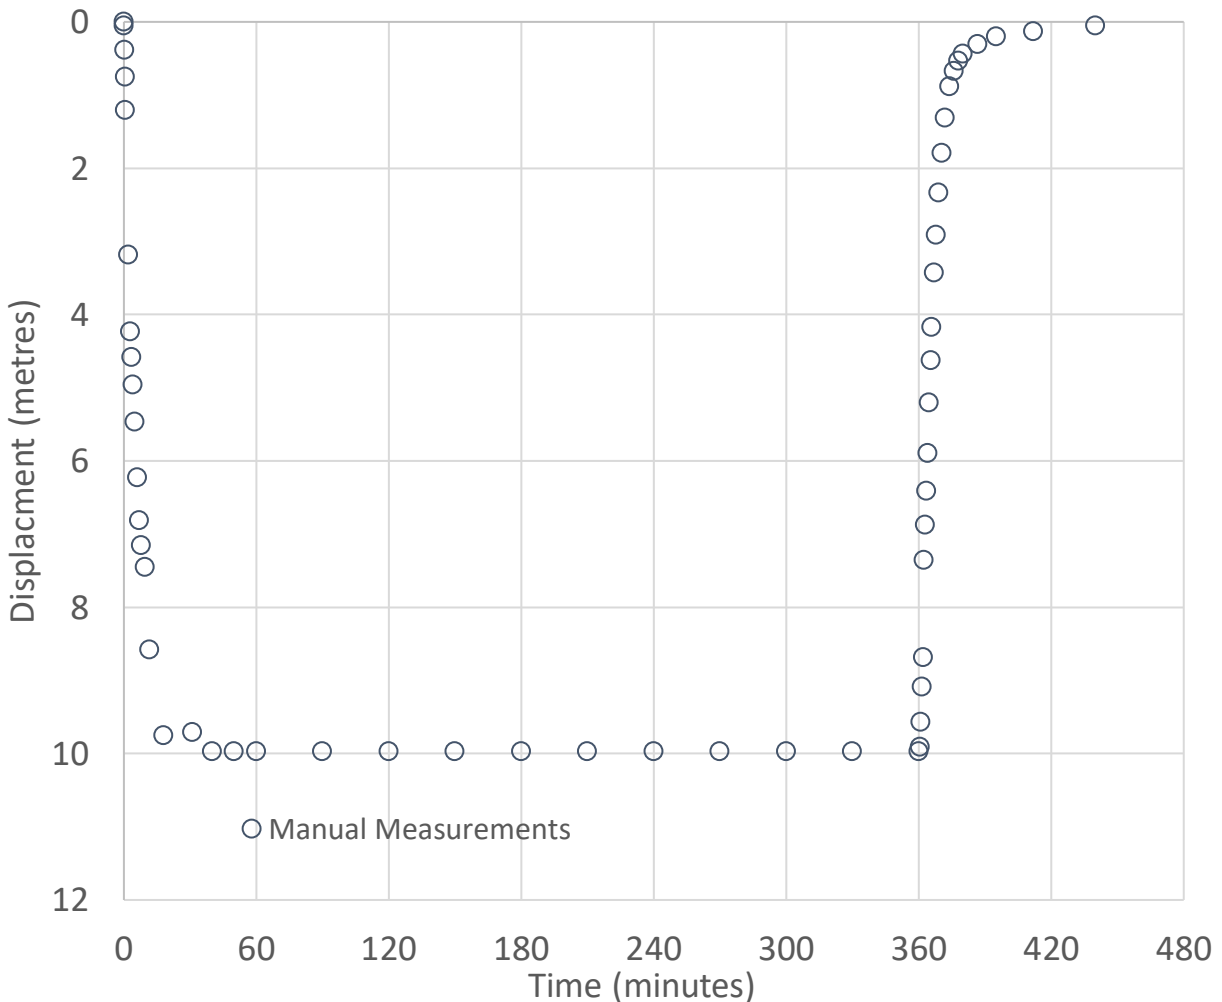



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-04

P-Test Date: Apr 28, 2022

Analysis Reviewed by: AP

Method: Manual Measurements


Analysis Date: Mar 14, 2024

Aquifer Thickness: 2.0 m

Discharge: Constant 27 L/min

Duration: 6 hours

## Pumping Test Analysis (TW22-03): Papadopulous-Cooper Analysis (Confined Aquifer)

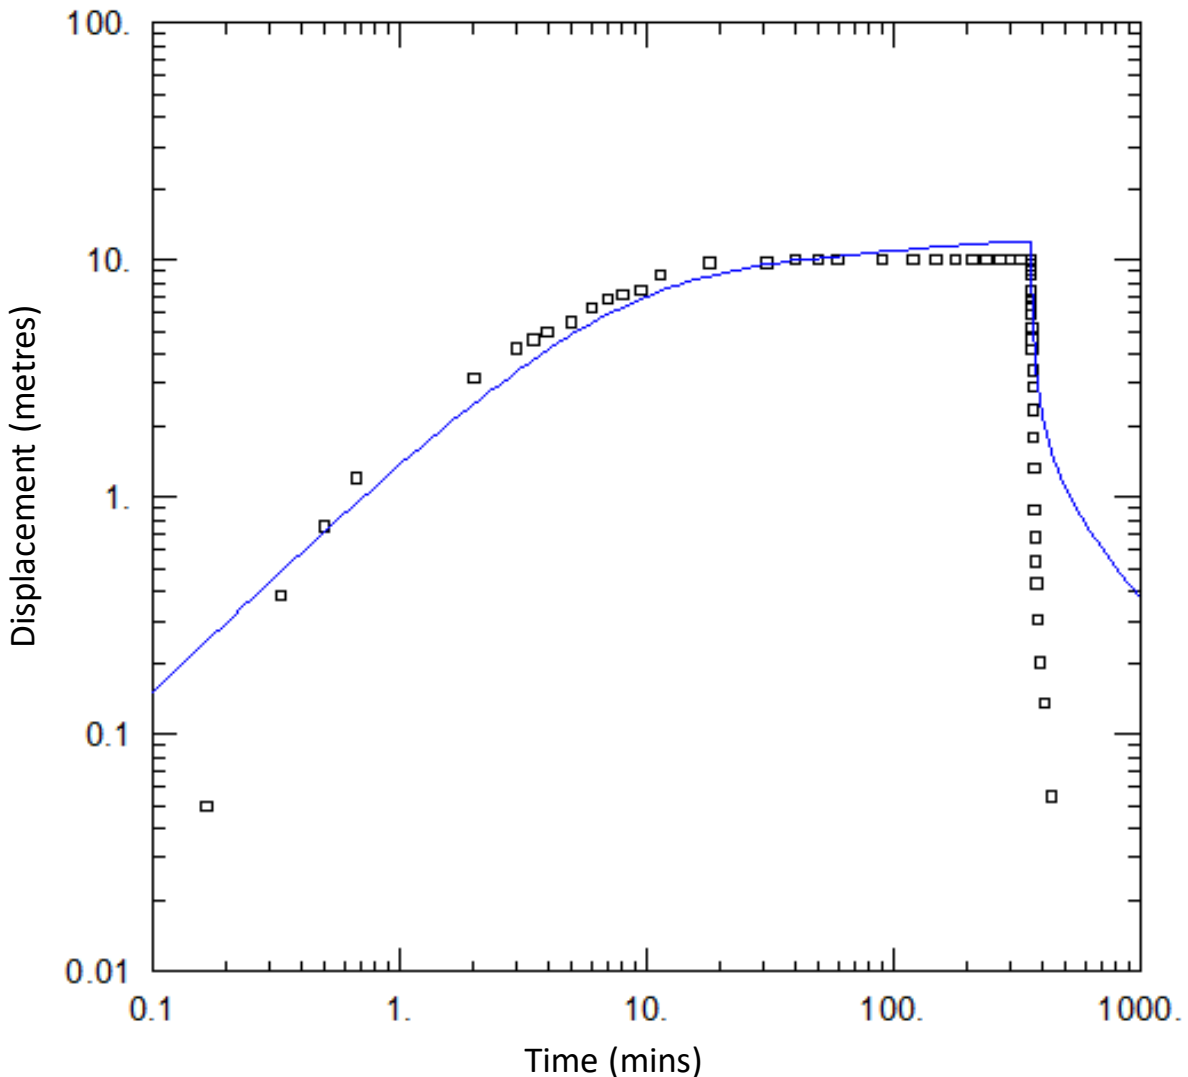

**Estimated Transmissivity: 3.8 m<sup>2</sup>/day / 4.4 x 10<sup>-5</sup> m<sup>2</sup>/s**



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-04

P-Test Date: Apr 28, 2022

Analysis Reviewed by: AP

Method: Manual Measurements


Analysis Date: Mar 14, 2024

Aquifer Thickness: 2.0 m

Discharge: Constant 27 L/min

Duration: 6 hours

## Pumping Test Analysis (TW22-03): Theis-Recovery Analysis (Confined Aquifer)

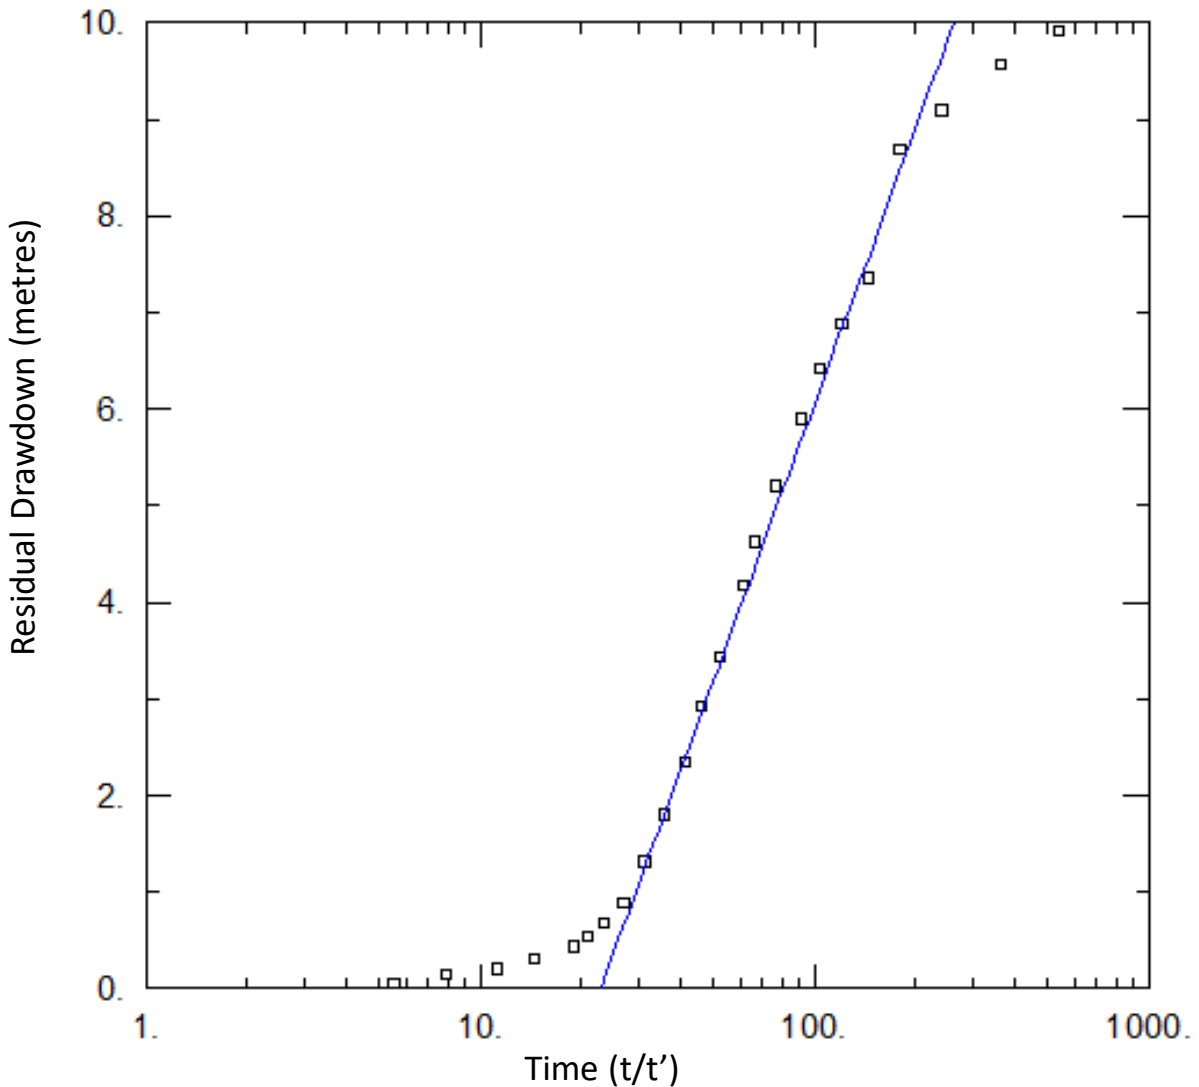

Estimated Transmissivity:  $0.7 \text{ m}^2/\text{day}$  /  $8.1 \times 10^{-6} \text{ m}^2/\text{s}$



Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-04

P-Test Date: Sep. 1, 2022

Analysis Reviewed by: AP

Method: Logger Measurements


Analysis Date: Sep. 1, 2022

Aquifer Thickness: 4.5 m

Discharge: Constant 15 L/min

Duration: 7.5 hours

### Pumping Test Data (TW22-04): Drawdown and Recovery

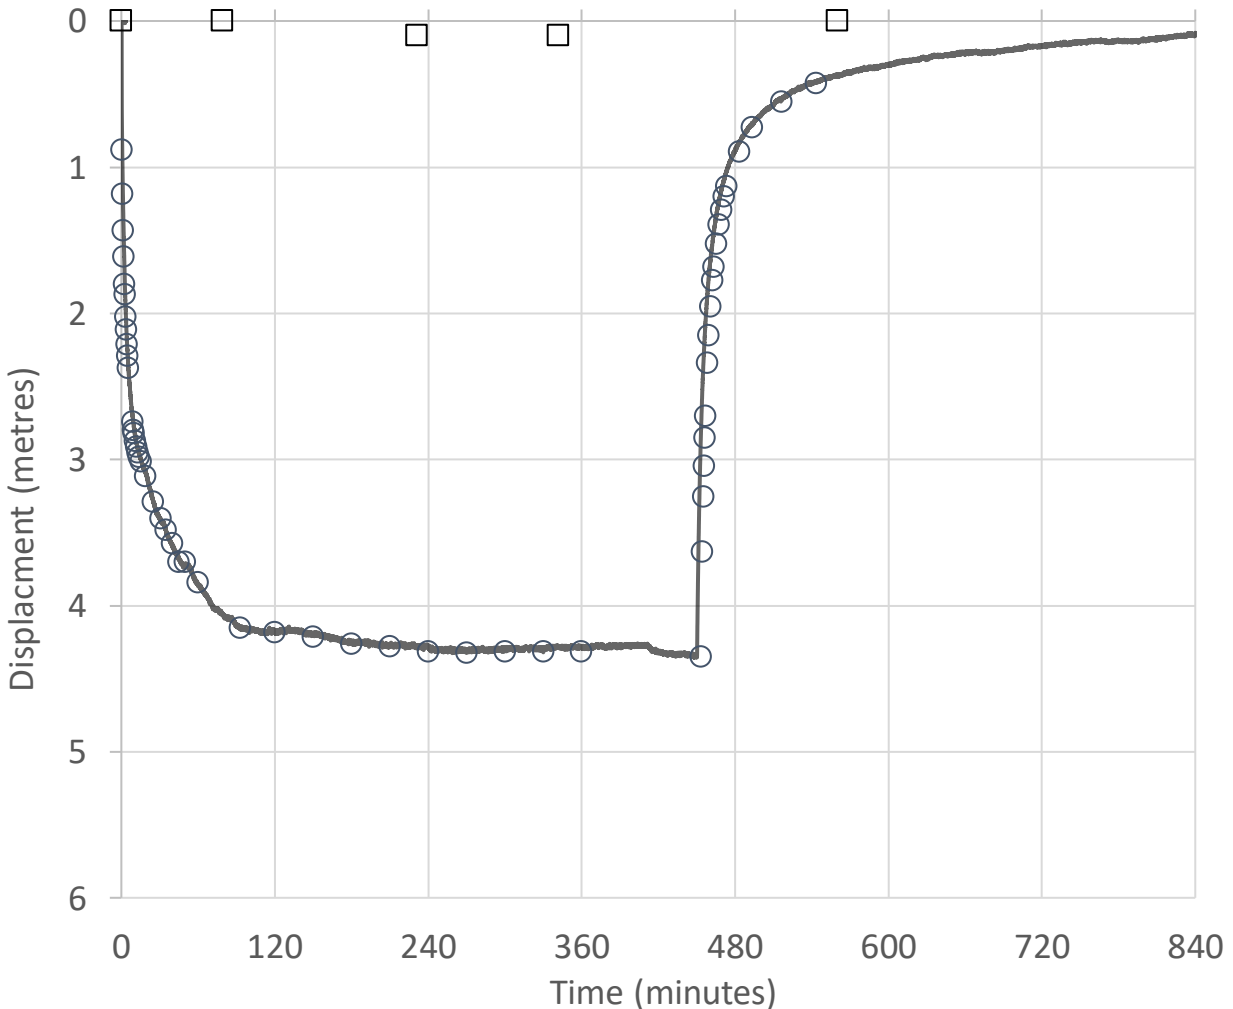

#### Water Levels TW22-04

Static : 2.76 m below top of casing (BTOC)      TOC = 0.76 m above ground surface

End of pump test (6-hours): 7.11 m BTOC; Following recovery (11-hours): 2.78 m BTOC



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-04

P-Test Date: Sep. 1, 2022

Analysis Reviewed by: AP

Method: Manual / Datalogger


Analysis Date: Feb. 15, 2024

Aquifer Thickness: 4.5 m

Discharge: Constant 15 L/min

Duration: 7.5 hours

## Pumping Test Analysis (TW22-04): Theis Analysis (Confined Aquifer)

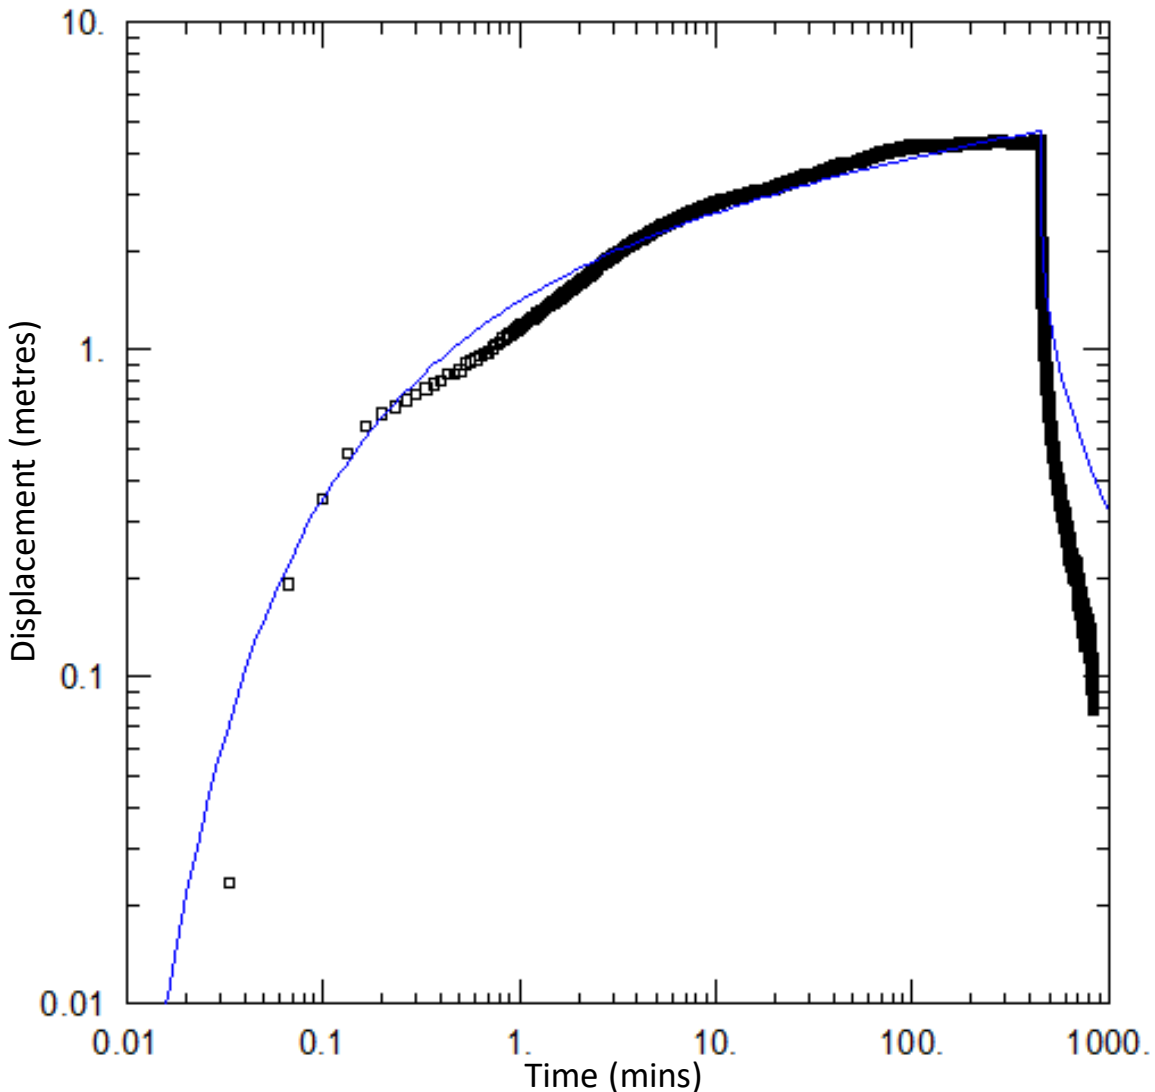

**Estimated Transmissivity: 2.8 m<sup>2</sup>/day / 3.3 x 10<sup>-5</sup> m<sup>2</sup>/s**





# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW22-04

P-Test Date: Sep. 1, 2022

Analysis Reviewed by: AP

Method: Manual / Datalogger


Analysis Date: Feb. 15, 2024

Aquifer Thickness: 4.5 m

Discharge: Constant 15 L/min

Duration: 7.5 hours

## Pumping Test Analysis (TW22-04): Theis-Recovery (Confined Aquifer)

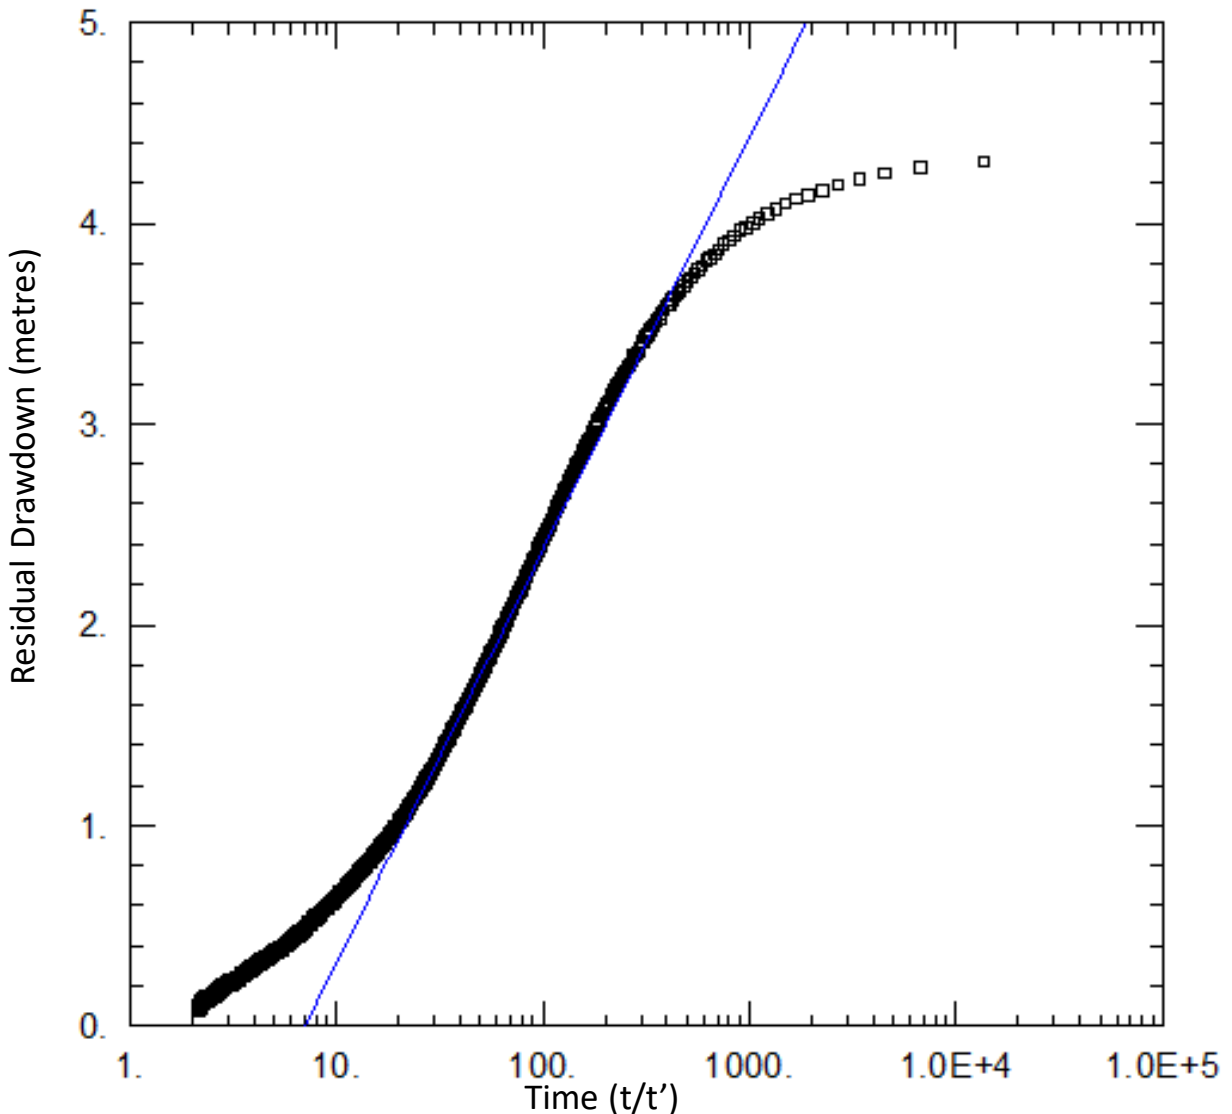

**Estimated Transmissivity: 1.9 m<sup>2</sup>/day / 2.2 x 10<sup>-5</sup> m<sup>2</sup>/s**



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW24-05

P-Test Date: Jan 18, 2024

Analysis Reviewed by: AP

Method: Manual / Datalogger


Analysis Date: Feb. 15, 2024

Aquifer Thickness: 18 m

Discharge: Constant 19 L/min

Duration: 6 hours

### Pumping Test Data (TW24-05): Drawdown and Recovery

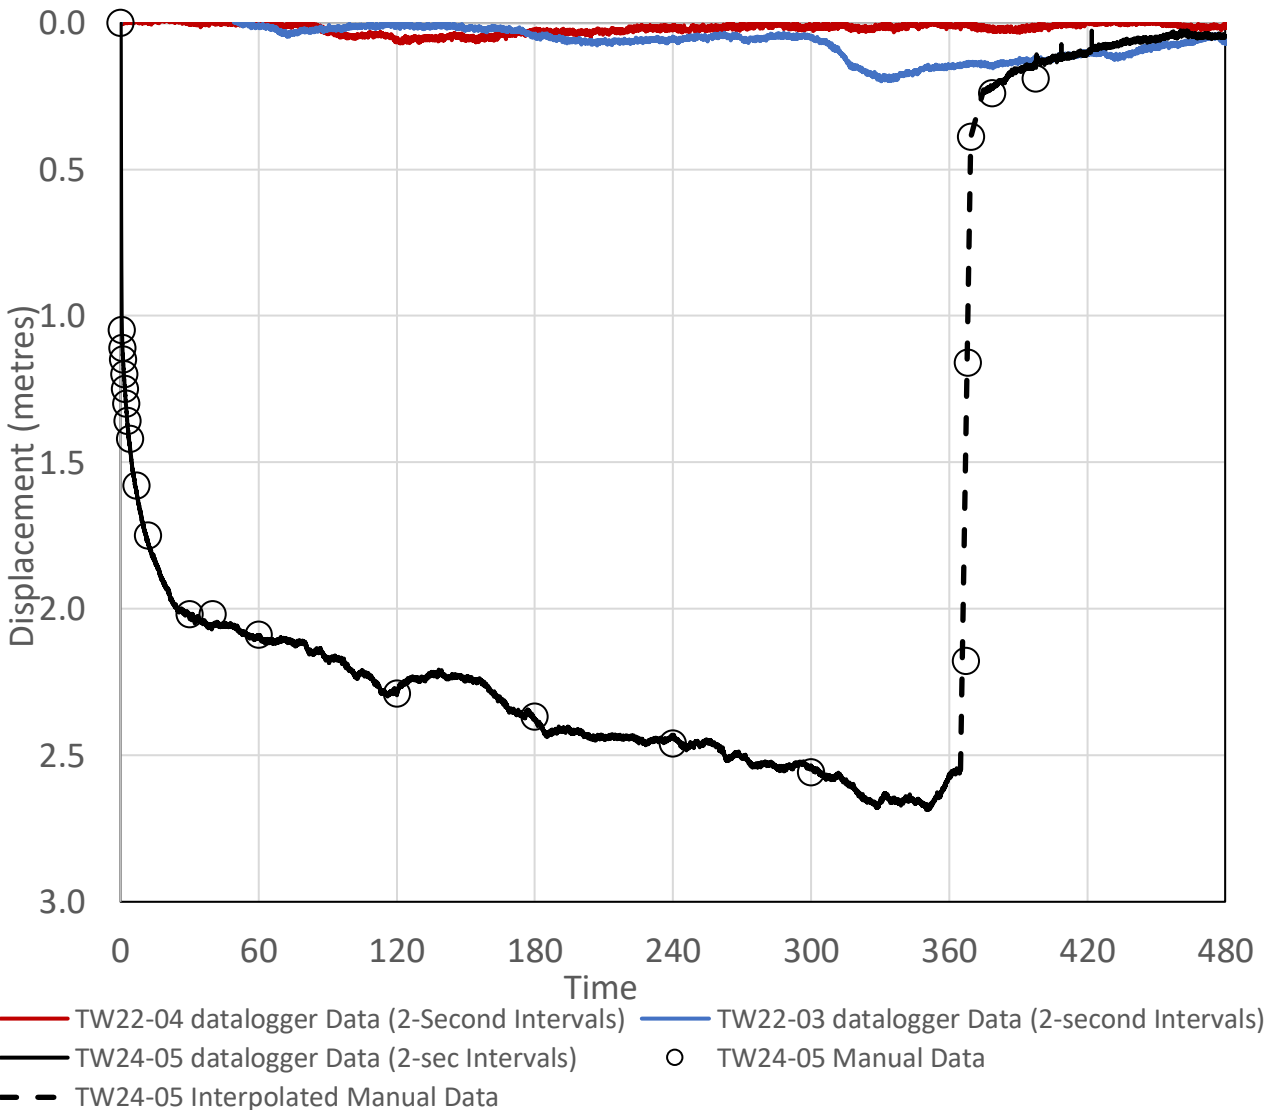

#### Water Levels TW24-05

Static : 8.78 m below top of casing (BTOC);

TOC = 0.5 m above ground surface

End of pump test (6-hours): 11.34 m BTOC; Following recovery (6.5-hours): 8.91 m BTOC



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW24-05

P-Test Date: Jan 18, 2024

Analysis Reviewed by: AP

Method: Manual / Datalogger


Analysis Date: Feb. 15, 2024

Aquifer Thickness: 18 m

Discharge: Constant 19 L/min

Duration: 6 hours

## Pumping Test Analysis (TW24-05): Cooper-Jacob (Confined Aquifer)

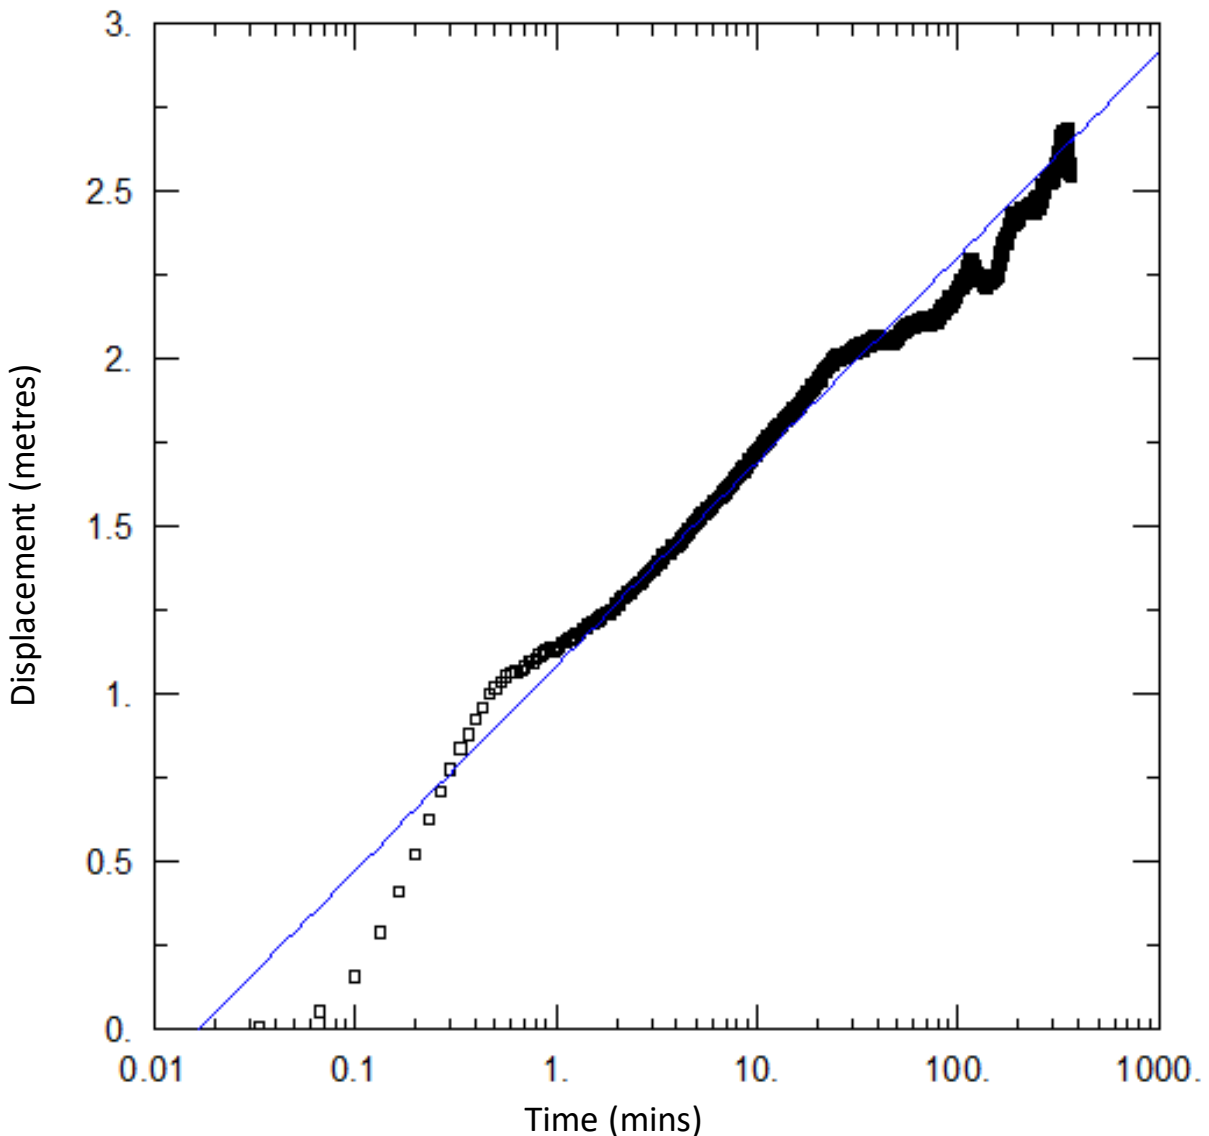

**Estimated Transmissivity: 8.2 m<sup>2</sup>/day / 9.5 x 10<sup>-5</sup> m<sup>2</sup>/s**



# GEMTEC

CONSULTING ENGINEERS  
AND SCIENTISTS

Pumping Test Analysis Report

Project: Scoped Hydrogeological Investigation

Project Number: 100812.001

Client: Hierarchy Development and Design

Location: 930 Smith Road, Ottawa, Ontario

Analysis Performed by: SE

Pumping Well: TW24-05

P-Test Date: Jan 18, 2024

Analysis Reviewed by: AP

Method: Manual / Datalogger


Analysis Date: Feb. 15, 2024

Aquifer Thickness: 18 m

Discharge: Constant 19 L/min

Duration: 6 hours

## Pumping Test Analysis (TW24-05): Theis-Recovery (Confined Aquifer)

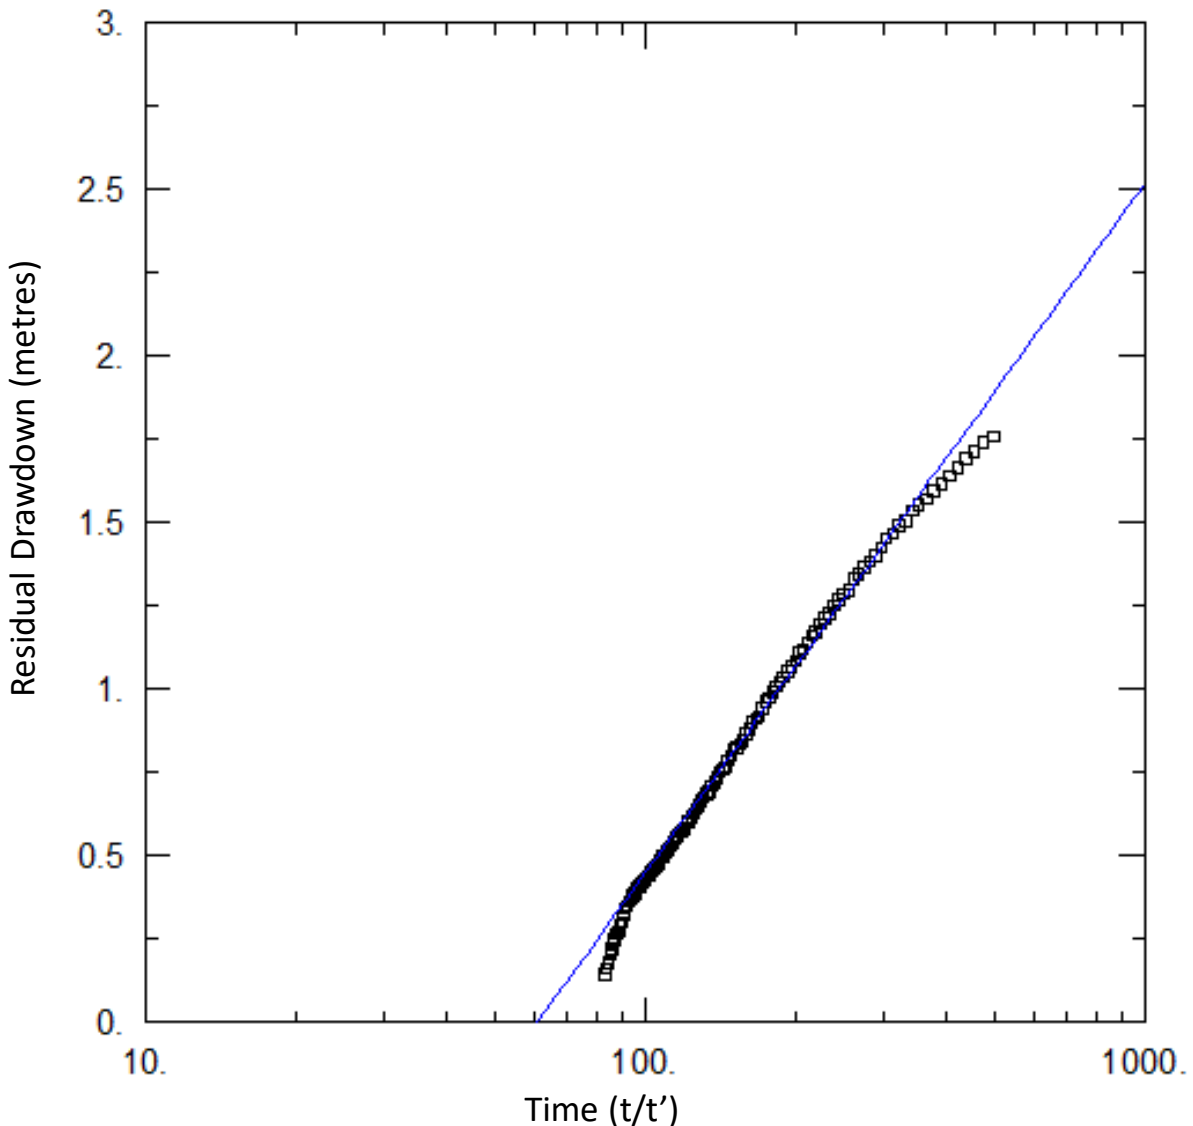

**Estimated Transmissivity: 2.4 m<sup>2</sup>/day / 2.8 x 10<sup>-5</sup> m<sup>2</sup>/s**



## **APPENDIX H**

### Nitrate Dilution Calculations

## Nitrate Dilution Calculation Worksheet

Entire Parcel with 7 lots - 13.49 acres

### Nitrate Loading

#### Residential Septic Systems (assumes 1,000 L/day/lot)

|   |                   |
|---|-------------------|
| Number of lots with untreated septic systems =        | 7 lots            |
| Nitrate loading from untreated septic system =        | 40 grams/lot/day  |
| Total annual nitrate loading from untreated systems = | 102200 grams/year |

**Total Annual Nitrate Loading from all Systems = 102200 grams/year**

### Dilution Volumes

#### Infiltration Factors

|                                |      |
|--------------------------------|------|
| Topography factor =            | 0.17 |
| Soil factor =                  | 0.15 |
| Cover factor =                 | 0.1  |
| Combined infiltration factor = | 0.42 |

#### Precipitation Infiltration

|   |                    |
|---|--------------------|
| Annual water surplus =                                      | 0.380 metres/year  |
| Annual infiltration (Water Surplus x Infiltration Factor) = | 0.1596 metres/year |

#### Infiltration Area and Infiltration Volumes

|  |                        |
|--|------------------------|
| Area available for infiltration (Site Area) =                                    | 54591.67 square metres |
| Area available for infiltration (Site Area - Hard Surface Area) =<br>assumes 10% | 49132.5 square metres  |

Total Annual Volume of Infiltration (Infiltration x Area) = 7842 cubic metres/year

Annual Flow from Residential Lots (assuming 1000 L/day/lot) = 2555 cubic metres/year


**Total Annual Volume Available for Dilution = 10397 cubic metres/year**

### Dilution Calculation

$$C_{\text{Nitrate}} = \frac{\text{Mass}}{\text{Volume}} = \frac{\text{Annual Nitrate Loading (grams/year)}}{\text{Annual Dilution Volume (cubic metres/year)}} = \frac{\text{grams}}{\text{cubic metre}} = \frac{\text{mg}}{\text{L}}$$

$$C_{\text{Nitrate}} = \frac{102200 \text{ grams/year}}{10397 \text{ cubic metres/year}} = 9.83 \text{ mg/L}$$

experience • knowledge • integrity

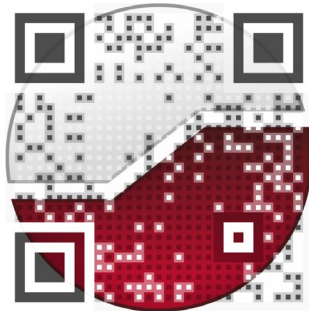

civil  
geotechnical  
environmental  
field services  
materials testing

civil  
géotechnique  
environnementale  
surveillance de chantier  
service de laboratoire des matériaux

expérience • connaissance • intégrité

