

GRADIENTWIND

ENGINEERS & SCIENTISTS

PEDESTRIAN LEVEL WIND STUDY

45 Laurel Street
Ottawa, Ontario

Report: 21-147-PLW



November 11, 2023

PREPARED FOR

2729685 Ontario Inc.
The Estate of Carson Unsworth
320 McRae Avenue
Ottawa, ON K1Z 5R8

PREPARED BY

Sunny Kang, B.A.S., Project Coordinator
Daniel Davalos, MEng., Wind Scientist
Justin Ferraro, P.Eng., Principal

EXECUTIVE SUMMARY

This report describes a pedestrian level wind (PLW) study undertaken to satisfy City of Ottawa Zoning By-law Amendment application requirements for the proposed mixed-use residential development at 45 Laurel Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

The study involves simulation of wind speeds for selected wind directions in a three-dimensional (3D) computer model using the computational fluid dynamics (CFD) technique, combined with meteorological data integration, to assess pedestrian wind comfort and safety within and surrounding the subject site according to City of Ottawa wind comfort and safety criteria. The results and recommendations derived from these considerations are detailed in the main body of the report (Section 5), illustrated in Figures 3A-9, and summarized as follows:

- 1) Most grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks, nearby existing surface parking lots, playground areas serving Devonshire Community Public School, Trillium Pathway, laneway, walkways, and in the vicinity of the building access points serving the proposed development are considered acceptable according to the City of Ottawa Terms of Reference. The two areas that are predicted to experience windy conditions are described as follows:
 - a. **Proposed Parkland and Corner Side Yard.** During the typical use period, conditions within the proposed parkland and the corner side yard situated at the northwest corner and along the south elevation of the subject site, respectively, are predicted to be suitable for a mix of sitting and standing. Comfort levels within these spaces may be improved by implementing landscaping elements around sensitive areas such as tall wind screens and coniferous trees in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.



The extent of mitigation measures is dependent on the programming of the noted spaces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.

- 2) Regarding the common amenity terraces serving the proposed development, wind comfort conditions during the typical use period and recommendations regarding mitigation are described as follows. Notably, all amenity terraces were modelled with 1.8-m-tall wind screens along their full perimeters.
- a. **Building A, North Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable for sitting at the northeast corner and to the south of the terrace and suitable for standing to the north of the terrace with an isolated region suitable for strolling near the northwest corner of the tower.
 - b. **Building A, South Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable a mix of standing and strolling, with conditions suitable for sitting close to the tower façade.
 - c. **Building B, East Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the southeast corner of the tower.
 - d. **Building B, West Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the northwest corner of the tower.
 - e. To improve comfort levels within the common amenity terraces serving Buildings A and B, mitigation inboard of the terrace perimeters and targeted around sensitive areas is recommended, in combination with taller perimeter wind screens (that is, greater than 1.8 m, measured from the walking surface). Inboard mitigation could take the form of wind screens or other common landscape elements. Canopies may also be required above sensitive areas.

- f. The extent of mitigation measures is dependent on the programming of the terraces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.
- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events, (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

TABLE OF CONTENTS

1. INTRODUCTION	1
2. TERMS OF REFERENCE	1
3. OBJECTIVES	3
4. METHODOLOGY.....	3
4.1 Computer-Based Context Modelling	4
4.2 Wind Speed Measurements.....	4
4.3 Historical Wind Speed and Direction Data	5
4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa.....	7
5. RESULTS AND DISCUSSION.....	9
5.1 Wind Comfort Conditions – Grade Level.....	10
5.2 Wind Comfort Conditions – Common Amenity Terraces	13
5.3 Wind Safety	14
5.4 Applicability of Results	14
6. CONCLUSIONS AND RECOMMENDATIONS	14

FIGURES

APPENDICES

Appendix A – Simulation of the Atmospheric Boundary Layer

1. INTRODUCTION

Gradient Wind Engineering Inc. (Gradient Wind) was retained by 2729685 Ontario Inc. to undertake a pedestrian level wind (PLW) study to satisfy City of Ottawa Zoning By-law Amendment application requirements for the proposed mixed-use residential development at 45 Laurel Street in Ottawa, Ontario (hereinafter referred to as “subject site” or “proposed development”). A PLW study was previously conducted in June 2023 for the previous design of the proposed development¹. Our mandate within this study is to investigate pedestrian wind conditions within and surrounding the subject site, and to identify areas where conditions may interfere with certain pedestrian activities so that mitigation measures may be considered, where required.

Our work is based on industry standard computer simulations using the computational fluid dynamics (CFD) technique and data analysis procedures, City of Ottawa wind comfort and safety criteria, architectural drawings prepared by RLA Architecture Inc. in October 2023, surrounding street layouts and existing and approved future building massing information obtained from the City of Ottawa, as well as recent satellite imagery.

2. TERMS OF REFERENCE

The subject site is located at 45 Laurel Street in Ottawa, situated to the north at the intersection of Laurel Street and Loretta Avenue North, on a ‘L’-shaped parcel of land bounded by Laurel Street to the south, Breezehill Avenue North and low-rise buildings to the west, a low-rise building to the north, and the O-Train Line 2 to the east. Throughout this report, Laurel Street is considered project south. The proposed development comprises two buildings, Building A (30 storeys) and Building B (35 storeys), situated to the north and south, respectively, along the east elevation of the subject site. Each building includes a six-storey podium, are topped with a mechanical penthouse (MPH), and share two below-grade parking levels. A proposed parkland is located at the northwest corner and a corner side yard is located along the south elevation of the subject site.

Above the below-grade parking, the ground floor of Building A includes a residential main entrance to the west, residential units along the east elevation, and an indoor pool at the southwest corner. Access to the

¹ Gradient Wind Engineering Inc., ‘75 Breezehill Avenue North – Pedestrian Level Wind Study’, [June 27, 2021]



shared underground parking is provided by a ramp at the northwest corner via a laneway from Laurel Street. Levels 2-6 are reserved for residential use. Level 7 includes indoor amenities to the north and south and residential units throughout the remainder of the level. At Level 7, the building steps back from the north and south elevations to accommodate common amenity terraces. Levels 8-30 rise above the podium with a nominally rectangular planform and comprise residential units.

The ground floor of Building B includes a residential main entrance to the south, retail spaces to the southeast and southwest, a commercial garbage and recycling space at the northwest corner, bike storage spaces to the north, and an indoor amenity at the northeast corner. Levels 2-6 are reserved for residential use. Level 7 includes indoor amenities to the east and west and residential units throughout the remainder of the level. At Level 7, the building steps back from the east and west elevations to accommodate common amenity terraces. Levels 8-35 rise above the podium with a nominally rectangular planform and comprise residential units.

The near-field surroundings, defined as an area within 200 metres (m) of the subject site, include low-rise massing from the southeast clockwise to the northeast with a high-rise building and a mid-rise residential building to the west, and a green space to the east. To the east of the site, the O-Train Line 2 and the Trillium Pathway extend from the northwest to the southeast. Notably, a 30-storey development is approved (Site Plan Control) at 1040 Somerset Street West, approximately 75 m to the north-northwest, a 28-storey development is approved (ZBLA) at 1050 Somerset West, approximately 90 m to the northwest, a development comprising mixed-use residential mid- and high-rise buildings (ranging from 9 to 30 storeys) and townhouse blocks is approved (ZBLA) at 933 Gladstone Avenue, to the east across the O-Train Line 2, and a development comprising three mixed-use towers (30, 33, and 35 storeys) is approved (ZBLA) at 951 Gladstone Avenue and 145 Loretta Avenue North, approximately 85 m to the southeast.

The far-field surroundings, defined as an area beyond the near-field but within a 2-kilometre (km) radius of the subject site, are characterized by low-rise massing with isolated mid- and high-rise buildings from the north clockwise to the west-northwest, and low-rise massing followed by greenspace and the Ottawa River in the remaining directions, with the mid- and high-rise buildings of the edge of Ottawa downtown core situated approximately 1.2 km to the northeast. Dow's Lake is situated approximately 1.3 km to the southeast and the Ottawa River flows from the west-northwest to the north-northeast, approximately 830 m to the north-northwest.



Site plans for the proposed and existing massing scenarios are illustrated in Figures 1A and 1B, while Figures 2A-2H illustrate the computational models used to conduct the study. The existing massing scenario includes the existing massing and any future developments approved by the City of Ottawa.

3. OBJECTIVES

The principal objectives of this study are to (i) determine pedestrian level wind conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; and (iii) recommend suitable mitigation measures, where required.

4. METHODOLOGY

The approach followed to quantify pedestrian wind conditions over the site is based on CFD simulations of wind speeds across the study site within a virtual environment, meteorological analysis of the Ottawa area wind climate, and synthesis of computational data with City of Ottawa wind comfort and safety criteria². The following sections describe the analysis procedures, including a discussion of the noted pedestrian wind criteria.

² City of Ottawa Terms of References: Wind Analysis
https://documents.ottawa.ca/sites/default/files/torwindanalysis_en.pdf

4.1 Computer-Based Context Modelling

A computer based PLW study was performed to determine the influence of the wind environment on pedestrian comfort over the proposed development site. Pedestrian comfort predictions, based on the mechanical effects of wind, were determined by combining measured wind speed data from CFD simulations with statistical weather data obtained from Ottawa Macdonald-Cartier International Airport. The general concept and approach to CFD modelling is to represent building and topographic details in the immediate vicinity of the study site on the surrounding model, and to create suitable atmospheric wind profiles at the model boundary. The wind profiles are designed to have similar mean and turbulent wind properties consistent with actual site exposures.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the model due to the difficulty of providing accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly stronger wind speeds.

4.2 Wind Speed Measurements

The PLW analysis was performed by simulating wind flows and gathering velocity data over a CFD model of the site for 12 wind directions. The CFD simulation model was centered on the study building, complete with surrounding massing within a radius of 480 m. The process was performed for two context massing scenarios, as noted in Section 2.


Mean and peak wind speed data obtained over the study site for each wind direction were interpolated to 36 wind directions at 10° intervals, representing the full compass azimuth. Measured wind speeds approximately 1.5 m above local grade and the common amenity terraces serving the proposed development were referenced to the wind speed at gradient height to generate mean and peak velocity ratios, which were used to calculate full-scale values. Gradient height represents the theoretical depth of the boundary layer of the earth's atmosphere, above which the mean wind speed remains constant. Further details of the wind flow simulation technique are presented in Appendix A.

4.3 Historical Wind Speed and Direction Data

A statistical model for winds in Ottawa was developed from approximately 40 years of hourly meteorological wind data recorded at Ottawa Macdonald-Cartier International Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were analyzed for each month of the year to determine the statistically prominent wind directions and corresponding speeds, and to characterize similarities between monthly weather patterns.

The statistical model of the Ottawa area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The prominent wind speeds and directions can be identified by the longer length of the bars. For Ottawa, the most common winds occur for westerly wind directions, followed by those from the east, while the most common wind speeds are below 36 km/h. The directional prominence and relative magnitude of wind speed changes somewhat from season to season.

SEASONAL DISTRIBUTION OF WIND OTTAWA MACDONALD-CARTIER INTERNATIONAL AIRPORT

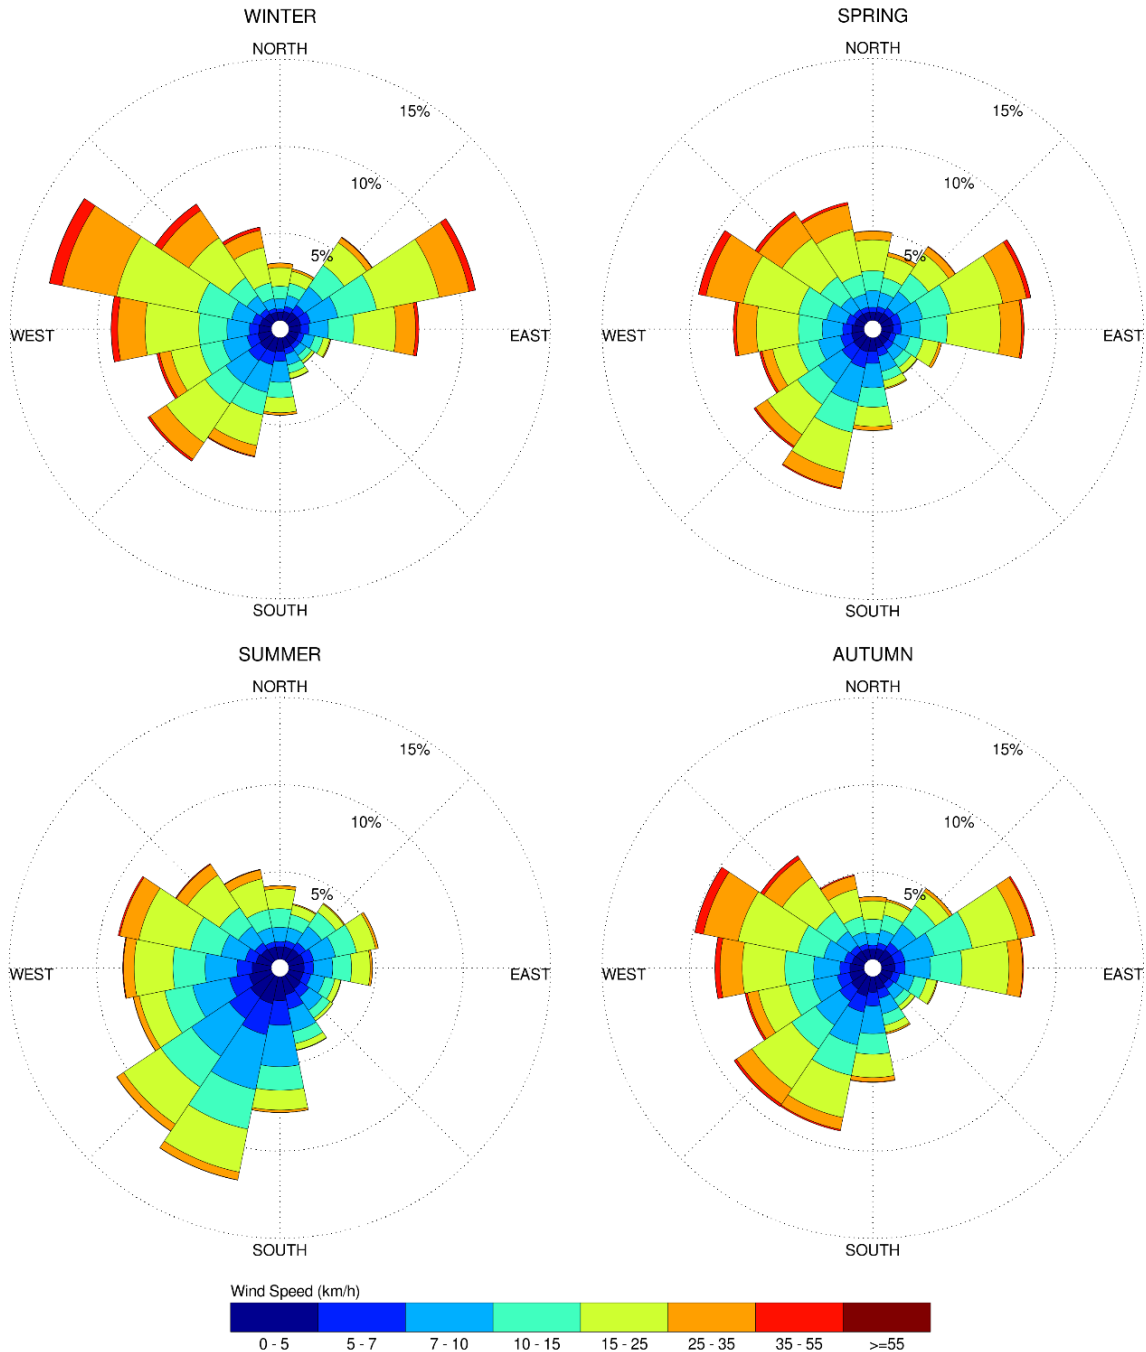

Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.



4.4 Pedestrian Wind Comfort and Safety Criteria – City of Ottawa

Pedestrian wind comfort and safety criteria are based on the mechanical effects of wind without consideration of other meteorological conditions (that is, temperature and relative humidity). The comfort criteria assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Five pedestrian comfort classes based on 20% non-exceedance mean wind speed ranges are used to assess pedestrian comfort: (1) Sitting; (2) Standing; (3) Strolling; (4) Walking; and (5) Uncomfortable. The gust speeds, and equivalent mean speeds, are selected based on the Beaufort scale, which describes the effects of forces produced by varying wind speed levels on objects. Wind conditions suitable for sitting are represented by the colour blue, standing by green, strolling by yellow, and walking by orange; uncomfortable conditions are represented by the colour magenta. Specifically, the comfort classes, associated wind speed ranges, and limiting criteria are summarized as follows:

PEDESTRIAN WIND COMFORT CLASS DEFINITIONS

Wind Comfort Class	GEM Speed (km/h)	Description
SITTING	≤ 10	Mean wind speeds no greater than 10 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 16 km/h.
STANDING	≤ 14	Mean wind speeds no greater than 14 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 22 km/h.
STROLLING	≤ 17	Mean wind speeds no greater than 17 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 27 km/h.
WALKING	≤ 20	Mean wind speeds no greater than 20 km/h occurring at least 80% of the time. The equivalent gust wind speed is approximately 32 km/h.
UNCOMFORTABLE	> 20	Uncomfortable conditions are characterized by predicted values that fall below the 80% target for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

Regarding wind safety, the pedestrian safety wind speed criterion is based on the approximate threshold that would cause a vulnerable member of the population to fall. A 0.1% exceedance gust wind speed of 90 km/h is classified as dangerous. From calculations of stability, it can be shown that gust wind speeds of 90 km/h would be the approximate threshold wind speed that would cause an average elderly person in good health to fall. Notably, pedestrians tend to be more sensitive to wind gusts than to steady winds for lower wind speed ranges. For strong winds approaching dangerous levels, this effect is less important because the mean wind can also create problems for pedestrians.

Experience and research on people's perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 20% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if a mean wind speed of 10 km/h (equivalent gust wind speed of approximately 16 km/h) were exceeded for more than 20% of the time most pedestrians would judge that location to be too windy for sitting. Similarly, if mean wind speed of 20 km/h (equivalent gust wind speed of approximately 32 km/h) at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established throughout the subject site, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for discrete regions within and surrounding the subject site. This step involves comparing the predicted comfort classes to the target comfort classes, which are dictated by the location type for each region (that is, a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their typical windiest target comfort classes are summarized on the following page. Depending on the programming of a space, the desired comfort class may differ from this table.



TARGET PEDESTRIAN WIND COMFORT CLASSES FOR VARIOUS LOCATION TYPES

Location Types	Target Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Walking
Public Sidewalk / Bicycle Path	Walking
Outdoor Amenity Space	Sitting / Standing
Café / Patio / Bench / Garden	Sitting / Standing
Transit Stop (Without Shelter)	Standing
Transit Stop (With Shelter)	Walking
Public Park / Plaza	Sitting / Standing
Garage / Service Entrance	Walking
Parking Lot	Walking
Vehicular Drop-Off Zone	Walking

5. RESULTS AND DISCUSSION

The following discussion of the predicted pedestrian wind conditions for the subject site is accompanied by Figures 3A-6B, illustrating wind conditions at grade level for the proposed and existing massing scenarios, and by Figures 8A-8D, which illustrate conditions over the common amenity terraces serving Buildings A and B at Level 7. Conditions are presented as continuous contours of wind comfort throughout the subject site and correspond to the comfort classes presented in Section 4.4.

Wind comfort conditions at grade level and over the noted common amenity terraces are also reported for the typical use period, which is defined as May to October, inclusive. Figures 7 and 9 illustrate comfort conditions at grade and over the noted common amenity terraces, respectively, consistent with the comfort classes in Section 4.4. The details of these conditions are summarized in the following pages for each area of interest.



5.1 Wind Comfort Conditions – Grade Level

Sidewalks along Loretta Avenue North: Following the introduction of the proposed development, wind comfort conditions over the nearby public sidewalks along Loretta Avenue North are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for standing, or better, throughout the remainder of the year with a small, isolated region suitable for strolling at the intersection of Loretta Avenue North and Laurel Street during the winter. The noted conditions are considered acceptable.

Wind conditions over the sidewalks along Loretta Avenue North with the existing massing are predicted to be suitable mostly for sitting throughout the year. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions with the proposed development are nevertheless considered acceptable.

Sidewalks along Laurel Street and Existing Surface Parking Lot South of Subject Site: Following the introduction of the proposed development, wind conditions over the public sidewalks along Laurel Street and the nearby areas of the existing parking lot to the south of the subject site are predicted to be suitable for sitting during summer, becoming suitable for standing, or better, throughout the remainder of the year. The noted conditions are considered acceptable.

Conditions over the sidewalks along Laurel Street and the noted parking lot with the existing massing are predicted to be suitable for sitting throughout the year. While the introduction of the proposed development produces windier conditions over the noted areas in comparison to the existing massing, conditions are nevertheless considered acceptable.

Existing Surface Parking Lots to the West: Following the introduction of the proposed development, wind conditions over the existing surface parking lot to the west of Building A are predicted to be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year, while conditions over the existing surface parking lot to the west of Building B are predicted to be suitable for sitting during the summer, becoming suitable mostly for sitting throughout the remainder of the year. The noted conditions are considered acceptable.



Conditions over the noted areas with the existing massing are predicted to be suitable for sitting throughout the year. While the introduction of the proposed development produces windier conditions over the noted areas in comparison to the existing massing, conditions are nevertheless considered acceptable.

Sidewalks along Breezehill Avenue North: Following the introduction of the proposed development, wind comfort conditions over the nearby public sidewalks along Breezehill Avenue North are predicted to be suitable mostly for sitting during the summer, becoming suitable for a mix of sitting and standing during the autumn, and suitable for standing, or better, with isolated regions suitable for strolling during the winter and spring. The noted conditions are considered acceptable.

Wind conditions over the sidewalks along Breezehill Avenue North with the existing massing are predicted to be suitable mostly for sitting during the summer, becoming suitable for mostly standing, or better, throughout the remainder of the year. While the introduction of the proposed development produces windier conditions in comparison to existing conditions, wind comfort conditions with the proposed development are nevertheless considered acceptable.

Playground Areas Serving Devonshire Community Public School West of Subject Site: Prior to the introduction of the proposed development, wind conditions over the playground areas serving Devonshire Community Public School situated to the west of the subject site at 100 Breezehill Avenue North are predicted to be suitable for sitting during the typical use period. The noted conditions remain unchanged following the introduction of the proposed development, and the wind conditions with the proposed development are considered acceptable.

Trillium Pathway East of Subject Site: Following the introduction of the proposed development, conditions over the Trillium Pathway situated to the east of the subject site are predicted to be suitable for sitting with an isolated region suitable for standing during the summer, becoming suitable for standing, or better, throughout the remainder of the year. The noted conditions are considered acceptable.

Wind comfort conditions over the nearby areas of the Trillium Pathway with the existing massing are predicted to be suitable for sitting during the summer, becoming suitable for a mix of sitting and standing throughout the remainder of the year. While the introduction of the proposed development produces



windier conditions in comparison to existing conditions, wind comfort conditions with the proposed development are nevertheless considered acceptable.

Proposed Parkland and Corner Side Yard: Wind comfort conditions during the typical use period within the proposed parkland situated at the northwest corner of the subject site are predicted to be suitable for sitting to the west and suitable for standing to the east, as illustrated in Figure 7.

During the typical use period, conditions within the corner side yard along the south elevation of the subject site are predicted to be suitable for sitting with standing conditions to the east.

Comfort levels within the proposed parkland and corner side yard may be improved by implementing landscaping elements around sensitive areas such as tall wind screens and coniferous trees in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.

The extent of mitigation measures is dependent on the programming of the noted spaces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.

Proposed Laneway and Walkways: Conditions over the laneway situated along the west elevation of the subject site are predicted to be suitable for sitting with an isolated region suitable for standing during the summer, becoming suitable for standing, or better, throughout the remainder of the year with small, isolated regions suitable for strolling during the winter and spring. Conditions over the walkways within the subject site are predicted to be suitable for a mix of sitting and standing during the summer, becoming suitable for strolling, or better, throughout the remainder of the year. The noted conditions are considered acceptable.

Building Access Points: Wind conditions in the vicinity of all building access points serving Building A and the building access points serving Building B along its south and west elevations are predicted to be suitable for sitting throughout the year. Conditions in the vicinity of the secondary building access points along the north elevation of Building B are predicted to be suitable for standing, or better, during the summer, becoming suitable for a mix of standing and strolling throughout the remainder of the year. The noted conditions are considered acceptable.



5.2 Wind Comfort Conditions – Common Amenity Terraces

Building A is served by common amenity terraces at Level 7 to the north and south, while Building B is served by common amenity terraces at Level 7 to the east and west. The noted amenity terraces were modelled with 1.8-m-tall wind screens along their full perimeters. Wind comfort conditions within these spaces during the typical use period and recommendations regarding mitigation are described as follows:

Building A, North Level 7 Amenity Terrace: Wind comfort conditions within the common amenity terrace serving Building A at Level 7 to the north are predicted to be suitable for sitting at the northeast corner and to the south of the terrace and suitable for standing to the north of the terrace with an isolated region suitable for strolling near the northwest corner of the tower, as illustrated in Figure 9.

Building A, South Level 7 Amenity Terrace: Wind comfort conditions within the common amenity terrace serving Building A at Level 7 to the south are predicted to be suitable a mix of standing and strolling, with conditions suitable for sitting close to the tower façade, as illustrated in Figure 9. More specifically, strolling conditions are predicted nearly central to the terrace.

Building B, East Level 7 Amenity Terrace: Wind comfort conditions within the common amenity terrace serving Building B at Level 7 to the east are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the southeast corner of the tower, as illustrated in Figure 9.

Building B, West Level 7 Amenity Terrace: Wind comfort conditions within the common amenity terrace serving Building B at Level 7 to the west are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the northwest corner of the tower, as illustrated in Figure 9.

To improve comfort levels within the common amenity terraces serving Buildings A and B, mitigation inboard of the terrace perimeters and targeted around sensitive areas is recommended, in combination with taller perimeter wind screens (that is, greater than 1.8 m, measured from the walking surface). Inboard mitigation could take the form of wind screens or other common landscape elements. Canopies may also be required above sensitive areas.

The extent of mitigation measures is dependent on the programming of the terraces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.



5.3 Wind Safety

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no pedestrian areas within or surrounding the subject site are expected to experience conditions that could be considered dangerous, as defined in Section 4.4.

5.4 Applicability of Results

Pedestrian wind comfort and safety have been quantified for the specific configuration of existing and foreseeable construction around the subject site. Future changes (that is, construction or demolition) of these surroundings may cause changes to the wind effects in two ways, namely: (i) changes beyond the immediate vicinity of the subject site would alter the wind profile approaching the subject site; and (ii) development in proximity to the subject site would cause changes to local flow patterns.

6. CONCLUSIONS AND RECOMMENDATIONS

A complete summary of the predicted wind conditions is provided in Section 5 and illustrated in Figures 3A-9. Based on computer simulations using the CFD technique, meteorological data analysis of the Ottawa wind climate, City of Ottawa wind comfort and safety criteria, and experience with numerous similar developments, the study concludes the following:

- 1) Most grade-level areas within and surrounding the subject site are predicted to experience conditions that are considered acceptable for the intended pedestrian uses throughout the year. Specifically, conditions over surrounding sidewalks, nearby existing surface parking lots, playground areas serving Devonshire Community Public School, Trillium Pathway, laneway, walkways, and in the vicinity of the building access points serving the proposed development are considered acceptable according to the City of Ottawa Terms of Reference. The two areas that are predicted to experience windy conditions are described as follows:
 - a. **Proposed Parkland and Corner Side Yard.** During the typical use period, conditions within the proposed parkland and the corner side yard situated at the northwest corner and along the south elevation of the subject site, respectively, are predicted to be suitable for a mix of sitting and standing. Comfort levels within these spaces may be improved by implementing landscaping elements around sensitive areas such as tall wind screens and



coniferous trees in dense arrangements, in combination with strategically placed seating with high-back benches and other local wind mitigation.

The extent of mitigation measures is dependent on the programming of the noted spaces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.

- 2) Regarding the common amenity terraces serving the proposed development, wind comfort conditions during the typical use period and recommendations regarding mitigation are described as follows. Notably, all amenity terraces were modelled with 1.8-m-tall wind screens along their full perimeters.
 - a. **Building A, North Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable for sitting at the northeast corner and to the south of the terrace and suitable for standing to the north of the terrace with an isolated region suitable for strolling near the northwest corner of the tower.
 - b. **Building A, South Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable a mix of standing and strolling, with conditions suitable for sitting close to the tower façade.
 - c. **Building B, East Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the southeast corner of the tower.
 - d. **Building B, West Level 7 Amenity Terrace:** Wind comfort conditions are predicted to be suitable mostly for sitting, with an isolated region suitable for standing near the northwest corner of the tower.
 - e. To improve comfort levels within the common amenity terraces serving Buildings A and B, mitigation inboard of the terrace perimeters and targeted around sensitive areas is recommended, in combination with taller perimeter wind screens (that is, greater than



1.8 m, measured from the walking surface). Inboard mitigation could take the form of wind screens or other common landscape elements. Canopies may also be required above sensitive areas.

- f. The extent of mitigation measures is dependent on the programming of the terraces. If necessary, an appropriate mitigation strategy will be developed in collaboration with the building and landscape architects for the future Site Plan Control application submission.
- 3) The foregoing statements and conclusions apply to common weather systems, during which no dangerous wind conditions, as defined in Section 4.4, are expected anywhere over the subject site. During extreme weather events, (for example, thunderstorms, tornadoes, and downbursts), pedestrian safety is the main concern. However, these events are generally short-lived and infrequent and there is often sufficient warning for pedestrians to take appropriate cover.

Sincerely,

Gradient Wind Engineering Inc.



Daniel Davalos, MEng.
Wind Scientist





Justin Ferraro, P.Eng.
Principal



Sunny Kang, B.A.S.
Project Coordinator



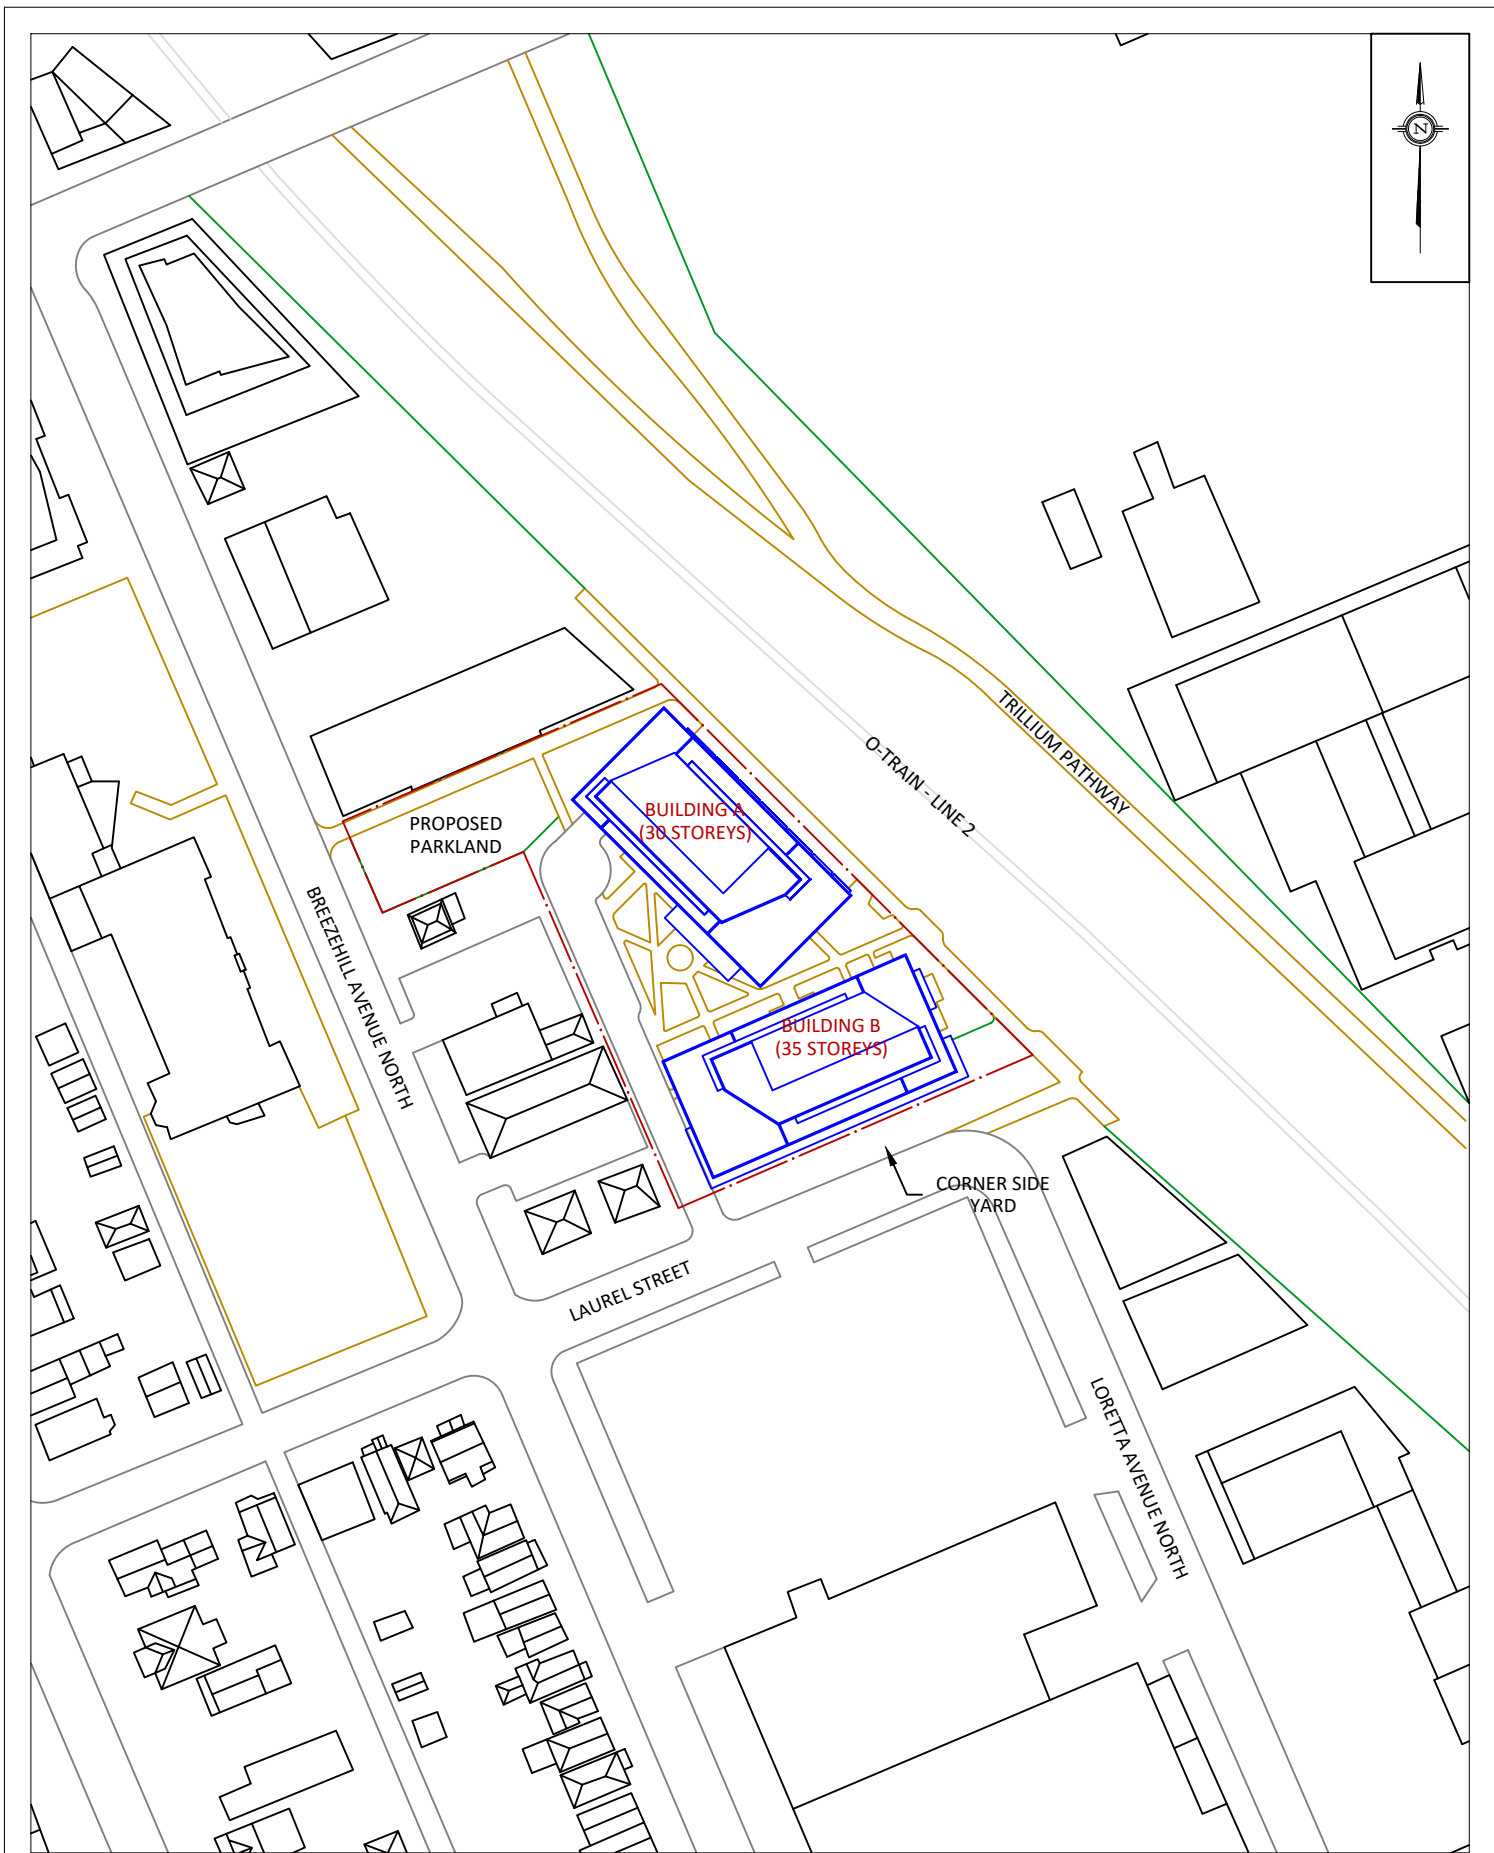

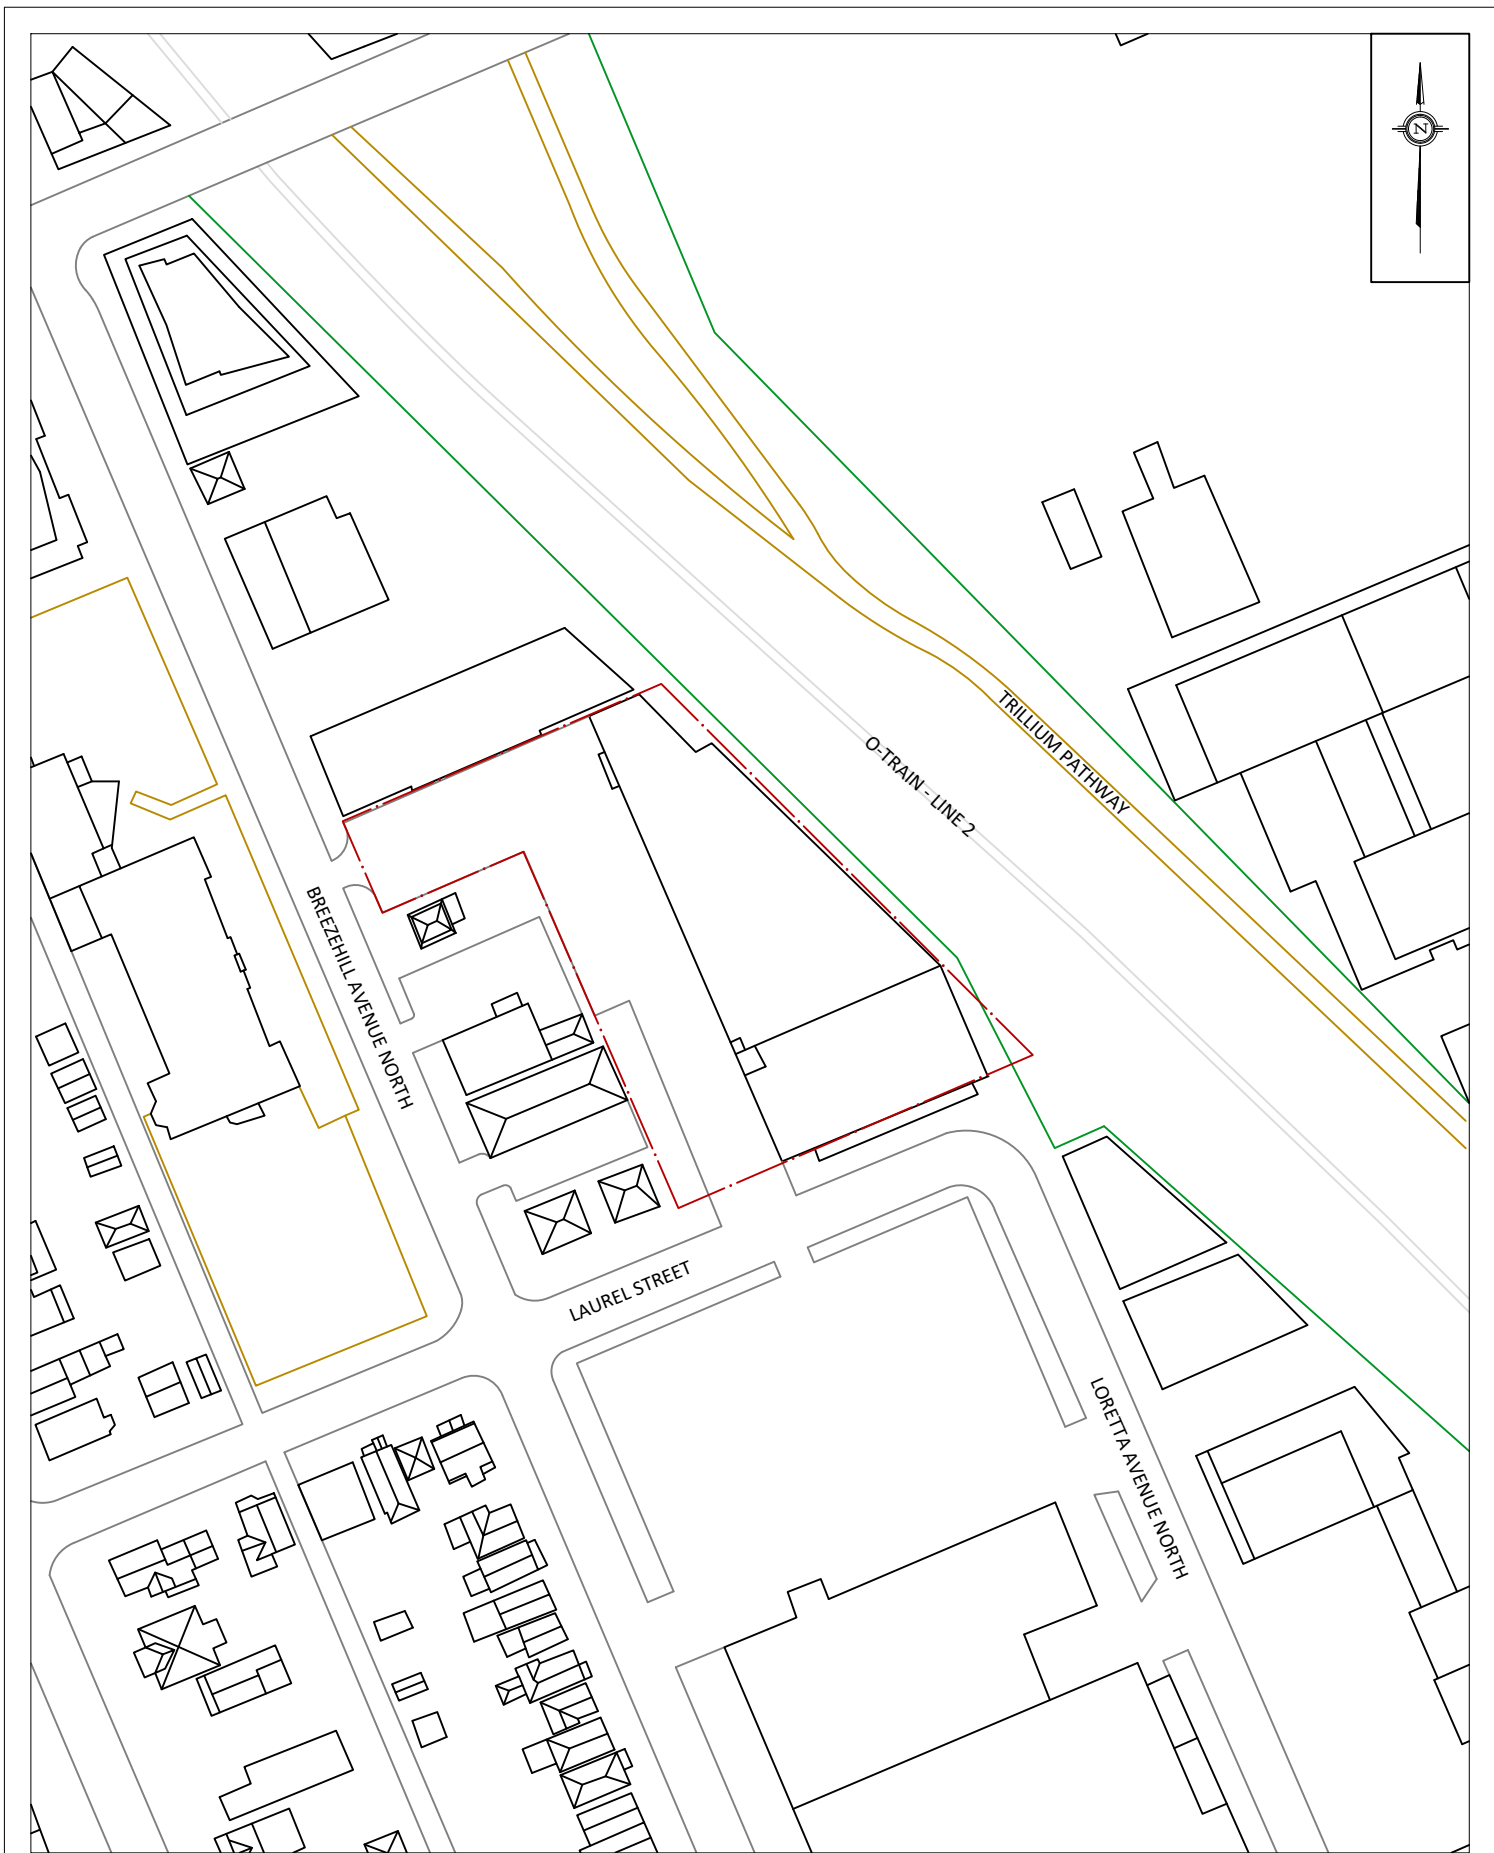

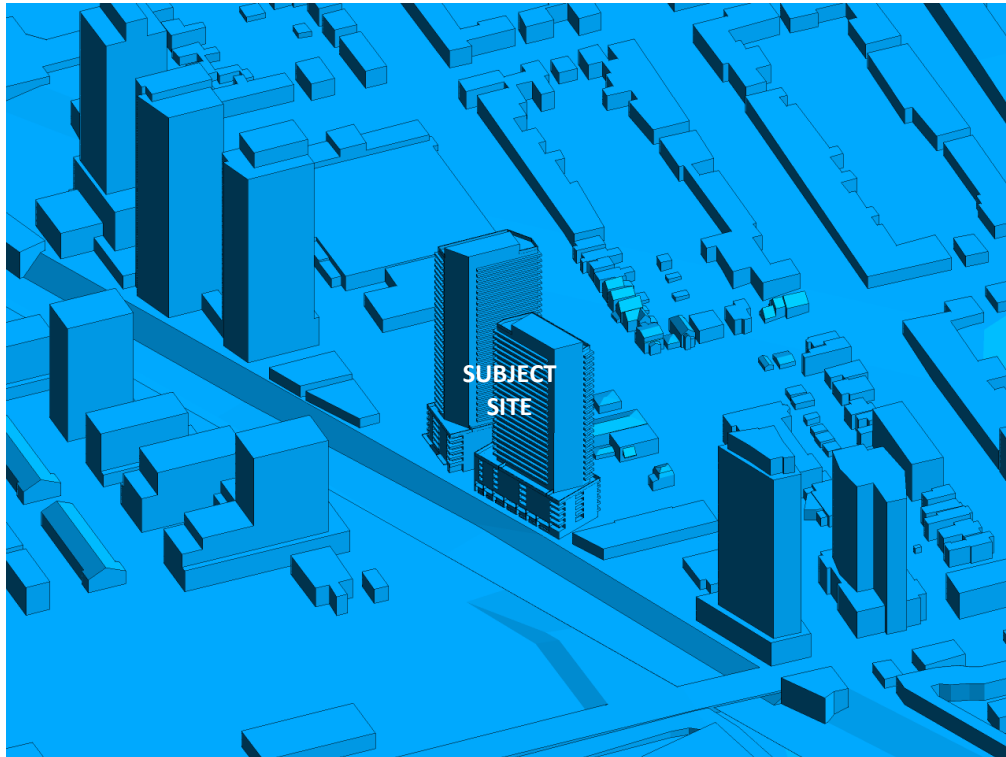


FIGURE 2A: COMPUTATIONAL MODEL, PROPOSED MASSING, NORTH PERSPECTIVE

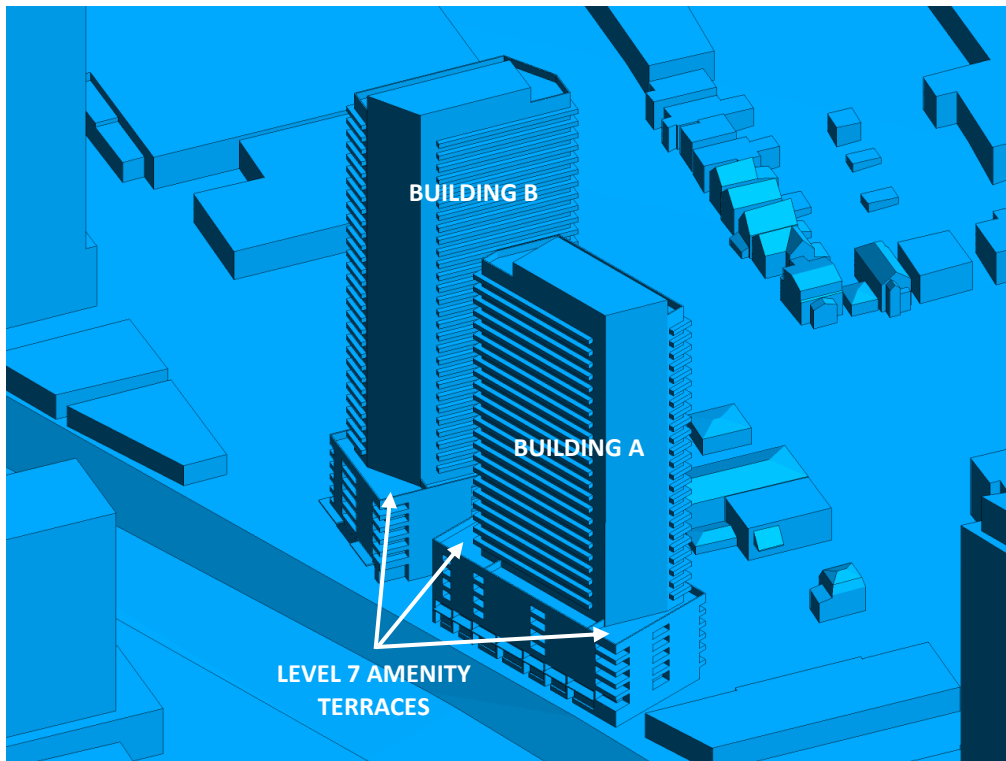


FIGURE 2B: CLOSE UP OF FIGURE 2A



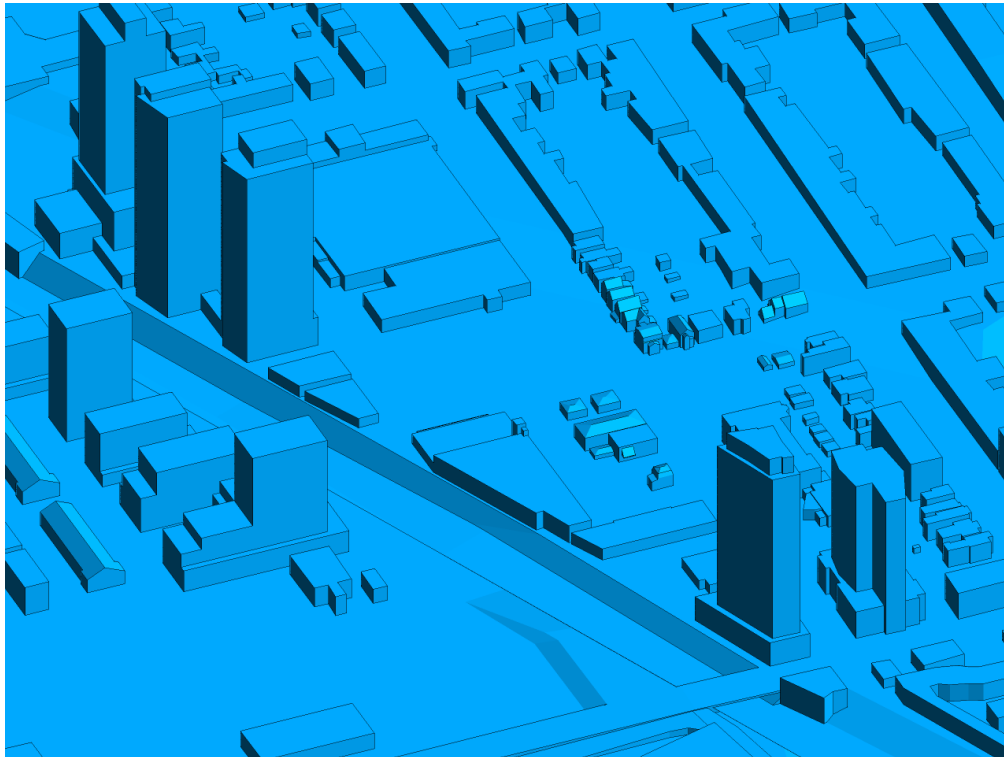


FIGURE 2C: COMPUTATIONAL MODEL, EXISTING MASSING, NORTH PERSPECTIVE

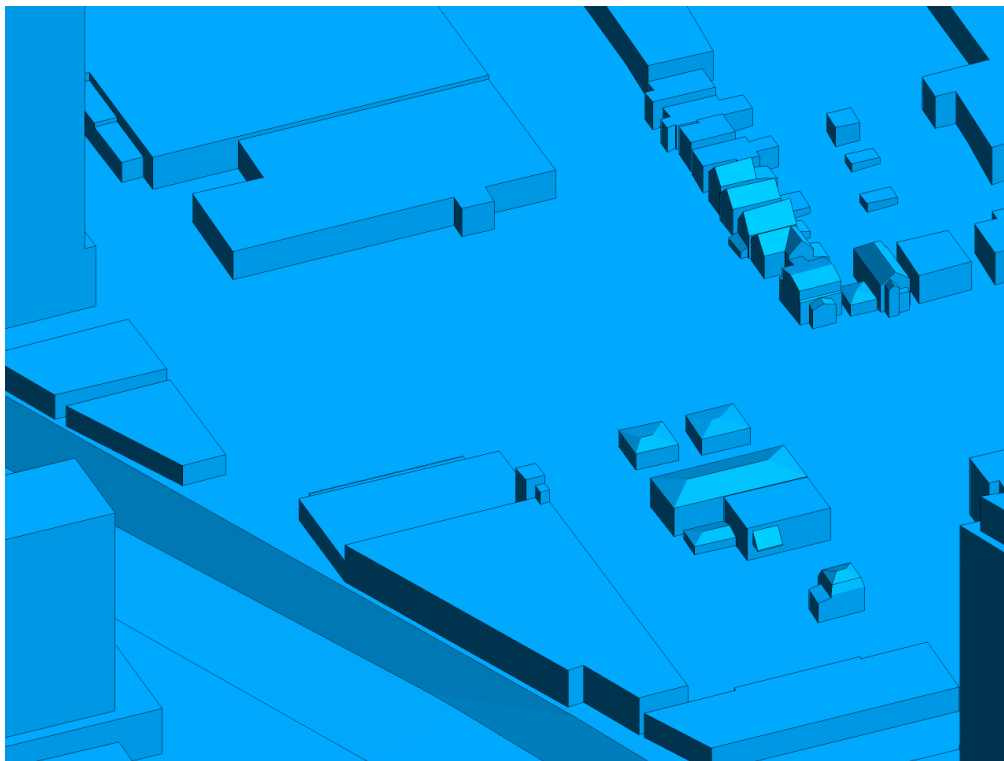


FIGURE 2D: CLOSE UP OF FIGURE 2C



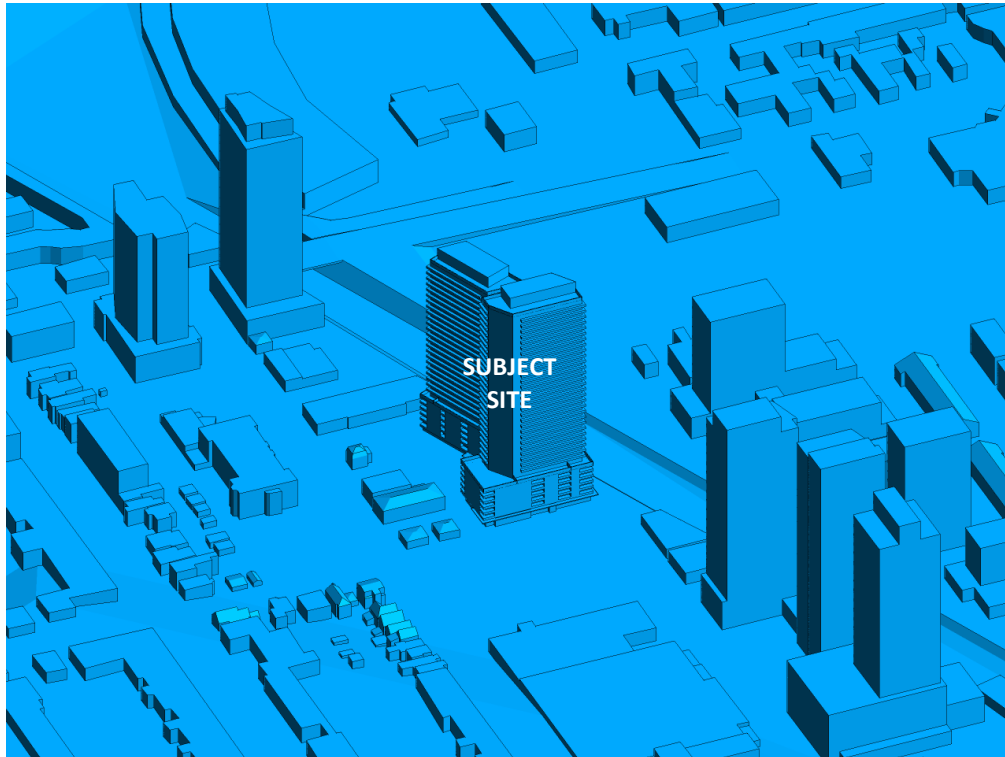


FIGURE 2E: COMPUTATIONAL MODEL, PROPOSED MASSING, SOUTH PERSPECTIVE

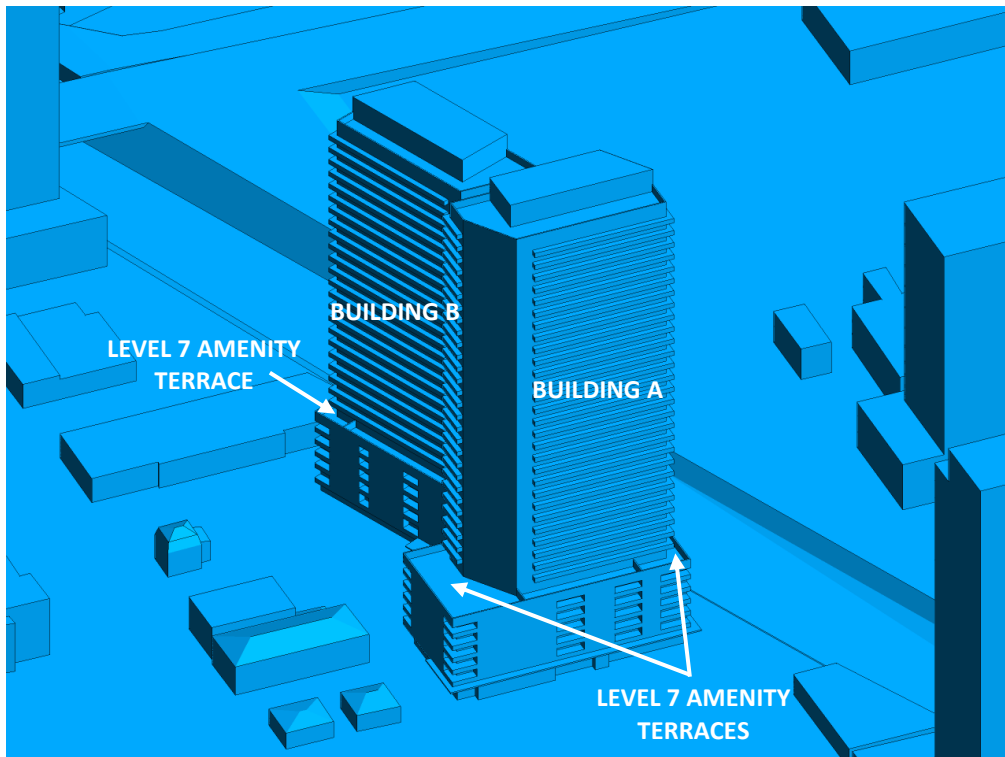


FIGURE 2F: CLOSE UP OF FIGURE 2E



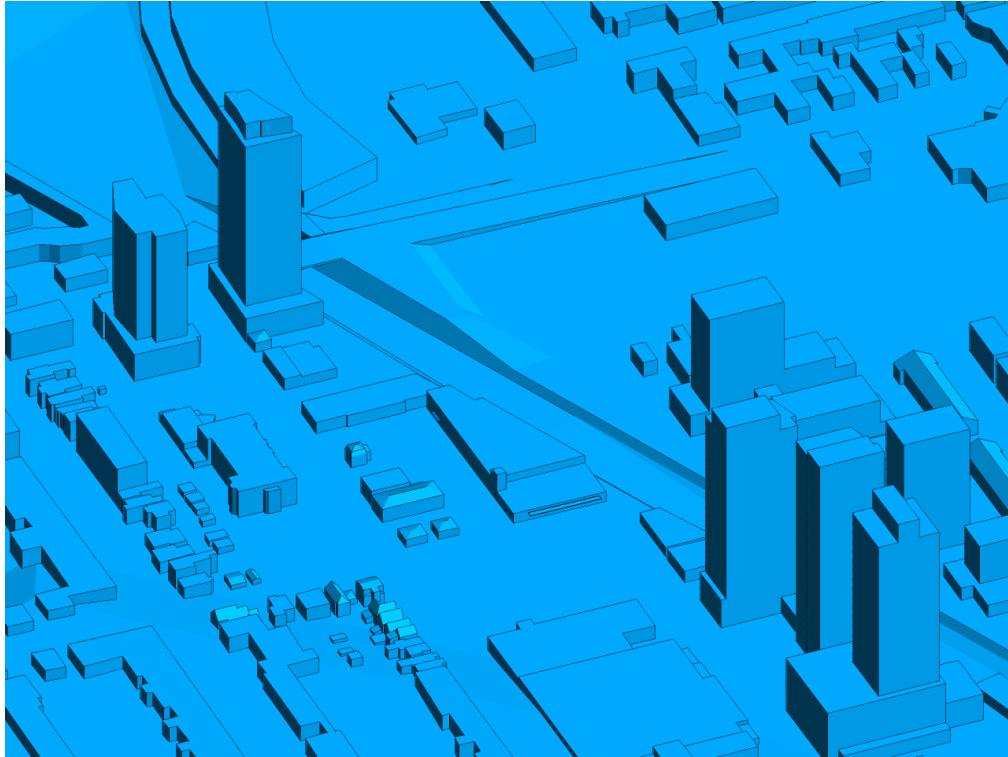


FIGURE 2G: COMPUTATIONAL MODEL, EXISTING MASSING, SOUTH PERSPECTIVE

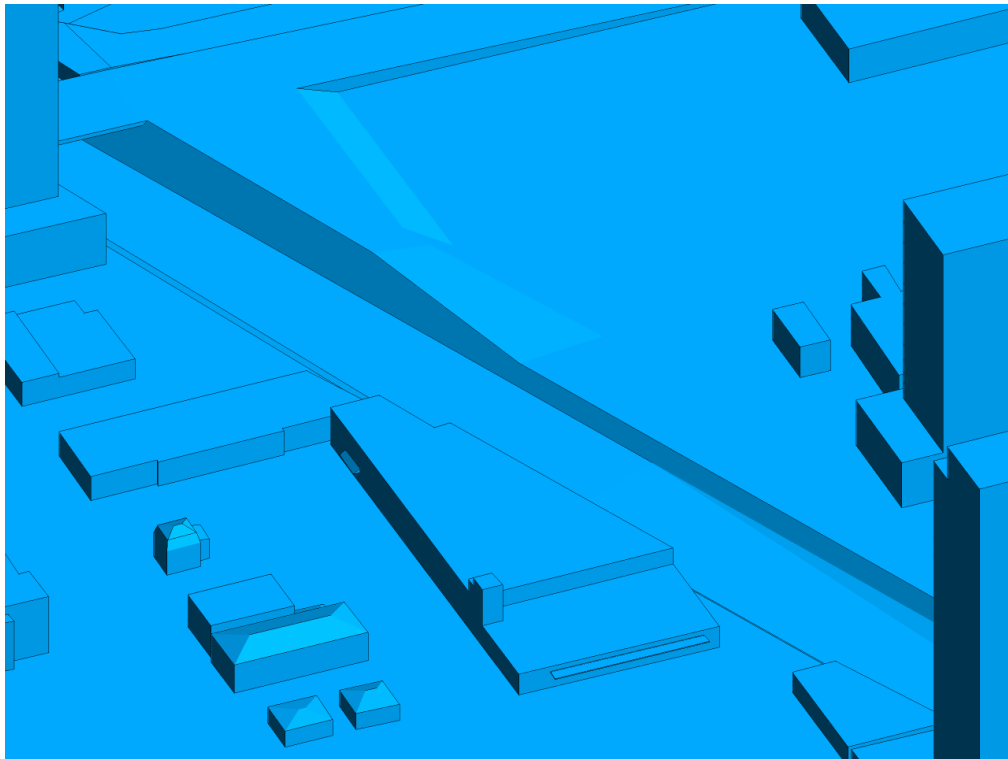


FIGURE 2H: CLOSE UP OF FIGURE 2G



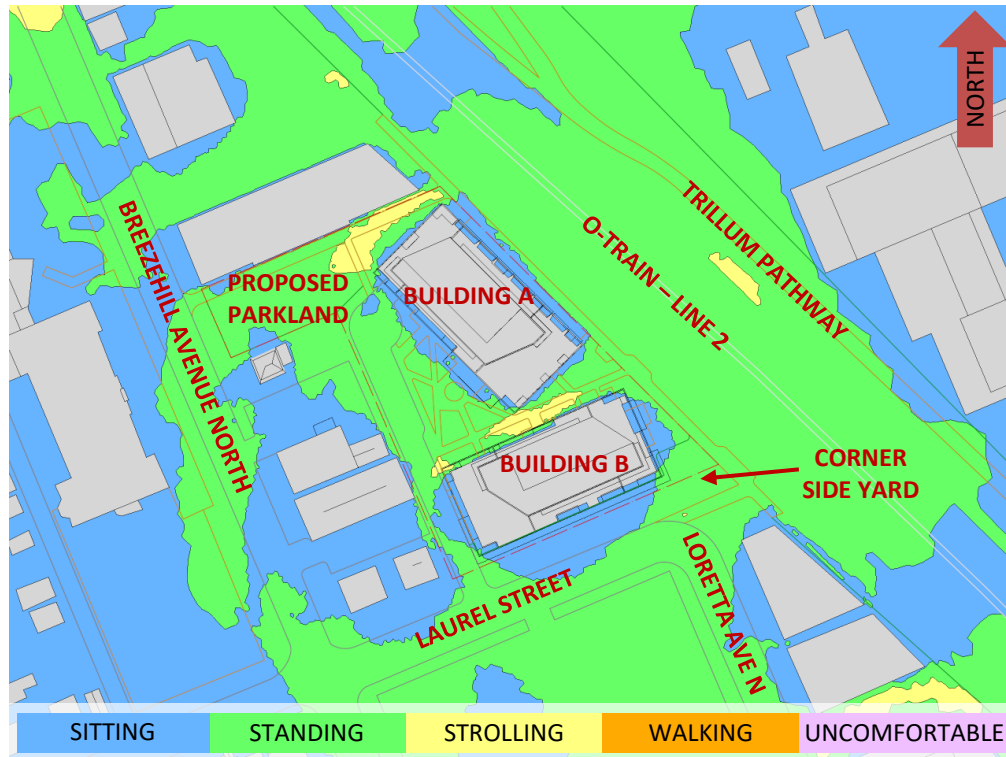


FIGURE 3A: SPRING – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

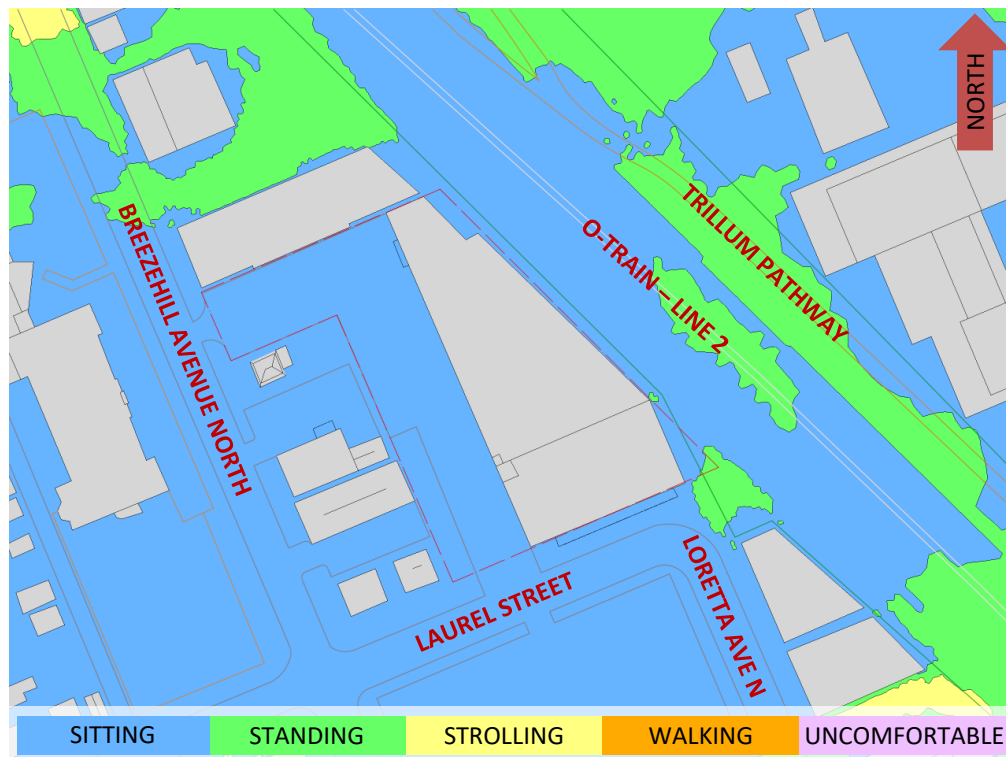


FIGURE 3B: SPRING – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



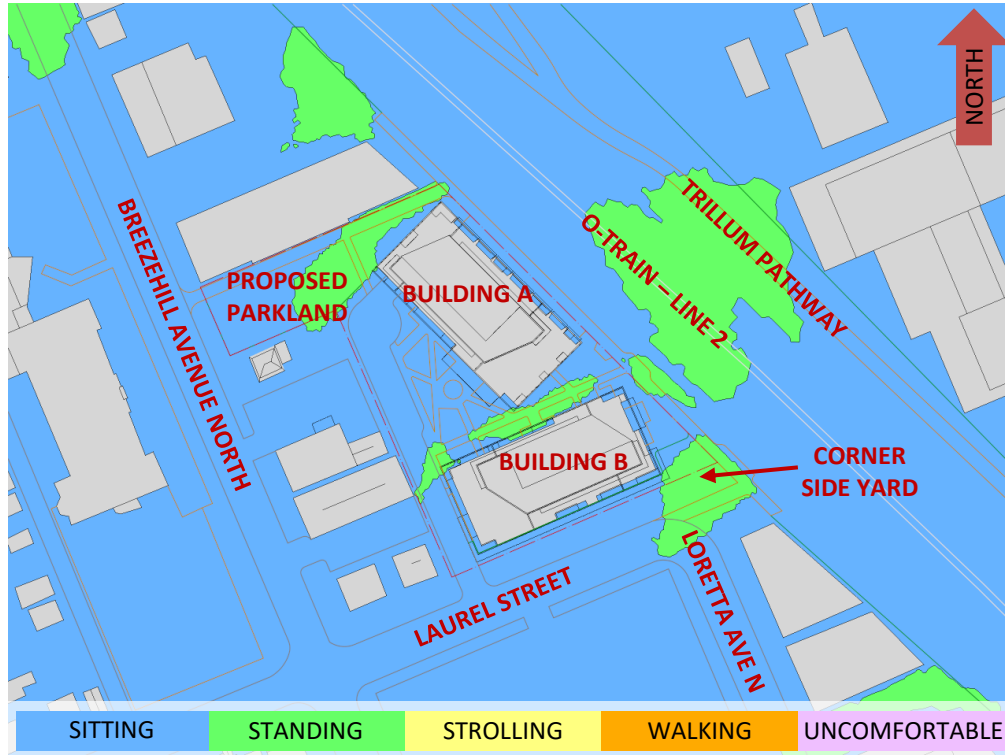


FIGURE 4A: SUMMER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

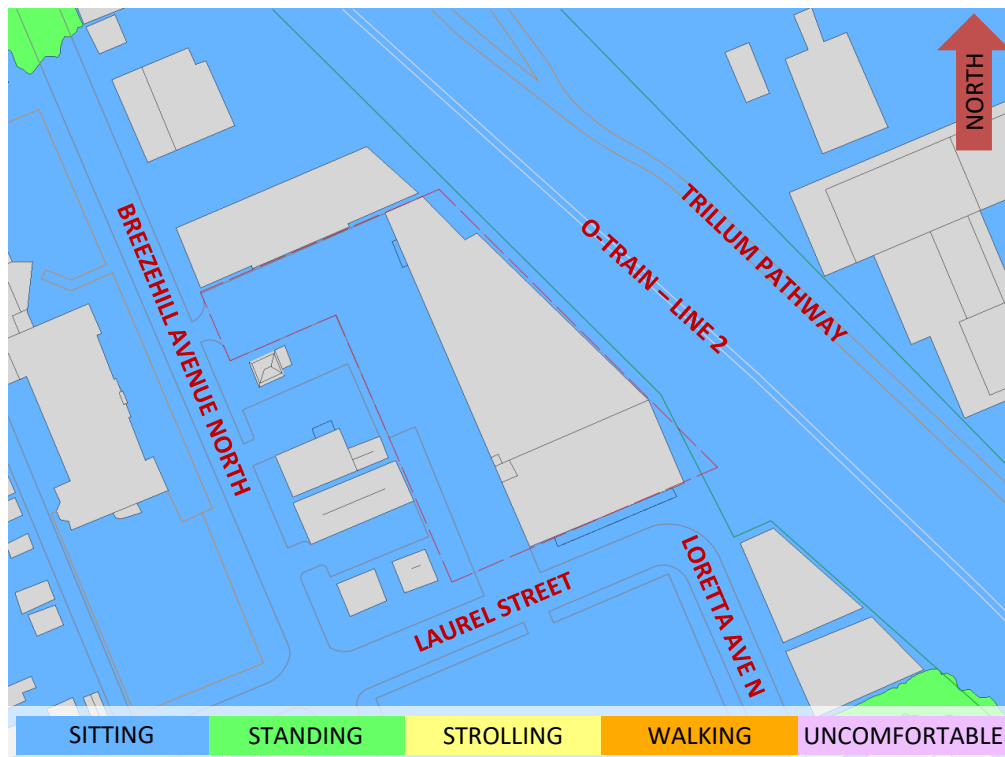


FIGURE 4B: SUMMER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



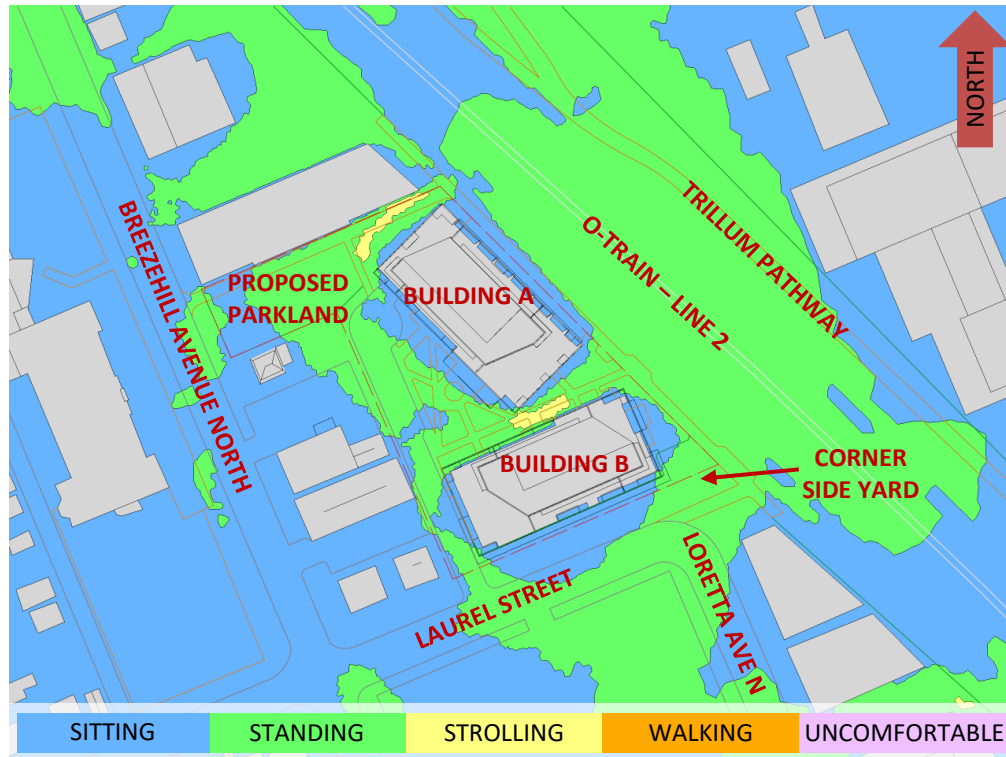


FIGURE 5A: AUTUMN – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

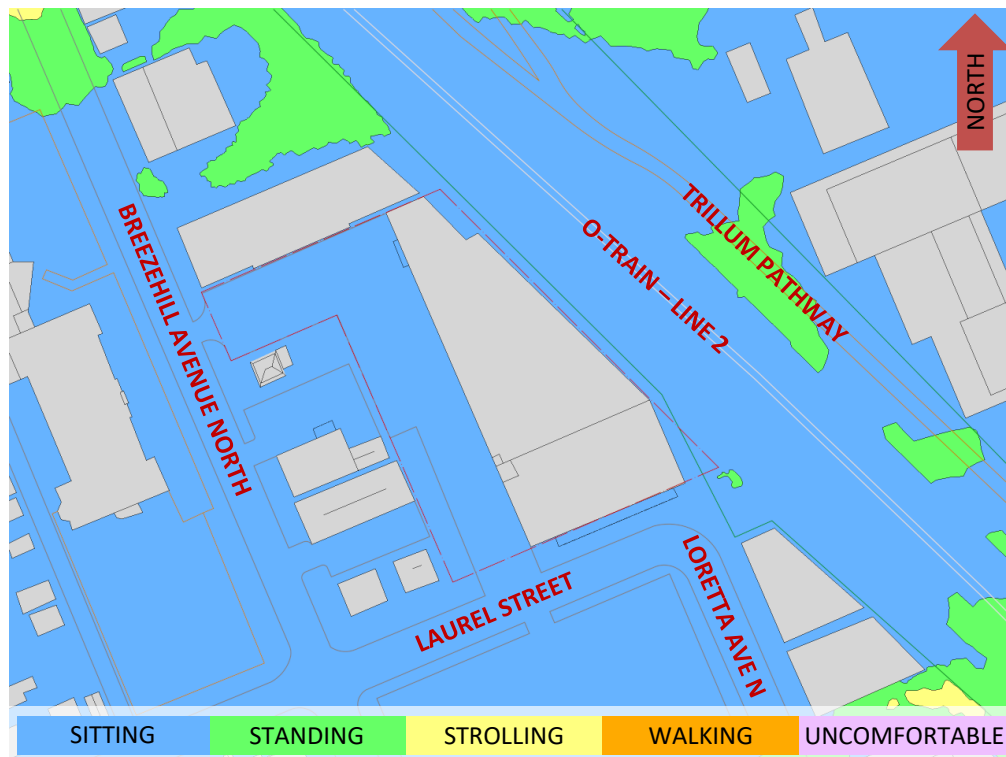


FIGURE 5B: AUTUMN – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



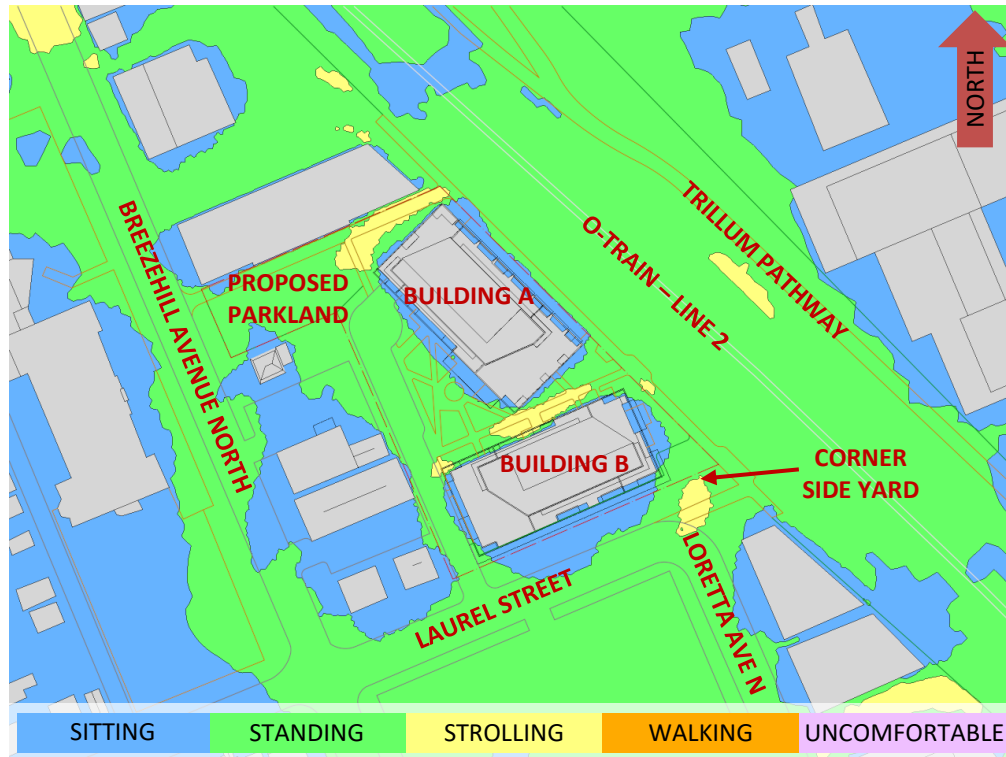


FIGURE 6A: WINTER – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING

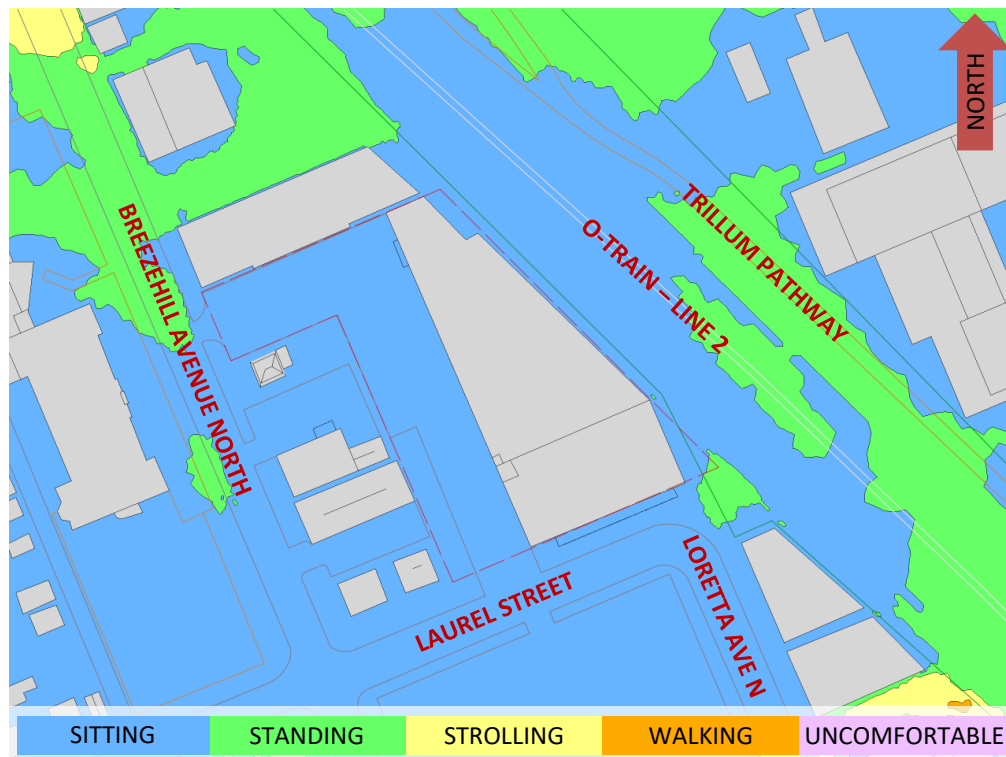


FIGURE 6B: WINTER – WIND COMFORT, GRADE LEVEL – EXISTING MASSING



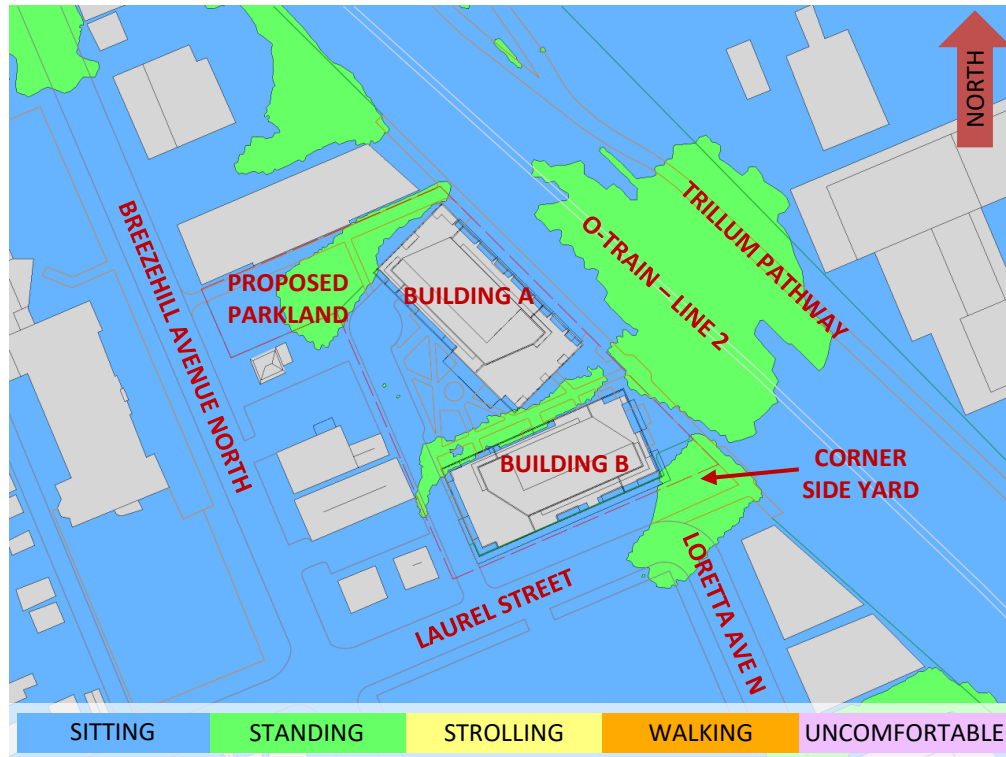


FIGURE 7: TYPICAL USE PERIOD – WIND COMFORT, GRADE LEVEL – PROPOSED MASSING



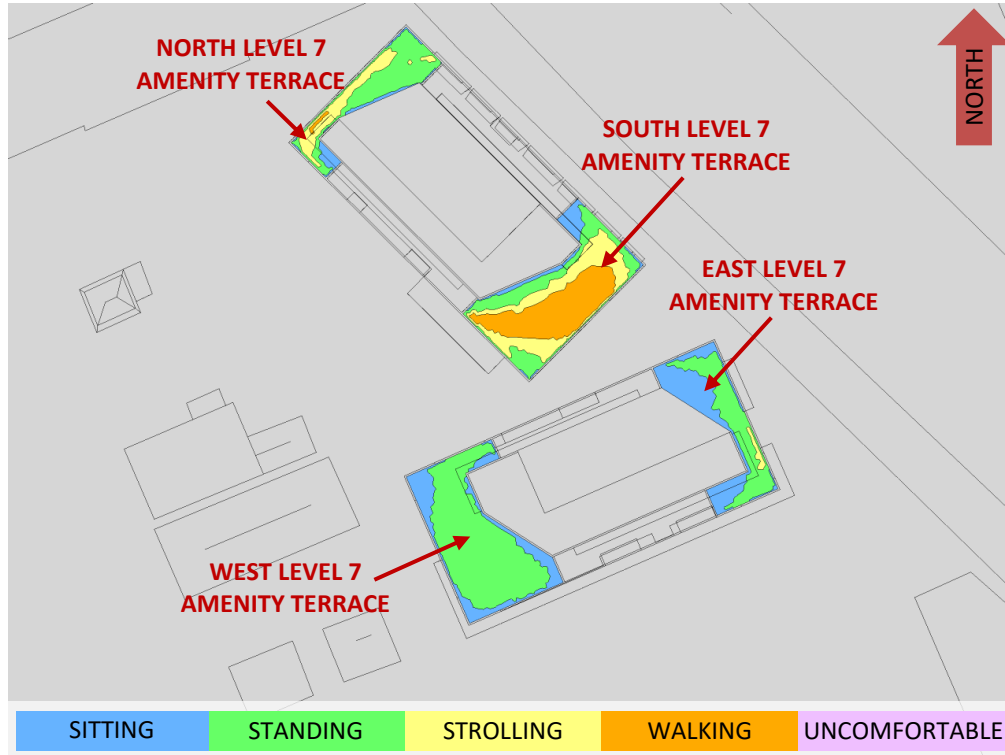


FIGURE 8A: SPRING – WIND COMFORT, COMMON AMENITY TERRACES

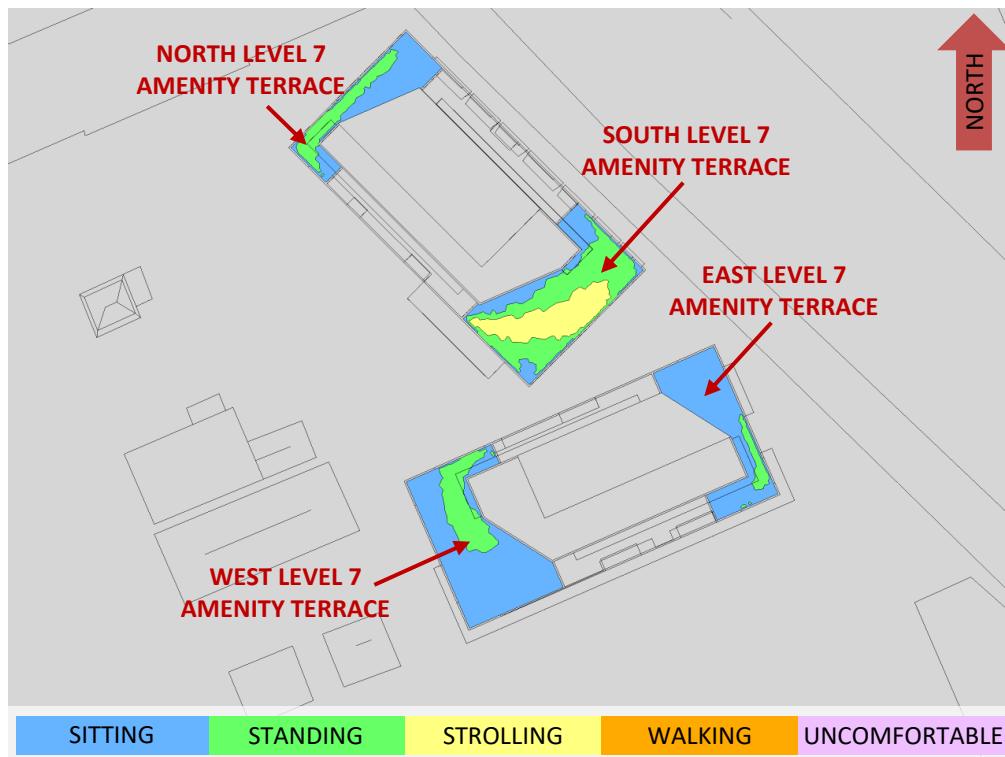


FIGURE 8B: SUMMER – WIND COMFORT, COMMON AMENITY TERRACES



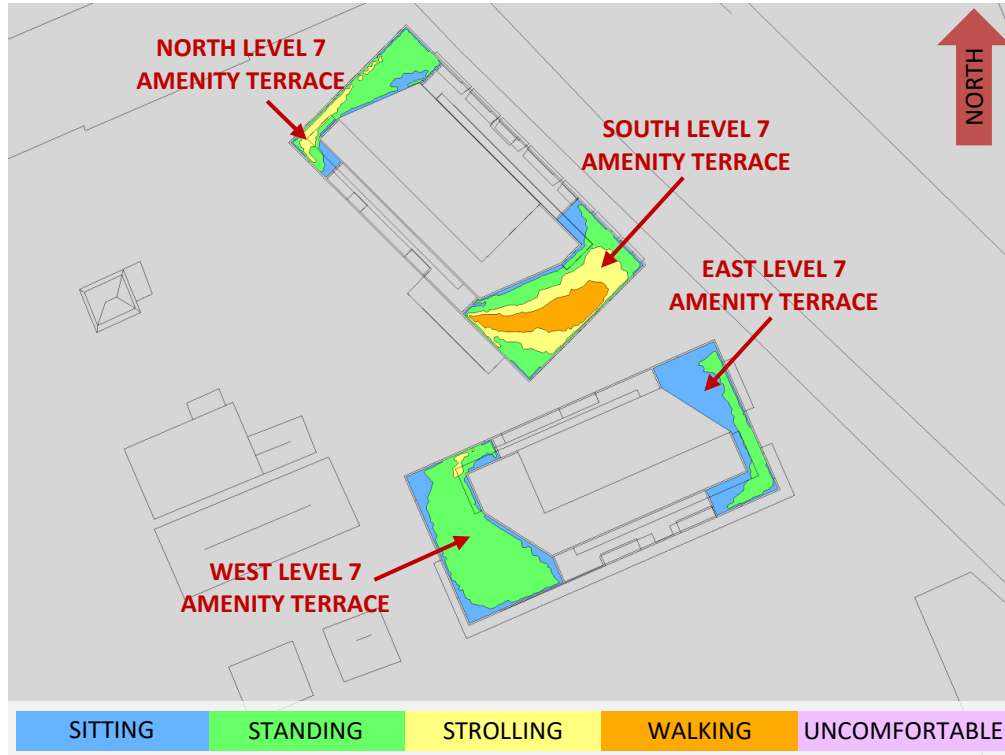


FIGURE 8C: AUTUMN – WIND COMFORT, COMMON AMENITY TERRACES



FIGURE 8D: WINTER – WIND COMFORT, COMMON AMENITY TERRACES



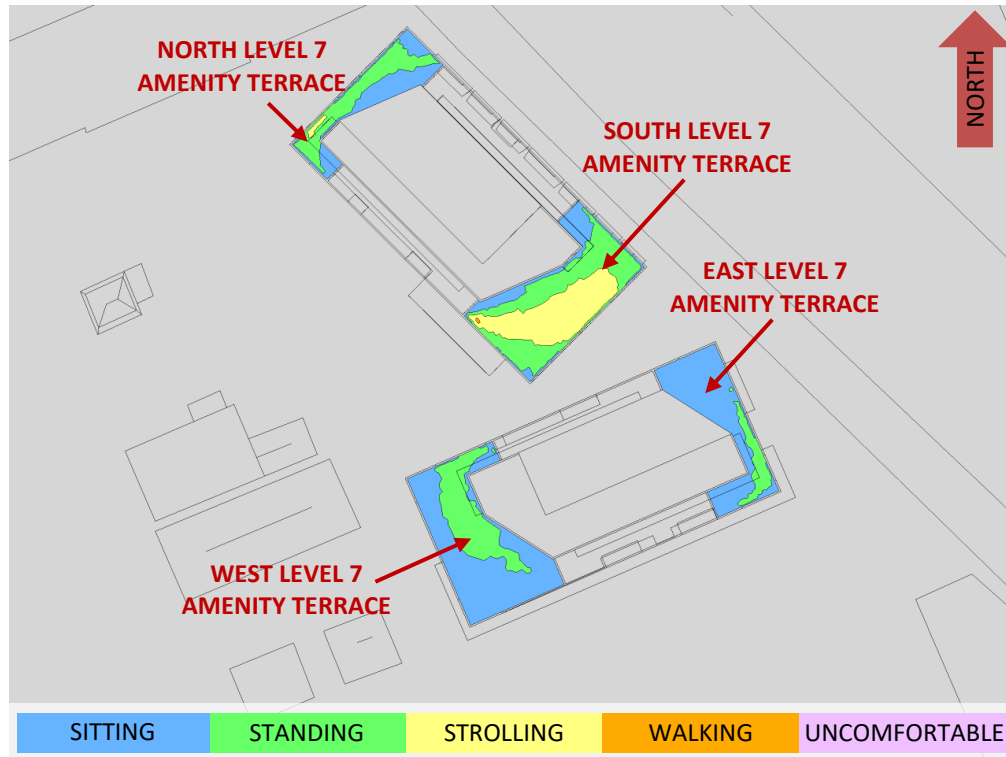


FIGURE 9: TYPICAL USE PERIOD – WIND COMFORT, COMMON AMENITY TERRACES



GRADIENTWIND

ENGINEERS & SCIENTISTS



APPENDIX A

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

SIMULATION OF THE ATMOSPHERIC BOUNDARY LAYER

The atmospheric boundary layer (ABL) is defined by the velocity and turbulence profiles according to industry standard practices. The mean wind profile can be represented, to a good approximation, by a power law relation, Equation (1), giving height above ground versus wind speed (1), (2).

$$U = U_g \left(\frac{Z}{Z_g} \right)^\alpha \quad \text{Equation (1)}$$

where, U = mean wind speed, U_g = gradient wind speed, Z = height above ground, Z_g = depth of the boundary layer (gradient height), and α is the power law exponent.

For the model, U_g is set to 6.5 metres per second, which approximately corresponds to the 60% mean wind speed for Ottawa based on historical climate data and statistical analyses. When the results are normalized by this velocity, they are relatively insensitive to the selection of gradient wind speed.

Z_g is set to 540 m. The selection of gradient height is relatively unimportant, so long as it exceeds the building heights surrounding the subject site. The value has been selected to correspond to our physical wind tunnel reference value.

α is determined based on the upstream exposure of the far-field surroundings (that is, the area that it not captured within the simulation model).

Table 1 presents the values of α used in this study, while Table 2 presents several reference values of α . When the upstream exposure of the far-field surroundings is a mixture of multiple types of terrain, the α values are a weighted average with terrain that is closer to the subject site given greater weight.

TABLE 1: UPSTREAM EXPOSURE (ALPHA VALUE) VS TRUE WIND DIRECTION

Wind Direction (Degrees True)	Alpha Value (α)
0	0.24
49	0.27
74	0.25
103	0.25
167	0.23
197	0.24
217	0.24
237	0.24
262	0.23
282	0.23
301	0.20
324	0.21

TABLE 2: DEFINITION OF UPSTREAM EXPOSURE (ALPHA VALUE)

Upstream Exposure Type	Alpha Value (α)
Open Water	0.14-0.15
Open Field	0.16-0.19
Light Suburban	0.21-0.24
Heavy Suburban	0.24-0.27
Light Urban	0.28-0.30
Heavy Urban	0.31-0.33

The turbulence model in the computational fluid dynamics (CFD) simulations is a two-equation shear-stress transport (SST) model, and thus the ABL turbulence profile requires that two parameters be defined at the inlet of the domain. The turbulence profile is defined following the recommendations of the Architectural Institute of Japan for flat terrain (3).

$$I(Z) = \begin{cases} 0.1 \left(\frac{Z}{Z_g} \right)^{-\alpha-0.05}, & Z > 10 \text{ m} \\ 0.1 \left(\frac{10}{Z_g} \right)^{-\alpha-0.05}, & Z \leq 10 \text{ m} \end{cases} \quad \text{Equation (2)}$$

$$L_t(Z) = \begin{cases} 100 \text{ m} \sqrt{\frac{Z}{30}}, & Z > 30 \text{ m} \\ 100 \text{ m}, & Z \leq 30 \text{ m} \end{cases} \quad \text{Equation (3)}$$

where, I = turbulence intensity, L_t = turbulence length scale, Z = height above ground, and α is the power law exponent used for the velocity profile in Equation (1).

Boundary conditions on all other domain boundaries are defined as follows: the ground is a no-slip surface; the side walls of the domain have a symmetry boundary condition; the top of the domain has a specified shear, which maintains a constant wind speed at gradient height; and the outlet has a static pressure boundary condition.

REFERENCES

- [1] P. Arya, "Chapter 10: Near-neutral Boundary Layers," in *Introduction to Micrometeorology*, San Diego, California, Academic Press, 2001.
- [2] S. A. Hsu, E. A. Meindl and D. B. Gilhousen, "Determining the Power-Law Wind Profile Exponent under Near-neutral Stability Conditions at Sea," vol. 33, no. 6, 1994.
- [3] Y. Tamura, H. Kawai, Y. Uematsu, K. Kondo and T. Okhuma, "Revision of AIJ Recommendations for Wind Loads on Buildings," in *The International Wind Engineering Symposium, IWES 2003*, Taiwan, 2003.