


**ROADWAY TRAFFIC NOISE
FEASIBILITY ASSESSMENT**

267 O'Connor Street
Ottawa, Ontario

Report: 20-166 –T.Noise Feasibility-2025

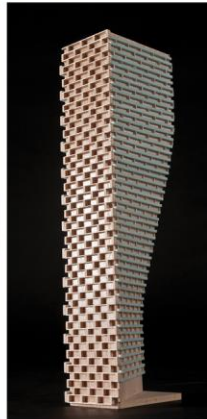

January 13th, 2025

PREPARED FOR

Taggart Realty Management
225 Metcalfe Street
Ottawa, ON K2P 1P9

PREPARED BY

Sergio Nunez Andres, B.Eng., Junior Environmental Scientist
Joshua Foster, P.Eng., Principal

EXECUTIVE SUMMARY

This report describes a roadway traffic noise feasibility study undertaken to satisfy Official Plan Amendment and Zoning By-Law Amendment (Phase 1) and subsequent Site Plan Control (Phase 2) application submission requirements for the proposed mixed-use residential development located at 267 O'Connor Street in Ottawa, Ontario (hereinafter referred to as "subject site" or "proposed development"). The Phase 1 Tower, of 27 storeys, is located at the northwest corner of the site, with the long axis oriented along MacLaren Street. Phase 2 Tower, of 25 storeys, is located at the southeast corner of the site, with the long axis oriented along Gilmour Street. The major sources of traffic noise are O'Connor Street to the west and Somerset Street West to the north. Figure 1 illustrates a complete site plan with surrounding context.

The assessment is based on (i) theoretical noise prediction methods that conform to the Ministry of the Environment, Conservation and Parks (MECP) and City of Ottawa requirements; (ii) noise level criteria as specified by the City of Ottawa's Environmental Noise Control Guidelines (ENCG); (iii) future vehicular traffic volumes based on the City of Ottawa's Official Plan roadway classifications; and (iv) architectural drawings prepared by provided by Hobin Architecture Inc. in December 2024.

The results of the current analysis indicate that noise levels will range between 56 and 69 dBA during the daytime period (07:00-23:00) and between 49 and 61 dBA during the nighttime period (23:00-07:00). The highest noise level (69 dBA) occurs at the west façade of Phase 1 Tower, which is nearest and most exposed to O'Connor Street. Building components with a higher Sound Transmission Class (STC) rating will be required where exterior noise levels exceed 65 dBA. Due to the limited information available at the time of the study, which was prepared for a zoning by-law amendment application submission, detailed STC calculations could not be performed at this time. A detailed review of window and wall assemblies should be performed by a qualified engineer with expertise in acoustics during the detailed design stage of the towers.

Results of the calculations also indicate that the development will require central air conditioning, which will allow occupants to keep windows closed and maintain a comfortable living environment. Warning Clauses will also be required to be placed on all Lease, Purchase and Sale Agreements.



Addendum: The roadway traffic noise assessment was completed based on architectural drawings that were prepared by Hobin Architecture Inc. in December 2024. Updated drawings were distributed to the consultant team in January 2025 with some minor changes to the proposed development. Most notably, some changes have been made to the distribution of the Rooftop Outdoor Amenities areas in both Phase 1 and Phase 2.

From an acoustics perspective, the drawings do not depict significant changes to the building design that would alter the noise impacts onto the development from nearby traffic noise sources. As such, the initial recommendations and conclusions of our traffic noise assessment remain unchanged

TABLE OF CONTENTS

1. INTRODUCTION	0
2. TERMS OF REFERENCE	0
3. OBJECTIVES	1
4. METHODOLOGY.....	1
4.1 Background.....	1
4.2 Roadway Traffic Noise.....	2
4.2.1 Criteria for Roadway Traffic Noise	2
4.2.2 Roadway Traffic Volumes.....	3
4.2.3 Theoretical Roadway Noise Predictions	3
5. RESULTS AND DISCUSSION.....	4
5.1 Roadway Traffic Noise Levels.....	4
6. CONCLUSIONS AND RECOMMENDATIONS	5
FIGURES	
APPENDICES	
Appendix A – STAMSON 5.04 Input and Output Data and Supporting Information	

1. INTRODUCTION

Gradient Wind Engineering Inc. (Gradient Wind) was retained by Taggart Realty Management to undertake a roadway traffic noise feasibility assessment to satisfy Official Plan Amendment and Zoning By-Law Amendment (Phase 1) and subsequent Site Plan Control (Phase 2) application submission requirements for a proposed two-tower development located at 267 O'Connor Street in Ottawa, Ontario. This report summarizes the methodology, results, and recommendations related to the assessment of exterior noise levels generated by local roadway traffic.

Our work is based on theoretical noise calculation methods conforming to the City of Ottawa¹ and Ministry of the Environment, Conservation and Parks (MECP)² guidelines. Noise calculations were based on architectural drawings prepared by Hobin Architecture Inc. in December 2024, with future traffic volumes corresponding to the City of Ottawa's Official Plan (OP) roadway classifications.

2. TERMS OF REFERENCE

The focus of this roadway traffic noise feasibility assessment is a proposed two-tower development located at 267 O'Connor Street in Ottawa, Ontario. The subject site is located on the west side of a parcel of land bounded by MacLaren Street to the north, Metcalfe Street to the east, Gilmour Street to the south, and O'Connor Street to the west.

The Phase 1 Tower, of 27 storeys, is located at the northwest corner of the site, with the long axis oriented along MacLaren Street. Phase 2 Tower, of 25 storeys, is located at the southeast corner of the site, with the long axis oriented along Gilmour Street. The major sources of traffic noise are O'Connor Street to the west and Somerset Street West to the north. Above four levels of shared underground parking, the ground floor of the Phase 1 Tower, the Podium and the Phase 2 Tower features retail and amenity space fronting O'Connor Street with building support facilities, including a leasing office, bike room and lobby, in the remaining areas. The ground floor of the South Tower contains a lobby, amenity space and building support facilities. A ramp which provides access to below-grade parking from Gilmour Street is located at

¹ City of Ottawa Environmental Noise Control Guidelines, January 2016

² Ontario Ministry of the Environment, Conservation and Parks – Environmental Noise Guidelines, Publication NPC-300, Queens Printer for Ontario, Toronto, 2013

the southeast corner of the South Tower. All levels above grade are reserved from residential occupancy. Levels 10 and above rise with a uniform planform.

As the balconies extend less than 4 metres from the façade, they do not require consideration as outdoor living areas (OLA) in this study. Furthermore, the grade-level P.O.P.S was not considered as an OLA, as it is not intended to provide a space for the quiet enjoyment of the outdoors for the residents.

The site is surrounded by a mixture of low and mid-rise buildings in all directions. The major sources of traffic noise are O'Connor Street to the west and Somerset Street West to the north. Although Metcalfe Street located east of the site is a nearby arterial roadway, it is located just beyond 100 metres of the study site and therefore is not included as sources influencing the study site as per ENCG Section 2.1. Figure 1 illustrates a complete site plan with surrounding context.

3. OBJECTIVES

The principal objectives of this study are to (i) calculate the future noise levels on the study buildings produced by local roadway traffic, and (ii) explore potential noise mitigation options, where required.

4. METHODOLOGY

4.1 Background

Noise can be defined as any obtrusive sound. It is created at a source, transmitted through a medium, such as air, and intercepted by a receiver. Noise may be characterized in terms of the power of the source or the sound pressure at a specific distance. While the power of a source is characteristic of that particular source, the sound pressure depends on the location of the receiver and the path that the noise takes to reach the receiver. Measurement of noise is based on the decibel unit, dBA, which is a logarithmic ratio referenced to a standard noise level (2×10^{-5} Pascals). The 'A' suffix refers to a weighting scale, which better represents how the noise is perceived by the human ear. With this scale, a doubling of power results in a 3 dBA increase in measured noise levels and is just perceptible to most people. An increase of 10 dBA is often perceived to be twice as loud.

4.2 Roadway Traffic Noise

4.2.1 Criteria for Roadway Traffic Noise

For surface roadway traffic noise, the equivalent sound energy level, L_{eq} , provides a measure of the time varying noise levels, which is well correlated with the annoyance of sound. It is defined as the continuous sound level, which has the same energy as a time varying noise level over a period of time. For roadways, the L_{eq} is commonly calculated on the basis of a 16-hour (L_{eq16}) daytime (07:00-23:00) / 8-hour (L_{eq8}) nighttime (23:00-07:00) split to assess its impact on residential buildings. The City of Ottawa's Environmental Noise Control Guidelines (ENCG) specifies that the recommended indoor noise limit range (that is relevant to this study) is 50, 45 and 40 dBA for retail space, living rooms and sleeping quarters, respectively, as listed in Table 1.

TABLE 1: INDOOR SOUND LEVEL CRITERIA (ROAD)³

Type of Space	Time Period	L_{eq} (dBA)
General offices, reception areas, retail stores , etc.	07:00 – 23:00	50
Living/dining/den areas of residences , hospitals, schools, nursing/retirement homes, day-care centres, theatres, places of worship, libraries, individual or semi-private offices, conference rooms, etc.	07:00 – 23:00	45
Sleeping quarters of hotels/motels	23:00 – 07:00	45
Sleeping quarters of residences , hospitals, nursing/retirement homes, etc.	23:00 – 07:00	40

Predicted noise levels at the plane of window (POW) dictate the action required to achieve the recommended sound levels. An open window is considered to provide a 10 dBA reduction in noise, while a standard closed window is capable of providing a minimum 20 dBA noise reduction⁴. A closed window due to a ventilation requirement will bring noise levels down to achieve an acceptable indoor environment⁵. Therefore, where noise levels exceed 55 dBA daytime and 50 dBA nighttime, the ventilation for the building should consider the need for having windows and doors closed, which triggers the need for forced air heating with provision for central air conditioning. Where noise levels exceed 65 dBA

³ Adapted from ENCG 2016 – Tables 2.2b and 2.2c

⁴ Burberry, P.B. (2014). Mitchell's Environment and Services. Routledge, Page 125

⁵ MECP, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.8



daytime and 60 dBA nighttime, air conditioning will be required and building components will require higher levels of sound attenuation⁶.

The sound level criterion for outdoor living areas is 55 dBA, which applies during the daytime (07:00 to 23:00). When noise levels exceed 55 dBA, mitigation must be provided to reduce noise levels where technically and administratively feasible to acceptable levels at or below the criterion.

4.2.2 Roadway Traffic Volumes

The ENCG dictates that noise calculations should consider future sound levels based on a roadway's classification at the mature state of development. Therefore, traffic volumes are based on the roadway classifications outlined in the City of Ottawa's Official Plan (OP) and Transportation Master Plan⁷ which provide additional details on future roadway expansions. Average Annual Daily Traffic (AADT) volumes are then based on data in Table B1 of the ENCG for each roadway classification. Table 2 (below) summarizes the AADT values used for each roadway included in this assessment.

TABLE 2: ROADWAY TRAFFIC DATA

Segment	Roadway Traffic Data	Speed Limit (km/h)	Traffic Volumes
O'Connor Street	2-Lane Urban Arterial (2-UAU)	50	15,000
Somerset Street West	2-Lane Urban Arterial (2-UAU)	50	15,000

4.2.3 Theoretical Roadway Noise Predictions

Noise predictions were performed with the aid of the MECP computerized noise assessment program, STAMSON 5.04, for road analysis. Appendix A includes the STAMSON 5.04 input and output data.

Roadway traffic noise calculations were performed by treating each roadway segment as separate line sources of noise. In addition to the traffic volumes summarized in Table 2, theoretical noise predictions were based on the following parameters:

- Truck traffic on all roadways was taken to comprise 5% heavy trucks and 7% medium trucks, as per ENCG requirements for noise level predictions.

⁶ MECP, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.1.3

⁷ City of Ottawa Transportation Master Plan, November 2013



- The day/night split for all streets was taken to be 92%/8%, respectively.
- Ground surfaces were taken to be reflective due to the presence of hard (paved) ground.
- Topography was assumed to be a flat/gentle slope surrounding the study building.
- For select sources where appropriate, the receptors considered the proposed North Tower and surrounding, existing buildings as barrier, partially or fully obstructing exposure to the source as illustrated by exposure angles in Figures 3-4.
- Noise receptors were strategically placed at ten (10) locations around the study area (see Figure 2).

5. RESULTS AND DISCUSSION

5.1 Roadway Traffic Noise Levels

The results of the roadway traffic noise calculations are summarized in Table 3 below. A complete set of input and output data from all STAMSON 5.04 calculations are available in Appendix A.

TABLE 3: EXTERIOR NOISE LEVELS DUE TO ROAD TRAFFIC

Receptor Number	Receptor Height Above Grade (m)	Receptor Location	Exterior Noise Level (dBA)	
			Day	Night
1	86	POW – Phase 1 Façade	62	54
2	86	POW – Phase 1 North Façade	63	55
3	86	POW – Phase 1 West Façade	69	61
4	91.5	POW – Middle West Façade	56	49
5	86	POW – Phase 2 North Façade	58	50
6	86	POW – Phase 2 West Façade	67	60
7	86	POW – Phase 2 South Façade	61	54
8	89.5	OLA – Phase 1 Roof Top	59	N/A*

*Noise levels during the nighttime are not considered for OLAs

TABLE 3 (CONTINUATION): EXTERIOR NOISE LEVELS DUE TO ROAD TRAFFIC

Receptor Number	Receptor Height	Receptor Location	Exterior Noise Level (dBA)
-----------------	-----------------	-------------------	----------------------------



	Above Grade (m)		Day	Night
9	5.5	OLA – Podium Roof Top	55	N/A*
10	80.5	OLA – Phase 2 Roof Top	46	N/A*

*Noise levels during the nighttime are not considered for OLAs

The results of the current analysis indicate that noise levels will range between 56 and 69 dBA during the daytime period (07:00-23:00) and between 49 and 61 dBA during the nighttime period (23:00-07:00). The highest noise level (69 dBA) occurs at the west façade of the Phase 1 Tower, which is nearest and most exposed to O'Connor Street.

The noise levels predicted due to roadway traffic exceed the criteria listed in Section 4.2 for building components. Upgraded building components, including STC rated glazing elements and exterior walls, will be required where noise levels due to roadway traffic exceed 65 dBA, as discussed in Section 4.2.1. Results of the calculations also indicated that both towers will require air conditioning, which will allow occupants to keep windows closed and maintain a comfortable living environment. In addition to ventilation requirements, Warning Clauses will also be required to be placed on all Lease, Purchase and Sale Agreements. Specific noise control measures can be developed once the design of the towers has progressed sufficiently, typically at the time of site plan approval.

6. CONCLUSIONS AND RECOMMENDATIONS

The results of the current analysis indicate that noise levels will range between 56 and 69 dBA during the daytime period (07:00-23:00) and between 49 and 61 dBA during the nighttime period (23:00-07:00). The highest noise level (69 dBA) occurs at the west façade of Phase 1 Tower, which is nearest and most exposed to O'Connor Street.

Noise levels for Outdoor Living Area (OLA) receptors will range between 46 and 59. A Type A warning clause will be required on all Lease, Purchase, and Sale Agreements:

Type A

"Purchasers/tenants are advised that sound levels due to increasing road traffic may occasionally interfere with some activities of the dwelling occupants as the sound levels exceed the sound level limits of the Municipality and the Ministry of the Environment."

Results of the calculations also indicate that the development will require central air conditioning, which will allow occupants to keep windows closed and maintain a comfortable living environment. The following Type D Warning Clause will be required to be placed on all Lease, Purchase, and Sale Agreements, as summarized below:

Type D:

"This dwelling unit has been supplied with a central air conditioning system which will allow windows and exterior doors to remain closed, thereby ensuring that the indoor sound levels are within the sound level limits of the Municipality and the Ministry of the Environment."

Building components with a higher Sound Transmission Class (STC) rating will be required where exterior noise levels exceed 65 dBA. Due to the limited information available at the time of the study, which was prepared for a zoning by-law amendment application submission, detailed STC calculations could not be performed at this time. A detailed review of window and wall assemblies should be performed by a qualified engineer with expertise in acoustics during the detailed design stage of the towers.

This concludes our roadway traffic noise feasibility assessment and report. If you have any questions or wish to discuss our findings, please advise us. In the interim, we thank you for the opportunity to be of service.



Sincerely,

Gradient Wind Engineering Inc.

Sergio Nunez Andres


Sergio Nunez Andres, B.Eng.
Junior Environmental Scientist

Gradient Wind File 20-166-T.Noise Feasibility





Joshua Foster, P.Eng.
Lead Engineer



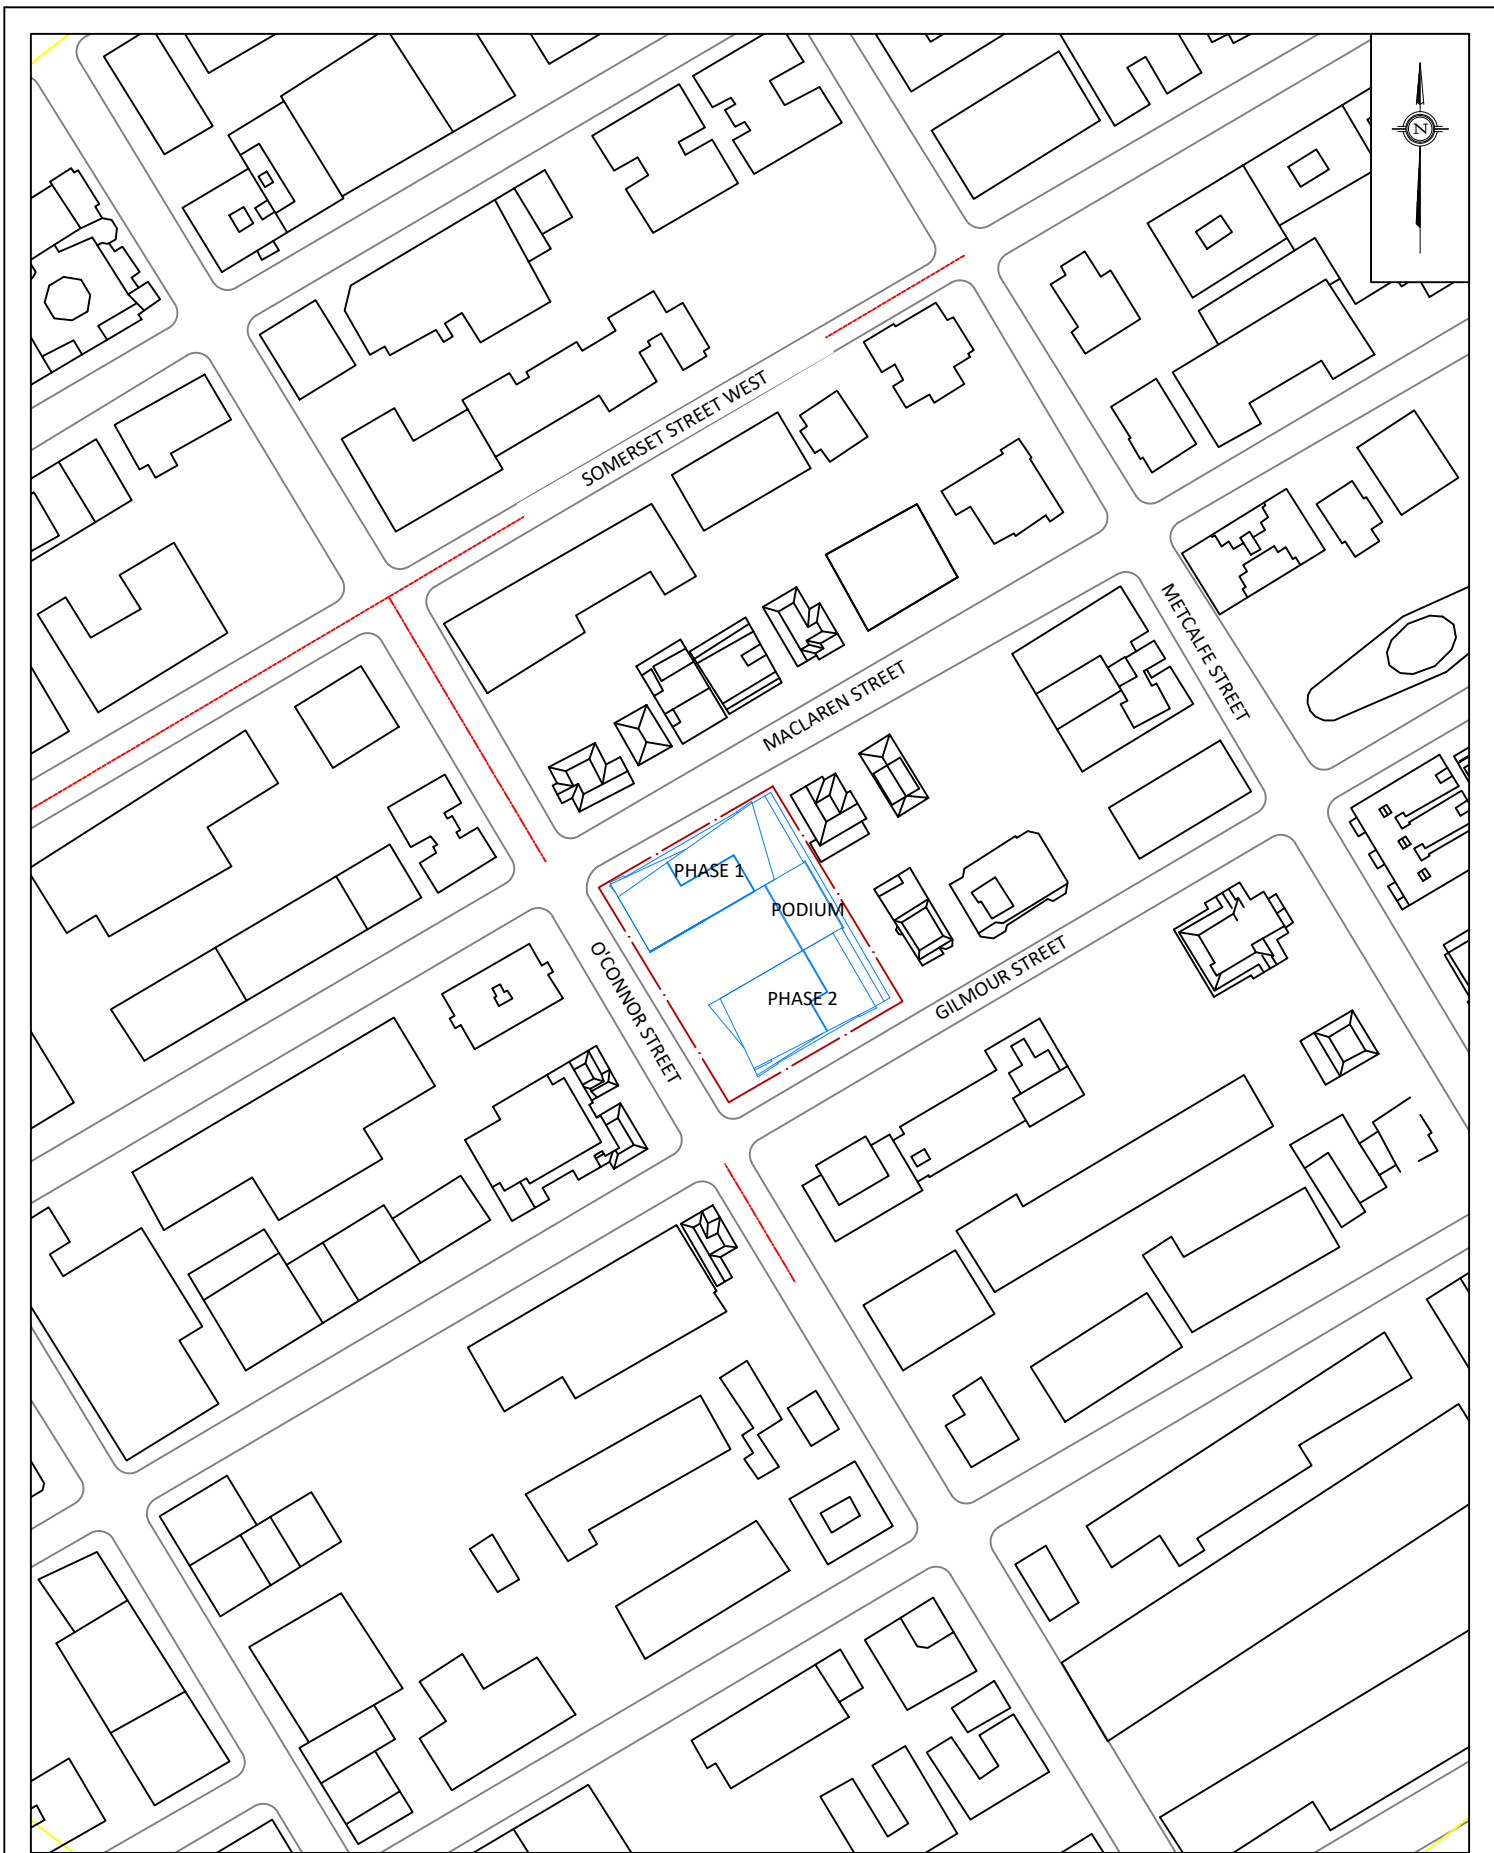


GRADIENTWIND ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT 267 O'CONNOR STREET, OTTAWA ROADWAY TRAFFIC NOISE FEASIBILITY ASSESSMENT		DESCRIPTION FIGURE 1: SITE PLAN AND SURROUNDING CONTEXT
	SCALE 1:2000 (APPROX.)	DRAWING NO. 20-166-1	
	DATE JANUARY 2, 2024	DRAWN BY T.K.	

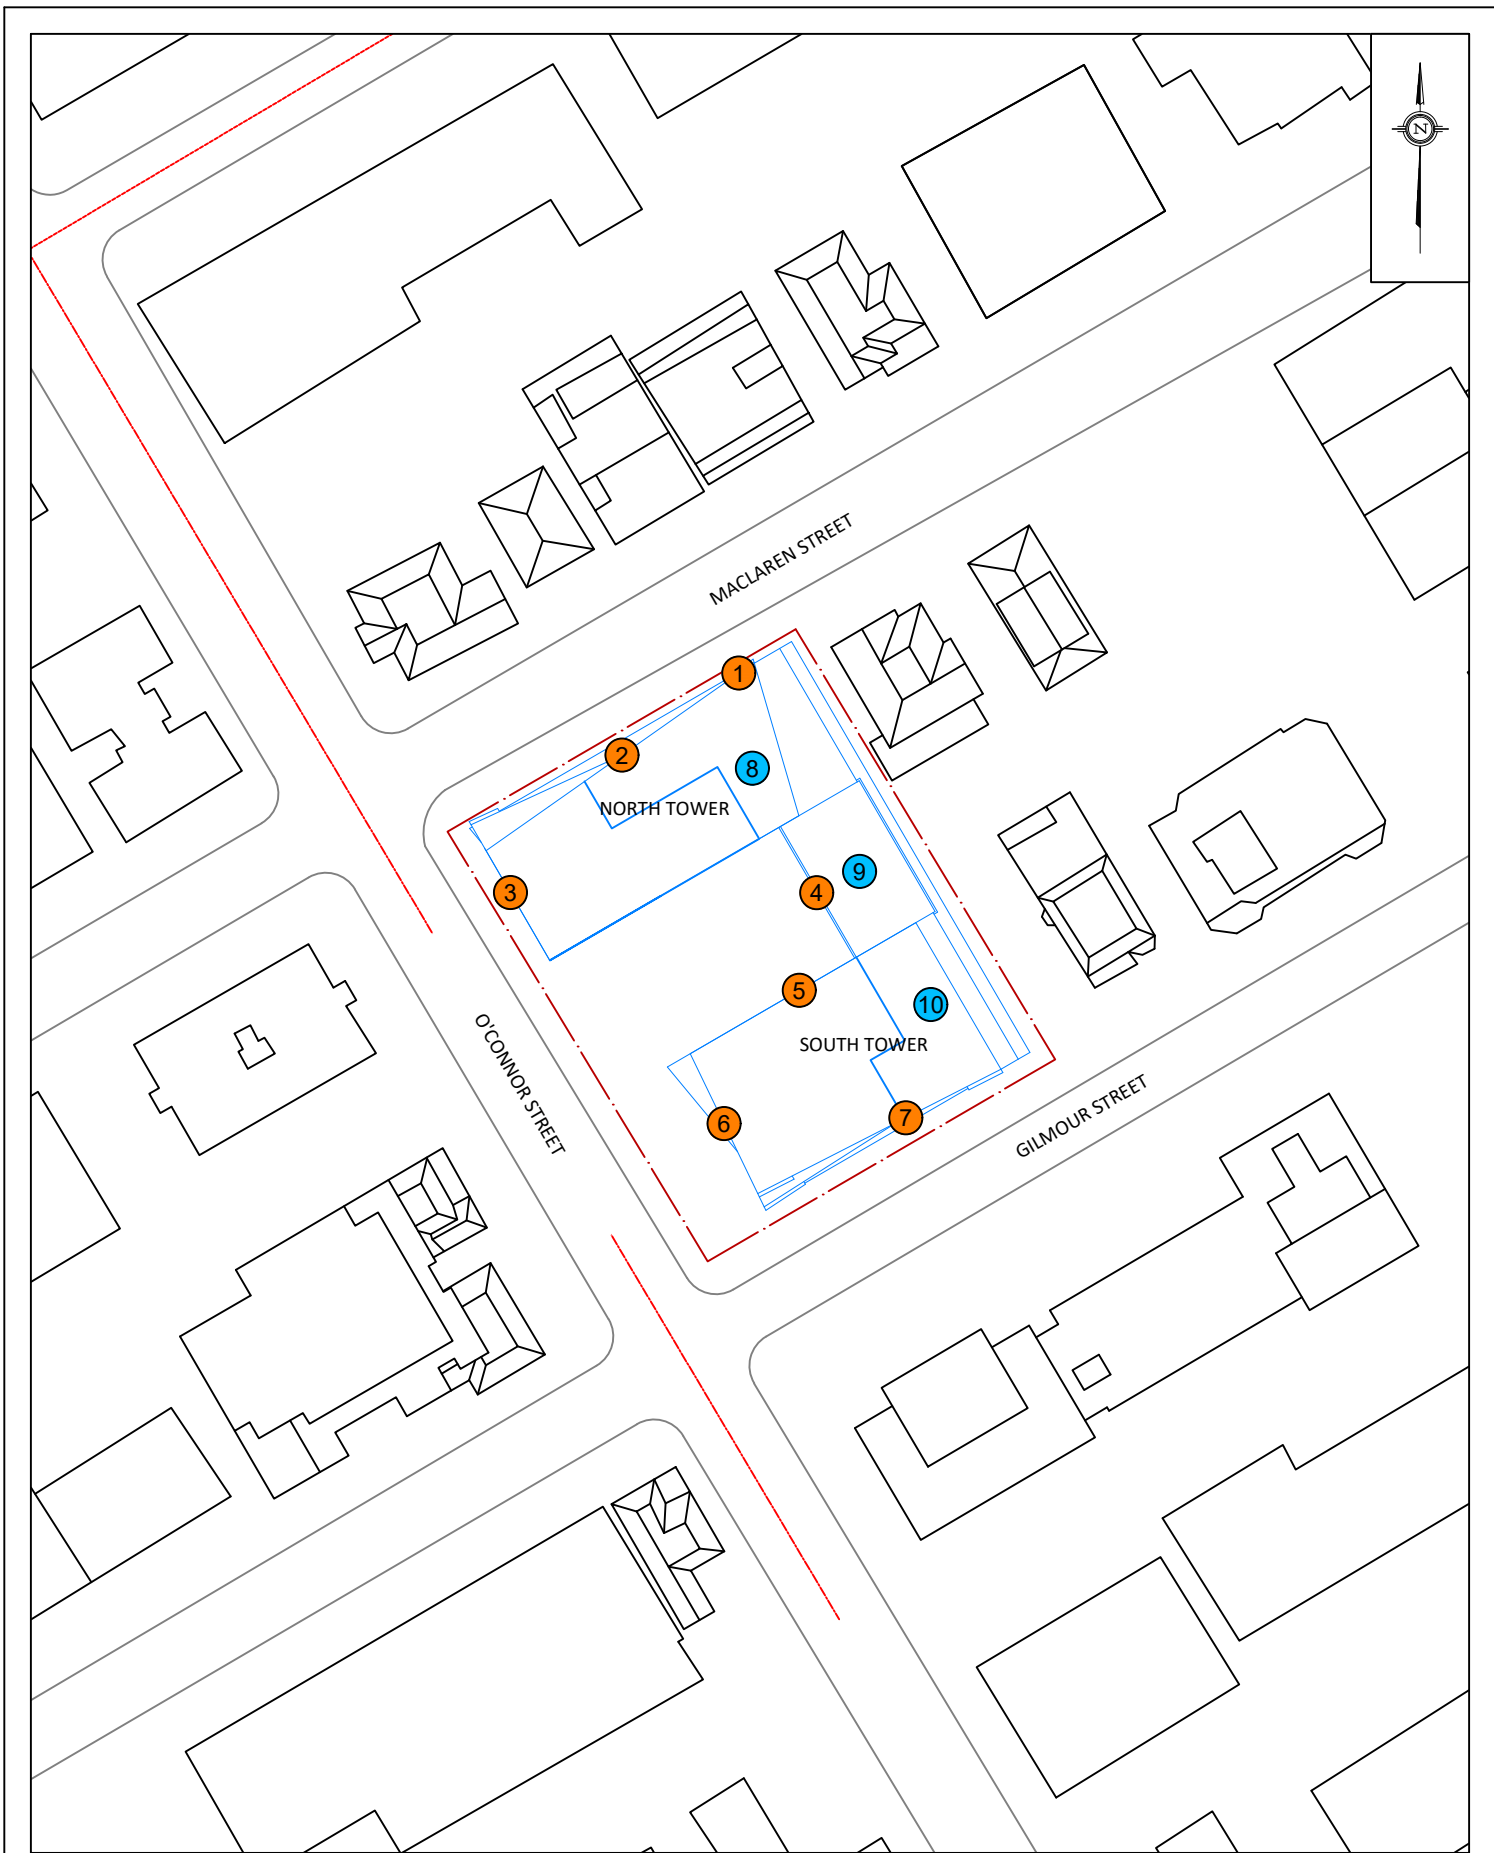

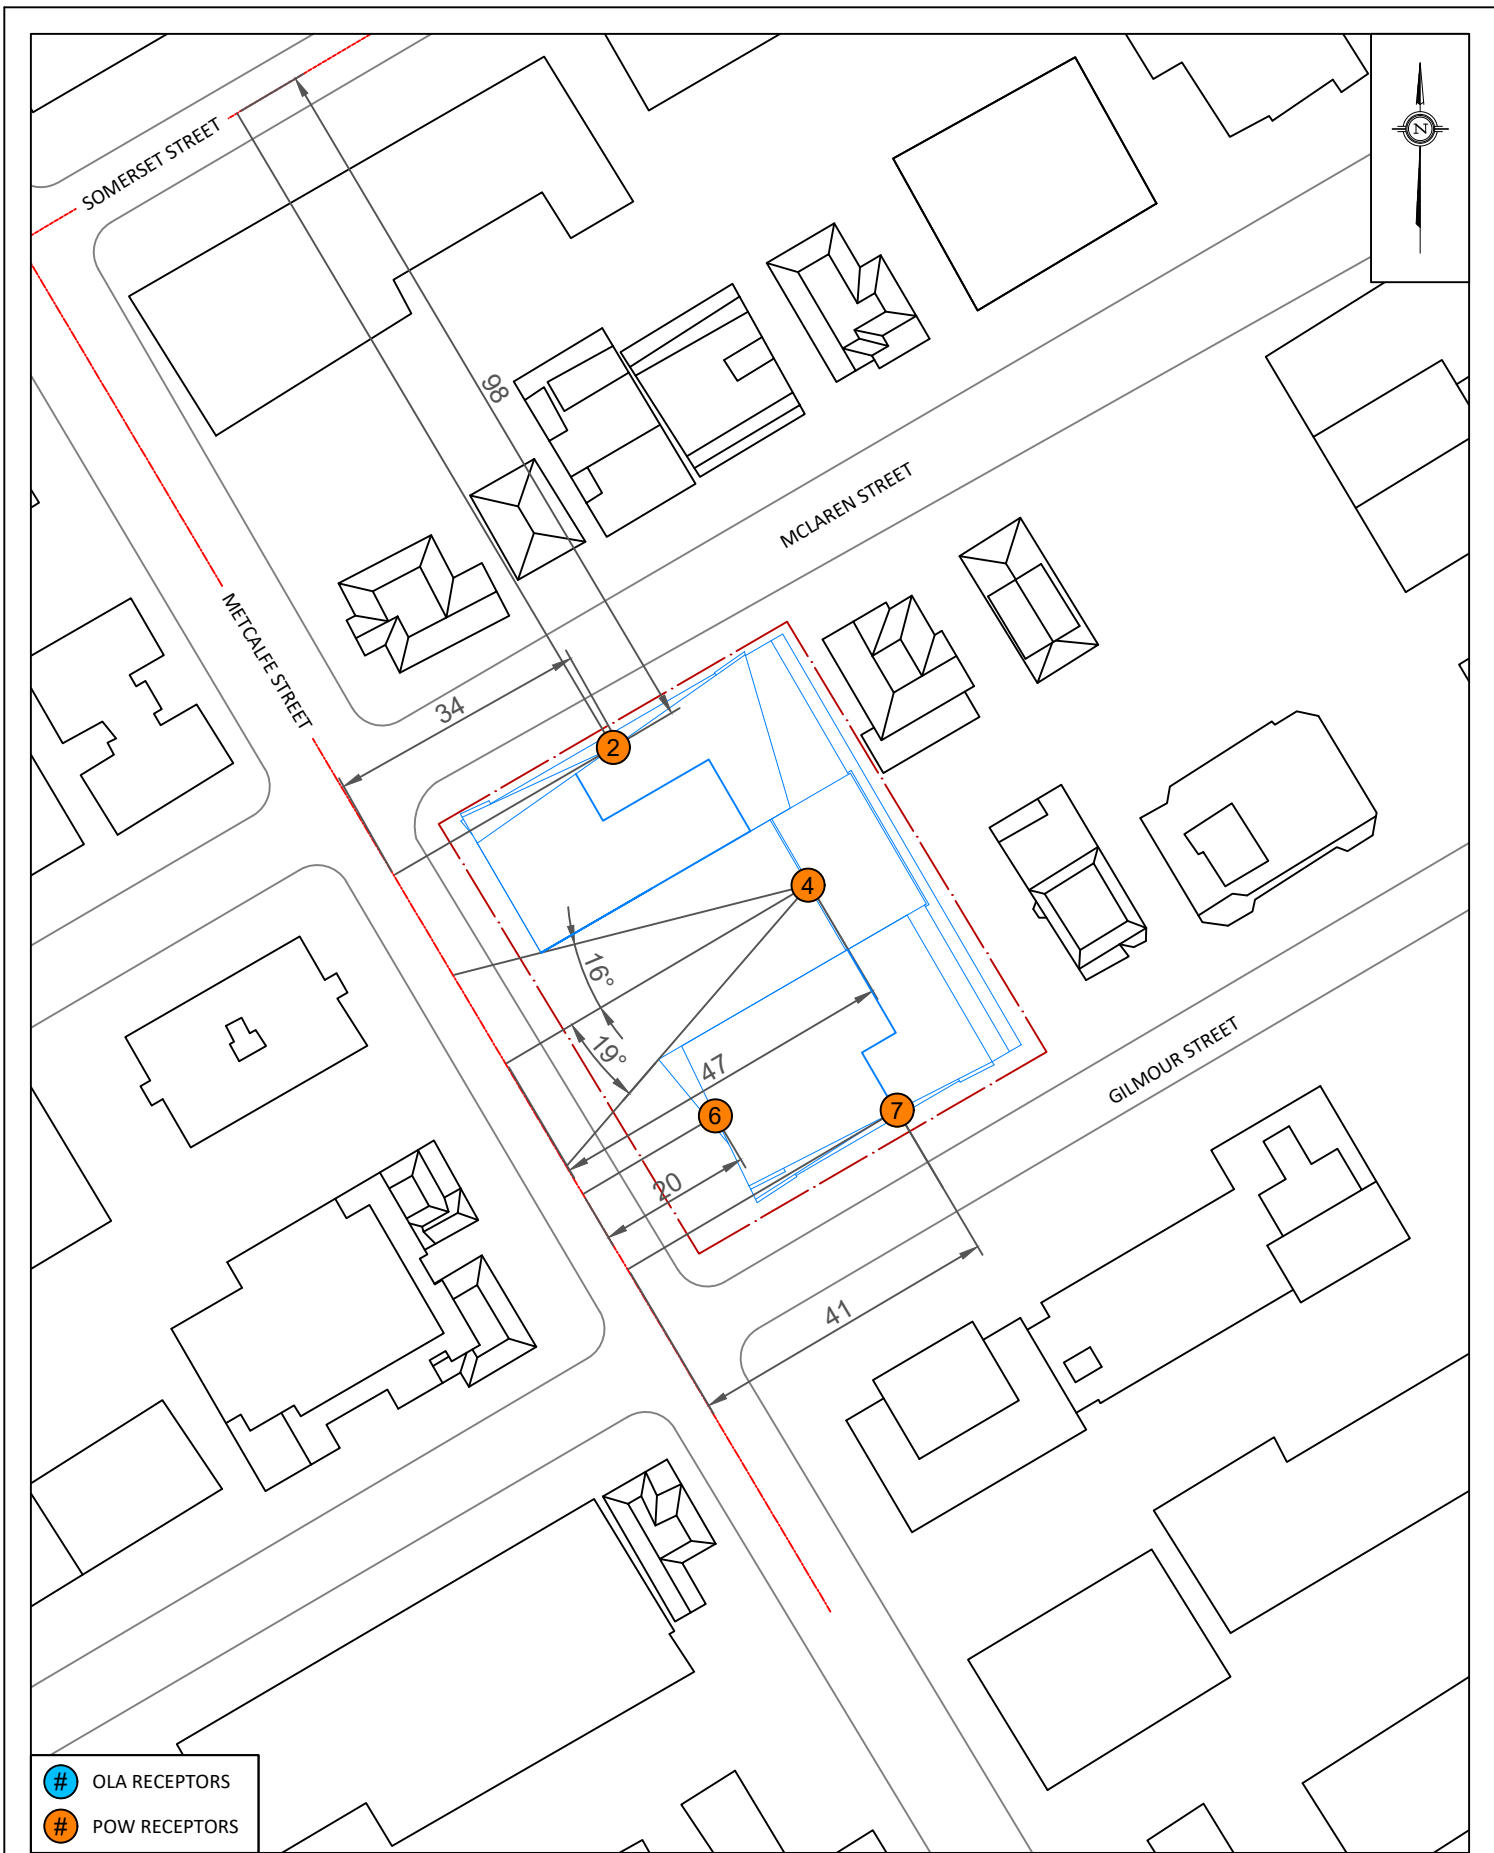


- # OLA RECEPTORS
- # POW RECEPTORS

<div>GRADIENTWIND</div> <div>ENGINEERS & SCIENTISTS</div> <div>127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM</div>	PROJECT		267 O'CONNOR STREET, OTTAWA		DESCRIPTION	
			ROADWAY TRAFFIC NOISE FEASIBILITY ASSESSMENT			
	SCALE	1:1000	DRAWING NO.	20-166-3		
	DATE	JANUARY 2, 2024	DRAWN BY	T.K.		
FIGURE 3: STAMSON INPUT PARAMETERS RECEPTORS 2, 4, 6 & 7						

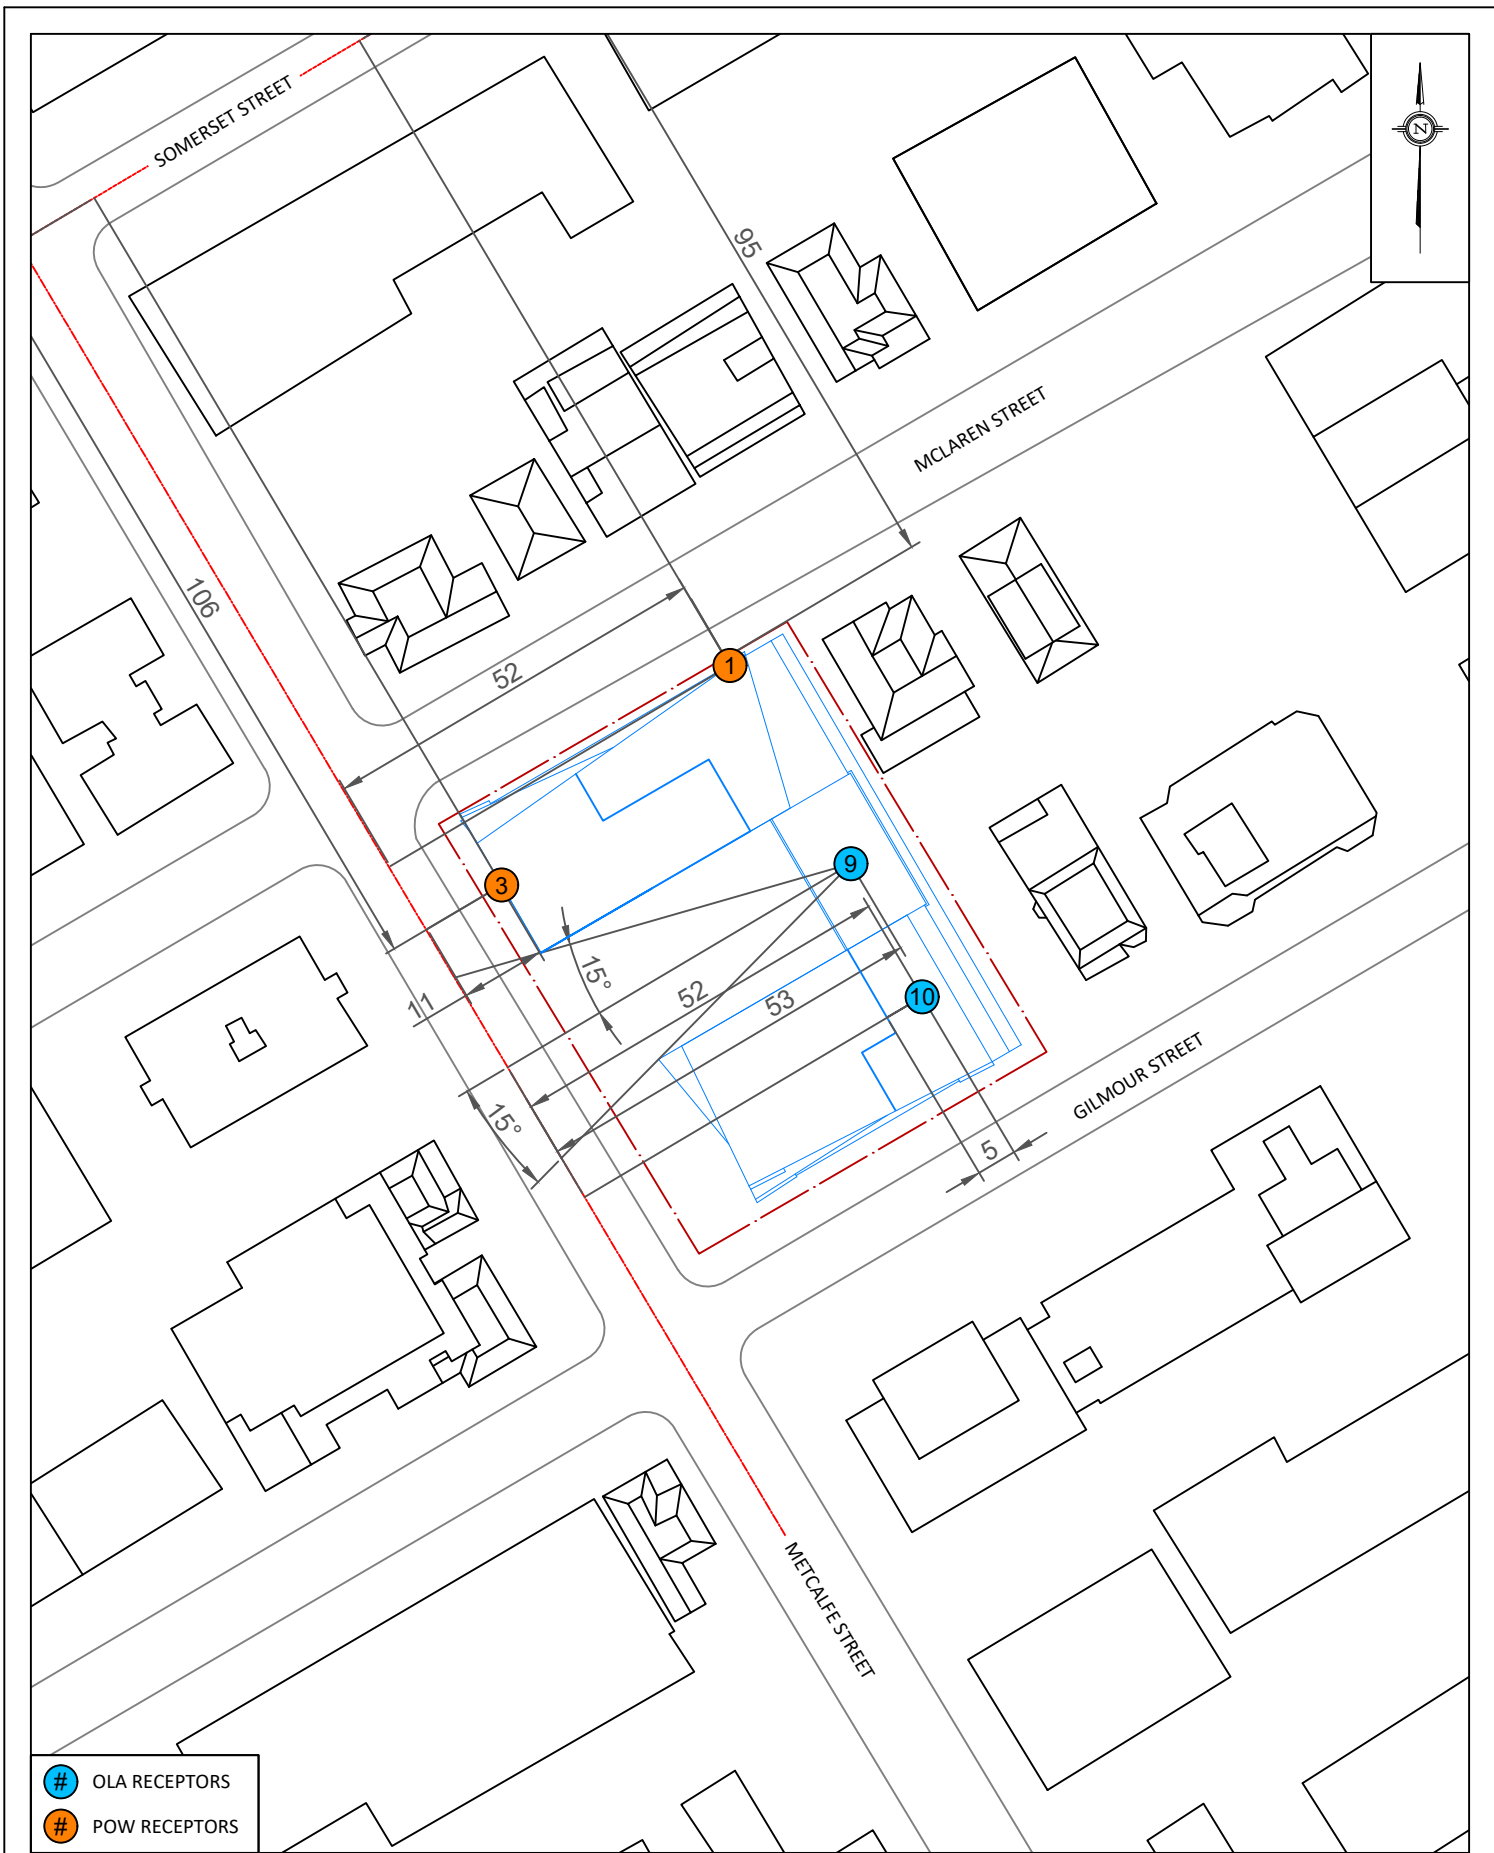

<div>GRADIENTWIND</div> <div>ENGINEERS & SCIENTISTS</div> <div>127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM</div>	PROJECT		267 O'CONNOR STREET, OTTAWA ROADWAY TRAFFIC NOISE FEASIBILITY ASSESSMENT		DESCRIPTION
	SCALE	1:1000	DRAWING NO.	20-166-4	
	DATE	JANUARY 2, 2024	DRAWN BY	T.K.	
	FIGURE 4: STAMSON INPUT PARAMETERS RECEPTORS 1,3, 9 & 10				

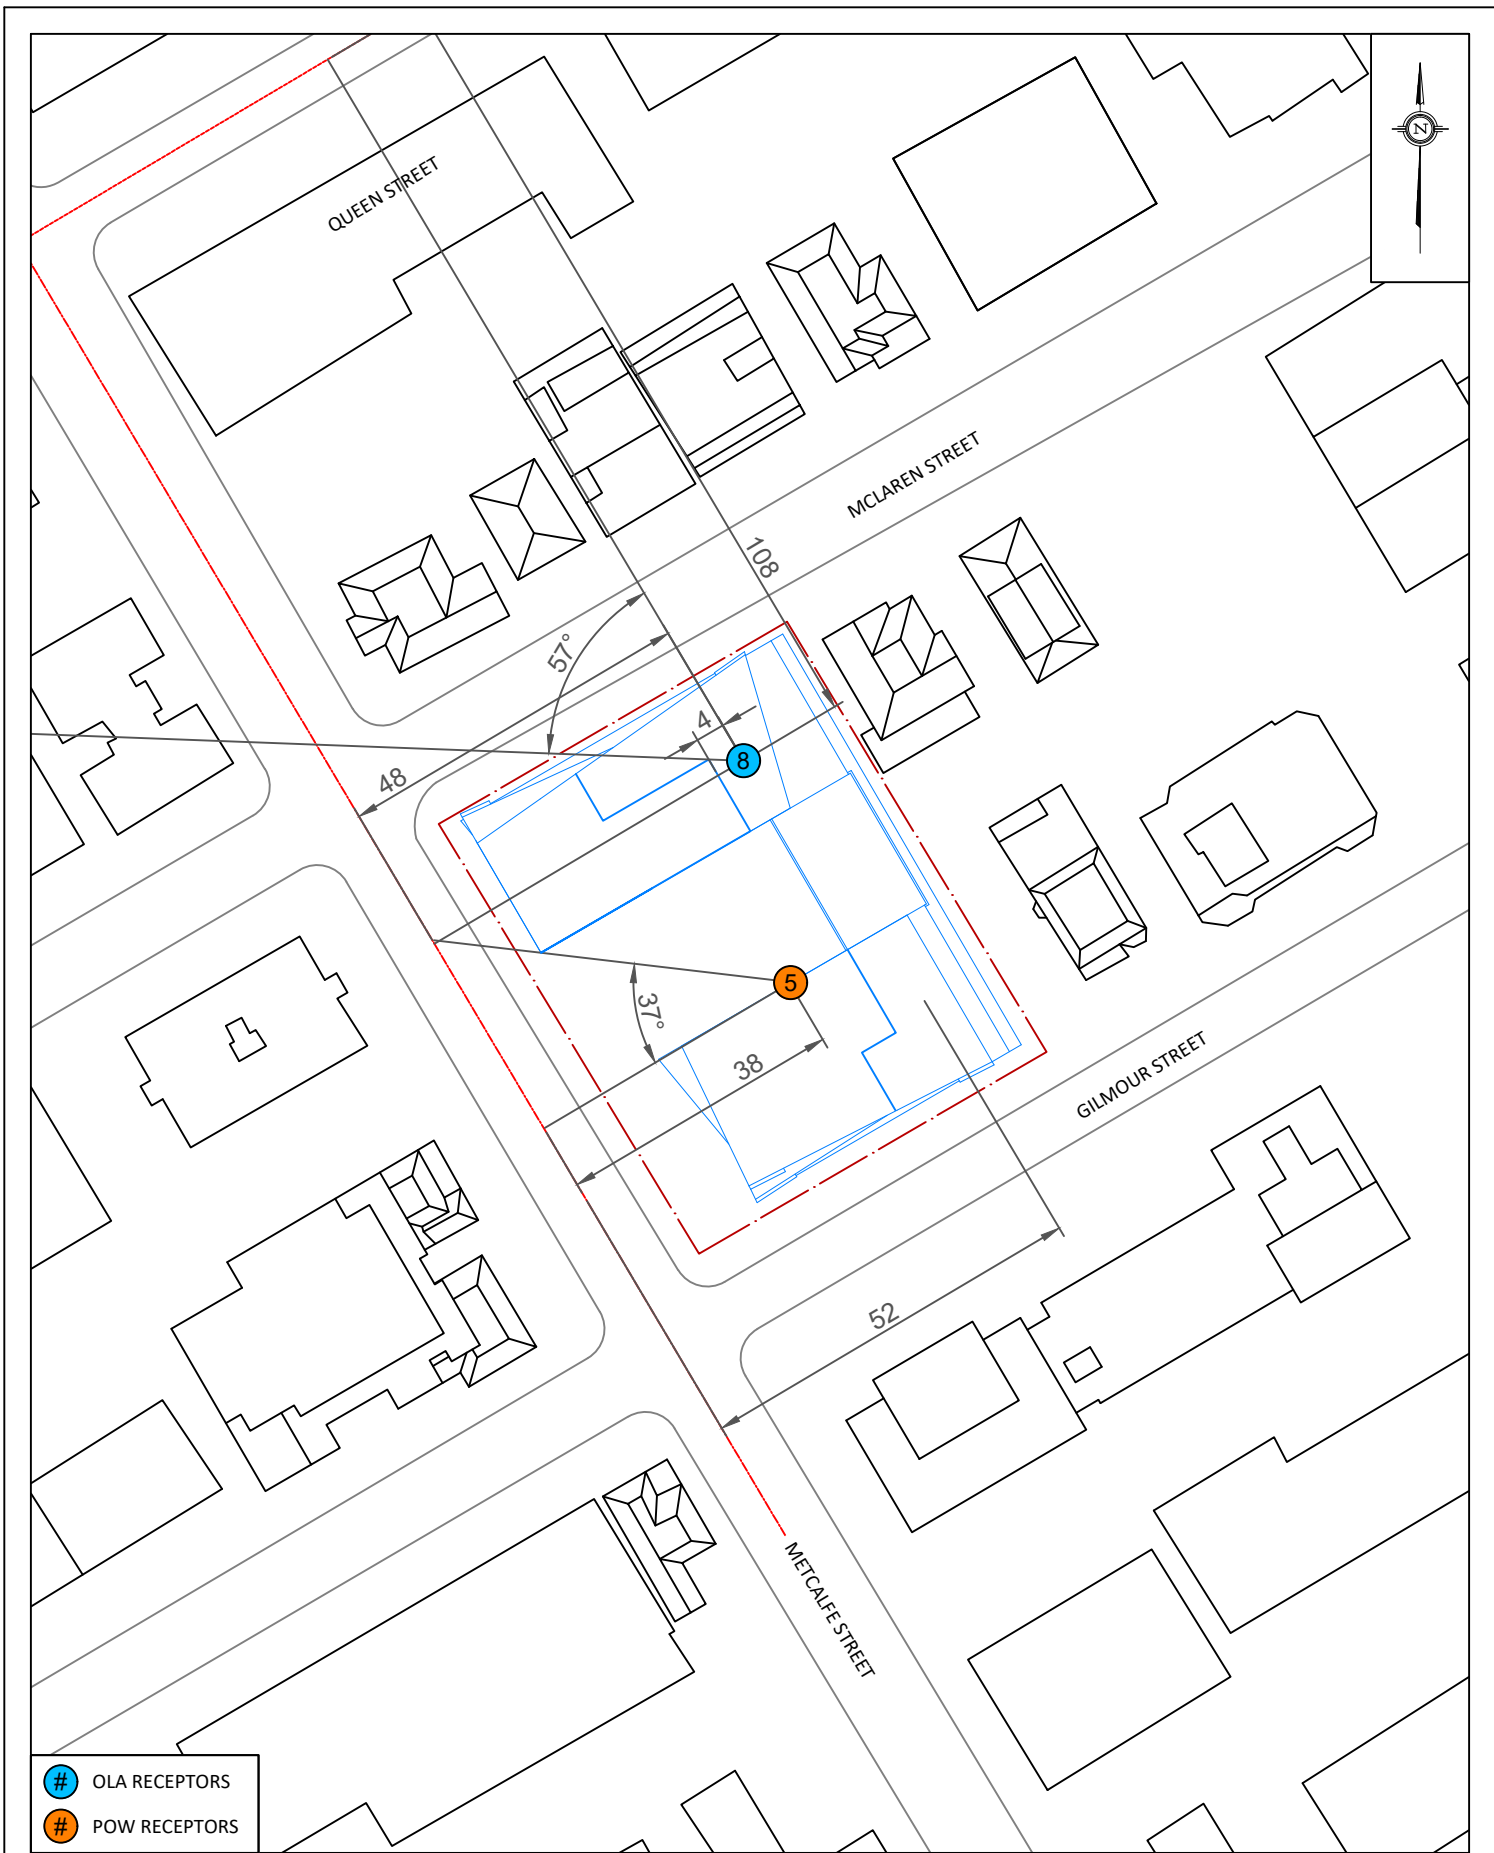

- # OLA RECEPTORS
- # POW RECEPTORS

<div>GRADIENTWIND</div> <div>ENGINEERS & SCIENTISTS</div> <div>127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM</div>	PROJECT		267 O'CONNOR STREET, OTTAWA		DESCRIPTION	
			ROADWAY TRAFFIC NOISE FEASIBILITY ASSESSMENT			
	SCALE	1:1000	DRAWING NO.	20-166-5		
	DATE	JANUARY 2, 2024	DRAWN BY	T.K.		
FIGURE 5: STAMSON INPUT PARAMETERS RECEPTORS 5 & 8						

GRADIENTWIND

ENGINEERS & SCIENTISTS



APPENDIX A

STAMSON 5.04 INPUT AND OUTPUT DATA

GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:14:32
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: rl.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : 0.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 52.00 / 52.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Road data, segment # 2: Somerset St (day/night)

```
-----
Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)
```

* Refers to calculated road volumes based on the following input:

```
24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00
```

Data for Segment # 2: Somerset St (day/night)

```
-----
Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 2 / 2
House density : 40 %
Surface : 2 (Reflective ground surface)
Receiver source distance : 95.00 / 95.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00
```



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 60.07 + 0.00) = 60.07 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	90	0.00	68.48	0.00	-5.40	-3.01	0.00	0.00	0.00
60.07									

Segment Leq : 60.07 dBA

Results segment # 2: Somerset St (day)

Source height = 1.50 m

ROAD (0.00 + 56.96 + 0.00) = 56.96 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	68.48	0.00	-8.02	0.00	0.00	-3.50	0.00
56.96									

Segment Leq : 56.96 dBA

Total Leq All Segments: 61.80 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 52.47 + 0.00) = 52.47 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	90	0.00	60.88	0.00	-5.40	-3.01	0.00	0.00	0.00
52.47									



--

Segment Leq : 52.47 dBA

Results segment # 2: Somerset St (night)

Source height = 1.50 m

ROAD (0.00 + 49.37 + 0.00) = 49.37 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

--	-90	90	0.00	60.88	0.00	-8.02	0.00	0.00	-3.50	0.00
49.37										

--

Segment Leq : 49.37 dBA

Total Leq All Segments: 54.20 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 61.80
(NIGHT): 54.20



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:15:23
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r2.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : 0.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 34.00 / 34.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Road data, segment # 2: Somerset St (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Somerset St (day/night)

Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 2 / 2
House density : 40 %
Surface : 2 (Reflective ground surface)
Receiver source distance : 98.00 / 98.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 61.92 + 0.00) = 61.92 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	90	0.00	68.48	0.00	-3.55	-3.01	0.00	0.00	0.00
61.92									

Segment Leq : 61.92 dBA

Results segment # 2: Somerset St (day)

Source height = 1.50 m

ROAD (0.00 + 56.83 + 0.00) = 56.83 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	68.48	0.00	-8.15	0.00	0.00	-3.50	0.00
56.83									

Segment Leq : 56.83 dBA

Total Leq All Segments: 63.09 dBA



Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 54.32 + 0.00) = 54.32 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	90	0.00	60.88	0.00	-3.55	-3.01	0.00	0.00	0.00
54.32									

Segment Leq : 54.32 dBA

Results segment # 2: Somerset St (night)

Source height = 1.50 m

ROAD (0.00 + 49.23 + 0.00) = 49.23 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	60.88	0.00	-8.15	0.00	0.00	-3.50	0.00
49.23									

Segment Leq : 49.23 dBA

Total Leq All Segments: 55.49 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 63.09
(NIGHT): 55.49



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:16:12
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r3.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 15.00 / 15.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Road data, segment # 2: Somerset St (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 2: Somerset St (day/night)

Angle1 Angle2 : -90.00 deg 0.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 106.00 / 106.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 68.48 + 0.00) = 68.48 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	68.48	0.00	0.00	0.00	0.00	0.00	0.00
68.48									

Segment Leq : 68.48 dBA

Results segment # 2: Somerset St (day)

Source height = 1.50 m

ROAD (0.00 + 56.98 + 0.00) = 56.98 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	0	0.00	68.48	0.00	-8.49	-3.01	0.00	0.00	0.00
56.98									

Segment Leq : 56.98 dBA

Total Leq All Segments: 68.78 dBA



Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 60.88 + 0.00) = 60.88 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	60.88	0.00	0.00	0.00	0.00	0.00	0.00
60.88									

Segment Leq : 60.88 dBA

Results segment # 2: Somerset St (night)

Source height = 1.50 m

ROAD (0.00 + 49.38 + 0.00) = 49.38 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	0	0.00	60.88	0.00	-8.49	-3.01	0.00	0.00	0.00
49.38									

Segment Leq : 49.38 dBA

Total Leq All Segments: 61.18 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 68.78
(NIGHT): 61.18



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:20:14
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r4.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -19.00 deg 16.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 47.00 / 47.00 m
Receiver height : 91.50 / 91.50 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 56.41 + 0.00) = 56.41 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-19	16	0.00	68.48	0.00	-4.96	-7.11	0.00	0.00	0.00
56.41									

Segment Leq : 56.41 dBA

Total Leq All Segments: 56.41 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 48.81 + 0.00) = 48.81 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-19	16	0.00	60.88	0.00	-4.96	-7.11	0.00	0.00	0.00
48.81									

Segment Leq : 48.81 dBA

Total Leq All Segments: 48.81 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 56.41
(NIGHT): 48.81



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:19:20
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r5.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : 0.00 deg 37.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 38.00 / 38.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 57.57 + 0.00) = 57.57 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	37	0.00	68.48	0.00	-4.04	-6.87	0.00	0.00	0.00
57.57									

Segment Leq : 57.57 dBA

Total Leq All Segments: 57.57 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 49.98 + 0.00) = 49.98 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

0	37	0.00	60.88	0.00	-4.04	-6.87	0.00	0.00	0.00
49.98									

Segment Leq : 49.98 dBA

Total Leq All Segments: 49.98 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 57.57
(NIGHT): 49.98



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:21:57
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r6.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 20.00 / 20.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 67.23 + 0.00) = 67.23 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	68.48	0.00	-1.25	0.00	0.00	0.00	0.00
67.23									

Segment Leq : 67.23 dBA

Total Leq All Segments: 67.23 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 59.63 + 0.00) = 59.63 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	90	0.00	60.88	0.00	-1.25	0.00	0.00	0.00	0.00
59.63									

Segment Leq : 59.63 dBA

Total Leq All Segments: 59.63 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 67.23
(NIGHT): 59.63



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 10-01-2025 12:23:43
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r7.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -90.00 deg 0.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 41.00 / 41.00 m
Receiver height : 86.00 / 86.00 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 61.10 + 0.00) = 61.10 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	0	0.00	68.48	0.00	-4.37	-3.01	0.00	0.00	0.00
61.10									

Segment Leq : 61.10 dBA

Total Leq All Segments: 61.10 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 53.51 + 0.00) = 53.51 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-90	0	0.00	60.88	0.00	-4.37	-3.01	0.00	0.00	0.00
53.51									

Segment Leq : 53.51 dBA

Total Leq All Segments: 53.51 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 61.10
(NIGHT): 53.51



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 06-02-2025 10:17:19
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r8.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 48.00 / 18.00 m
Receiver height : 89.50 / 89.50 m
Topography : 2 (Flat/gentle slope; with barrier)
Barrier angle1 : -90.00 deg Angle2 : 90.00 deg
Barrier height : 3.00 m
Barrier receiver distance : 4.00 / -26.00 m
Source elevation : 0.00 m
Receiver elevation : 0.00 m
Barrier elevation : 88.00 m
Reference angle : 0.00



Road data, segment # 2: Somerset St (day/night)

```
-----
Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)
```

* Refers to calculated road volumes based on the following input:

```
24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00
```

Data for Segment # 2: Somerset St (day/night)

```
-----
Angle1 Angle2 : -57.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 108.00 / 108.00 m
Receiver height : 89.50 / 89.50 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00
```

Results segment # 1: O'Connor (day)

Source height = 1.50 m

Barrier height for grazing incidence

```
-----
Source ! Receiver ! Barrier ! Elevation of
Height (m) ! Height (m) ! Height (m) ! Barrier Top (m)
-----+-----+-----+-----
1.50 ! 89.50 ! -5.83 ! 82.17
```

ROAD (0.00 + 46.08 + 0.00) = 46.08 dBA

```
Angle1 Angle2 Alpha RefLeq P.Adj D.Adj F.Adj W.Adj H.Adj B.Adj
SubLeq
```

```
-----
--
-90 90 0.00 68.48 0.00 -5.05 0.00 0.00 0.00 -17.34
46.08
-----
--
```



Segment Leq : 46.08 dBA

Results segment # 2: Somerset St (day)

Source height = 1.50 m

ROAD (0.00 + 59.03 + 0.00) = 59.03 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

--									
-57	90	0.00	68.48	0.00	-8.57	-0.88	0.00	0.00	0.00
59.03									
--									

Segment Leq : 59.03 dBA

Total Leq All Segments: 59.24 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	89.50	128.62	216.62

ROAD (0.00 + 60.09 + 0.00) = 60.09 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

--									
-90	90	0.00	60.88	0.00	-0.79	0.00	0.00	0.00	99.00
159.09									
-90	90	0.00	60.88	0.00	-0.79	0.00	0.00	0.00	0.00
60.09									
--									

* Bright Zone !

Segment Leq : 60.09 dBA



Results segment # 2: Somerset St (night)

Source height = 1.50 m

ROAD (0.00 + 51.43 + 0.00) = 51.43 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-57	90	0.00	60.88	0.00	-8.57	-0.88	0.00	0.00	0.00
51.43									

Segment Leq : 51.43 dBA

Total Leq All Segments: 60.64 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 59.24
(NIGHT): 60.64



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 13-01-2025 08:56:33
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: R9.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -15.00 deg 15.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 53.00 / 53.00 m
Receiver height : 5.50 / 5.50 m
Topography : 1 (Flat/gentle slope; no barrier)
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

ROAD (0.00 + 55.22 + 0.00) = 55.22 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-15	15	0.00	68.48	0.00	-5.48	-7.78	0.00	0.00	0.00
55.22									

Segment Leq : 55.22 dBA

Total Leq All Segments: 55.22 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

ROAD (0.00 + 47.62 + 0.00) = 47.62 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
SubLeq									

-15	15	0.00	60.88	0.00	-5.48	-7.78	0.00	0.00	0.00
47.62									

Segment Leq : 47.62 dBA

Total Leq All Segments: 47.62 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 55.22
(NIGHT): 47.62



GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0 NORMAL REPORT Date: 06-02-2025 10:22:58
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: r10.te Time Period: Day/Night 16/8 hours
Description:

Road data, segment # 1: O'Connor (day/night)

Car traffic volume : 12144/1056 veh/TimePeriod *
Medium truck volume : 966/84 veh/TimePeriod *
Heavy truck volume : 690/60 veh/TimePeriod *
Posted speed limit : 50 km/h
Road gradient : 0 %
Road pavement : 1 (Typical asphalt or concrete)

* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth : 0.00
Number of Years of Growth : 0.00
Medium Truck % of Total Volume : 7.00
Heavy Truck % of Total Volume : 5.00
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: O'Connor (day/night)

Angle1 Angle2 : -90.00 deg 90.00 deg
Wood depth : 0 (No woods.)
No of house rows : 0 / 0
Surface : 2 (Reflective ground surface)
Receiver source distance : 52.00 / 27.00 m
Receiver height : 80.50 / 80.50 m
Topography : 2 (Flat/gentle slope; with barrier)
Barrier angle1 : -90.00 deg Angle2 : 90.00 deg
Barrier height : 3.00 m
Barrier receiver distance : 5.00 / 10.00 m
Source elevation : 0.00 m
Receiver elevation : 0.00 m
Barrier elevation : 79.00 m
Reference angle : 0.00



Results segment # 1: O'Connor (day)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	80.50	-6.10	72.90

ROAD (0.00 + 45.69 + 0.00) = 45.69 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
-90	90	0.00	68.48	0.00	-5.40	0.00	0.00	0.00	-17.39

SubLeq

45.69

Segment Leq : 45.69 dBA

Total Leq All Segments: 45.69 dBA

Results segment # 1: O'Connor (night)

Source height = 1.50 m

Barrier height for grazing incidence

Source Height (m)	Receiver Height (m)	Barrier Height (m)	Elevation of Barrier Top (m)
1.50	80.50	-27.76	51.24

ROAD (0.00 + 39.65 + 0.00) = 39.65 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj
-90	90	0.00	60.88	0.00	-2.55	0.00	0.00	0.00	-18.68

SubLeq

39.65

Segment Leq : 39.65 dBA

Total Leq All Segments: 39.65 dBA



TOTAL Leq FROM ALL SOURCES (DAY) : 45.69
(NIGHT) : 39.65

