

**TRANSPORTATION NOISE  
FEASIBILITY ASSESSMENT**

1137 & 1151 Ogilvie Road  
Ottawa, Ontario

REPORT: 24-126-Transportation Noise Feasibility



March 5, 2025

PREPARED FOR

TCU Development Corp.  
1207-150 Isabella Street,  
Ottawa, ON K1S 5H3

PREPARED BY

Benjamin Page, AdvDip, Junior Environmental Scientist  
Joshua Foster, P.Eng., Lead Engineer

## EXECUTIVE SUMMARY

This report describes a transportation noise feasibility assessment for Phases 1 and 2 of the proposed mixed-use residential development located at 1137 and 1151 Ogilvie Road in Ottawa, Ontario. The proposed development comprises two 30-storey mixed-use residential buildings, with Phase 1 located to the west, alongside Cummings Avenue and Phase 2 to the east. The primary sources of traffic noise impacting the site are Ogilvie Road and Cummings Avenue. Figure 1 illustrates a site plan with the surrounding context.

The assessment is based on (i) theoretical noise calculation methods conforming to the Ministry of the Environment, Conservation and Parks (MECP) NPC-300 guidelines<sup>1</sup>, Ministry of Transportation Ontario (MTO)<sup>2</sup>, and City of Ottawa Environmental Noise Control Guidelines (ENCG)<sup>3</sup> guidelines; (ii) future traffic volumes corresponding to roadway classifications, theoretical roadway capacities, and recent satellite imagery; and (iii) architectural drawings prepared by Roderick Lahey Architect Inc. in February 2025.

The results of the current analysis indicate that noise levels will range between 41 and 68 dBA during the daytime period (07:00-23:00) and between 33 and 60 dBA during the nighttime period (23:00-07:00). The highest noise level (i.e. 68 dBA) occurs along the south-facing façade of the Phase 2 development, which is nearest and most exposed to Ogilvie Road.

As a result, upgraded building components and central air conditioning will be required, as noise levels predicted due to roadway traffic exceed the criteria of 65 dBA during the daytime listed in ENCG. The development will require upgraded building components with an STC 33 rating along the south façade of the Phase 1 podium and the south façade of the Phase 2 podium and tower (see Figure 4). This will be sufficient in reducing indoor noise levels at or below the ENCG criterion for noise-sensitive spaces. For the remaining facades, OBC-compliant windows will suffice. All units will require air conditioning. In addition, A Type D Warning Clause will also be required to be placed on all Lease, Purchase and Sale Agreements for all units.

---

<sup>1</sup> Ontario Ministry of the Environment and Climate Change – Environmental Noise Guidelines, Publication NPC-300, Queens Printer for Ontario, Toronto, 2013

<sup>2</sup> Ministry of Transportation Ontario, “*Environmental Guide for Noise*”, August 2021

<sup>3</sup> City of Ottawa Environmental Noise Control Guidelines, January 2016



The results also indicate that noise levels at the Level 7 South Terrace of both the Phase 1 and Phase 2 developments are expected to be between 58 dBA and 60 dBA. As noise levels exceed the criteria listed in ENCG for outdoor living areas, as discussed in Section 4.2, noise mitigation at the OLAs is required. Detailed mitigation measures would be the subject of a detailed noise assessment during the site plan approval stage.

With regard to stationary noise impacts, the building will be designed to ensure compliance with the ENCG sound level limits. Noise impacts can generally be minimized by judicious selection and placement of the equipment. Where necessary, noise screens and silencers can be placed into the design. It is recommended a stationary noise study be conducted once mechanical plans for the proposed building become available. This study would assess the impacts of stationary noise from rooftop mechanical units serving the proposed building on surrounding noise-sensitive areas.



**TABLE OF CONTENTS**

**1. INTRODUCTION..... 1**

**2. TERMS OF REFERENCE..... 1**

**3. OBJECTIVES..... 3**

**4. METHODOLOGY ..... 3**

**4.1 Background.....3**

**4.2 Transportation Noise.....3**

**4.2.1 Criteria for Transportation Noise.....3**

**4.2.2 Roadway Traffic Volumes.....5**

**4.2.3 Theoretical Roadway Noise Predictions .....5**

**5. RESULTS AND DISCUSSION ..... 6**

**5.1 Transportation Noise Levels .....6**

**5.2 Noise Control Measures .....8**

**6. CONCLUSIONS AND RECOMMENDATIONS ..... 9**

**FIGURES**

**APPENDICES**

**Appendix A – STAMSON 5.04 INPUT AND OUTPUT DATA**



## 1. INTRODUCTION

Gradient Wind Engineering Inc. (Gradient Wind) was retained by TCU Development Corporation to undertake a transportation noise feasibility assessment to satisfy Zoning By-Law Amendment (ZBLA) application submission requirements for Phases 1 and 2 of the proposed mixed-use residential development located at 1137 and 1151 Ogilvie Road in Ottawa, Ontario. This report summarizes the methodology, results, and recommendations related to a transportation noise feasibility assessment investigating exterior noise levels generated by local roadway traffic.

The assessment was performed based on theoretical noise calculation methods conforming to the Ministry of the Environment, Conservation and Parks (MECP) NPC-300 guidelines<sup>4</sup>, Ministry of Transportation Ontario (MTO)<sup>5</sup>, and City of Ottawa Environmental Noise Control Guidelines (ENCG)<sup>6</sup> guidelines. Noise calculations were based on architectural drawings prepared by Roderick Lahey Architect Inc. in February 2025, with future traffic volumes corresponding to roadway classifications, theoretical roadway capacities, and recent satellite imagery.

## 2. TERMS OF REFERENCE

The subject site is located at 1137 and 1151 Ogilvie Road in Ottawa, situated at the northeast corner of the intersection of Ogilvie Road and Cummings Avenue. Throughout this report, Ogilvie Road is considered as project south. The proposed development comprises two 30-storey mixed-use residential buildings, with Phase 1 located to the west, alongside Cummings Avenue and Phase 2 to the east. Both buildings feature 4-storey podia to the north and 6-storey podia to the south, with nominally rectangular towers rising to 30 storeys. Phase 1 is topped with a mechanical penthouse (MPH). A drive aisle extends from Cummings Avenue to the northwest of the subject site, providing access to a parking ramp, surface parking to the north, loading areas, and a drop-off/pick-up area serving Phases 1 and 2. A privately-owned publicly

---

<sup>4</sup> Ontario Ministry of the Environment and Climate Change – Environmental Noise Guidelines, Publication NPC-300, Queens Printer for Ontario, Toronto, 2013

<sup>5</sup> Ministry of Transportation Ontario, “*Environmental Guide for Noise*”, August 2021

<sup>6</sup> City of Ottawa Environmental Noise Control Guidelines, January 2016



accessible space (POPS) is located along Ogilvie Road between Phases 1 and 2, extending to the south of Phase 2.

Above three underground parking levels, the ground floor of the proposed development includes an amenity/commercial space along the south elevation, a residential main entrance with a lobby to the inner northeastern corner of the building, shared building support spaces to the northeast, and residential spaces throughout the remainder of the level. An amenity patio is located to the south of the building along Ogilvie Road. Levels 2-30 are reserved for residential occupancy, while the Penthouse Level includes mechanical spaces, as well as interior and exterior amenity spaces.

The ground floor of Phase 2 includes a lobby/amenity along the west elevation, a loading area to the northwest, an amenity/commercial space to the south, and residential space along the east elevation. Levels 2-30 are reserved for residential occupancy.

The site is surrounded by low-rise commercial buildings with surface parking lots from the east-southeast clockwise to the south, a high-rise building to the south, a gas station to the west, low-rise residential dwellings from the west clockwise to the north, and a forested area from the north-northeast clockwise to the east. Notably, a 6-storey residential development is under construction at 1184 Cummings Avenue, to the immediate northwest, and a mixed-use hotel/residential development comprising two towers (25 and 27 storeys) is approved at 1098 Ogilvie Road and 1178 Cummings Avenue, approximately 80 m to the southwest. The primary sources of traffic noise impacting the site are Ogilvie Road and Cummings Avenue. Figure 1 illustrates a site plan with the surrounding context.

With regard to stationary noise impacts, the building will be designed to ensure compliance with the ENCG sound level limits. Noise impacts can generally be minimized by judicious selection and placement of the equipment. Where necessary, noise screens and silencers can be placed into the design. It is recommended a stationary noise study be conducted once mechanical plans for the proposed building become available. This study would assess the impacts of stationary noise from rooftop mechanical units serving the proposed building on surrounding noise-sensitive areas.

### **3. OBJECTIVES**

The main goals of this work are to (i) calculate the future noise levels on the study buildings produced by local transportation sources, and (ii) determine whether exterior noise levels exceed the allowable limits specified by the City of Ottawa's Environmental Noise Control Guidelines as outlined in Section 4.2 of this report.

### **4. METHODOLOGY**

#### **4.1 Background**

Noise can be defined as any obtrusive sound. It is created at a source, transmitted through a medium, such as air, and intercepted by a receiver. Noise may be characterized in terms of the power of the source or the sound pressure at a specific distance. While the power of a source is characteristic of that particular source, the sound pressure depends on the location of the receiver and the path that the noise takes to reach the receiver. Measurement of noise is based on the decibel unit, dBA, which is a logarithmic ratio referenced to a standard noise level ( $2 \times 10^{-5}$  Pascals). The 'A' suffix refers to a weighting scale, which better represents how the noise is perceived by the human ear. With this scale, a doubling of power results in a 3 dBA increase in measured noise levels and is just perceptible to most people. An increase of 10 dBA is often perceived to be twice as loud.

#### **4.2 Transportation Noise**

##### **4.2.1 Criteria for Transportation Noise**

For vehicle traffic, the equivalent sound energy level,  $L_{eq}$ , provides a measure of the time-varying noise levels, which is well correlated with the annoyance of sound. It is defined as the continuous sound level, which has the same energy as a time-varying noise level over a period of time. For roadways, the  $L_{eq}$  is commonly calculated on the basis of a 16-hour ( $L_{eq16}$ ) daytime (07:00-23:00)/8-hour ( $L_{eq8}$ ) nighttime (23:00-07:00) split to assess its impact on residential buildings. The City of Ottawa's Environmental Noise Control Guidelines (ENCG) specifies that the recommended indoor noise limit range (that is relevant to this study) is 50, 45 and 40 dBA for reception areas, residence living rooms and sleeping quarters respectively, as listed in Table 1.

**TABLE 1: INDOOR SOUND LEVEL CRITERIA (ROAD)<sup>7</sup>**

Type of Space	Time Period	L <sub>eq</sub> (dBA)
General offices, <b>reception areas</b> , retail stores, etc.	07:00 – 23:00	50
<b>Living/dining/den areas of residences, sleeping quarters</b> , hospitals, schools, nursing/retirement homes, day-care centres, theatres, places of worship, libraries, individual or semi-private offices, conference rooms, etc.	07:00 – 23:00	45
Sleeping quarters of hotels/motels	23:00 – 07:00	45
Sleeping quarters of <b>residences</b> , hospitals, nursing/retirement homes, etc.	23:00 – 07:00	40

Predicted noise levels at the plane of window (POW) dictate the action required to achieve the recommended sound levels. An open window is considered to provide a 10 dBA reduction in noise, while a standard closed window is capable of providing a minimum 20 dBA noise reduction<sup>8</sup>. A closed window due to a ventilation requirement will bring noise levels down to achieve an acceptable indoor environment<sup>9</sup>. Therefore, where noise levels exceed 55 dBA daytime and 50 dBA nighttime, the ventilation for the building should consider the need for having windows and doors closed, which normally triggers the need for forced air heating with provision for central air conditioning. Where noise levels due to roadway traffic exceed 65 dBA daytime and 60 dBA nighttime, air conditioning will be required and building components will require higher levels of sound attenuation<sup>10</sup>.

For designated Outdoor Living Areas (OLAs), the sound level limit is 55 dBA during the daytime period. An excess above the limit of 5 dBA is acceptable only in cases where the required noise control measures are not feasible for technical, economic or administrative reasons.

<sup>7</sup> Adapted from ENCG 2016 – Tables 2.2b and 2.2c

<sup>8</sup> Burberry, P.B. (2014). Mitchell’s Environment and Services. Routledge, Page 125

<sup>9</sup> MOECP, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.8

<sup>10</sup> MOECP, Environmental Noise Guidelines, NPC 300 – Part C, Section 7.1.3





## 4.2.2 Roadway Traffic Volumes

The ENCG dictates that noise calculations should consider future sound levels based on a roadway’s classification at the mature state of development. Therefore, traffic volumes are based on the roadway classifications outlined in the City of Ottawa’s Official Plan (OP) and Transportation Master Plan<sup>11</sup> which provide additional details on future roadway expansions. Average Annual Daily Traffic (AADT) volumes are then based on data in Table B1 of the ENCG for each roadway classification. Table 2 (below) summarizes the AADT values used for each roadway included in this assessment.

**TABLE 2: ROADWAY TRAFFIC DATA**

Segment	Roadway/Transit Class	Speed Limit (km/h)	AADT Count
Ogilvie Road	4-Lane Urban Arterial Divided (4-UAD)	60	<b>35,000</b>
Cummings Avenue 1	2-Lane Urban Arterial (2-UAU)	50	<b>15,000</b>
Cummings Avenue 2	2-Lane Major Collector (2-UMCU)	50	<b>12,000</b>

## 4.2.3 Theoretical Roadway Noise Predictions

The impact of transportation noise sources on the development was determined by computer modelling. Transportation noise source modelling is based on the software program *Predictor-Lima* which utilizes the United States Federal Highway Administration’s Traffic Noise Model (TNM) to represent the roadway line sources. This computer program can represent three-dimensional surfaces and the first reflections of sound waves over a suitable spectrum for human hearing. A set of comparative calculations were performed in the free field environment for comparisons to the current Ontario traffic noise prediction model STAMSON. The STAMSON model is however older and requires each receptor to be calculated separately. STAMSON also does not accurately account for building reflections and multiple screening elements, and curved road geometry. Noise levels were found to be within an imperceptible level of 0-3

<sup>11</sup> City of Ottawa Transportation Master Plan, November 2013

dBA of those predicted in Predictor. A total of 22 receptor locations were identified around the site, as illustrated in Figure 2.

Roadway noise calculations were performed by treating each transportation segment as separate line sources of noise, and by using existing building locations as noise barriers. In addition to the traffic volumes summarized in Table 2, theoretical noise predictions were based on the following parameters:

- Truck traffic on all roadways was taken to comprise 5% heavy trucks and 7% medium trucks.
- The day/night split for all streets was taken to be 92%/8%, respectively.
- Default ground surfaces were taken to be reflective due to the presence of hard (paved) ground.
- Ken Steele Park located to the immediate east of the site, is considered to be a foliage region due to its dense tree coverage
- Topography was assumed to be a flat/gentle slope surrounding the study building.
- For select sources where appropriate, receptors considered the proposed and/or existing buildings as a barrier partially or fully obstructing exposure to the source as illustrated by exposure angles in Figure 3.

## 5. RESULTS AND DISCUSSION

### 5.1 Transportation Noise Levels

The results of the roadway noise calculations are summarized in Table 3 below.

**TABLE 3: EXTERIOR NOISE LEVELS DUE TO TRANSPORTATION SOURCES**

Receptor Number	Receptor Height Above Grade (m)	Receptor Location	Total Noise Level (dBA)	
			Day	Night
Phase 1 Building				
R1	14	POW - Level 4 West Façade	64	56
R2	14	POW - Level 4 North Façade	58	50
R3	21	POW - Level 6 East Façade	58	51
R4	21	POW - Level 6 South Façade	67	59

**TABLE 3 CONTINUED: EXTERIOR NOISE LEVELS DUE TO TRANSPORTATION SOURCES**

Receptor Number	Receptor Height Above Grade (m)	Receptor Location	Total Noise Level (dBA)	
			Day	Night
R5	21	POW - Level 6 West Façade	64	56
R6	94	POW - Level 30 West Façade	64	57
R7	94	POW - Level 30 North Façade	58	50
R8	94	POW - Level 30 East Façade	60	52
R9	94	POW - Level 30 South Façade	54	47
R10	17	OLA - Level 5 North Terrace	54	<b>N/A*</b>
R11	24	OLA - Level 7 South Terrace	60	<b>N/A*</b>
R12	97	OLA - Level 31 North Terrace	50	<b>N/A*</b>
<b>Phase 2 Building</b>				
R13	14	POW - Level 4 North Façade	41	33
R14	14	POW - Level 4 East Façade	61	54
R15	21	POW - Level 6 South Façade	68	60
R16	21	POW - Level 6 West Façade	61	54
R17	94	POW - Level 30 West Façade	60	52
R18	94	POW - Level 30 North Façade	52	44
R19	94	POW - Level 30 East Façade	61	53
R20	94	POW - Level 30 South Façade	66	59
R21	17	OLA - Level 5 North Terrace	53	<b>N/A*</b>
R22	24	OLA - Level 7 South Terrace	58	<b>N/A*</b>

\*Noise levels during the nighttime are not considered for OLAs

The results of the current analysis indicate that noise levels will range between 41 and 68 dBA during the daytime period (07:00-23:00) and between 33 and 60 dBA during the nighttime period (23:00-07:00). The highest noise level (i.e. 68 dBA) occurs along the south-facing façade of the Phase 2 development, which is nearest and most exposed to Ogilvie Road.

Table 4 shows a comparison in results between Predictor-Lima and STAMSON. Noise levels calculated in STAMSON were found to have a good correlation with Predictor-Lima and variability between the two programs was within an acceptable level of  $\pm 0-3$  dBA. Sample calculations are presented in Appendix A.

**TABLE 4: RESULTS OF STAMSON/PREDICTOR-LIMA CORRELATION**

Receptor ID	Receptor Location	Receptor Height Above Grade/Roof (m)	PREDICTOR-LIMA Noise Level (dBA)		STAMSON 5.04 Noise Level (dBA)	
			Day	Night	Day	Night
R15	POW - Level 6 South Façade	21	68	60	71	63
R16	POW - Level 6 South Façade	21	61	54	64	56

\*Noise levels during the nighttime are not considered for OLAs

## 5.2 Noise Control Measures

The results indicate that upgraded building components and central air conditioning will be required, as noise levels predicted due to roadway traffic exceed the criteria of 65 dBA during the daytime listed in ENCG. Since noise levels slightly exceed this threshold, the development will require upgraded building components with an STC 33 rating along the south façade of the Phase 1 podium and the south façade of the Phase 2 podium and tower (see Figure 4). This will be sufficient in reducing indoor noise levels at or below the ENCG criterion for noise-sensitive spaces. For the remaining facades, OBC-compliant windows will suffice. All units will require air conditioning. In addition, A Type D Warning Clause will also be required to be placed on all Lease, Purchase and Sale Agreements for all units.

The results also indicate that noise levels at the Level 7 South Terrace of both the Phase 1 and Phase 2 developments are expected to be between 58 dBA and 60 dBA. As noise levels exceed the criteria listed in ENCG for outdoor living areas, as discussed in Section 4.2, noise mitigation at the OLAs is required. Detailed mitigation measures would be the subject of a detailed noise assessment during the site plan approval stage.

## **6. CONCLUSIONS AND RECOMMENDATIONS**

The results of the current analysis indicate that noise levels will range between 41 and 68 dBA during the daytime period (07:00-23:00) and between 33 and 60 dBA during the nighttime period (23:00-07:00). The highest noise level (i.e. 68 dBA) occurs along the south-facing façade of the Phase 2 development, which is nearest and most exposed to Ogilvie Road.

As a result, upgraded building components and central air conditioning will be required, as noise levels predicted due to roadway traffic exceed the criteria of 65 dBA during the daytime listed in ENCG. The development will require upgraded building components with an STC 33 rating along the south façade of the Phase 1 podium and the south façade of the Phase 2 podium and tower (see Figure 4). This will be sufficient in reducing indoor noise levels at or below the ENCG criterion for noise-sensitive spaces. For the remaining facades, OBC-compliant windows will suffice. All units will require air conditioning. In addition, A Type D Warning Clause will also be required to be placed on all Lease, Purchase and Sale Agreements for all units.

The results also indicate that noise levels at the Level 7 South Terrace of both the Phase 1 and Phase 2 developments are expected to be between 58 dBA and 60 dBA. As noise levels exceed the criteria listed in ENCG for outdoor living areas, as discussed in Section 4.2, noise mitigation at the OLAs is required. Detailed mitigation measures would be the subject of a detailed noise assessment during the site plan approval stage.

With regard to stationary noise impacts, the building will be designed to ensure compliance with the ENCG sound level limits. Noise impacts can generally be minimized by judicious selection and placement of the equipment. Where necessary, noise screens and silencers can be placed into the design. It is recommended a stationary noise study be conducted once mechanical plans for the proposed building become available. This study would assess the impacts of stationary noise from rooftop mechanical units serving the proposed building on surrounding noise-sensitive areas.

This concludes our assessment and report. If you have any questions or wish to discuss our findings, please advise us. In the interim, we thank you for the opportunity to be of service.

Sincerely,

***Gradient Wind Engineering Inc.***




Benjamin Page, AdvDip.  
Junior Environmental Scientist





Joshua Foster, P.Eng.  
Lead Engineer

*Gradient Wind File #24-126-Transportation Noise Feasibility*

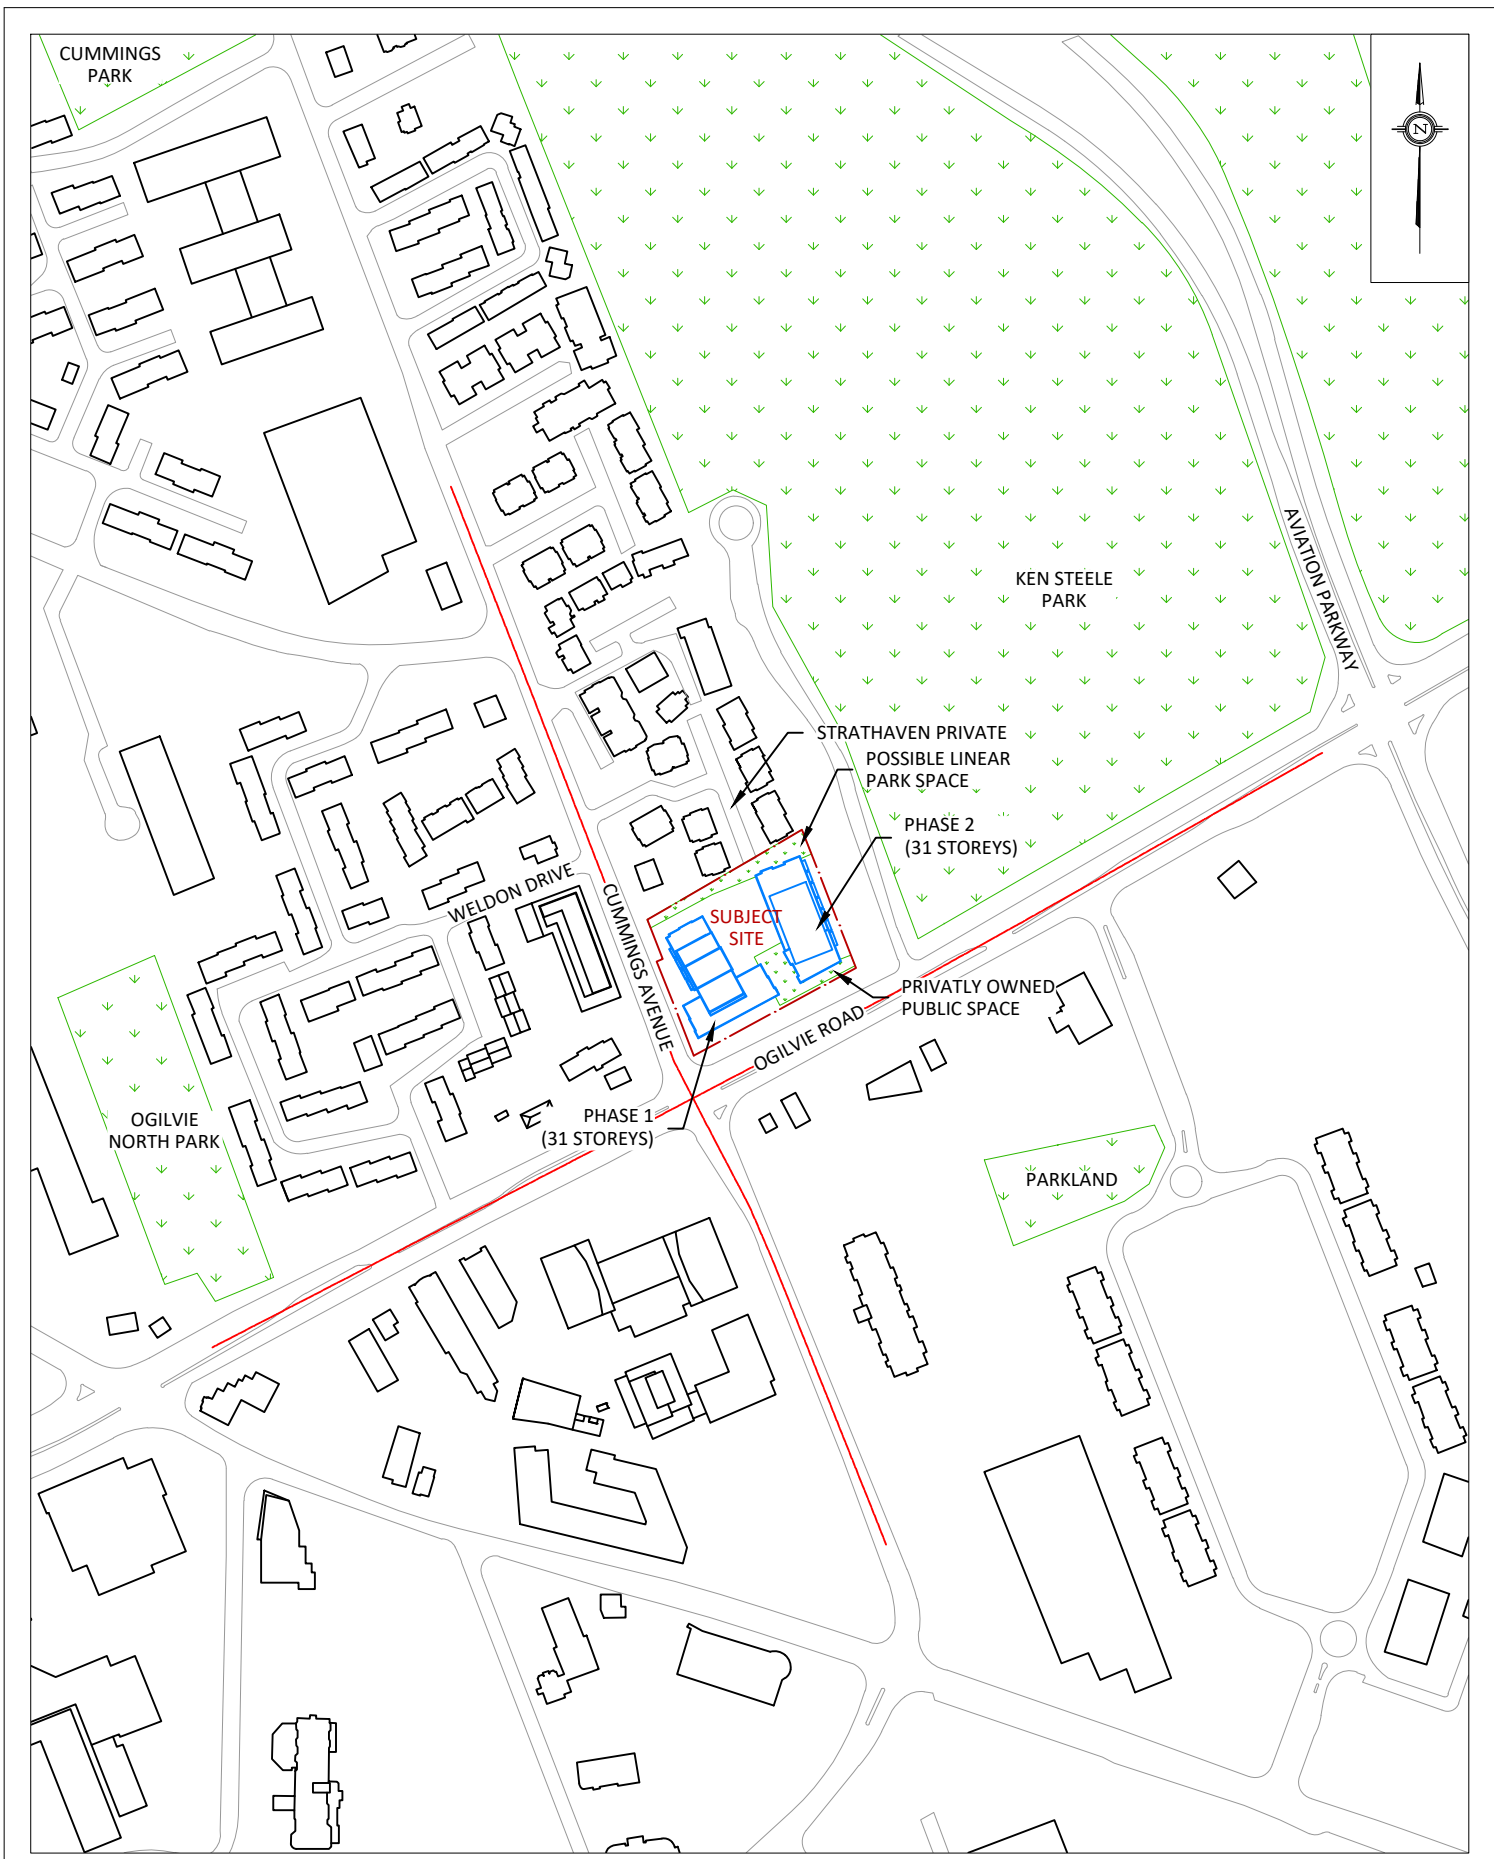

PROJECT	1137 & 1151 OGILVIE ROAD, OTTAWA TRANSPORT NOISE FEASIBILITY ASSESSMENT	
SCALE	1:4000 (SCALE)	DRAWING NO. 24-126-FIG1
DATE	MARCH 5, 2025	DRAWN BY B.P.

DESCRIPTION  
**FIGURE 1:**  
 SITE PLAN AND SURROUNDING CONTEXT

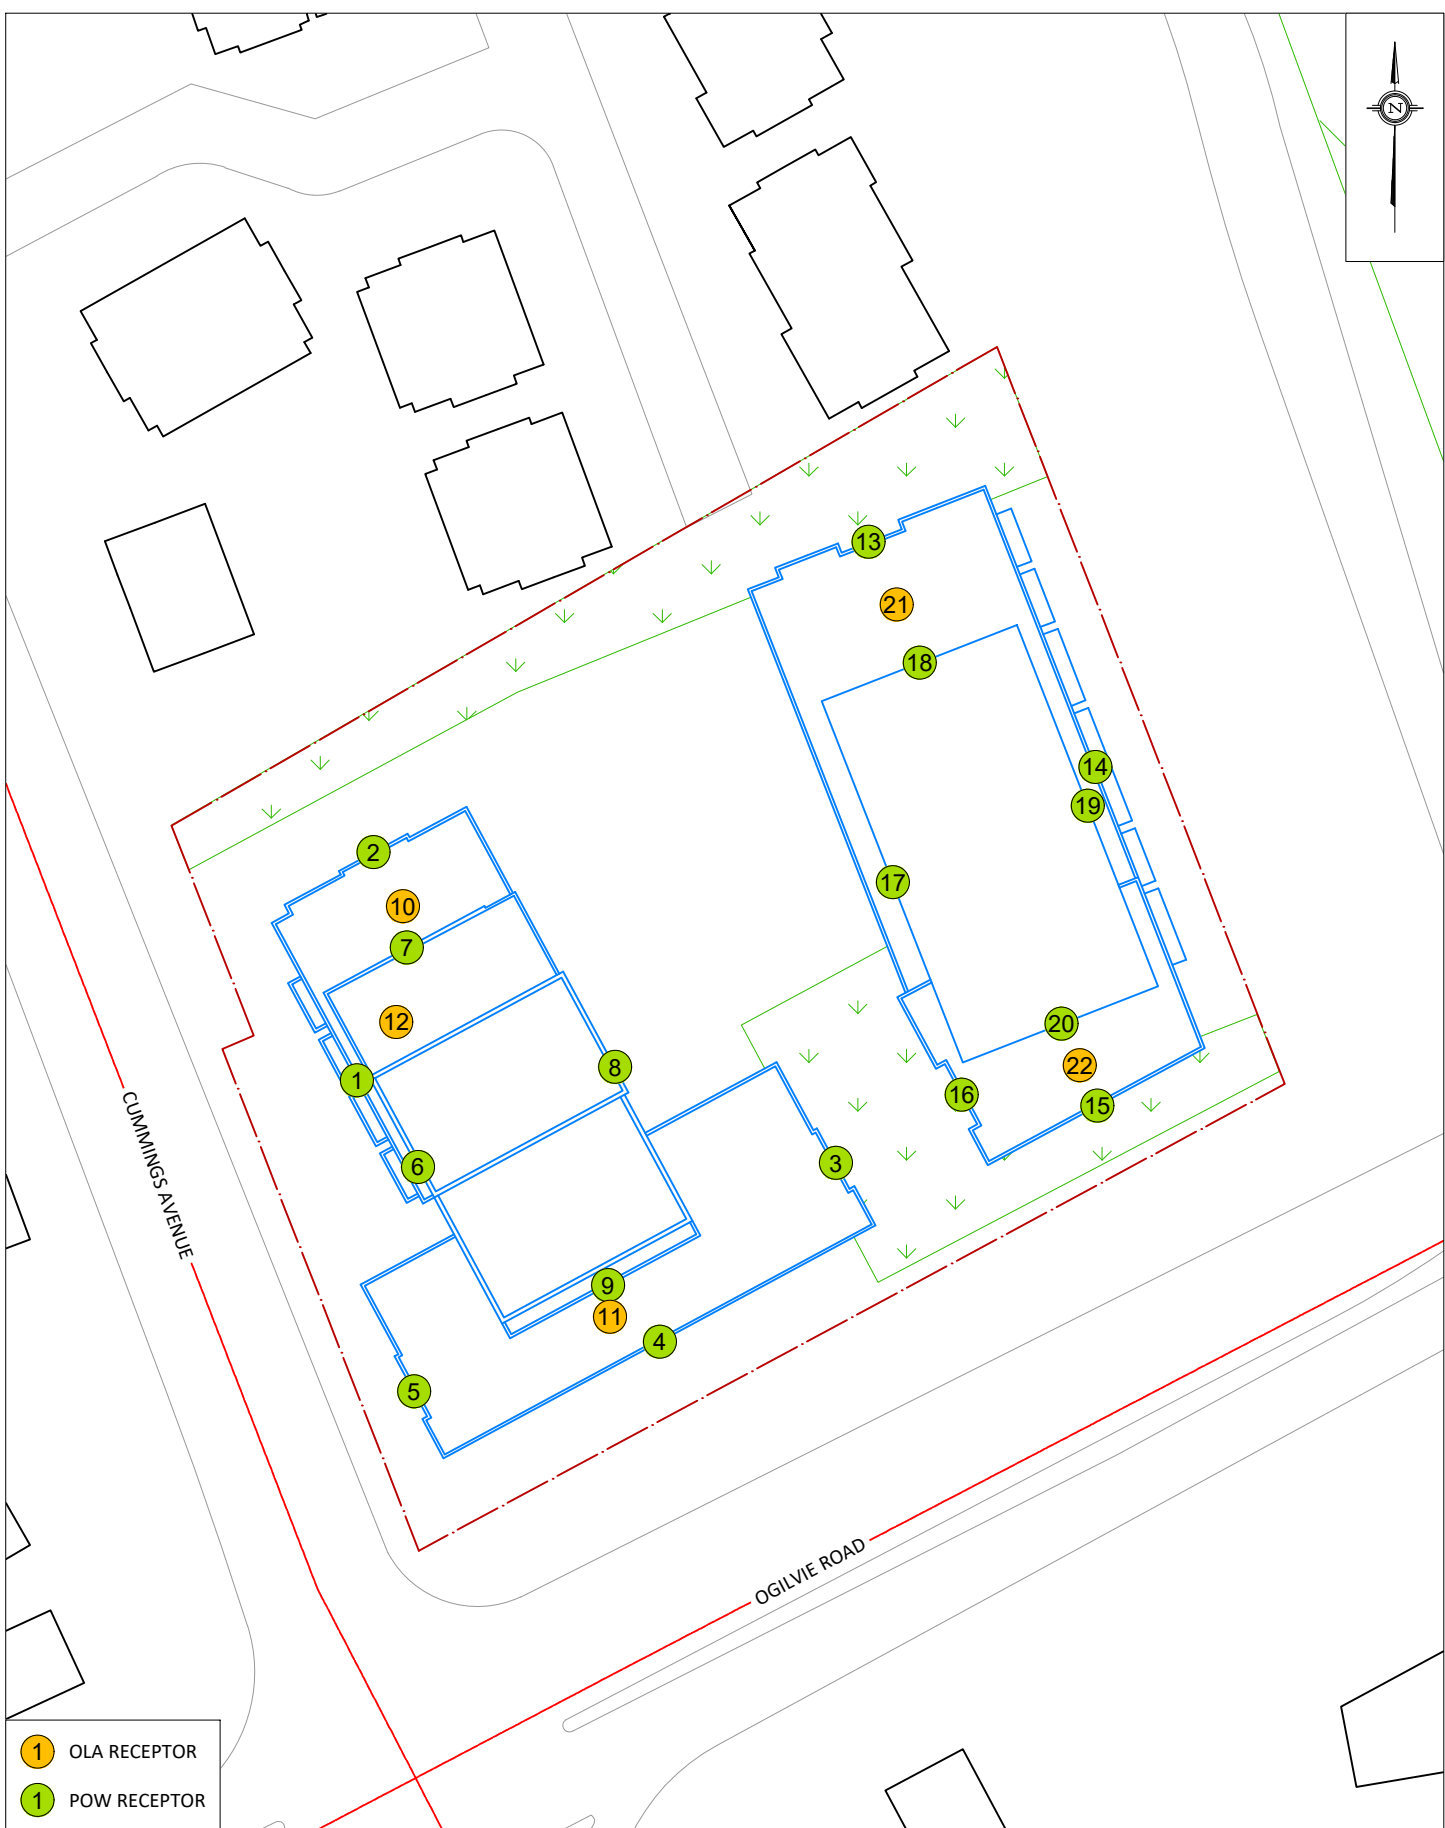

- 1 OLA RECEPTOR
- 1 POW RECEPTOR

PROJECT	1137 & 1151 OGILVIE ROAD, OTTAWA TRANSPORT NOISE FEASIBILITY ASSESSMENT	DESCRIPTION
SCALE	1:750 (SCALE)	DRAWING NO. 24-126-FIG2
DATE	MARCH 5, 2025	DRAWN BY B.P.

FIGURE 2:  
RECEPTOR LOCATIONS






- 1 OLA RECEPTOR
- 1 POW RECEPTOR

<b>GRADIENTWIND</b> ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT	1137 & 1151 OGILVIE ROAD, OTTAWA TRANSPORT NOISE FEASIBILITY ASSESSMENT	DESCRIPTION
	SCALE	1:1000 (SCALE)	DRAWING NO. 24-126-FIG3
	DATE	MARCH 5, 2025	DRAWN BY B.P.

FIGURE 3:  
STAMSON 5.04 INPUT DATA



 BEDROOM/LIVING ROOM/RETAIL WINDOWS: STC 33/33/33

PROJECT	1137 & 1151 OGILVIE ROAD, OTTAWA TRANSPORT NOISE FEASIBILITY ASSESSMENT	
SCALE	1:750 (SCALE)	DRAWING NO. 24-126-FIG4
DATE	MARCH 5, 2025	DRAWN BY B.P.

# GRADIENTWIND

ENGINEERS & SCIENTISTS



## APPENDIX A

### STAMSON 5.04 – INPUT AND OUTPUT DATA

# GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0                      NORMAL REPORT                      Date: 05-03-2025 13:32:17  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: R15.te                      Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: Ogilvie (day/night)

-----  
Car traffic volume : 28336/2464    veh/TimePeriod    \*  
Medium truck volume : 2254/196    veh/TimePeriod    \*  
Heavy truck volume : 1610/140    veh/TimePeriod    \*  
Posted speed limit : 60 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Ogilvie (day/night)

-----  
Angle1 Angle2 : -90.00 deg 90.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 2 (Reflective ground surface)  
Receiver source distance : 28.00 / 28.00 m  
Receiver height : 21.00 / 21.00 m  
Topography : 1 (Flat/gentle slope; no barrier)  
Reference angle : 0.00

Road data, segment # 2: Cummings 1 (day/night)

-----  
Car traffic volume : 9715/845    veh/TimePeriod    \*  
Medium truck volume : 773/67    veh/TimePeriod    \*  
Heavy truck volume : 552/48    veh/TimePeriod    \*  
Posted speed limit : 50 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 12000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00



# GRADIENTWIND

ENGINEERS & SCIENTISTS

Data for Segment # 2: Cummings 1 (day/night)

```

-----
Angle1   Angle2           : -17.00 deg   0.00 deg
Wood depth           :           0   (No woods.)
No of house rows     :           0 / 0
Surface              :           2   (Reflective ground surface)
Receiver source distance : 90.00 / 90.00 m
Receiver height      : 21.00 / 21.00 m
Topography           :           1   (Flat/gentle slope; no barrier)
Reference angle      :           0.00
  
```

Road data, segment # 3: Cummings 2 (day/night)

```

-----
Car traffic volume   : 12144/1056 veh/TimePeriod *
Medium truck volume  : 966/84   veh/TimePeriod *
Heavy truck volume   : 690/60   veh/TimePeriod *
Posted speed limit   : 50 km/h
Road gradient        : 0 %
Road pavement        : 1 (Typical asphalt or concrete)
  
```

\* Refers to calculated road volumes based on the following input:

```

24 hr Traffic Volume (AADT or SADT): 15000
Percentage of Annual Growth         : 0.00
Number of Years of Growth           : 0.00
Medium Truck % of Total Volume      : 7.00
Heavy Truck % of Total Volume       : 5.00
Day (16 hrs) % of Total Volume      : 92.00
  
```

Data for Segment # 3: Cummings 2 (day/night)

```

-----
Angle1   Angle2           : -90.00 deg  -17.00 deg
Wood depth           :           0   (No woods.)
No of house rows     :           0 / 0
Surface              :           2   (Reflective ground surface)
Receiver source distance : 90.00 / 90.00 m
Receiver height      : 21.00 / 21.00 m
Topography           :           1   (Flat/gentle slope; no barrier)
Reference angle      :           0.00
  
```

Results segment # 1: Ogilvie (day)

Source height = 1.50 m

ROAD (0.00 + 70.97 + 0.00) = 70.97 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	73.68	0.00	-2.71	0.00	0.00	0.00	0.00	70.97

Segment Leq : 70.97 dBA



# GRADIENTWIND

ENGINEERS & SCIENTISTS

Results segment # 2: Cummings 1 (day)

Source height = 1.50 m

ROAD (0.00 + 49.48 + 0.00) = 49.48 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-17	0	0.00	67.51	0.00	-7.78	-10.25	0.00	0.00	0.00	49.48

Segment Leq : 49.48 dBA

Results segment # 3: Cummings 2 (day)

Source height = 1.50 m

ROAD (0.00 + 56.78 + 0.00) = 56.78 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	-17	0.00	68.48	0.00	-7.78	-3.92	0.00	0.00	0.00	56.78

Segment Leq : 56.78 dBA

Total Leq All Segments: 71.16 dBA

Results segment # 1: Ogilvie (night)

Source height = 1.50 m

ROAD (0.00 + 63.37 + 0.00) = 63.37 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	90	0.00	66.08	0.00	-2.71	0.00	0.00	0.00	0.00	63.37

Segment Leq : 63.37 dBA

Results segment # 2: Cummings 1 (night)

Source height = 1.50 m

ROAD (0.00 + 41.88 + 0.00) = 41.88 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-17	0	0.00	59.91	0.00	-7.78	-10.25	0.00	0.00	0.00	41.88

Segment Leq : 41.88 dBA



# GRADIENTWIND

ENGINEERS & SCIENTISTS

Results segment # 3: Cummings 2 (night)

-----  
Source height = 1.50 m

ROAD (0.00 + 49.18 + 0.00) = 49.18 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
-90	-17	0.00	60.88	0.00	-7.78	-3.92	0.00	0.00	0.00	49.18

-----

Segment Leq : 49.18 dBA

Total Leq All Segments: 63.46 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 71.16  
(NIGHT): 63.46



# GRADIENTWIND

ENGINEERS & SCIENTISTS

STAMSON 5.0                      NORMAL REPORT                      Date: 05-03-2025 13:42:14  
MINISTRY OF ENVIRONMENT AND ENERGY / NOISE ASSESSMENT

Filename: R16.te                      Time Period: Day/Night 16/8 hours  
Description:

Road data, segment # 1: Ogilvie (day/night)

-----  
Car traffic volume : 28336/2464 veh/TimePeriod \*  
Medium truck volume : 2254/196 veh/TimePeriod \*  
Heavy truck volume : 1610/140 veh/TimePeriod \*  
Posted speed limit : 60 km/h  
Road gradient : 0 %  
Road pavement : 1 (Typical asphalt or concrete)

\* Refers to calculated road volumes based on the following input:

24 hr Traffic Volume (AADT or SADT): 35000  
Percentage of Annual Growth : 0.00  
Number of Years of Growth : 0.00  
Medium Truck % of Total Volume : 7.00  
Heavy Truck % of Total Volume : 5.00  
Day (16 hrs) % of Total Volume : 92.00

Data for Segment # 1: Ogilvie (day/night)

-----  
Angle1 Angle2 : 16.00 deg 61.00 deg  
Wood depth : 0 (No woods.)  
No of house rows : 0 / 0  
Surface : 2 (Reflective ground surface)  
Receiver source distance : 35.00 / 35.00 m  
Receiver height : 21.00 / 21.00 m  
Topography : 1 (Flat/gentle slope; no barrier)  
Reference angle : 0.00

Results segment # 1: Ogilvie (day)

-----  
Source height = 1.50 m

ROAD (0.00 + 63.98 + 0.00) = 63.98 dBA  
Angle1 Angle2 Alpha RefLeq P.Adj D.Adj F.Adj W.Adj H.Adj B.Adj SubLeq  
-----  
16 61 0.00 73.68 0.00 -3.68 -6.02 0.00 0.00 0.00 63.98  
-----

Segment Leq : 63.98 dBA

Total Leq All Segments: 63.98 dBA





# GRADIENTWIND

ENGINEERS & SCIENTISTS

Results segment # 1: Ogilvie (night)

-----  
Source height = 1.50 m

ROAD (0.00 + 56.38 + 0.00) = 56.38 dBA

Angle1	Angle2	Alpha	RefLeq	P.Adj	D.Adj	F.Adj	W.Adj	H.Adj	B.Adj	SubLeq
16	61	0.00	66.08	0.00	-3.68	-6.02	0.00	0.00	0.00	56.38

-----

Segment Leq : 56.38 dBA

Total Leq All Segments: 56.38 dBA

TOTAL Leq FROM ALL SOURCES (DAY): 63.98  
(NIGHT): 56.38

