

## Engineering

Land/Site  
Development

Municipal  
Infrastructure

Environmental/  
Water Resources

Traffic/  
Transportation

Recreational

## Planning

Land/Site  
Development

Planning Application  
Management

Municipal Planning

Urban Design

Expert Witness  
(OLT)

Wireless Industry

## Landscape Architecture

Streetscapes &  
Public Amenities

Open Space, Parks &  
Recreation

Community &  
Residential

Commercial &  
Institutional

Environmental  
Restoration

# 2175 Prince of Wales Drive Ottawa, ON

## Serviceability Report

**2175 PRINCE OF WALES DRIVE  
OTTAWA, ONTARIO**

**SERVICEABILITY REPORT**

Prepared By:

**NOVATECH**

Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario  
K2M 1P6

September 2015

Revised: July 17, 2024

Revised: March 13, 2026

Ref: R-2015-035

Novatech File: 117074 (formerly 107005)

March 13, 2026

City of Ottawa  
Planning and Growth Management Department  
4<sup>th</sup> Floor  
110 Laurier Avenue West  
Ottawa, Ontario  
K1P 1J1

**Attention: Kimberley Baldwin, Planner III**

Dear Ms. Baldwin:

**Re: 2175 Prince of Wales Drive  
Serviceability Report  
Our File No.: 117074 (formerly 107005)**

---

Please find enclosed the Serviceability Report for the above noted property. This report has been revised per City comments and is submitted in support of a Zoning Amendment Application for the property at 2175 Prince of Wales Drive.

If you have any questions, please contact the undersigned.

Sincerely,

**NOVATECH**



Cara Ruddle, P.Eng.  
Senior Project Manager  
Land Development

cc:

## TABLE OF CONTENTS

1.0.	INTRODUCTION .....	1
2.0.	EXISTING AND PROPOSED DEVELOPMENT.....	1
3.0.	WATER SERVICING .....	1
4.0.	SANITARY SERVICING .....	3
5.0.	STORM SERVICING .....	3
6.0.	EROSION AND SEDIMENT CONTROL MEASURES .....	4
7.0.	CONCLUSIONS AND RECOMMENDATIONS .....	5

### List of Figures

- Figure 1 Key Plan
- Figure 2 Existing Conditions
- Figure 3 Conceptual Servicing Plan
- Figure 4 Hydrant Coverage Plan
- Figure 5 Development Drainage Plan (Appendix C)

### List of Appendices

- Appendix A Water Servicing Information
- Appendix B Sanitary Servicing Information
- Appendix C Stormwater Management Calculations

## 1.0. INTRODUCTION

Novatech has been retained by Zena Investment Corporation to prepare a Serviceability Report in support of a Zoning Amendment Application. The site is located at 2175 Prince of Wales Drive within the City of Ottawa. **Figure 1** is a Key Plan showing the site location.

## 2.0. EXISTING AND PROPOSED DEVELOPMENT

The property is approximately 3.22 hectares in size. The property is currently undeveloped vacant land with 2 existing accesses from Prince of Wales Drive and 2 existing accesses from Waterbend Lane. The topography of the site is relatively flat with a gentle slope towards the east side of the site. The slope increases along the east side of the property adjacent to the Rideau River, it also increases as it drains to an existing watercourse on the north side of the property outletting to the Rideau River. The site is bounded by West Hunt Club Rd and the existing watercourse to the north, Rideau River to the east, residences fronting on Waterbend Lane to the south, and Prince of Wales Drive to the West. **Figure 2** shows the existing conditions.

The proposed development is not defined at this time. It is anticipated that commercial or light industrial use buildings will be constructed. There are a number of setbacks or constraints which are outlined in the Environmental Impact Study for proposed development at 2175 Prince of Wales Drive, Nepean, Ontario, Prepared by Kilgour & Associates Ltd., dated October 17, 2023, Project #Myers 1534. Figure 5 Developable Land and Setback Requirements On-site from the EIS Report shows the various setbacks and the developable land for the subject site and is included for reference. The area of the developable land is 1.94 hectares and this area will be used in the calculations in this report since the remainder of the property will remain untouched.

The purpose of this report is to demonstrate that commercial and/or light industrial uses can be serviced with the existing Municipal infrastructure surrounding the subject site.


## 3.0. WATER SERVICING

There is an existing 400mm diameter watermain within the Prince of Wales right-of-way and a 150mm diameter watermain in Waterbend Lane. A portion of the City watermain mapping is provided in Appendix A for reference.

A water service connection could be made to either of the two existing watermains noted above to service the subject property. Calculations have been prepared for both industrial and commercial uses. Preliminary water demands and fire flows have been calculated in the following **Table 3.0**. Refer to **Figure 3** Conceptual Servicing Plan for the existing watermain information and proposed service locations.

**Table 3.0 Water Demand Summary**

Use	Ave. Daily Demand (L/s)	Max. Daily Demand (L/s)	Peak Hour Demand (L/s)	Fire Flow (L/s)
<b>Industrial Use</b>	2.05	3.08	5.54	250
<b>Commercial Use</b>	1.04	1.56	2.81	217

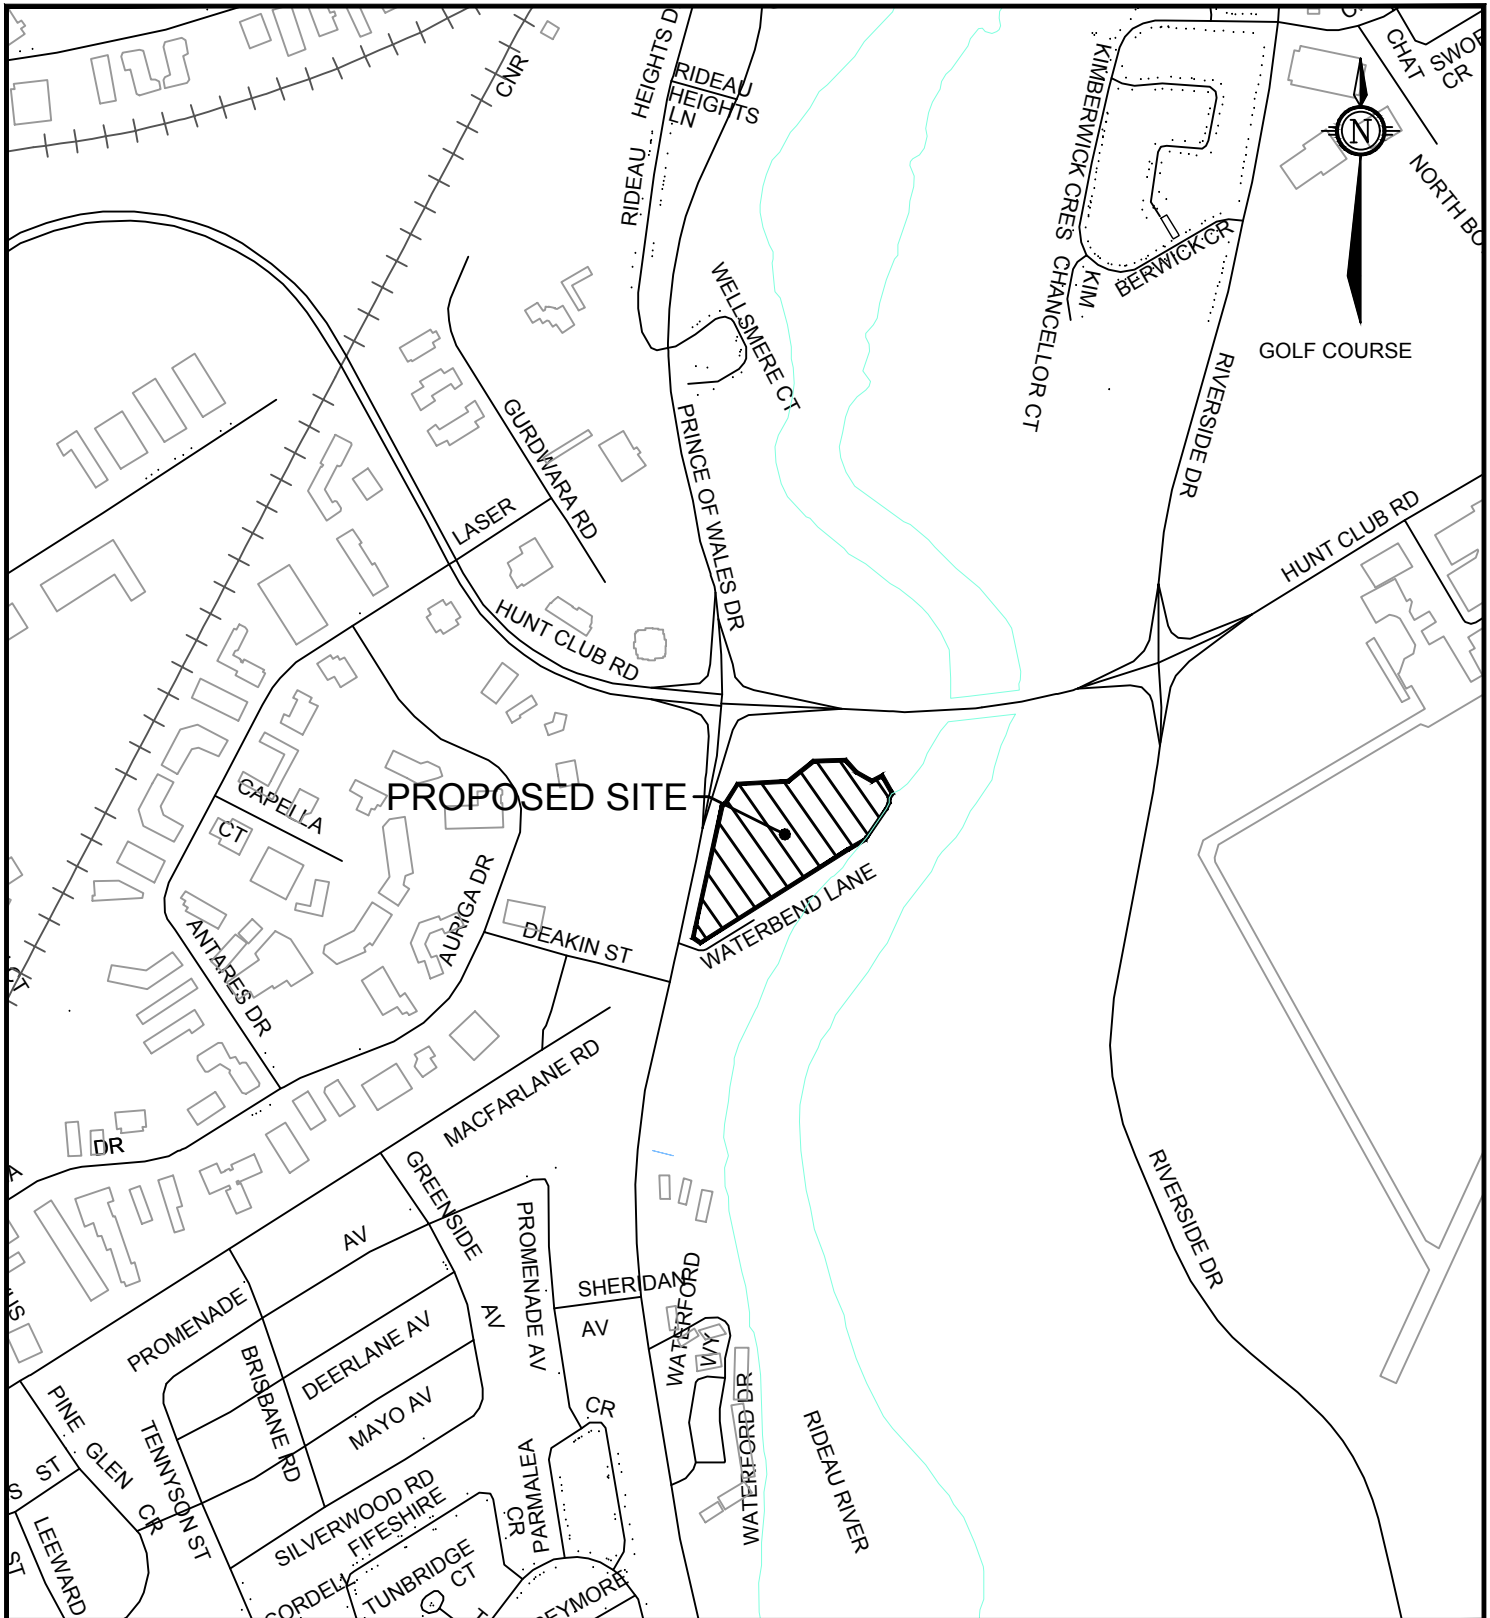

M:\2017\117074\CAD\Design\Report\Figures\117074-KP.dwg, KP, Jul 12, 2024 - 1:53pm, madeoiti



Engineers, Planners & Landscape Architects  
 Suite 200, 240 Michael Cowpland Drive  
 Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
 Facsimile (613) 254-5867  
 Website www.novatech-eng.com

2175 PRINCE OF WALES  
 DRIVE

KEY PLAN

SCALE

NTS

DATE

JUL 2024

JOB

117074

FIGURE

1

M:\2017\117074\CAD\Design\Report\Figures\117074-FIG2.dwg, EXCOND, Jul 12, 2024 - 2:26pm, madeoti



PROPOSED SITE

HUNT CLUB DRIVE

PRINCE OF WALES

WATER BEND LANE

AURIGA DRIVE

DEAKEN STREET

MCFARLAND ROAD

RIVERSIDE DRIVE



**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6


Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

2175 PRINCE OF WALES  
DRIVE

EXISTING CONDITIONS

SCALE 1 : 2500'

DATE JUL 2024 JOB 117074 FIGURE 2

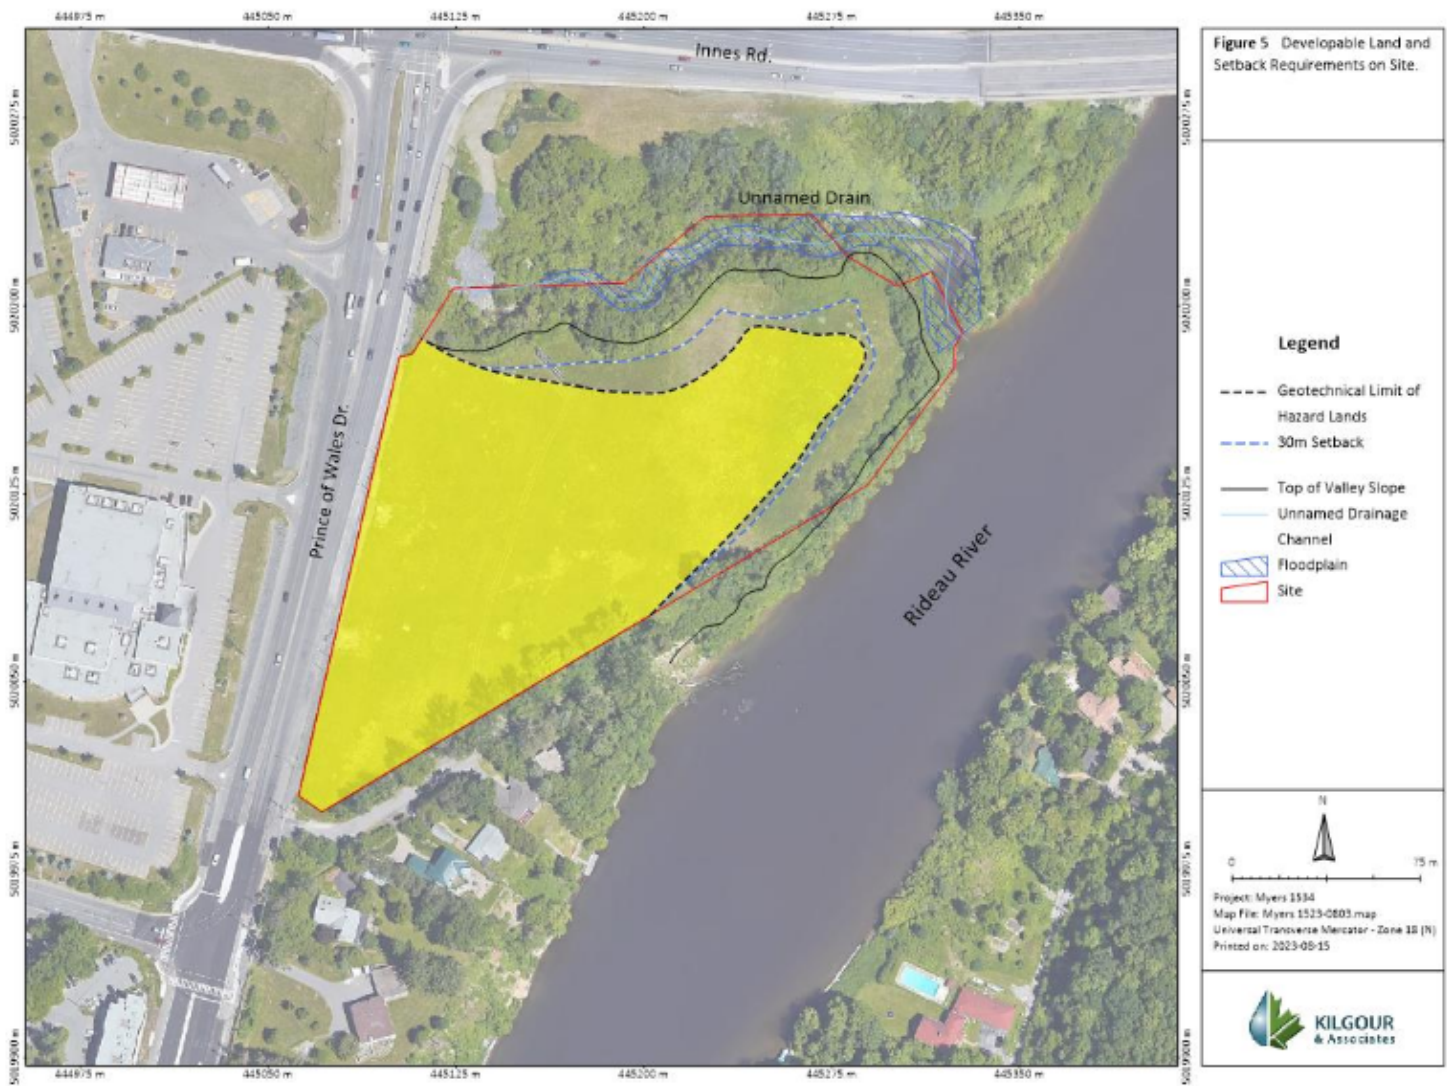


**Figure 5 Developable Land and Setback Requirements on Site**

REFERENCE: Environmental Impact Study for proposed development at 2175 Prince of Wales Drive, Nepean, Ontario

BY: KILGOUR & ASSOCIATES LTD.

DATED: 2023-10-17

M:\2017\117074\CAD\Design\Figures\Report Figures\117074-FIG4.dwg, GS, Jul 12, 2024 - 2:38pm, madeoft

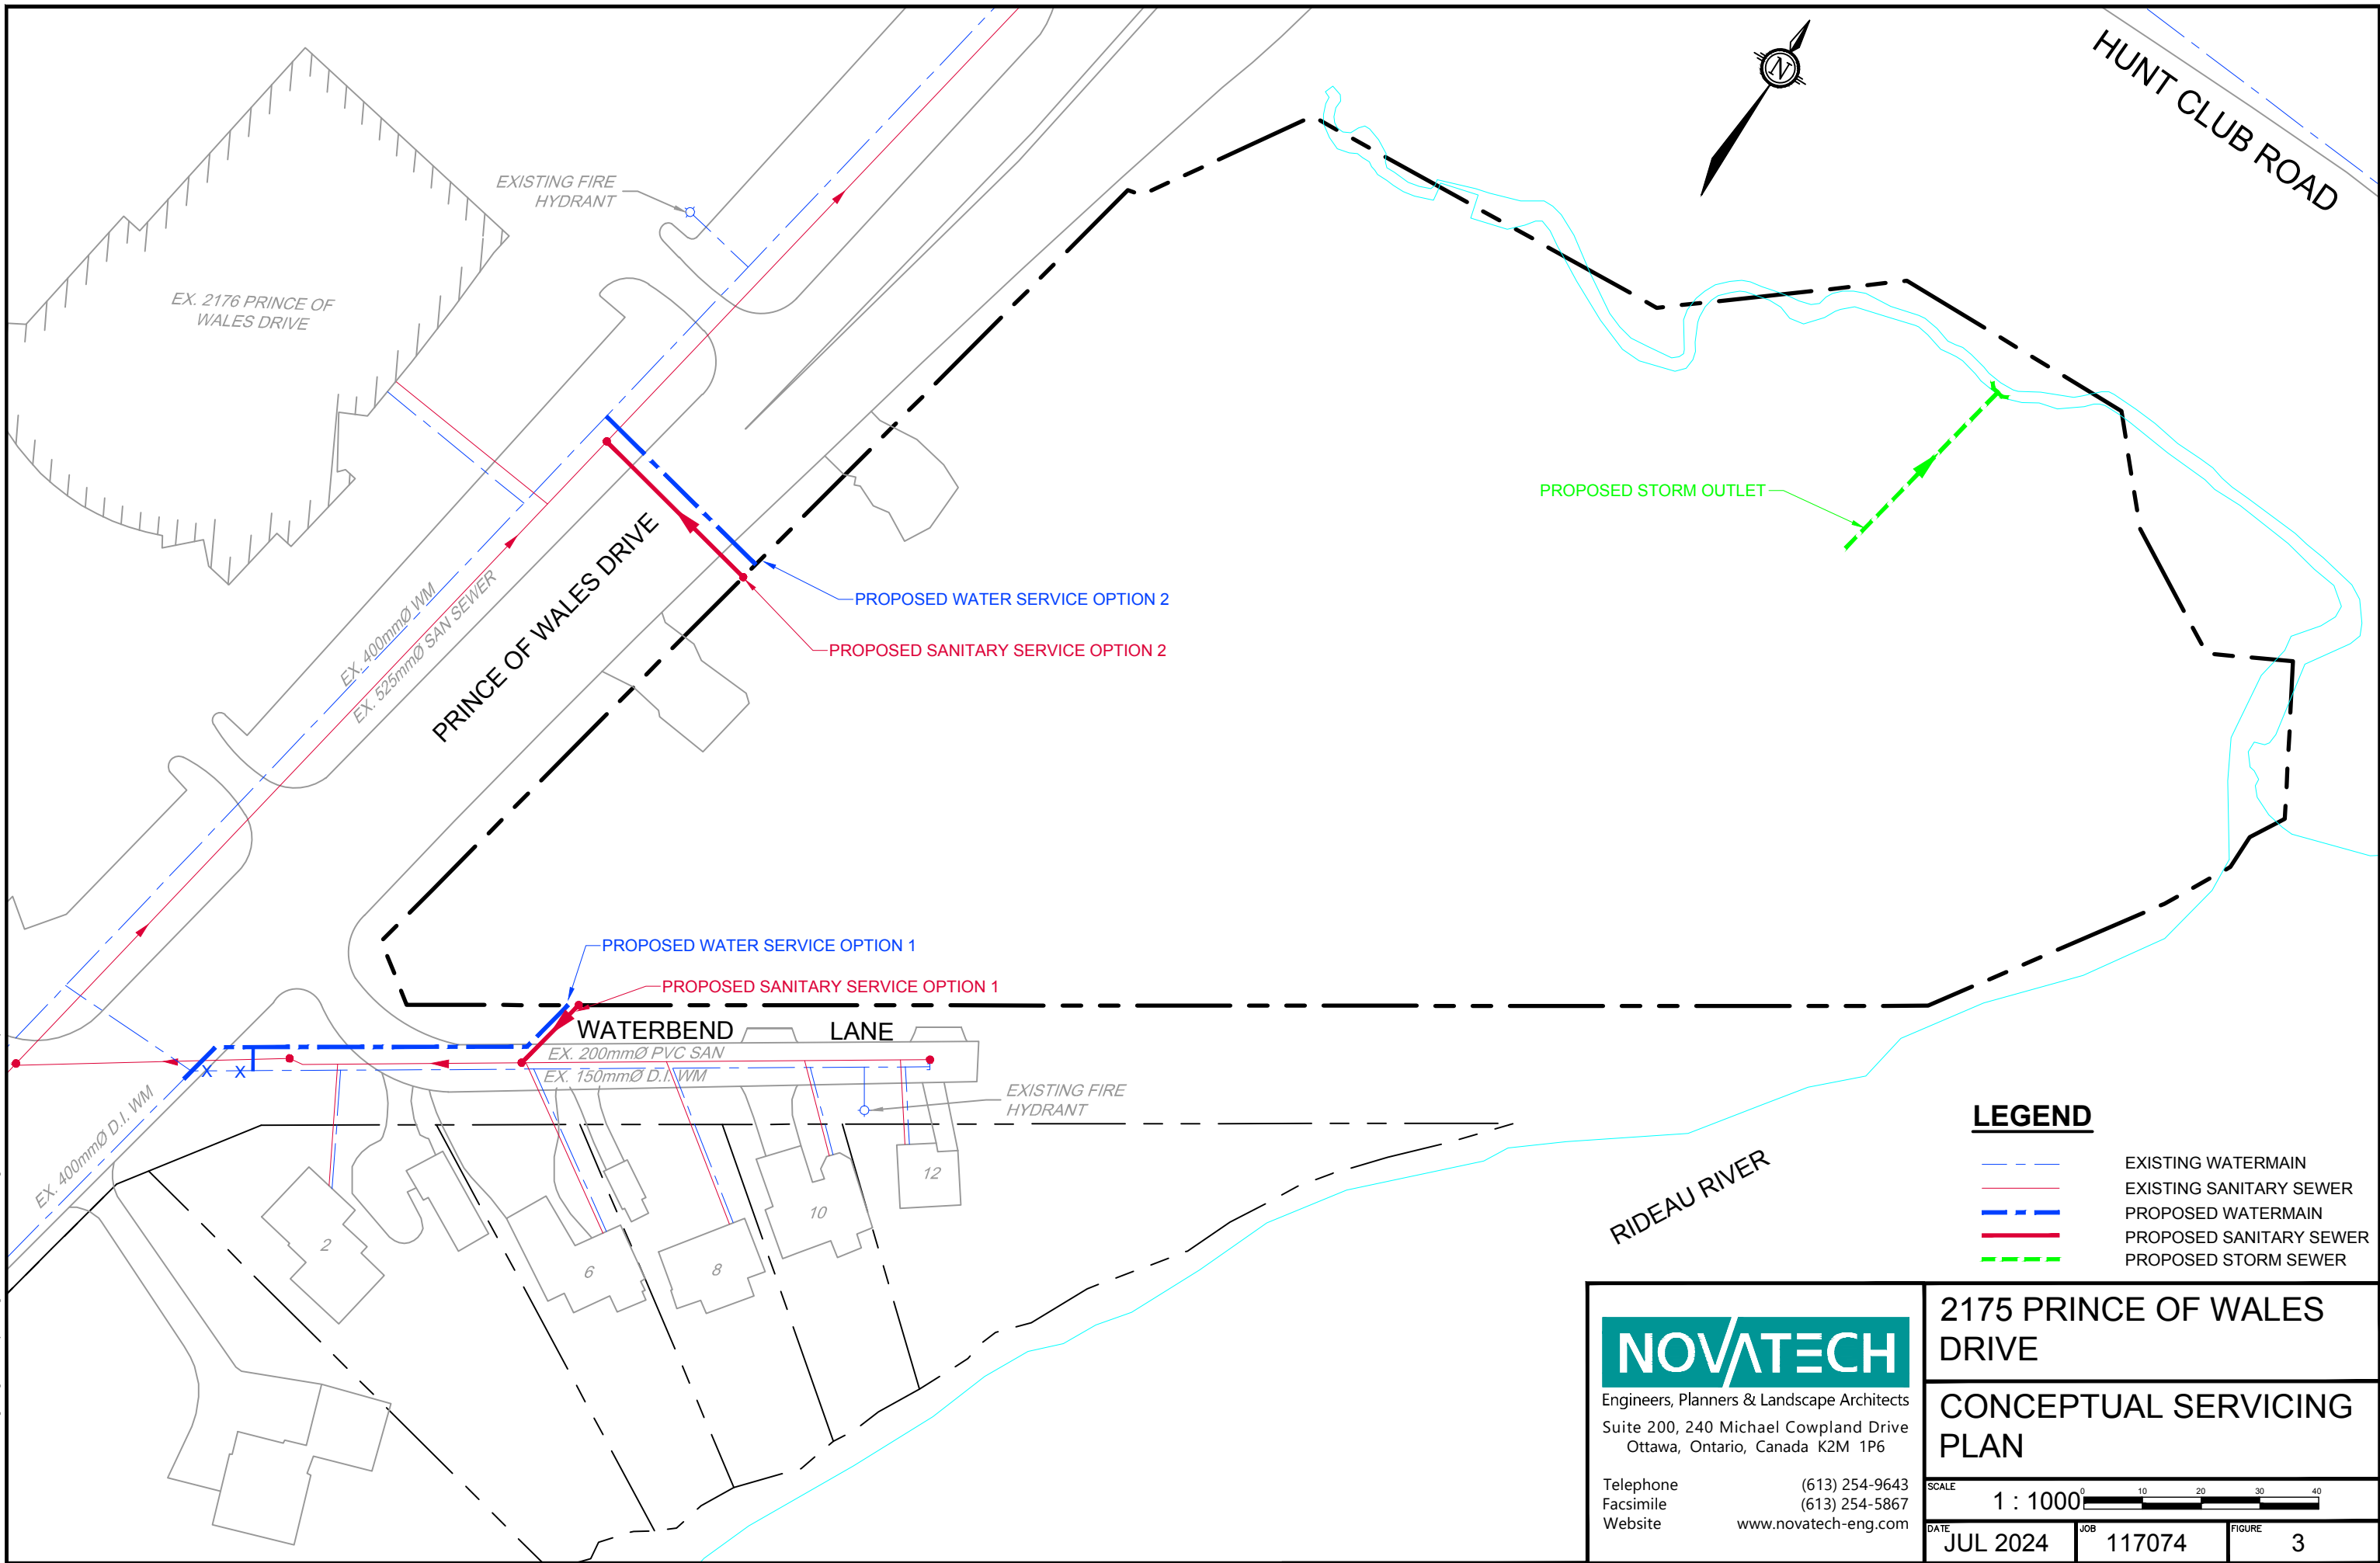

**LEGEND**

- EXISTING WATERMAIN
- EXISTING SANITARY SEWER
- PROPOSED WATERMAIN
- PROPOSED SANITARY SEWER
- PROPOSED STORM SEWER



Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

2175 PRINCE OF WALES DRIVE

**CONCEPTUAL SERVICING PLAN**

SCALE 1 : 1000

DATE JUL 2024 JOB 117074 FIGURE 3

The maximum water demands were provided to the City and the boundary conditions found in **Table 3.1** below were provided for both the 150mm watermain in Waterbend Lane and the 400mm watermain in Prince of Wales Drive. Correspondence is provided in **Appendix A** for reference.

**Table 3.1 Boundary Conditions**

Criteria	Head (m)
<b>Connection 1 to Existing 150mm Watermain in Waterbend Lane.</b>	
Minimum HGL	124.2
Maximum HGL	132.0
Max Day + Fire Flow (89L/s)	101.1m
Max Day + Fire Flow (91L/s)	101.1m
<b>Connection 2 to Existing 400mm Watermain in Prince of Wales Dr.</b>	
Minimum HGL	124.2m
Maximum HGL	132.0m
Max Day + Fire Flow (250L/s)	126.9m
Max Day + Fire Flow (217L/s)	126.5m

Preliminary calculations were performed to establish the approximate limits of the design operating pressures. Refer to **Appendix A** for calculation details. A summary of the water results is presented in **Table 3.2** below.

**Table 3.2 Water Analysis Results Summary**

Condition	Street	Demand (L/s)	Min/Max Allowable Operating Pressures (psi)	Limits of Design Operating Pressures (psi)
High Pressure	Waterbend	2.05	80psi (Max)	63.9
	Prince of Wales			63.9
Maximum Daily Demand and <i>Fire Flow</i> Industrial / Commercial	Waterbend	89 / 91	20psi (Min)	20.0 / 20.0
	Prince of Wales	250 / 217		56.7 / 56.1
Peak Hour	Waterbend	5.54	40psi (Min)	52.9
	Prince of Wales			52.9

Based on the boundary conditions provided by the City, the watermain along Prince of Wales could provide adequate water supply for domestic water and fire flow demands while the watermain along Waterbend Lane could only provide adequate water supply for domestic water demand. If a connection is made to the existing watermain along Waterbend Lane, a dry hydrant or a fire pump and an onsite fire suppression water storage tank will be needed to meet the fire flow pressure demand. There is also the option to upsize a portion of the existing watermain along Waterbend Lane to a 200mm or 300mm diameter watermain to service the property.

Additionally, a multi-hydrate approach to firefighting has been reviewed to provide fire flow to the proposed development. There are currently 2 Class AA (blue bonnet) municipal fire hydrants within 150m of the site. And private hydrant will be required to service the development. Refer to **Figure 4** Hydrant Coverage Plan in **Appendix A** for the hydrant locations and assumed distances from site. This would be reviewed in more detail when a defined development concept has been prepared during the Site Plan Approval process.

The site is serviceable from the existing municipal watermain system.

#### 4.0. SANITARY SERVICING

There is an existing 525mm diameter sanitary sewer within the Prince of Wales right-of-way and an existing 200mm diameter sanitary sewer within the Waterbend Lane right-of-way. A portion of the City sewer mapping is included in Appendix B for reference.

Flows for the proposed development have been estimated for both industrial and commercial uses and are 11.0 L/s and 2.0 L/s respectively. Sanitary flow calculations are also included in Appendix B for reference.

The subject property can be serviced with a connection to either of the two existing sanitary sewers noted above. **Figure 3** Conceptual Servicing Plan shows the two servicing options. The existing sanitary sewer along Waterbend Lane only services the 5 existing residential dwellings along this road and has excess capacity to service the subject property. This existing sewer drains into the existing 525mm diameter sanitary sewer along Prince of Wales Drive. The 525mm diameter sanitary sewer along Prince of Wales Drive is considered a collector sewer and a direct service connection will likely not be the City's preferred alternative.

The site is serviceable from the existing municipal sanitary sewer system and the recommended option is to connect to the existing sanitary sewer along Waterbend Lane.

#### 5.0. STORM SERVICING

As indicated previously the site is currently undeveloped vacant land. Stormwater currently sheet drains to the Rideau River along the east side of the property and to the existing watercourse along the north side of the property that drains into the Rideau River. The existing watercourse along the north property limit is an outlet for an existing 1650mm diameter trunk storm sewer servicing an area west of Prince of Wales Drive. A portion of the City sewer mapping is included in Appendix C for reference.

Development of the subject property would cause an increase in the existing storm runoff from the property. Therefore, stormwater management is required including both quality and quantity control. However, due to the close proximity to the Rideau River, it is recommended that storm flows be released directly from the site without quantity control. Storm flows from the site would outlet into the Rideau River well before the natural peak occurs in the river from the upstream watershed. Infiltration and LID measures could be included in the site design depending on the suitability of the existing soils and elevation of the ground water table. This would be reviewed in more detail during the site plan application process.

The site will continue to outlet to the Rideau River in post-development conditions. During detailed design, the velocity of the stormwater being released will need to be reviewed to ensure there are no negative impacts or erosive effects to the receiving watercourse. Refer to **Figure 3** Conceptual Servicing Plan for a proposed storm outlet location.

Quality control of stormwater is also required for 80% removal of total suspended solids (TSS). Quality control of stormwater can be provided through a combination of methods including an oil grit separator (OGS) unit, best management practices and low impact development techniques.

More details on these measures would be provided during the detailed design and site plan application process.

Preliminary stormwater calculations have been prepared. The pre-development release rate is calculated to be 112.4 L/s and 240.8 L/s for the 5 and 100 year storm events respectively. Post-development flows are estimated to be 477.6 L/s and 914.9 L/s for the 5 and 100 year storm events respectively. A drainage area plan and stormwater calculations are provided in **Appendix C** for reference.

The 100-year flood elevation for the Rideau River by the site is 77.05m (taken from Figure 9a in the RVCA Rideau River Flood Risk Mapping (Hogs Back to Kars)). The top of slope along the north side of the site by the watercourse is approximately 86.00m (9m from top of slope to 100 year water elevation). Therefore, it is anticipated that the proposed development will have minimal impact on the capacity of the outlet water course. The impacts of flooding and downstream erosion will be reviewed in more detail during the site plan application process and if required mitigative measures can be proposed.

During storms, in excess of the 100 year storm event, the existing overland flow route is to the Rideau River. This overland flow route would be maintained and incorporated into the detailed design of the subject property.

Therefore, the site is serviceable in terms of storm servicing and stormwater management. Once a defined development plan has been prepared, detailed stormwater calculations can be provided.

## **6.0. EROSION AND SEDIMENT CONTROL MEASURES**

Temporary erosion and sediment control measures will be implemented on-site during construction in accordance with the Best Management Practices for Erosion and Sediment Control. This includes the following temporary measures:

- Filter bags will be placed under the grates of nearby catchbasins and manholes, and will remain in place until vegetation has been established and construction is completed;
- Silt fencing will be placed along the surrounding construction limits;
- Mud mats will be installed at the site entrances;
- The contractor will be required to perform regular street sweeping and cleaning as required, to suppress dust and to provide safe and clean roadways adjacent to the construction site;

The erosion and sediment control measures will be implemented prior to construction and will remain in place during all phases of construction. Regular inspection and maintenance of the erosion control measures will be undertaken

## 7.0. CONCLUSIONS AND RECOMMENDATIONS

The conclusions of this report are as follows:

- Water servicing, including both domestic and fire protection, can be provided by connection to the existing watermain infrastructure within Prince of Wales Drive. The watermain within Waterbend Lane can provide servicing for domestic flows and some additional measures may be required for fire protection depending on the type of development.
- Sanitary servicing can be provided from the existing sanitary sewer within Waterbend Lane or Prince of Wales Drive.
- Stormwater can outlet, as per existing conditions, to the Rideau River or the existing watercourse along the north property limit.
- Stormwater management is required for the development however, quantity control is not recommended given the close proximity of the site to the Rideau River. The velocity of stormwater will be reviewed as part of the detailed design to ensure there are no negative impacts to the receiving watercourse.
- Quality control of stormwater can be provided through the installation of an oil grit separator unit prior to release of stormwater from the site.
- An overland flow route will be provided.
- Erosion and sediment control measures will be implemented during construction.

### NOVATECH

Prepared by:




Cara Ruddle, P.Eng.  
Project Manager


Reviewed by:

J. Lee Sheets, CET  
Sr. Project Manager

**APPENDIX A**  
**Watermain Information**

# 2175 Prince of Wales Drive

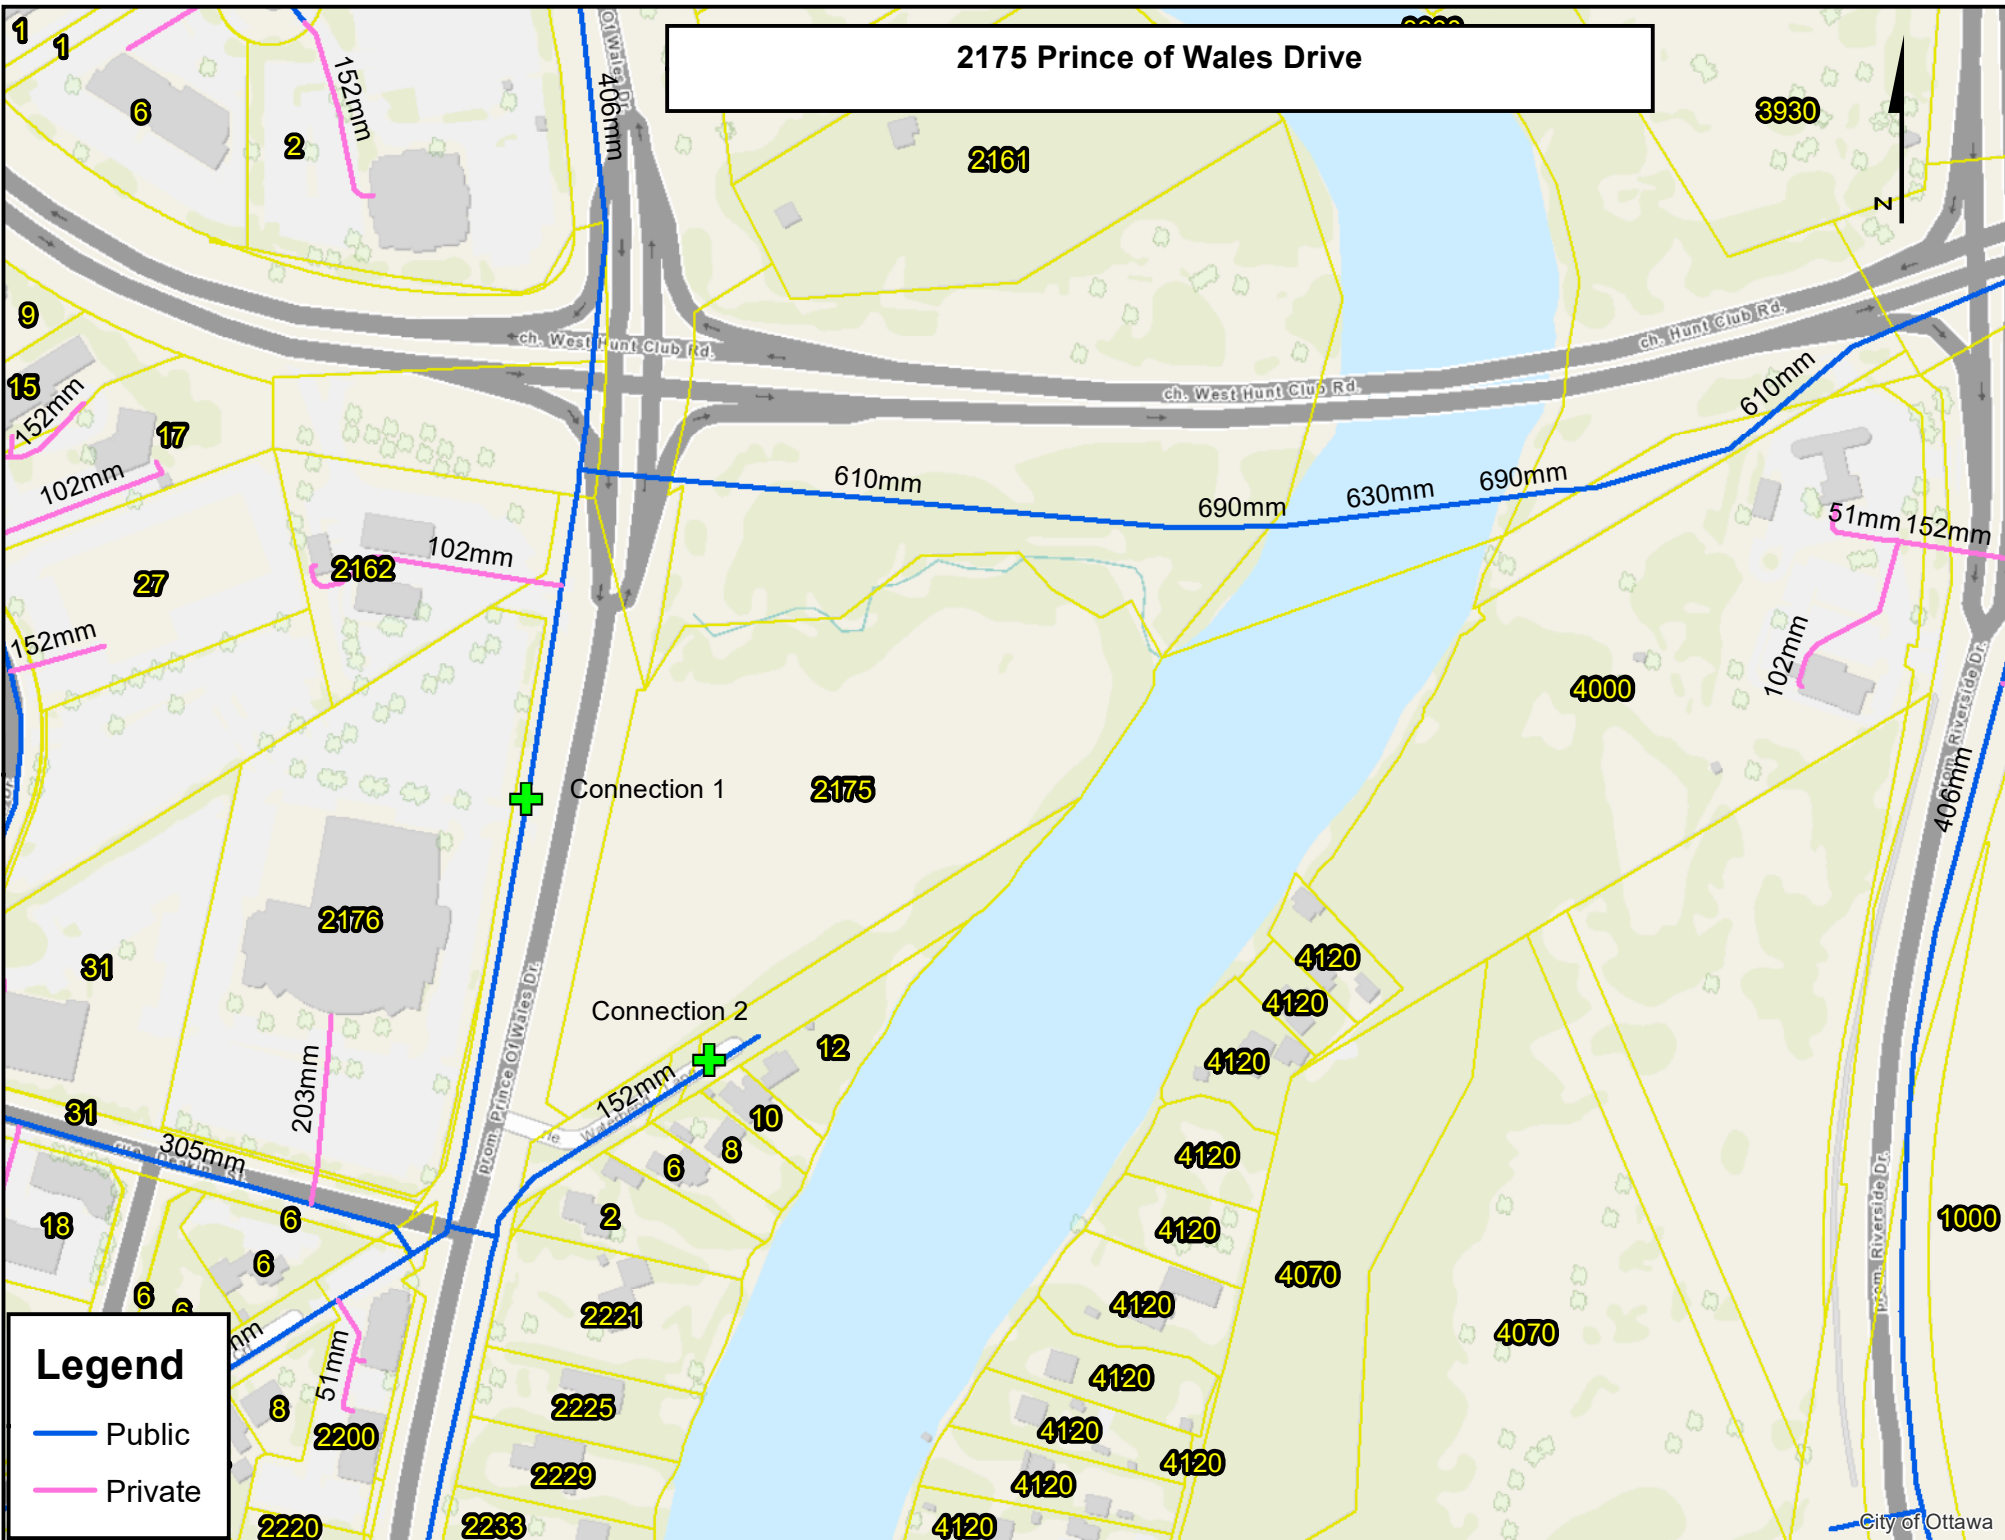

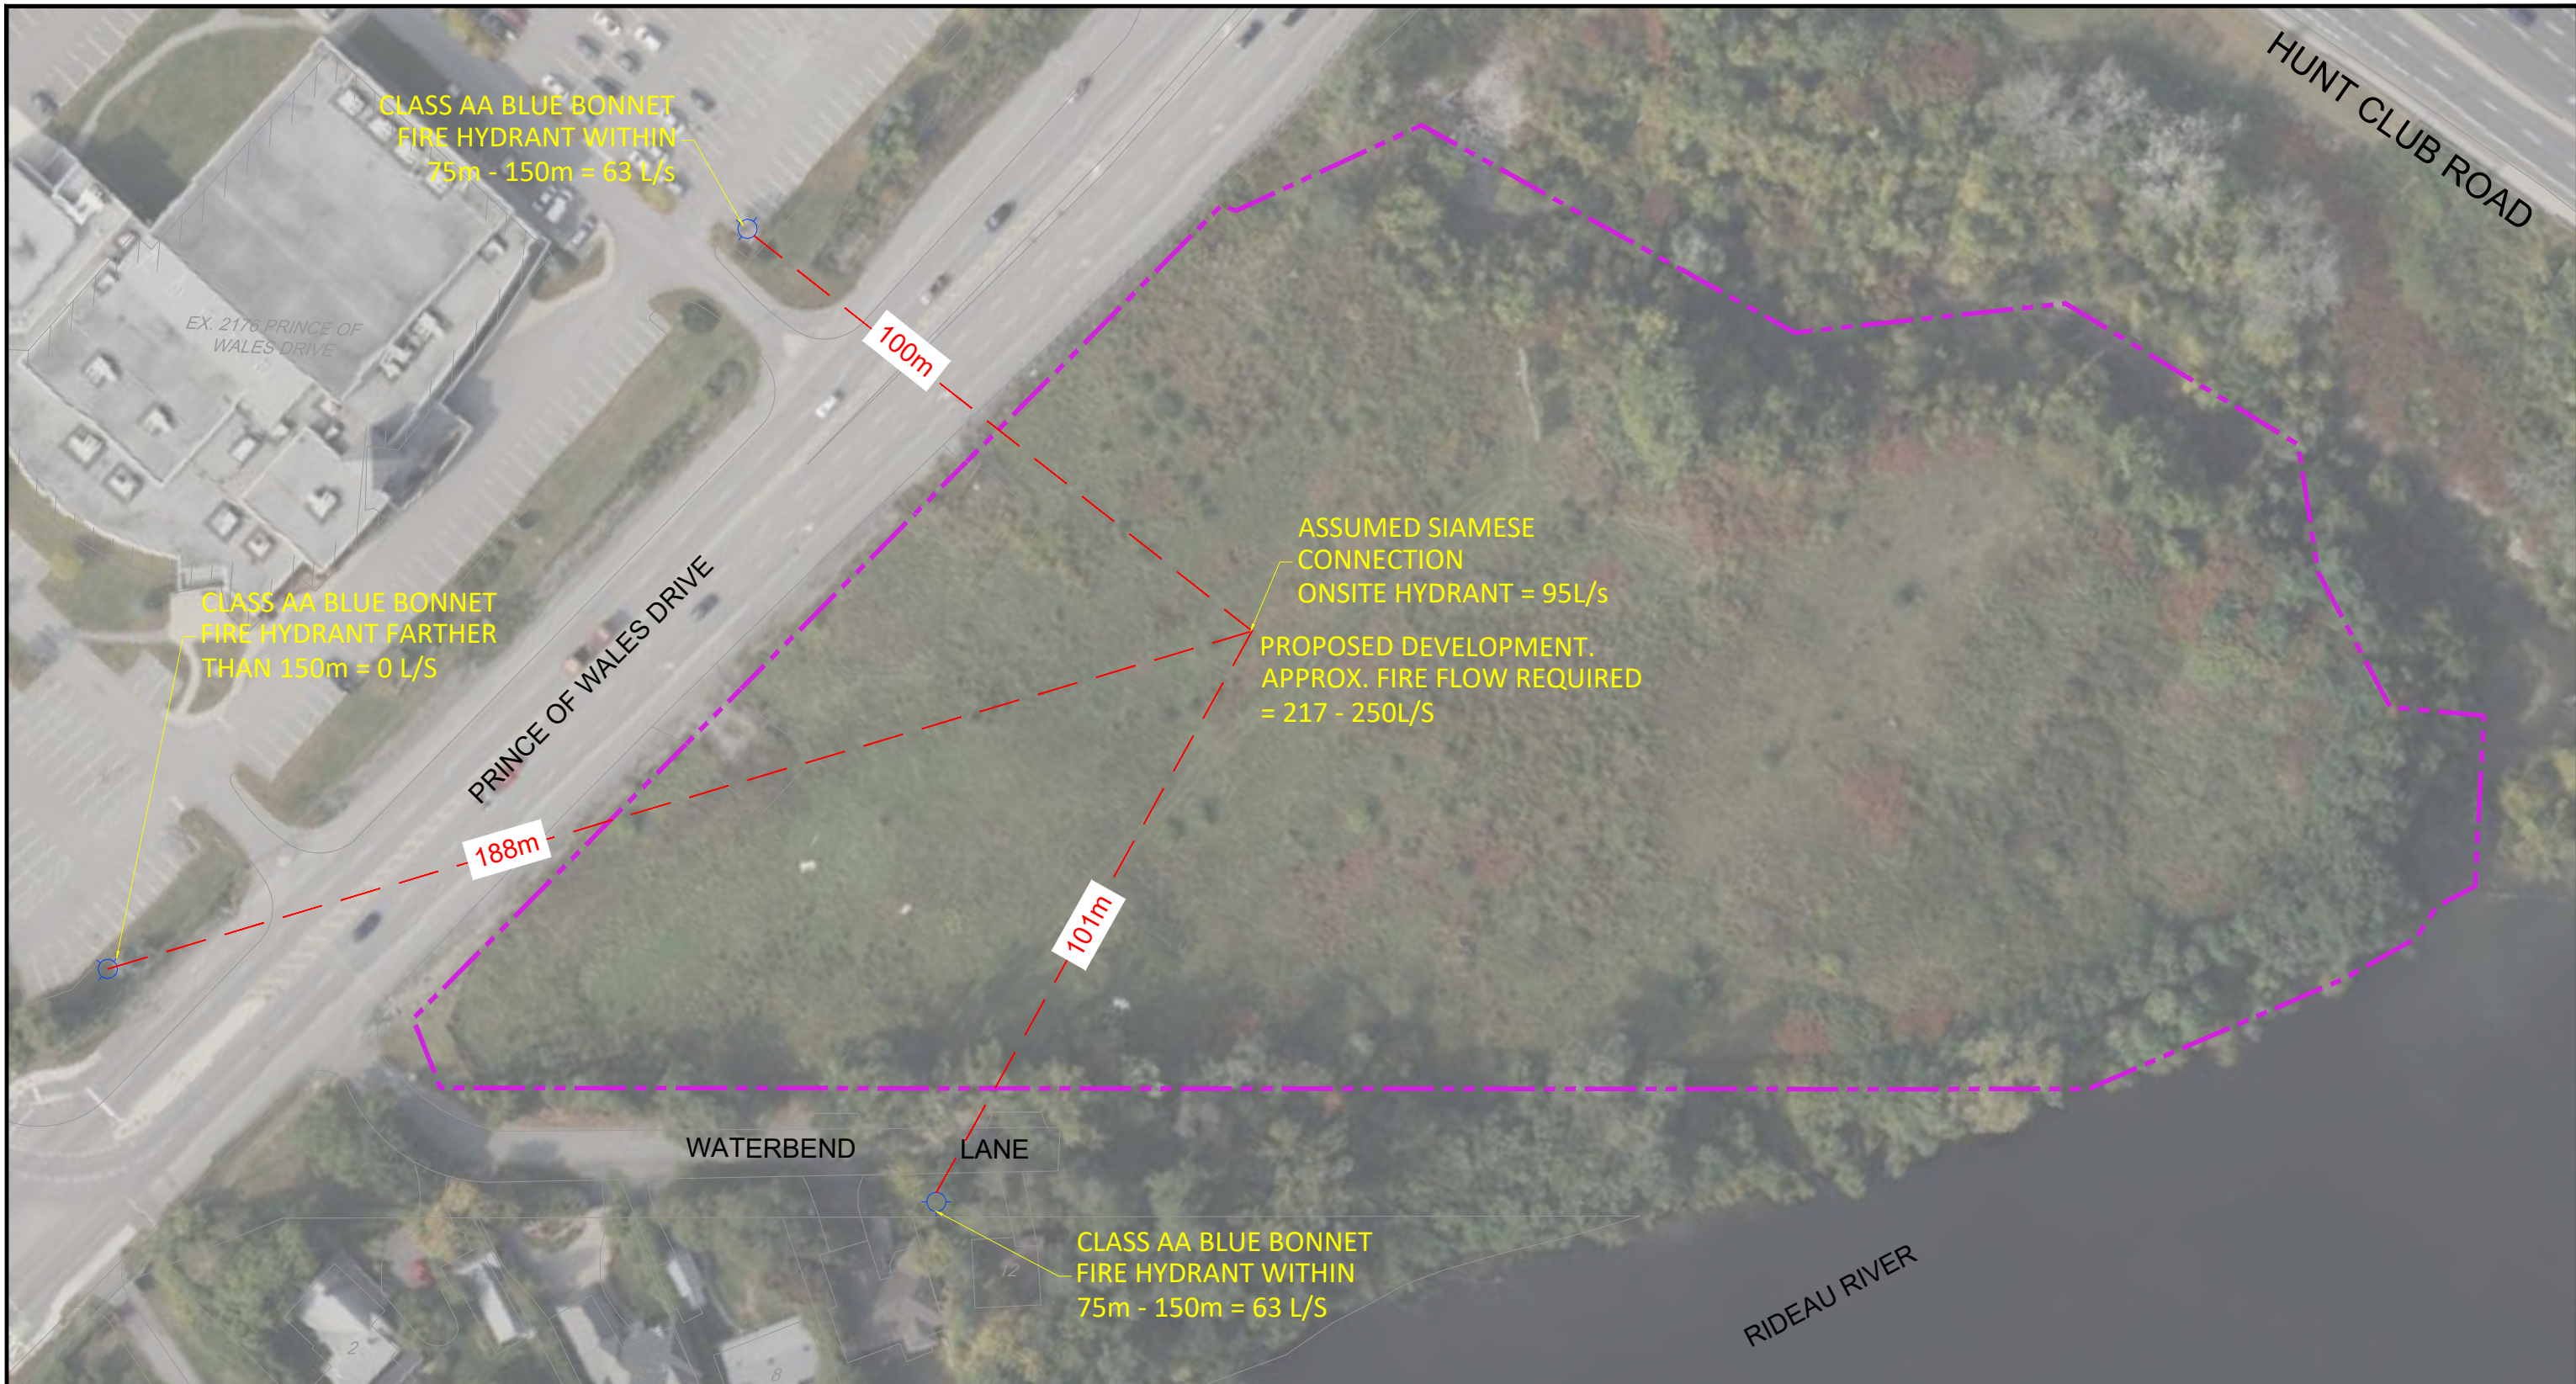


**LEGEND**

— — — DISTANCE FROM HYDRANT TO SIAMESE CONNECTION



EXISTING CLASS AA HYDRANT

- - - - - PROPERTY LINE



**NOVATECH**

Engineers, Planners & Landscape Architects  
Suite 200, 240 Michael Cowpland Drive  
Ottawa, Ontario, Canada K2M 1P6

Telephone (613) 254-9643  
Facsimile (613) 254-5867  
Website www.novatech-eng.com

2175 PRINCE OF WALES DRIVE

HYDRANT COVERAGE PLAN

SCALE 1 : 1000

DATE MAR 2026 JOB 117074 FIGURE 4



# FUS - Fire Flow Calculations



**Novatech Project #:** 117074  
**Project Name:** 2175 Prince of Wales Drive  
**Date:** 5/31/2024  
**Input By:** Leonel Perez  
**Reviewed By:** Cara Ruddle  
**Drawing Reference:**

**Legend:** Input by User  
 No Input Required  
**Reference:** Fire Underwriter's Survey Guideline (2020)  
 Formula Method

**Building Description:** Multi-Storey Industrial Building  
 Type II - Non-combustible construction

Step		Choose		Value Used	Total Fire Flow (L/min)
<b>Base Fire Flow</b>					
1	<b>Construction Material</b>		<b>Multiplier</b>		0.8
	<b>C</b> Coefficient related to type of construction	Type V - Wood frame		1.5	
		Type IV - Mass Timber		Varies	
		Type III - Ordinary construction		1	
		Type II - Non-combustible construction	Yes	0.8	
Type I - Fire resistive construction (2 hrs)			0.6		
2	<b>Floor Area</b>				25,000
	<b>A</b>	Building Footprint (m <sup>2</sup> )	8000		
		Number of Floors/Storeys	3		
		Protected Openings (1 hr) if C<1.0	No		
		Area of structure considered (m <sup>2</sup> )		20,000	
<b>F</b>	Base fire flow without reductions				
	$F = 220 C (A)^{0.5}$				
<b>Reductions or Surcharges</b>					
3	<b>Occupancy hazard reduction or surcharge</b>		<b>FUS Table 3</b>	<b>Reduction/Surcharge</b>	25,000
	<b>(1)</b>	Non-combustible		-25%	
		Limited combustible		-15%	
		Combustible	Yes	0%	
		Free burning		15%	
Rapid burning			25%		
4	<b>Sprinkler Reduction</b>		<b>FUS Table 4</b>	<b>Reduction</b>	-10,000
	<b>(2)</b>	Adequately Designed System (NFPA 13)	Yes	-30%	
		Standard Water Supply	Yes	-10%	
		Fully Supervised System	No	-10%	
		<b>Cumulative Sub-Total</b>			
	Area of Sprinklered Coverage (m <sup>2</sup> )	24000	100%		
		<b>Cumulative Total</b>		-40%	
5	<b>Exposure Surcharge</b>		<b>FUS Table 5</b>	<b>Surcharge</b>	0
	<b>(3)</b>	North Side	>30m	0%	
		East Side	>30m	0%	
		South Side	>30m	0%	
		West Side	>30m	0%	
		<b>Cumulative Total</b>		0%	
<b>Results</b>					
6	<b>(1) + (2) + (3)</b>	<b>Total Required Fire Flow, rounded to nearest 1000L/min</b>		<b>L/min</b>	<b>15,000</b>
		(2,000 L/min < Fire Flow < 45,000 L/min)		or	L/s
				or	USGPM

# FUS - Fire Flow Calculations



**Novatech Project #:** 117074  
**Project Name:** 2175 Prince of Wales Drive  
**Date:** 5/31/2024  
**Input By:** Leonel Perez  
**Reviewed By:** Cara Ruddle  
**Drawing Reference:**

**Legend:** Input by User  
 No Input Required  
**Reference:** Fire Underwriter's Survey Guideline (2020)  
 Formula Method

**Building Description:** Multi-Storey Commercial Building  
 Type I - Fire resistive construction (2 hrs)


Step		Choose		Value Used	Total Fire Flow (L/min)	
<b>Base Fire Flow</b>						
1	<b>Construction Material</b>		<b>Multiplier</b>		0.6	
	<b>C</b> Coefficient related to type of construction	Type V - Wood frame		1.5		
		Type IV - Mass Timber		Varies		
		Type III - Ordinary construction		1		
		Type II - Non-combustible construction		0.8		
Type I - Fire resistive construction (2 hrs)		Yes	0.6			
2	<b>Floor Area</b>				20,000	
	<b>A</b>	Building Footprint (m <sup>2</sup> )	8000			
		Number of Floors/Storeys	4			
		Protected Openings (1 hr) if C<1.0	No			
		Area of structure considered (m <sup>2</sup> )		24,000		
<b>F</b>	Base fire flow without reductions $F = 220 C (A)^{0.5}$					
<b>Reductions or Surcharges</b>						
3	<b>Occupancy hazard reduction or surcharge</b>		<b>FUS Table 3</b>	<b>Reduction/Surcharge</b>	20,000	
	<b>(1)</b>	Non-combustible		-25%		
		Limited combustible		-15%		
		Combustible	Yes	0%		
		Free burning		15%		
Rapid burning			25%			
4	<b>Sprinkler Reduction</b>		<b>FUS Table 4</b>	<b>Reduction</b>	-7,500	
	<b>(2)</b>	Adequately Designed System (NFPA 13)	Yes	-30% -30%		
		Standard Water Supply	Yes	-10% -10%		
		Fully Supervised System	Yes	-10% -10%		
		<b>Cumulative Sub-Total</b>				<b>-50%</b>
	Area of Sprinklered Coverage (m <sup>2</sup> )	24000	75%			
		<b>Cumulative Total</b>		<b>-38%</b>		
5	<b>Exposure Surcharge</b>		<b>FUS Table 5</b>	<b>Surcharge</b>	0	
	<b>(3)</b>	North Side	>30m	0%		
		East Side	>30m	0%		
		South Side	>30m	0%		
		West Side	>30m	0%		
		<b>Cumulative Total</b>		<b>0%</b>		
<b>Results</b>						
6	<b>(1) + (2) + (3)</b>	<b>Total Required Fire Flow, rounded to nearest 1000L/min</b>		<b>L/min</b>	<b>13,000</b>	
		(2,000 L/min < Fire Flow < 45,000 L/min)		or	<b>L/s</b>	<b>217</b>
				or	<b>USGPM</b>	<b>3,435</b>

**FW: 2175 Prince of Wales Drive (107005) - Water boundary conditions request**

Cara Ruddle &lt;c.ruddle@novatech-eng.com&gt;

Mon 7/8/2024 3:41 PM

To: Micheal Adeoti &lt;m.adeoti@novatech-eng.com&gt;; Jesse Appiah-Kubi &lt;j.appiah-kubi@novatech-eng.com&gt;

 1 attachments (644 KB)

2175 Prince of Wales Drive June 2024.pdf;

Please update the calculations and Serviceability Report based on the below water boundary conditions.

Thanks.

**Cara Ruddle**, P.Eng., Senior Project Manager | Land Development Engineering**NOVATECH**

Engineers, Planners &amp; Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 220 | Cell: 613.261.7719

The information contained in this email message is confidential and is for exclusive use of the addressee.

---

**From:** Brault, Ryan <ryan.brault@ottawa.ca>**Sent:** Wednesday, July 3, 2024 5:29 PM**To:** Cara Ruddle <c.ruddle@novatech-eng.com>**Subject:** RE: 2175 Prince of Wales Drive (107005) - Water boundary conditions request

Hi Cara,

Please find the below boundary conditions for the 2175 Prince of Wales Drive site:

---

The following are boundary conditions, HGL, for hydraulic analysis at 2175 Prince of Wales Drive (zone 2W2C) assumed to be connected to the 406mm watermain on Prince of Wales Drive or the 152mm watermain on Waterbend Lane (see attached PDF for location).

**Scenario 1 (Industrial):**

Minimum HGL = 124.2 m

Maximum HGL = 132.0 m

Max Day + Fire Flow (250 L/s) at Prince of Wales Drive connection = 126.9 m

Max Day + Available Fire Flow at 152mm on Waterbend Lane is 89 L/s with a residual pressure of 20 psi

**Scenario 2 (Commercial):**

Minimum HGL = 124.2 m

Maximum HGL = 132.0 m

200Max Day + Fire Flow (217 L/s) at Prince of Wales Drive connection = 126.5 m

Max Day + Available Fire Flow at 152mm on Waterbend Lane is 91 L/s with a residual pressure of 20 psi

These are for current conditions and are based on computer model simulation.

*Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.*

---

Please note that the Fire Flow is not met at connection 2 (Waterbend Lane).

Please let me know if you have any questions.

Regards,

**Ryan Brault, M.Eng., P.Eng**

Project Manager - Infrastructure Approvals

City of Ottawa  
Development Review - West Branch  
Planning, Development, and Building Services  
110 Laurier Ave West, 4th Floor East;  
Ottawa ON K1P 1J1  
Tel: 613-580-2424 x 32540

---

**From:** Cara Ruddle <[c.ruddle@novatech-eng.com](mailto:c.ruddle@novatech-eng.com)>

**Sent:** July 03, 2024 10:41 AM

**To:** Brault, Ryan <[ryan.brault@ottawa.ca](mailto:ryan.brault@ottawa.ca)>

**Subject:** RE: 2175 Prince of Wales Drive (107005) - Water boundary conditions request

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**

**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

That is great news.

Thanks.

**Cara Ruddle**, P.Eng., Senior Project Manager | Land Development Engineering

**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 220 | Cell: 613.261.7719

The information contained in this email message is confidential and is for exclusive use of the addressee.

**From:** Brault, Ryan <[ryan.brault@ottawa.ca](mailto:ryan.brault@ottawa.ca)>  
**Sent:** Wednesday, July 3, 2024 10:38 AM  
**To:** Cara Ruddle <[c.ruddle@novatech-eng.com](mailto:c.ruddle@novatech-eng.com)>  
**Subject:** RE: 2175 Prince of Wales Drive (107005) - Water boundary conditions request

Hi Cara,

I actually received them yesterday but sent a question back to my colleagues to confirm one of the notes they provided.

You should have them by end of day today.

Regards,

**Ryan Brault, M.Eng., P.Eng**  
Project Manager - Infrastructure Approvals

City of Ottawa  
Development Review - West Branch  
Planning, Development, and Building Services  
110 Laurier Ave West, 4th Floor East;  
Ottawa ON K1P 1J1  
Tel: 613-580-2424 x 32540

---

**From:** Cara Ruddle <[c.ruddle@novatech-eng.com](mailto:c.ruddle@novatech-eng.com)>  
**Sent:** July 03, 2024 10:01 AM  
**To:** Brault, Ryan <[ryan.brault@ottawa.ca](mailto:ryan.brault@ottawa.ca)>  
**Subject:** RE: 2175 Prince of Wales Drive (107005) - Water boundary conditions request

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**

**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Ryan:  
Just thought I would try to get an update on the timing for these boundary conditions so I can give an update to my client.

Thanks.

**Cara Ruddle**, P.Eng., Senior Project Manager | Land Development Engineering

**NOVATECH**

Engineers, Planners & Landscape Architects  
240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 220 | Cell: 613.261.7719  
The information contained in this email message is confidential and is for exclusive use of the addressee.

---

**From:** Schaeffer, Gabrielle <[gabrielle.schaeffer@Ottawa.ca](mailto:gabrielle.schaeffer@Ottawa.ca)>  
**Sent:** Friday, June 14, 2024 11:04 AM  
**To:** Cara Ruddle <[c.ruddle@novatech-eng.com](mailto:c.ruddle@novatech-eng.com)>; Brault, Ryan <[ryan.brault@ottawa.ca](mailto:ryan.brault@ottawa.ca)>  
**Subject:** RE: 2175 Prince of Wales Drive (107005) - Water boundary conditions request

Hi Cara,

Ryan Brault will be helping me with this file and will review your BC request. Once he's done his review, he will send it to the City's water modelling team to get you the BC information. This part may take up to 2 weeks after Ryan's review. If he has any questions, he'll reach out to you.

Regards,

**Gabrielle (Gabi) Schaeffer, P.Eng**  
Senior Engineer - Infrastructure Applications

City of Ottawa  
Development Review - West Branch  
Planning, Development and Building Department  
110 Laurier Ave West, 4th Floor East;  
Ottawa ON K1P 1J1  
Tel: 613-580-2424 x 22517

---

**From:** Cara Ruddle <[c.ruddle@novatech-eng.com](mailto:c.ruddle@novatech-eng.com)>  
**Sent:** June 14, 2024 8:48 AM  
**To:** Schaeffer, Gabrielle <[gabrielle.schaeffer@Ottawa.ca](mailto:gabrielle.schaeffer@Ottawa.ca)>  
**Subject:** 2175 Prince of Wales Drive (107005) - Water boundary conditions request

**CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.**

**ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.**

Gabrielle:

Please find attached information for water demands for a proposed development at 2175 Prince of Wales. I am looking to get boundary conditions in order to update a Serviceability Report to support a Zoning Amendment Application. In addition to the water demand and FUS calculations, attached is a portion of the GeoOttawa mapping showing the existing watermain infrastructure surrounding the subject site. Please note that the property could be serviced with either commercial or light industrial use and an FUS calculation has been provided for both uses. Also, a water service could be connected to either the existing 400mm diameter watermain along Prince of Wales or the 150mm diameter watermain along Waterbend Lane. Please provide updated boundaries conditions as soon as possible so that our report can be updated and submitted to the City for review and approval.

Thanks.

**Cara Ruddle**, P.Eng., Senior Project Manager | Land Development Engineering

**NOVATECH**

Engineers, Planners & Landscape Architects

240 Michael Cowpland Drive, Suite 200, Ottawa, ON, K2M 1P6 | Tel: 613.254.9643 Ext: 220 | Cell: 613.261.7719

The information contained in this email message is confidential and is for exclusive use of the addressee.

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'  
'

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

Name : 2175 - Prince of Wales

Date : July 10/2024

Project : 117074

By : MA

400mm WM (Prince of Wales)

\* Assumed Finished  
grade = 87.0 ±

Min HGL - 124.2m

Max HGL - 132.0m

Max Day + Fire flow - 126.9m (Industrial)

Max Day + Fire flow - 126.5m (Commercial)

Max Day - 308 L/s

Fire flow - 250 L/s (Industrial)

Fire flow - 217 L/s (Commercial)

$$\text{Avg Day} = 132.0\text{m} - 87.0\text{m} = 45\text{m} \\ \approx 63.9\text{ psi}$$

$$\text{Peak Hour} = 124.2\text{m} - 87.0\text{m} = 37.2\text{m} \\ \approx 52.9\text{ psi}$$

$$\text{Max Day + FF (Industrial)} = 126.9\text{m} - 87.0\text{m} = 39.9\text{m} \\ \approx 56.7\text{ psi}$$

$$\text{Max Day + FF (Commercial)} = 126.5\text{m} - 87.0\text{m} = 39.5\text{m} \\ \approx 56.1\text{ psi}$$

150 mm WM (Water bend)

$$\text{Min HGL} = 124.2 \text{ m}$$

$$\text{Max HGL} = 132.0 \text{ m}$$

$$\text{(Industrial) Max Day + Fire flow} = 89 \text{ L/s (Residual 20 psi)}$$

$$\text{(Commercial) Max Day + Fire flow} = 91 \text{ L/s (Residual 20 psi)}$$

$$\begin{aligned} \text{Avg. Day} &= 132.0 \text{ m} - 87.0 \text{ m} = 45 \text{ m} \\ &\approx 63.9 \text{ psi} \end{aligned}$$

$$\begin{aligned} \text{Peak Hour} &= 124.2 \text{ m} - 87.0 \text{ m} = 37.2 \text{ m} \\ &\approx 52.9 \text{ psi} \end{aligned}$$


$$\begin{aligned} \text{Max Day + FF} &= 89 \text{ L/s @ 20 psi (Industrial)} \\ 20 \text{ psi} &= 14.1 \text{ m} \end{aligned}$$

$$\therefore \text{HGL} = 14.1 \text{ m} + 87.0 \text{ m} = 101.1 \text{ m @ 20 psi}$$

$$\begin{aligned} \text{Max Day + FF} &= 91 \text{ L/s @ 20 psi (Commercial)} \\ 20 \text{ psi} &= 14.1 \text{ m} \end{aligned}$$

$$\therefore \text{HGL} = 14.1 \text{ m} + 87.0 \text{ m} = 101.1 \text{ m @ 20 psi}$$

**APPENDIX B**  
**Sanitary Calculations**

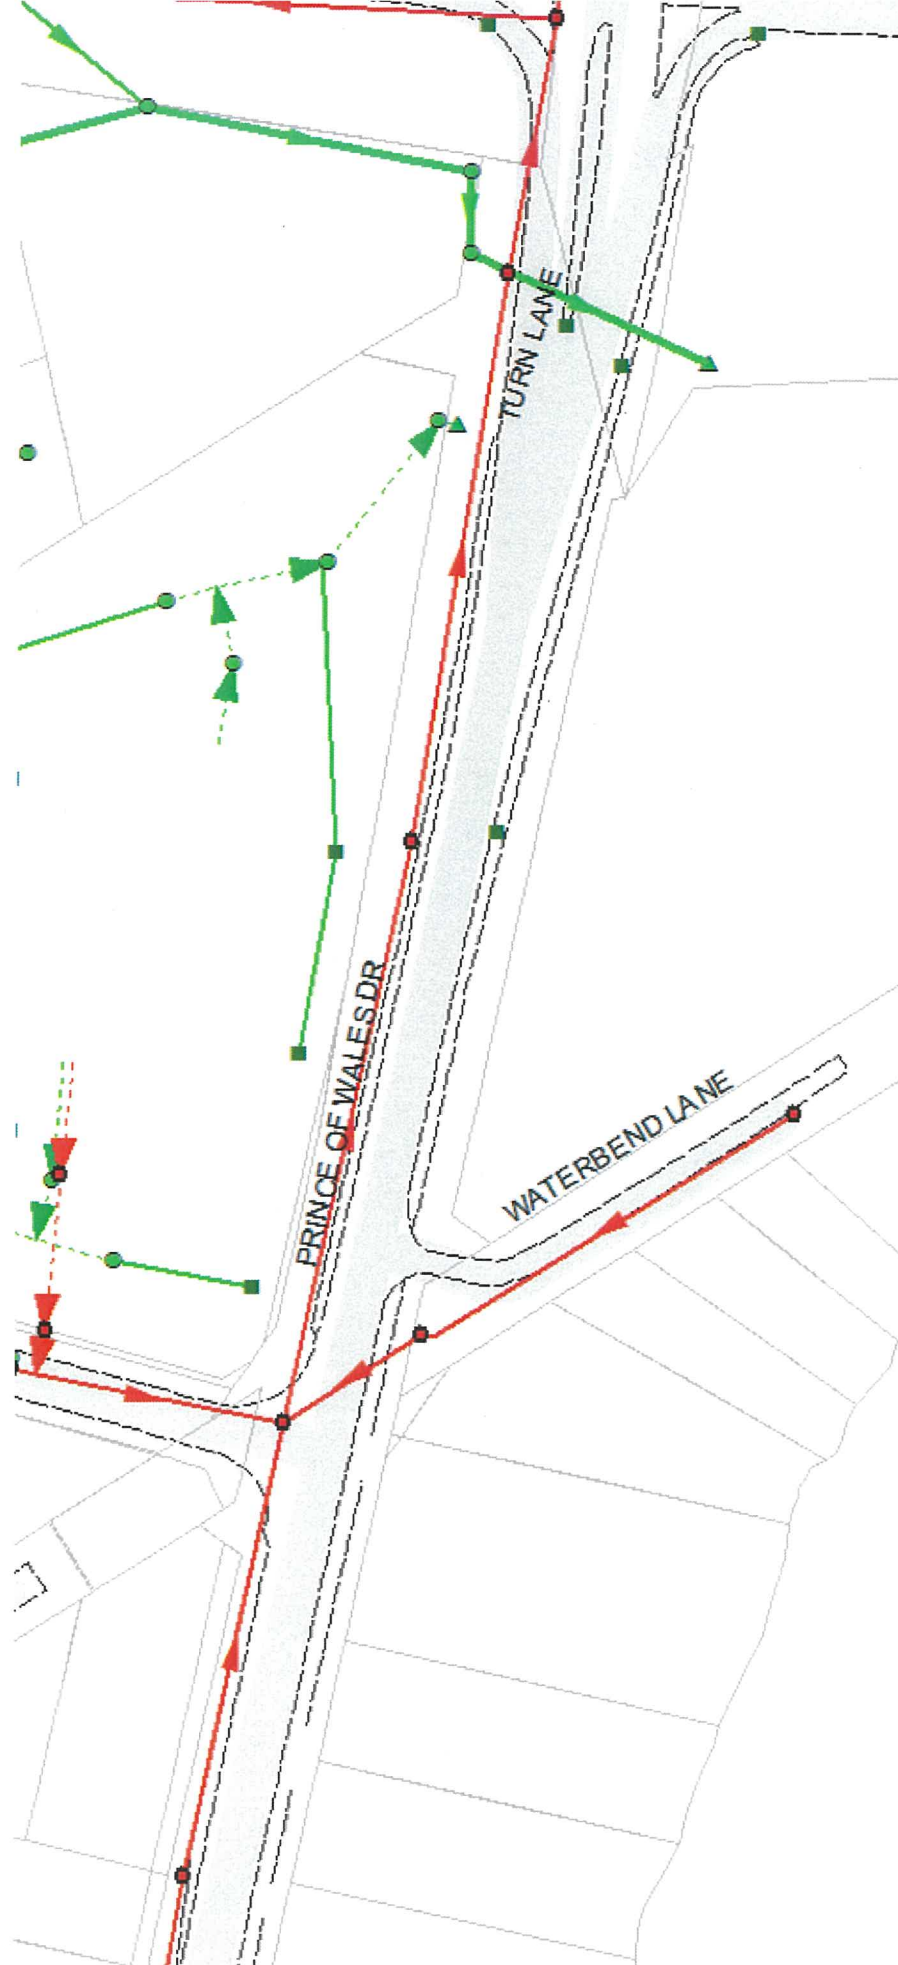

Identify

Identify from: <All layers>

Location: 367,485.876 5,021,592.652 Met

Field	Value
Administrative_Area	NEPEAN
CCTV_REPORT_ID	<null>
CCTV_STATUS	<null>
CCTV_YEAR	0
COMMENTS	<null>
CREATED_BY	<null>
CREATED_DATE	<null>
District	<null>
Flow_Direction	<null>
Function	<null>
INSITU_SOIL	<null>
Install_Year	1990
Invert_Downstream	83.28
Invert_Upstream	83.86
LAST_ID	<null>
LENGTH_AS_BUILT	105
Life_Cycle_Status	In Service
Lining_Type	None
Lining_Year	0
MATERIAL	Poly Vinyl Chloride
MXASSETNUM	3695787
NODE1	MHSA19103
NODE1_TYPE	Sanitary_Manhole
NODE2	MHSA19102
NODE2_TYPE	Sanitary_Manhole
Ownership	Public
PIPE_CLASS	SDR26
Pipe_Shape	Round
REFERENCE	8180
SHAPE_Length	108
SLOPE	0.55
Street	WATERBEND LANE NEP
STRUCT_ID	SAN19685
STRUCT_TYPE	Sanitary_Pipe
SURFACE_TYPE	<null>
TEMP_NUMBER	<null>
Trunk	No
Ward	09 Knoxdale-Merivale
Width	200mm
XStreet	PRINCE OF WALES DR NI

Identified 23 features


**Analysis of Existing Sanitary Sewer on Waterbend Lane**

LOCATION			EXISTING RESIDENTIAL					ICI				INFILTRATION			Total Flow (l/s)	PIPE					
Site Use	FROM	TO	SINGLES			Commercial Area (ha)	Industrial Area (ha)	Accum. Area (ha)	Peak Flow (l/s)	Total Area (ha)	Accum. Area (ha)	Infil. Flow (l/s)	Size (mm)	Slope (%)		Length (m)	Capacity (l/s)	Full Flow Vel. (m/s)	Q/Q <sub>full</sub> (%)		
			Units	Pop.	Accum. Pop.															Peak Factor	Peak Flow (l/s)
Industrial	EX SANMH 2	EX SANMH 1	5	16.5	16.5	3.7	0.2		3.22	3.22	9.6	4.08	4.08	1.1	11.0	200	0.55	81	25.4	0.78	43.2%
Commercial	EX SANMH 2	EX SANMH 1	5	16.5	16.5	3.7	0.2	3.22		3.22	1.6	4.08	4.08	1.1	2.9	200	0.55	81	25.4	0.78	11.5%

**Design Parameters:**





Extraneous Flows =	0.28 l/s/ha	
Industrial Flow =	55,000 l/ha/day	
Commercial Flow =	28,000 l/ha/day	CHANGES AS PER CITY TECHNICAL BULLETING 2018-01
Peaking Factor Commercial =	1.5	
Peaking Factor Heavy Industrial =	4.7 (Based on Appendix 4-B.1, Ottawa Sewer Design Guidelines)	
Domestic Flow:		
Avg Flow/Person	280 l/day	
Population Density:	3.3 people/unit	
Residential Peaking Factor = Harmon Equation (max 4, min 2)		
Pipe Friction n =	0.013	


**APPENDIX C**  
**Stormwater Management Calculations**

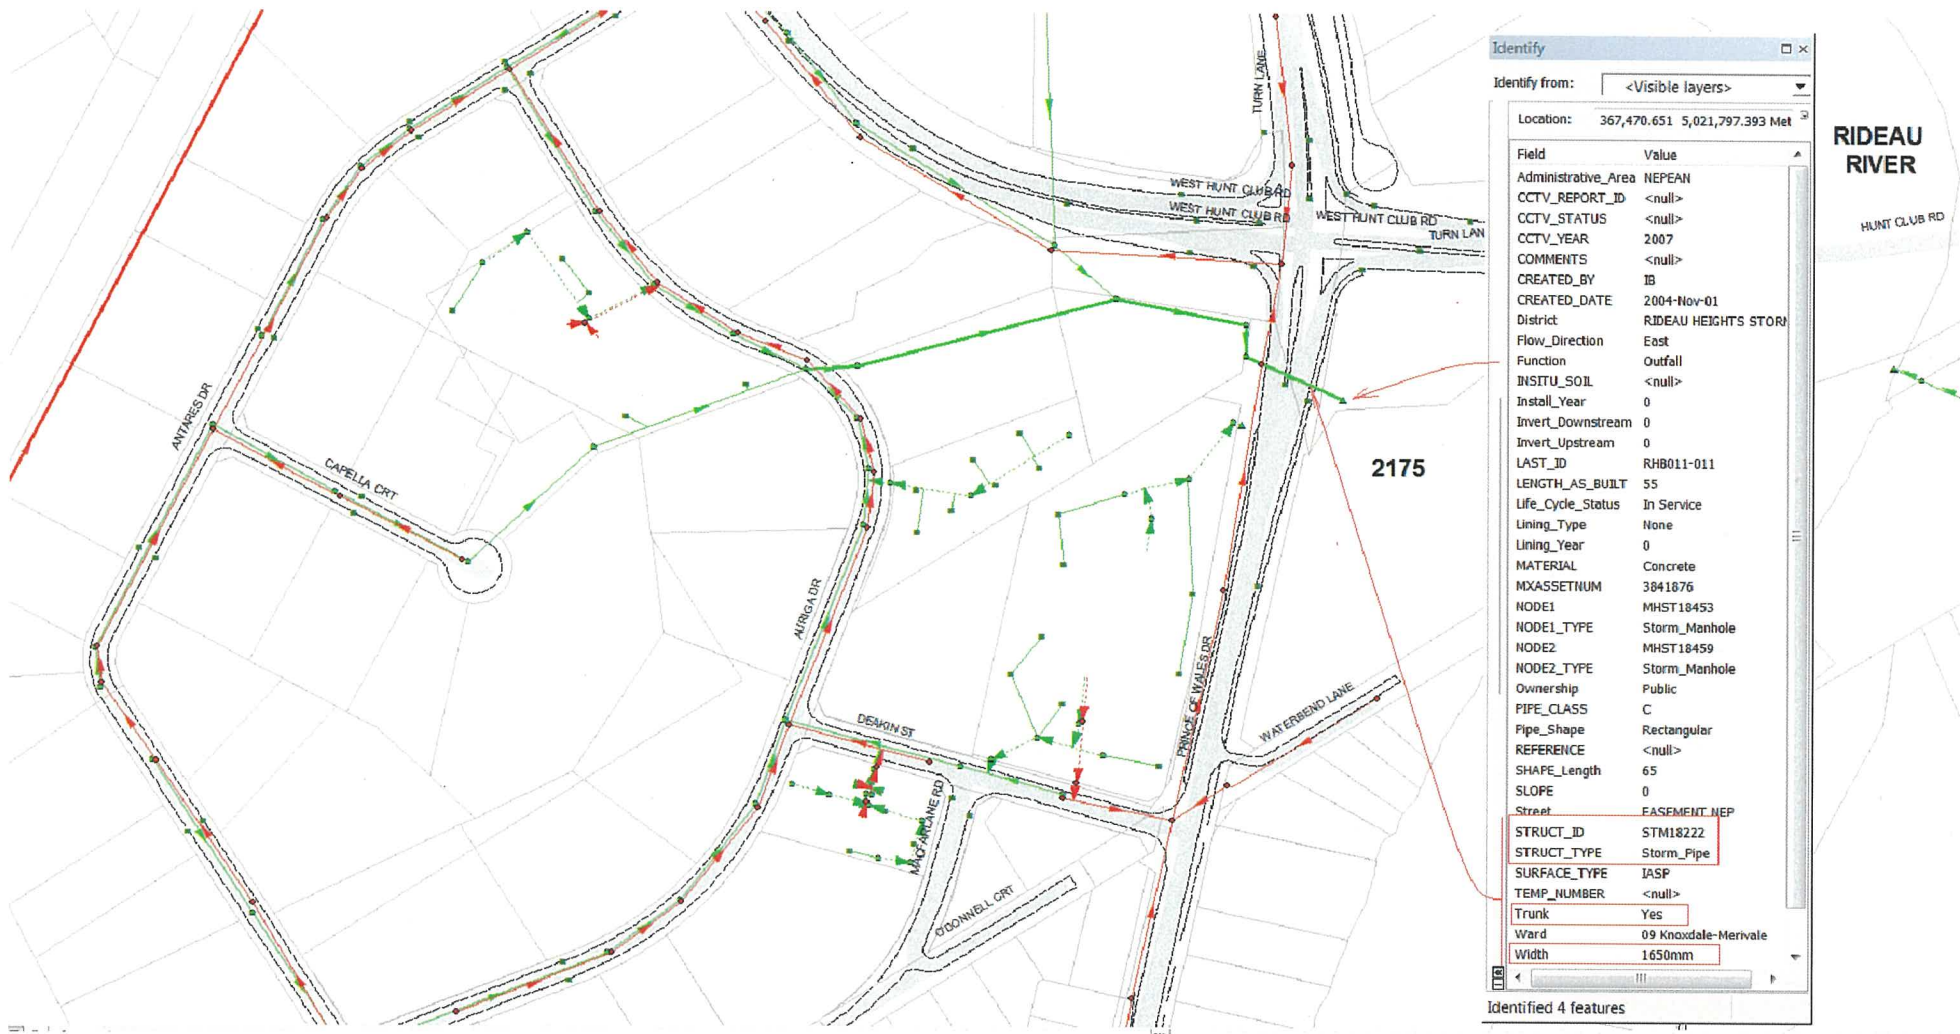



2175 Prince of Wales Dr – ArcMAP (2015) – Storm Sewer Data

**LEGEND**

-  MAJOR OVERLAND FLOW
-  TRIBUTARY AREA
-  AREA I.D.  
DRAINAGE AREA  
RUNOFF COEFFICIENT
-  PROPOSED STM SEWER

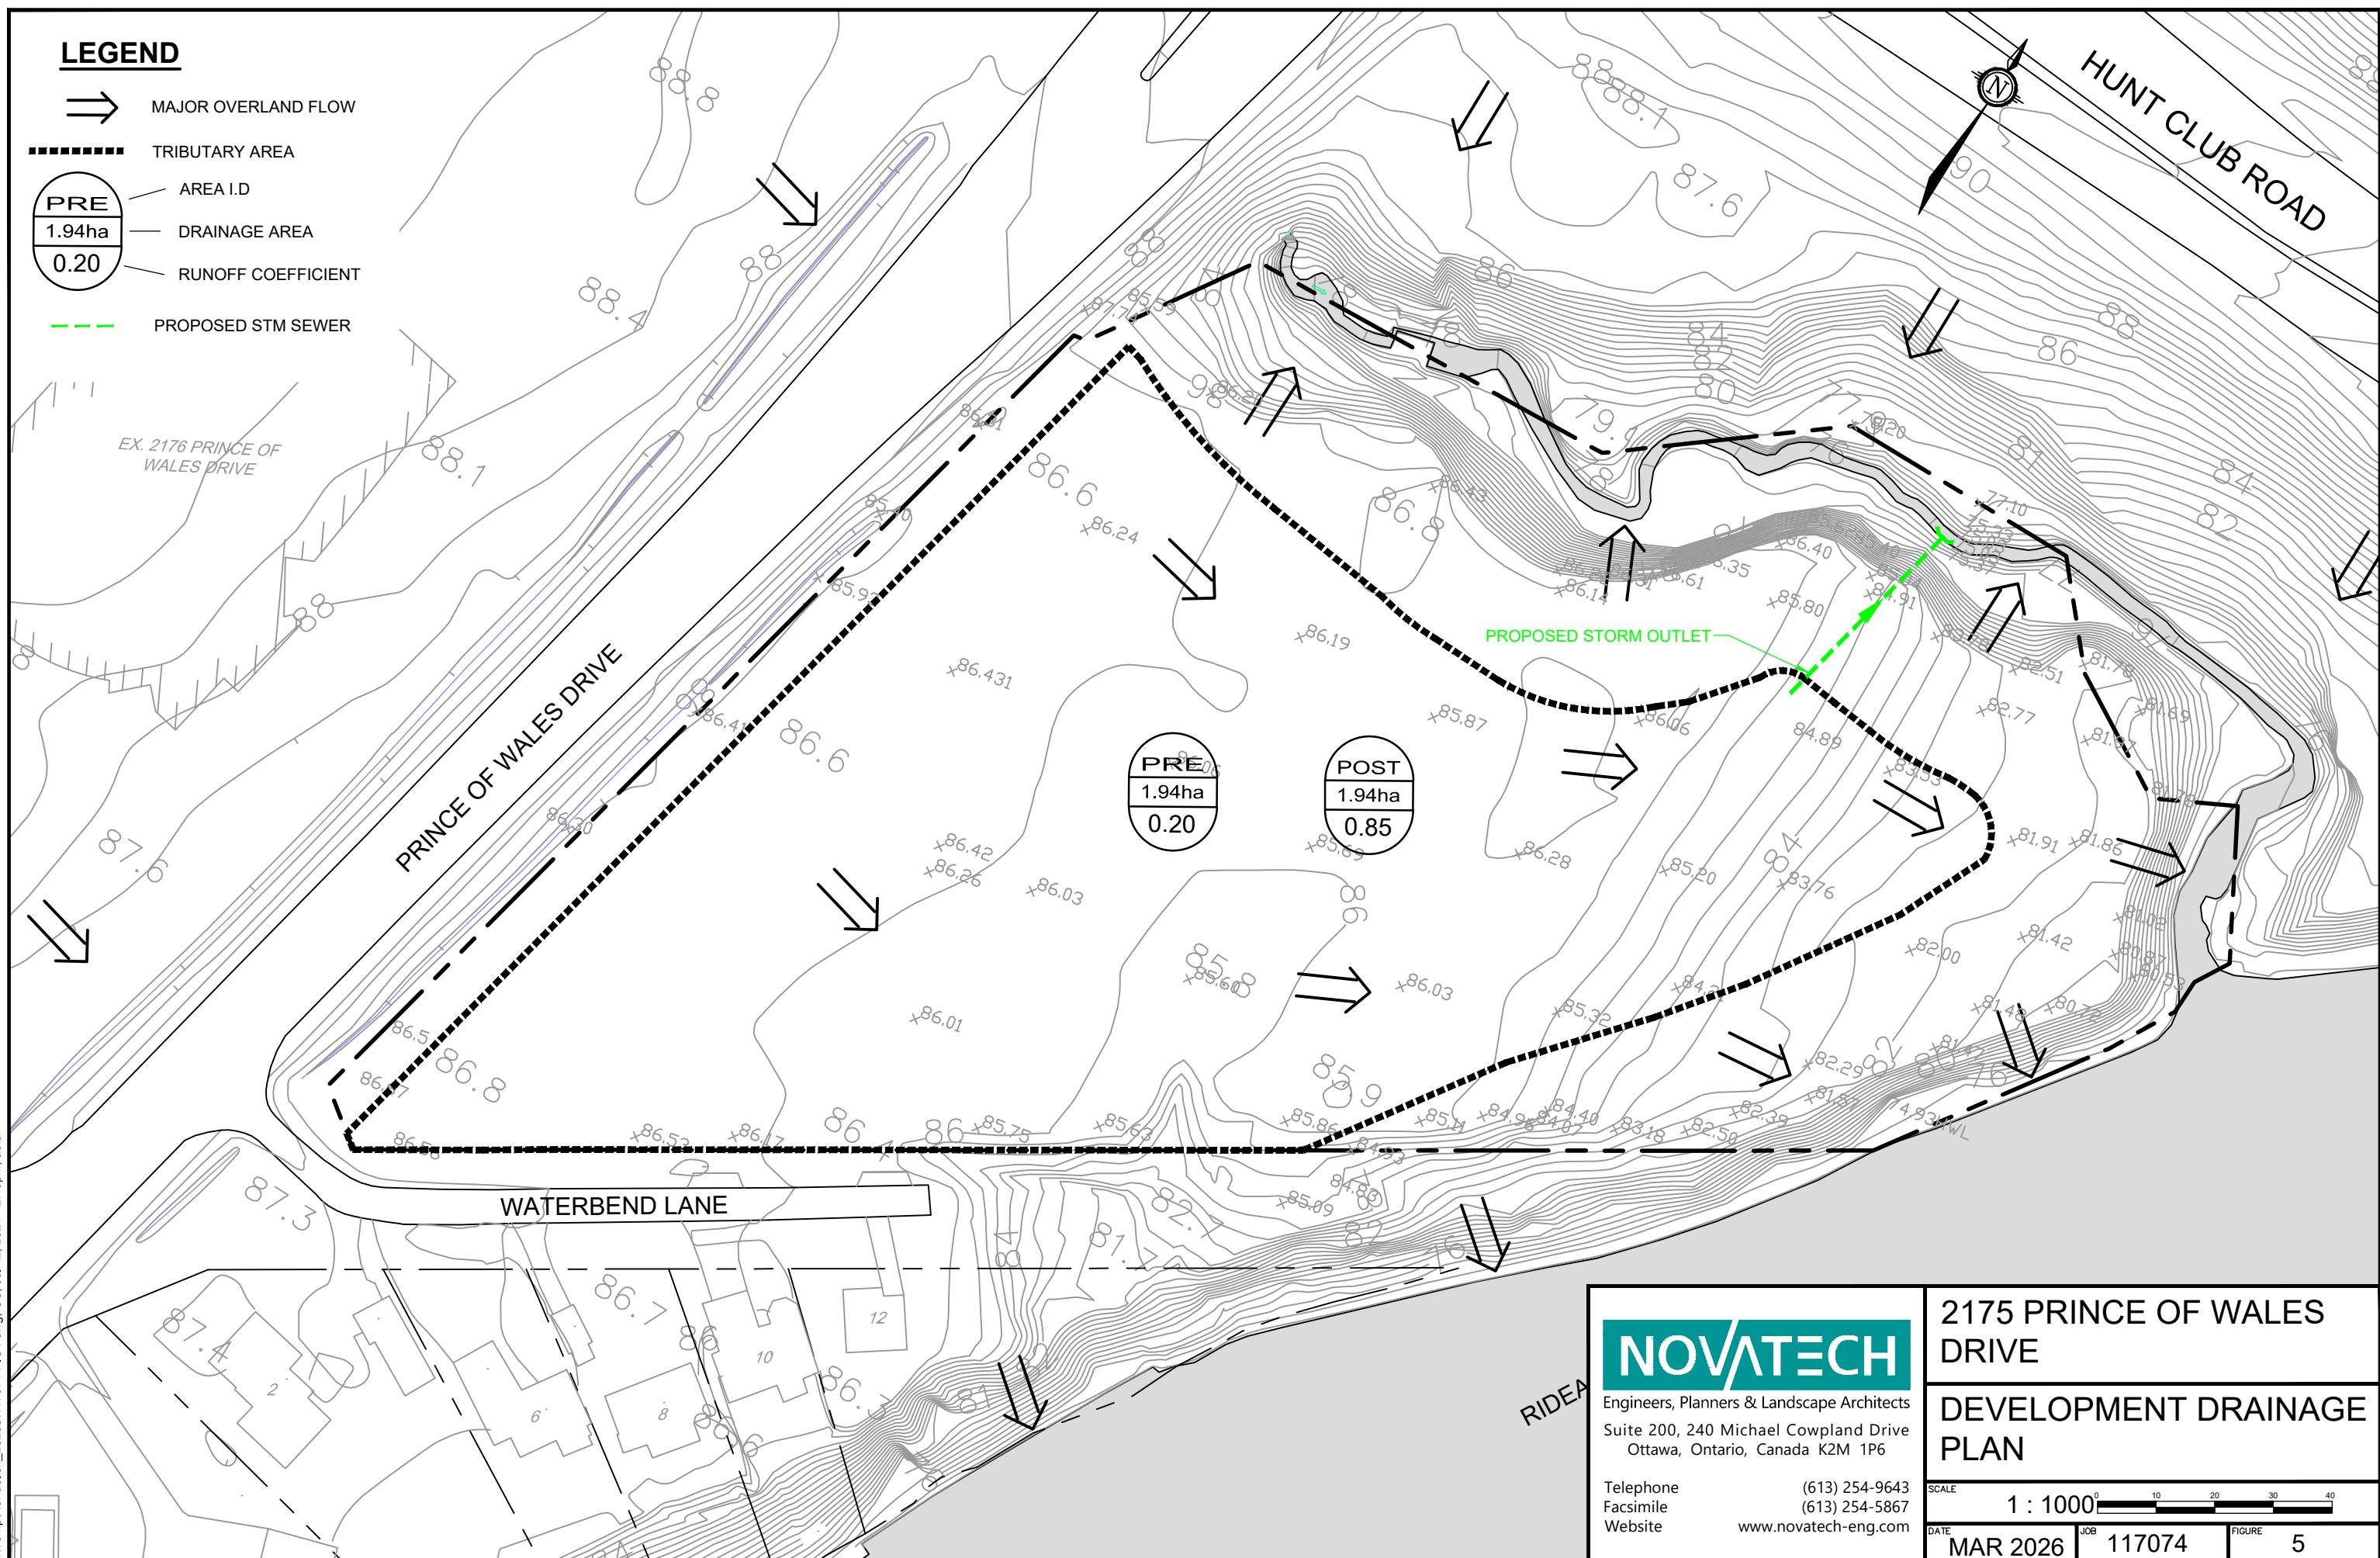

C:\Temp\AcPublish\25288\117074-FIG4.dwg, GS, Jul 12, 2024 - 2:49pm, abbi

 Engineers, Planners & Landscape Architects Suite 200, 240 Michael Cowpland Drive Ottawa, Ontario, Canada K2M 1P6 Telephone (613) 254-9643 Facsimile (613) 254-5867 Website www.novatech-eng.com	<b>2175 PRINCE OF WALES DRIVE</b>	
	<b>DEVELOPMENT DRAINAGE PLAN</b>	
SCALE 1 : 1000 	DATE MAR 2026	JOB 117074
		FIGURE 5

PROJECT #: 117074

PROJECT NAME: 2175 Prince of Wales Dr  
 LOCATION: Ottawa, ON  
 DATE PREPARED: March 2015  
 DATE REVISED: July 2024



TABLE C1: Free Flow Pre-Development

Pre-Development Runoff Coefficient "C"

Area	Surface	Ha	1:5 Year Event		1:100 Year Event	
			C	C <sub>5</sub>	C	C <sub>100</sub>
Total	Hard	0.000	0.90	0.20	1.00	0.25
1.940	Soft	1.940	0.20		0.25	

Pre-Development Free Flows

Outlet Options	Area (ha)	Q <sub>5 Year</sub> (L/s)	Q <sub>100 Year</sub> (L/s)
Overland Free flow	1.940	112.4	240.8

Runoff Coefficient Equation

$$C_5 = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{Tot}}$$

$$C_{100} = (A_{\text{hard}} \times 1.0 + A_{\text{soft}} \times 0.25) / A_{\text{Tot}}$$

\* Runoff Coefficient increases by 25% up to a maximum value of 1.00 for the 100-Year event

Time of Concentration T<sub>c</sub>= 10 min  
 Rainfall Intensity (5 Year Event) I<sub>5</sub>= 104.19 mm/hr  
 Rainfall Intensity (100 Year Event) I<sub>100</sub>= 178.56 mm/hr

$$100 \text{ year Intensity} = 1735.688 / (\text{Time in min} + 6.014)^{0.820}$$

$$5 \text{ year Intensity} = 998.071 / (\text{Time in min} + 6.053)^{0.814}$$

PROJECT #: 117074

PROJECT NAME: 2175 Prince of Wales Dr  
 LOCATION: Ottawa, ON  
 DATE PREPARED: March 2015  
 DATE REVISED: July 2024



TABLE C2: Free Flow Post-Development

Post-Development Runoff Coefficient "C"

Area	Surface	Ha	1:5 Year Event		1:100 Year Event	
			C	C <sub>5</sub>	C	C <sub>100</sub>
Total	Hard	1.804	0.90	0.85	1.00	0.95
1.940	Soft	0.136	0.20		0.25	

Post-Development Free Flows

Outlet Options	Area (ha)	Q <sub>5 Year</sub> (L/s)	Q <sub>100 Year</sub> (L/s)
Overland Free flow	1.940	477.6	914.9

Runoff Coefficient Equation

$$C_5 = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2) / A_{\text{Tot}}$$

$$C_{100} = (A_{\text{hard}} \times 1.0 + A_{\text{soft}} \times 0.25) / A_{\text{Tot}}$$

\* Runoff Coefficient increases by 25% up to a maximum value of 1.00 for the 100-Year event

Time of Concentration T<sub>c</sub>= 10 min  
 Rainfall Intensity (5 Year Event) I<sub>5</sub>= 104.19 mm/hr  
 Rainfall Intensity (100 Year Event) I<sub>100</sub>= 178.56 mm/hr

$$100 \text{ year Intensity} = 1735.688 / (\text{Time in min} + 6.014)^{0.820}$$

$$5 \text{ year Intensity} = 998.071 / (\text{Time in min} + 6.053)^{0.814}$$