


RECORD OF REVISIONS

1	ISSUED FOR SITE PLAN APPROVAL	DECEMBER 16, 2021
---	-------------------------------	-------------------

PRELIMINARY 33%
NOT FOR CONSTRUCTION

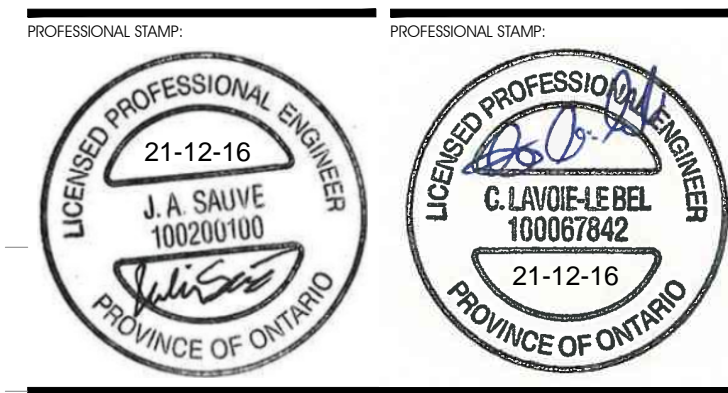

CIVITAS ARCHITECTURE INC.
14 CHAMBERLAN AVENUE, SUITE 101 OTTAWA, ON CANADA K1S 1V9 T: 613.742.7482 WWW.CIVITAS-INC.CA

PROJECT FILE:
FASTFRATE OTTAWA WAREHOUSE AND DISTRIBUTION FACILITY
SCALE: NONE
SOMME ST, OTTAWA, ON

DETAILS

DRAWN BY: D.CANN DRAWING NUMBER:
DATE: J.SAUVÉ
REVIEWED BY: J.SAUVÉ
APPROVED BY: J.SAUVÉ
PRINT DATE: NOVEMBER 26, 2021
ISSUED DATE: NOVEMBER 26, 2021
CLIENT PROJECT #: PROJECT #:

C017

A001083

DO NOT SCALE THIS DRAWING. USE FIGURE DIMENSIONS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL DIMENSIONS AND NOTIFYING THE ARCHITECT OF ANY DISCREPANCIES BEFORE CONSTRUCTION COMMENCES. THE DRAWING IS TO BE READ IN CONJUNCTION WITH ALL STRUCTURAL, MECHANICAL, ELECTRICAL, CIVIL AND OTHER CONSULTANT DRAWINGS. THE DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNLESS SIGNED BY THE ARCHITECT. COPYRIGHT RESERVED. ALL PORTIONS OF THIS DRAWING ARE THE EXCLUSIVE PROPERTY OF THE ARCHITECT AND SHALL NOT BE USED WITHOUT THE WRITTEN PERMISSION FROM THE ARCHITECT.

TABLE 1 - NUMBER OF RODS IN FRAME

PIPE DIA	No of RODS
450	1
525	1
600	2
675	3
750	3
825	4
900	4
975	5
1050	6
1200	7

TABLE 2 - NUMBER OF RODS IN FIXED UPPER FRAME

PIPE DIA	No of RODS
1350	1
1500	2
1650	3
1800	4
1950	5
2100	6
2250	7
2400	8

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2018 Rev 2
GRATING FOR CONCRETE ENDWALL
OPSD 804.050

SPLICE BOLT AND NUT

LOCATION	LENGTH
At posts	32
At structure anchor	38

ARRANGEMENT AT POST WOODEN POST SHOWN

NOTES:
1 Base metal thickness of rail shall be 2.67mm nominal and 2.44mm minimum.
2 Holes only in rail.
A All dimensions subject to manufacturing tolerances unless otherwise indicated.
B All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2010 Rev 2
GUIDE RAIL SYSTEM, STEEL BEAM RAIL COMPONENT
OPSD 912.101

POST BOLT AND HOLE

Hole Dia	Post Bolt Size and Type
18	16x460 BH
18	16x310 CaB

NOTES:
1 Washer shall not be installed at front face of rail. One bolt located at centre of steel beam guide rail.
A Wooden posts and offset blocks shall be 190x190mm. Tops to have 25mm chamfer.
B Steel beam guide rail mounting heights shall be as specified.
C This OPSD to be read in conjunction with OPSD 912.101 and 912.102.
D All dimensions are in millimetres unless otherwise shown.

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2010 Rev 2
GUIDE RAIL SYSTEM, STEEL BEAM WOODEN POST ASSEMBLY INSTALLATION - SINGLE RAIL
OPSD 912.140

LEGEND:
D - Inside diameter

NOTES:
1 Height of fill is measured from the finished surface to top of pipe.
2 The pipe bed shall be compacted and shaped to receive the bottom of the pipe.
3 Pipe culvert frost treatment shall be according to OPSD 803.030 and 803.031.
4 Condition of excavation is symmetrical about centreline of pipe.
A Granular material placed in the haunch area shall be compacted prior to placing and compacting the remainder of the embedment material.
B Soil types as defined in the Occupational Health and Safety Act and Regulations for Construction Projects.
C All dimensions are in metres unless otherwise shown.

CLEARANCE TABLE

Pipe Inside Diameter	Clearance
mm	mm
900 or less	300
Over 900	500

ONTARIO PROVINCIAL STANDARD DRAWING Nov 2014 Rev 3
FLEXIBLE PIPE EMBEDMENT AND BACKFILL EARTH EXCAVATION
OPSD 802.010