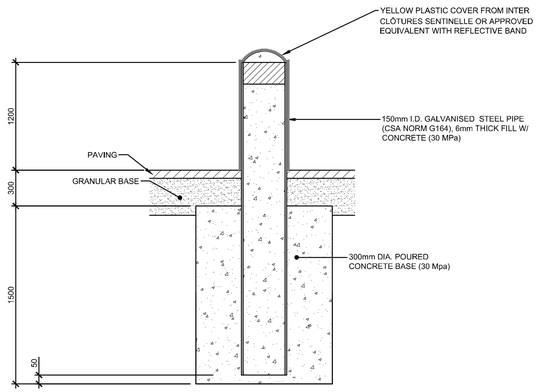

STANDARD BOLLARD

AUCUNE / NTS

403

CULVERT NUMBER IDENTIFICATION SIGN

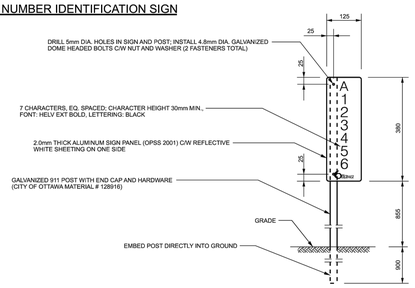

VINYL ADHESIVE LABELS

ADHESIVE LABEL LOCATIONS



NOTES:

1. REFLECTIVE WHITE SHEETING SHALL BE 3M ENGINEERED PRESSURE SENSITIVE (PS) OR EQUIVALENT.
2. TOTAL OF 2 CULVERT NUMBER IDENTIFICATION SIGNS AND 4 VINYL ADHESIVE LABELS REQUIRED FOR EACH CULVERT.
3. PREPARE SURFACE OF GALVANIZED STEEL AS PER LABEL MANUFACTURER'S RECOMMENDATION TO ACHIEVE PROPER BOND.
4. CITY OF OTTAWA LOGO STAMP SHALL BE AFFIXED TO THE FRONT OF EACH CULVERT NUMBER IDENTIFICATION SIGN.
5. TO BE PLACED NEXT TO CEDAR POST WITH REFLECTIVE STRIP.

N.T.S.

Ottawa	CULVERT IDENTIFICATION SIGN FOR CULVERTS OWNED BY CITY OF OTTAWA	DATE:	SEPTEMBER 2006
		REV. DATE:	MARCH 2021
		DWG. No.:	S34

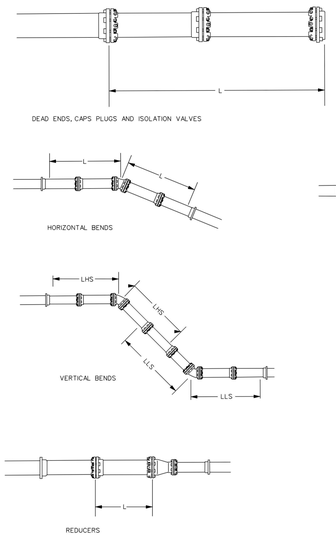

NOTES:

1. ANY JOINT THAT FALLS WITHIN THE RECOMMENDED LENGTH (L) SHALL BE RESTRAINED. SEE DRAWING W25.6
2. TO REDUCE THE NUMBER OF RESTRAINERS REQUIRED THE USE OF FULL PIPE LENGTHS IS RECOMMENDED IN THESE AREAS.

Ottawa	RESTRAINING AND RETAINING RINGS FOR PVC AND DI PIPE 400mm AND UNDER	DATE:	MAY 2001
		REV. DATE:	NONE
		DWG. No.:	W25.5

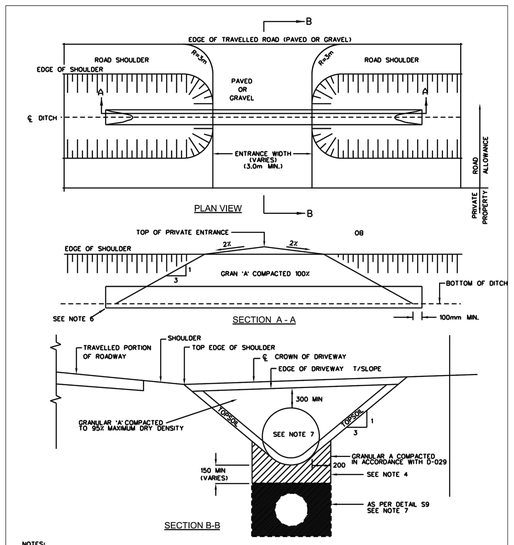

NOTES:

1. APPROVED NEW CULVERT MATERIAL ONLY, MIN. 500mm UNLESS SPECIFIED OTHERWISE, DITCH AND CULVERT TO BE SIZED ACCORDING TO SEWER DESIGN GUIDELINE MANUAL.
2. LENGTH OF CULVERTS IS DEPENDENT UPON THE DEPTH OF DITCH AND WIDTH OF ENTRANCE.
3. ENTRANCE CULVERTS GREATER THAN 900mm DIA. OR MULTIPLE CULVERTS MUST BE APPROVED PRIOR TO INSTALLATION. CULVERTS OVER 12m LONG AND HEADWALLS REQUIRE APPROVAL AND PERMIT BY THE CITY.
4. IN FROST SUSCEPTIBLE SOILS SPECIAL BEDDING CONDITIONS WILL BE REQUIRED.
5. REMOVE ALL ORGANICS FROM SIDE SLOPES AND DITCH BOTTOM PRIOR TO PLACING CULVERT AND GRANULARS.
6. CULVERT TO BE COUNTERSUNK 10% OF ITS DIAMETER BELOW FINISHED DITCH INVERT.
7. WHERE SPECIFIED, APPROVED DITCHED PIPE TO BE AT A MINIMUM GRADE OF 0.5% AND BE NON-PERFORATED TYPE UNDER CULVERTS.
8. SEE WS 22.15 FOR APPROVED PRODUCTS. UNLESS OTHERWISE STATED IN THE CONTRACT, CONSTRUCTION AS PER OPSS 421.
9. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.

Ottawa	PRIVATE ENTRANCE DETAIL - RURAL	DATE:	MAY 2001
		REV. DATE:	MARCH 2016
		DWG. No.:	S26

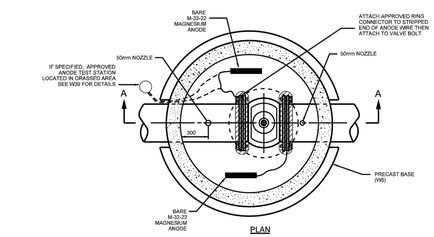

PLAN

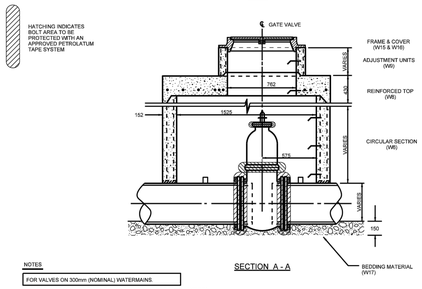

SECTION A - A

NOTES:

FOR VALVES ON 300mm (NOMINAL) WATERMAINS

1. CLEARANCE AROUND PIPE AT CHAMBER WALL TO BE 50mm MINIMUM.
2. VALVE CHAMBERS IN LIEU OF BOXES ON WATERMAINS SMALLER THAN 300mm ONLY TO BE USED, IF APPROVED BY THE CONTRACT ADMINISTRATOR.
3. REFER TO MW-13.1 FOR ADDITIONAL REQUIREMENTS.
4. REFER TO MW-18.15 FOR APPROVED MANUFACTURERS.
5. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS SHOWN OTHERWISE.
6. CATHODIC PROTECTION MEASURES SHALL BE INSTALLED IN ACCORDANCE WITH W26, W40 AND W42.
7. TRACER WIRE REQUIRED FOR PVC, PEX AND HDPE WATERMAIN PIPE ONLY AS PER W26. TRACER WIRE TO BE CONNECTED TO VALVE BOLT AS PER W45 AND SECURED TO TOP OF CHAMBER.

Ottawa	CIRCULAR CHAMBER GATE VALVES	DATE:	MAY 2001
		REV. DATE:	MARCH 2021
		DWG. No.:	W3

TABLE OF RESTRAINED LENGTHS FOR DI AND PVC WATERMAIN PIPE IN STANDARD GRANULAR 'A' EMBEDMENT IN SOILS OF BEARING CAPACITY OF 100 KPa AND OVER

REDUCERS — LARGER DIAMETER SIDE (TO BE RESTRAINED)

SMALLER DIAMETER (UNRESTRAINED)	100mm	150mm	200mm	250mm	300mm	400mm
100mm	N/A	3	6	8	10	14
150mm	N/A	N/A	4	6	9	13
200mm	N/A	N/A	N/A	3	6	11
250mm	N/A	N/A	N/A	N/A	4	9
300mm	N/A	N/A	N/A	N/A	N/A	7
400mm	N/A	N/A	N/A	N/A	N/A	N/A

PIPE DIAMETER

	100mm	150mm	200mm	250mm	300mm	400mm
DEAD ENDS, CAPS, PLUGS, VALVES						
BEFORE CAPS AND EITHER SIDE OF VALVES - L	5	6	9	10	12	16
VERTICAL BENDS						
LENGTH HIGH SIDE - LHS	3	4	5	6	7	9
LENGTH LOW SIDE - LLS	1.5	2	2.5	3	3.5	4.5
TEES						
LENGTH ALONG THE BRANCH - L	1	1	1	1	1	1
LENGTH ALONG THE RUN - Lr	3	3	3	3	3	3
HORIZONTAL BENDS						
11.25, 22.5, AND 45 DEGREE BENDS	1	1.5	1.5	2	2	2.5

NOTES:

1. THE ABOVE RESTRAINED LENGTHS MEET OR EXCEED THE WATERMAIN DESIGN CRITERIA FOR FUTURE ALTERATIONS AUTHORIZED UNDER A DRINKING WATER WORKS PERMIT.
2. THE ASSUMPTIONS MADE FOR THE ABOVE CALCULATIONS ARE AS FOLLOWS:
   a) MAXIMUM OPERATING PRESSURE OF 100 psi.
   b) MAXIMUM SURGE PRESSURE WITH A FLOW VELOCITY CHANGE OF 0.6 m/s OF 115 psi (115 psi FOR CLASS 52 DI AND FOR PVC MAX. SURGE IS 35 psi)
3. FOR SOFTWARE CALCULATIONS A TEST PRESSURE OF 150 psi AND A SAFETY FACTOR OF 1.5 WAS USED WHICH RESULTS IN 225 psi MAXIMUM PRESSURE.
4. TYPE 5 TRENCH BEDDING.
5. DEPTH TO BURY 2.4 METRES EXCEPT FOR VERTICAL BENDS WHERE THE HIGH SIDE IS AT 1.8 METRES.
6. EMBEDMENT MATERIAL GRANULAR 'A' WITH CHARACTERISTICS OF ASTM D2487 GP.
7. GP SOILS ARE DESCRIBED AS POORLY GRADED GRAVEL AND SAND-GRAVEL MIXES WITH LITTLE OR NO FINES.
8. (Lr) MUST BE OF SOLID PIPE WITHOUT JOINTS, FITTINGS, ETC.
9. THE TABLES APPLY TO BOTH DUCTILE IRON AND PVC. WHERE ONE LENGTH EXCEEDED THE OTHER THE LONGER LENGTH WAS USED.
10. RESTRAINED LENGTHS ARE IN METRES.

Ottawa	TABLES OF RESTRAINED LENGTHS FOR PVC AND DI PIPE 400mm AND UNDER	DATE:	MAY 2001
		REV. DATE:	MARCH 2011
		DWG. No.:	W25.6

CLIENT LOGO:

FASTFRATE

CBRE

KEY PLAN:



TRUE NORTH: PROJECT NORTH:



RECORD OF REVISIONS:

NUMBER:	REVISION:	DATE: (MM/DD/YYYY)
6		
5		
4		
3		
2	ISSUED FOR SITE PLAN CONTROL REV. 2	JUNE 7, 2022
1	ISSUED FOR SITE PLAN APPROVAL	DECEMBER 16, 2021

ISSUE:

PRELIMINARY 33%
NOT FOR CONSTRUCTION

PROFESSIONAL STAMP:

PROFESSIONAL STAMP:

CIVITAS GROUP
ARCHITECTURE & LANDSCAPE ARCHITECTURE

CIVITAS ARCHITECTURE INC OTTAWA, ON T: 613.742.7482
14 CHAMBERLAIN AVENUE, SUITE 101 CANADA K1S 1V9 WWW.CIVITAS-INC.CA

CONSULTANT LOGO:

PROJECT TITLE:

FASTFRATE OTTAWA WAREHOUSE AND DISTRIBUTION FACILITY

SCALE: NONE

SOMME ST.
OTTAWA, ON

DRAWING TITLE:

DETAILS

DRAWN BY: D.CANN DRAWING NUMBER:
DATE:
REVIEWED BY: J.SAUVE C014
APPROVED BY:
PRINT DATE: REVISION NUMBER:
ISSUED DATE: NOVEMBER 26, 2021
CLIENT PROJECT #: PROJECT #: A001083

DO NOT SCALE THIS DRAWING. USE FIGURE DIMENSIONS ONLY. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ALL DIMENSIONS AND NOTIFYING THE ARCHITECT OF ANY DISCREPANCIES BEFORE CONSTRUCTION COMMENCES. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL STRUCTURAL, MECHANICAL, ELECTRICAL, CIVIL, AND OTHER CONSULTANT DRAWINGS. THIS DRAWING SHALL NOT BE USED FOR CONSTRUCTION PURPOSES UNLESS SIGNED BY THE ARCHITECT. COPYRIGHT RESERVED. ALL PARTS OF THIS DRAWING ARE THE EXCLUSIVE PROPERTY OF THE ARCHITECT AND SHALL NOT BE USED WITHOUT THE EXPRESSED PERMISSION FROM THE ARCHITECT.

Z:\CIMA-C10\OTT_PROJECTS\A\A001000-A001499\A001083_FASTFRATE WAREHOUSE DEVELOPMENT\400\460_CIVIL