

ACCESS PROPERTY DEVELOPMENT INC

415 LEGGET DRIVE STORMWATER MANAGEMENT REPORT

AUGUST 04, 2022





415 LEGGET DRIVE STORMWATER MANAGEMENT REPORT

ACCESS PROPERTY DEVELOPMENT INC

3RD SUBMISSION

PROJECT NO.: 219-00058-04

CLIENT REF:

DATE: AUGUST 04, 2022

WSP
SUITE 300
2611 QUEENSVIEW DRIVE
OTTAWA, ON, CANADA K2B 8K2

T: +1 613 829-2800

F: +1 613 829-8299

WSP.COM

REVISION HISTORY

FIRST ISSUE

October 22 nd , 2021	Draft SWM Report			
Prepared by	Reviewed by	Approved By		
MO	AJ	AJ		
SECOND ISSUE				
March 25 th , 2022	SWM Report			
Prepared by	Reviewed by	Approved By		
MO	AJ	AJ		
THIRD ISSUE				
August 4 th , 2022	SWM Report			
Prepared by	Reviewed by	Approved By		
KK	AJ	AJ		

SIGNATURES

PREPARED BY



Kathryn Kerker, M.A.Sc.
Designer, Water Resources

August 4th, 2022

APPROVED¹ BY



Ayham Jadallah, M.Eng., P.Eng.
Project Engineer, Water Resources

August 4th, 2022

WSP Canada Inc. (“WSP”) prepared this report solely for the use of the intended recipient, ACCESS PROPERTY DEVELOPMENT INC, in accordance with the professional services agreement. The intended recipient is solely responsible for the disclosure of any information contained in this report. The content and opinions contained in the present report are based on the observations and/or information available to WSP at the time of preparation. If a third party makes use of, relies on, or makes decisions in accordance with this report, said third party is solely responsible for such use, reliance or decisions. WSP does not accept responsibility for damages, if any, suffered by any third party as a result of decisions made or actions taken by said third party based on this report. This limitations statement is considered an integral part of this report.

The original of this digital file will be conserved by WSP for a period of not less than 10 years. As the digital file transmitted to the intended recipient is no longer under the control of WSP, its integrity cannot be assured. As such, WSP does not guarantee any modifications made to this digital file subsequent to its transmission to the intended recipient.

¹ Approval of this document is an administrative function indicating readiness for release and does not impart legal liability on to the Approver for any technical content contained herein. Technical accuracy and fit-for-purpose of this content is obtained through the review process. The Approver shall ensure the applicable review process has occurred prior to signing the document.

CONTRIBUTORS

CLIENT

Access Property Development Inc.

WSP

Water Resources, Designer Kathryn Kerker

Water Resources, Project Engineer Ayham Jadallah



TABLE OF CONTENTS

1	INTRODUCTION	1
1.1	Scope	1
1.2	Site Location	1
1.3	Stormwater Management Plan Objectives	2
1.4	Design Criteria	2
2	PRE-DEVELOPMENT CONDITIONS	3
2.1	General	3
2.2	Rainfall Information	4
2.3	Allowable Flow Rates	4
3	POST-DEVELOPMENT CONDITIONS	5
3.1	General	5
3.2	Water Quantity	6
3.2.1	Existing Wet Pond	7
3.3	Water Quality	9
3.4	Floodplain Considerations	10
3.5	Temperature Considerations	11
4	CONCLUSIONS	12

TABLES

TABLE 1: PRE-DEVELOPMENT CATCHMENT CHARACTERISTICS.....	3
TABLE 2: PRE-DEVELOPMENT PEAK FLOW RATES.....	4
TABLE 3: POST DEVELOPMENT CATCHMENT CHARACTERISTICS.....	5
TABLE 4: PRE VS POST DEVELOPMENT FLOW RATES.....	6
TABLE 5: PCSWMM MODELING RESULTS.....	7
TABLE 6: PCSWMM RESULTS - WET POND.....	9

FIGURES

FIGURE 1: SITE LOCATION.....	1
FIGURE 2: EXISTING POND OUTLET STRUCTURE.....	8
FIGURE 3: EXISTING DRAINAGE.....	8
FIGURE 4: PLAN, PROFILE, AND SECTION VIEWS OF GRASS SWALE (REF: TRCA, 2010).....	10

APPENDICES

A	PRE-CONSULTATION MEETING MINUTES AND TECHNICAL COMMENTS
B	EXHIBITS
C	CALCULATIONS & PCSWMM OUTPUT
D	MVCA FLOODPLAIN MAP
E	SUPPORTING DOCUMENTS

1 INTRODUCTION

1.1 SCOPE

WSP Canada Inc. was retained by Access Property Development Inc. to prepare a Stormwater Management (SWM) report for the proposed development at 415 Legget Drive in Ottawa, Ontario. This SWM report examines the potential water quality and quantity impacts of the proposed commercial development and summarizes how each will be addressed in accordance with applicable guidelines.

1.2 SITE LOCATION

The site of the proposed commercial development is located at 415 Legget Drive, Ottawa, Ontario. The subject site is bounded by Solandt Road to the north, Legget Drive to the west, other commercial properties to the south, and a golf course to the east. The site is accessed via Legget Drive and Solandt Road. The site location is shown in Figure 1.

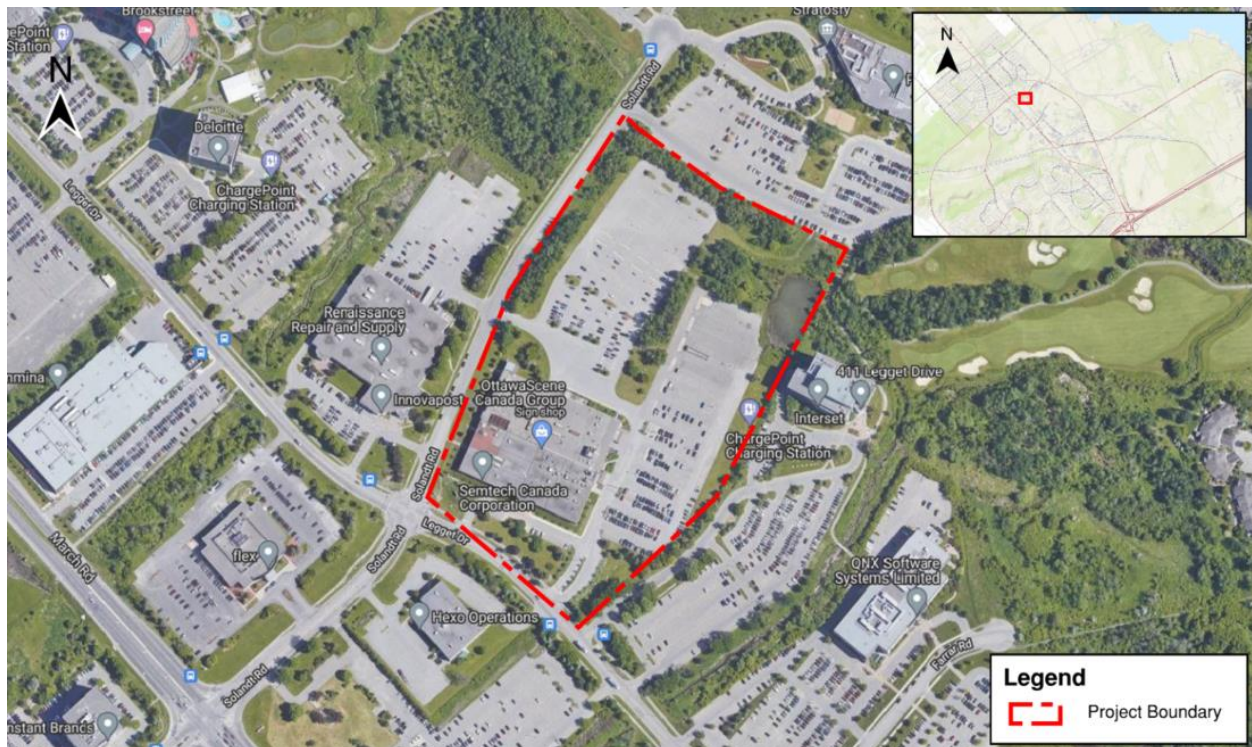


Figure 1: Site Location

1.3 STORMWATER MANAGEMENT PLAN OBJECTIVES

The objectives of the stormwater management plan are as follows:

- Collect and review background information
- Determine the site-specific stormwater management requirements to ensure that the proposals are in conformance with the applicable Provincial, Municipal and Conservation Authority stormwater management and development guidelines.
- Evaluate various stormwater management practices that meet the applicable SWM and development requirements and recommend a preferred strategy.
- Prepare a stormwater management report documenting the strategy along with the technical information necessary for the justification and sizing of the proposed stormwater management facilities.

1.4 DESIGN CRITERIA

Design criteria were obtained through a pre-consultation meeting with the City of Ottawa held on September 27th, 2021 (meeting minutes included in **Appendix A**). Criteria for 415 Legget Drive are as follows:

- **Stormwater Quantity**- control post-development flows to pre-development levels for the 2- to 100-year storm events. The existing drainage patterns for the site should be maintained. Allowable runoff coefficient (C) shall be the lesser of pre-development conditions to a maximum of 0.5.
- **Storm Quality**- enhanced level of protection per the Mississippi Valley Conservation Authority (MVCA) is required (80% TSS Removal).

2 PRE-DEVELOPMENT CONDITIONS

2.1 GENERAL

The subject site is a 7.28 ha parcel of land comprised of two paved parking areas and an existing commercial building. Vehicular access to the site is via two entrances on Legget Drive and Solandt Road. Under pre-development conditions the subject site consists of primarily impervious building and parking area with the exception of the north-east corner of the property which is undeveloped pervious area. Within the north-east corner of the site there is an existing stormwater management wet pond. Existing drainage patterns for the site were determined based on topographic survey information. With the exception of the existing building and a small portion along the north and west border of the site which drains to Solandt Rd, existing site drainage is towards the existing wet pond which discharges into the Kizell Drain. The existing building roof drainage discharges via roof drains into the Solandt Road sewer. It should be noted that the existing building will remain unchanged in the proposed development and therefore no new quantity or quality control measures are proposed for this area (S-BEX). Additionally, as shown on the exhibits found in **Appendix B**, there is approximately 0.28 ha of external drainage area from the adjacent property to the south draining towards the site and into the existing wet pond. This area was considered in both the pre and post development calculations. The pre-development catchment characteristics are summarized in Table 1 and illustrated in Exhibit 1 and 2 in **Appendix B**.

Table 1: Pre-development Catchment Characteristics

CATCHMENT ID	AREA (ha)	% COVERAGE OF PROJECT AREA	RUNOFF COEFFICIENT
External Drainage Areas to Wet Pond / Kizell Drain			
S-EXT1	0.28		0.35
Un-Controlled Drainage Areas to Solandt Rd			
S-U1	0.76	10.4%	0.23
S-BEX	0.97	13.3%	0.90
Un-Controlled Drainage Areas to Wet Pond / Kizell Drain			
S-U2**	5.55	76.2%	0.63*
TOTAL PROJECT AREA	7.28	100%	0.62
TOTAL (INCL. EXTERNAL DRAINAGE)	7.56		0.61

*Runoff coefficient of 0.50 used for pre-development PCSWMM model per OSDG 8.3.7.3

**Includes "Pond" catchment

2.2 RAINFALL INFORMATION

The rainfall intensity is calculated in accordance with Section 5.4.2 of the Ottawa Sewer Design Guidelines (October, 2012):

Where;

$$i = \left[\frac{A}{(Td + C)^B} \right]$$

- A, B, C = regression constants for each return period (defined in section 5.4.2)
- i = rainfall intensity (mm/hour)
- Td = storm duration (minutes)

The IDF parameters/regression constants are per the Ottawa Sewer Design Guidelines (October, 2012).

2.3 ALLOWABLE FLOW RATES

As noted in section 1.4, relevant policies from the OSDG for a re-development and the pre-consultation meeting require the post-development discharge rate from the site match pre-development levels for the 2- to 100-year storm events where pre-development conditions are analyzed using the lesser of the actual runoff coefficient and a runoff coefficient of 0.5.

PCSWMM was used to analyze the existing conditions for the site and determine the allowable peak flow rates from the site into the existing wet pond and Solandt Rd, results are summarized in Table 2. It should be noted that “OF_1 – Wet Pond” is the existing peak inflow from the site into the pond, as to not interfere with existing wet pond function, the primary quantity control target was to control proposed flows from the site and into the wet pond to existing conditions. “OF2_2 – Kizell Drain” is an estimate of the peak flows discharging from the pond into the Kizell Drain based on the surveyed outlet. Detailed PCSWMM results are provided in **Appendix C**.

Table 2: Pre-Development Peak Flow Rates

OUTFALL	PEAK FLOW RATE (m ³ /sec)					
	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
OF1 – Solandt Rd	0.22	0.33	0.40	0.50	0.58	0.66
OF2_1 – Wet Pond	0.29	0.54	0.73	1.00	1.21	1.43
OF2_2 – Kizell Drain	0.07	0.16	0.23	0.31	0.38	0.42

3 POST-DEVELOPMENT CONDITIONS

3.1 GENERAL

The proposed Legget Drive project is a commercial development in Ottawa, Ontario. Post development condition catchment characteristics are summarized in Table 3 and illustrated on Exhibits 3 and 4 found in **Appendix B**. The proposed development includes the construction of two additional commercial buildings over a portion of the two existing parking areas. Vehicular access to the site will continue to be via the existing entrances off Legget Drive and Solandt Road. In general, existing drainage patterns are maintained with the majority of the site draining to the existing wet pond.

Table 3: Post Development Catchment Characteristics

CATCHMENT ID	AREA (HA)	% COVERAGE OF PROJECT AREA	RUNOFF COEFFICIENT
External Drainage Areas to Wet Pond / Kizell Drain			
S-U2 (external portion)	0.08		0.67
S-U4 (external portion)	0.19		0.20
Un-Controlled Drainage Areas to Solandt Rd			
S-U1	0.59	8.1%	0.28
S-BEX	0.97	13.3%	0.90
Un-Controlled Drainage Areas to Wet Pond / Kizell Drain			
S-U2 (internal portion)	2.03	27.8%	0.74
S-U3	0.56	7.7%	0.84
S-U4 (internal portion)	0.22	3.0%	0.21
S-U5	0.18	2.5%	0.20
S-U6	0.05	0.7%	0.20
S-U7	0.37	5.1%	0.20
S-U8*	0.47	6.4%	0.20
Controlled Drainage Areas to Wet Pond / Kizell Drain			
S-BA	1.12	15.4%	0.90
S-BB	0.72	9.9%	0.90
TOTAL PROJECT AREA	7.28	100%	0.68
TOTAL (INCL. EXTERNAL DRAINAGE)	7.56		0.66

*Includes "Pond" catchment

To meet stormwater management objectives, as defined by the design criteria outlined in Section 1.4, the following components have been proposed:

- Roof storage on the two proposed buildings, controlled by WATTS Adjustable Flow Control Roof Drains (or equivalent)
- Existing Wet Pond
- Enhanced grassed swales

The application and sizing of these proposed stormwater management facilities is outlined in the following sections.

3.2 WATER QUANTITY

As noted previously, it is required that the post-development discharge rate from the site match pre-development levels for the 2- to 100-year storm events.

Proposed features to achieve these targets include:

- Roof storage with flow control roof drains

PCSWMM software has been used to model the behaviour of the proposed SWM system and determine its response under various storm events. The model was developed and tested in an iterative manner to determine the necessary storage volumes and flow control rates from the two proposed buildings. Roof storage areas were defined using storage nodes in the model, with appropriate stage-storage relationships based on the volumes available in each area. Outflow controls from each storage node were defined using outlets with appropriate head-discharge curves as defined using manufacture information provided in **Appendix E**.

A summary of the modeling results is provided in Table 4 and Table 5, detailed PCSWMM modeling results are provided in **Appendix C**.

The model was developed assuming 90% of the roof area is available for storage, as shown on the roof plan, discharge from Building A and Building B will be controlled by 18 and 15 WATTS Adjustable Flow Control Roof Drains (or equivalent) respectively.

Table 4: Pre vs Post Development Flow Rates

OUTFALL	PEAK FLOW RATE (m ³ /sec)					
	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Existing Conditions						
OF1 – Solandt Rd	0.22	0.33	0.40	0.50	0.58	0.66
OF2_1 – Wet Pond	0.29	0.54	0.73	1.00	1.21	1.43
OF2_2 – Kizell Drain	0.07	0.16	0.23	0.31	0.38	0.42
Proposed Conditions						
OF1 – Solandt Rd	0.23	0.33	0.40	0.49	0.56	0.64
OF2_1 – Wet Pond	0.27	0.43	0.54	0.68	0.78	0.91
OF2_2 – Kizell Drain	0.07	0.11	0.15	0.20	0.24	0.28

Table 5: PCSWMM Modeling Results

RETURN PERIOD (Years)	BUILDING A			BUILDING B		
	ROOF STORAGE UTILIZED (m ³)	ROOF PONDING DEPTH (mm)	ROOF STORAGE AVAILABLE (m ³)	ROOF STORAGE UTILIZED (m ³)	ROOF PONDING DEPTH (mm)	ROOF STORAGE AVAILABLE (m ³)
2	186	172	1148	110	152	581
5	275	198		163	176	
10	337	214		200	190	
25	416	230		248	206	
50	477	242		285	217	
100	541	253		324	227	

As shown in Table 5, there is a maximum roof ponding depth of 253 mm and 227 for buildings A and B respectively during the full range of storm events and there is sufficient storage volume available on both roofs to store up to and including the 100-yr event. The available storage volume was calculated as the volume available below the overflow scuppers (340 mm and 290 mm above the roof drains for Building A and B respectively).

3.2.1 EXISTING WET POND

As previously discussed, there is an existing wet pond in the north-east corner of the site. A Phase 1 Environmental Site Assessment completed by SRL in April 2021 determined that the existing wet pond is approximately 1 m deep and noted some additional ponding in the area around the pond as shown on Figure 3. It should be noted that the existing ponding area adjacent to the pond will be regraded in proposed conditions to promote positive drainage towards the wet pond and reduce risk of flooding the adjacent property. Detailed survey information found the pond to have an approximately 1,868 m² area at the top of the permanent pool and a top of water elevation of approximately 76.1 m at the time of the survey.

A survey of the outlet structure found that the metal plate containing a trapezoidal weir and rectangular opening had been lifted. It was assumed that this plate was designed to be down in existing conditions. Modelling for both existing and proposed conditions was done with the metal plate lowered, which sets the originally designed permanent pool elevation at 76.09 m. Discharge from the pond flows into a v-ditch and into the Kizell Drain as shown on the MVCA Floodplain Map in **Appendix D**.

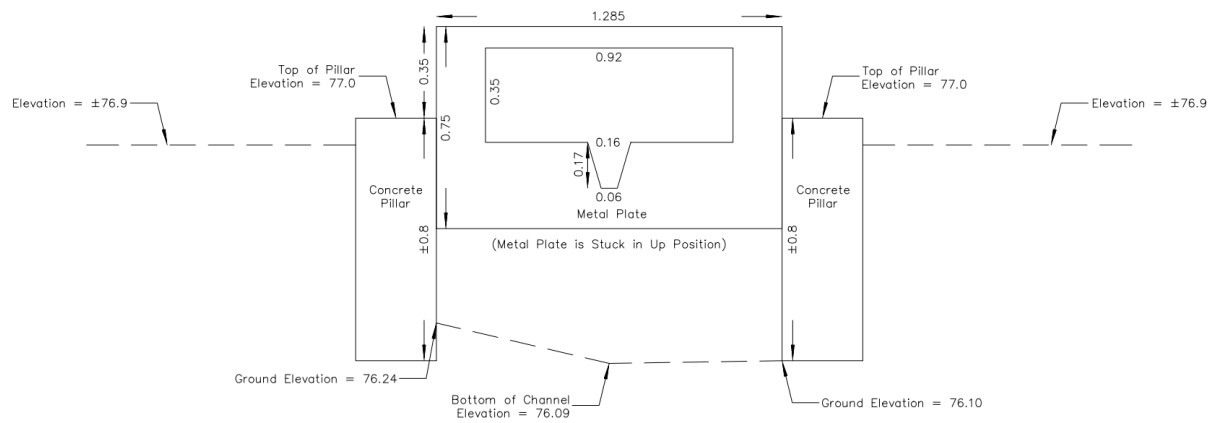


Figure 2: Existing pond outlet structure

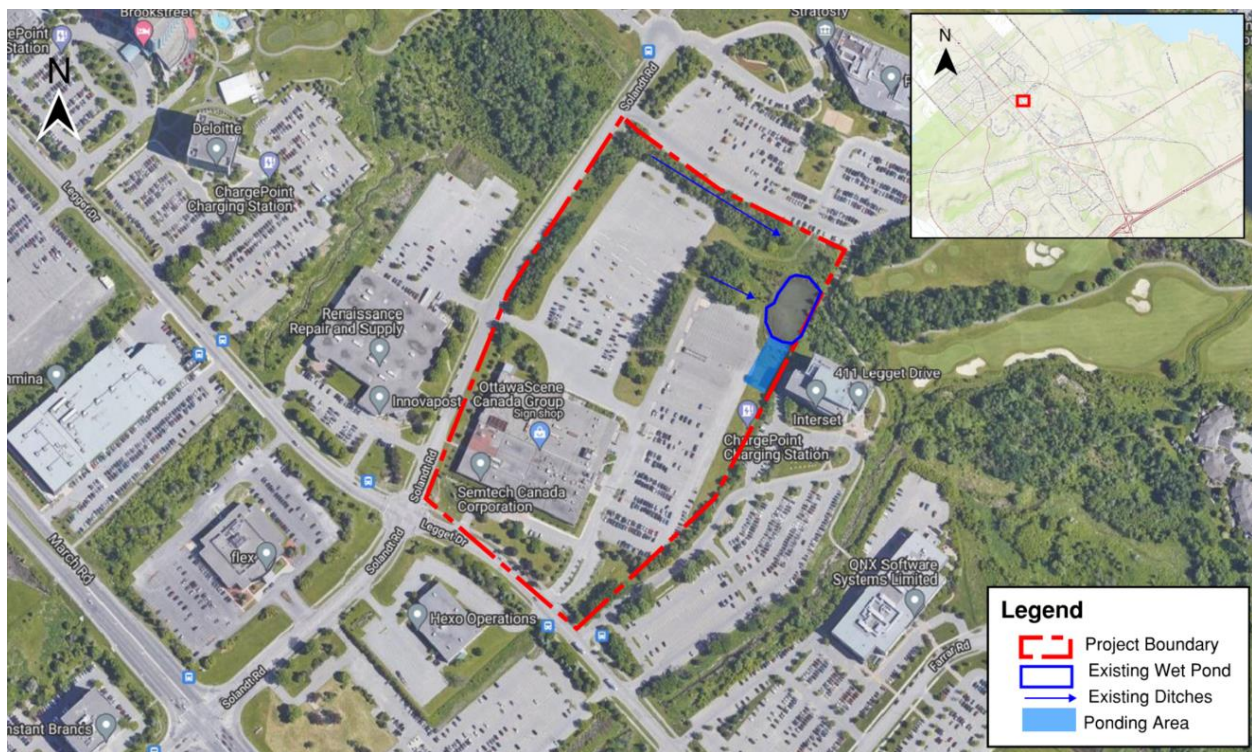


Figure 3: Existing Drainage

The existing wet pond was modeled using PCSWMM with the appropriate stage-storage information based on the available data. Existing contour lines were used to develop the storage curve above the water elevation. The pond was assumed to be 1 m deep (per the ESA) with 3:1 side slopes below the permanent pool. The wet pond storage curve is included in **Appendix C**.

A summary of the modeling results showing expected high-water elevations and maximum storage volumes in the pond in both existing and proposed conditions is shown in Table 6, as shown, the expected storage and water elevations in the pond are reduced in proposed conditions. Detailed modeling results can be found in **Appendix C**.

Table 6: PCSWMM Results - Wet Pond

RETURN PERIOD	2-YR	5-YR	10-YR	25-YR	50-YR	100-YR
Existing Conditions						
Estimated Permanent Pool Volume (m ³)	1862					
Active Storage Volume (m ³)	306	556	723	937	1093	1283
Total Storage Volume (m ³)	2168	2418	2585	2799	2955	3145
Maximum Water Elevation (m)	76.364	76.463	76.521	76.587	76.629	76.671
Proposed Conditions						
Estimated Permanent Pool Volume (m ³)	1862					
Active Storage Volume (m ³)	308	425	520	649	749	856
Total Storage Volume (m ³)	2170	2287	2382	2511	2611	2718
Maximum Water Elevation (m)	76.365	76.413	76.450	76.496	76.530	76.563

3.3 WATER QUALITY

As noted previously, the majority of site runoff will continue to drain to the existing wet pond on site and ultimately discharge into the Kizell Drain.

It is assumed that runoff from the proposed rooftop areas and walkways areas will be free of typical sediment-generating activities and therefore runoff will leave them effectively unchanged and can be considered clean for the purposes of water quality assessment. It should be noted that the typical sediment-generating activities are in areas with vehicular access, such as loading areas and parking areas. In the case of this development, the overall parking area is reduced and replaced with the roof areas of the proposed buildings. Therefore, the overall water quality leaving the site is considered to be improved upon existing conditions.

Under existing conditions, a treatment train approach of grassed ditches and a wet pond exist on site which will be maintained under proposed conditions. Vegetation in the grassed ditches allow for sedimentation and filtration. Additionally, wet ponds allow for extended detention times allowing sediment to settle out prior to discharge. Finally, site runoff is generally directed over pervious grassed area, helping to filter out additional sediment and slow the runoff, prior to entering the pond. The combination of the existing quality control measures on site, as well as the overall reduction in parking area, is considered sufficient to meet the quality control requirements of this site.

To further improve the water quality leaving the site, proposed swales have been designed as enhanced swales. As shown on Exhibit 3 found in **Appendix B**, all impervious area discharge to enhanced grass swales prior to discharge into the existing pond.

Enhanced grass swales are vegetated open channels that convey, treat and attenuate stormwater runoff. Flat bottoms and vegetation in the swale decrease the velocity of the water, allowing for sedimentation, and filtration through the root zone and soil, and evapotranspiration, and infiltration into the underlying soil (TRCA, 2010).

The enhanced grassed swales have been designed according to the below design guidance (TRCA,2010):

- Shape: Grass swales should be designed with a trapezoidal or parabolic cross section. Trapezoidal swales will generally evolve into parabolic swales over time, so the initial trapezoidal cross section design should be checked for capacity and conveyance assuming it is a parabolic cross section. Swale length between culverts should be 5 meters or greater;

- Bottom Width: Grass swales should be designed with a bottom width between 0.75 and 3.0 meters. The design width should allow for shallow flows and adequate water quality treatment, while preventing flows from concentrating and creating gullies;
- Longitudinal Slope: Slopes should be between 0.5% and 4%. Check dams should be incorporated on slopes greater than 3%;
- Length: When used to convey and treat road runoff, the length simply parallels the road, and therefore should be equal to, or greater than the contributing roadway length;
- Flow Depth: The maximum flow depth should correspond to two-thirds the height of the vegetation. Vegetation in some grass swales may reach heights of 150 mm; therefore, a maximum flow depth of 100 mm is recommended during a 4-hour, 25 mm Chicago storm event;
- Side Slopes: The side slopes should be as flat as possible to aid in providing pre-treatment for lateral incoming flows and to maximize the swale filtering surface. Steeper side slopes are likely to have erosion gullying from incoming lateral flows. A maximum slope of 2.5:1 (H:V) is recommended and a 4:1 slope is preferred where space permits.
- Drainage Area and Runoff Volume: The conveyance capacity should match the drainage area. Sheet flow to the grass swale is preferable. If drainage areas are greater than 2 hectares, high discharge through the swale may not allow for filtering and infiltration, and may create erosive conditions. Typical ratios of impervious drainage area to swale area range from 5:1 to 10:1.

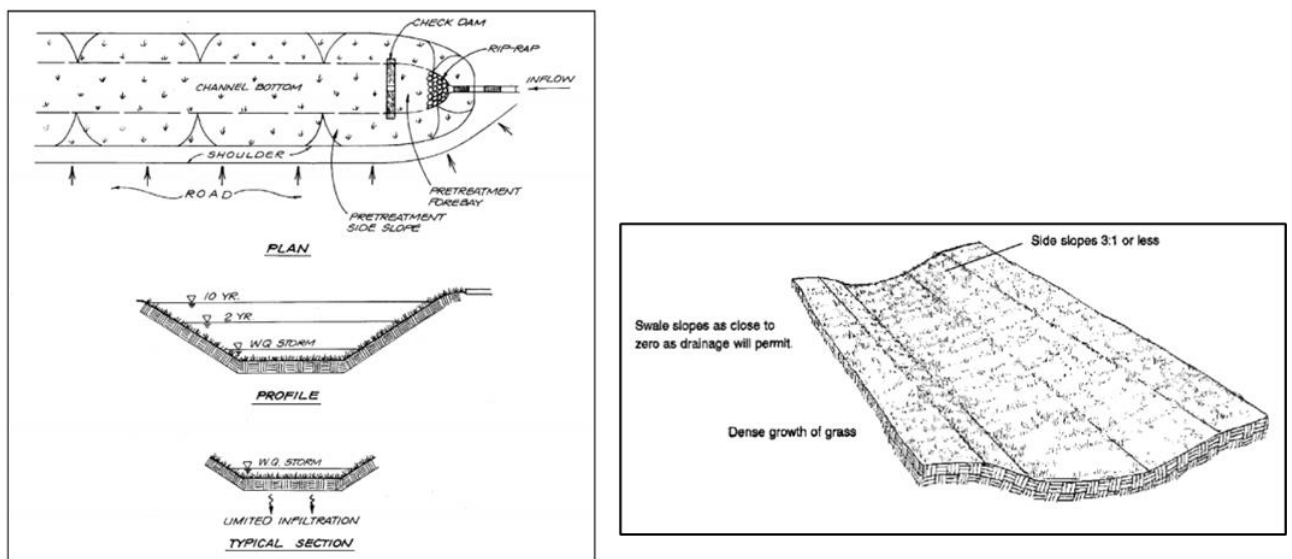


Figure 4: Plan, Profile, and Section Views of Grass Swale (ref: TRCA, 2010)

A detailed enhanced grass swale design sheets is included in **Appendix C**.

3.4 FLOODPLAIN CONSIDERATIONS

A flood plain map was provided by the MVCA and is included in **Appendix D**. As shown on the map, the proposed development is outside of both the Kizell Drain and Shirley's Brook 1:100-year floodplain and therefore loss of floodplain storage is not a concern in the case of this development.

3.5 TEMPERATURE CONSIDERATIONS

Proposed enhanced grass swales as well as the vegetation surrounding the existing pond help to cool runoff as it passes along / through naturally vegetated media and infiltrate flows from asphalt surfaces. Furthermore, existing trees around the wet pond further cool water within the pond.

In conjunction, the above measures are considered sufficient to address MVCA requirements related to temperature of storm runoff from the site.

4 CONCLUSIONS

A stormwater management report has been prepared to support the feasibility study for the proposed development at 415 Legget Drive in the City of Ottawa. The key points are summarized below.

WATER QUALITY

Enhanced grassed swales, and stormwater management wet pond is considered sufficient to meet the quality control requirements for the site.

WATER QUANTITY

Quantity control will be provided via roof storage on the two proposed buildings, controlled with flow control roof drains.

APPENDIX

A

PRE-CONSULTATION
MEETING MINUTES
AND TECHNICAL
COMMENTS

Pre-Application Consultation Meeting Notes

11:00am to 12:00pm, September 27, 2021, via Microsoft Teams
Property Address: 415 Legget Drive and 2700 Solandt Road
File No.: PC2021-0327

Attendees:

Molly Smith – Planner, City of Ottawa
Matthew Ippersiel – Planner (Urban Design), City of Ottawa
Matthew Hayley – Planner (Environmental), City of Ottawa
Jeffrey Ren – Co-op Student, City of Ottawa
Jill MacDonald – WSP
Justyna Garbos – WSP
Survir Pursnani – WSP
Jie Chen – Architecture49
Frank Abrantes – Access Storage
Hind Barnieh – Access Storage

Regrets:

Mark Richardson – Forester, City of Ottawa
Neeti Paudel – Project Manager (Transportation), City of Ottawa
Jessica Valic – Project Manager (Infrastructure), City of Ottawa
Jeff Goettling – Planner (Parks), City of Ottawa

Applicant's Proposal:

- The proposed development will be split into two phases – the first phase is interior retrofit of the existing building and the second phase is the construction of the two new warehouse buildings in the current parking lot
- The new buildings will be between 24 and 36 feet in height
- A total of 176 surface level parking spaces will be provided
- Access to the proposed development will be via the three existing accesses from Legget Drive and Solandt Road
- No minor variance being sought; the applicants expect that the proposed development conforms to the Zoning By-law.
- The applicant is targeting a submission on or before October 27

Preliminary comments and questions from staff and agencies, including follow-up actions:

Infrastructure

Water

Available Watermain

- 305mm (DI) – Legget Dr (existing 250mm service is located off this main)
- 305mm (PVC) – Solandt Rd

- Per WDG 4.3.1, where basic demand is greater than 50 m³/day, there shall be a minimum of two water services, separated by an isolation valve, to avoid creation of vulnerable service area.
- Per WDG 4.4.7.2, District Meter Area (DMA) Chamber is required for services greater than 150mm in diameter.
- Only one water service is permitted per parcel. Servicing for additional buildings must be accomplished through internal branching of existing water service. If larger water service is required to accommodate additional development, please utilize the location of the existing service to limit cuts in watermain. If a new service is required, and existing location cannot be used, the existing service must be blanked at the main
- Demonstrate that the water service is adequately sized for increased water use.
- Demonstrate that adequate fire flow from fire hydrants and required pressures per City of Ottawa Water Design Guidelines are available. Provide fire hydrant coverage plan.

Boundary Conditions

Request prior to first submission. Contact assigned City Infrastructure Project Manager with the following information

- Location of service(s)
- Type of development
- Fire flow (per FUS method – include FUS calculation sheet with boundary condition request – boundary conditions will not be requested without fire flow calculations)
- Average Daily Demand (l/s)
- Maximum Hourly Demand (l/s)
- Maximum Daily Demand (l/s)

Sanitary

Available Sanitary Sewer

- 750mm (CONR) – Legget Dr – Marchwood Collector
- No available sanitary main on Solandt Rd
- Connections to collector sewers are discouraged. It is assumed that the existing building sanitary service is connected to this collector sewer. Reuse existing connection location to limit cuts in sanitary sewer.
- Demonstrate that the existing sanitary service is adequately sized for increased flow.
- Demonstrate that there is sufficient/adequate residual capacity in the receiving system to accommodate increase in flow
- Provided the existing service is adequately sized, please CCTV existing lateral to determine the condition of the lateral and submit CCTV video and report with application. If service is in poor condition, repair/replacement will be required.

Storm

Available Storm Sewer

- 525mm (CONC) – Solandt Rd
- 375mm (PVC) – Legget Dr

Stormwater Management

- Quantity Control
 - Required for the site up to and including the 100-yr storm event.
 - Refer to Shirley's Brook and Watts Creek Subwatershed Study Report for relevant environmental protection targets.
 - Consult Stormwater Management Plan, Kanata Research Park, City of Kanata for relevant stormwater management criteria.
 - Existing ditch system and wet pond exist on site.
 - If underground/inline stormwater storage is proposed, an average release rate equal to 50% of the determined peak allowable rate must be used. Otherwise, disregard the underground/inline storage as available storage or provide modeling to support the proposed design. The reasoning for this restriction is that the discharge rate at full storage is not representative of the discharge rate for more frequent storm events. Halving the discharge rate compensates for the inaccuracies of the modified rational method when underground storage is used.
 - Provide both pre and post development stormwater management plans, showing individual drainage areas and their respective coefficient.
 - If roof storage is proposed, please provide a roof drainage plan showing the 5 and 100-year storm ponding levels. Include the roof drain type, opening settings, and flow rate.
 - Per Technical Bulletin PIEDTB-2016-01 section 8.3.11.1 there shall be no surface ponding on private parking areas during the 2-year storm rainfall event.
 - Please note that the minimum orifice dia. for a plug style ICD is 83mm and the minimum flow rate from a vortex ICD is 6 L/s in order to reduce the likelihood of plugging.
- Quality Control: Please consult Conservation Authority (CA) regarding water quality control restrictions for the subject site. Include correspondence in servicing report.
- Ministry of Environment, Conservation, and Parks (MECP): Designer to determine if approval for sewage works under Section 53 of OWRA is required and to determine the type of application required. Reviews will be done through Transfer of Review or Direct Submission.
- Stormwater drainage systems that are designed to accommodate drainage from two separate parcels require an ECA.

Geotechnical Investigation

- Geotechnical Report is required for this development proposal.
- The Geotechnical Report shall speak to any proposed underground stormwater storage and provide confirmation that the site subsurface characteristics (groundwater table elevation, soil type) are appropriate. Of note, the high groundwater table must be 1.0m above the bottom of any proposed storage system per MECP requirements.

Exterior Lighting

- If exterior light fixtures are proposed, provide a plan showing the location of all exterior fixtures and include a table providing fixture details (make, model, mounting heights). All external light fixtures must meet the criteria for full cut-off classification as recognized by the Illuminating Engineering Society of North America (IESNA or IES), resulting in minimal light spillage onto

adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable spillage). Provide certification letter from a relevant Professional Engineer.

Required Studies

- Servicing/Stormwater Management Report (Submit completed Servicing Study Checklist with Servicing Report)
- Geotechnical Investigation

Required Plans

- Site Servicing Plan
- Grade Control and Drainage Plan (Show major overland flow route)
- Erosion and Sediment Control Plan (Can be combined with grading plan)
- Existing Conditions and Removals Plan
- SWM Plans

General Information

1. The Servicing Study Guidelines for Development Applications are available at the following address: <https://ottawa.ca/en/city-hall/planning-and-development/information-developers/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans#servicing-study-guidelines-development-applications>
2. Servicing and site works shall be in accordance with the following documents:
 - Ottawa Sewer Design Guidelines (October 2012) (including subsequent Technical Bulletins)
 - Ottawa Design Guidelines – Water Distribution (2010) (including subsequent Technical Bulletins)
 - Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
 - Ottawa Standard Tender Documents (latest version)
3. Record drawings and utility plans are also available for purchase from the City (Contact the City's Information Centre by email at InformationCentre@ottawa.ca or by phone at (613) 580-2424 x.44455).
4. Any proposed work in utility easements requires written consent of easement owner.
5. **All submitted report and plan pdf documents to be flattened and unsecured to allow for editing and ease of use.**
6. All documents prepared by Engineers shall be signed and dated on the seal.

Please contact Infrastructure Project Manager Jessica Valic (jessica.valic@ottawa.ca) for follow-up questions.

Planning

- The application will be considered Site Plan Control (Manager Approval, Public Consultation), please fine the application form and information on fees [here](#).
- Please review the following Official Plan policies and Zoning By-law provisions:

- The subject site is designated as [Urban Employment Area](#) in the Official Plan
- The subject site is zone [Business Park Industrial Zone, Subzone 6 – Kanata North Business Park \(IP6\)](#).
- The New Official Plan will be going to Planning Committee on October 14, 2021 and then to City Council for adoption on October 27, 2021 – please be aware of the following New Official Plan policies:
 - The subject site is designated as ‘Kanata North Economic District’ with an ‘Evolving Neighbourhood’ overlay; policies for the ‘Kanata North Economic District’ can be found under [Section 6.6.3.2 of the revised draft New Official Plan](#).
 - Please provide a review and summary of the designation and applicable policies as they apply to the site.
 - The ‘Kanata North Economic District’ is expected to be the site of a Community Planning Permit System pilot project – the pilot project would require the passage of a Community Planning Permit System by-law after the New Official Plan comes into effect.
 - A complete application is received by no later than the day before the new Official Plan is adopted (October 27, 2021), it will be processed on the basis of existing Official Plan policy provided it is consistent with the 2020 Provincial Policy Statement.
 - Applications received after the day before the new Official Plan is adopted will be reviewed and evaluated on the basis of the policies of the new Official Plan.
 - Based on the submitted concept plan and the draft New Official Plan available at the time of the pre-consultation meeting, the proposed development does not appear to be affected by any proposed policy changes.
- Please consider providing only the minimum number of required parking spaces.
- Please consider relocating the parking spaces between the right-of-way and the existing building.
- Please incorporate additional landscaping throughout the parking lot through the introduction of additional parking lot islands and along the perimeter of the property where sidewalks would be found.
- Please ensure that all landscaping provisions for parking lots are being followed; please refer to Section 110 of the Zoning By-law.
- Please provide shaded landscaped pedestrian connections from the public sidewalk to building entrances.
- For bicycle parking, consider providing covered shelters for bicycle parking or integrate within buildings.
- Please refrain from designing blank walls along the street frontages; buildings should be street-oriented with entrances facing the street with highly transparent ground-floor facades.
- Please consider integrating pedestrian-oriented features such as shade trees, bicycle/scooter parking, outdoor seating areas and street furniture.
- Please ensure that the proposed development complies with all applicable provisions of the Zoning By-law and provide a comprehensive zoning table on the submitted site plan and report.
- Please note that Councillor Jenna Sudds has resigned as Councillor for Kanata North (Ward 4) – please reach out to her successor when applicable.
 - City Council will be declaring the office vacant and staff will recommend that City Council approve interim delegations of authority with respect to Ward 4 matters on

October 13, 2021, Council will then appoint person to fill the vacancy or hold a by-election.

- The application will be subject to public consultation (conducted through the posting of on-site signage, the notification of community groups, and through the City of Ottawa's DevApps website); please note that the Councillor may also ask for a Community Information and Comment Session.
- Please determine if Section 37 applies.

Urban Design

- Specific Design Comments
 - Avoid blank walls facing the public realm. Integrate as much glazing, transparency, entrances and active frontages as possible facing Legget and Solandt, particularly at the ground floor.
 - Integrate a generous landscaping treatment along Solandt that is in keeping with the character of Kanata Business Park. This often includes coniferous species of trees.
 - Consider opportunities for pedestrian-oriented features such as shade trees, bicycle/scooter parking, outdoor seating areas and street furniture
 - To minimize the impact on the public realm, service areas such as parking, loading, vehicle access and service entrances should be at the rear of the buildings. Use landscaping to screen them from the public realm.
 - Where exposed to the public realm, use landscaping to screen parking lots as much as possible.
 - Integrate as much greening into the parking lot as possible and ensure strong and logical pedestrian connectivity to building entrances.
- New Official Plan (New OP) – Note that the draft new OP aims to designate the greater area that this property falls within as a “Special Economic District” and as a Design Priority Area. The new policy will aim to enhance mobility options, encourage mixed-use development and promote enhanced urban design. Please refer to [Section 6.6.3.2](#) of the draft plan. Though not currently in effect, the proponent is strongly encouraged to implement the new vision for the area as much as possible.
- Kanata North Tech Park Community Planning Permit Pilot Study (CPP) – Note that a study is currently underway for the greater area that this property falls within, which will have implications for urban design. It is being re-envisioned as a “highly-connected, vibrant mixed-use area where people live, work, connect and play”. Refer to the project [Website](#) for more details.
- Design Brief – As part of your submission, please include a Design Brief. Please refer to the attached Design Brief Terms of Reference to inform the content of the brief.
- Urban Design Review Panel – In the current policy context, this application is not subject to review by the Urban Design Review Panel (UDRP). While the draft new Official Plan aims to recognize the area as a Design Priority Area, early indications from staff working on the Kanata

North CPP are that the area will likely be exempt from review by the UDRP (though it is possible that this may be subject to change).

Please contact Urban Design Planner Matthew Ippersiel (Matthew.Ippersiel@ottawa.ca) for follow-up questions.

Environmental Planning

Bird-safe Design

- Given the height of the proposal (mid to high rise) the proposal will need to review and incorporate bird safe design elements. Some of the risk factors include glass and related design traps such as corner glass and fly-through conditions, ventilation grates and open pipes, landscaping, light pollution. More guidance and solutions are available in the guidelines which can be found here: <https://ottawa.ca/en/planning-development-and-construction/developing-property/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans> .

Environmental Impact Statement (EIS) to address species at risk and provide recommendations on wildlife mitigations.

- Blanding's turtles sighted in the area, indicating regulated habitat may be present on the property, particularly in the parts around the pond. MECP consultation will likely be required to address the limits of Blanding's turtle habitat and to obtain the necessary approvals.

Please contact Environmental Planner Matthew Hayley (Matthew.Hayley@ottawa.ca) for follow-up questions.

Forestry

- A Tree Conservation Report (TCR) must be supplied for review along with the suite of other plans/reports required by the City
 - a. an approved TCR is a requirement of Site Plan approval.
 - b. The TCR may be combined with the Landscape Plan provided all information is supplied.
- As of January 1 2021, any removal of privately-owned trees 10cm or larger in diameter, or publicly (City) owned trees of any diameter requires a tree permit issued under the Tree Protection Bylaw (Bylaw 2020 – 340); the permit will be based on an approved TCR and made available at or near plan approval.
- The Planning Forester from Planning and Growth Management as well as foresters from Forestry Services will review the submitted TCR.
 - a. If tree removal is required, both municipal and privately-owned trees will be addressed in a single permit issued through the Planning Forester.
 - b. Compensation may be required for city owned trees – if so, it will need to be paid prior to the release of the tree permit.
- The TCR must list all trees on site, as well as off-site trees if the CRZ extends into the developed area, by species, diameter and health condition.
- Please identify trees by ownership – private onsite, private on adjoining site, city owned, co-owned (trees on a property line).
- The TCR must list all trees on adjacent sites if they have a critical root zone that extends onto the development site.

- If trees are to be removed, the TCR must clearly show where they are, and document the reason they cannot be retained.
- All retained trees must be shown and all retained trees within the area impacted by the development process must be protected as per City guidelines available at [Tree Protection Specification](#) or by searching Ottawa.ca.
 - a. The location of tree protection fencing must be shown on a plan
 - b. Show the critical root zone of the retained trees
 - c. If excavation will occur within the critical root zone, please show the limits of excavation
- The City encourages the retention of healthy trees; if possible, please seek opportunities for retention of trees that will contribute to the design/function of the site.
- For more information on the process or help with tree retention options, contact Mark Richardson mark.richardson@ottawa.ca or on [City of Ottawa](#).

Landscape Plan tree planting requirements:

For additional information on the following please contact tracy.smith@Ottawa.ca

Minimum Setbacks

- Maintain 1.5m from sidewalk or MUP/cycle track.
- Maintain 2.5m from curb
- Coniferous species require a minimum 4.5m setback from curb, sidewalk or MUP/cycle track/pathway.
- Maintain 7.5m between large growing trees, and 4m between small growing trees. Park or open space planting should consider 10m spacing.
- Adhere to Ottawa Hydro's planting guidelines (species and setbacks) when planting around overhead primary conductors.

Tree specifications

- Minimum stock size: 50mm tree caliper for deciduous, 200cm height for coniferous.
- Maximize the use of large deciduous species wherever possible to maximize future canopy coverage
- Tree planting on city property shall be in accordance with the City of Ottawa's Tree Planting Specification; and include watering and warranty as described in the specification (can be provided by Forestry Services).
- Plant native trees whenever possible
- No root barriers, dead-man anchor systems, or planters are permitted.
- No tree stakes unless necessary (and only 1 on the prevailing winds side of the tree)

Hard surface planting

- Curb style planter is highly recommended
- No grates are to be used and if guards are required, City of Ottawa standard (which can be provided) shall be used.
- Trees are to be planted at grade

Soil Volume

- Please ensure adequate soil volumes are met:

Tree Type/Size	Single Tree Soil Volume (m3)	Multiple Tree Soil Volume (m3/tree)
Ornamental	15	9
Columnar	15	9
Small	20	12
Medium	25	15
Large	30	18
Conifer	25	15

Please note that these soil volumes are not applicable in cases with Sensitive Marine Clay.

Sensitive Marine Clay

- Please follow the City's 2017 Tree Planting in Sensitive Marine Clay guidelines

Please contact Planning Forester Mark Richardson (Mark.Richardson@ottawa.ca) for follow-up questions.

Transportation

- Follow Traffic Impact Assessment Guidelines
 - Proceed with scoping.
 - Start this process asap.
 - Applicant advised that their application will not be deemed complete until the submission of the draft step 1-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable). Collaboration and communication between development proponents and City staff are required at the end of every step in the TIA process
 - Request base mapping asap if RMA is required. Contact Engineering Services (<https://ottawa.ca/en/city-hall/planning-and-development/engineering-services>)
- Noise Impact Studies required for the following:
 - Stationary (if, within 100m of noise sensitive land use).
- Ensure clear throat length requirements as per TAC are met at the accesses.
- The easterly access on Legget Drive does not meet the private approach guidelines. This may have to be reconfigured and will be further reviewed in the TIA.
- On site plan:
 - Show all details of the roads abutting the site up to and including the opposite curb; include such items as pavement markings, accesses and/or sidewalks.
 - Turning templates will be required for all accesses showing the largest vehicle to access the site; required for internal movements and at all access (entering and exiting and going in both directions).
 - Show all curb radii measurements; ensure that all curb radii are reduced as much as possible
 - Grey out any area that will not be impacted by this application.

- As the proposed site is industrial and for general public use, AODA legislation applies. Consider using the City's Accessibility Design Standards.
- Number of accessible parking spaces should meet the requirements from Table 3 of the City's accessible Design Standards.
- Site triangles at the following locations on the final plan will be required:
 - Collector Road to Collector Road: 5 metre x 5 metres
- The scoping and forecasting can be submitted together and should be done as soon as possible.

Please contact Transportation Project Manager Neeti Paudel (Neeti.Paudel@ottawa.ca) for follow-up questions.

Parks

- How will the proposal meet the Parkland Dedication (By-law No. 2009-95)?
- For commercial and industrial purposes, the parkland requirement is calculated as 2% of the gross land area of the site being developed.
- The conveyance of land for purposes or the payment of money in-lieu of accepting the conveyance is not required for development, redevelopment, subdivisions or consents, where it is known, or can be demonstrated that the required parkland conveyance or money in-lieu thereof has been previously satisfied.

Please contact Parks Planner Jeff Goettling (Jeff.Goettling@ottawa.ca) for follow-up questions.

Other

Please refer to the links to the [guide to preparing studies and plans](#) and [development application fees](#) for general information. Additional information is available related to [building permits](#), [development charges](#), and [the Accessibility Design Standards](#). Be aware that other fees and permits may be required, outside of the development review process. You may obtain background drawings by contacting informationcentre@ottawa.ca.

These pre-consultation comments are valid for one year. If you submit a development application(s) after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change. You are as well encouraged to contact us for a follow-up meeting if the plan/concept will be further refined.

APPENDIX

B EXHIBITS






CLIENT
ACCESS PROPERTY DEVELOPMENT


PROJECT
415 LEGGET DRIVE

TITLE
**EXHIBIT 1
EXISTING CONDITIONS
DRAINAGE MOSAIC**

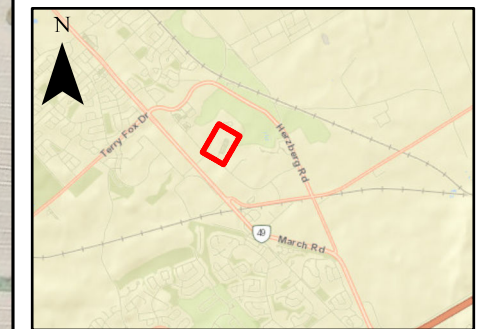

LEGEND

- Existing Ditches
- Existing Wet Pond
- Existing Drainage Areas
- S-BEX
- S-EXT1
- S-U1
- S-U2



DRAWN BY
MO


March 2022

NAD 1983 MTM 9

1:1,275

CHECKED BY
AJ





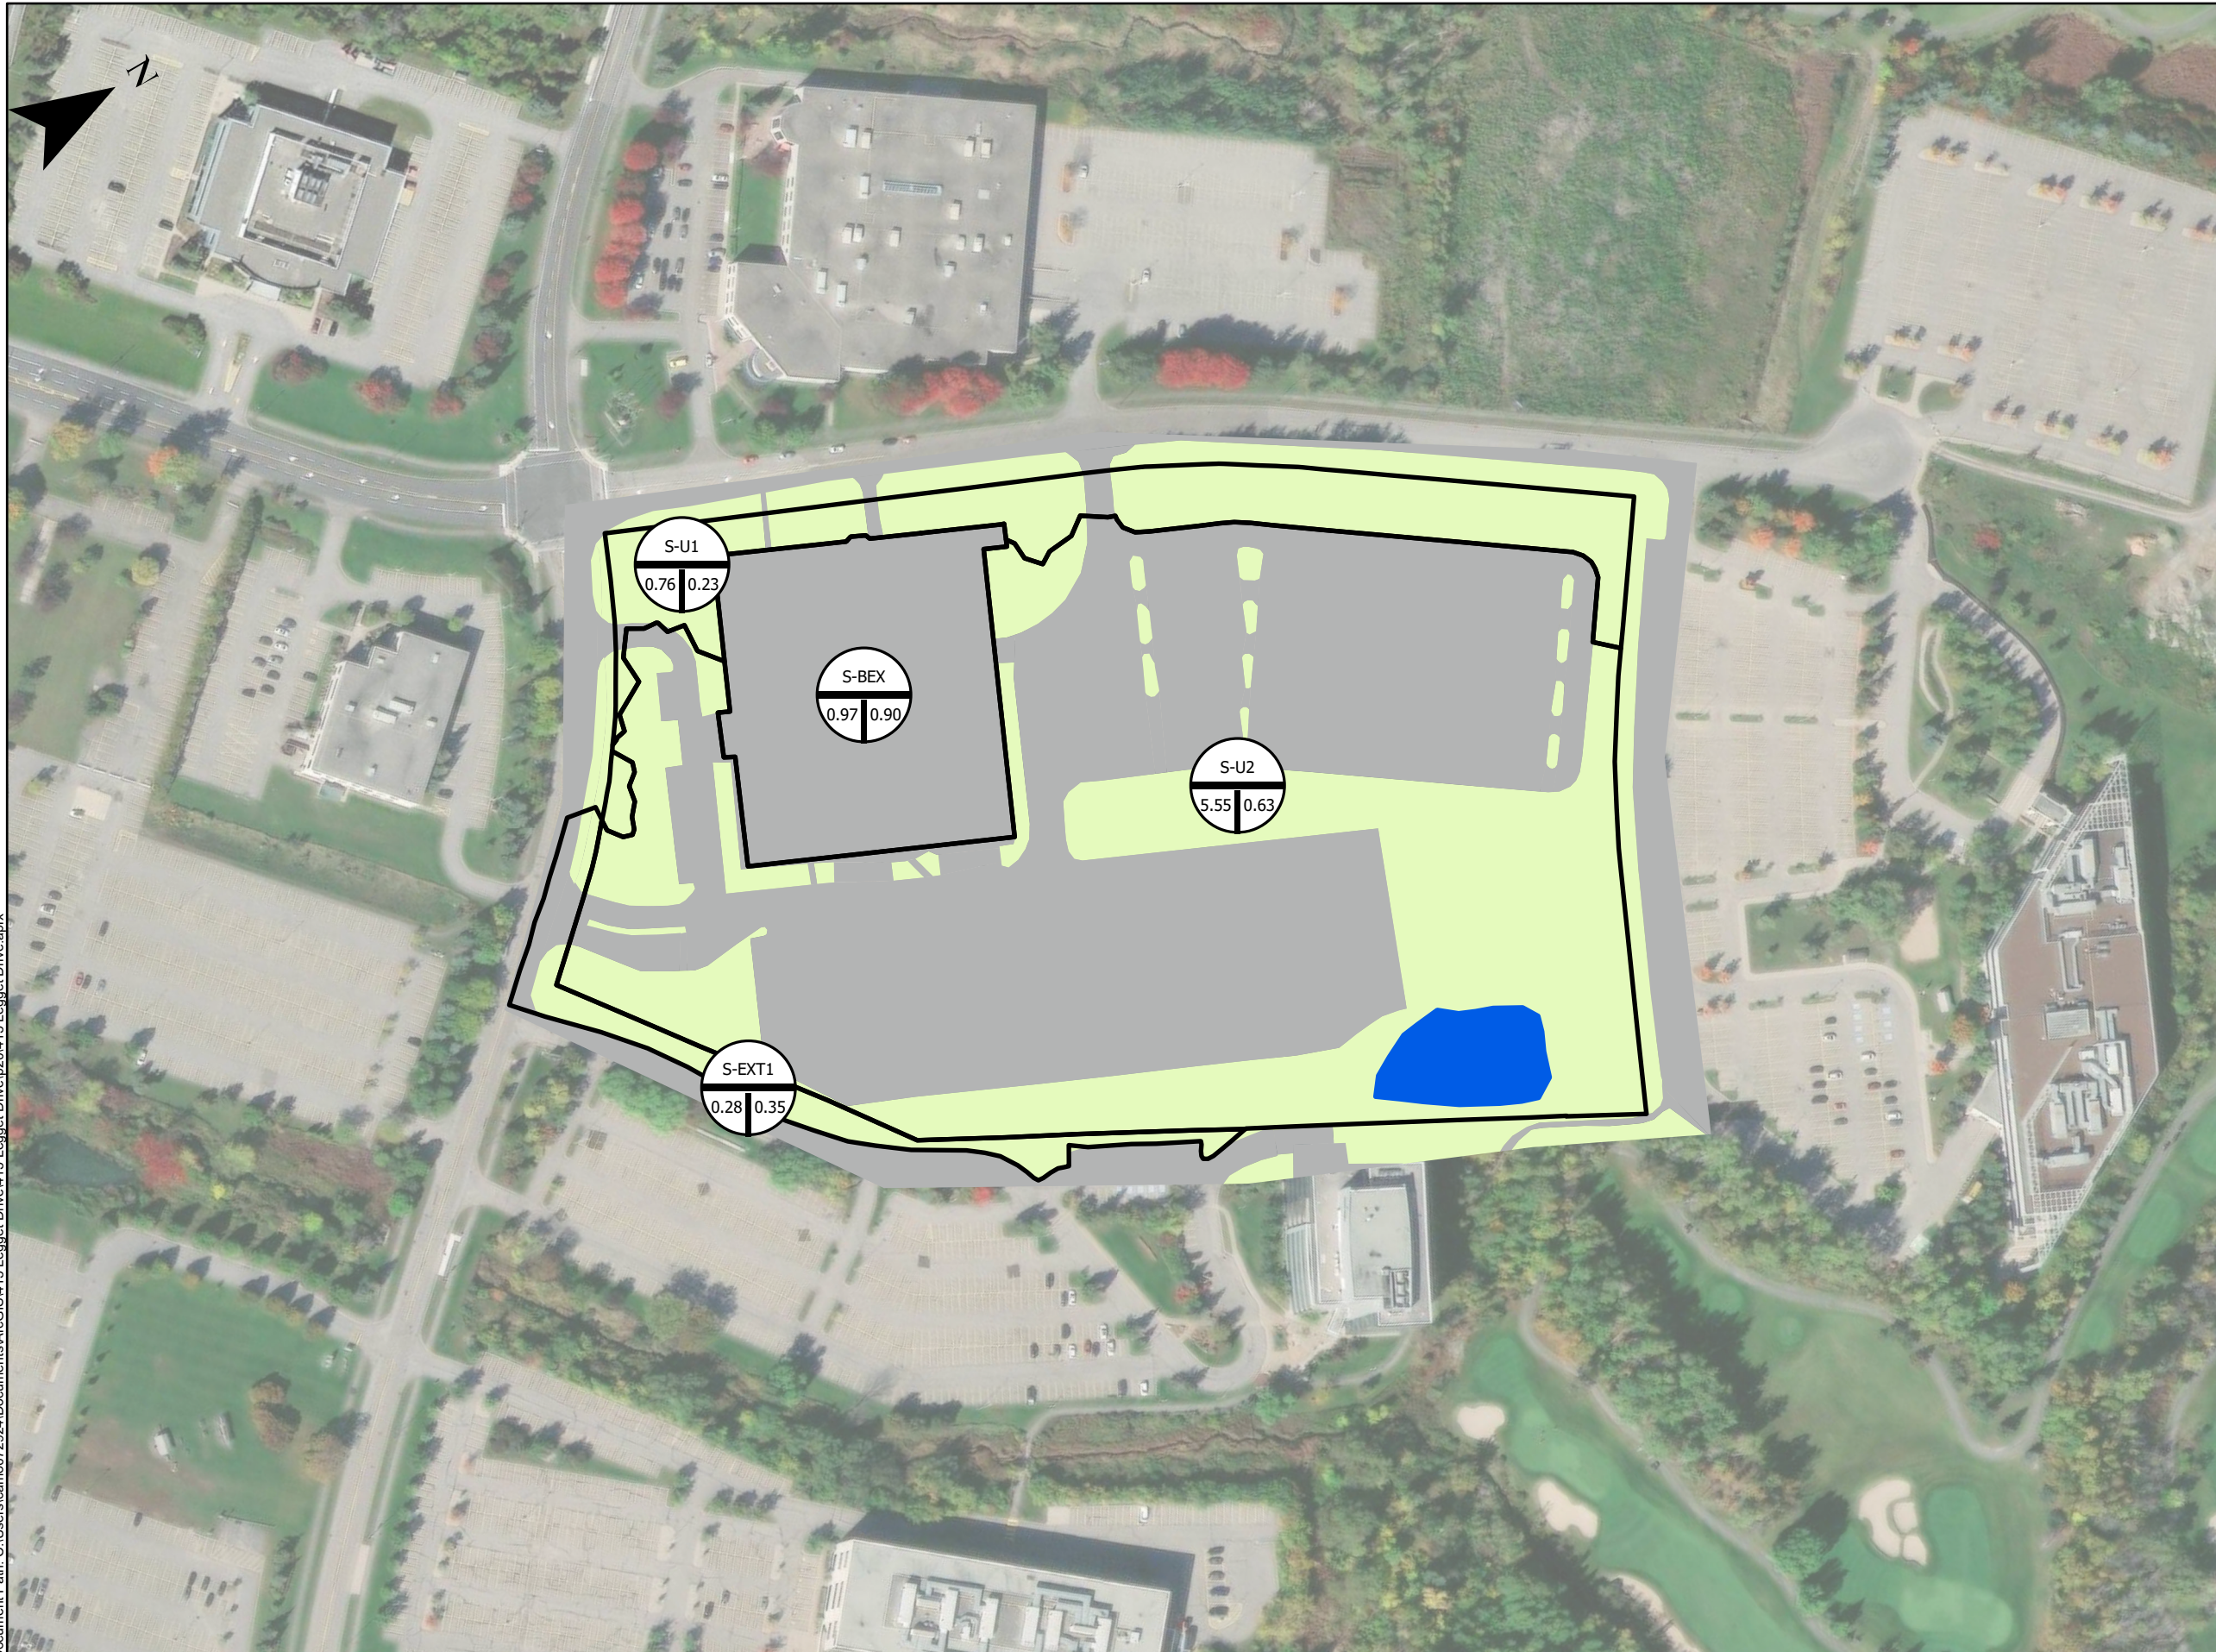

CLIENT
ACCESS PROPERTY DEVELOPMENT

PROJECT
415 LEGGET DRIVE


TITLE
**EXHIBIT 2
EXISTING CONDITIONS
LAND USE**

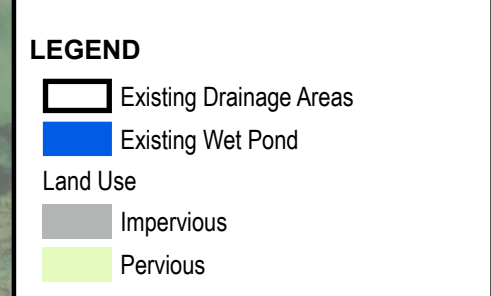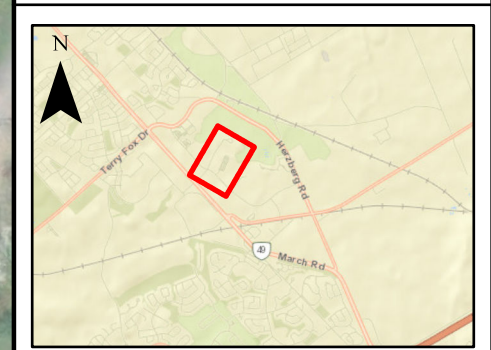

Subcatchment ID	Area (ha)	Runoff C
S-U1	0.76	0.23
S-BEX	0.97	0.90
S-U2	5.55	0.63
S-EXT1	0.28	0.35

DRAWN BY MO	CHECKED BY AJ
March 2022	
NAD 1983 MTM 9	
1:2,204	

Document Path: C:\Users\cam072924\Documents\ArcGIS\415 Legget Drive\415 Legget Drive\201415 Legget Drive.aprx

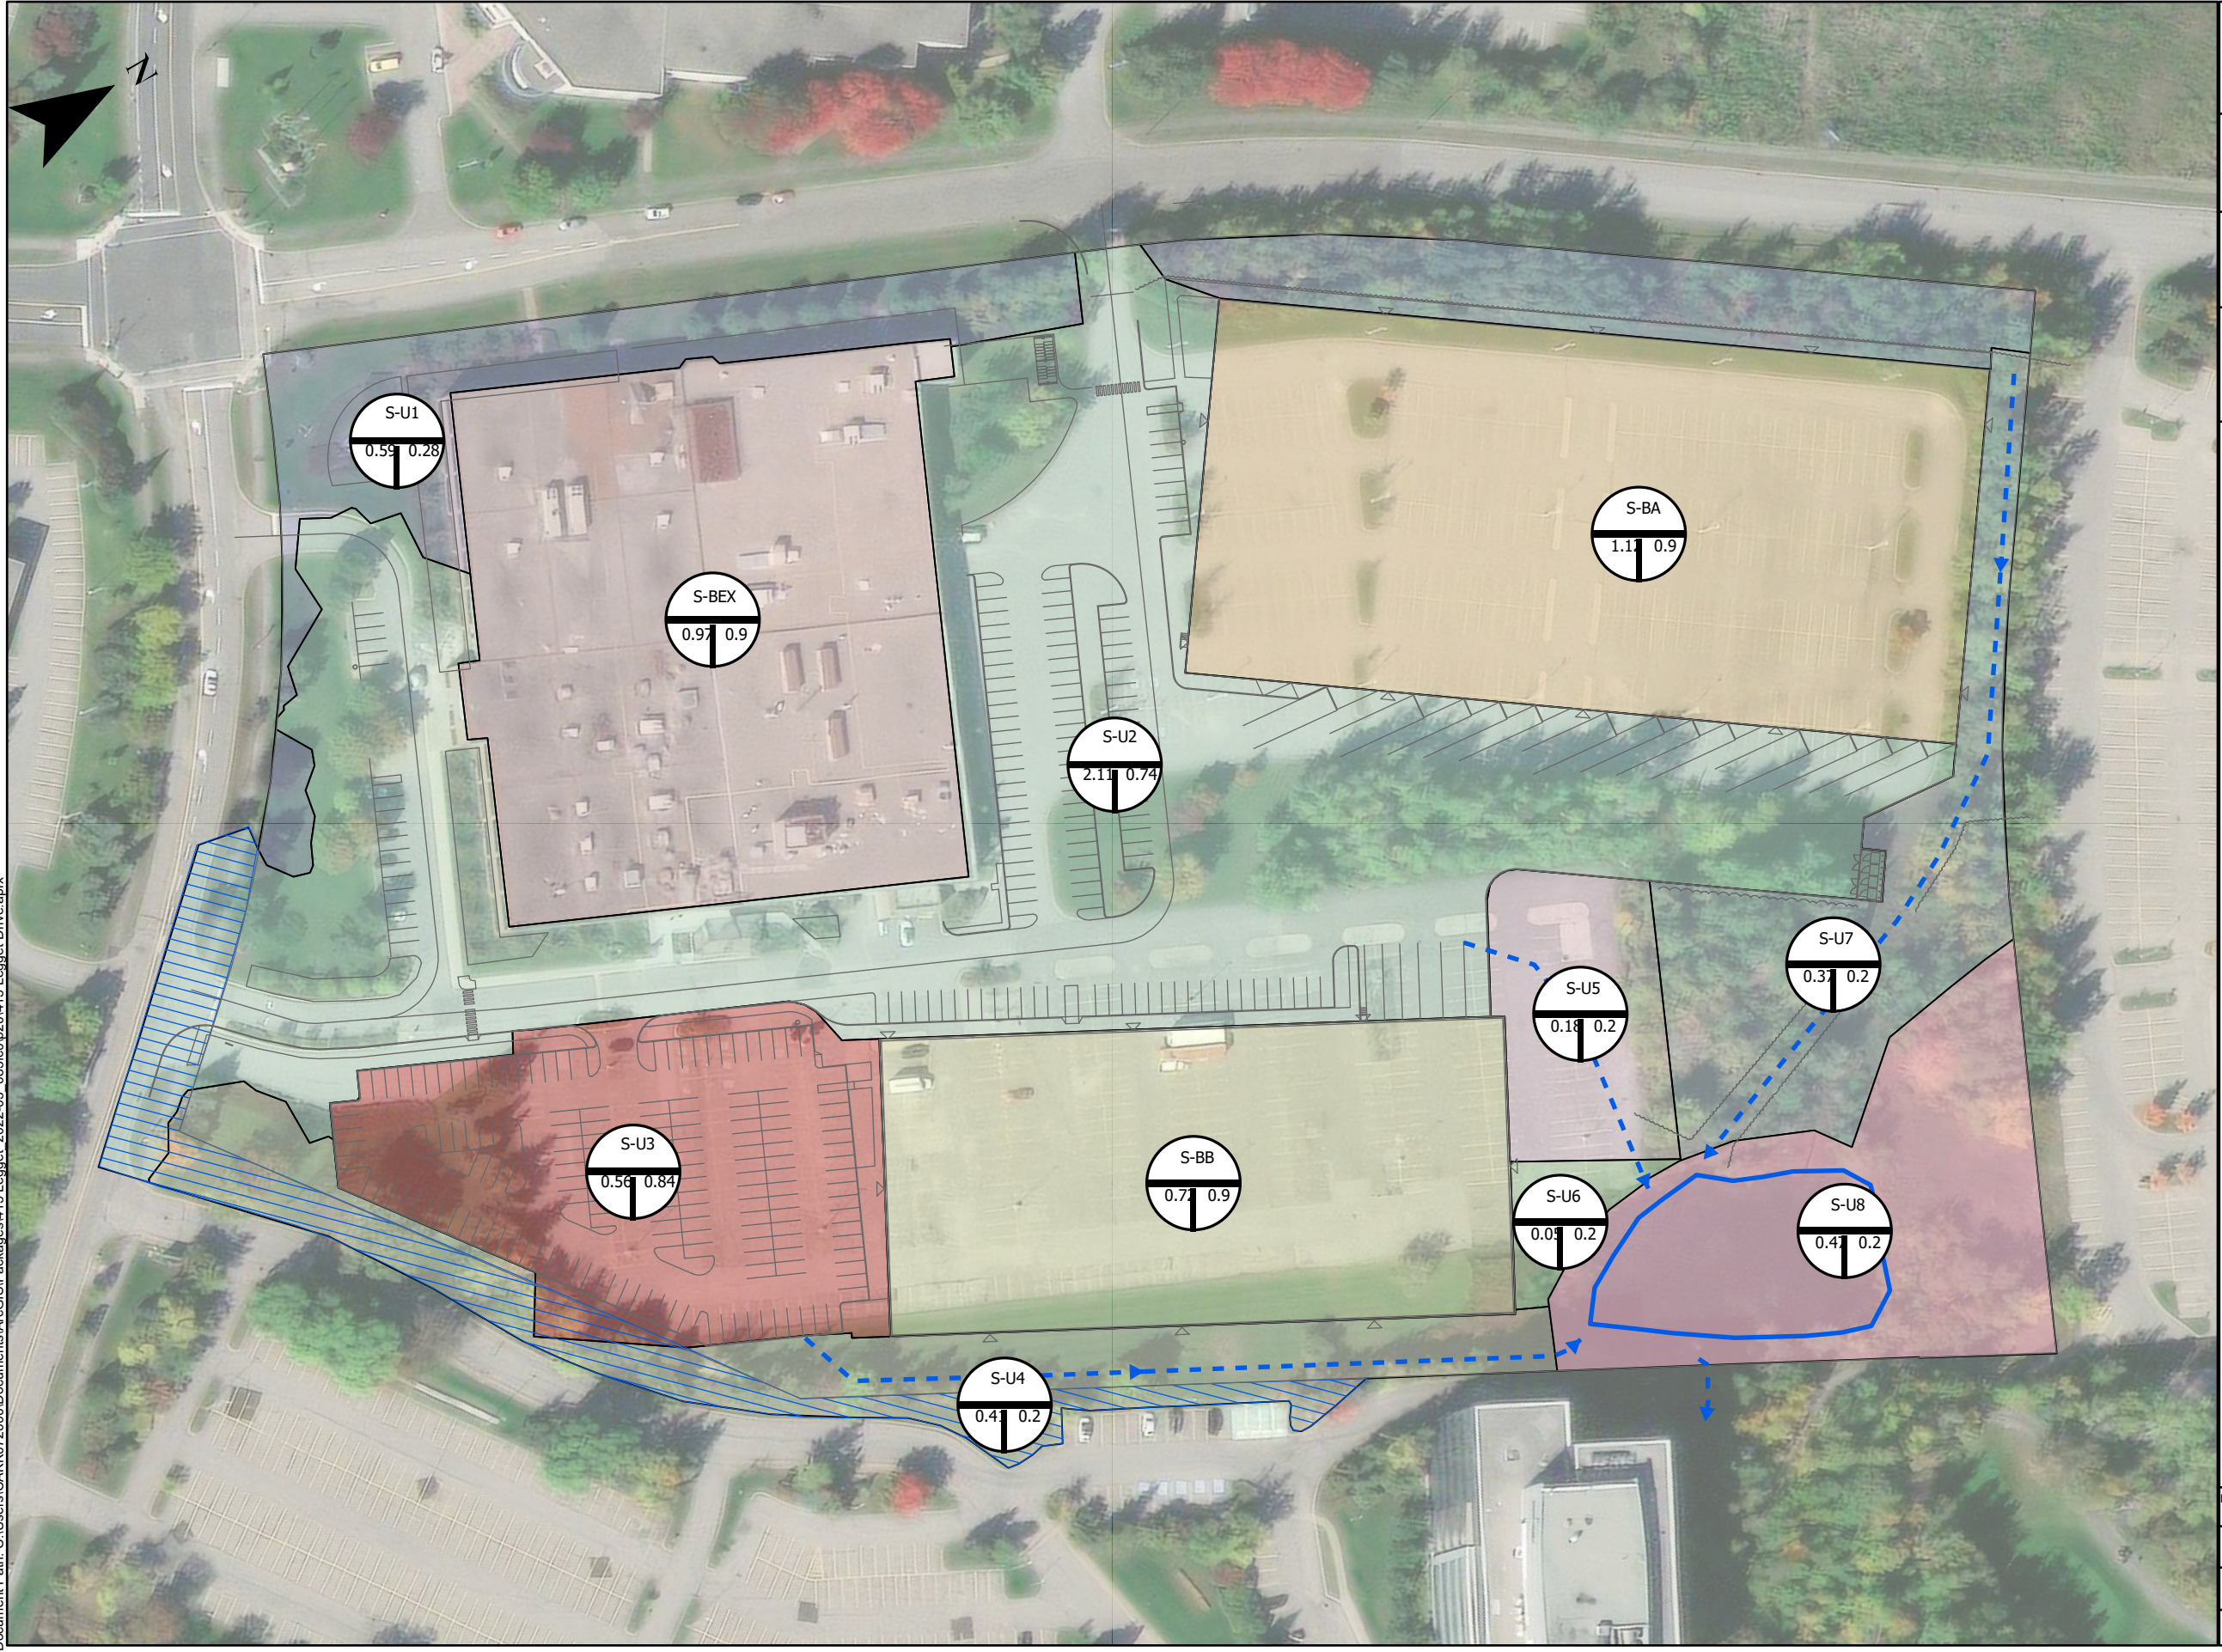


CLIENT
ACCESS PROPERTY DEVELOPMENT

PROJECT
415 LEGGET DRIVE

TITLE
**EXHIBIT 3
PROPOSED CONDITIONS
DRAINAGE MOSAIC**

**EXHIBIT 3
PROPOSED CONDITIONS
DRAINAGE MOSAIC**

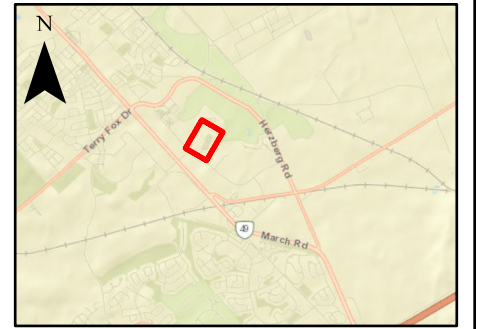

LEGEND

- Proposed Swales
- Existing Wet Pond
- External Drainage Area

Proposed Drainage Areas


- S-BA
- S-BB
- S-BEX
- S-U1
- S-U2
- S-U3
- S-U4
- S-U5
- S-U6
- S-U7
- S-U8

Subcatchment ID	Area (ha)	Runoff C
S-U1	0.59	0.28
S-BEX	0.97	0.9
S-U2	2.11	0.74
S-BA	1.11	0.9
S-U3	0.56	0.84
S-BB	0.7	0.9
S-U4	0.4	0.2
S-U5	0.18	0.2
S-U6	0.09	0.2
S-U7	0.37	0.2
S-U8	0.41	0.2

0 0.01 0.03 km

Document Path: C:\Users\CAK\72000\Documents\ArcGIS\ISDPackages\415 Legget 2022-03 08360ip20\415 Legget Drive.aprx


DRAWN BY KK	CHECKED BY AJ
August 2022	
NAD 1983 MTM 9	
1:1,275	

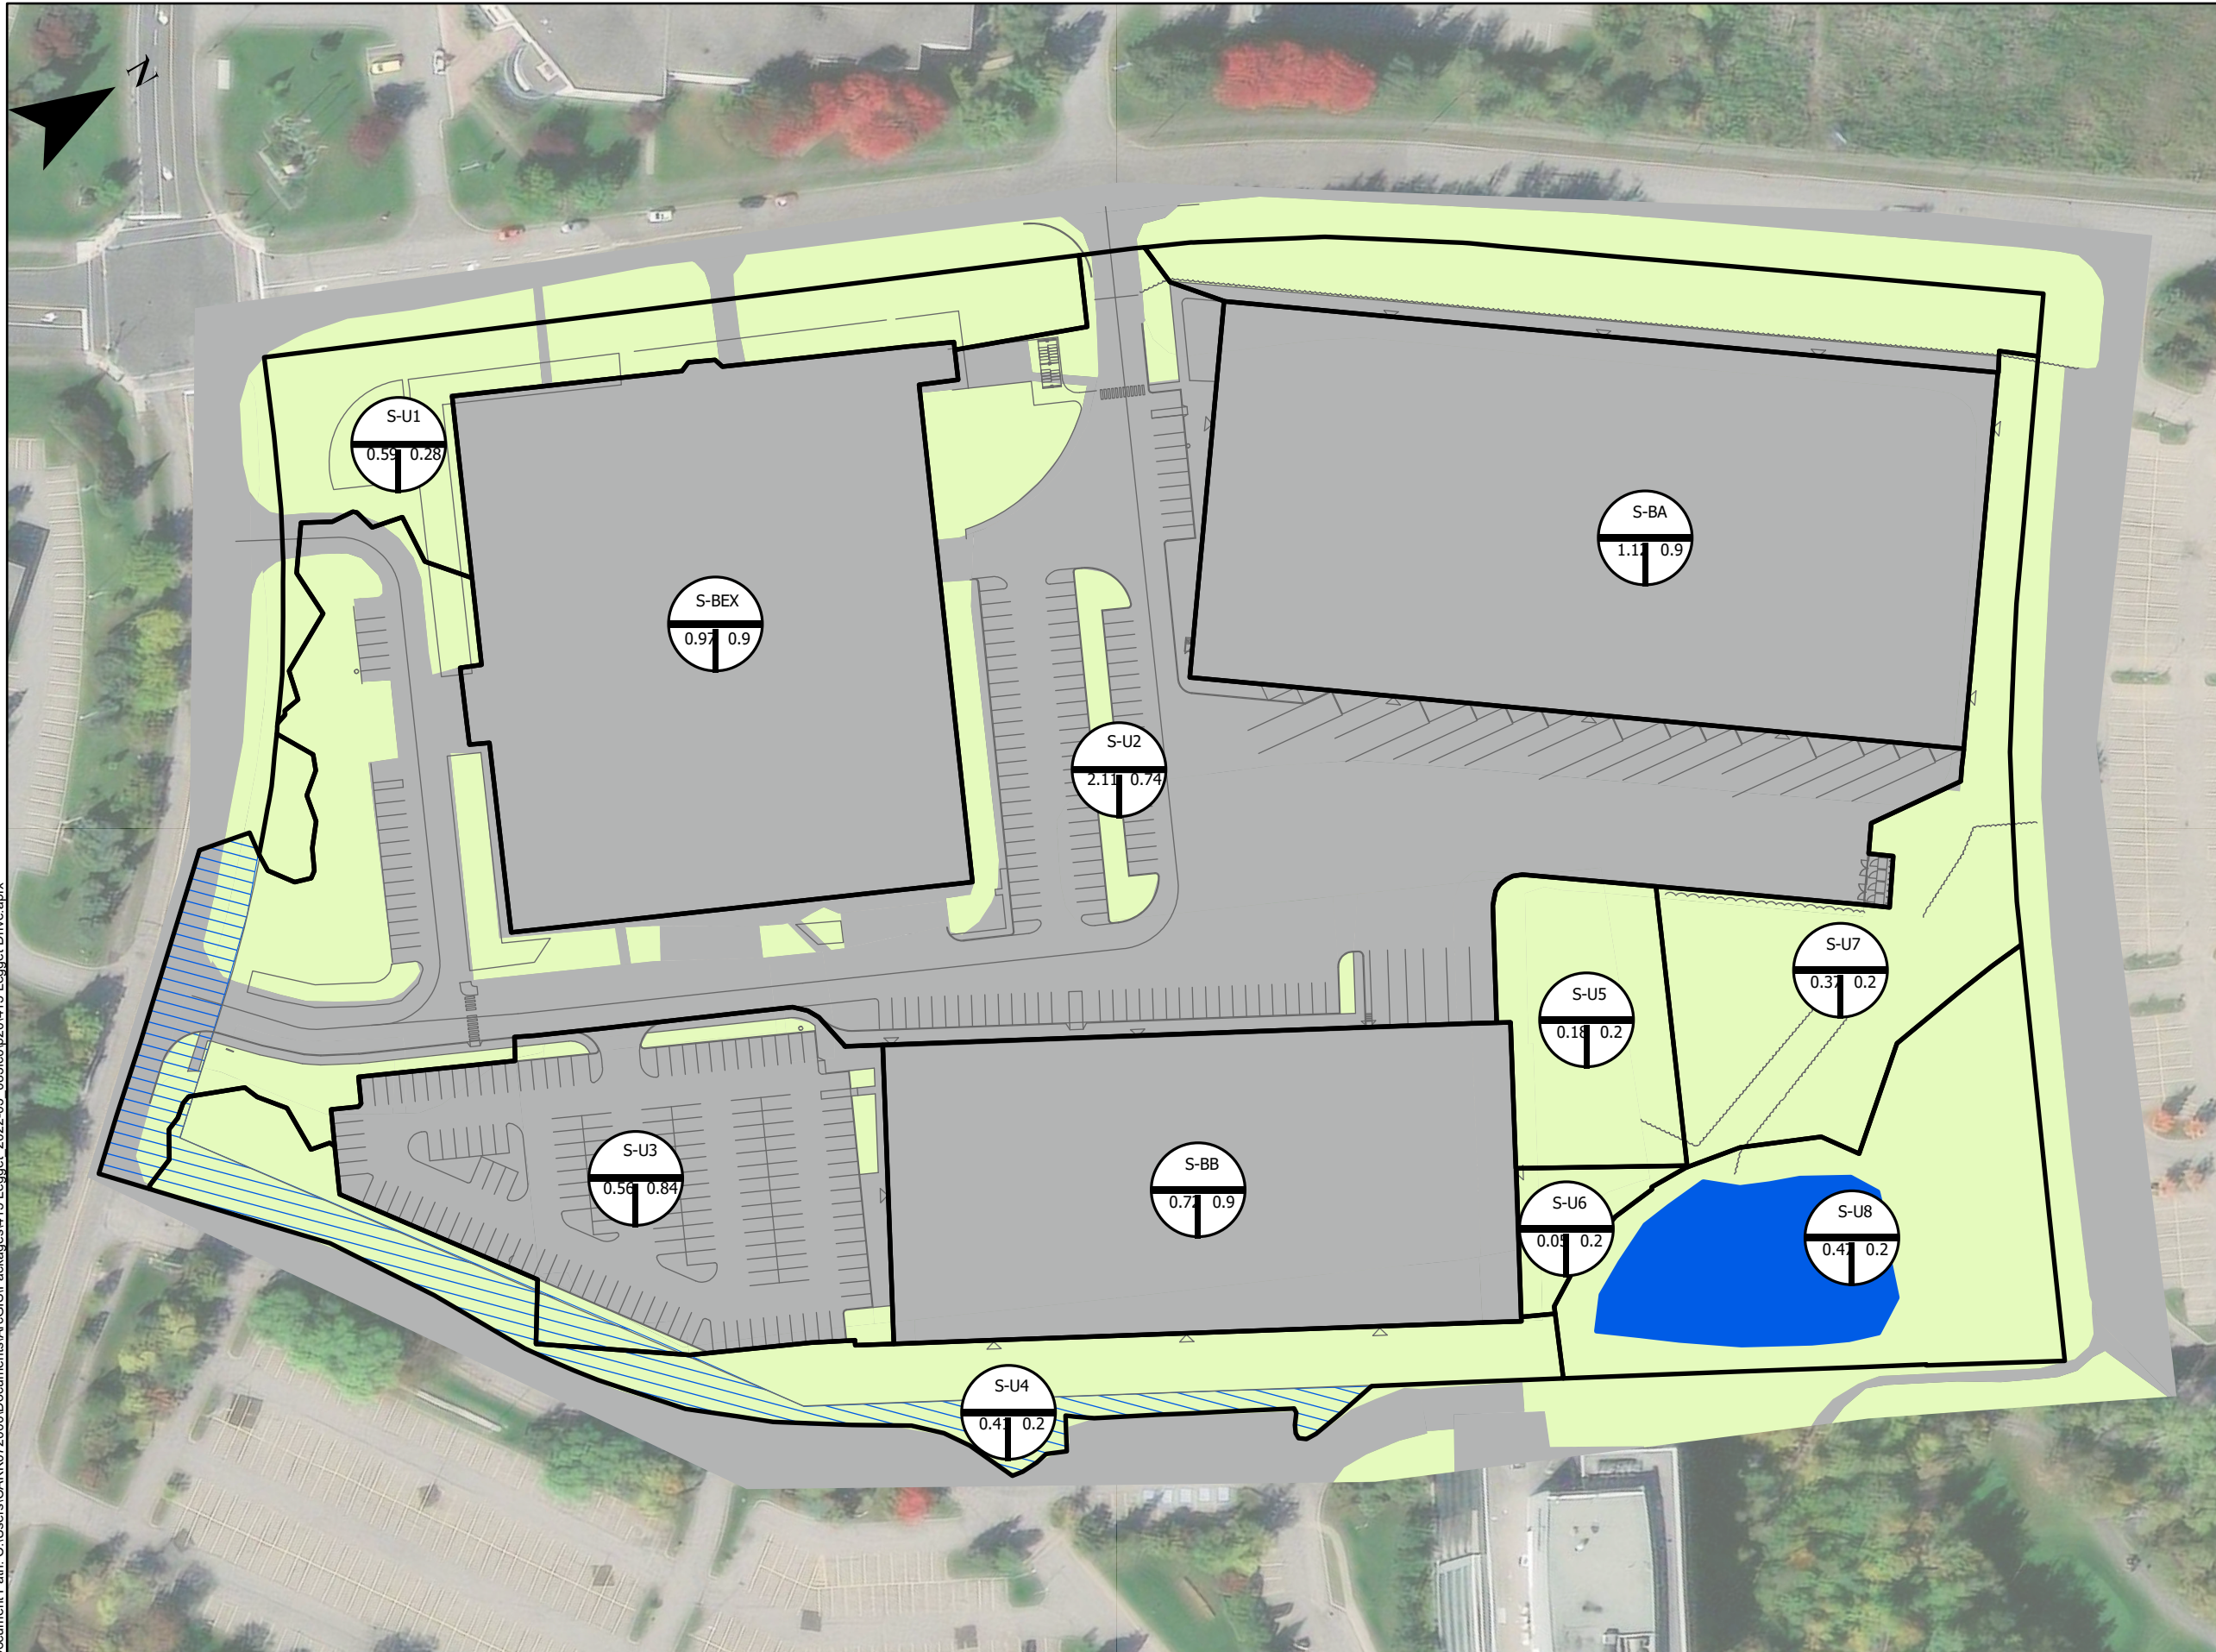


CLIENT
ACCESS PROPERTY DEVELOPMENT

PROJECT
415 LEGGET DRIVE

TITLE
**EXHIBIT 4
PROPOSED CONDITIONS
LAND USE**

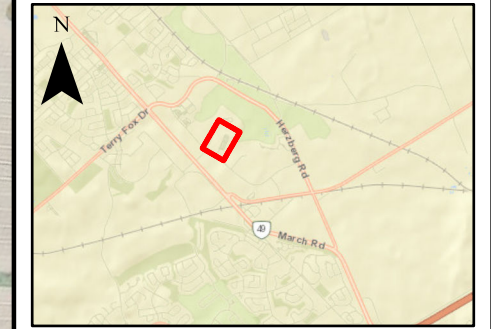

- LEGEND**
- External Drainage Area
 - Existing Wet Pond
 - Land Use
 - Impervious
 - Pervious

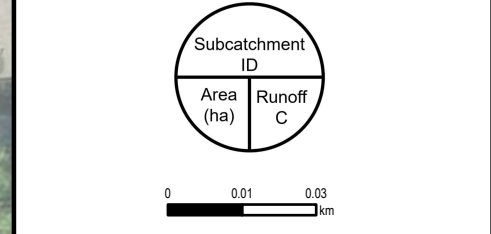

DRAWN BY KK	CHECKED BY AJ
August 2022	
NAD 1983 MTM 9	
1:1,275	

Document Path: C:\Users\CAK\72000\Documents\ArcGIS\ISIPackages\415 Legget - 2022-03_083c0p20\415 Legget Drive.aprx

APPENDIX

C CALCULATIONS & PCSWMM OUTPUT





SWALE CALCULATION SHEET

415 Legget - 25 mm, 4 hour storm

Check for satisfaction of criteria for enhanced grass swales (TRCA, 2010)

Designed by: Meaghan O'Neill Date: 3/17/2022
 Checked by: Ayham Jadallah Date: 3/17/2022
 Approved by: Ayham Jadallah Date: 3/17/2022
 Drawing Ref:

Standard Design Calculation Sheet (Rational Method)

Location			Drainage Areas			Rational Method Runoff					Swale Data					Comment		
Street Name or Description	From	To	Runoff Coefficients			Individual AC	Accum. AC	Runoff Coefficient C	Rainfall Intensity i mm/h	Q L/s	Side Slope x:1	Bottom Width m	Depth m	Slope %	Length m	Q L/s	Vel. m/s	
			0.20 ha	0.70 ha	0.90 ha													
S1	LCB01	Pond	0.37		1.12	1.08	1.08	0.73	37.1	112	3	0.75	0.17	0.60	174	112	0.5	
S2	LCB02	Pond	0.73		1.68	1.66	1.66	0.69	35.5	164	3	0.75	0.20	0.60	64	164	0.6	
S3	LCB03	Pond	0.48		1.08	1.07	1.07	0.68	35.3	104	3	0.75	0.16	0.60	153	104	0.5	


Notes:

- The slope of open channels will depend on various factors including roadway longitudinal grade and natural topography;
- The minimum allowable ditch/swale slope is 0.5% (1% is desirable);
- For Runoff Coefficient (C), grassed area = 0.2, ballast = 0.7, paved area = 0.9
- Also for C, add 10% for 25-year storm event, 20% for 50-year storm event and 25% for 100-year storm event (update this in appropriate drainage cell)
- A minimum time of concentration of 10min shall be used
- Rainfall intensity determined by MOE Stormwater Management Planning and Design Manual (2003) $i = 43C + 5.9$
- Maximum velocity = 0.5m/s, Flow depth below 0.1m preferred
- Channel protection in the form of sodding, gabion, armour stone, riprap, asphalt, and concrete lining may be required depending on design flow and velocities; and
- Roughness Coefficient (n) = 0.04
- Permissible velocities for channels lined with grass are included in Appendix 6-C of the Ottawa Sewer Design Guidelines.
- Depths will be greater where checkdams are used

PRE-DEVELOPMENT CONDITIONS



WET POND - EXISTING CONDITIONS

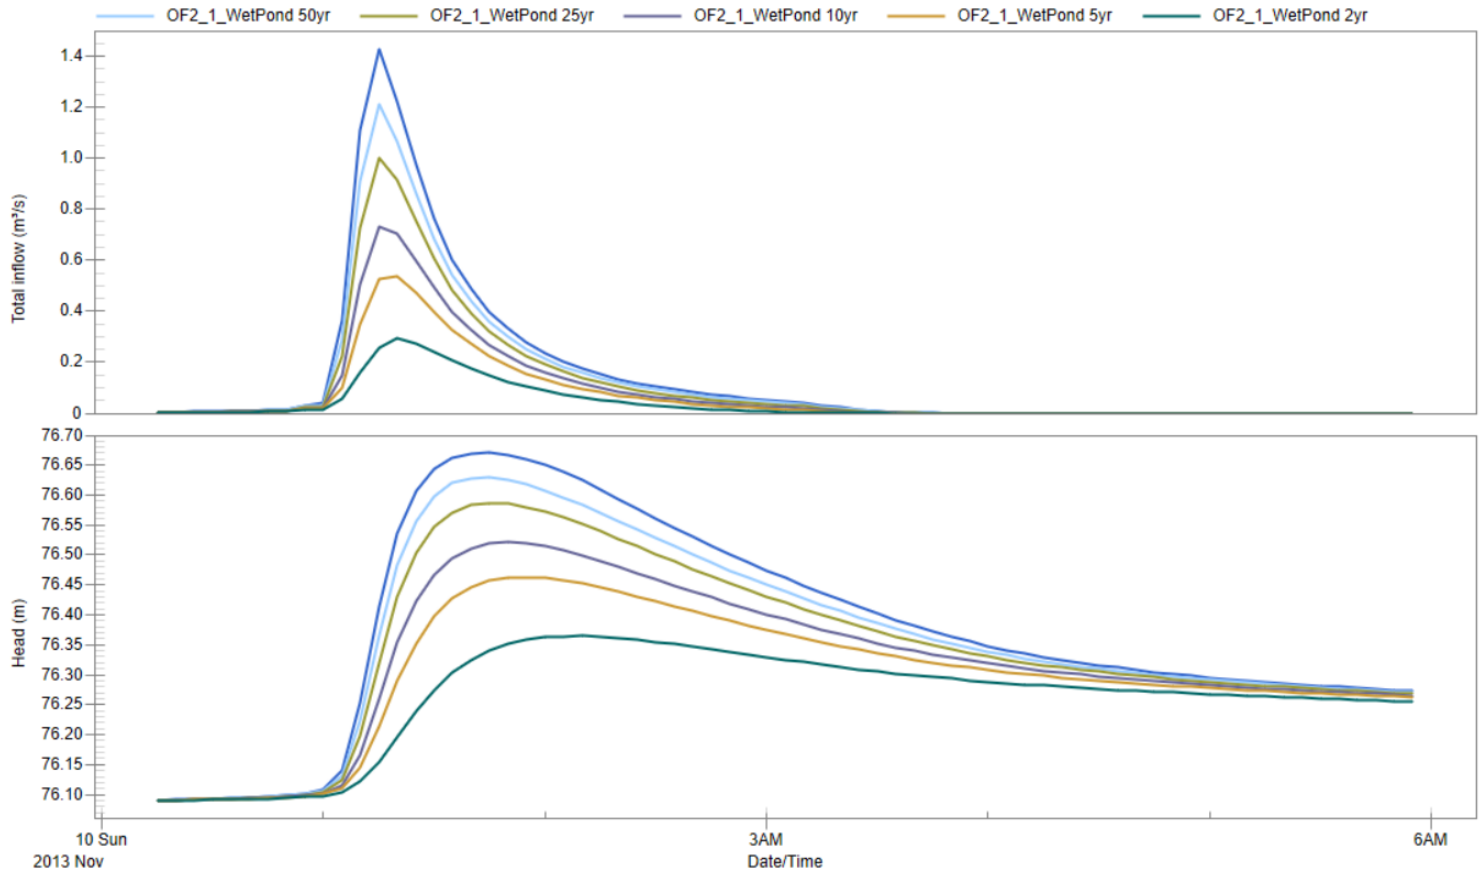

2-year Pre Development

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.013)

 Element Count

 Number of rain gages 16
 Number of subcatchments ... 5
 Number of nodes 4
 Number of links 3
 Number of pollutants 0
 Number of land uses 0

 Raingage Summary

Name	Data Source	Data Type	Recording Interval
100yr_3hr_Chicago	100yr_3hr_Chicago	INTENSITY	10 min.
100yr_3hr_Chicago_Climate_Change	100yr_3hr_Chicago_Increase_20percent	INTENSITY	10 min.
100yr_6hr_Chicago	100yr_6hr_Chicago	INTENSITY	10 min.
100yr_6hr_Chicago_Climate_Change	100yr_6hr_Chicago_Increase_20percent	INTENSITY	10 min.
10yr_3hr_Chicago	10yr_3hr_Chicago	INTENSITY	10 min.
10yr_6hr_Chicago	10yr_6hr_Chicago	INTENSITY	10 min.
25mm_3hr_Chicago	25mm_3hr_Chicago	INTENSITY	10 min.
25mm_4hr_Chicago	25mm_4hr_Chicago	INTENSITY	10 min.
25yr_3hr_Chicago	25yr_3hr_Chicago	INTENSITY	10 min.
25yr_6hr_Chicago	25yr_6hr_Chicago	INTENSITY	10 min.
2yr_3hr_Chicago	2yr_3hr_Chicago	INTENSITY	10 min.
2yr_6hr_Chicago	2yr_6hr_Chicago	INTENSITY	10 min.
50yr_3hr_Chicago	50yr_3hr_Chicago	INTENSITY	10 min.
50yr_6hr_Chicago	50yr_6hr_Chicago	INTENSITY	10 min.
5yr_3hr_Chicago	5yr_3hr_Chicago	INTENSITY	10 min.
5yr_6hr_Chicago	5yr_6hr_Chicago	INTENSITY	10 min.

 Subcatchment Summary

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
Pond	0.28	27550.00	100.00	3.3690	2yr_3hr_Chicago	OF2_1_WetPond
S-BEX	0.97	167.35	99.91	2.0000	2yr_3hr_Chicago	OF1
S-EXT1	0.28	7.91	24.19	7.3320	2yr_3hr_Chicago	OF2_1_WetPond
S-U1	0.76	162.55	8.85	4.9330	2yr_3hr_Chicago	OF1
S-U2	5.27	198.99	66.00	3.4650	2yr_3hr_Chicago	OF2_1_WetPond

 Node Summary

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
OF2_2_KizellDrain	JUNCTION	76.09	1.91	0.0	
OF1	OUTFALL	77.70	0.00	0.0	
OF2	OUTFALL	75.90	1.49	0.0	
OF2_1_WetPond	STORAGE	75.10	3.00	0.0	

 Link Summary

Name	From Node	To Node	Type	Length	%Slope	Roughness
C1	OF2_2_KizellDrain	OF2	CONDUIT	11.1	1.7054	0.0350
W1	OF2_1_WetPond	OF2_2_KizellDrain	WEIR			
W2	OF2_1_WetPond	OF2_2_KizellDrain	WEIR			

 Cross Section Summary

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	Transect1	1.49	10.54	0.51	22.03	1	25.26

 Transect Summary

Transect	Area:	0.0004	0.0016	0.0037	0.0066	0.0103
		0.0148	0.0201	0.0261	0.0326	0.0398
		0.0475	0.0558	0.0646	0.0741	0.0841
		0.0947	0.1059	0.1177	0.1302	0.1434
		0.1572	0.1717	0.1868	0.2026	0.2189
		0.2359	0.2535	0.2716	0.2904	0.3099
		0.3302	0.3512	0.3730	0.3957	0.4193
		0.4438	0.4693	0.4958	0.5235	0.5525
		0.5838	0.6182	0.6557	0.6960	0.7395
		0.7867	0.8369	0.8897	0.9440	1.0000
Hrad:		0.0283	0.0566	0.0849	0.1132	0.1415

	0.1698	0.2008	0.2341	0.2683	0.3015
	0.3339	0.3656	0.3968	0.4277	0.4581
	0.4872	0.5142	0.5413	0.5682	0.5951
	0.6221	0.6493	0.6764	0.7057	0.7351
	0.7644	0.7936	0.8227	0.8487	0.8719
	0.8954	0.9185	0.9383	0.9587	0.9797
	0.9957	1.0114	1.0281	1.0389	1.0427
	1.0049	0.9690	0.9539	0.9451	0.9240
Width:	0.9138	0.9228	0.9436	0.9738	1.0000
	0.0131	0.0263	0.0394	0.0525	0.0657
	0.0788	0.0905	0.1006	0.1098	0.1189
	0.1281	0.1372	0.1463	0.1555	0.1646
	0.1742	0.1846	0.1949	0.2054	0.2159
	0.2264	0.2369	0.2475	0.2571	0.2667
	0.2763	0.2859	0.2955	0.3063	0.3183
	0.3302	0.3425	0.3563	0.3701	0.3840
	0.4001	0.4168	0.4335	0.4533	0.4772
	0.5243	0.5769	0.6225	0.6678	0.7269
	0.7828	0.8252	0.8580	0.8811	1.0000

 NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

 Analysis Options

Flow Units CMS
 Process Models:
 Rainfall/Runoff YES
 RDI NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed YES
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method DYNNAVE
 Surcharge Method EXTRAN
 Starting Date 11/10/2013 00:00:00
 Ending Date 11/10/2013 06:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:05:00
 Wet Time Step 00:05:00
 Dry Time Step 00:05:00
 Routing Time Step 1.00 sec
 Variable Time Step YES
 Maximum Trials 20
 Number of Threads 1
 Head Tolerance 0.001500 m

	Volume	Depth
	hectare-m	mm
Runoff Quantity Continuity	0.241	31.860
Total Precipitation	0.000	0.000
Evaporation Loss	0.126	16.677
Infiltration Loss	0.109	14.434
Surface Runoff	0.007	0.982
Final Storage	-0.730	
Continuity Error (%)		

	Volume	Volume
	hectare-m	10 ⁶ ltr
Flow Routing Continuity	0.000	0.000
Dry Weather Inflow	0.109	1.092
Wet Weather Inflow	0.000	0.000
Groundwater Inflow	0.000	0.000
RDI Inflow	0.000	0.000
External Inflow	0.077	0.774
External Outflow	0.000	0.000
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.161	1.607
Initial Stored Volume	0.192	1.924
Final Stored Volume	0.000	
Continuity Error (%)		

 Time-Step Critical Elements

None

 Highest Flow Instability Indexes

All links are stable.

 Routing Time Step Summary

Minimum Time Step	: 0.50 sec
Average Time Step	: 1.00 sec
Maximum Time Step	: 1.00 sec
Percent in Steady State	: 0.00
Average Iterations per Step	: 2.00
Percent Not Converging	: 0.00

 Subcatchment Runoff Summary

Subcatchment	Total Precip mm	Total Runon mm	Total Evap mm	Total Infil mm	Imperv Runoff mm	Perv Runoff mm	Total Runoff mm	Total Runoff 10 ⁶ ltr	Peak Runoff CMS	Runoff Coeff
Pond	31.86	0.00	0.00	0.00	31.86	0.00	31.86	0.09	0.06	1.000
S-BX	31.86	0.00	0.00	0.03	30.53	0.00	30.53	0.30	0.21	0.958
S-EXT1	31.86	0.00	0.00	30.67	7.39	0.89	0.89	0.00	0.00	0.028
S-U1	31.86	0.00	0.00	29.02	2.69	0.04	2.73	0.02	0.02	0.086
S-U2	31.86	0.00	0.00	18.10	20.13	12.96	12.96	0.68	0.27	0.407

 Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
OF2_2_KizellDrain	JUNCTION	0.08	0.15	76.24	0 02:08	0.15
OF1	OUTFALL	0.00	0.00	77.70	0 00:00	0.00
OF2	OUTFALL	0.07	0.13	76.03	0 02:08	0.13
OF2_1_WetPond	STORAGE	1.16	1.26	76.36	0 02:08	1.26

 Node Inflow Summary

Node	Type	Maximum Lateral Inflow CMS	Maximum Total Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10 ⁶ ltr	Total Inflow Volume 10 ⁶ ltr	Flow Balance Error Percent
OF2_2_KizellDrain	JUNCTION	0.000	0.067	0 02:08	0	0.456	0.028
OF1	OUTFALL	0.221	0.221	0 01:10	0.318	0.318	0.000
OF2	OUTFALL	0.000	0.067	0 02:08	0	0.456	0.000
OF2_1_WetPond	STORAGE	0.292	0.292	0 01:20	0.774	2.38	0.001

 Node Surge Summary

No nodes were surcharged.

 Node Flooding Summary

No nodes were flooded.

 Storage Volume Summary

Storage Unit	Average Volume 1000 m3	Avg Full Pent	Evap Loss	Exfil Loss	Maximum Volume 1000 m3	Max Full Pent	Time of Max Occurrence days hr:min	Maximum Outflow CMS
OF2_1_WetPond	1.937	5	0	0	2.169	5	0 02:08	0.067

 Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10 ⁶ ltr
OF1	86.65	0.017	0.221	0.318
OF2	82.56	0.026	0.067	0.456
System	84.61	0.043	0.067	0.774

 Link Flow Summary

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/Full Flow	Max/Full Depth
C1	CHANNEL	0.067	0 02:08	0.70	0.00	0.09
W1	WEIR	0.009	0 02:07			1.00
W2	WEIR	0.057	0 02:08			0.30

Flow Classification Summary

Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class								
		Up Dry	Down Dry	Sub Dry	Sup Dry	Up Crit	Down Crit	Norm Crit	Inlet Crit	
C1	1.00	0.04	0.00	0.00	0.89	0.07	0.00	0.00	0.00	0.00

 Conduit Surge Summary

No conduits were surcharged.

Analysis begun on: Wed Aug 3 10:35:47 2022
 Analysis ended on: Wed Aug 3 10:35:47 2022
 Total elapsed time: < 1 sec

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.013)

Element Count

Number of rain gages 16
Number of subcatchments 5
Number of nodes 4
Number of links 3
Number of pollutants 0
Number of land uses 0

Raiage Summary

Table with columns: Name, Data Source, Data Type, Recording Interval. Lists various data sources like 100yr_3hr_Chicago and their recording intervals.

Subcatchment Summary

Table with columns: Name, Area, Width, %Imperv, %Slope, Rain Gage, Outlet. Lists subcatchments like Pond, S-BXK, S-EXT1, S-U1, S-U2.

Node Summary

Table with columns: Name, Type, Invert Elev., Max. Depth, Poned Area, External Inflow. Lists nodes like OF2_2_KizellDrain, OF1, OF2, OF2_1_WetPond.

Link Summary

Table with columns: Name, From Node, To Node, Type, Length, %Slope, Roughness. Lists links like C1, W1, W2.

Cross Section Summary

Table with columns: Conduit, Shape, Depth, Full Area, Hyd. Rad., Max. Width, No. of Barrels, Full Flow. Lists conduit C1 with shape Transect1.

Transect Summary

Table with columns: Area, and a grid of numerical values representing flow characteristics for Transect1.

Table with columns of numerical values, likely representing flow or hydraulic parameters for different elements.

NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

Analysis Options

Flow Units CMS
Process Models:
Rainfall/Runoff YES
RDII NO
Snowmelt NO
Groundwater NO
Flow Routing YES
Ponding Allowed YES
Water Quality NO
Infiltration Method HORTON
Flow Routing Method DYNWAVE
Surcharge Method EXTRAN
Starting Date 11/10/2013 00:00:00
Ending Date 11/10/2013 06:00:00
Antecedent Dry Days 0
Report Time Step 00:05:00
Wet Time Step 00:05:00
Dry Time Step 00:05:00
Routing Time Step 1.00 sec
Variable Time Step YES
Maximum Trials 20
Number of Threads 1
Head Tolerance 0.001500 m

Table with columns: Runoff Quantity, Continuity, Volume, Depth. Lists precipitation and infiltration losses.

Table with columns: Flow Routing, Continuity, Volume, Volume. Lists various inflow and outflow types like Dry Weather Inflow, Wet Weather Inflow, etc.

Time-Step Critical Elements

None

Highest Flow Instability Indexes

All links are stable.

Routing Time Step Summary

Minimum Time Step : 0.50 sec
Average Time Step : 1.00 sec
Maximum Time Step : 1.00 sec
Percent in Steady State : 0.00
Average Iterations per Step : 2.00

Percent Not Converging : 0.00

Subcatchment Runoff Summary

Subcatchment	Precip mm	Runon mm	Evap mm	Infil mm	Runoff mm	Runoff mm	Runoff mm	Runoff mm	Runoff mm	Runoff mm	Runoff mm	Coeff
Fond	71.68	0.00	0.00	0.00	71.67	0.00	71.67	0.20	0.14	1.000		
S-BX	71.68	0.00	0.00	0.04	70.56	0.03	70.59	0.69	0.48	0.985		
S-EXT1	71.68	0.00	0.00	42.78	17.06	28.83	28.83	0.08	0.03	0.402		
S-U1	71.68	0.00	0.00	42.11	6.21	23.89	30.10	0.23	0.18	0.420		
S-U2	71.68	0.00	0.00	20.86	46.65	50.55	50.55	2.67	1.36	0.705		

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
OF2_2_KisellDrain	JUNCTION	0.14	0.29	76.38	0 01:43	0.29
OF1	OUTFALL	0.00	0.00	77.70	0 00:00	0.00
OF2	OUTFALL	0.13	0.27	76.17	0 01:43	0.27
OF2_1_WetPond	STORAGE	1.26	1.57	76.67	0 01:43	1.57

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CMS	Maximum Total Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10^6 ltr	Total Inflow Volume 10^6 ltr	Flow Balance Error Percent
OF2_2_KisellDrain	JUNCTION	0.000	0.421	0 01:43	0	2.59	0.006
OF1	OUTFALL	0.662	0.662	0 01:10	0.918	0.918	0.000
OF2	OUTFALL	0.000	0.421	0 01:43	0	2.59	0.000
OF2_1_WetPond	STORAGE	1.429	1.429	0 01:15	2.94	4.55	0.001

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Storage Unit	Average Volume 1000 m3	Avg Pcnt	Evap Pcnt	Exfil Pcnt	Maximum Volume 1000 m3	Max Full	Time of Max Occurrence days hr:min	Maximum Outflow CMS
OF2_1_WetPond	2.225	6	0	0	3.146	8	0 01:43	0.421

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10^6 ltr
OF1	92.20	0.046	0.662	0.918
OF2	85.54	0.140	0.421	2.590
System	88.87	0.186	0.421	3.507

Link Flow Summary

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/ Full Flow	Max/ Full Depth
C1	CHANNEL	0.421	0 01:43	1.12	0.02	0.19
W1	WEIR	0.014	0 01:43			1.00
W2	WEIR	0.407	0 01:43			1.00

Flow Classification Summary


Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class									
		Dry Dry	Up Dry	Down Dry	Sub Crit	Sup Crit	Up Crit	Down Crit	Norm Crit	Inlet Ltd	Ctrl
C1	1.00	0.04	0.00	0.00	0.88	0.08	0.00	0.00	0.00	0.00	0.00

Conduit Surcharge Summary


No conduits were surcharged.

Analysis begun on: Tue Aug 2 16:11:37 2022
Analysis ended on: Tue Aug 2 16:11:37 2022
Total elapsed time: < 1 sec


POST DEVELOPMENT CONDITIONS

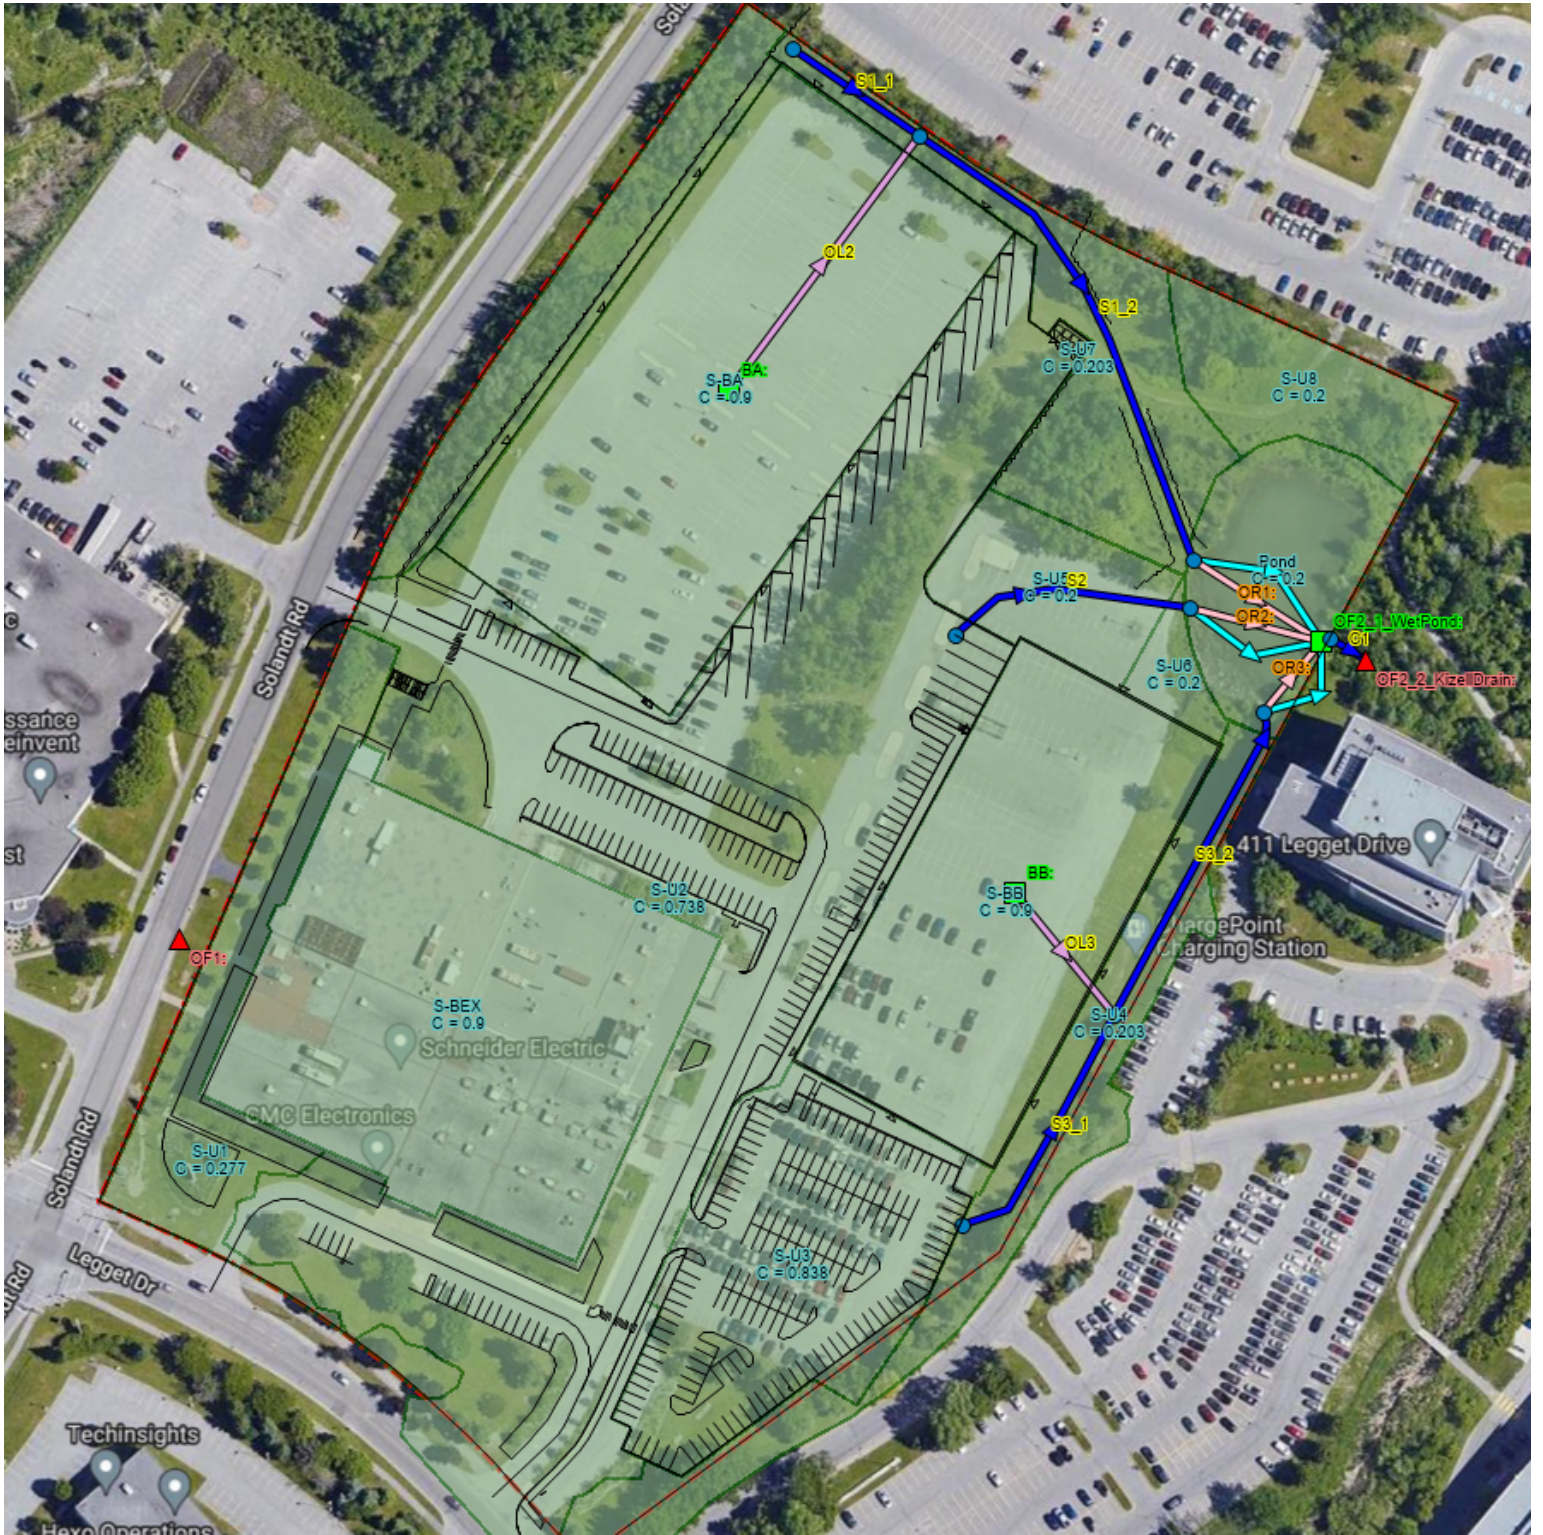


WET POND - PROPOSED CONDITIONS

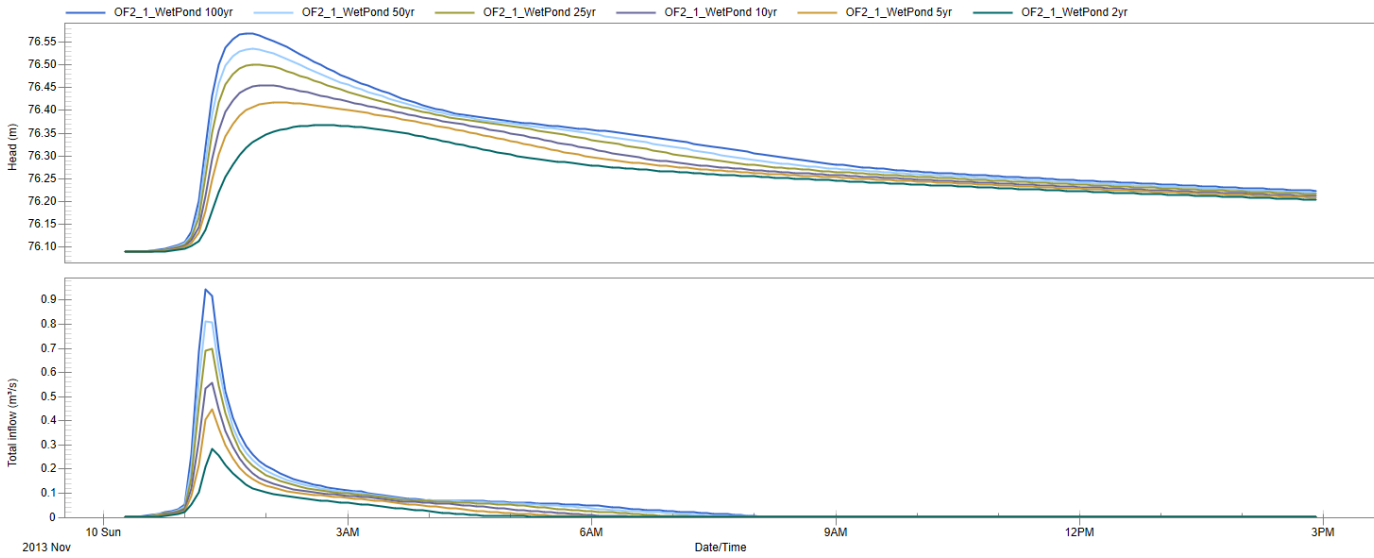

BUILDING A

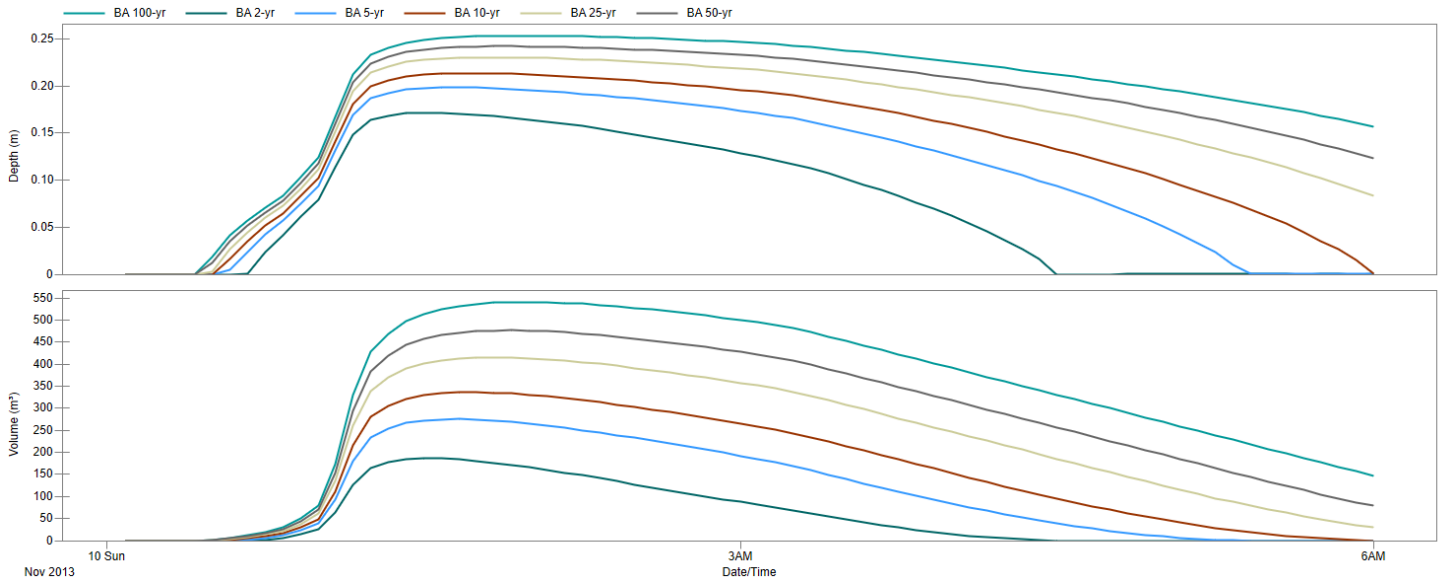

BUILDING B

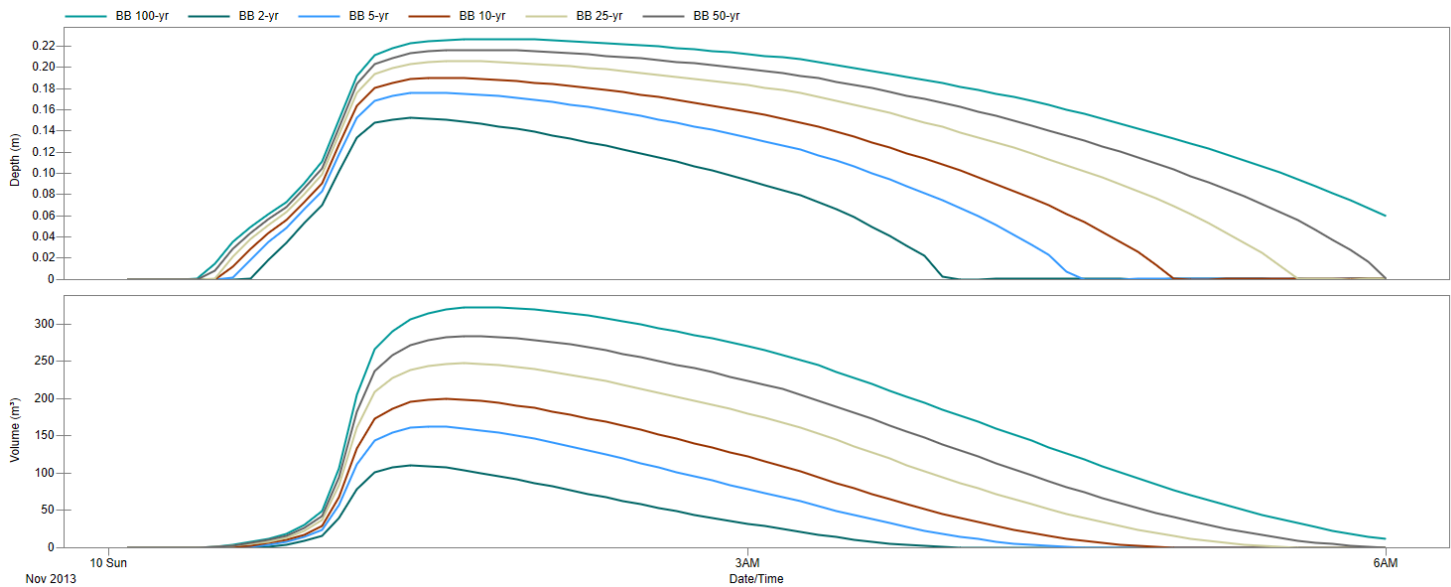

2-year Post Development

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.013)

WARNING 02: maximum depth increased for Node J1
 WARNING 02: maximum depth increased for Node J3
 WARNING 02: maximum depth increased for Node J4
 WARNING 02: maximum depth increased for Node J5
 WARNING 02: maximum depth increased for Node J8

 Element Count

 Number of rain gages 16
 Number of subcatchments ... 12
 Number of nodes 14
 Number of links 16
 Number of pollutants 0
 Number of land uses 0

 Raingage Summary

Name	Data Source	Data Type	Recording Interval
100yr_3hr_Chicago	100yr_3hr_Chicago	INTENSITY	10 min.
100yr_3hr_Chicago_Climate_Change	100yr_3hr_Chicago_Increase_20percent	INTENSITY	10 min.
100yr_6hr_Chicago	100yr_6hr_Chicago	INTENSITY	10 min.
100yr_6hr_Chicago_Climate_Change	100yr_6hr_Chicago_Increase_20percent	INTENSITY	10 min.
10yr_3hr_Chicago	10yr_3hr_Chicago	INTENSITY	10 min.
10yr_6hr_Chicago	10yr_6hr_Chicago	INTENSITY	10 min.
25mm_3hr_Chicago	25mm_3hr_Chicago	INTENSITY	10 min.
25mm_4hr_Chicago	25mm_4hr_Chicago	INTENSITY	10 min.
25yr_3hr_Chicago	25yr_3hr_Chicago	INTENSITY	10 min.
25yr_6hr_Chicago	25yr_6hr_Chicago	INTENSITY	10 min.
2yr_3hr_Chicago	2yr_3hr_Chicago	INTENSITY	10 min.
2yr_6hr_Chicago	2yr_6hr_Chicago	INTENSITY	10 min.
50yr_3hr_Chicago	50yr_3hr_Chicago	INTENSITY	10 min.
50yr_6hr_Chicago	50yr_6hr_Chicago	INTENSITY	10 min.
5yr_3hr_Chicago	5yr_3hr_Chicago	INTENSITY	10 min.
5yr_6hr_Chicago	5yr_6hr_Chicago	INTENSITY	10 min.

 Subcatchment Summary

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
Fpond	0.28	27550.00	5.00	3.3690	2yr_3hr_Chicago	OF2_1_WetPond
S-BA	1.12	660.53	100.00	2.0000	2yr_3hr_Chicago	BA
S-BB	0.72	422.71	99.98	2.0000	2yr_3hr_Chicago	BB
S-BBX	0.97	221.34	99.97	2.0000	2yr_3hr_Chicago	OF1
S-U	0.59	125.57	15.416	4.9330	2yr_3hr_Chicago	OF1
S-U2	2.11	83.39	77.97	2.0000	2yr_3hr_Chicago	J2
S-U3	0.56	54.08	91.54	0.6000	2yr_3hr_Chicago	J6
S-U4	0.41	31.45	5.39	7.3320	2yr_3hr_Chicago	J6
S-U5	0.18	73.22	5.00	2.0000	2yr_3hr_Chicago	J2
S-U6	0.05	19.04	5.00	2.0000	2yr_3hr_Chicago	OF2_1_WetPond
S-U7	0.37	98.63	5.36	2.0000	2yr_3hr_Chicago	J1
S-U8	0.20	41.38	5.00	2.0000	2yr_3hr_Chicago	OF2_1_WetPond

 Node Summary

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
J1	JUNCTION	77.50	1.00	0.0	
J2	JUNCTION	76.20	1.00	0.0	
J3	JUNCTION	75.85	1.31	0.0	
J4	JUNCTION	75.85	1.31	0.0	
J5	JUNCTION	75.85	1.31	0.0	
J6	JUNCTION	76.72	1.00	0.0	
J7	JUNCTION	76.33	1.00	0.0	
J8	JUNCTION	77.13	1.00	0.0	
J9	JUNCTION	76.09	1.91	0.0	
OF1	OUTFALL	77.70	0.00	0.0	
OF2_2_KizellDrain	OUTFALL	75.90	1.49	0.0	
BA	STORAGE	95.50	2.00	0.0	
BB	STORAGE	95.50	2.00	0.0	
OF2_1_WetPond	STORAGE	75.10	3.00	0.0	

 Link Summary

Name	From Node	To Node	Type	Length	%Slope	Roughness
C1	J9	OF2_2_KizellDrain	CONDUIT	11.1	1.7054	0.0350
SI_1	J1	J8	CONDUIT	39.1	0.9572	0.0350
SI_2	J1	J3	CONDUIT	133.4	0.9566	0.0350
S2	J2	J4	CONDUIT	64.2	0.5453	0.0350
S3_1	J6	J7	CONDUIT	69.7	0.5555	0.0350
S3_2	J7	J5	CONDUIT	86.9	0.5561	0.0350
OR1	J3	OF2_1_WetPond	ORIFICE			
OR2	J4	OF2_1_WetPond	ORIFICE			
OR3	J5	OF2_1_WetPond	ORIFICE			
C1_1	OF2_1_WetPond	J9	WEIR			

W1	J3	OF2_1_WetPond	WEIR
W2	J4	OF2_1_WetPond	WEIR
W3	J5	OF2_1_WetPond	WEIR
W4	OF2_1_WetPond	J9	WEIR
OL2	BA	J8	OUTLET
OL3	BB	J7	OUTLET

 Cross Section Summary

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	Transect1	1.49	10.54	0.51	22.03	1	25.26
SI_1	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	6.87
SI_2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	6.86
S2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.18
S3_1	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.23
S3_2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.23

 Transect Summary

Transect	Area:	0.0004	0.0016	0.0037	0.0066	0.0103
		0.0148	0.0201	0.0261	0.0326	0.0398
		0.0475	0.0558	0.0646	0.0741	0.0841
		0.0947	0.1059	0.1177	0.1302	0.1434
		0.1572	0.1717	0.1868	0.2026	0.2189
		0.2359	0.2535	0.2716	0.2904	0.3099
		0.3302	0.3512	0.3730	0.3957	0.4193
		0.4438	0.4693	0.4958	0.5235	0.5525
		0.5838	0.6182	0.6557	0.6960	0.7395
		0.7867	0.8369	0.8897	0.9440	1.0000
Width:		0.0131	0.0263	0.0394	0.0525	0.0657
		0.0788	0.0905	0.1006	0.1098	0.1189
		0.1281	0.1372	0.1463	0.1555	0.1646
		0.1742	0.1846	0.1949	0.2054	0.2159
		0.2264	0.2369	0.2475	0.2571	0.2667
		0.2763	0.2859	0.2955	0.3063	0.3183
		0.3302	0.3425	0.3563	0.3701	0.3840
		0.4001	0.4168	0.4335	0.4533	0.4772
		0.5243	0.5769	0.6225	0.6678	0.7269
		0.7828	0.8252	0.8580	0.8811	1.0000
Transect	Area:	0.0004	0.0016	0.0037	0.0066	0.0103
		0.0148	0.0201	0.0261	0.0326	0.0398
		0.0475	0.0558	0.0646	0.0741	0.0841
		0.0947	0.1059	0.1177	0.1302	0.1434
		0.1572	0.1717	0.1868	0.2026	0.2189
		0.2359	0.2535	0.2716	0.2904	0.3099
		0.3302	0.3512	0.3730	0.3957	0.4193
		0.4438	0.4693	0.4958	0.5235	0.5525
		0.5838	0.6182	0.6557	0.6960	0.7395
		0.7867	0.8369	0.8897	0.9440	1.0000
Width:		0.0131	0.0263	0.0394	0.0525	0.0657
		0.0788	0.0905	0.1006	0.1098	0.1189
		0.1281	0.1372	0.1463	0.1555	0.1646
		0.1742	0.1846	0.1949	0.2054	0.2159
		0.2264	0.2369	0.2475	0.2571	0.2667
		0.2763	0.2859	0.2955	0.3063	0.3183
		0.3302	0.3425	0.3563	0.3701	0.3840
		0.4001	0.4168	0.4335	0.4533	0.4772
		0.5243	0.5769	0.6225	0.6678	0.7269
		0.7828	0.8252	0.8580	0.8811	1.0000

 NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

Analysis Options

 Flow Units CMS
 Process Models:
 Rainfall/Runoff YES
 RDII NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed YES
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method DYNWAVE
 Surge Method EXTRAN
 Starting Date 11/10/2013 00:00:00
 Ending Date 11/10/2013 12:00:00
 Antecedent Dry Days 0
 Report Time Step 00:05:00
 Wet Time Step 00:05:00
 Dry Time Step 00:05:00
 Routing Time Step 1.00 sec
 Variable Time Step YES
 Maximum Trials 20
 Number of Threads 2
 Head Tolerance 0.001500 m

	Volume	Depth
Runoff Quantity Continuity	hectare-m	mm
Total Precipitation	0.241	31.860
Evaporation Loss	0.000	0.000
Infiltration Loss	0.091	12.095
Surface Runoff	0.143	18.914
Final Storage	0.008	1.071
Continuity Error (%)	-0.690	

	Volume	Volume
Flow Routing Continuity	hectare-m	10 ⁶ ltr
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.143	1.431
Groundwater Inflow	0.000	0.000
RDII Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	0.114	1.145
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.164	1.644
Final Stored Volume	0.196	1.959
Continuity Error (%)	-0.928	

Highest Continuity Errors

 Node J3 (6.15%)
 Node J5 (4.18%)
 Node J4 (3.23%)

Time-Step Critical Elements

 None

Highest Flow Instability Indexes

 Link W2 (77)
 Link W3 (76)
 Link W1 (62)
 Link OR2 (11)
 Link GL3 (9)

Routing Time Step Summary

 Minimum Time Step : 0.50 sec
 Average Time Step : 1.00 sec
 Maximum Time Step : 1.00 sec
 Percent in Steady State : 0.00
 Average Iterations per Step : 2.00
 Percent Not Converging : 0.00

Subcatchment Runoff Summary

Subcatchment	Total Precip mm	Total Runon mm	Total Evap mm	Total Infil mm	Imperv Runoff mm	Perv Runoff mm	Total Runoff mm	Total Runoff 10 ⁶ ltr	Peak Runoff CMS	Runoff Coeff
Pond	31.86	0.00	0.00	25.39	1.59	5.17	6.76	0.02	0.03	0.212
S-BA	31.86	0.00	0.00	0.00	30.46	0.00	30.46	0.34	0.24	0.956
S-BB	31.86	0.00	0.00	0.01	30.45	0.00	30.46	0.22	0.15	0.956
S-BBX	31.86	0.00	0.00	0.01	30.55	0.00	30.55	0.30	0.21	0.959
S-UI	31.86	0.00	0.00	26.92	4.70	0.04	4.74	0.03	0.02	0.149
S-U2	31.86	0.00	0.00	12.85	23.78	18.09	18.09	0.38	0.16	0.568

S-U3	31.86	0.00	0.00	5.43	27.94	25.45	25.45	0.14	0.09	0.799
S-U4	31.86	0.00	0.00	31.71	1.64	0.09	0.09	0.00	0.00	0.003
S-U5	31.86	0.00	0.00	31.63	1.52	0.20	0.20	0.00	0.00	0.006
S-U6	31.86	0.00	0.00	31.63	1.52	0.20	0.20	0.00	0.00	0.006
S-U7	31.86	0.00	0.00	31.66	1.63	0.15	0.15	0.00	0.00	0.005
S-U8	31.86	0.00	0.00	31.70	1.52	0.11	0.11	0.00	0.00	0.004

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	Maximum HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
J1	JUNCTION	0.00	0.01	77.51	0 01:13	0.01
J2	JUNCTION	0.08	0.21	76.41	0 01:20	0.21
J3	JUNCTION	0.41	0.52	76.37	0 02:43	0.52
J4	JUNCTION	0.41	0.52	76.37	0 02:43	0.52
J5	JUNCTION	0.41	0.52	76.37	0 02:43	0.52
J6	JUNCTION	0.01	0.15	76.87	0 01:15	0.15
J7	JUNCTION	0.02	0.17	76.50	0 01:17	0.17
J8	JUNCTION	0.02	0.08	77.21	0 01:21	0.08
J9	JUNCTION	0.08	0.15	76.24	0 02:44	0.15
OF1	OUTFALL	0.00	0.00	77.70	0 00:00	0.00
OF2_2_KizellDrain	OUTFALL	0.07	0.13	76.03	0 02:44	0.13
BA	STORAGE	0.04	0.17	95.67	0 01:32	0.17
BB	STORAGE	0.03	0.15	95.65	0 01:24	0.15
OF2_1_WetPond	STORAGE	1.16	1.27	76.37	0 02:44	1.27

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CMS	Maximum Total Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow 10 ⁶ ltr	Total Inflow Volume 10 ⁶ ltr	Flow Balance Error Percent
J1	JUNCTION	0.001	0.001	0 01:10	0.000568	0.000568	-0.296
J2	JUNCTION	0.161	0.161	0 01:20	0.382	0.382	-0.082
J3	JUNCTION	0.000	0.035	0 01:21	0	0.349	6.550
J4	JUNCTION	0.000	0.160	0 01:20	0	0.353	3.334
J5	JUNCTION	0.000	0.112	0 01:17	0	0.368	4.359
J6	JUNCTION	0.095	0.095	0 01:15	0.144	0.144	-0.159
J7	JUNCTION	0.000	0.119	0 01:15	0	0.368	-0.112
J8	JUNCTION	0.000	0.035	0 01:13	0	0.348	-0.078
J9	JUNCTION	0.000	0.067	0 02:44	0	0.82	0.013
OF1	OUTFALL	0.227	0.227	0 01:10	0.325	0.325	0.000
OF2_2_KizellDrain	OUTFALL	0.067	0.067	0 02:44	0	0.82	0.000
BA	STORAGE	0.240	0.240	0 01:10	0.342	0.342	-1.616
BB	STORAGE	0.153	0.153	0 01:10	0.219	0.219	-2.312
OF2_1_WetPond	STORAGE	0.031	0.273	0 01:20	0.0189	2.68	-0.148

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Storage Unit	Average Volume 1000 m3	Avg Pent	Evap Pent	Exfil Pent	Maximum Volume 1000 m3	Max Pent	Time of Max Occurrence days hr:min	Maximum Outflow CMS
BA	0.028	0	0	0	0.186	0	0 01:32	0.034
BB	0.014	0	0	0	0.110	0	0 01:24	0.028
OF2_1_WetPond	1.943	5	0	0	2.170	5	0 02:44	0.067

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10 ⁶ ltr
OF1	39.95	0.019	0.227	0.325
OF2_2_KizellDrain	91.11	0.021	0.067	0.820
System	65.53	0.040	0.067	1.145

Link Flow Summary

100-year Post Development

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/ Full Flow	Max/ Full Depth
C1	CHANNEL	0.067	0 02:44	0.70	0.00	0.09
S1_1	CONDUIT	0.001	0 01:13	0.02	0.00	0.04
S1_2	CONDUIT	0.035	0 01:21	0.13	0.01	0.30
S2	CONDUIT	0.160	0 01:20	0.28	0.03	0.34
S3_1	CONDUIT	0.091	0 01:15	0.46	0.02	0.16
S3_2	CONDUIT	0.112	0 01:17	0.24	0.02	0.30
OR1	ORIFICE	0.020	0 01:13			1.00
OR2	ORIFICE	0.052	0 01:17			1.00
OR3	ORIFICE	0.045	0 01:17			1.00
Cl_1	WEIR	0.009	0 02:43			1.00
W1	WEIR	0.028	0 02:27			0.21
W2	WEIR	0.105	0 01:22			0.21
W3	WEIR	0.060	0 01:20			0.21
W4	WEIR	0.058	0 02:44			0.30
OL2	DUMMY	0.034	0 01:10			
OL3	DUMMY	0.028	0 01:24			

Flow Classification Summary

Conduit	Adjusted /Actual Length	Fraction of Time in Flow Class								
		Up Dry	Down Dry	Sub Crit	Sup Crit	Up Crit	Down Crit	Norm Ltd	Inlet Ctrl	
C1	1.00	0.05	0.00	0.00	0.93	0.02	0.00	0.00	0.00	0.00
S1_1	1.00	0.05	0.65	0.00	0.30	0.00	0.00	0.00	0.91	0.00
S1_2	1.00	0.00	0.05	0.00	0.95	0.00	0.00	0.00	0.95	0.00
S2	1.00	0.00	0.08	0.00	0.92	0.00	0.00	0.00	0.06	0.00
S3_1	1.00	0.05	0.15	0.00	0.81	0.00	0.00	0.00	0.92	0.00
S3_2	1.00	0.00	0.05	0.00	0.95	0.00	0.00	0.00	0.95	0.00

Conduit Surge Summary

No conduits were surcharged.

Analysis begun on: Thu Aug 4 13:19:20 2022
 Analysis ended on: Thu Aug 4 13:19:21 2022
 Total elapsed time: 00:00:01

EPA STORM WATER MANAGEMENT MODEL - VERSION 5.1 (Build 5.1.013)

WARNING 02: maximum depth increased for Node J1
 WARNING 02: maximum depth increased for Node J3
 WARNING 02: maximum depth increased for Node J4
 WARNING 02: maximum depth increased for Node J5
 WARNING 02: maximum depth increased for Node J8

 Element Count

 Number of rain gages 16
 Number of subcatchments ... 12
 Number of nodes 14
 Number of links 16
 Number of pollutants 0
 Number of land uses 0

Rainage Summary

Name	Data Source	Data Type	Recording Interval
100yr_3hr_Chicago	100yr_3hr_Chicago	INTENSITY	10 min.
100yr_3hr_Chicago_Climate_Change_Increase_20percent	100yr_3hr_Chicago_Climate_Change_Increase_20percent	INTENSITY	10 min.
100yr_6hr_Chicago	100yr_6hr_Chicago	INTENSITY	10 min.
100yr_6hr_Chicago_Climate_Change_Increase_20percent	100yr_6hr_Chicago_Climate_Change_Increase_20percent	INTENSITY	10 min.
10yr_3hr_Chicago	10yr_3hr_Chicago	INTENSITY	10 min.
10yr_6hr_Chicago	10yr_6hr_Chicago	INTENSITY	10 min.
25mm_3hr_Chicago	25mm_3hr_Chicago	INTENSITY	10 min.
25mm_4hr_Chicago	25mm_4hr_Chicago	INTENSITY	10 min.
25yr_3hr_Chicago	25yr_3hr_Chicago	INTENSITY	10 min.
25yr_6hr_Chicago	25yr_6hr_Chicago	INTENSITY	10 min.
2yr_3hr_Chicago	2yr_3hr_Chicago	INTENSITY	10 min.
2yr_6hr_Chicago	2yr_6hr_Chicago	INTENSITY	10 min.
50yr_3hr_Chicago	50yr_3hr_Chicago	INTENSITY	10 min.
50yr_6hr_Chicago	50yr_6hr_Chicago	INTENSITY	10 min.
5yr_3hr_Chicago	5yr_3hr_Chicago	INTENSITY	10 min.
5yr_6hr_Chicago	5yr_6hr_Chicago	INTENSITY	10 min.

Subcatchment Summary

Name	Area	Width	%Imperv	%Slope	Rain Gage	Outlet
Pond	0.28	27550.00	5.00	3.3690	100yr_3hr_Chicago	OF2_1_WetPond
S-BA	1.12	460.53	100.00	2.0000	100yr_3hr_Chicago	BA
S-BB	0.72	422.71	99.98	2.0000	100yr_3hr_Chicago	BB
S-BEX	0.97	221.34	99.97	2.0000	100yr_3hr_Chicago	OF1
S-U1	0.59	125.57	15.46	4.9330	100yr_3hr_Chicago	OF1
S-U2	2.11	83.39	77.97	2.0000	100yr_3hr_Chicago	J2
S-U3	0.56	54.08	91.54	0.6000	100yr_3hr_Chicago	J6
S-U4	0.41	31.45	5.39	7.3320	100yr_3hr_Chicago	J6
S-U5	0.18	73.32	5.00	2.0000	100yr_3hr_Chicago	J2
S-U6	0.05	19.04	5.00	2.0000	100yr_3hr_Chicago	OF2_1_WetPond
S-U7	0.37	98.63	5.36	2.0000	100yr_3hr_Chicago	J1
S-U8	0.20	41.38	5.00	2.0000	100yr_3hr_Chicago	OF2_1_WetPond

Node Summary

Name	Type	Invert Elev.	Max. Depth	Ponded Area	External Inflow
J1	JUNCTION	77.50	1.00	0.0	
J2	JUNCTION	76.20	1.00	0.0	
J3	JUNCTION	75.85	1.31	0.0	
J4	JUNCTION	75.85	1.31	0.0	
J5	JUNCTION	75.85	1.31	0.0	
J6	JUNCTION	76.72	1.00	0.0	
J7	JUNCTION	76.33	1.00	0.0	
J8	JUNCTION	77.13	1.00	0.0	
J9	JUNCTION	76.09	1.91	0.0	
OF1	OUTFALL	77.70	0.00	0.0	
OF2_2_RizellDrain	OUTFALL	75.90	1.49	0.0	
BA	STORAGE	95.50	2.00	0.0	
BB	STORAGE	95.50	2.00	0.0	
OF2_1_WetPond	STORAGE	75.10	3.00	0.0	

Link Summary

Name	From Node	To Node	Type	Length	%Slope	Roughness
C1	J9	OF2_2_RizellDrain	CONDUIT	11.1	1.7054	0.0350
S1_1	J1	J8	CONDUIT	39.1	0.9572	0.0350
S1_2	J8	J3	CONDUIT	133.4	0.8566	0.0350
S2	J2	J4	CONDUIT	64.2	0.5453	0.0350
S3_1	J6	J7	CONDUIT	69.7	0.5555	0.0350
S3_2	J7	J5	CONDUIT	86.9	0.5561	0.0350
OR1	J3	OF2_1_WetPond	ORIFICE			
OR2	J4	OF2_1_WetPond	ORIFICE			
OR3	J5	OF2_1_WetPond	ORIFICE			
Cl_1	OF2_1_WetPond	J9	WEIR			
W1	J3	OF2_1_WetPond	WEIR			

W2 J4 OF2_1_WetPond WEIR
 W3 J5 OF2_1_WetPond WEIR
 W4 OF2_1_WetPond J9 WEIR
 OL2 BA J8 OUTLET
 OL3 BB J7 OUTLET

 Cross Section Summary

Conduit	Shape	Full Depth	Full Area	Hyd. Rad.	Max. Width	No. of Barrels	Full Flow
C1	Transect1	1.49	10.54	0.51	22.03	1	25.26
S1_1	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	6.87
S1_2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	6.86
S2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.18
S3_1	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.23
S3_2	TRAPEZOIDAL	1.00	3.75	0.53	6.75	1	5.23

 Transect Summary

Transect	Transect1	Area:	0.0004	0.0016	0.0037	0.0066	0.0103
		0.0148	0.0201	0.0261	0.0326	0.0398	
		0.0475	0.0558	0.0646	0.0741	0.0841	
		0.0947	0.1059	0.1177	0.1302	0.1434	
		0.1572	0.1717	0.1868	0.2026	0.2189	
		0.2359	0.2535	0.2716	0.2904	0.3099	
		0.3302	0.3512	0.3730	0.3957	0.4193	
		0.4438	0.4693	0.4958	0.5235	0.5525	
		0.5838	0.6182	0.6557	0.6960	0.7395	
		0.7867	0.8369	0.8897	0.9440	1.0000	
Brad:		0.0283	0.0566	0.0849	0.1132	0.1415	
		0.1698	0.2008	0.2341	0.2683	0.3015	
		0.3339	0.3656	0.3968	0.4277	0.4581	
		0.4872	0.5142	0.5413	0.5682	0.5951	
		0.6221	0.6493	0.6764	0.7057	0.7351	
		0.7644	0.7936	0.8227	0.8487	0.8719	
		0.8954	0.9185	0.9383	0.9587	0.9797	
		0.9957	1.0114	1.0281	1.0389	1.0427	
		1.0049	0.9690	0.9539	0.9451	0.9240	
		0.9138	0.9228	0.9436	0.9738	1.0000	
Width:		0.0131	0.0263	0.0394	0.0525	0.0657	
		0.0788	0.0905	0.1006	0.1098	0.1189	
		0.1281	0.1372	0.1463	0.1555	0.1646	
		0.1742	0.1846	0.1949	0.2054	0.2159	
		0.2264	0.2369	0.2475	0.2571	0.2667	
		0.2763	0.2859	0.2955	0.3063	0.3183	
		0.3302	0.3425	0.3563	0.3701	0.3840	
		0.4001	0.4168	0.4335	0.4533	0.4772	
		0.5243	0.5769	0.6225	0.6678	0.7269	
		0.7828	0.8252	0.8580	0.8811	1.0000	

Transect	Transect2	Area:	0.0004	0.0016	0.0037	0.0066	0.0103
		0.0148	0.0201	0.0261	0.0326	0.0398	
		0.0475	0.0558	0.0646	0.0741	0.0841	
		0.0947	0.1059	0.1177	0.1302	0.1434	
		0.1572	0.1717	0.1868	0.2026	0.2189	
		0.2359	0.2535	0.2716	0.2904	0.3099	
		0.3302	0.3512	0.3730	0.3957	0.4193	
		0.4438	0.4693	0.4958	0.5235	0.5525	
		0.5838	0.6182	0.6557	0.6960	0.7395	
		0.7867	0.8369	0.8897	0.9440	1.0000	
Brad:		0.0311	0.0622	0.0933	0.1244	0.1555	
		0.1867	0.2208	0.2574	0.2950	0.3315	
		0.3671	0.4020	0.4363	0.4702	0.5037	
		0.5357	0.5653	0.5951	0.6247	0.6543	
		0.6840	0.7138	0.7437	0.7759	0.8082	
		0.8404	0.8725	0.9045	0.9331	0.9586	
		0.9845	1.0099	1.0316	1.0540	1.0771	
		1.0948	1.1120	1.1304	1.1422	1.1464	
		1.0049	1.0653	1.0488	1.0391	1.0159	
		1.0047	1.0146	1.0374	1.0706	1.0000	
Width:		0.0131	0.0263	0.0394	0.0525	0.0657	
		0.0788	0.0905	0.1006	0.1098	0.1189	
		0.1281	0.1372	0.1463	0.1555	0.1646	
		0.1742	0.1846	0.1949	0.2054	0.2159	
		0.2264	0.2369	0.2475	0.2571	0.2667	
		0.2763	0.2859	0.2955	0.3063	0.3183	
		0.3302	0.3425	0.3563	0.3701	0.3840	
		0.4001	0.4168	0.4335	0.4533	0.4772	
		0.5243	0.5769	0.6225	0.6678	0.7269	
		0.7828	0.8252	0.8580	0.8811	1.0000	

NOTE: The summary statistics displayed in this report are based on results found at every computational time step, not just on results from each reporting time step.

 Analysis Options

Flow Units CMS
 Process Models:
 Rainfall/Runoff YES
 RDI NO
 Snowmelt NO
 Groundwater NO
 Flow Routing YES
 Ponding Allowed YES
 Water Quality NO
 Infiltration Method HORTON
 Flow Routing Method DYNRAVE
 Surge Method EXTRN
 Starting Date 11/10/2013 00:00:00
 Ending Date 11/10/2013 12:00:00
 Antecedent Dry Days 0.0
 Report Time Step 00:05:00
 Wet Time Step 00:05:00
 Dry Time Step 00:05:00
 Routing Time Step 1.00 sec
 Variable Time Step YES
 Maximum Trials 20
 Number of Threads 2
 Head Tolerance 0.001500 m

	Volume	Depth
Runoff Quantity	hectare-m	mm
Total Precipitation	0.542	71.677
Evaporation Loss	0.000	0.000
Infiltration Loss	0.122	16.166
Surface Runoff	0.416	55.010
Final Storage	0.008	1.071
Continuity Error (%)	-0.795	

	Volume	Volume
Flow Routing Continuity	hectare-m	10 ⁶ ltr
Dry Weather Inflow	0.000	0.000
Wet Weather Inflow	0.416	4.161
Groundwater Inflow	0.000	0.000
RDI Inflow	0.000	0.000
External Inflow	0.000	0.000
External Outflow	0.381	3.811
Flooding Loss	0.000	0.000
Evaporation Loss	0.000	0.000
Exfiltration Loss	0.000	0.000
Initial Stored Volume	0.164	1.644
Final Stored Volume	0.202	2.018
Continuity Error (%)	-0.410	

Highest Continuity Errors
 Node J3 (3.018)
 Node J4 (2.088)
 Node J5 (1.368)

Time-Step Critical Elements
 None

Highest Flow Instability Indexes
 Link W2 (70)
 Link W3 (48)
 Link W1 (34)
 Link OR2 (9)
 Link OR3 (6)

Routing Time Step Summary
 Minimum Time Step : 0.50 sec
 Average Time Step : 1.00 sec
 Maximum Time Step : 1.00 sec
 Percent in Steady State : 0.00
 Average Iterations per Step : 2.00
 Percent Not Converging : 0.00

 Subcatchment Runoff Summary

Subcatchment	Total Precip mm	Total Runon mm	Evap mm	Total Infil mm	Total Imperv Runoff mm	Total Ferv Runoff mm	Total Runoff mm	Total Runoff 10 ⁶ ltr	Peak Runoff CMS
Pond in this report	71.68	0.00	0.00	37.06	3.58	31.08	34.66	0.10	0.12 0.484
S-BA	71.68	0.00	0.00	0.00	70.28	0.00	70.28	0.79	0.56 0.981
S-BB	71.68	0.00	0.00	0.01	70.27	0.01	70.27	0.50	0.36 0.980
S-BEX	71.68	0.00	0.00	0.01	70.53	0.01	70.54	0.69	0.48 0.984
S-U1	71.68	0.00	0.00	38.92	10.85	22.33	35.18	0.20	0.16 0.463
S-U2	71.68	0.00	0.00	14.43	55.13	56.92	56.92	1.20	0.67 0.794
S-U3	71.68	0.00	0.00	5.88	64.73	65.32	65.32	0.37	0.25 0.911

S-U4	71.68	0.00	0.00	46.83	3.78	25.13	25.13	0.10	0.05	0.351
S-U5	71.68	0.00	0.00	44.25	3.52	28.19	28.19	0.05	0.04	0.393
S-U6	71.68	0.00	0.00	44.25	3.51	28.19	28.19	0.01	0.01	0.393
S-U7	71.68	0.00	0.00	45.03	3.76	27.16	27.16	0.10	0.07	0.379
S-U8	71.68	0.00	0.00	45.81	3.51	26.27	26.27	0.05	0.03	0.367

Node Depth Summary

Node	Type	Average Depth Meters	Maximum Depth Meters	HGL Meters	Time of Max Occurrence days hr:min	Reported Max Depth Meters
J1	JUNCTION	0.01	0.11	77.61	0 01:10	0.11
J2	JUNCTION	0.15	0.49	76.69	0 01:17	0.48
J3	JUNCTION	0.48	0.71	76.56	0 01:46	0.71
J4	JUNCTION	0.49	0.80	76.65	0 01:18	0.80
J5	JUNCTION	0.48	0.72	76.57	0 01:46	0.72
J6	JUNCTION	0.02	0.28	77.00	0 01:15	0.28
J7	JUNCTION	0.06	0.29	76.62	0 01:15	0.28
J8	JUNCTION	0.05	0.14	77.26	0 01:14	0.14
J9	JUNCTION	0.12	0.25	76.34	0 01:46	0.25
OF1	OUTFALL	0.00	0.00	77.70	0 00:00	0.00
OF2_2_KizellDrain	OUTFALL	0.11	0.23	76.13	0 01:46	0.23
BA	STORAGE	0.11	0.25	95.75	0 02:00	0.25
BB	STORAGE	0.08	0.23	95.73	0 01:44	0.23
OF2_1_WetPond	STORAGE	1.23	1.46	76.56	0 01:46	1.46

Node Inflow Summary

Node	Type	Maximum Lateral Inflow CMS	Maximum Total Inflow CMS	Time of Max Occurrence days hr:min	Lateral Inflow Volume 10 ⁶ ltr	Total Inflow Volume 10 ⁶ ltr	Flow Balance Error Percent
J1	JUNCTION	0.068	0.068	0 01:10	0.102	0.102	-0.055
J2	JUNCTION	0.704	0.704	0 01:15	1.25	1.25	-0.057
J3	JUNCTION	0.000	0.094	0 01:14	0	0.895	3.105
J4	JUNCTION	0.000	0.665	0 01:15	0	1.25	1.377
J5	JUNCTION	0.000	0.313	0 01:16	0	0.981	2.127
J6	JUNCTION	0.297	0.297	0 01:15	0.47	0.47	-0.236
J7	JUNCTION	0.000	0.321	0 01:15	0	0.977	-0.300
J8	JUNCTION	0.000	0.100	0 01:10	0	0.892	-0.351
J9	JUNCTION	0.000	0.280	0 01:46	0	2.93	0.004
OF1	OUTFALL	0.637	0.637	0 01:10	0.882	0.882	0.000
OF2_2_KizellDrain	OUTFALL	0.000	0.280	0 01:46	0	2.93	0.000
BA	STORAGE	0.557	0.557	0 01:10	0.789	0.789	-0.152
BB	STORAGE	0.356	0.356	0 01:10	0.505	0.505	-0.246
OF2_1_WetPond	STORAGE	0.159	0.960	0 01:16	0.161	4.83	-0.103

Node Surcharge Summary

No nodes were surcharged.

Node Flooding Summary

No nodes were flooded.

Storage Volume Summary

Storage Unit	Average Volume 1000 m3	Avq Pcnt Full	Evap Pcnt Loss	Exfil Pcnt Loss	Maximum Volume 1000 m3	Max Pcnt Full	Time of Max Occurrence days hr:min	Maximum Outflow CMS
BA	0.174	0	0	0	0.541	1	0 02:00	0.034
BB	0.081	0	0	0	0.324	0	0 01:44	0.028
OF2_1_WetPond	2.111	5	0	0	2.719	7	0 01:46	0.280

Outfall Loading Summary

Outfall Node	Flow Freq Pcnt	Avg Flow CMS	Max Flow CMS	Total Volume 10 ⁶ ltr
OF1	42.62	0.048	0.637	0.882
OF2_2_KizellDrain	92.85	0.073	0.280	2.930
System	67.74	0.121	0.280	3.811

Link Flow Summary

Link	Type	Maximum Flow CMS	Time of Max Occurrence days hr:min	Maximum Veloc m/sec	Max/ Full Flow	Max/ Full Depth
C1	CHANNEL	0.280	0 01:46	1.01	0.01	0.16
S1_1	CONDUIT	0.066	0 01:10	0.50	0.01	0.12
S1_2	CONDUIT	0.094	0 01:14	0.22	0.01	0.41
S2	CONDUIT	0.665	0 01:15	0.44	0.13	0.65
S3_1	CONDUIT	0.293	0 01:15	0.66	0.06	0.28
S3_2	CONDUIT	0.313	0 01:16	0.36	0.06	0.48
OR1	ORIFICE	0.019	0 01:01			1.00
OR2	ORIFICE	0.078	0 01:15			1.00
OR3	ORIFICE	0.050	0 01:13			1.00
C1_1	WEIR	0.013	0 01:46			1.00
W1	WEIR	0.045	0 01:41			0.40
W2	WEIR	0.544	0 01:17			0.49
W3	WEIR	0.227	0 01:17			0.41
W4	WEIR	0.268	0 01:46			0.87
OL2	DUMMY	0.034	0 01:03			
OL3	DUMMY	0.028	0 01:05			

Flow Classification Summary

Conduit	Adjusted /Actual Length	Up Dry	Down Dry	Sub Dry	Sup Crit	Up Crit	Down Crit	Norm Crit	Inlet Ltd	Flow Ctrl
C1	1.00	0.04	0.00	0.00	0.94	0.03	0.00	0.00	0.00	0.00
S1_1	1.00	0.03	0.57	0.00	0.41	0.00	0.00	0.00	0.92	0.00
S1_2	1.00	0.00	0.03	0.00	0.97	0.00	0.00	0.00	0.97	0.00
S2	1.00	0.00	0.08	0.00	0.92	0.00	0.00	0.00	0.02	0.00
S3_1	1.00	0.03	0.11	0.00	0.86	0.00	0.00	0.00	0.93	0.00
S3_2	1.00	0.00	0.03	0.00	0.97	0.00	0.00	0.00	0.77	0.00

Conduit Surcharge Summary

No conduits were surcharged.

Analysis begun on: Thu Aug 4 13:19:55 2022
Analysis ended on: Thu Aug 4 13:19:56 2022
Total elapsed time: 00:00:01

APPENDIX








D


MVCA

FLOODPLAIN


MAP

Legend

- Parcels - Assessment
-  Meander Belt
-  1:100 yr Flood Plain
-  Floodplain Spill Lines
-  Floodplain Study Limit
-  MVCA Regulation Limit
-  MVCA Streams
-  Ottawa_Subcatchments




Projection: UTM Zone 18- NAD 83 Datum

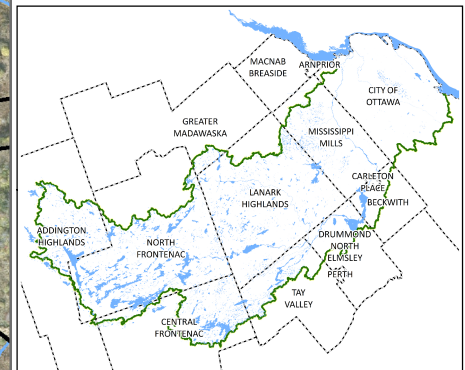

This map is produced in part with data provided by the Ontario Geographic Data Exchange under License with the Ontario Ministry of Natural Resources and the Queen's Printer for Ontario, 2019

Imagery @ Fugro Geospatial, May 2014

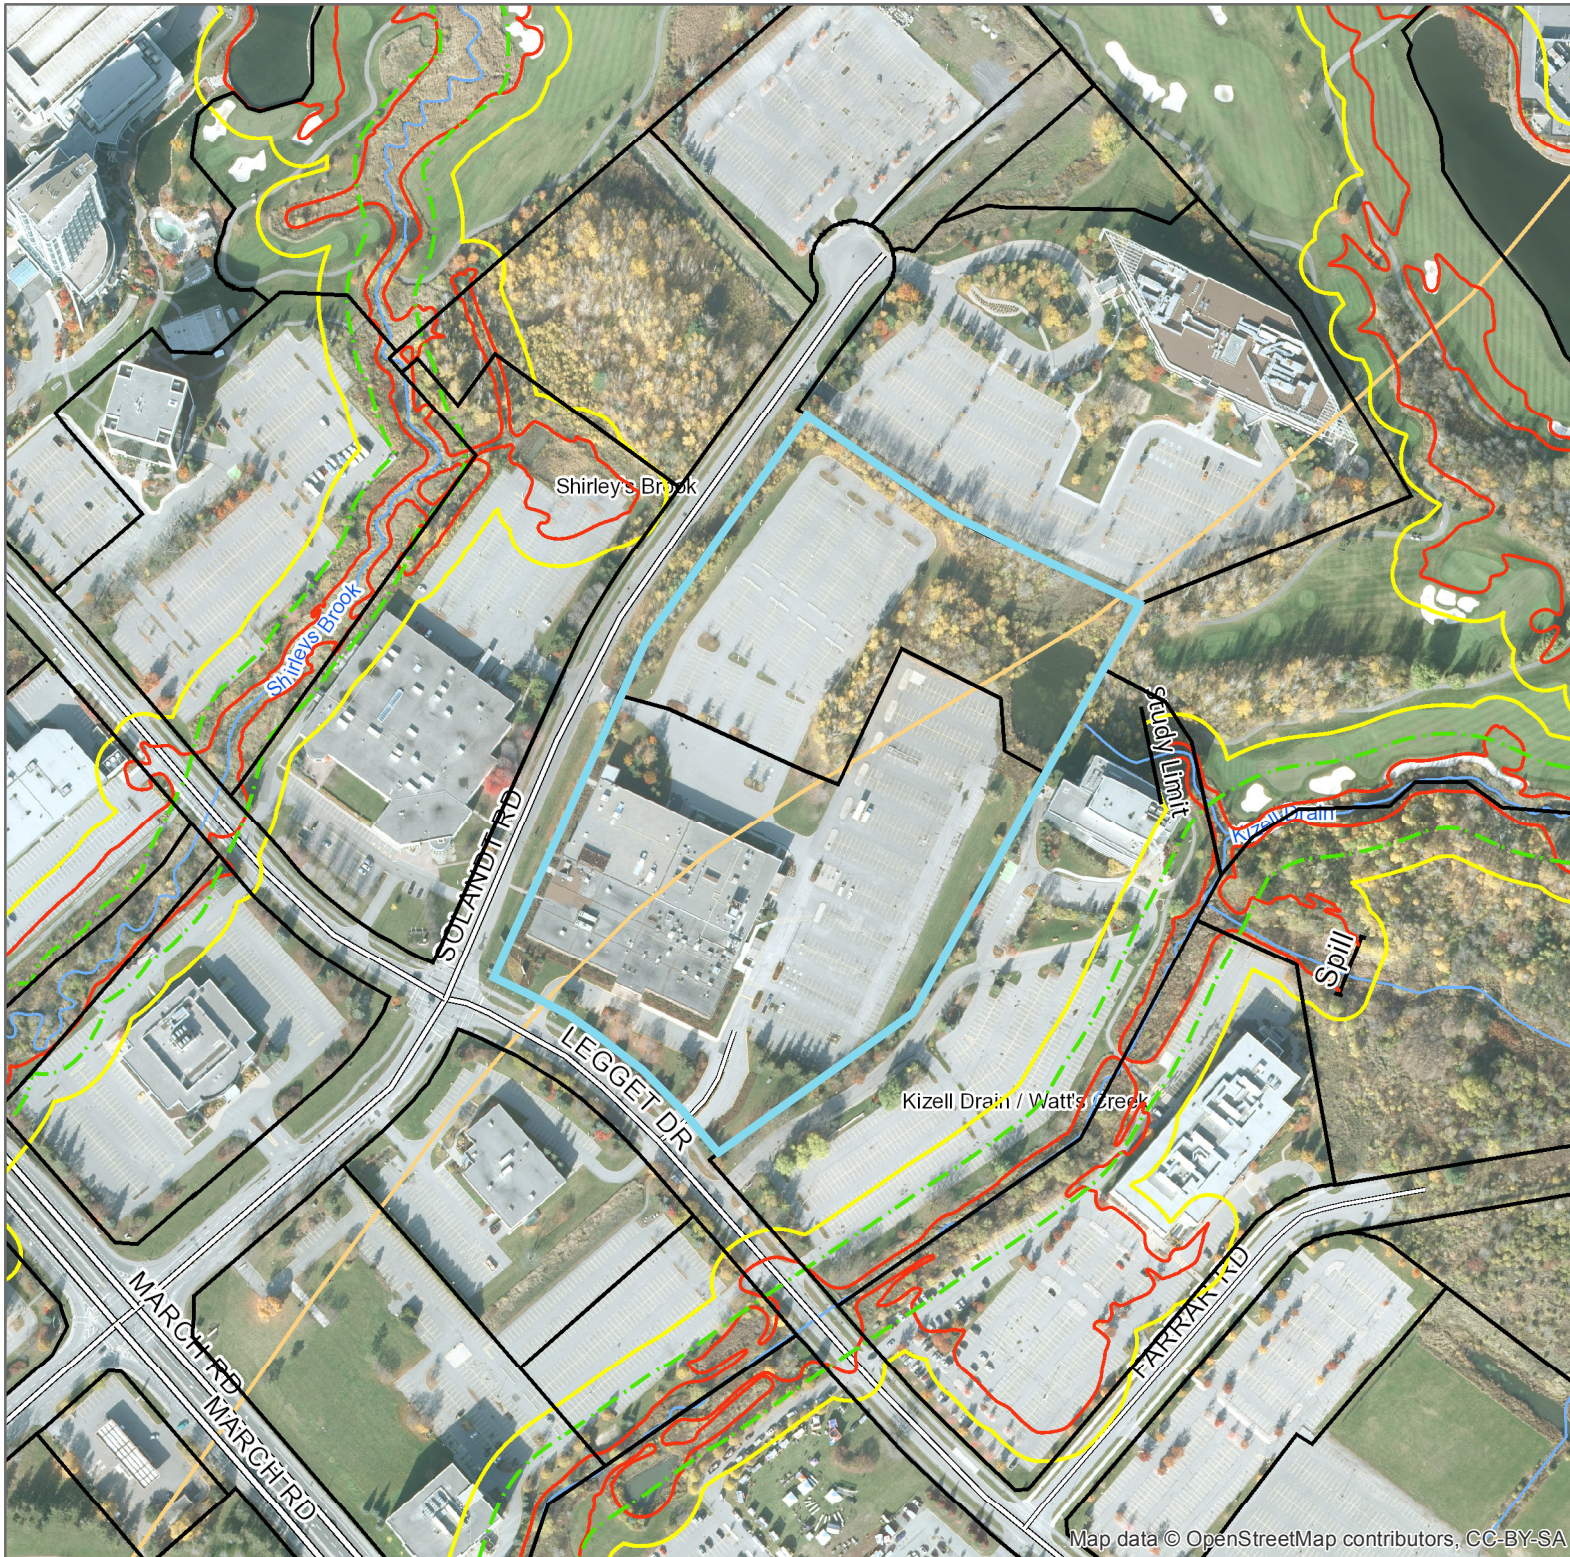

Map data © OpenStreetMap contributors, CC-BY-SA

APPENDIX

E SUPPORTING DOCUMENTS





Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control for Roof Drains



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
 Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

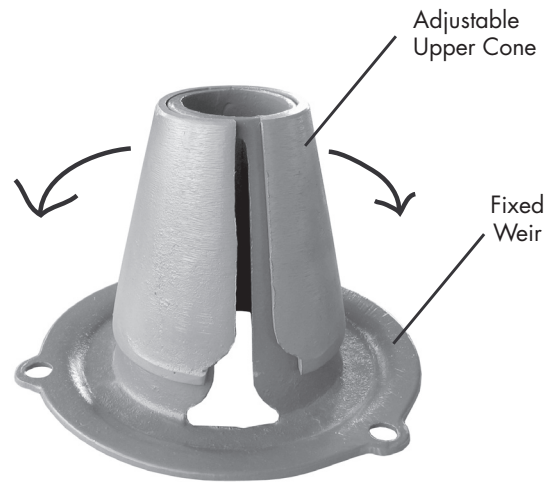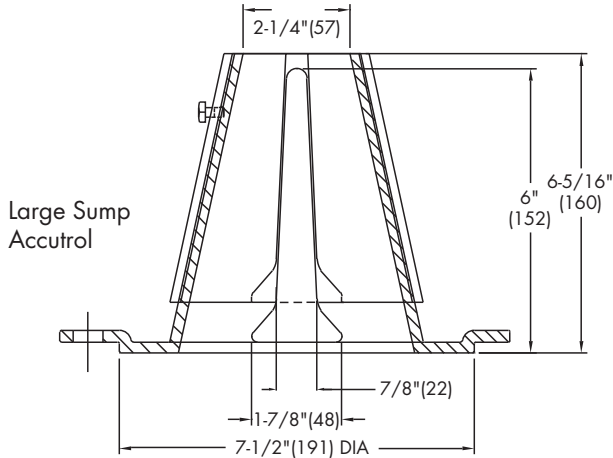

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____
 Job Location _____
 Engineer _____

Contractor _____
 Contractor's P.O. No. _____
 Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com
 Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca
 Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com

