



**Site Servicing and Stormwater
Management Report
365 Forest Street, Ottawa, ON**

Client:

11061917 Canada Inc.
200-768 St. Joseph Boulevard
Gatineau, QC J8Y 4B8

Submitted for:

Site Plan Control, Zoning By-law Amendment & Official Plan Amendment

Project Name:

365 Forest Street

Project Number:

OTT-00252570-A0

Prepared By:

EXP
2650 Queensview Drive
Ottawa, ON K2B 8H8
t: +1.613.688.1899
f: +1.613.225.7337

Date Submitted:

2023-10-30

Site Servicing and Stormwater Management Report 365 Forest Street, Ottawa, ON

Client:

11061917 Canada Inc.
200-768 St. Joseph Boulevard
Gatineau, QC J8Y 4B8

Submitted for:

Site Plan Control, Zoning By-law Amendment & Official Plan Amendment

Project Name:

365 Forest Street

Project Number:

OTT-00252570-A0

Prepared By:

EXP
2650 Queensview Drive
Ottawa, ON K2B 8H8
t: +1.613.688.1899
f: +1.613.225.7337

Prepared by:

Approved by:



Alexander Cole, EIT
Engineering Designer

Bruce Thomas, P.Eng.
Senior Project Manager

Date Submitted:

2023-10-30

Table of Contents

1	Introduction	1
1.1	Overview	1
2	Existing Conditions.....	2
3	Existing Infrastructure.....	2
4	Water Servicing.....	4
4.1	Existing Water Servicing.....	4
4.2	Water Servicing Proposal	4
4.3	Water Servicing Design	4
4.4	Water Servicing Design Criteria	5
4.5	Estimated Water Demands	6
4.6	Boundary Conditions.....	6
4.7	Fire Flow Requirements	6
4.8	Review of Hydrant Spacing	7
5	Sewage Servicing	8
5.1	Existing Sewage Conditions.....	8
5.2	Proposed Sewage Conditions.....	8
6	Storm Servicing & Stormwater Management.....	10
6.1	Design Criteria.....	10
6.2	Minor System Design Criteria	10
6.3	Major System Design Criteria.....	11
6.4	Runoff Coefficients.....	11
6.5	Time of Concentration	12
6.6	Pre-Development Conditions.....	12
6.7	Allowable Release Rate	12
6.8	Proposed Stormwater System	13
6.9	Flow Attenuation	15
7	Erosion & Sediment Control	17
8	Conclusions and Recommendations.....	17
9	Legal Notification.....	19

List of Figures

Figure 1-1 - Site Location.....	1
Figure A-1 - Pre-Development Drainage Areas	A
Figure A-2 - Post-Development Drainage Areas.....	A
Figure A-3 – Hydrant Location Plan.....	A
Figure A-4 – Roof Catchments.....	A
Figure A-5 – Fire Flow Distance Plan	A

List of Tables

Table 4-1 - Summary of Water Supply Design Criteria.....	5
Table 4-2 : Water Demand Summary	6
Table 4-3 - Summary of Design Parameters Used in Calculating Required Fire Flows (RFF) Using FUS.....	7
Table 4-4 – Required Fire Flows	8
Table 5-1 – Summary of Existing Sewage Flows	8
Table 5-2 – Summary of Wastewater Design Criteria / Parameters	9
Table 5-3 – Summary of Anticipated Sewage Rates	9
Table 6-1 – Spillway Elevations	11
Table 6-2 – Summary of Runoff Coefficients.....	12
Table 6-3 – Summary of Pre-Development Flows	12
Table 6-4 – Summary of Allowable Release Rates	12
Table 6-5 – Summary of Proposed Storm System	14
Table 6-6 – Summary of Post-Development Flows	14
Table 6-7 – Summary of Post-Development Storage	15
Table 6-8 – Summary of Ponding Storage Depths on Roof	16
Table B-1 – Water Demand Chart	B
Table B-2 – Fire Flow Requirements Based on Fire Underwriters Survey (FUS) – Tower A	B
Table B-3 – Fire Flow Requirements Based on Fire Underwriters Survey (FUS) – Tower B	B
Table B-4 – Available Fire Flows Based on Hydrant Spacing	B
Table B-5 – Estimated Water Pressure at Proposed Building.....	B
Table C-6 – Sanitary Sewer Design Sheet	C
Table D-7 – Average Runoff Coefficients for Pre-Development.....	D
Table D-8 – Estimation of Pre-Development Peak Flows	D
Table D-9 – Estimation of Allowable Peak Flows (Based on Max C=0.50 with Tc=10mins)	D
Table D-10 – Average Runoff Coefficients for Post-Development	D
Table D-11 – Summary of Post-Development Peak Flows (Uncontrolled and Controlled)	D
Table D-12 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-1)	D
Table D-13 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-3)	D
Table D-14 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-4)	D
Table D-15 –Roof Design Sheet - Tower A.....	D

Table D-16 – Roof Design Sheet - Tower B D

List of Appendices

Appendix A - Figures A
Appendix B – Water Servicing Tables B
Appendix C – Sanitary Servicing Tables C
Appendix D – Stormwater Servicing Tables D
Appendix E – Consultation / Correspondence E
Appendix F – Background Information F
Appendix G – Checklist G
Appendix H – Drawings H

1 Introduction

1.1 Overview

EXP Services Inc. (EXP) was retained by 11061917 Canada Inc. to prepare a Site Servicing and Stormwater Management report for the proposed redevelopment of 365 Forest Street in support of Official Plan Amendment, Zoning By-Law Amendment and Site Plan Control applications.

The 0.54 hectare site is situated at the corner of Richmond Road and Forest Street as illustrated in **Figure 1-1** below. The site is within the City of Ottawa urban boundary and situated in Bay Ward. The description of the subject property is noted below:

- Part of Lots 42, 56 and 57, Registered Plan 311, in the City of Ottawa, consisting of:
- PIN 039620357 or 1420 Richmond Road.
- PIN 039620356 or 365 Forest Street.
- PIN 039620352 or 2589 Bond Street.
- PIN 039620390 & PIN 039620391, 2583 Bond Street.

The development will consist of two high-rise buildings. Tower A is a 12-storey high-rise comprised of 168 units and Tower B is 12-storey high-rise and comprised of 223 units. Below the towers, four levels of underground parking will be provided. As part of the development, a road widening will be provided to the City along Richmond Road (18.75 m from centreline), reducing the site area to 0.51 hectares.

This report will discuss the adequacy of the adjacent municipal watermain, sanitary sewers and storm sewers to provide the required water supply, convey the sewage and stormwater flows that will result from the proposed development. This report provides a design brief for submission, along with the engineering drawings, for City approval.



Figure 1-1 - Site Location

2 Existing Conditions

Within the four subject properties, there are two (2) existing buildings. The following summarizes the current land use conditions.

- 1420 Richmond Road Vacant property, but currently used as gravel parking lot.
- 365 Forest Street Automobile garage and repair shop including asphalt parking lot.
- 2589 Bond Street Automobile repair shop and asphalt parking lot.
- 2583 Bond Street Vacant property.

All four properties are zoned Arterial Mainstreet Zone (AM10).

The topography of the subject site falls in a southerly and easterly direction along Forest Street and Bond Street, with a localized roadway sag condition on Forest Street approximately $\pm 50\text{m}$ south of Richmond Road.

3 Existing Infrastructure

The site includes two commercial buildings that will be removed during the redevelopment of the site.

From review of the sewer and watermain mapping, as-built drawings and Utility Central Registry (UCC) plans, the following summarizes the onsite and adjacent offsite infrastructure:

Within property

- Storm, sanitary and watermain laterals to the two buildings that will be abandoned.

On Bond Street

- 150mm watermain
- 225mm sanitary sewer
- 300mm storm sewer
- 35mm Gas / Bell / Streetlighting/ Hydro

On Forest Street

- 300mm watermain
- 250mm sanitary sewer
- 300mm storm sewer
- Hydro /Bell / Streetlighting / Hydro

On Richmond Road

- 300mm watermain
- 225 mm sanitary sewer
- 525mm storm sewer
- 200mm Gas / Hydro / Bell / Streetlighting

As-built drawings for Bond Street, Forest Street, and Richmond Road were obtained from the City's vault and are included in **Appendix F**.

1.3 Pre-Consultation / Permits / Approvals

A pre-consultation meeting was held with the City prior to design commencement. This meeting outlined the submission requirements and provided information to assist with the development proposal. A copy of pre-consultation correspondence is included in **Appendix E**.

The proposed site is located within the Rideau Valley Conservation Authority (RVCA) jurisdiction, therefore signoff from the RVCA will be required prior to Site Plan approval. The RVCA has been contacted to confirm the stormwater management quality control requirements. A copy of the correspondence with the RCVA is attached in **Appendix E**.

Generally, an Environmental Compliance Approval (ECA) would be obtained from the Ministry of Environment, Conservation and Parks (MECP), formerly the Ministry of the Environment and Climate Change (MOECC), for any onsite private Sewage Works.

The onsite Sewage Works would generally include the onsite stormwater works such as flow controls, associated stormwater detention, and treatment works. However, an Approval Exemption under Ontario Regulation 525/98 can be applied. Under Section 3 of O. Reg 525/98, Section 53 (1) and (3) do not apply to the alteration, extension, replacement or a change to a stormwater management facility that 1) is designed to service one lot or parcel of land, b) discharges into a storm sewer that is not a combined sewer, c) does not service industrial land or a structure located on industrial land, and finally d) is not located on industrial land.

Based on this exemption, if the parcels noted above are merged into one property parcel, then by completing this the Approval Exemptions under O. Reg 525/98, would be satisfied and not require an ECA. Prior to City signoff on the infrastructure design a pre-consultation meeting will be held with the local MECP, to confirm that the site will not require an ECA.

In addition, various design guidelines were referred to in preparing the current report including:

- Bulletin ISDTB-2012-4 (20 June 2012)
 - Technical Bulletin ISDTB-2014-01 (05 February 2014)
 - Technical Bulletin PIEDTB-2016-01 (September 6, 2016)
 - Technical Bulletin ISDTB-2018-01 (21 March 2018)
 - Technical Bulletin ISDTB-2018-04 (27 June 2018)
- Ottawa Design Guidelines – Water Distribution, July 2010 (WDG001), including:
 - Technical Bulletin ISDTB-2014-02 (May 27, 2014)
 - Technical Bulletin ISTB-2018-02 (21 March 2018)
- Stormwater Management Planning and Design Manual, Ontario Ministry of the Environment and Climate Change, March 2003 (SMPDM).
- Design Guidelines for Drinking-Water Systems, Ontario Ministry of the Environment and Climate Change, 2008 (GDWS).
- Fire Underwriters Survey, Water Supply for Public Fire Protection (FUS), 1999.
- Ontario Building Code 2012, Ministry of Municipal Affairs and Housing.
- Stormwater Management Guidelines for the Pinecrest Creek/Westboro Area Final Report by JFSA
- Stormwater Management Design Criteria for Pinecrest Creek/Westboro Area, City of Ottawa Final – May 2020

4 Water Servicing

4.1 Existing Water Servicing

The subject site is within the City of Ottawa 1W pressure zone. The site is currently serviced by the existing 300mm watermain on Forest Street and the 150mm watermain on Bond Street. The two existing buildings are serviced by laterals that will be blanked at the main to satisfaction of the City's Sewer Operations prior to shoring and excavating of the building.

4.2 Water Servicing Proposal

The proposed development will consist of two high-rise buildings. Tower A is a 12-storey high-rise comprised of 168 units and Tower B is 12 storeys and comprised of 223 units. Architectural plans and rendering of the proposed building along with building statistics are provided in **Appendix H**.

Water supply for the site will be provided by twin 200mm watermains supplied from the existing watermain on Forest Street. The need for a twin watermain is the result of the average day water demands exceeding 50 m³/day. The watermain feeds from the underground parking level and will connect directly to the existing 300mm watermain on Forest Street and will have an isolation valve between them, consistent with City of Ottawa Water Design Guidelines.

The buildings will be protected by automatic sprinkler systems. A fire department connection (or siamese) will be located within 45 metres of an adjacent municipally owned fire hydrant. In order to achieve this, a new hydrant will be installed off the existing 300mm watermain within Forest Street. Detailed layout of the proposed water services is provided in drawing C100 of **Appendix H**.

4.3 Water Servicing Design

The water servicing requirements for the proposed building is designed in accordance with the City Design Guidelines (July 2010). The following steps indicate the basic methodology that was used in our analysis:

- Estimated water demands under average day, maximum day and peak hour conditions. As the total population estimate was greater than 500, standard residential peaking factors were used, rather than based on MECP Table 3-3 which would be necessary when the design population is less than 500 persons.
- Estimated the required fire flow (RFF) based on the Fire Underwriters Survey (FUS).
- Obtained hydraulic boundary conditions (HGL) from the City, based on the above water demands and required fire flows.
- Boundary condition data and water demands were used to estimate the pressure at the proposed building, and this was compared to the City's design criteria.

Since the average day demand exceed 50 m³ per day, two watermain feeds to the building will be necessary as per Section 4.31 of the WDG001. **Table B-1** in **Appendix B** provides detailed calculations of the total water demands.

A review of the estimated watermain pressures at the building connection, based on the boundary conditions provided, was completed based on using two watermains. **Table B-5** in **Appendix B** provides a comparison of anticipated pressures at the building connection based on using a single or double watermain feed. A single watermain analysis was completed to determine if the water pressure still met the City requirement during either the maximum day plus fire flow or peak hour condition, if one of the laterals was out of service.

Based on results, the use of two 150mm watermains would result in a pressure of ±50.1 psi at the building, while the use of two 200mm watermains would improve the pressure to ±52.4 psi under maximum day plus fire flow conditions. The minimal

difference in pressure is the result of the short length of the water service lateral. In the event one of the watermains are down for service, the pressure at the building using only a single 150mm or 200mm watermain would be ±42.1 psi or ±50.3 psi respectively.

Under peak hour conditions, there is little difference using a 150mm or 200mm watermain, with anticipated pressure at the building of ±52.2 psi.

Based on the results, the installation of two 200mm watermains with a shut-off valve between them is proposed. Detailed calculations of the anticipated water pressures, based on City of Ottawa boundary conditions, is provided in **Table B-5**.

No pressure reducing measures are required as operating pressures are within 50 psi and 80 psi.

4.4 Water Servicing Design Criteria

Table 4-1 below summarizes the Design Criteria that was used to establish the water demands and the required fire flows, based on the proposed building uses. The design parameters that apply to this project and used for calculations are identified below in **Table 4-1**.

Table 4-1 - Summary of Water Supply Design Criteria

Design Parameter	Value	Applies
Population Density – Single-family Home	3.4 persons/unit	
Population Density – Semi-detached Home	2.7 persons/unit	
Population Density – Townhome or Terrace Flat	1.8 persons/unit	
Population Density – Bachelor Apartment	1.4 persons/unit	✓
Population Density – Bachelor + Den Apartment	1.4 persons/unit	
Population Density – One Bedroom Apartment	1.4 persons/unit	✓
Population Density – One Bedroom plus Den Apartment	1.4 persons/unit	✓
Population Density – Two Bedroom Apartment	2.1 persons/unit	✓
Population Density – Two Bedroom plus Den Apartment	2.1 persons/unit	
Average Day Demands – Residential	350 L/person/day	✓
Average Day Demands – Commercial / Institutional	28,000 L/gross ha/day	✓
Average Day Demands – Light Industrial / Heavy Industrial	35,000 or 55,000 L/gross ha/day	
Maximum Day Demands – Residential	2.5 x Average Day Demands	✓
Maximum Day Demands – Commercial / Institutional	1.5 x Average Day Demands	✓
Peak Hour Demands – Residential	2.2 x Maximum Day Demands	✓
Peak Hour Demands – Commercial / Institutional	1.8 x Maximum Day Demands	✓
Fire Flow Requirements Calculation	FUS	✓
Depth of Cover Required	2.4m	✓
Maximum Allowable Pressure	551.6 kPa (80 psi)	✓
Minimum Allowable Pressure	275.8 kPa (40 psi)	✓
Minimum Allowable Pressure during fire flow conditions	137.9 kPa (20 psi)	✓

4.5 Estimated Water Demands

The following **Table 4-2** below summarizes the anticipated water demands for the proposed development based on following:

- Tower A having 168 units and estimated population of 264.6 persons.
- Tower B having 223 units and estimated population of 342.3 persons.

Table 4-2 : Water Demand Summary

Water Demand Conditions	Tower A - Water Demands (L/sec)	Tower B - Water Demands (L/sec)	Total Water Demands (L/sec)
Average Day	1.1	1.4	2.5
Max Day	2.7	3.5	6.2
Peak Hour	5.9	7.6	13.6

4.6 Boundary Conditions

Hydraulic Grade Line (HGL) boundary conditions were obtained from the City for design purposes. A copy of the correspondence received from the City is provided in **Appendix E**.

The following hydraulic grade line (HGL) boundary conditions were provided:

- Minimum HGL = 108.3 m
- Maximum HGL = 115.4 m
- Max Day + Fire Flow (133L/sec) = 109.8 m
- Max Day + Fire Flow (183L/sec) = 109.2 m

4.7 Fire Flow Requirements

Water for fire protection will be available utilizing the proposed fire hydrants located along the adjacent roadways: Bond Street, Forest Street, Croydon Avenue, and Richmond Road. The required fire flows for the proposed buildings were calculated based on typical values as established by the Fire Underwriters Survey 1999 (FUS).

The following equation from the Fire Underwriters document “Water Supply for Public Fire Protection”, 1991, was used for calculation of the on-site supply rates required to be supplied by the hydrants:

$$F = 200 * C * \sqrt{A}$$

where:

F	=	Required Fire flow in Litres per minute
C	=	Coefficient related to type of Construction
A	=	Total Floor Area in square metres

The proceeding **Table 4-3** summarizes the parameters used for estimating the Required Fire Flows (RFF) based on the Fire Underwriters Survey (FUS) and the latest City of Ottawa Technical Bulletins. The RFFs were estimated in accordance with ISTB-2018-02, and based on floor areas provided by the architect, which are illustrated in **Appendix H**.

The following summarizes the parameters used for both proposed buildings.

- Type of Construction Non-combustible
- Occupancy Limited combustible
- Sprinkler Protection Fully Supervised Automatic Sprinkler

Table 4-3 - Summary of Design Parameters Used in Calculating Required Fire Flows (RFF) Using FUS

Design Parameter	Value
Coefficient Related to type of Construction C	0.80 (Towers A, Tower B)
Total Floor Area (m ²)	7,175 (Tower A) 9,480 (Tower B)
Fire Flow prior to reduction (L/min)	14,908 (Tower A) 17,136 (Tower B)
Reduction Due to Occupancy Non-combustible (-25%), Limited Combustible (-15%), Combustible (0%), Free Burning (+15%), Rapid Burning (+25%)	-15% (Tower A) -15% (Tower B)
Reduction due to Sprinkler (Max 50%) Sprinkler Conforming to NFPA 13 (-30%), Standard Water Supply (-10%), Fully Supervised Sprinkler (-10%)	-50% (Tower A) -50% (Tower B)
Exposures	+25% (Tower A) +46% (Tower B)

The estimated required fire flows (RFF) based on the FUS methods is: 133 L/sec for Tower A, and 183 L/sec for Tower B.

4.8 Review of Hydrant Spacing

A review of the hydrant spacing was completed to ensure compliance with Ottawa Design Guidelines – Water Distribution, July 2010 (WDG001) and Appendix I of Technical Bulletin ISTB-2018-02. To meet the fire hydrant spacing guidelines of 90m for apartments and high-density areas, an additional fire hydrant is proposed on Bond Street, approximately 25m east of Forest Street. An additional fire hydrant is proposed on Forest Avenue to be within 45m of the fire department connection on each building.

As per Section 3 of Appendix I of Technical Bulletin ISTB-2018-02, all hydrants within 150 metres were reviewed to assess the total possible available flow from these contributing hydrants. For each hydrant the distance to the proposed building was determined to arrive at the contribution of fire flow from each. All hydrants are expected to be of Class AA as per Section 5.1 of Appendix I. For each hydrant the straight-line distance, distance measured along a fire route or roadway, whether its location is accessible, and its contribution to the required fire flow was established. **Figure A-3 in Appendix A** illustrates the hydrant locations in proximity to the site.

Table 4-4 – Required Fire Flows

Building	Required Fire Flow (L/min)	Available Fire flow Based on Hydrant Spacing as per ISTB-2018-02 (L/min)
Tower A	8,000 (or 133 L/sec)	22,800
Tower B	11,000 (or 183 L/sec)	34,200

The total available contribution of flow from hydrants was estimated at ±22,800 L/min and ±34,200 L/min for Towers A and B, whereas the required fire flows (RFF) for each building is only 8,000 L/min and 11,000 L/min. Therefore, the available flows from hydrants exceed each building’s fire flow requirements as identified in Appendix I of Technical Bulletin ISTB-2018-02. Additional information on the available flows from hydrants is provided in **Table B-4**.

5 Sewage Servicing

5.1 Existing Sewage Conditions

The subject property is located within the Pinecrest Collector Sewershed, which then discharges to the West Nepean Collector. From the property sewage is discharged:

- Southerly on Forest Street (±45m of 250mm pipe),
- Easterly on Bond Street (130m of 225mm and 250mm pipe)
- Northerly on Croydon Avenue (±180m of 225mm pipe)
- Easterly on Richmond Road (±625m of 300mm pipe) to Pinecrest Collector
- Northerly on Transitway (±460m of 900mm pipe) to West Nepean Collector

Table 5-1 below summarizes the sewage flow from the existing properties.

Table 5-1 – Summary of Existing Sewage Flows

Sewage Condition	Sanitary Sewage Flow (L/sec)
Average Day Sewage Flow	0.26
Infiltration Flow (at 0.33 L/ha/sec)	0.18
Peak Wet Weather Sewage Flow	0.44

5.2 Proposed Sewage Conditions

It is proposed to provide one single sanitary sewer connection from the subject property to the existing sanitary sewer. Tower A having a connection on Forest Street and Tower B having a connection on Bond St. Each tower will have a separate building lateral which will discharge to a sanitary manhole. The sanitary manhole for Tower A will be installed at the connection from the sanitary lateral and the sanitary sewer on Forest St. The sanitary manhole for Tower B will be installed at the connection from the sanitary lateral and the sanitary sewer on Bond St. The sanitary sewer system was designed based on a population flow with an area-based infiltration allowance. A 250mm diameter sanitary sewer is proposed with a minimum 2% slope, having a capacity of 87.7 L/sec based on Manning’s Equation under full flow conditions. Based on the OBC, the maximum permitted hydraulic load for a 250mm at 2% is 4,500 fixture units. **Table 5-2** below summarizes the design parameters used.

Table 5-2 – Summary of Wastewater Design Criteria / Parameters

Design Parameter	Value	Applies
Population Density – Single-family Home	3.4 persons/unit	
Population Density – Semi-detached Home	2.7 persons/unit	
Population Density – Duplex	2.3 persons/unit	
Population Density – Townhome (row)	2.7 persons/unit	
Population Density – Bachelor Apartment	1.4 persons/unit	✓
Population Density – Bachelor + Den Apartment	1.4 persons/unit	
Population Density – One Bedroom Apartment	1.4 persons/unit	✓
Population Density – One Bedroom plus Den Apartment	1.4 persons/unit	✓
Population Density – Two Bedroom Apartment	2.1 persons/unit	✓
Population Density – Two Bedroom plus Den Apartment	2.1 persons/unit	
Average Daily Residential Sewage Flow	280 L/person/day	
Average Daily Commercial / Institutional Flow	28,000 L/gross ha/day	✓
Average Light / Heavy Industrial Daily Flow	35,000 / 55,000 L/gross ha/day	
Residential Peaking Factor – Harmon Formula (Min = 2.0, Max =4.0, with K=0.8)	$M = 1 + \frac{14}{4 + P^{0.5}} * k$	✓
Commercial Peaking Factor	1.0	✓
Institutional Peaking Factor	1.5	
Industrial Peaking Factor	As per Table 4-B (SDG002)	
Unit of Peak Extraneous Flow (Dry Weather / Wet Weather)	0.05 or 0.28 L/s/gross ha	
Unit of Peak Extraneous Flow (Total I/I)	0.33 L/s/gross ha	✓

The estimated peak sanitary flow rate from the proposed property at 365 Forest Street is **6.76 L/sec** based on City Design Guidelines. Sewage rates below include a total infiltration allowance of 0.18 L/ha/sec based on the total gross site area. Refer to **Appendix C** for detailed calculations.

Sewage Flows within the property were estimated in order to compare with developed conditions. **Table 5-3** below summarizes the approximate sewage flows generated from the existing properties, based on a commercial flow and infiltration allowance.

Table 5-3 – Summary of Anticipated Sewage Rates

Sewage Condition	Sanitary Sewage Flow (L/sec)
Peak Residential / Commercial Flow	6.58
Infiltration Flow	0.18
Peak Design Flow	6.76

A review of the downstream sanitary sewer capacity was completed. The minimum sewer capacity of the last sewer run on Croydon Street (with a slope of 0.36%) has a calculated full flow capacity of 27 L/sec. It is anticipated that the increase in peak sewage flows up to 6.76 L/sec can be accommodated in the downstream sanitary sewer system.

6 Storm Servicing & Stormwater Management

Since the subject properties are located within the Ottawa River East subwatershed, stormwater works are therefore subject to both the Rideau Valley Conservation Authority (RVCA) and City of Ottawa (COO) approval.

In November 2020, after receipt of the comments from RVCA and pre-consultation with the City of Ottawa in 2019, the City of Ottawa Council approved the “Stormwater Management Design Criteria for the Pinecrest Creek/Westboro Area” (herein referred to as the Pinecrest/Westboro Criteria). The subject site falls within the Pinecrest Study Area identified on Figure 1 of the Pinecrest/Westboro Criteria and discharges directly to the Ottawa River. After multiple calls with the City of Ottawa, it was determined that the site would be required to adhere to the quality and quantity control guidelines of the Pinecrest/Westboro Criteria’s. EXP met with the City of Ottawa to confirm runoff from the site discharges to the Ottawa River and the requirements based on the Pinecrest/Westboro Criteria as it relates to the subject development. Email correspondence is provided in **Appendix E**.

6.1 Design Criteria

The proposed stormwater system is designed in conformance with the latest version of the City of Ottawa Design Guidelines (October 2012). Section 5 “Storm and Combined Sewer Design” and Section 8 “Stormwater Management”. A summary of the design criteria that relates to this design report is in the proceeding sections below.

The requirements related to stormwater quantity control were noted in the pre-consultation meeting as follows:

- *Stormwater quantity control criteria – control the quantity to the 5-year pre-development/existing level for all storms up to and including the 100-year storm.*
- *When using the modified rational method to calculate the storage requirements for the site, the underground storage should not be included in the overall available storage. The modified rational method assumes that the restricted flow rate is constant throughout the storm which, in this case, underestimates the storage requirement prior to the 1: 100-year head elevation being reached. Alternately, if you wish to include the underground storage, you may use an assumed average release rate equal to 50% of the peak allowable rate. Otherwise, disregard the underground storage as available storage or provide modeling to support the design.*

The stormwater management criteria identified for Site Plan Approval of sites within Pinecrest Creek Study Area draining to the Ottawa River are provided on Table 1: SWM Design Criteria for the Pinecrest Creek / Westboro Study Area of the Pinecrest/Westboro Criteria as follows:

- *Runoff Volume Reduction – Minimum on-site retention of the 10 mm design storm.*
- *Water Quality – 80% TSS removal, some of which may be achieved by on-site retention of first 10 mm of rainfall.*
- *Water Quantity – As per the City of Ottawa Sewer Design Guideline.*
- *Erosion Control – Not applicable.*

6.2 Runoff Volume Reduction

The reduction of flow from the site following development is provided through retention of the 10 mm design storm as follows:

- Amended topsoil in all landscaped areas.
- Calculation of the 10 mm storm volume based on the site proposed development.

- Capture and retention of the 10 mm storm volume in two cisterns in the underground parking lot to store for use on-site irrigation and maintenance. Location and details of the cistern are provided on the Mechanical Plans in **Appendix H**.

6.3 Water Quality

- An oil grit separator (OGS) structure designed to remove 80% total suspended solids will be in the underground parking lot. Refer to Mechanical Plans in **Appendix H**.
- Runoff from the at grade driveway area will be collected by area drains, conveyed to the mechanical plumbing within the underground parking garage that discharges to the OGS for treatment prior to leaving the site. Details of the Oil Grit Separator are provided in **Appendix H**.

6.4 Minor System Design Criteria

- The storm sewer was sized based on the Rational Method and Manning’s Equation under free flow conditions for the 2-year storm using a 10-minute inlet time.
- Since a detailed site plan was available for the site, including building footprints, calculations of the average runoff coefficients for each drainage area were completed.
- Minimum sewer slopes to be based on minimum velocities for storm sewers of 0.80 m/sec.

6.5 Major System Design Criteria

- The major system has been designed to accommodate on-site detention with sufficient capacity to attenuate the 100-year design storm. On-site storage is calculated based on the 100-year design storm with on-site detention storage provided on the roof and within the underground parking structure (stormwater cistern).
- On site storage is provided and calculated for up to the 100-year design storm. There is no surface ponding proposed on the ground surface.
- Overland flow routes are provided.
- The vertical distance from the spill elevation on the street and the ground elevation at the buildings is at least 15cm.
- The emergency overflow spill elevation is at least 30 cm below the lowest building opening.

Table 6-1 – Spillway Elevations

Building	Spillway Elevation	Lowest building opening Elevation	Lowest Ground Elevation at Building
Tower A (Richmond Road)	74.85	75.60	75.40
Tower B (Bond St./Croydon Ave.)	74.08	74.40	74.40

6.6 Runoff Coefficients

Runoff coefficients used for were based on actual areas taken from CAD. Runoff coefficients for impervious surfaces (roofs, asphalt, and concrete) were taken as 0.90, whereas those for pervious surfaces (grass/landscaping) were taken as 0.20. Average runoff coefficients were calculated for subcatchments (or drainage areas) using the area-weighting routine in PCSWMM. The runoff coefficients for pre-development and post-development catchments are provided in **Appendix D**, with a summary provided in **Table 6-2** below.

Table 6-2 – Summary of Runoff Coefficients

Location	Area (hectares)	Pre-Development Runoff Coefficient, C_{AVG}	Post-Development Runoff Coefficient, C_{AVG}
Entire Site	0.5126	0.75	0.81

6.7 Time of Concentration

A minimum time of concentration of 10-minutes was used for both pre-development and post-development subcatchments.

6.8 Pre-Development Conditions

Under current conditions stormwater runoff from the 0.5126 hectare site is divided into two drainage areas. Stormwater runoff discharges: 1) in a northwestern direction towards Richmond Road / Forest Street and 2) in a southern direction towards Bond Street. **Figure A-1** illustrates these pre-development drainage areas. These drainage areas (or subcatchments) are derived from PCSWMM using the Watershed Delineation Tool.

Table 6-3 – Summary of Pre-Development Flows

Return Period Storm	Peak Flows to Richmond Road / Forest Street Storm Sewers (L/sec)	Peak Flows to Bond Street Storm Sewers (L/sec)	Total Peak Flows (L/sec)
2-year	21.7	60.9	82.6
5-year	29.5	82.6	112.1
100-year	63.1	176.9	240.0

6.9 Allowable Release Rate

Rather than meeting pre-development release rates, the City of Ottawa imposes a more restrictive stormwater release rate as noted in Section 8.3.7.3 of the SDG002. The allowable discharge release rate from the site was established using the peak flows derived based on a 5-year return period storm, a maximum runoff coefficient of 0.50 and a standard time of concentration of 10 minutes.

The allowable release rate of 74.3 L/sec from the proposed site will be based on a 5-year storm event. **Table D-9** provides detailed calculations on the total allowable peak flow, and the distribution to each outfall. In summary, the allowable release rate of 74.3 L/sec is comprised of 19.9 L/sec to Forest Street and 54.4 L/sec to Bond Street.

Table 6-4 – Summary of Allowable Release Rates

Area (onsite)	Area (ha)	Storm = 2 Year Q_{2ALLOW} (L/sec)	Storm = 5 Year Q_{5ALLOW} (L/sec)
Pre-1	0.1375	14.7	19.9
Pre-2	0.3751	40.0	54.4
Totals	0.5126	54.7	74.3

6.10 Proposed Stormwater System

Stormwater runoff from the proposed site will drain from a combination of controlled and uncontrolled areas. As a result of the changes onsite the overall post-development runoff coefficient will change over pre-development conditions. This increase / decrease in runoff is the result of changes due to site development (i.e. additional hard surfaces, roof areas and hard landscaping).

A storm drainage plan is illustrated on **Figure A-2**. A total five (5) subcatchments (or drainage areas) within the development site are shown on this drawing with average runoff coefficients calculated for each drainage area. As the entire site property contains an underground parking structure, the stormwater works shall consist of the following elements:

- The proposed grading for the site will generally meet the existing drainage pattern sloping from the west at Richmond Road and Forest Street southerly/easterly to Bond Street.
- Roof drainage and landscape/hard surfaces to have separate 250mm storm lateral connections to the municipal storm sewer system with the roof drainage being conveyed to Forest Street storm sewer and the remainder of the site being conveyed to Bond Street storm sewer.
- Flow-control roof drains for Towers A & B discharging to internal storm plumbing to stormwater cistern 1, retaining the 10 mm storm volume prior to the excess flows discharging to the municipal sewer on Forest Street. The 10mm storm volume will be retained in the cistern and reused for irrigation of the landscaped areas.
- Landscaped areas will have existing native fill removed 0.3m deep and replaced with 0.3m deep + 10% of pre-mixed amended topsoil to achieve additional infiltration. Amended topsoil will allow rainfall in a minor event to infiltrate and prevent runoff into cistern 2.
- Amended topsoil to be installed as per from the Draft Implementation Guide is provided in Appendix F (Brief summary to follow). Amendment material shall be obtained from a Compost Quality Assurance (CQA) licensed and OMOE/ CCME approved facility and shall comply with the Category "A" compost designation. The amendment material must contain:
 - pH of 6.0 to 8.0
 - 8-15% organic matter by dry- weight (equals 8-15% organic matter Loss-on-ignition test (LOI) per the most current version of ASTM D2974, MOE E3139 or TMECC 05.07A or equivalent.
 - No uncomposted manure or other organic materials, sphagnum peat or organic amendments that contain sphagnum peat (see General Requirement No. 5).

Place imported pre-mixed amended topsoil in 150mm lifts, lightly roll or smooth using machinery bucket and repeat. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading. Amended topsoil should be wetted after application, allowed to settle for a minimum of one (1) week and grades adjusted as required.

- Runoff from surface areas will be collected by area drains, pass through an oil grit separator and discharge to underground storage (2.0 m x 5.0 m x 6.0 m stormwater cistern 2) located in the underground parking structure on P2 that will detain the runoff from the site to meet allowable rates. This in turn will be conveyed by the internal storm plumbing ultimately discharging to the storm lateral outletting from Tower B to STMMH 101 at the allowable rate. Water from hard surfaces passing through the oil grit separator will not be reused for irrigation due to salt dissolved in water being potentially detrimental to plants.
- Remaining drainage areas along frontage of Forest Street and Bond Street to flow uncontrolled overland to the right-of-way.

A summary of the proposed storm and foundation infrastructure is provided in **Table 6-5** below.

Table 6-5 – Summary of Proposed Storm System

Storm Laterals	Rooftops	Foundation Drainage	Catchbasins	Area Drains
Storm Outlet #1 250mm from Underground Parking Garage to existing 300 mm Storm Sewer on Forest Street (STMMH 101).	Tower A & B roofs to drain through storm outlet #1 (STMMH101)		CBE1 CB1 CBE2	AD1 through AD13
Storm Outlet #2 250 mm from Underground Parking Garage to existing 250 mm Storm Sewer on Bond Street (STMMH 100)		Foundation drains to outlet through storm outlet #2 (STMMH 100)	Above CBs and ADs drain to cistern 2 at East side in Parking Garage with controlled flow through outlet #2 to the 300mm existing storm sewer on Bond Street (STMMH 100).	

A summary of the post-development flows is provided in **Table 6-6** below.

Table 6-6 – Summary of Post-Development Flows

Return Period Storm	Peak Flows to Richmond Road / Forest Street Storm Sewers (L/sec)	Peak Flows to Bond Street Storm Sewers (L/sec)	Total Peak Flows (L/sec)	Allowable Peak Flows (L/sec)
2-year	7.6	12.8	20.4	74.3
5-year	15.0	17.3	32.3	
100-year	20.5	36.7	57.2	
Allowable to Forest / Richmond =				19.9
Allowable to Bond =				54.4

To achieve the quantity control requirements and meet the allowable discharge rates as noted in **Section 6.9**, the roof drains on both Towers will require flow-controlled weirs. Based on the roof areas, an estimate of the number of roof drains required was completed. WATTS ACCUTROL weirs were used to determine the total discharge rates from the roof areas based on the number of drains. In addition, the total cumulative prism volumes on the roofs were calculated at a maximum permitted depth of 150mm. Additional information on the estimated 100-year volumes is provided in **Section 6.11**.

It is noted that the post-development flow to Richmond Road/ Forest St (20.5 L/s) is slightly in excess of the pre-development flow to Richmond Road / Forest St (19.9 L/s), however the overall flow from the site following development, **57.2 L/s** is less than the allowable flow of 74.3 L/s with the two systems (from Richmond and Bond St storm sewers) joining immediately downstream at Croydon Ave and Richmond Road intersection. The proposed flow from the development is a 23% reduction of the pre-development flow, which results in a significant reduction in flow to the City sewers.

6.11 Flow Attenuation

Stormwater flow attenuation will be achieved by utilizing roof storage and two stormwater storage cisterns in the underground parking structure. Using the allowable release rates, the Modified Rational Method was used to determine the 2-year, 5-year, and 100-year volumes that will occur for corresponding release rates.

Table D-12, Table D-13 and **Table D-14** provide the storage volumes required on the roof and in the two cisterns in the underground parking structure to attenuate the controlled release rates. **Table D-11** summarizes the combined controlled and uncontrolled flows leaving the subject site. A summary of release rates, storage volume requirements, and provided storage volumes are identified in

Table 6-7 below and calculated in **Appendix D**.

Table 6-7 – Summary of Post-Development Storage

Area No.	Outlet	Release Rate (L/s)			Storage Required (m ³) (MRM)			Storage Provided (m ³)		Control Method
		2-yr	5-yr	100-yr	2-yr	5-yr	100-yr	Roof	Cistern	
Tower A Roof	Richmond / Forest	2.4	5.7	6.3	20.8	22.9	53.3	67.1		Flow Controlled Roof Drains with Weir (Set 3-1/4 open)
Surface - Uncontrolled		2.7	3.7	7.8						None
Tower B Roof		2.5	5.6	6.4	26.8	29.5	67.6	80.7		Flow Controlled Roof Drains with Weir (Set 3-1/4 open)
Surface - Controlled	Bond St	11.4	15.4	33.0	8.3	11.2	39.1		60.0	Pump Rate from Cistern
Surface - Uncontrolled		1.4	1.9	3.7						none
Totals =		20.4	32.3	57.2	55.9	63.6	160.0	147.8	60.0	

For the building roofs flow-controlled drains are necessary. An estimate of the controlled release rate and associated 100-year storage requirements was completed for the flat roof areas. **Table 6-7** provides the estimated 5-year and 100-year storage requirements for the entire site based on the Modified Rational Method. A combined 100-year storage of 160.0 m³ is required based on the allowable discharge rate of 74.3 L/s. The combination of controlled release from the roofs (7 drains on each roof with weir open 3-1/4) and cistern pump along with the uncontrolled flow result in an overall release rate of 57.2 L/s. Roof catchment areas and drains are shown on **Figure A-4** in **Appendix A**. For each tower (A & B). **Table 6-8** below summarizes the estimated water depths on the roof during the 100-year event. Detailed calculations are provided in **Appendix D, Table D-15** and **D-16**.

Table 6-8 – Summary of Ponding Storage Depths on Roof

Storm	Tower A	Tower B
2-year	Not calculated	Not calculated
5-year	94-110	98-109
100-year	127-144	132-144

The roof top terraces on Level 11 of each building will have roof drains uncontrolled to allow for sufficient drainage with no ponding of water. The uncontrolled flow is accounted for as shown in **Appendix D, Table D-15 and D-16**.

Refer to Mechanical Plans in **Appendix H** for cistern details.

6.12 Quality Control Measures

The site is located within the Pinecrest Creek subcatchment. As this area discharges to the Ottawa River the following summarizes the specific additional quality control requirements as per the Pinecrest / Westboro Criteria.

- Runoff Volume Reduction: On-site retention of 10 mm storm.
- Water Quality: 80% TSS removal.

As total suspended solids (TSS) removal efficiency of 80% is required it is proposed to provide an oil grit separator for quality control. Following discussions with the City, only the runoff from the driveway and surrounding pathways require treatment. This area is 0.1124 ha. The Mechanical Design Drawing Details and sizing calculations for the quality control structure are provided in **Appendix H**.

To provide the necessary 10mm of volume reduction, the method outlined on Page 2 of Appendix B of the “SWM Guidelines for Pinecrest Creek/Westboro Area” report by JFSA was used. Approximately **38.9 m³** of the stormwater runoff from the 10 mm storm is required to be retained on site. A summary of the calculations from the methodology are shown below:

$$\begin{aligned} \text{Landscaped Area Runoff Volume} &= 0.085 \text{ ha} * (10\text{mm} - 4.67\text{mm}) * 10 \text{ m}^3/\text{ha} * \text{mm} \\ &= 4.5 \text{ m}^3 \end{aligned}$$

$$\begin{aligned} \text{Hard Surface Runoff Volume} &= 0.1124 \text{ ha} * (10\text{mm} - 1.57\text{mm}) * 10 \text{ m}^3/\text{ha} * \text{mm} \\ &= 9.5 \text{ m}^3 \end{aligned}$$

$$\begin{aligned} \text{Roof Area Runoff Volume} &= 0.2953 \text{ ha} * (10\text{mm} - 1.57\text{mm}) * 10 \text{ m}^3/\text{ha} * \text{mm} \\ &= 24.9 \text{ m}^3 \end{aligned}$$

4.5 m³ is required from the landscaped areas and will be captured and retained by amended topsoil. Runoff will be drained from the rooftop to the cistern located at the west side of Tower B and stored water will be used for irrigation purposes. The required 10 mm storm volume for the two buildings and driveway area is +/- 34.4 m³. This volume of water will be collected from the roofs only, to allow runoff from the driveway area to be treated in the OGS before outletting to the storm sewer on Bond St. This area will not be retained for irrigation due to the dissolved salt in the water being potentially detrimental to plants. The remainder of the site, approximately 199 m², requiring approximately 2 m³ retention of 10 mm storm, is located along the

perimeter of the site adjacent to Forest and Bond Street right of way. This area drains uncontrolled via surface flow to the municipal right of way. As per discussions with the City, the allowance for the uncontrolled flow from these areas is acceptable.

The potential for LID infiltration methods were reviewed but determined impractical due to the required extent of the development and underground parking garage.

7 Erosion & Sediment Control

During all construction activities, erosion and sedimentation shall be controlled by the following techniques:

- Filter cloth shall be installed between the frame and cover of all adjacent catch basins and catch basin manhole structures.
- Heavy duty silt fencing will be used to control runoff around the construction area. Silt fencing locations are identified on the site grading and erosion control plan.
- A mud mat will be installed at the construction entrance to help avoid mud from being transported to offsite roads.
- Visual inspection shall be completed daily on sediment control barriers and any damage repaired immediately. Care will be taken to prevent damage during construction operations.
- In some cases, barriers may be removed temporarily to accommodate the construction operations. The affected barriers will be reinstated at night when construction is completed.
- Sediment control devices will be cleaned of accumulated silt as required. The deposits will be disposed of as per the requirements of the contract.
- During the course of construction, if the engineer believes that additional prevention methods are required to control erosion and sedimentation, the contractor will install additional silt fences or other methods as required to the satisfaction of the engineer.
- Construction and maintenance requirements for erosion and sediment controls are to comply with Ontario Provincial Standard Specification (OPSS) OPSS 805 and City of Ottawa specifications.

8 Conclusions and Recommendations

This Functional Servicing & Stormwater Report outlines the rationale which will be used to service the proposed development. The following summarizes the servicing requirements for the site:

Water

- Two parallel 200mm watermains are proposed to service the residential Towers A and B, as the average day demands exceed 50 m³ per day, which is mandatory as per Section 4.31 of the WDG001.
- Two new hydrants are proposed; one located on Bond Street to meet spacing requirements of 90m for apartments and high-density areas as per WDG001 and the other located on Forest Street within 45m from the proposed fire department connections.
- The Required Fire Flows (RFFs) were estimated at **8,000 L/min** (133 L/sec) for Tower A, and **11,000 L/min** (183 L/sec) for Tower B. The total minimum available flows for firefighting purposes, based on the contribution from hydrants, was estimated at **22,800 L/min**.
- Based on hydraulic boundary conditions (HGL) provided by the City of Ottawa, a system pressure of **±52.2 psi** under peak hourly demands is anticipated at the proposed building. This exceeds the City's guideline of 20 psi.
- Domestic water booster and fire pump will be provided in the mechanical room at P1 parking level.

Sewage

- Estimated peak sewage flows of **6.76 L/sec** are anticipated. This exceeds the estimated current sewage flows of **0.44 L/sec** under existing conditions. An initial review of the downstream sanitary sewer system from the site and the Pinecrest Collector indicates minimum pipe capacity of 27 L/sec for a sewer run on Croydon Ave.

Stormwater

- For the stormwater system, the allowable capture rate from the entire site was calculated based on a runoff coefficient of 0.50, time of concentration of 10 minutes for a 5-year storm event. The allowable release rate for the entire site was calculated to be **74.3 L/sec**. Runoff in excess of this will be detained onsite for up to the 100-year storm.
- Two minor surface drainage areas will flow uncontrolled to the right-of-way. The 100-year peak flows from these two areas were accounted for (ie. subtracted) from the total runoff rate to establish the allowable rate.
- In order to meet the allowable release rate, a total retention volume of **±160.0 m³** is required.
- Runoff on the building roofs will be controlled using flow-controlled roof drains. For each roof-drain is equipped with WATTS ACCUTROL weirs and set at the ¼ OPEN position are proposed. Each drain having maximum discharge rate of 30 gpm at 150mm depth. A maximum release rate of **6.3 L/sec from Tower A** and **6.4 L/sec from Tower B** was established for the 100-year event.
- A total 100-year storage volume requirements on the roofs of Tower A and Tower B was estimated as **120.9 m³** (53.3 m³ and 67.6 m³ respectively), based on the above release rates, using the Modified Rational Method. The volumes available on the roofs are **147.8 m³** (67.1 m³ and 80.7 m³ respectively), therefore exceeding the required volumes.
- Runoff from the surface areas above the parking structure will be collected and detained in an underground stormwater chamber (cistern) located in the parking structure. The allowable discharge rate of **16.5 L/sec** (50% of 33 L/s) from cistern 2 will be met using an equal pump rate. The volume necessary to detain the 100-year event, is **59.0 m³**, based on using 50% of the allowable release rate as required by the City of Ottawa. The stormwater tank (cistern 2) will be sized to hold a minimum volume of approximately **60.0 m³**.
- Retention of the 10 mm storm is captured within the site through amended topsoil in the landscaped areas and **29.5 m³** in cistern 1 (from the rooftops) located in the parking garage.
- Quality control is provided via an oil grit separator within the underground parking garage collecting runoff from the driveway area and conveyed to cistern 2 prior to discharge to the municipal sewer. It is designed to remove 80% TSS from stormwater runoff from the driveway and surrounding area. The 10mm storm from the hard surfaces will not be retained due to dissolved salts in the water being potentially detrimental to plants.

Erosion & Sediment Control

- Erosion and sediment control methods will be used during construction to limit erosion potential.

9 Legal Notification

This report was prepared by EXP Services Inc. for the account of 11061917 Canada Inc.

Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. EXP Services Inc. accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this project.

Appendix A - Figures

Figure A-1 - Pre-Development Drainage Areas

Figure A-2 - Post-Development Drainage Areas

Figure A-3 – Hydrant Location Plan

Figure A-4 – Roof Catchments


Figure A-5 – Fire Flow Distance Plan



FIGURE A-1 - PRE-DEVELOPMENT DRAINAGE AREA



FIGURE A-2 POST DEVELOPMENT DRAINAGE AREAS

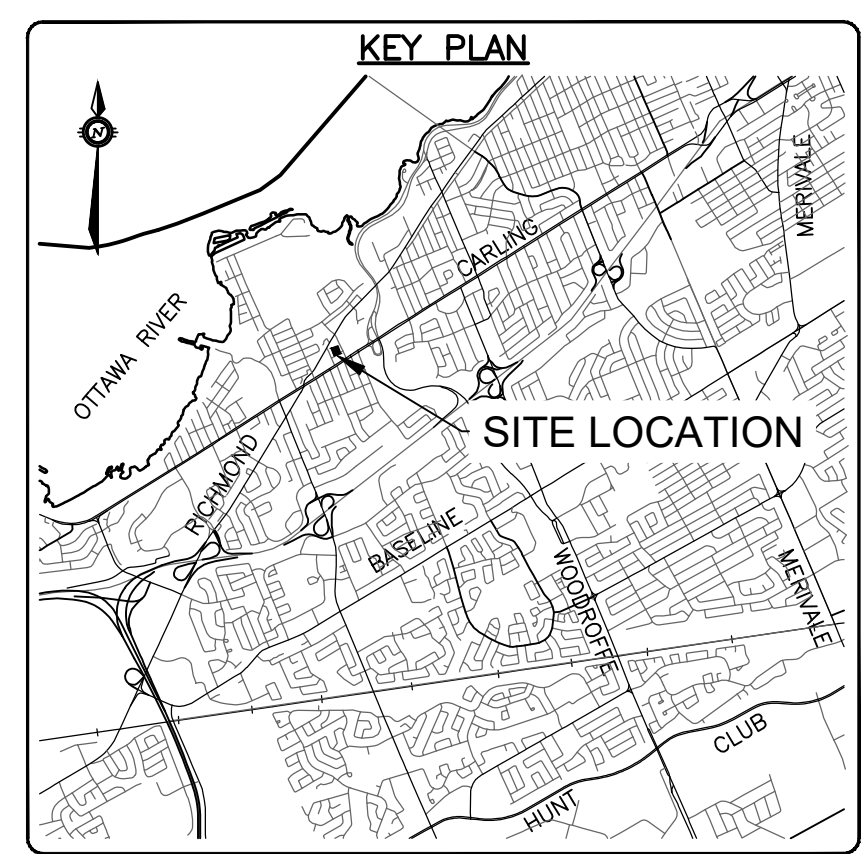

LEGEND

- SITE BOUNDARIES
- 0m OFFSET FROM BUILDING
- 75m OFFSET FROM BUILDING
- 150m OFFSET FROM BUILDING
- JUNCTIONS

CAUTION
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

REV	REVISION DESCRIPTION	DATE	BY	APPD
5	4TH CITY SUBMISSION	15/07/22	AC	BMT
4	REVISED PER CITY COMMENTS	10/12/21	AC	JD
3	REVISED PER CITY COMMENTS	27/05/21	AC	BMT
2	ISSUED FOR REZONING APPLICATION	27/01/20	MZG	BMT
1	ISSUED FOR REVIEW	12/09/19	SAB	BMT

SCALE
 0 10m 20m 40m
 HORIZONTAL 1:1000
 NORTH

DESIGNED BY
 REVIEWED BY
 CLIENT



11061917 CANADA INCORPORATED
 100-768 ST. JOSEPH BOULEVARD
 GATINEAU, QC. J8Y 4B8

exp.
 exp Services Inc.
 2000 Deschênes Drive, Unit 100
 Ottawa, ON K2B 9R6
 www.exp.ca
 • BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
 • INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

DESIGN	SAB	PROJECT	11061917 CANADA INC RESIDENTIAL DEVELOPMENT 365 FOREST STREET OTTAWA, ONTARIO.
CHECKED	BMT	TITLE	HYDRANT LOCATION PLAN
CAD	SAB	PROJECT MANAGER	BMT
APPROVED	BMT		

PROJECT No. OTT-252570-A0
 SURVEY ADV
 DATE JAN 2020
 DRAWING No. FIG A-3

File: \\exp\projects\11061917\11061917_001\11061917_001.dwg
 User: jsmith
 Date: 2022-01-10 10:00:00
 Plot: 11061917_001.dwg
 Plot Date: 2022-01-10 10:00:00
 Plot Scale: 1:1000
 Plot Size: 300x300
 Plot Orientation: Landscape
 Plot Color: Black
 Plot Lineweight: 0.5
 Plot Font: Arial, 10
 Plot Title: 11061917_001.dwg
 Plot Sheet: 1 of 1
 Plot Status: OK
 Plot Message:

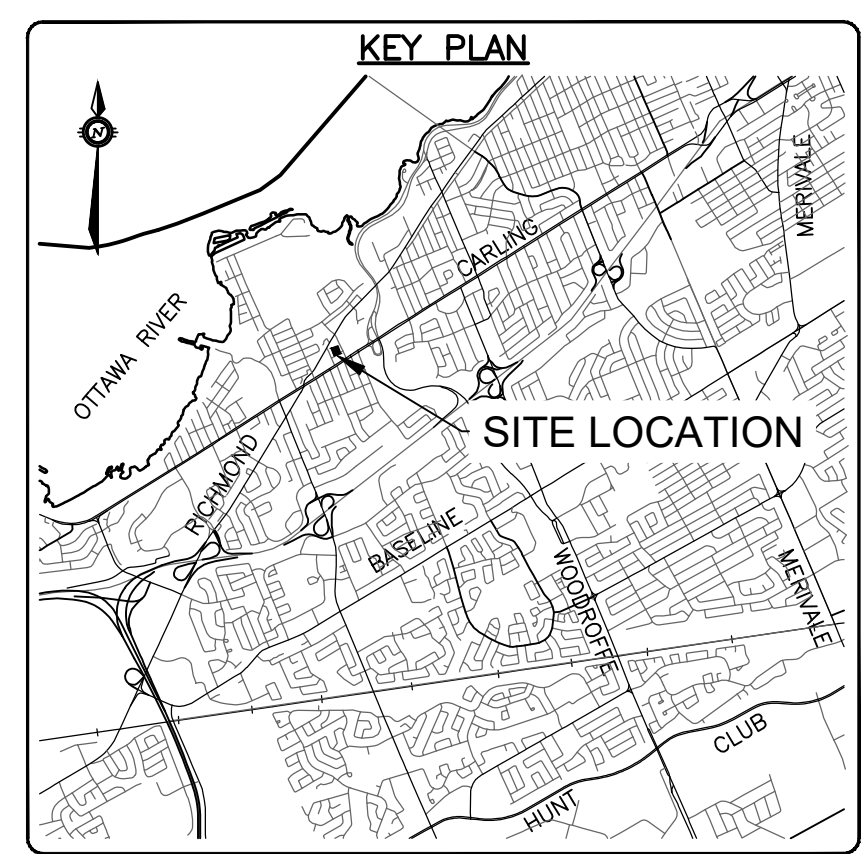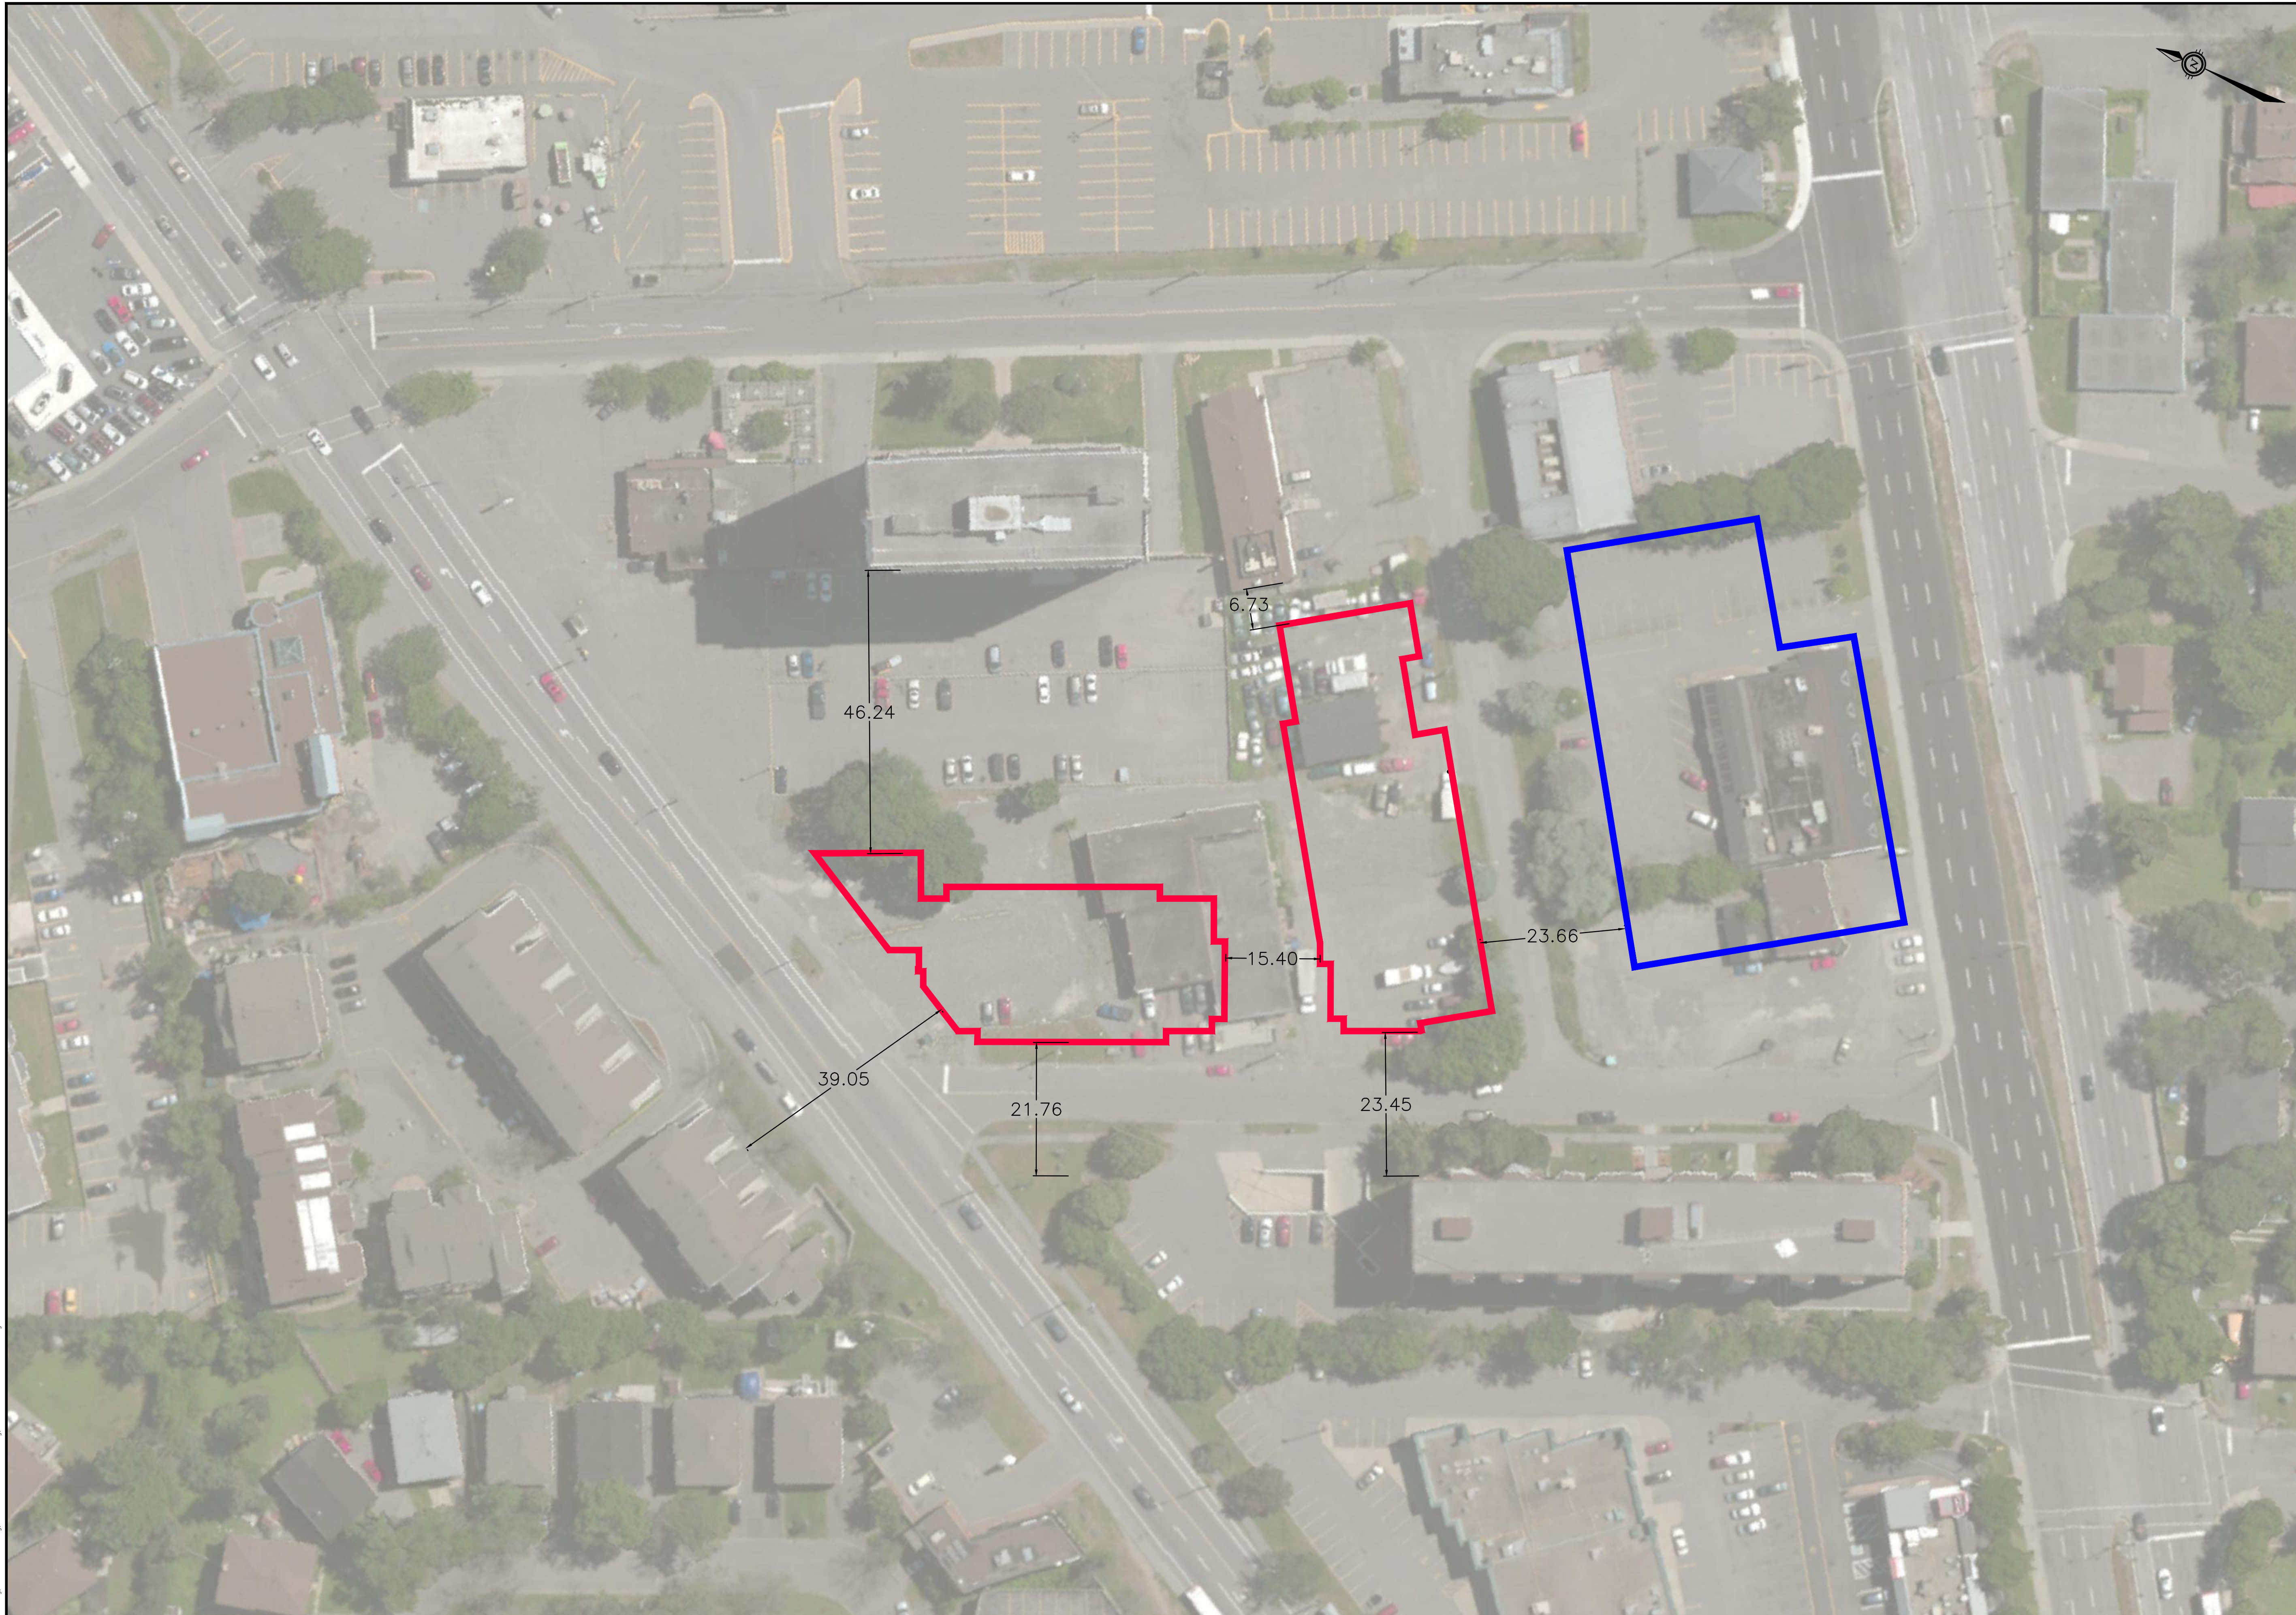

LEGEND

- BUILDING FOOTPRINT
- OFF-SITE NEW BUILDING
- $\leftarrow 20.00 \rightarrow$ DISTANCE BETWEEN PROPOSED TOWERS AND EXISTING SURROUNDING BUILDINGS

File: \\exp\services\11061917\11061917-000000.dwg - 365 - 11061917 - outside - inc\00-execution\04-dwg\11061917-000000.dwg
 User: Smeets\j.smeets
 Date: 2023/01/12 10:21:03 AM
 Plot: 11061917-000000.dwg - 365 - 11061917 - outside - inc\00-execution\04-dwg\11061917-000000.dwg
 Reference: \\exp\services\11061917\11061917-000000.dwg - 365 - 11061917 - outside - inc\00-execution\04-dwg\11061917-000000.dwg

CAUTION
 THE POSITION OF ALL POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND OVERGROUND UTILITIES AND STRUCTURES IS NOT NECESSARILY SHOWN ON THE CONTRACT DRAWINGS, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. BEFORE STARTING WORK, DETERMINE THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES AND ASSUME ALL LIABILITY FOR DAMAGE TO THEM.

REV	REVISION DESCRIPTION	DATE	BY	APPD
5	4TH CITY SUBMISSION	15/07/22	AC	BMT
4	REVISED PER CITY COMMENTS	10/12/21	AC	JD
3	REVISED PER CITY COMMENTS	27/05/21	AC	BMT
2	ISSUED FOR REZONING APPLICATION	27/01/20	MZG	BMT
1	ISSUED FOR REVIEW	12/09/19	SAB	BMT

REV	REVISION DESCRIPTION	DATE	BY	APPD

SCALE
 0 5m 10m 20m
 HORIZONTAL 1:500
 NORTH

DESIGNED BY
 REVIEWED BY
 CLIENT

11061917 CANADA INCORPORATED
 100-768 ST. JOSEPH BOULEVARD
 GATINEAU, QC. J8Y 4B8

exp.
 exp Services Inc.
 2111 DUNDAS STREET W. #1113 2ND FLOOR
 2000 Deseronto Drive, Unit 100
 Ottawa, ON K2C 6R6
 Canada
 www.exp.ca
 416-232-1111
 • BUILDINGS • EARTH & ENVIRONMENT • ENERGY •
 • INDUSTRIAL • INFRASTRUCTURE • SUSTAINABILITY •

BASE PLAN: SAB
 DESIGN: BMT
 CHECKED: BMT
 CAD: SAB
 PROJECT MANAGER: BMT
 APPROVED: BMT

PROJECT: **11061917 CANADA INC**
RESIDENTIAL DEVELOPMENT
 365 FOREST STREET
 OTTAWA, ONTARIO.

TITLE: **FIRE FLOW DISTANCE PLAN**

PROJECT No. OTT-252570-A0
 SURVEY: ADV
 DATE: JAN 2020
 DRAWING No. **FIG A-5**

Appendix B – Water Servicing Tables

Table B-1 – Water Demand Chart

Table B-2 – Fire Flow Requirements Based on Fire Underwriters Survey (FUS) – Tower A

Table B-3 – Fire Flow Requirements Based on Fire Underwriters Survey (FUS) – Tower B

Table B-4 – Available Fire Flows Based on Hydrant Spacing

Table B-5 – Estimated Water Pressure at Proposed Building



**Table B-1
Water Demand Chart**

Building	No. of Units										Total Pop	Residential Demands					Commercial				Total Demands in (L/sec)				
	Singles/Semis/Towns					Apartments						Avg Day Demand (L/day)	Max Day Peaking Factor	Max Hour Peaking Factor	Max Day Demand (L/day)	Peak Hourly Demand (L/day)	Area (ha)	Avg Demand (L/day)	Peaking Factors (x Avg Day)		Max Day Demand (L/day)	Peak Hour Demand (L/day)	Avg Day (L/s)	Max Day (L/s)	Peak Hour (L/s)
	Single Family	Semi	Duplex	Townhome	Bachelor	1-Bed Apt	1-Bed +Den Apt	2 Bed Apt	2-Bed +Den Apt	3 Bed Apt									Max Day	Peak Hour					
Tower A					11	13	102	42			264.6	92,610	2.5	2.2	231,525	509,355	0.0338	946	1.5	1.8	1419.6	2555.3	1.08	2.70	5.92
Tower B					23	12	145	43			342.3	119,805	2.5	2.2	299,513	658,928	0.0092	257.6	1.5	1.8	386.4	463.7	1.39	3.47	7.63
Totals =					34	25	247	85			606.9	212,415			531,038	1,168,283	0.0430	1,204			1,806.0	3,019.0	2.47	6.17	13.56
Unit Densities												Project:													
Persons/Unit												365 Forest Street													
Residential												Designed: J Diaz, P.Eng. Location: Ottawa, Ontario													
Singles 3.4 Residential Consumption (L/pers/day) = 350												Checked: B. Thomas, P.Eng.													
Semi-Detached 2.7 Max Day Peaking Factor (* avg day) = 2.5												File Reference: 252570 Water - Demand Chart, Sept 1, 2022.xlsx													
Duplex 2.3 Peak Hour Factor (* max day) = 2.2												Page No: 1 of 1													
Townhome 2.7																									
Bachelor Apt Unit 1.4																									
1-Bed Apt Unit 1.4																									
1-Bed + Den Apt Unit 1.4																									
2-Bed Apt Unit 2.1																									
2-Bed + Den Apt Unit 2.1																									
3-Bed Apt Unit 3.1																									
Industrial/Commercial/Institutional Water Consumption																									
Light Industrial (L/gross ha/day) = 35,000																									
Heavy Industrial (L/gross ha/day) = 55,000																									
Commer/Instit (L/gross ha/day) = 28,000																									
Max Day Peaking Factor (* avg day) = 1.5																									
Peak Hour Factor (* max day) = 1.8																									

TABLE B-2
FIRE FLOW REQUIREMENTS BASED ON FIRE UNDERWRITERS SURVEY(FUS) 1999 FOR TOWER A



An estimate of the Fire Flow required for a given fire area may be estimated by:

$$F = 220 * C * \text{SQRT}(A)$$

where: F = required fire flow in litres per minute
 A = total floor area in m² (including all storeys, but excluding basements at least 50% below grade)
 C = coefficient related to the type of construction

Task	Options	Multiplier	Input			Value Used	Fire Flow Total (L/min)
Choose Building Frame (C)	Wood Frame	1.5	Non-combustible Construction			0.8	
	Ordinary Construction	1					
	Non-combustible Construction	0.8					
	Fire Resistive Construction	0.6					
Input Building Floor Areas (A)			Area	% Used	Area Used	2 largest adjoining floors+ 50% of floors above (up to eight)	
	Floor 12		1,186	0%	0		
	Floor 11		1,193	0%	0		
	Floor 10		1,193	50%	597		
	Floor 9		1,193	50%	597		
	Floor 8		1,193	50%	597		
	Floor 7		1,158	50%	579		
	Floor 6		1,210	50%	605		
	Floor 5		1,210	50%	605		
	Floor 4		1,210	50%	605		
	Floor 3		1,210	50%	605		
	Floor 2		1,193	100%	1,193		
	Floor 1 (Ground)		1,193	100%	1,193		
	Basement (At least 50% below grade, not included)		0				
Fire Flow (F)	F = 220 * C * SQRT(A)						14,908
Fire Flow (F)	Rounded to nearest 1,000						15,000

Reductions/Increases Due to Factors Effecting Burning

Task	Options	Multiplier	Input			Value Used	Fire Flow Change (L/min)	Fire Flow Total (L/min)									
Choose Combustibility of Building Contents	Non-combustible	-25%	Limited Combustible			-15%	-2,250	12,750									
	Limited Combustible	-15%															
	Combustible	0%															
	Free Burning	15%															
	Rapid Burning	25%															
Choose Reduction Due to Sprinkler System	Adequate Sprinkler Conforms to NFPA13	-30%	Adequate Sprinkler Conforms to NFPA13			-30%	-3,825	8,925									
	No Sprinkler	0%															
	Standard Water Supply for Fire Department Hose Line and for Sprinkler System	-10%	Standard Water Supply for Fire Department Hose Line and for Sprinkler System			-10%	-1,275	7,650									
	Not Standard Water Supply or Unavailable	0%															
	Fully Supervised Sprinkler System	-10%	Fully Supervised Sprinkler System			-10%	-1,275	6,375									
Choose Structure Exposure Distance	Exposures	Separation Dist (m)	Cond	Separation Condition	Exposed Wall type	Exposed Wall Length				Total Charge (%)	Total Exposure Charge (L/min)						
						Length (m)	No of Storeys	Lenth-height Factor	Sub-Condition								
						Side 1 (west)	22	4	20.1 to 30			Type B	43	9	387	4E	10%
						Side 2 (east)	46	6	> 45.1			Type B	46	19	874	6	0%
						Front (north)	39	5	30.1 to 45			Type B	62	2	124	5E	5%
Back (south)	15	3	10.1 to 20	Type B	15	12	30	3A	10%								
Obtain Required Fire Flow	Total Required Fire Flow, Rounded to the Nearest 1,000 L/min =										8,000						
	Total Required Fire Flow, L/s =										133						

Exposure Charges for Exposing Walls of Wood Frame Construction (from Table G5)

- Type A Wood-Frame or non-combustible
- Type B Ordinary or fire-resistive with unprotected openings
- Type C Ordinary or fire-resistive with semi-protected openings
- Type D Ordinary or fire-resistive with blank wall

Conditons for Separation

Separation Dist	Condition
0m to 3m	1
3.1m to 10m	2
10.1m to 20m	3
20.1m to 30m	4
30.1m to 45m	5
> 45.1m	6

**TABLE B-3
FIRE FLOW REQUIREMENTS BASED ON FIRE UNDERWRITERS SURVEY(FUS) 1999 FOR**

TOWER B



An estimate of the Fire Flow required for a given fire area may be estimated by:

$$F = 220 * C * \text{SQRT}(A)$$

where:

- F = required fire flow in litres per minute
- A = total floor area in m² (including all storeys, but excluding basements at least 50% below grade)
- C = coefficient related to the type of construction

Task	Options	Multiplier	Input			Value Used	Fire Flow Total (L/min)
Choose Building Frame (C)	Wood Frame	1.5	Non-combustible Construction			0.8	
	Ordinary Construction	1					
	Non-combustible Construction	0.8					
	Fire Resistive Construction	0.6					
Input Building Floor Areas (A)			Area	% Used	Area Used	2 largest adjoining floors+ 50% of floors above (up to eight)	
	Floor 12		1,507	50%	754		
	Floor 11		1,518	50%	759		
	Floor 10		1,518	50%	759		
	Floor 9		1,518	50%	759		
	Floor 8		1,518	50%	759		
	Floor 7		1,468	50%	734		
	Floor 6		1,652	50%	826		
	Floor 5		1,652	50%	826		
	Floor 4		1,652	100%	1,652		
	Floor 3		1,652	100%	1,652		
	Floor 2		1,500	0%	0		
	Floor 1 (Ground)		1,470	0%	0		
	Basement (At least 50% below grade, not included)		0				
Fire Flow (F)	F = 220 * C * SQRT(A)						17,136
Fire Flow (F)	Rounded to nearest 1,000						17,000

Reductions/Increases Due to Factors Effecting Burning

Task	Options	Multiplier	Input					Value Used	Fire Flow Change (L/min)	Fire Flow Total (L/min)			
Choose Combustibility of Building Contents	Non-combustible	-25%	Limited Combustible					-15%	-2,550	14,450			
	Limited Combustible	-15%											
	Combustible	0%											
	Free Burning	15%											
	Rapid Burning	25%											
Choose Reduction Due to Sprinkler System	Adequate Sprinkler Conforms to NFPA13	-30%	Standard Water Supply for Fire Department Hose Line and for Sprinkler System					-30%	-4,335	10,115			
	No Sprinkler	0%											
	Standard Water Supply for Fire Department Hose Line and for Sprinkler System	-10%											
	Not Standard Water Supply or Unavailable	0%											
	Fully Supervised Sprinkler System	-10%											
Not Fully Supervised or N/A	0%												
Choose Structure Exposure Distance	Exposures	Separation Dist (m)	Cond	Separation Condition	Exposed Wall type	Exposed Wall Length				Total Charge (%)	Total Exposure Charge (L/min)		
	Side 1 (west)	23	4	20.1 to 30	Type B	Length (m)	No of Storeys	Lenth-height Factor	Sub-Condition				Charge (%)
	Side 2 (east)	7	2	3.1 to 10	Type B	11	1	11	2A				15%
	Front (north)	15	3	10.1 to 20	Type B	22	12	264	3E				15%
	Back (south)	24	4	20.1 to 30	Type B	69	5	30	4A				6%
Obtain Required Fire Flow	Total Required Fire Flow, Rounded to the Nearest 1,000 L/min =										11,000	Total Required Fire Flow, L/s =	183

Exposure Charges for Exposing Walls of Wood Frame Constructon (from Table G5)

- Type A Wood-Frame or non-combustible
- Type B Ordinary or fire-resistive with unprotected openings
- Type C Ordinary or fire-resistive with semi-protected openings
- Type D Ordinary or fire-resistive with blank wall

Conditions for Separation

Separation Dist	Condition
0m to 3m	1
3.1m to 10m	2
10.1m to 20m	3
20.1m to 30m	4
30.1m to 45m	5
> 45.1m	6

TABLE B-4**AVAILABLE FIRE FLOWS BASED ON HYDRANT SPACING**

Hydrant #	Location	Tower A		Tower B	
		¹ Distance (m)	² Fire Flow Contribution (L/min)	Distance (m)	Fire Flow Contribution (L/min)
New FH-1	Forest Street	8	5,700	32	5,700
New FH-2	Bond Street	82	3,800	56	5,700
360024H013	Forest Steet at Richmond Rd	37	5,700	62	5,700
360024H038	Forest Steet at Carling Ave	116	3,800	98	3,800
360024H039	Forest Steet at Carling Ave	161	0	144	3,800
360024HP120	Forest Steet near Bond St	76	3,800	52	5,700
360024H041	Bond Street at Croydon Ave	170	0	145	3,800
Total (L/min)			22,800		34,200
FUS RFF in L/min or (L/sec)			8,000 (133)	11,000 (183)	
Meets Requirement (Yes/No)			Yes	Yes	
Notes:					
¹ Distance is measured along a road or fire route.					
² Fire Flow Contribution for Class AA Hydrant from Table 1 of Appendix I, ISTB-2018-02					

TABLE B-5

ESTIMATED WATER PRESSURE AT PROPOSED BUILDING

Description	From	To	Demand (L/sec)	Pipe Length (m)	Pipe Dia (mm)	Dia (m)	Q (m3/sec)	Area (m2)	C	Vel (m/s)	Slope of HGL (m/m)	Head Loss (m)	Elev From (m)	Elev To (m)	*Elev Diff (m)	Pressure From kPa (psi)	Pressure To kPa (psi)	Pressure Drop (psi)
Avg Day Conditions																		
Single 200mm watermain	Main	Building	2.5	11 m	204	0.204	0.0025	0.032685	110	0.0756	6E-05	0.0007	74.85	71.80	3.1	328.1 (47.6)	358.1 (51.9)	-4.3
Double 200mm watermain	Main	Building	1.2	11 m	204	0.204	0.0012	0.032685	110	0.0378	1.7E-05	0.0002	74.85	71.80	3.1	328.1 (47.6)	358.1 (51.9)	-4.3
Max Day Conditions																		
Single 200mm watermain	Main	Building	6.2	11 m	204	0.204	0.0062	0.032685	110	0.1885	0.00033	0.0036	74.85	71.80	3.1	397.8 (57.7)	427.7 (62.0)	-4.3
Double 200mm watermain	Main	Building	3.1	11 m	204	0.204	0.0031	0.032685	110	0.0942	9.1E-05	0.001	74.85	71.80	3.1	397.8 (57.7)	427.7 (62.0)	-4.3
Peak Hour Conditions																		
Single 200mm watermain	Main	Building	13.6	11 m	204	0.204	0.0136	0.032685	110	0.4146	0.00141	0.0155	74.85	71.80	3.1	330.1 (47.9)	359.9 (52.2)	-4.3
Double 200mm watermain	Main	Building	6.8	11 m	204	0.204	0.0068	0.032685	110	0.2073	0.00039	0.0043	74.85	71.80	3.1	330.1 (47.9)	360.0 (52.2)	-4.3
Max Day Plus Fireflow Conditions																		
Single 200mm watermain	Main	Building	189.2	11 m	204	0.204	0.1892	0.032685	110	5.7873	0.18628	2.0491	74.85	71.80	3.1	337.0 (48.9)	346.8 (50.3)	-1.4
Double 200mm watermain	Main	Building	94.6	11 m	204	0.204	0.0946	0.032685	110	2.8937	0.0516	0.5676	74.85	71.80	3.1	337.0 (48.9)	361.3 (52.4)	-3.5
Peak Hour Conditions (Review of 150mm)																		
Single 150mm watermain	Main	Building	13.6	11 m	155	0.155	0.0136	0.018869	110	0.7181	0.00538	0.0592	74.85	71.80	3.1	330.1 (47.9)	359.4 (52.1)	-4.3
Double 150mm watermain	Main	Building	6.8	11 m	155	0.155	0.0068	0.018869	110	0.3591	0.00149	0.0164	74.85	71.80	3.1	330.1 (47.9)	359.9 (52.2)	-4.3
Max Day Plus Fireflow (Review of 150mm)																		
Single 150mm watermain	Main	Building	189.2	11 m	155	0.155	0.1892	0.018869	110	10.025	0.70982	7.808	74.85	71.80	3.1	337.0 (48.9)	290.3 (42.1)	6.8
Double 150mm watermain	Main	Building	94.6	11 m	155	0.155	0.0946	0.018869	110	5.0124	0.19663	2.1629	74.85	71.80	3.1	337.0 (48.9)	345.7 (50.1)	-1.3
Water Demand Info																		
Average Demand =	2.47	L/sec														11 m		
Max Day Demand =	6.16	L/sec														110		
Peak Hr Demand =	13.55	L/sec																
Fireflow Requirement =	183	L/sec																
Max Day Plus FF Demand =	189.2	L/sec																
Boundary Condition																		
HGL (m)	<u>Min HGL</u>	<u>Max HGL</u>	<u>Peak Hr</u>	<u>Max Day + Fireflow</u>														
	108.3	115.4	108.5	109.2	(From City of Ottawa)													
Approx Ground Elev (m) =	74.85	74.85	74.85	74.85														
Approx Mech Room FF Elev (m) =	71.80	71.80	71.80	71.80														
Pressure (m) =	33.45	40.55	33.65	34.35														
Pressure (Pa) =	328,145	397,796	330,107	336,974														
Pressure (psi) =	47.6	57.7	47.9	48.9														

Appendix C – Sanitary Servicing Tables

Table C-6 – Sanitary Sewer Design Sheet



**Table C-6
SANITARY SEWER CALCULATION SHEET**

LOCATION			RESIDENTIAL AREAS AND POPULAITONS											COMMERCIAL				INFILTRATION			SEWER DATA																						
Street	U/S MH	D/S MH	Area (ha)	NUMBER OF UNITS						POPULATION		Peak Factor	Peak Flow (L/sec)	AREA (ha)		Peak Factor	Peak Flow (L/sec)	AREA (ha)		INFILT FLOW (L/s)	TOTAL FLOW (L/s)	Nom Dia (mm)	Actual Dia (mm)	Slope (%)	Length (m)	Capacity (L/sec)	Q/Q _{CAP} (%)	Full Velocity (m/s)															
				Single	Semi	1-Bed Apt.	1-Bed + Den Apt.	2-Bed Apt.	2-Bed + Den Apt.	3-Bed Apt.	INDIV			ACCU	INDIV			ACCU	INDIV										ACCU														
Forest	Tower A	MH 200	0.2717			24	102	42			264.6	264.6	4.00	3.43	0.0256	0.0256	1.0	0.008	0.2717	0.2717	0.09	3.53	250	251.46	2.0	6.1	85.4	4%	1.72														
	Tower B	MH 200	0.2717			35	145	43			342.3	342.3	4.00	4.44	0.0092	0.0092	1.0	0.003	0.2717	0.2717	0.09	4.53	250	251.46	2.0	1.0	85.4	5%	1.72														
		MH 200	MH 201								606.9	606.9	3.34	6.57		0.0348	1.0	0.011		0.5434	0.18	6.76	250	251.46	2.0	9.7	85.4	8%	1.72														
			0.543			59	247	85			607																																
Residential Avg. Daily Flow, q (L/p/day) = 280 Commercial Avg. Daily Flow (L/gross ha/day) = 28,000 or L/gross ha/sec = 0.324 Institutional Avg. Daily Flow (L/s/ha) = 28,000 or L/gross ha/sec = 0.324 Light Industrial Flow (L/gross ha/day) = 35,000 or L/gross ha/sec = 0.4051 Light Industrial Flow (L/gross ha/day) = 55,000 or L/gross ha/sec = 0.637																		Commercial Peak Factor = 1.5 (when area >20%) = 1.0 (when area <20%) Institutional Peak Factor = 1.5 (when area >20%) = 1.0 (when area <20%) Residential Correction Factor, K = 0.80 Manning N = 0.013 Peak extraneous flow, I (L/s/ha) : 0.33 (Total I/I)						Peak Population Flow, (L/sec) = P*q*M/86.4 Peak Extraneous Flow, (L/sec) = I*Ac Residential Peaking Factor, M = 1 + (14/(4+P^0.5)) * K Sewer Capacity, Qcap (L/sec) = 1/N S ^{1/2} R ^{2/3} A _c				Unit Type Ppu Singles = 3.4 Semi-Detached = 2.7 1-bed Apt = 1.4 1-bed + Den Apt = 1.4 2-bed Apt. Unit = 2.1 2-bed + Den Apt = 2.1 3-bed Apt. Unit = 3.1				Designed: J. Diaz, P.Eng.		Project: 365 Forest Street		Checked: B. Thomas, P.Eng.		Location: Ottawa, Ontario		File Reference: 252570 Sanitary - Sewer Design Sheet, Sept 1, 2022.xlsx		Page No: 1 of 1	

Appendix D – Stormwater Servicing Tables

Table D-7 – Average Runoff Coefficients for Pre-Development

Table D-8 – Estimation of Pre-Development Peak Flows

Table D-9 – Estimation of Allowable Peak Flows (Based on Max C=0.50 with Tc=10mins)

Table D-10 – Average Runoff Coefficients for Post-Development

Table D-11 – Summary of Post-Development Peak Flows (Uncontrolled and Controlled)

Table D-12 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-1)

Table D-13 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-3)

Table D-14 – Storage Volumes for 2-year, 5-year and 100-Year Storms (Area PST-4)

Table D-15 –Roof Design Sheet - Tower A

Table D-16 – Roof Design Sheet - Tower B

Table D-7 AVERAGE RUNOFF COEFFICIENTS FOR PRE-DEVELOPMENT

Runoff Coefficients									
		$C_{GRAVEL} =$	<u>0.73</u>	$C_{ROOF} =$	<u>0.90</u>	$C_{GRASS} =$	<u>0.20</u>	$C_{Asphalt} =$	<u>0.90</u>
Area No.	Gravel Areas (m ²)	A * C _{ASPH}	Roof Areas (m ²)	A * C _{ROOF}	Grassed Areas (m ²)	A * C _{GRASS}	Sum AC	Total Area (m ²)	C _{AVG} (see note)
PRE-1								1375.0	0.74
PRE-2								3751.0	0.76
Notes									
1) Cavg derived with area-weighting command in PCSWMM									

Table D-8 ESTIMATION OF PRE-DEVELOPMENT PEAK FLOWS

Catchment No.	Area (ha)	Outlet Location	Time of Conc, Tc (min)	Storm = 2 yr			Storm = 5 yr			Storm = 100 yr		
				I ₂ (mm/hr)	Cavg	Q _{2PRE} (L/sec)	I ₅ (mm/hr)	Cavg	Q _{5PRE} (L/sec)	I ₁₀₀ (mm/hr)	Cavg	Q _{100PRE} (L/sec)
PRE-1	0.1375	To Richmond / Forest	10.0	76.81	0.74	21.7	104.29	0.74	29.5	178.56	0.93	63.1
PRE-2	0.3751	To Bond St	10.0	76.81	0.76	60.9	104.29	0.76	82.6	178.56	0.95	176.9
Totals		0.5126				82.6			112.1			240.0
Notes												
1) Intensity, I = 732.951/(Tc+6.199) ^{0.810} (2-year, City of Ottawa)												
2) Intensity, I = 998.071/(Tc+6.035) ^{0.814} (5-year, City of Ottawa)												
3) Intensity, I = 1735.688/(Tc+6.014) ^{0.820} (100-year, City of Ottawa)												
4) Cavg for 100-year is increased by 25% to a maximum of 1.0												

Table D-9 ESTIMATION OF ALLOWABLE PEAK FLOWS (Based on Max C=0.50 with Tc=10mins)

Area (onsite)	Area (ha)	Time of Conc, Tc (min)	Storm = 2 yr			Storm = 5 yr		
			I ₅ (mm/hr)	Cavg	Q _{SALLOW} (L/sec)	I ₅ (mm/hr)	Cavg	Q _{SALLOW} (L/sec)
PRE-1	0.1375	10	76.81	0.50	14.7	104.29	0.50	19.9
PRE-2	0.3751	10	76.81	0.50	40.0	104.29	0.50	54.4
Totals		0.5126			54.7			74.3
Notes								
1) Allowable Capture Rate is based on 5-year storm at Tc=10 minutes.								
2) Intensity, I ₅ = 998.071/(Tc+6.035) ^{0.814} (5-year, City of Ottawa)								
<div style="border: 1px solid black; padding: 5px; display: inline-block;"> Allowable Discharge (based on 5-yr storm) </div>								

Table D-10 AVERAGE RUNOFF COEFFICIENTS FOR POST-DEVELOPMENT

Runoff Coefficients $C_{ASPH/CONC} = 0.90$ $C_{ROOF} = 0.90$ $C_{GRASS} = 0.20$											
Area No.	Outlet Location	Asphalt & Conc Areas (m ²)	A * C _{ASPH}	Roof Areas (m ²)	A * C _{ROOF}	Grassed Areas (m ²)	A * C _{GRASS}	Sum AC	Total Area (m ²)	C _{AVG} (see note)	Comment
PST-1	To Richmond / Forest								1340	0.90	Tower A Roof
PST-2									173	0.73	Surface - Uncontrolled
PST-3									1613	0.90	Tower B Roof
PST-4	To Bond St								1926	0.61	Surface - Controlled
PST-5									74	0.90	Surface - Uncontrolled
Totals									5,126		
Notes											
1) Cavg derived with area-weighting command in PCSWMM											

Table D-11 SUMMARY OF POST-DEVELOPMENT PEAK FLOWS (Uncontrolled and Controlled)

Area No	Area (ha)	Time of Conc, Tc (min)	Storm = 2 yr				Storm = 5 yr				Storm = 100 yr				Outlet	Comments
			C _{AVG}	I ₂ (mm/hr)	Q (L/sec)	Q _{CAP} (L/sec)	C _{AVG}	I ₅ (mm/hr)	Q (L/sec)	Q _{CAP} (L/sec)	C _{AVG}	I ₁₀₀ (mm/hr)	Q (L/sec)	Q _{CAP} (L/sec)		
PST-1	0.1340	10	0.90	76.81	25.7	(2.4)	0.90	104.19	34.9	(3.3)	1.00	178.56	66.5	(6.3)	To Richmond / Forest	Tower A Roof
PST-2	0.0173	10	0.73	76.81	2.7	(2.7)	0.73	104.19	3.7	3.7	0.91	178.56	7.8	7.8		Surface - Uncontrolled
PST-3	0.1613	10	0.90	76.81	31.0	(2.5)	0.90	104.19	42.0	(3.4)	1.00	178.56	80.1	(6.4)		Tower B Roof
PST-4	0.1926	10	0.61	76.81	25.1	(11.4)	0.61	104.19	34.0	(15.4)	0.76	178.56	72.9	(33.0)	To Bond St	Surface - Controlled
PST-5	0.0074	10	0.90	76.81	1.4	1.4	0.90	104.19	1.9	1.9	1.00	178.56	3.7	3.7		Surface - Uncontrolled
Totals		0.5126			85.9	20.4			116.5	27.7			231.0	57.3		
Notes																
2-yr Storm Intensity, I = 732.951/(Tc+6.199)^0.810 (City of Ottawa)																
5-yr Storm Intensity, I = 998.071/(Tc+6.035)^0.814 (City of Ottawa)																
100-yr Storm Intensity, I = 1735.688/(Tc+6.014)^0.820 (City of Ottawa)																
Time of Concentration (min), Tc = 10																
For Flows under column Qcap which are shown in brackets (0.0), denotes flows that are controlled																

Table D-12 Storage Volumes for 2-year, 5-Year and 100-Year Storms Area: PST-1

Area No: <u>PST-1</u> $C_{AVG} = \underline{0.90}$ (2-yr) $C_{AVG} = \underline{0.90}$ (5-yr) $C_{AVG} = \underline{1.00}$ (100-yr, Max 1.0) Time Interval = <u>5.000</u> (mins) Drainage Area = <u>0.1340</u> (hectares)															
Duration (min)	Release Rate = <u>2.4</u> (L/sec) Return Period = <u>2</u> (years) IDF Parameters, A = <u>732.951</u> , B = <u>0.810</u> ($I = A/(T_c+C)$), C = <u>6.199</u>					Release Rate = <u>3.3</u> (L/sec) Return Period = <u>5</u> (years) IDF Parameters, A = <u>998.071</u> , B = <u>0.814</u> ($I = A/(T_c+C)$), C = <u>6.053</u>					Release Rate = <u>6.3</u> (L/sec) Return Period = <u>100</u> (years) IDF Parameters, A = <u>1735.688</u> , B = <u>0.820</u> ($I = A/(T_c+C)$), C = <u>6.014</u>				
	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)
0	167.2	55.9	2.45	53.5	0.00	230.5	77.1	3.322	73.8	0.00	398.6	148.5	6.340	142.2	0.00
5	103.6	34.6	2.45	32.2	9.66	141.2	47.2	3.322	43.9	13.17	242.7	90.4	6.340	84.1	25.22
10	76.8	25.7	2.45	23.2	13.95	104.2	34.9	3.322	31.5	18.92	178.6	66.5	6.340	60.2	36.11
15	61.8	20.7	2.45	18.2	16.39	83.6	28.0	3.322	24.6	22.17	142.9	53.2	6.340	46.9	42.20
20	52.0	17.4	2.45	15.0	17.95	70.3	23.5	3.322	20.2	24.21	120.0	44.7	6.340	38.3	46.01
25	45.2	15.1	2.45	12.7	18.99	60.9	20.4	3.322	17.0	25.57	103.8	38.7	6.340	32.3	48.52
30	40.0	13.4	2.45	10.9	19.70	53.9	18.0	3.322	14.7	26.49	91.9	34.2	6.340	27.9	50.19
35	36.1	12.1	2.45	9.6	20.19	48.5	16.2	3.322	12.9	27.11	82.6	30.8	6.340	24.4	51.29
40	32.9	11.0	2.45	8.5	20.51	44.2	14.8	3.322	11.5	27.50	75.1	28.0	6.340	21.7	51.97
45	30.2	10.1	2.45	7.7	20.70	40.6	13.6	3.322	10.3	27.73	69.1	25.7	6.340	19.4	52.33
50	28.0	9.4	2.45	6.9	20.79	37.7	12.6	3.322	9.3	27.82	64.0	23.8	6.340	17.5	52.45
55	26.2	8.8	2.45	6.3	20.81	35.1	11.7	3.322	8.4	27.81	59.6	22.2	6.340	15.9	52.37
60	24.6	8.2	2.45	5.8	20.76	32.9	11.0	3.322	7.7	27.71	55.9	20.8	6.340	14.5	52.13
65	23.2	7.7	2.45	5.3	20.65	31.0	10.4	3.322	7.1	27.54	52.6	19.6	6.340	13.3	51.76
70	21.9	7.3	2.45	4.9	20.50	29.4	9.8	3.322	6.5	27.31	49.8	18.5	6.340	12.2	51.27
75	20.8	7.0	2.45	4.5	20.31	27.9	9.3	3.322	6.0	27.03	47.3	17.6	6.340	11.3	50.69
80	19.8	6.6	2.45	4.2	20.09	26.6	8.9	3.322	5.6	26.70	45.0	16.8	6.340	10.4	50.02
85	18.9	6.3	2.45	3.9	19.83	25.4	8.5	3.322	5.2	26.34	43.0	16.0	6.340	9.7	49.27
90	18.1	6.1	2.45	3.6	19.55	24.3	8.1	3.322	4.8	25.94	41.1	15.3	6.340	9.0	48.46
95	17.4	5.8	2.45	3.4	19.24	23.3	7.8	3.322	4.5	25.50	39.4	14.7	6.340	8.4	47.60
100	16.7	5.6	2.45	3.2	18.92	22.4	7.5	3.322	4.2	25.04	37.9	14.1	6.340	7.8	46.68
Max =				20.81					27.82					52.45	

Notes
 1) Peak flow is equal to the product of 2.78 x C x I x A
 2) Rainfall Intensity, I = A/(Tc+C)^B
 3) Release Rate = Min (Release Rate, Peak Flow)
 4) Storage Rate = Peak Flow - Release Rate
 5) Storage = Duration x Storage Rate
 6) Maximum Storage = Max Storage Over Duration
 7) Parameters a,b,c are for City of Ottawa

Table D-13 Storage Volumes for 2-year, 5-Year and 100-Year Storms Area: PST-3

Area No: PST-3 $C_{AVG} = 0.90$ (2-yr) $C_{AVG} = 0.90$ (5-yr) $C_{AVG} = 1.00$ (100-yr, Max 1.0) Time Interval = 5.00 (mins) Drainage Area = 0.1613 (hectares)															
Duration (min)	Release Rate = <u>2.5</u> (L/sec) Return Period = <u>2</u> (years) IDF Parameters, A = <u>732.951</u> , B = <u>0.810</u> ($I = A/(T_c+C)$), C = <u>6.199</u>					Release Rate = <u>3.4</u> (L/sec) Return Period = <u>5</u> (years) IDF Parameters, A = <u>998.071</u> , B = <u>0.814</u> ($I = A/(T_c+C)$), C = <u>6.053</u>					Release Rate = <u>6.4</u> (L/sec) Return Period = <u>100</u> (years) IDF Parameters, A = <u>1735.688</u> , B = <u>0.820</u> ($I = A/(T_c+C)$), C = <u>6.014</u>				
	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)
0	167.2	67.5	2.49	65.0	0.00	230.5	93.0	3.372	89.6	0.00	398.6	178.7	6.420	172.3	0.00
5	103.6	41.8	2.49	39.3	11.79	141.2	57.0	3.372	53.6	16.08	242.7	108.8	6.420	102.4	30.72
10	76.8	31.0	2.49	28.5	17.11	104.2	42.0	3.372	38.7	23.21	178.6	80.1	6.420	73.6	44.19
15	61.8	24.9	2.49	22.4	20.20	83.6	33.7	3.372	30.3	27.31	142.9	64.1	6.420	57.7	51.89
20	52.0	21.0	2.49	18.5	22.22	70.3	28.4	3.372	25.0	29.98	120.0	53.8	6.420	47.4	56.84
25	45.2	18.2	2.49	15.7	23.61	60.9	24.6	3.372	21.2	31.81	103.8	46.6	6.420	40.1	60.22
30	40.0	16.2	2.49	13.7	24.62	53.9	21.8	3.372	18.4	33.11	91.9	41.2	6.420	34.8	62.59
35	36.1	14.6	2.49	12.1	25.34	48.5	19.6	3.372	16.2	34.04	82.6	37.0	6.420	30.6	64.28
40	32.9	13.3	2.49	10.8	25.87	44.2	17.8	3.372	14.5	34.70	75.1	33.7	6.420	27.3	65.46
45	30.2	12.2	2.49	9.7	26.24	40.6	16.4	3.372	13.0	35.17	69.1	31.0	6.420	24.5	66.27
50	28.0	11.3	2.49	8.8	26.49	37.7	15.2	3.372	11.8	35.47	64.0	28.7	6.420	22.3	66.77
55	26.2	10.6	2.49	8.1	26.65	35.1	14.2	3.372	10.8	35.65	59.6	26.7	6.420	20.3	67.04
60	24.6	9.9	2.49	7.4	26.73	32.9	13.3	3.372	9.9	35.72	55.9	25.1	6.420	18.6	67.12
65	23.2	9.3	2.49	6.9	26.75	31.0	12.5	3.372	9.2	35.71	52.6	23.6	6.420	17.2	67.03
70	21.9	8.8	2.49	6.4	26.70	29.4	11.9	3.372	8.5	35.62	49.8	22.3	6.420	15.9	66.81
75	20.8	8.4	2.49	5.9	26.61	27.9	11.3	3.372	7.9	35.48	47.3	21.2	6.420	14.8	66.47
80	19.8	8.0	2.49	5.5	26.48	26.6	10.7	3.372	7.3	35.27	45.0	20.2	6.420	13.8	66.02
85	18.9	7.6	2.49	5.2	26.32	25.4	10.2	3.372	6.9	35.02	43.0	19.3	6.420	12.8	65.49
90	18.1	7.3	2.49	4.8	26.12	24.3	9.8	3.372	6.4	34.72	41.1	18.4	6.420	12.0	64.88
95	17.4	7.0	2.49	4.5	25.89	23.3	9.4	3.372	6.0	34.39	39.4	17.7	6.420	11.3	64.20
100	16.7	6.8	2.49	4.3	25.64	22.4	9.0	3.372	5.7	34.03	37.9	17.0	6.420	10.6	63.46
Max =				26.75					35.72					67.12	

Notes
 1) Peak flow is equal to the product of $2.78 \times C \times I \times A$
 2) Rainfall Intensity, $I = A/(T_c+C)^B$
 3) Release Rate = Min (Release Rate, Peak Flow)
 4) Storage Rate = Peak Flow - Release Rate
 5) Storage = Duration x Storage Rate
 6) Maximum Storage = Max Storage Over Duration
 7) Parameters a,b,c are for City of Ottawa

Table D-14 Storage Volumes for 2-year, 5-Year and 100-Year Storms Area: PST-4

Area No: PST-4 $C_{AVG} = 0.61$ (2-yr) $C_{AVG} = 0.61$ (5-yr) $C_{AVG} = 0.76$ (100-yr, Max 1.0) Time Interval = 2.00 (mins) Drainage Area = 0.1926 (hectares)																	
Actual Release Rate (L/sec) = 33.0 Percentage of Actual Rate (City of Ottawa requirement) = 50% Release Rate Used for Estimation of 100-year Storage (L/sec) = 16.5																	
Duration (min)	Release Rate = 11.4 (L/sec) Return Period = 2 (years) IDF Parameters, A = 732.951, B = 0.810 $(I = A/(T_c + C))$, C = 6.199					Release Rate = 15.4 (L/sec) Return Period = 5 (years) IDF Parameters, A = 998.071, B = 0.814 $(I = A/(T_c + C))$, C = 6.053					Release Rate = 16.5 (L/sec) Return Period = 100 (years) IDF Parameters, A = 1735.688, B = 0.820 $(I = A/(T_c + C))$, C = 6.014						
	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)	Rainfall Intensity, I (mm/hr)	Peak Flow (L/sec)	Release Rate (L/sec)	Storage Rate (L/sec)	Storage (m ³)		
0	167.2	54.6	11.36	43.3	0.00	230.5	75.3	15.405	59.9	0.00	398.6	162.7	16.5	146.2	0.00		
2	133.3	43.5	11.36	32.2	3.86	182.7	59.7	15.405	44.3	5.31	315.0	128.6	16.5	112.1	13.45		
4	111.7	36.5	11.36	25.1	6.03	152.5	49.8	15.405	34.4	8.26	262.4	107.1	16.5	90.6	21.75		
6	96.6	31.6	11.36	20.2	7.27	131.6	43.0	15.405	27.6	9.92	226.0	92.3	16.5	75.8	27.28		
8	85.5	27.9	11.36	16.6	7.95	116.1	37.9	15.405	22.5	10.81	199.2	81.3	16.5	64.8	31.12		
10	76.8	25.1	11.36	13.7	8.24	104.2	34.0	15.405	18.6	11.18	178.6	72.9	16.5	56.4	33.84		
12	69.9	22.8	11.36	11.5	8.26	94.7	30.9	15.405	15.5	11.18	162.1	66.2	16.5	49.7	35.78		
14	64.2	21.0	11.36	9.6	8.08	86.9	28.4	15.405	13.0	10.91	148.7	60.7	16.5	44.2	37.14		
16	59.5	19.4	11.36	8.1	7.76	80.5	26.3	15.405	10.9	10.44	137.5	56.2	16.5	39.7	38.07		
18	55.5	18.1	11.36	6.8	7.31	75.0	24.5	15.405	9.1	9.81	128.1	52.3	16.5	35.8	38.65		
20	52.0	17.0	11.36	5.6	6.77	70.3	22.9	15.405	7.5	9.05	120.0	49.0	16.5	32.5	38.97		
22	49.0	16.0	11.36	4.7	6.14	66.1	21.6	15.405	6.2	8.18	112.9	46.1	16.5	29.6	39.05		
24	46.4	15.1	11.36	3.8	5.46	62.5	20.4	15.405	5.0	7.23	106.7	43.6	16.5	27.1	38.95		
26	44.0	14.4	11.36	3.0	4.72	59.3	19.4	15.405	4.0	6.21	101.2	41.3	16.5	24.8	38.70		
28	41.9	13.7	11.36	2.3	3.93	56.5	18.5	15.405	3.0	5.12	96.3	39.3	16.5	22.8	38.31		
30	40.0	13.1	11.36	1.7	3.10	53.9	17.6	15.405	2.2	3.98	91.9	37.5	16.5	21.0	37.81		
32	38.3	12.5	11.36	1.2	2.24	51.6	16.9	15.405	1.5	2.79	87.9	35.9	16.5	19.4	37.21		
34	36.8	12.0	11.36	0.7	1.34	49.5	16.2	15.405	0.8	1.56	84.3	34.4	16.5	17.9	36.52		
36	35.4	11.6	11.36	0.2	0.42	47.6	15.5	15.405	0.1	0.29	81.0	33.1	16.5	16.6	35.76		
38	34.1	11.1	11.36	-0.2	-0.52	45.8	15.0	15.405	-0.4	-1.01	77.9	31.8	16.5	15.3	34.92		
40	32.9	10.7	11.36	-0.6	-1.49	44.2	14.4	15.405	-1.0	-2.34	75.1	30.7	16.5	14.2	34.03		
Max =					8.26						11.18						39.05
Notes																	
1) Peak flow is equal to the product of $2.78 \times C \times I \times A$																	
2) Rainfall Intensity, $I = A/(T_c + C)^B$																	
3) Release Rate = Min (Release Rate, Peak Flow)																	
4) Storage Rate = Peak Flow - Release Rate																	
5) Storage = Duration x Storage Rate																	
6) Maximum Storage = Max Storage Over Duration																	
7) Parameters a,b,c are for City of Ottawa																	

Table D15: 5-year & 100-year Roof Design Sheet - For Roof Drains on Tower A using Flow Controlled Roof Drains

Project: 365 Forest Street
 Location: City of Ottawa
 Date: July 2022

Area #	Drain Type	Roof Drain Type	No Drains per Area	No of Weirs per Drain	Weir Position	Runoff Coeff (Cavg)		Drainage Area		5-year Event					100-year Event					Storage Required (ARM)		Maximum Storage Provided at Spill Elevation					
						5-year	100-year	m ²	ha	Runoff Rate (L/sec)	5yr Ponding Depth (mm)	Roof Drain Capacity Per Weir (gpm)	Roof Drain Capacity Per Drain per weir (gpm)	Roof Drain Capacity Per Drain (L/sec)	Total Flow From Roof Drains (L/sec)	Runoff Rate (L/sec)	100yr Ponding Depth (mm)	Roof Drain Capacity Per Weir (gpm)	Roof Drain Capacity Per Drain per weir (gpm)	Roof Drain Capacity Per Drain (L/sec)	Total Flow From Roof Drains (L/sec)	5-year (m ³)	100-year (m ³)	Area Available for Storage (m ²)	Max Prism Depth (mm)	Max Prism Volume (m ³)	Total Volume (m ³)
R-A1	RD	RD1	1	1	3-1/4 open	0.90	1.00	251	0.0251	6.543	108	12.9	12.9	0.814	0.814	12.459	142	14.6	14.6	0.921	0.921	4.71	10.73	251	150	12.6	12.55
R-A2	RD	RD1	1	1	3-1/4 open	0.90	1.00	181	0.0181	4.719	103	12.6	12.6	0.797	0.797	8.985	137	14.4	14.4	0.905	0.905	2.96	6.94	181	150	9.1	9.05
R-A3	RD	RD1	1	1	3-1/4 open	0.90	1.00	141	0.0141	3.676	99	12.5	12.5	0.785	0.785	6.999	133	14.2	14.2	0.893	0.893	2.04	4.93	141	150	7.1	7.05
R-A4	RD	RD1	1	1	3-1/4 open	0.90	1.00	102	0.0102	2.659	94	12.2	12.2	0.770	0.770	5.063	127	13.9	13.9	0.874	0.874	1.23	3.11	102	150	5.1	5.10
R-A5	RD	RD1	1	1	3-1/4 open	0.90	1.00	171	0.0171	4.458	102	12.6	12.6	0.795	0.795	8.488	136	14.3	14.3	0.902	0.902	2.72	6.43	171	150	8.6	8.55
R-A6	RD	RD1	1	1	3-1/4 open	0.90	1.00	277	0.0277	7.221	110	13.0	13.0	0.820	0.820	13.750	144	14.7	14.7	0.927	0.927	5.39	12.21	277	150	13.9	13.85
R-A7	RD	RD1	1	1	3-1/4 open	0.90	1.00	218	0.0218	5.683	106	12.8	12.8	0.808	0.808	10.821	140	14.5	14.5	0.915	0.915	3.86	8.91	218	150	10.9	10.90
Totals						0.9	1	1,341	0.1341	34.959		88.59		5.59	5.59	66.57		100.45		6.34	6.34	22.91	53.25	1341		67.1	67.1
Min																		94									
Max																		110									

Runoff Based on the Following:

Storm Frequency (years) = 5 100
 Time of Conc (mins) = 10 10
 Storm Intensity (mm/hr) = 104.2 178.6

Q_{yr}(cont) = 4.2
 V_{2yr} = 17.2

Roof Drains have Following Flow Rates: WATTS Flow Controlled Drain

Weir Position	Flow (gpm) per depth							Max Flow Rate per Weir
	0	25	50	75	100	125	150	
0	0.025	0.05	0.075	0.1	0.125	0.15		
1-None	0	0	0	0	0	0	0	0.000
2-Closed	0	5	5	5	5	5	5	0.315
3-1/4 open	0	5	10	11	13	14	15	0.946
4-1/2 open	0	5	10	12	15	18	20	1.262
5-3/4 open	0	5	10	14	18	21	25	1.577
6-Full	0	5	10	15	20	25	30	1.893

Roof Drain Types

Drain Type = RD1 RD2
 Max Overflow Depth (mm) 150 mm 150 mm
 Flow Controlled (Yes/No) Yes No
 Ponding Yes No
 Weir Desc Accutrol n/a
 No. Weirs 1 n/a

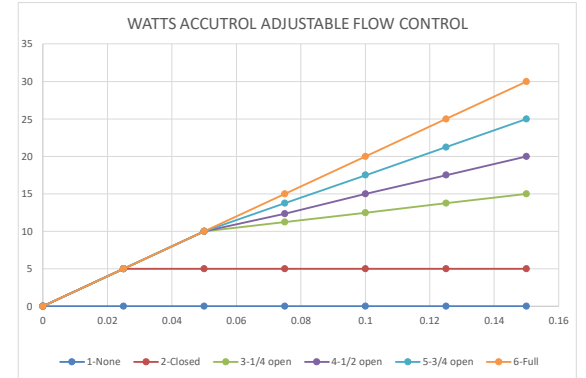


Table D16: 5-year & 100-year Roof Design Sheet - For Roof Drains on Tower B using Flow Controlled Roof Drains

Project: 365 Forest Street
 Location: City of Ottawa
 Date: July 2022

Area #	Drain Type	Roof Drain Type	No Drains per Area	No of Weirs per Drain	Weir Position	Runoff Coeff (Cavg)		Drainage Area		5-year Event					100-year Event					Storage Required (ARM)		Maximum Storage Provided at Spill Elevation						
						5-year	100-year	m ²	ha	Runoff Rate (L/sec)	5yr Ponding Depth (mm)	Roof Drain Capacity Per Weir (gpm)	Roof Drain Capacity Per Drain per weir (gpm)	Roof Drain Capacity Per Drain (L/sec)	Total Flow From Roof Drains (L/sec)	Runoff Rate (L/sec)	100yr Ponding Depth (mm)	Roof Drain Capacity Per Weir (gpm)	Roof Drain Capacity Per Drain per weir (gpm)	Roof Drain Capacity Per Drain (L/sec)	Total Flow From Roof Drains (L/sec)	5-year (m ³)	100-year (m ³)	Area Available for Storage (m ²)	Max Prism Depth (mm)	Max Prism Volume (m ³)	Total Volume (m ³)	
R-B1	RD	RD1	1	1	3-1/4 open	0.90	1.00	217	0.0217	5.657	106	12.8	12.8	0.808	0.808	10.772	140	14.5	14.5	0.915	0.915	3.84	8.85	217	150	10.9	10.85	
R-B2	RD	RD1	1	1	3-1/4 open	0.90	1.00	245	0.0245	6.387	108	12.9	12.9	0.814	0.814	12.162	142	14.6	14.6	0.921	0.921	4.55	10.39	245	150	12.3	12.25	
R-B3	RD	RD1	1	1	3-1/4 open	0.90	1.00	276	0.0276	7.195	109	13.0	13.0	0.817	0.817	13.700	144	14.7	14.7	0.927	0.927	5.37	12.15	276	150	13.8	13.80	
R-B4	RD	RD1	1	1	3-1/4 open	0.90	1.00	275	0.0275	7.169	109	13.0	13.0	0.817	0.817	13.651	144	14.7	14.7	0.927	0.927	5.34	12.09	275	150	13.8	13.75	
R-B5	RD	RD1	1	1	3-1/4 open	0.90	1.00	197	0.0197	5.136	104	12.7	12.7	0.801	0.801	9.779	139	14.5	14.5	0.912	0.912	3.34	7.77	197	150	9.9	9.85	
R-B6	RD	RD1	1	1	3-1/4 open	0.90	1.00	132	0.0132	3.441	98	12.4	12.4	0.782	0.782	6.552	132	14.1	14.1	0.890	0.890	1.85	4.50	132	150	6.6	6.60	
R-B7	RD	RD1	1	1	3-1/4 open	0.90	1.00	271	0.0271	7.065	109	13.0	13.0	0.817	0.817	13.452	143	14.7	14.7	0.924	0.924	5.23	11.87	271	150	13.6	13.55	
Totals						0.9	1	1,613	0.1613	42.049		89.65		5.66	5.66	80.07		101.70		6.42	6.42	29.51	67.63	1613		80.7	80.7	
Min																												
Max																												

Runoff Based on the Following:

Storm Frequency (years) = 5 100
 Time of Conc (mins) = 10 10
 Storm Intensity (mm/hr) = 104.2 178.6


Qyr(cont) = 4.2
 V2yr = 22.1

Roof Drains have Following Flow Rates: WATTS Flow Controlled Drain

Weir Position	Flow (gpm) per depth							Max Flow Rate per Weir
	0	25	50	75	100	125	150	
0	0	0.025	0.05	0.075	0.1	0.125	0.15	
1-None	0	0	0	0	0	0	0	0.000
2-Closed	0	5	5	5	5	5	5	0.315
3-1/4 open	0	5	10	11	13	14	15	0.946
4-1/2 open	0	5	10	12	15	18	20	1.262
5-3/4 open	0	5	10	14	18	21	25	1.577
6-Full	0	5	10	15	20	25	30	1.893

Roof Drain Types

Drain Type = RD1 RD2
 Max Overflow Depth (mm) 150 mm 150 mm
 Flow Controlled (Yes/No) Yes No
 Ponding Yes No
 Weir Desc Accutrol n/a
 No. Weirs 1 n/a

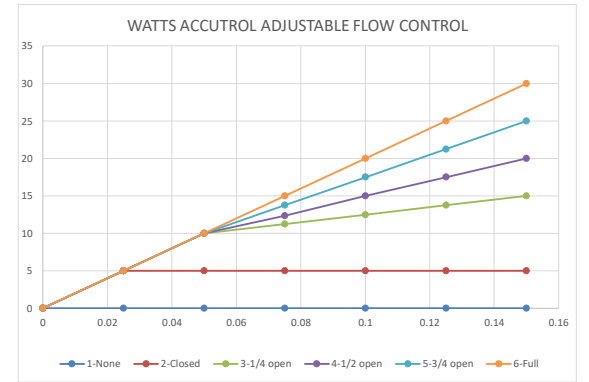

Appendix E – Consultation / Correspondence

Pre-consultation meeting minutes

Email on Water System Boundary Conditions

Email Sent to RCVA on Stormwater Management Requirements

Email Received from RCVA on Stormwater Management Requirements

Email Correspondence with City of Ottawa re SWM requirements for Pinecrest Creek/Westboro

365 Forest Street, 1420 Richmond Road & 2583-2589 Bond Street
Pre-Consultation Meeting Minutes

Location: Room 4103E, City Hall
Date: May 28, 2pm to 3pm

Attendee	Role	Organization
Mary Dickinson	Planner	City of Ottawa
Santosh Kuruvilla	Project Manager (Infrastructure)	
Melanie Knight	Planner (Urban Design)	
Samantha Gatchene	Planning Assistant	
Jamie Posen	Planner	FoTenn
Steve Heafey	Owner's Representative	Heafey Group
Carmine Zayoun	Owner's Representative	
Shawn Vandette	Owner	
Mathieu LaPalm	Architect	LaPalm Rheault Architects

Comments from Applicant

1. The applicant is proposing the development two 12-storey high rise buildings at 365 Forest Street, 1420 Richmond Road, and 2583-2589 Bond Street. The buildings would be residential in nature with 333 units total. Currently, no commercial uses at grade are proposed.
2. Underground parking and surface vehicle parking would be provided as well as bicycle parking.
3. The current two access points off Richmond Road and Forest Street are proposed to be maintained.

Planning Comments

1. A Zoning By-law Amendment and an Official Plan Amendment would be required to permit the 12-storey building option, in accordance with the settlement of Official Plan Amendment 150 (OPA 150). The amendment to Section 3.6.3 maintains that up to 9-storeys is permitted on Arterial Mainstreets unless stated in a secondary plan or if the building is located at a qualifying node defined as a location that is:
 - a. within 400 metres walking distance of a Rapid Transit Station on Schedule D of this Plan; or
 - b. directly abutting an intersection of the Mainstreet with another Mainstreet or a Transit Priority Corridor on Schedule D of this Plan; or

- c. directly abutting a Major Urban Facility.
2. Under OPA 150, the site is not considered a node and would require an OPA. Information regarding the settlement of OPA 150 building height and design appeals can be found in the April 24th [Planning Committee Report](#).
3. The City is in the early stages of creating a secondary plan for the area. This process is scheduled to begin in late 2019/early 2020. City staff strongly encourage the applicant to participate in that process.
4. Cash-in-lieu of parkland and associated appraisal fee will be required as a condition of approval as per the [Parkland Dedication By-law](#). For commercial and industrial purposes, parkland is calculated as 2% of the gross land area of the site being developed.
5. Building A should include a main front entrance directly from Richmond Road, or at the corner where Richmond Road and Forest Street meet. This is in accordance with the current AM10 zoning requirements. Please refer to the development standards in this zone for all other provisions including minimum glazing, minimum ceiling heights for the first storey etc.

Urban Design Comments

1. Site design:
 - All vehicular access should be off of Forest and/or Bond. Preference would be for all vehicular access off of Bond. Bond Street should be treated as a 'laneway' to the site where access to underground parking and any loading or servicing can be located.
 - There are hydro lines along Forest and Bond, which requires minimum building setbacks. If the hydro lines are to be buried, the building should still be set back to allow for enough space for street trees along Forest and Bond.
 - A sidewalk should be provided along Forest to connect to the sidewalk recently built along Forest towards Carling (Dymon Storage site).
 - All parking should be located underground. This would significantly improve the immediate area, which is dominated by surface parking lots.
 - There is an opportunity at the corner of Richmond and Forest to create a plaza space either as a POPS (privately owned public spaces) or a patio space associated with a commercial use
2. Built form/building design:

- The building separation in the current design between Building A and B should be maintained to break up the façade along Forest.
- The long frontage along Forest needs to be designed well to ensure that there is permeability to the site and the buildings do not negatively dominate the streetscape.

3. Building A (12 storeys)

- With vehicular access from Richmond removed, the building fronting onto Richmond Road can be designed as a complete perimeter corner building with design emphasis on the corner of Richmond and Forest.
- Main pedestrian entrances should be located off of Richmond with a corner entrance/plaza space at the corner of Richmond and Forest.
- The building should be designed with consideration for the City's [High Rise Design Guidelines](#) specifically with respect to built form (chapter 2).
- Consider the shadowing impacts to the low-rise residential homes on the north side of Richmond Road with the shaping of Building A

4. Building B (12 storeys)

- At 12 storeys, the mass of Building B dominates the site and Bond Street. A reduced building footprint and a reduced height down to 9 storeys is recommended. Please refer to Chapter 2 in the [High Rise Design Guidelines](#) for guidance on the appropriateness, mass and height of a bar building.
- This building should create a transition from the newly constructed building at 2599 Carling Avenue.
- The roof top amenity space could be realigned north/south to take better advantage of sun exposure and provide relief between the Building A and B.
- The building should be designed with consideration for the City's [High Rise Design Guidelines](#) specifically with respect to built form (Chapter 2).

5. General comments:

- This site presents an opportunity for redevelopment which can improve the existing context that is dominated by surface parking lots and oversized (high rise) bar buildings.
- With frontage on three streets, there is an opportunity to make a significant contribution to the public realm. Please refer to the City's [High Rise Design](#)

[Guidelines](#) (chapter 3) for more direction on the design of the pedestrian realm.

Engineering Comments

1. Stormwater quantity control criteria – control the quantity to the 5-year pre-development/existing level for all storms up to and including the 100-year storm.
2. When calculating the existing composite runoff coefficient (C) for the site, please provide a drawing showing the individual area and its runoff coefficient.
3. It appears that the subject site consists of more than one parcel. Therefore, MECP ECA is required. All parcels can be merged into one to avoid MECP ECA requirement.
4. Stormwater quality control – Consult with the Conservation Authority (RVCA) for their requirements. Include the correspondence with RVCA in the stormwater/site servicing report.
5. Show the existing storm and sanitary lateral service connections on the site servicing plan.
6. When using the modified rational method to calculate the storage requirements for the site, the underground storage should not be included in the overall available storage. The modified rational method assumes that the restricted flow rate is constant throughout the storm which, in this case, underestimates the storage requirement prior to the 1: 100-year head elevation being reached. Alternately, if you wish to include the underground storage, you may use an assumed average release rate equal to 50% of the peak allowable rate. Otherwise, disregard the underground storage as available storage or provide modeling to support the design.
7. Engineering plans are to be submitted on standard A1 size (594mm x 841mm) sheets.
8. Provide the following information for water main boundary conditions:
 - a. Location map with water service connection location
 - b. Average daily demand (l/s)
 - c. Maximum daily demand (l/s)
 - d. Maximum hourly demand
 - e. Fire flow demand (provide fire detailed flow calculations based on the fire underwriters survey method)
 - f. If you are proposing any exterior light fixtures, all must be included and approved as part of the site plan approval. Therefore, the lights must be clearly identified by make, model and part number. All external light

fixtures must meet the criteria for full cut-off classification as recognized by the Illuminating Engineering Society of North America (IESNA or IES), and must result in minimal light spillage onto adjacent properties (as a guideline, 0.5 fc is normally the maximum allowable spillage). In order to satisfy these criteria, the applicant must provide certification from an acceptable professional engineer. The location of all exterior fixtures, a table showing the fixture types (including make, model, part number), and the mounting heights must be included on a plan.

Transportation Comments

1. Please revise your screening form to indicate that the property is located on a Spine Bicycle Network (Richmond)
2. Follow Traffic Impact Assessment Guidelines
 - a. Traffic Impact Assessment will be required.
 - b. Start this process asap.
 - c. Applicant advised that their application will not be deemed complete until the submission of the draft step 1-4, including the functional draft RMA package (if applicable) and/or monitoring report (if applicable).
3. ROW protection on Richmond between HWY 417 and Ottawa River Parkway is 37.5m even (18.75 metres from centreline of road).
4. Corner triangles as per OP Annex 1 - Road Classification and Rights-of-Way at the following location on the final plan will be required:
 - a. Local Road to Local Road: 3 metre x 3 metres
 - b. Local Road to Arterial Road: 5 metre x 5 metres
5. Noise Impact Studies required for the following:
 - a. Road
 - b. Stationary (due to the proximity to neighbouring exposed mechanical equipment) and/or (if there will be any exposed mechanical equipment due to the proximity to neighbouring noise sensitive land uses)
6. Clear throat requirements on an arterial (Richmond) are as follows:

Apartments	Unit Count	Length (m)
	<100 units	15
	100-200 units	25
	>200 units	40

**Please note that vehicular access from Richmond Road is not our desired configuration.

7. On site plan:
 - a. Show all details of the roads abutting the site up to and including the opposite curb; include such items as pavement markings, accesses and/or sidewalks.
 - b. Turning templates will be required for all accesses showing the largest vehicle to access the site; required for internal movements and at all access (entering and exiting and going in both directions).
 - c. Show all curb radii measurements; ensure that all curb radii are reduced as much as possible
 - d. Show lane/aisle widths.
 - e. Sidewalk and cycle tracks are to be continuous across access as per City Specification 7.1.
 - f. Grey out any area that will not be impacted by this application.

Requested Plans and Studies

1. A list of required plans and studies required for a complete combined Official Plan Amendment, Zoning By-law Amendment and Site Plan Control application have been attached.

Process

1. This is a pre-consultation to determine the nature of the application and the requirements for a complete application.
 - a. For an Official Plan Amendment application, subject to Public Consultation, the application form, timeline, and fees can be found [here](#).
 - b. For a Major Zoning By-law Amendment application, Manager Approval, subject to Public Consultation, the application form, timeline, and fees can be found [here](#).
2. This proposal will trigger a Site Plan Control application, Manager Approval, subject to Public Consultation. The proposal would fall under the 'complex' category as per the [Site Plan Control Subtype Thresholds](#). The application form, timeline and fees can be found [here](#).
3. The applicant will be required to present their proposal to the Urban Design Review Panel (UDRP). The site is in a Design Priority Area and a pre-consultation is recommended. The next UDRP meeting is scheduled for Friday, July 12th and the submission deadline is Friday, June 28. Information regarding the review process and timelines can be found [here](#).

Please refer to the links to "[Guide to preparing studies and plans](#)" and [fees](#) for general information. Additional information is available related to [building permits, development charges, and the Accessibility Design Standards](#). Be aware that other fees and permits may be required, outside of the development review process. You may obtain background drawings by contacting informationcentre@ottawa.ca.

These pre-con comments are valid for one year. If you submit a development application(s) after this time, you may be required to meet for another pre-consultation meeting and/or the submission requirements may change. You are as well encouraged to contact us for a follow-up meeting if the plan/concept will be further refined.

Please contact me at mary.dickinson@ottawa.ca or at 613-580-2424 extension 13923 if you have any questions.

Sincerely,

A handwritten signature in black ink, appearing to be 'MD' with a flourish extending to the right.

Mary Dickinson MCIP RPP
Planner II
Development Review - West

Jennifer Diaz

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: Wednesday, June 2, 2021 1:56 PM
To: Bruce Thomas; Jennifer Diaz
Cc: Jason Fitzpatrick
Subject: RE: Request for Boundary Conditions - 365 Forest Street
Attachments: 365 Forest May 2021 - 2nd Submission.pdf



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Bruce,

The following are boundary conditions, HGL, for hydraulic analysis at 365 Forest (zone 1W) assumed to be connected to the 305 mm on Forest Street (see attached PDF for location).

Minimum HGL = 108.3 m

Maximum HGL = 115.4 m

MaxDay + FireFlow (133L/s) = 109.8 m

MaxDay + FireFlow (183L/s) = 109.2 m

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Thanks,

Santhosh

From: Kuruvilla, Santhosh
Sent: May 31, 2021 11:33 AM
To: Bruce Thomas <bruce.thomas@exp.com>; Jennifer Diaz <jennifer.diaz@exp.com>
Cc: Jason Fitzpatrick <jason.fitzpatrick@exp.com>
Subject: RE: Request for Boundary Conditions - 365 Forest Street

Ok, thanks Bruce.

Santhosh

From: Bruce Thomas <bruce.thomas@exp.com>
Sent: May 31, 2021 11:16 AM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>; Jennifer Diaz <jennifer.diaz@exp.com>
Cc: Jason Fitzpatrick <jason.fitzpatrick@exp.com>
Subject: RE: Request for Boundary Conditions - 365 Forest Street

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Santhosh,

A double feed is proposed from the location on Forest with a valve in between the two proposed connections.

Bruce Thomas, P.Eng.

EXP | Senior Project Manager

t : +1.613.688.1899 | m : +1.613.852.8753 | e : bruce.thomas@exp.com

[exp.com](#) | [legal disclaimer](#)
keep it green, read from the screen

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: Monday, May 31, 2021 10:55 AM
To: Jennifer Diaz <jennifer.diaz@exp.com>
Cc: Jason Fitzpatrick <jason.fitzpatrick@exp.com>; Bruce Thomas <bruce.thomas@exp.com>
Subject: RE: Request for Boundary Conditions - 365 Forest Street



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Jennifer,

We noticed that the previous boundary conditions that you requested for this site required two connections. Now there is only being requested but the demands require 2 connections (see section 4.3 of the Ottawa Water Distribution Design Guideline).

Please update your map showing both connection points and send us a copy.

Thanks,

Santhosh

From: Jennifer Diaz <jennifer.diaz@exp.com>
Sent: May 26, 2021 4:54 PM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Cc: Jason Fitzpatrick <jason.fitzpatrick@exp.com>; Bruce Thomas <Bruce.Thomas@exp.com>
Subject: RE: Request for Boundary Conditions - 365 Forest Street

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Santhosh,

Please see the attached requested information and summary of the water demand below:

Average Day: 2.5 L/sec

Max Day: 6.2 L/sec

Peak Hour: 13.6 L/sec

Fire flow (RFF): Tower A: 133 L/sec, Tower B: 183 L/sec (based on FUS method)

Max Day + FF: 189.2 L/sec.

Please advise if you require anything else.

Thank you

Jennifer Diaz, P.Eng.

EXP | Branch Manager

t : +1.613.542.1253, 122 | m : +1.613.484.2286 | e : jennifer.diaz@exp.com

exp.com | [legal disclaimer](#)

keep it green, read from the screen

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>

Sent: Friday, May 21, 2021 3:23 PM

To: Jennifer Diaz <jennifer.diaz@exp.com>

Subject: RE: Request for Boundary Conditions - 365 Forest Street



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Jennifer,

Please provide the following information for water boundary condition request.

- Provide the following information for water main boundary conditions:
 1. Location map with water service connection location(s).
 2. Average daily demand (l/s).
 3. Maximum daily demand (l/s).
 4. Maximum hourly demand (l/s).
 5. Fire flow demand (provide detailed fire flow calculations based on Fire Underwriters survey (FUS) Water Supply for Public Fire Protection). Exposure separation distances shall be defined on a figure to support the FUS calculation and required fire flow (RFF).

6. Hydrant capacity shall be assessed to demonstrate the RFF can be achieved. Please identify which hydrants are being considered to meet the RFF on a fire hydrant coverage plan as part of the boundary conditions request.

Please ensure all information listed above must be provided in the same email.

Thanks,

Santhosh

From: Jennifer Diaz <jennifer.diaz@exp.com>
Sent: May 20, 2021 8:50 PM
To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Subject: RE: Request for Boundary Conditions - 365 Forest Street

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good evening,

Further to our request there have been minor changes to the design of the proposed development at the subject address. We have since completed additional calculations and estimate the following demands and flow requirements:

Average Day: 2.5 L/sec
Max Day: 6.2 L/sec
Peak Hour: 13.6 L/sec
Fire flow (RFF): Tower A: 133 L/sec, Tower B: 183 L/sec (based on FUS method)
Max Day + FF: 189.2 L/sec.

Please provide the updated hydraulic boundary conditions based on our estimated values.

Thank you!

Jennifer Diaz, P.Eng.

EXP | Branch Manager

t : +1.613.542.1253, 122 | m : +1.613.484.2286 | e : jennifer.diaz@exp.com

*[exp.com](#) | [legal disclaimer](#)
keep it green, read from the screen*

From: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>
Sent: Wednesday, July 24, 2019 9:42 AM
To: Dickinson, Mary <mary.dickinson@ottawa.ca>; Jason Fitzpatrick <jason.fitzpatrick@exp.com>
Subject: RE: Request for Boundary Conditions - 365 Forest Street

Hi Jason,

Here is the boundary conditions for the subject application. Please see attached for the connection locations.

The following are boundary conditions, HGL, for hydraulic analysis at 365 Forest (zone 1W) assumed to be connected to the 305mm on Forest and 305mm on Richmond (see attached PDF for location).

Minimum HGL = 108.5m, same at both connections

Maximum HGL = 115.7m, same at both connections

MaxDay + FireFlow (150L/s) = 107.0m, Forest connection

MaxDay + FireFlow (150L/s) = 109.0m, Richmond connection

These are for current conditions and are based on computer model simulation.

Disclaimer: The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation.

Santhosh

From: Dickinson, Mary

Sent: July 10, 2019 3:58 PM

To: Kuruvilla, Santhosh <Santhosh.Kuruvilla@ottawa.ca>; jason.fitzpatrick@exp.com

Subject: FW: Request for Boundary Conditions - 365 Forest Street

Hi Jason,

I'm forwarding your request to Santhosh Kuruvilla who will be able to make the request for the boundary conditions.

Thank you,
Mary

Mary Dickinson, MCIP, RPP

Planner

Development Review West

Urbaniste

Examen des demandes d'aménagement ouest

City of Ottawa | Ville d'Ottawa

☎ 613.580.2424 ext./poste 13923

ottawa.ca/planning/ / ottawa.ca/urbanisme

From: Jason Fitzpatrick <jason.fitzpatrick@exp.com>
Sent: July 10, 2019 3:32 PM
To: Dickinson, Mary <mary.dickinson@ottawa.ca>
Cc: Bruce Thomas <bruce.thomas@exp.com>; Moe Ghadban <Moe.Ghadban@exp.com>
Subject: Request for Boundary Conditions - 365 Forest Street

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Mary,

We are working with the Heafey Group on a site plan application for 365 Forest Street, and would appreciate if you could arrange for IAD/water Resources to provide hydraulic boundary conditions that we will need for the watermain design. I have attached a sketch of the site and the approximate boundary condition locations. We are requesting boundary conditions at locations at this time to evaluate the best connection location within the right of way.

The following is a summary of the demands and the required fire flows (RFF) we have estimated. We would appreciate the hydraulic boundary conditions based on our estimated water demands and required fire flows as noted below:

Average Day: 2.4 L/sec
Max Day: 6.0 L/sec
Peak Hour: 13.2 L/sec
Fire flow (RFF): Tower A: 100 L/sec, Tower B: 150 L/sec (worst case). (based on FUS method)
Max Day + FF: 156.0 L/sec.

In the event you require confirmation of the above demands and the RFF, I've attached the design tables for reference.

Regards,



Jason Fitzpatrick, P.Eng.

EXP | Project Engineer
t : +1.613.688.1899 | m : +1.613.302.7441 | e : jason.fitzpatrick@exp.com
2650 Queensview Drive
Suite 100
Ottawa, ON K2B 8H6
CANADA

exp.com | [legal disclaimer](#)
keep it green, read from the screen

'
'
This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'
This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.


'
'
This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'
'
This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

Boundary Conditions for 365 Forest Street

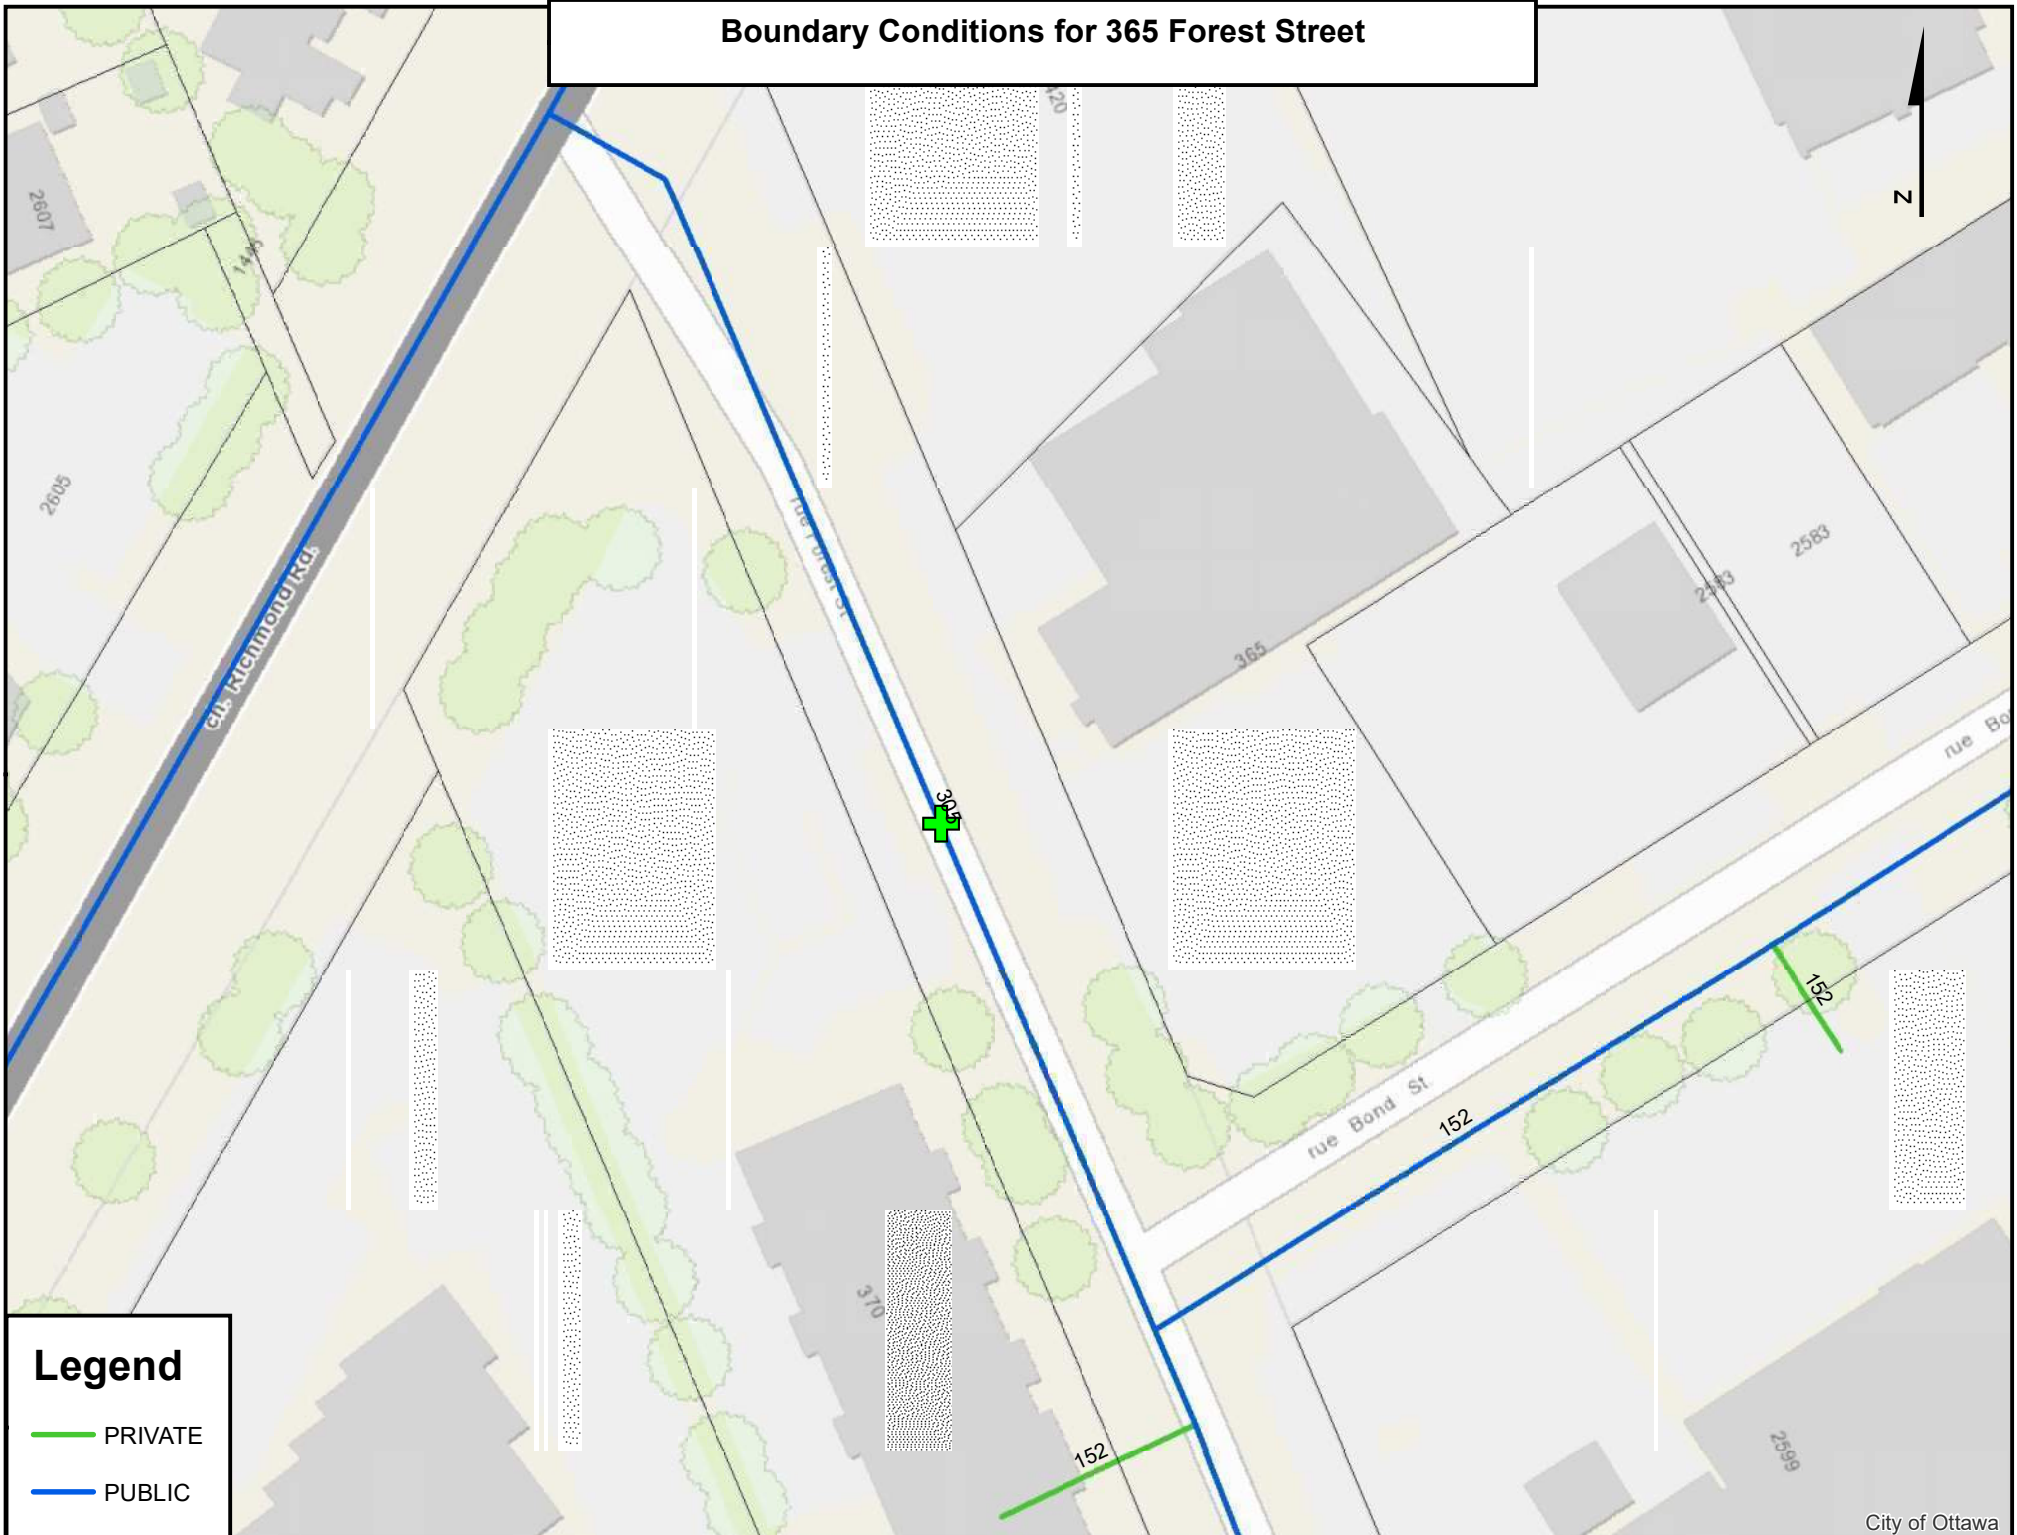

Legend

- PRIVATE
- PUBLIC

Jennifer Diaz

From: Miliu, Ghislaine <ghislaine.miliu@ottawa.ca>
Sent: Wednesday, October 13, 2021 11:17 AM
To: Bruce Thomas
Cc: Jennifer Diaz
Subject: RE: 365 Forest -Stormwater Management Criteria



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Bruce,

Please find some responses embedded in two of your emails below.

Please let me know if you have any other questions.

Kind regards,

Ghislaine

Ghislaine Miliu, P.Eng

Project Manager – Infrastructure Planning
Asset Management Branch
City of Ottawa | Ville d'Ottawa

From: Bruce Thomas <bruce.thomas@exp.com>
Sent: October 12, 2021 12:06 PM
To: Miliu, Ghislaine <ghislaine.miliu@ottawa.ca>
Cc: Jennifer Diaz <jennifer.diaz@exp.com>
Subject: RE: 365 Forest -Stormwater Management Criteria

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Ghislaine,

Hope you had a great Thanksgiving weekend. Thanks for your response below.

Yes, we wish to exclude the uncontrolled drainage areas from the 10mm retention requirement, as it is would be very difficult collect the runoff.

For the larger events we would be ok with over controlling the release rate from other areas of the site, to account for the uncontrolled areas.

RESPONSE: Yes, for this project (given the outlet of the STM sewers system to Ottawa River), the small area of uncontrolled drainage may be excluded from meeting the 10 mm retention.

Please let us know when you discuss with your colleagues.

Thanks,

Bruce

Bruce Thomas, P.Eng.

EXP | Senior Project Manager

t : +1.613.688.1899 | m : +1.613.852.8753 | e : bruce.thomas@exp.com

[exp.com](#) | [legal disclaimer](#)

keep it green, read from the screen

From: Miliu, Ghislaine <ghislaine.miliu@ottawa.ca>

Sent: Thursday, October 7, 2021 3:39 PM

To: Bruce Thomas <bruce.thomas@exp.com>

Cc: Jennifer Diaz <jennifer.diaz@exp.com>

Subject: RE: 365 Forest -Stormwater Management Criteria



CAUTION: This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Bruce (and Jennifer),

Re the uncontrolled drainage areas: is your question whether these areas be excluded from the 10 mm retention requirement **OR** are you asking if they can be excluded from the 10 mm retention requirement **AND** if runoff from these areas not contribute towards allowable release rate?

Once I hear back from you then I will reach out to my colleagues.

Thanks.
Ghislaine

From: Bruce Thomas <bruce.thomas@exp.com>

Sent: October 07, 2021 3:18 PM

To: Miliu, Ghislaine <ghislaine.miliu@ottawa.ca>

Cc: Jennifer Diaz <jennifer.diaz@exp.com>; Carmine Zayoun <carmine@zayoungroup.com>;

rakrawi@groupeheafey.com; Christian Rheault <C.Rheault@lrarch.ca>; Angel Rangel

<arangel@quadrantengineering.ca>; B. L. A. Mike Lennox (ml@jbla.ca) <ml@jbla.ca>

Subject: 365 Forest -Stormwater Management Criteria

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Ghislaine,

Thank you for meeting with us to provide guidance on the requirements provided within the “Stormwater Management Guidelines for the Pinecrest/Westboro Area Final Report” as they relate to the planned development at 365 Forest Street.

As per our discussion, we request further clarification on the following:

1. The referenced SWM guidelines states that the 10 mm design storm is to be retained. Please confirm whether it would be acceptable to provide measures for excess retention in one area to account for areas with uncontrolled flow. i.e. capture +/- first 20mm on the roof. Is it possible to have a very restrictive release rate for the site/portion of the site that would drain the 10mm storm over a longer time frame of say a few days?

RESPONSE: Yes, for this project (given the outlet of the STM sewers system to Ottawa River) we will accept the provision for excess retention in one area to account for areas with uncontrolled flow. Similar to the Feedmill Creek retention criteria, please account for initial abstraction contributing towards the retention target.

2. Our current design for quantity control allows for overcontrol of the runoff from the roof area to account for small uncontrolled areas adjacent to the City right of way (Forest St and Bond St). Due to limitations on grading, location, size and existing conditions, would the City be agreeable to these areas remaining uncontrolled? i.e. not retaining the 10 mm storm at these locations?

RESPONSE: Please see October 12, 2021 clarification and City response.

3. Could you provide City contacts in the Buildings Department for our team to discuss the City’s preferred/acceptable methods for reuse of the captured stormwater (watering, maintenance/cleaning, reuse as greywater, etc.).

RESPONSE: For this project (given the outlet of the STM sewers system to Ottawa River), please identify as many opportunities to retain the first 10 mm onsite (where it makes sense). Unfortunately, the City does not have guidelines specific to water re-use systems (especially within the building). If infiltrating does not make sense (i.e subsurface infiltration LID on top of the parking garage), then please consider simple surface type LID that provide opportunities for evapotranspiration (designed to not cause nuisances like mosquito breeding grounds) or re-use systems that make sense for the site (i.e. water re-use for landscape irrigation). If 10 mm cannot be achieved on the entire site (excluding the small uncontrolled areas) then justify why not.

4. During pre-consultation with the City and Conservation Authority for this project, it was noted that quality control for the site was not required. The above noted guidelines require 80% TSS removal. There is limited area on site for vehicle use (lane and turning circle). Please verify quality control requirements.

RESPONSE: Please provide enhanced quality control (to treat runoff from surfaces with vehicular traffic). The sizing of the unit may be based on the area draining to the unit. If Rooftop runoff is not directed to the OGS then the Rooftop area can be excluded from the sizing of the OGS unit. If landscape runoff is not directed to the OGS unit then the OGS unit does not need to be sized including landscape area.

Thank you, we look forward to your reply.

Regards,



Bruce Thomas, P.Eng.

EXP | Senior Project Manager

t : +1.613.688.1899 | m : +1.613.852.8753 | e : bruce.thomas@exp.com

2650 Queensview Drive

Suite 100

Ottawa, ON K2B 8H6

CANADA

exp.com | [legal disclaimer](#)

keep it green, read from the screen

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,

,

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

,



Appendix F – Background Information

City of Ottawa Vault Drawings (Plan and Profiles)

WATTS ACCUTROL Weir for Roof Drains

Excerpt page (pages 7-18) from Implementation Guide for the Pinecrest Creek / Westboro SWM Guidelines: Development Requiring a Building Permit Only. (Draft) Aquafor Beach, June 21, 2013.

BOND ST.

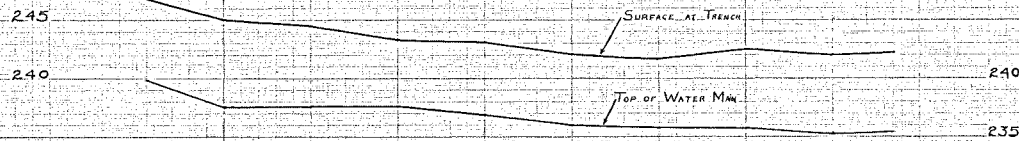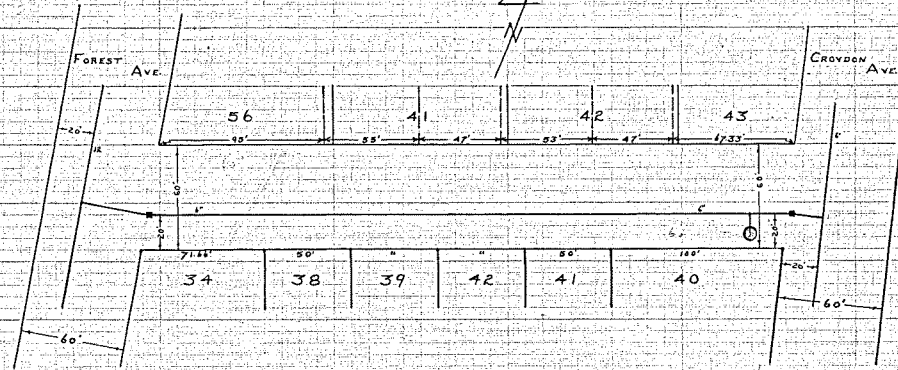

0-415-51/2" 20# @ Forest

0-04 1" VALVE
0-100

1-00

2-00


3-00

3-140 HYD II OFE WM

3-164 1" VALVE

3-186 1 1/4" 150# @ Crofton

CITY OF OTTAWA WATER WORKS DEPARTMENT	
6" WM INSTALLED ON BOND ST FROM FOREST AVE. TO CROFTON AVE.	
OWN BY <i>L. J. Irvine</i>	DATE: JAN 29/60
<i>P. S. Smith</i> ENGINEER	SCALE: HORIZ. 1" = 40' VERT. 1" = 4'
<i>Atorney</i> DEPUTY COMMISSIONER	INSTALLED SEPT. 1959
<i>H. S. Perkins</i> ENGINEER OF WATER WORKS	BOOK NO. 170

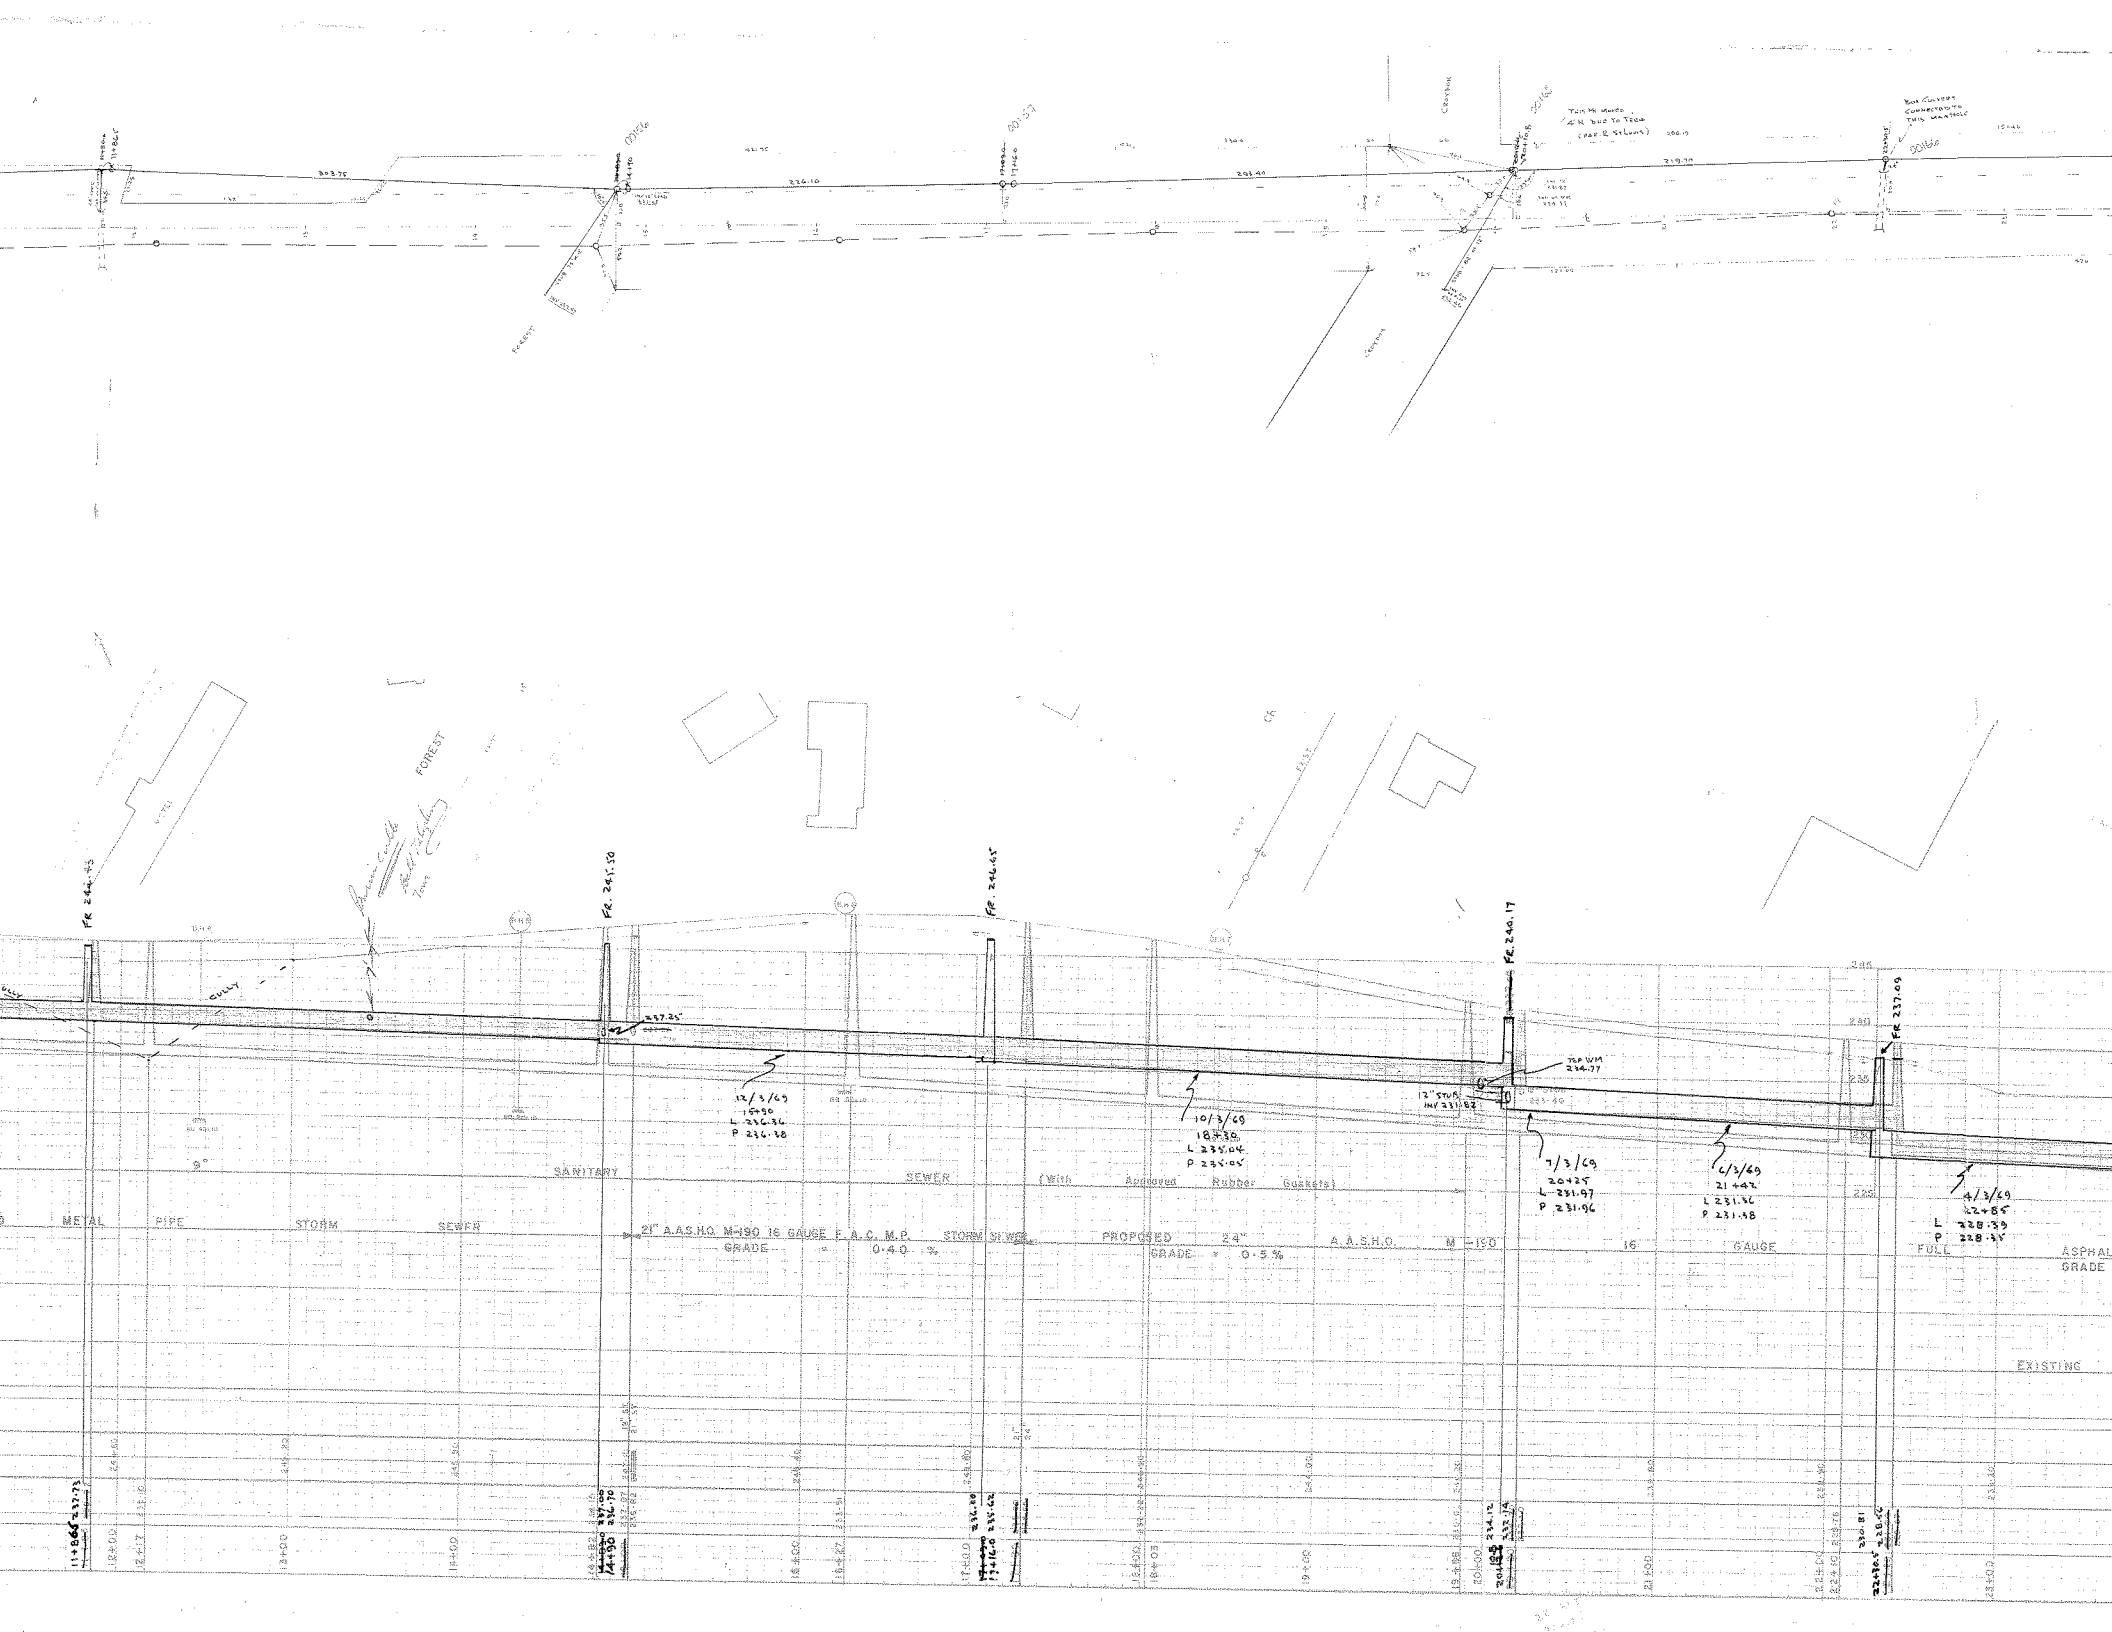



Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control for Roof Drains



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
 Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

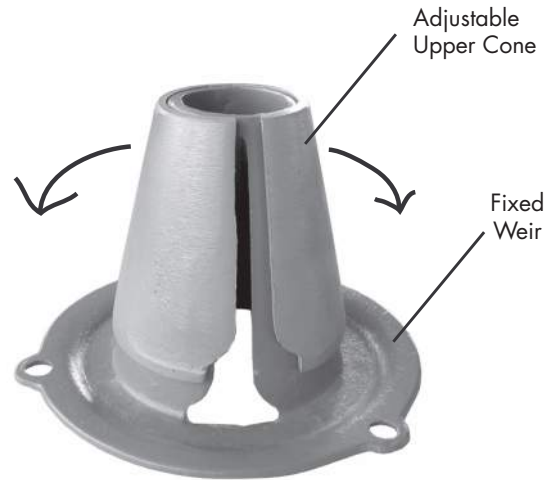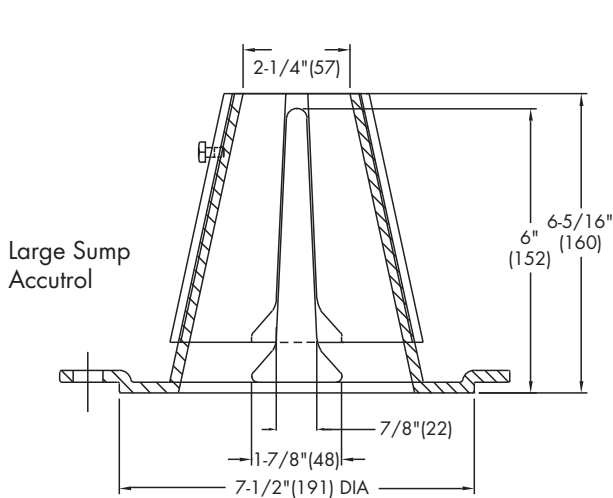

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____
 Job Location _____
 Engineer _____

Contractor _____
 Contractor's P.O. No. _____
 Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com
 Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca
 Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com



**Excerpt page (pages 7-18) from
Implementation Guide for the Pinecrest
Creek / Westboro SWM Guidelines:
Development Requiring a Building Permit
Only. (Draft) Aquafor Beach, June 21, 2013.
(total 12 pages)**

3.0 Post Construction Topsoil Amendment: General Requirements

Amended topsoil shall be considered in compliance with Section 3.4 of the JFSA, 2012 report, pursuant to the following general requirements.

1. Post Construction Topsoil Amendment shall be defined as
 - a. Decompaction activities (subsoil scarification, tilling and or ripping) followed by the placement of 300mm of amended topsoil
 - b. At project completion all landscaped areas (front and rear yard) shall have a minimum depth of 300mm of amended topsoil containing organic matter primarily leaf, yard and bark waste compost of 8-15% by dry weight, or 30-40% by volume and a pH of 6.0 to 8.0 per the recommendations of the Low Impact Development Stormwater Management Planning and Design Guide (TRCA/CVC 2010 Version 1.0).
2. Front and rear yard grading should be limited to a maximum of 2%, if possible while still meeting the surrounding existing grades. Grading shall conform to City standards and by-laws.
3. Organic matter shall be measured using a standard Loss-On-Ignition Test (ASTM D2974, MOE E3139 or TMECC 05.07A or equivalent)
4. The source of the organic content shall conform to the following guidelines which regulates the quality and use of compost in the province (Appendix B):
 - The Guidelines for the Production and Use of Aerobic Compost in Ontario (2004), Ministry of the Environment (OMOE)
 - Guidelines for Compost Quality (2005), Canadian Council of Ministers of the Environment (CCME)
5. Organic matter shall not contain uncomposted manure or other organic materials, sphagnum peat or organic amendments that contain sphagnum peat
6. Decompaction activities (subsoil scarification, tilling and or ripping) as well as amendment shall not be undertaken on wet or frozen soils
7. Decompaction activities shall not be undertaken within 3m of building foundations to limit the risk of water infiltration into basements (Figure 2)
8. Standard tree protection shall be mandatory per the Standard Tree Protection Forestry By-law 2006-279 and Special Provision No. F-5651. Decompaction activities and soil amendment shall not be undertaken within the critical root zone or dripline of existing trees (See Figure 2) per City of Ottawa Definition of Critical Root Zone (Forestry By-law 2006-279). The dripline shall be defined as the area of land within a radius of ten (10) cm from the trunk of a tree for every one (1) cm of trunk diameter measured from the ground surface at a height of:
 - one-hundred and twenty (120) cm for trees fifteen (15) cm in diameter or greater
 - thirty (30) cm for trees of less than fifteen (15) cm in diameter

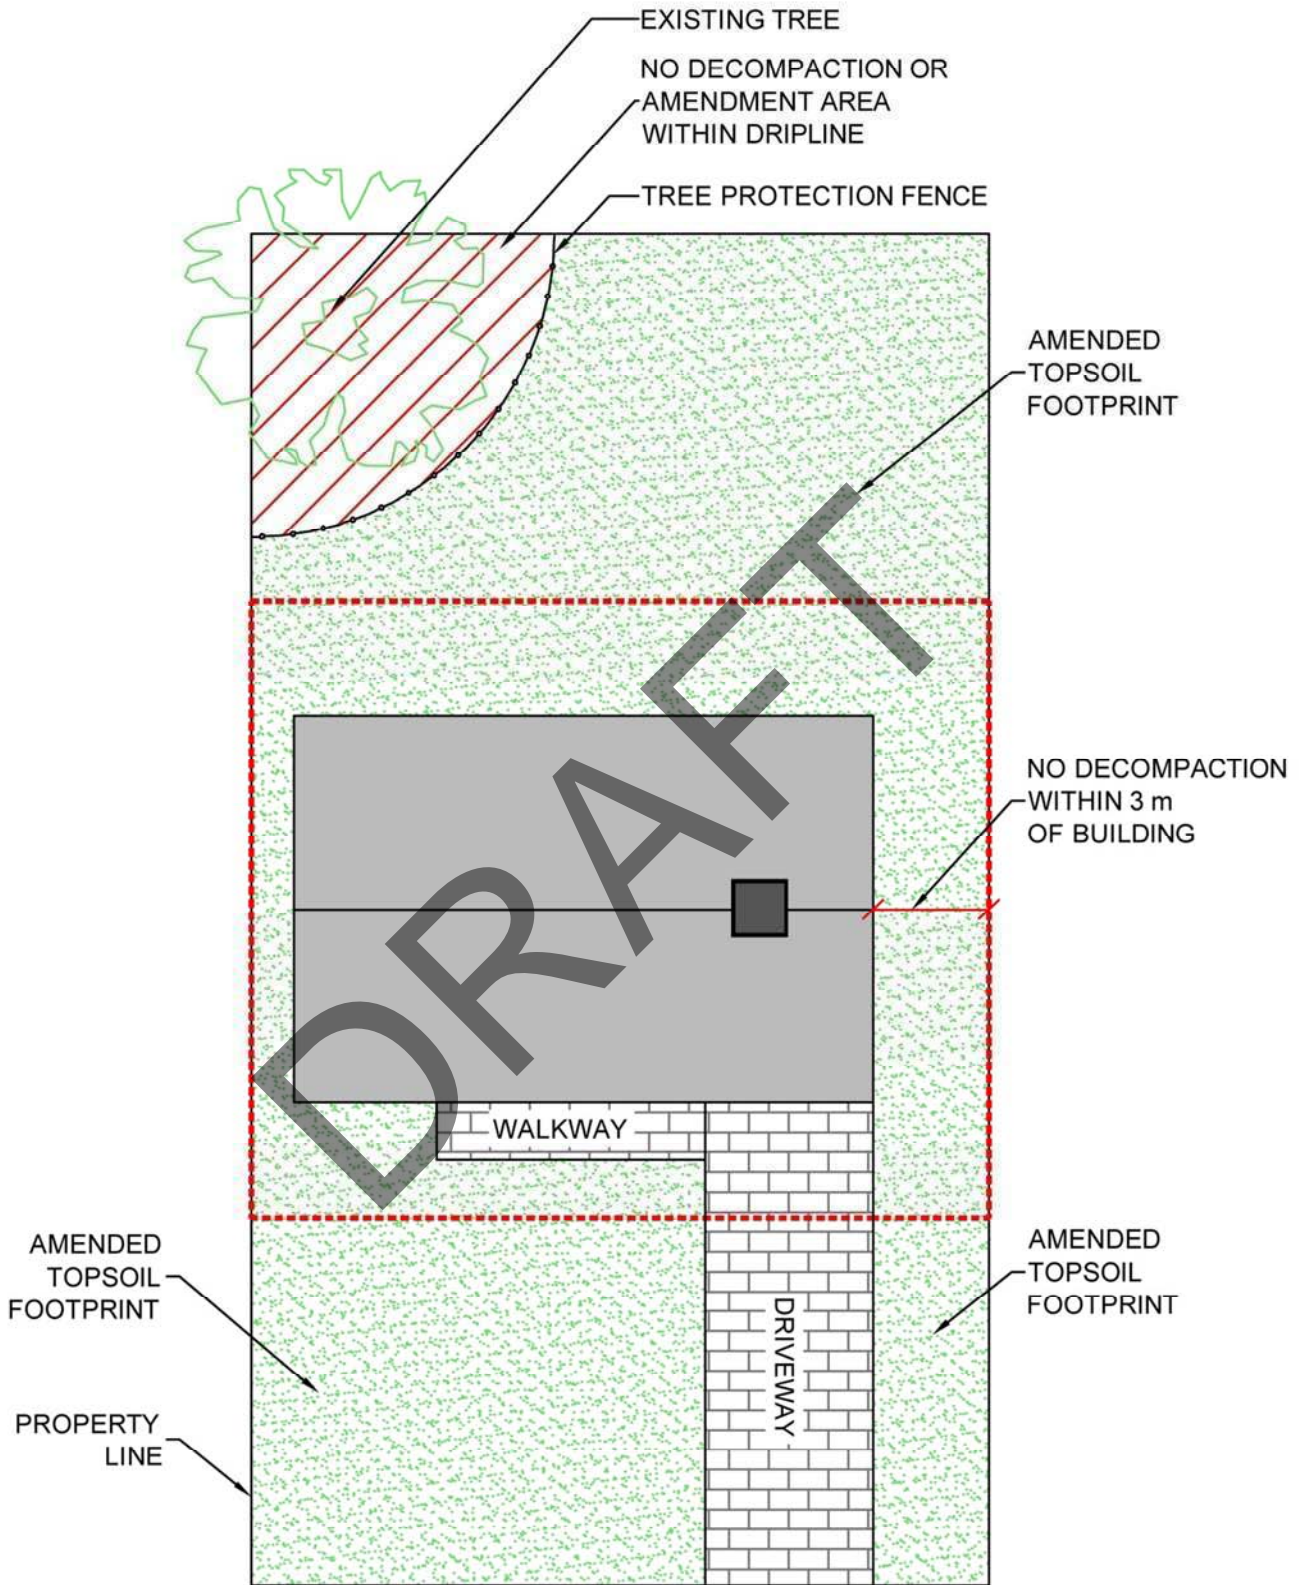


Figure 2 Site requirements for Pinecrest Creek and Westboro Area for Development Requiring a Building Permit Only

4.0 Compliance Pathways

The following sections outline the three (3) compliance pathways (see Figure 4.0) per the SWM requirements for Pinecrest Creek/Westboro Area For Development Requiring a Building Permit Only outlined in Table 1 pursuant to the general requirement detailed in Section 3.0. The three (3) compliance pathways include:

1. Amend existing topsoil using the default ratio of 3:1 (topsoil: amended materials)
2. Amend existing topsoil using a custom calculated ratio (laboratory testing required, must be submitted with building permit and certified by architect or engineer)
3. Import & replace existing topsoil with pre-mixed amended topsoil

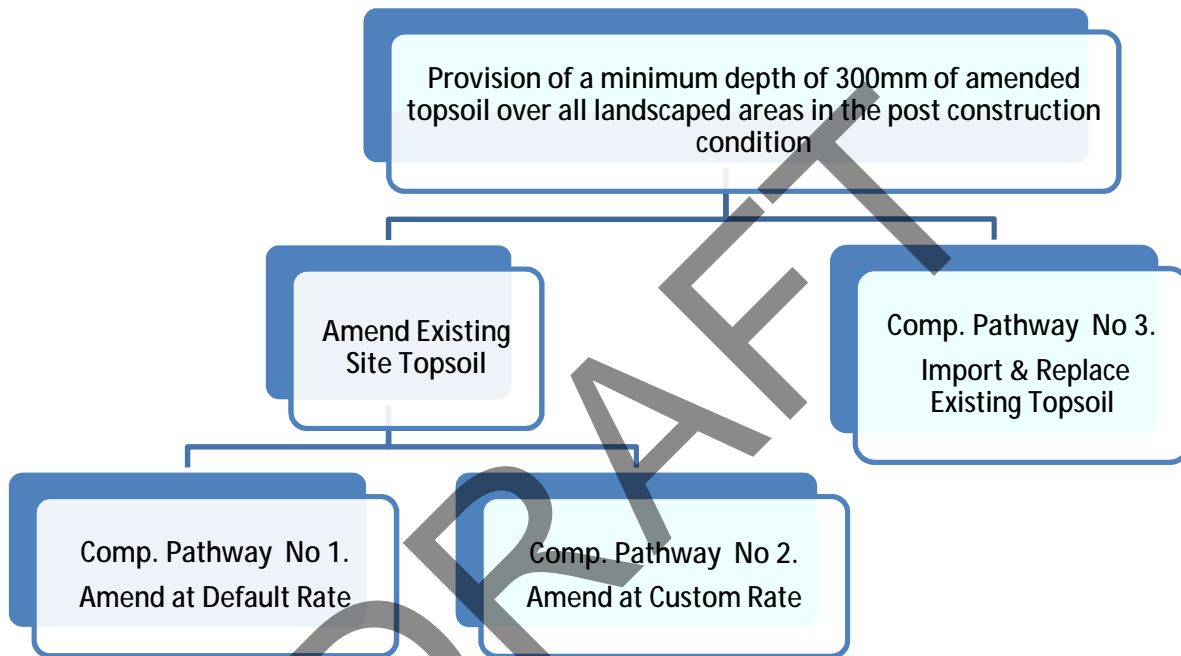


Figure 4.0 SWM Compliance Pathway Flowchart – Topsoil Amendment

It should be noted that composting facilities in Ontario (municipal and private) must perform standard laboratory testing in order to comply with the aforementioned regulations (see Section 3.0) and ensure that compost that is sold or given away is a consistent, high quality product that is safe for all uses. As such, suppliers in the Ontario, including in the Ottawa area generally do not sell 'raw compost' directly to the public or development industry, but instead mix composted material into secondary products. These secondary products or mixes (hereto referred to as amendment materials) do not fall within the OMOE (2004) or CCME (2005) regulations and can be sold directly to the public and development industry. These mixes are largely proprietary, and are sold under a variety of names and products types. Amendment Materials products generally consist of a mix of one or more of the following:

- Leaf and yard waste compost,
- Aged bark compost,
- Mushroom compost
- Black peat moss
- Topsoil and sands

It is not important what proprietary mix is used provided it meets the general requirements as detailed within Section 3.0 and the material specification requirements as detailed within the relevant options (Section 4.1 – 4.3).

It should be further noted that as a conservative estimate, organic matter content will decrease by 25% after the first growing season as plant materials become established. Options 1, 2 and 3 in the following sections take into account this anticipated decline.

DRAFT

4.1 Option 1 - Amend Existing Topsoil Using Default Ratio

If the default amendment material ratio is used, laboratory testing of in-situ pre-construction topsoil and custom calculations are not required.

General Actions

Strip, stockpile and preserve topsoil during construction and replace and amend per the general requirements detailed in Section 3.0.

Steps to Compliance

1. Remove existing topsoil and preserve on-site as stockpile to be re-instated after construction. Stockpiled material shall be free of large woody materials, construction waste and debris.
2. Where possible, stockpile height is recommended not to exceed 1.3m in height. On small sites stockpile height is recommended not to exceed 3m (ASHTO, 2011) in height. This is to preserve soil structure and prevent the loss of beneficial soil organisms.
3. Stockpiled areas shall have appropriate erosion and sediment controls per the relevant City policies and by-laws. As a minimum they shall be encircled with a light duty silt fence barrier in accordance with OPSD 219.110, sediment filter sock or equivalent.
4. Following construction, native sub-soil shall be decompacted at a depth of 100-200mm. Decompaction activities shall be undertaken using a perpendicular pattern (north-south, followed by east-west) ensuring full site coverage. No decompaction within tree protection areas or within 3m of building foundations - see exception under general requirements). The following methods for decompaction may be used :
 - Rototiller of appropriate size capable of decompacting the required minimum depth
 - Skid steer, mini-excavator or small backhoe – utilize bucket teeth to decompact to the required minimum depth
 - Small subsoiler or chisel plough (typically for larger infill sites)
5. Amendment material shall be obtained from a Compost Quality Assurance (COA) licensed and OMOE/ CCME approved facility and shall comply with the Category “A” compost designation. The amendment material must contain:
 - 20- 30% organic matter by dry-weight (equals 20-30% organic matter Loss-on-ignition test (LOI) per the most current version of ASTM D2974, MOE E3139 or TMECC 05.07A or equivalent.
 - pH of 6.0 to 8.0
 - No uncomposted manure or other organic materials, sphagnum peat or organic amendments that contain sphagnum peat (see General Requirement No. 5).

Note: Site Owner must retain delivery tickets, receipts and specifications detailing the delivery address, quantities and product description and sources for verification by City inspectors. Suppliers must provide owner with documentation regarding typical particle size distribution, soil texture classification, bulk density and organic matter content. Delivery address is to be listed and must correspond to the property/site being inspected. Site without proper documentation may be subject to additional verification procedures including laboratory testing at the expense of the owner.

6. Amend existing site topsoil to meet post construction soil amendment requirements using 3:1 ratio by volume (topsoil: amendment material).

Two (2) methods for amending the existing soils in place are acceptable:

Method No.1 - Layer and Incorporate

- i. Apply 100mm of existing site topsoil followed by 50mm of amendment material and incorporate amended material through tilling using decompaction methods outlined in Step 4.
- ii. Lightly roll or smooth using the back of the machinery bucket.
- iii. Repeat i. and ii.
- iv. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading

Method No.2 – Mechanical or Bucket Mix

- i. Successively add, mix and pile one (1) unit of amendment material with three (3) unit of existing site topsoil.
- ii. Thoroughly mix
- iii. Repeat i. and ii.
- iv. Place 150mm of amended topsoil, lightly roll or smooth using the back of the machinery bucket
- v. Repeat iv.
- vi. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading

Amended topsoil should be wetted after application, allowed to settle for a minimum of one (1) week and grades adjusted as required prior to installation of turf.

4.2 Option 2 - Amend Existing Topsoil Using a Custom Calculated Rate

Default amendment material rates are not used. Custom amendment ratio and volume are calculated, using the Custom Amendment Material Application Ratio Equations or Excel Spreadsheet Calculator (Appendix C). Calculations must be submitted as an attachment to the building permit, prior to undertaking site works.

Note: Accredited laboratory testing of existing topsoil is required prior to submission of building permit. Collect soil samples from three (3) locations evenly distributed across the site. Combine and mix thoroughly to produce one (1) composite sample of approximately 2L or 600gram. Store in a sealed, labelled container and submit to a local accredited laboratory. Check with the laboratory for specific instruction and quantities of sample required. Submit the sample for analysis for the following parameters:

- Bulk density (g/cm^3)
- Existing soil organic matter content (%) as determined by Loss-On-Ignition Test (see General Requirements No. 3)
- pH
- Particle size distribution (i.e. % sand, % silt and % clay)

The supplier of the amendment material is to provide the following specification/results as determined by an accredited laboratory.

- Amendment materials bulk density (g/cm^3)
- Amendment materials Organic Matter Content (%) as determined by Loss-On-Ignition Test (see General Requirements No. 3)

General Actions

Strip, stockpile and preserve topsoil during construction and replace and amend per custom rates calculated prior to building permit submission.

Steps to Compliance

1. Remove existing topsoil and preserve on-site as stockpile to be re-instated after construction. Stockpiled material shall be free of large woody materials, construction waste and debris.
 2. Where possible, stockpile height is recommended not to exceed 1.3m in height. On small sites stockpile height is recommended not to exceed 3m (ASHTO, 2011) in height. This is to preserve soil structure and prevent the loss of beneficial soil organisms.
 3. Stockpiled areas shall have appropriate erosion and sediment controls per the relevant City policies and by-laws. As a minimum they shall be encircled with a light duty silt fence barrier in accordance with OPSD 219.110, sediment filter sock or equivalent.
1. Following construction, native sub-soil shall be decompacted at depth of 100-200mm. Decompaction activities shall be undertaken using a perpendicular pattern (north-south, followed by east-west) ensuring full site coverage. No decompaction within tree protection areas or within 3m of building foundations - see exception under general requirements). The following methods for decompaction may be used :
 - Rototiller of appropriate size capable of decompacting the required minimum depth

- Skid steer, mini-excavator or small backhoe – utilize bucket teeth to decompact to the required minimum depth
 - Small subsoiler or chisel plough (typically for larger infill sites)
4. Amendment material shall be obtained from a Compost Quality Assurance (CQA) licensed and OMOE/ CCME approved facility and shall comply with the Category “A” compost designation. The amendment material must have a pH of 6.0 to 8.0 and contain no uncomposted manure or other organic materials, sphagnum peat or organic amendments that contain sphagnum peat (see General Requirement No. 5).

Note: Site Owner must retain delivery tickets, receipts and specifications detailing the delivery address, quantities and product description and sources for verification by City inspectors. Suppliers must provide owner with documentation regarding typical particle size distribution, soil texture classification, bulk density and organic matter content. Delivery address is to be listed and must correspond to the property/site being inspected. Site without proper documentation may be subject to additional verification procedures including laboratory testing at the expense of the owner.

7. Amend existing site topsoil to meet post construction soil amendment requirements per the custom amendment rate and volume as submitted with the respective building permit.

Two (2) methods for amending the existing soils in place:

Method No.1 - Layer and Incorporate

- i. Apply 100mm of existing site topsoil followed by 50mm of custom amendment material and incorporate amended material through tilling using decompaction methods outlined in Step 4.
- ii. Lightly roll or smooth using the back of the machinery bucket
- iii. Repeat i. and ii.
- iv. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading

Method No.2 – Mechanical or Bucket Mix

- i. Successively add, mix and pile custom amendment material and existing site topsoil per the calculated ratio.
- ii. Thoroughly mix
- iii. Repeat i. and ii.
- iv. Place 150mm of amended topsoil, lightly roll or smooth using the back of the machinery bucket
- v. Repeat iv.
- vi. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading

Amended topsoil should be wetted after application, allowed to settle for a minimum of one (1) week and grades adjusted as required prior to installation of turf.

4.3 Option 3 – Import & Replace Existing Topsoil with Pre-Mixed Amended Topsoil

General Actions

Replace existing site topsoil with imported pre-mixed amended topsoil per the general requirements detailed in Section 3.0.

Steps to Compliance

1. Remove existing site topsoil and dispose off-site accordance with OPSS 206 and OPSS 180, O. Reg. 153/06, the Environmental Protection Act or municipal by-laws and policies, whichever governs.
2. Following construction, native sub-soil shall be decompacted at depth of 100-200mm. Decompaction activities shall be undertaken using a perpendicular pattern (north-south, followed by east-west) ensuring full site coverage. No decompaction within tree protection areas or within 3m of building foundations - see exception under general requirements). The following methods for decompaction may be used :
 - Rototiller of appropriate size capable of decompacting the required minimum depth
 - Skid steer, mini-excavator or small backhoe – utilize bucket teeth to decompact to the required minimum depth
 - Small subsoiler or chisel plough (typically for larger infill sites)
2. Import pre-mixed amended topsoil in sufficient quantity (amendment area (m²) x 0.3m required depth + 10% for settlement) to achieve settled amended topsoil depth of 300mm with the following characteristics in accordance with the General requirements detailed in Section 3.0.

Amendment material shall be obtained from a Compost Quality Assurance (CQA) licensed and OMOE/ CCME approved facility and shall comply with the Category “A” compost designation. The amendment material must contain:

- 8-15% organic matter by dry-weight (equals 8-15% organic matter Loss-on-ignition test (LOI) per the most current version of ASTM D2974, MOE E3139 or TMECC 05.07A or equivalent.
- pH of 6.0 to 8.0
- No uncomposted manure or other organic materials, sphagnum peat or organic amendments that contain sphagnum peat (see General Requirement No. 5).

Note: Site Owner must retain delivery tickets, receipts and specifications detailing the delivery address, quantities and product description and sources for verification by City inspectors. Suppliers must provide owner with documentation regarding typical particle size distribution, soil texture classification, bulk density and organic matter content. Delivery address is to be listed and must correspond to the property/site being inspected. Site without proper documentation may be subject to additional verification procedures including laboratory testing at the expense of the owner.

3. Place imported pre-mixed amended topsoil in 150mm lifts, lightly roll or smooth using machinery bucket and repeat. Adjust layer quantities to ensure a settled amended topsoil depth of 300mm and compliance with site grading

Amended topsoil should be wetted after application, allowed to settle for a minimum of one (1) week and grades adjusted as required prior to installation of turf.

5.0 Verification Requirements

Verification by municipal staff shall be a critical component of the Stormwater Management Guidelines for Pinecrest Creek/Westboro Area for Development Requiring a Building Permit Only. Verification will confirm:

1. Amended soil quality
2. Amended soil depth
3. Compliance with site grading and
4. Disconnection of redirection to pervious areas

Verification Timing

Verification may occur after the minimum one (1) week settlement period and after grades have been adjusted, but may occur before or after the installation of turf. If non-compliance is confirmed, the contractor/owners shall be responsible for rectification including replacement of turf as required. As such, verification is suggested prior to turf placement.

Documentation Verification - Amended Soil Quality

As part of verification, the owners shall produce delivery tickets, receipts and specifications detailing the delivery address, quantities and product description and sources for verification by City inspectors. Delivery address is to be listed and must correspond to the property/site being inspected. Sites without proper documentation may be subject to additional verification procedures including laboratory testing at the expense of the owner.

Amended Soil Depth Verification

At random, the site inspector shall dig at least one (1) test hole within the amended topsoil area to verify amended topsoil depth and uncompacted soil depths. Test holes can be dug using a common garden spade or a small diameter coring unit (i.e. Ogeechee corer[®]) see inset photo. Test holes may be up to 30cm in diameter and shall extend a minimum of 400mm.

Requirements:

1. Amended topsoil layer shall be easily dug using only the inspector's weight or cored without other mechanical assistance.
2. The amended topsoil layer shall be darker in color than the unamended- decompacted subsoil and particles of organic matter should be easily visible.
3. Measured amended topsoil depths shall be deemed to be in conformance based on the following:
 - Using a common garden spade, the measured depth of amended topsoil is greater than or equal to ± 25 mm of the required 300mm depth (see Figure 5.0)
 - Using a small diameter coring unit, the measured core depth of amended topsoil shall be equal to ± 50 mm of the required 300mm depth (see Figure 5.1)



Note: \pm accounts for minor compaction resulting from various testing methods. A field inspection form is provided in Appendix D.



Figure 5.0 – Field Verification of Topsoil Depths using Common Garden Spade (Aquafor Beech, 2011)



Figure 5.1 – Field Verification of Topsoil Depths using Small Diameter Coring Unit (3 cm diameter core is displayed) (Aquafor Beech, 2011)

Verification of Downspouts Redirection to Pervious Areas and Site Grading Compliance

The City inspector shall verify that:

- Proper direction of the downspouts/ roof drainage to landscaped area to minimize runoff has been completed
- Where possible, a minimum flow path length of 5m across a pervious surface before flowing onto an impervious surface, or into a storm sewer system has been included.
- All discharge locations have a minimum of 3m from building foundations and directed to pervious surface. If no pervious surface is available, downspouts may be run subsurface and discharged as a `pop-up` outlet to nearest pervious surface (see Figure 5.2).

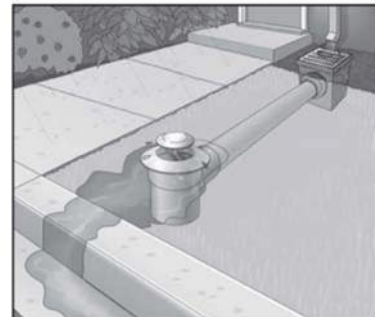


Figure 5.2 Pop-up emitter (source NDS, 2011)

- Wherever possible, front and rear yard grading has been limited to a maximum of 2%, while still meeting the surrounding existing grades. Grading shall conform to other City standards and by-laws.

Non-compliant Sites and Disputes

If a site is deemed by the inspector as non-compliant with the aforementioned requirements the site inspector shall:

- Notify the owner of what steps are needed to comply and provide guidance or clarification as required.

When results are disputed and cannot be resolved between the owner and the City, an independent consultant shall be contracted to conduct verification and sampling for submission for laboratory analysis and may include:

- Bulk density (g/cm^3)
- organic matter content (%) as determined by Loss-On-Ignition Test (see General Requirements No. 3)
- pH
- Particle size distribution (i.e. % sand, % silt and % clay)

Qualified consultants include soil scientists, landscape architects, or professional engineers.

DRAFT

Appendix G – Checklist

GENERAL CONTENT		RESPONSE
<input type="checkbox"/>	Executive Summary (for larger reports only).	Not included
<input checked="" type="checkbox"/>	Date and revision number of the report.	Date of report provided
<input checked="" type="checkbox"/>	Location map and plan showing municipal address, boundary, and layout of proposed development.	Page 1 and Appendix G
<input checked="" type="checkbox"/>	Development statistics, land use, density, adherence to zoning and official plan, and reference to applicable subwatershed and watershed plans that provide context to which individual developments must adhere.	Section 2 of report
<input checked="" type="checkbox"/>	Summary of Pre-consultation Meetings with City and other approval agencies.	In Appendix E
<input type="checkbox"/>	Reference and confirm conformance to higher level studies and reports (Master Servicing Studies, Environmental Assessments, Community Design Plans), or in the case where it is not in conformance, the proponent must provide justification and develop a defensible design criteria.	No Master Servicing Studies.
<input checked="" type="checkbox"/>	Statement of objectives and servicing criteria.	Section 1 of report
<input checked="" type="checkbox"/>	Identification of existing and proposed infrastructure available in the immediate area.	Section 2 & 3 of report
<input type="checkbox"/>	Identification of Environmentally Significant Areas, watercourses and Municipal Drains potentially impacted by the proposed development (Reference can be made to the Natural Heritage Studies, if available).	Not applicable
<input type="checkbox"/>	Concept level master grading plan to confirm existing and proposed grades in the development. This is required to confirm the feasibility of proposed stormwater management and drainage, soil removal and fill constraints, and potential impacts to neighbouring properties. This is also required to confirm that the proposed grading will not impede existing major system flow paths.	Not applicable
<input type="checkbox"/>	Identification of potential impacts of proposed piped services on private services (such as wells and septic fields on adjacent lands) and mitigation required to address potential impacts.	Not applicable
<input type="checkbox"/>	Proposed phasing of the development, if applicable.	Not applicable
<input type="checkbox"/>	Reference to geotechnical studies and recommendations concerning servicing.	Not applicable
<input checked="" type="checkbox"/>	All preliminary and formal site plan submissions should have the following information: Metric scale North arrow (including construction North) Key plan name and contact information of applicant and property owner Property limits including bearings and dimensions Existing and proposed structures and parking areas Easements, road widening and rights-of-way Adjacent street names	Functional Report, Civil and Architectural Plans provided all this information.
DEVELOPMENT SERVICING REPORT: WATER		RESPONSE
<input type="checkbox"/>	Confirm consistency with Master Servicing Study, if available Availability of public infrastructure to service proposed development Identification of system constraints	Not applicable
<input checked="" type="checkbox"/>	Identify boundary conditions	Section 4.6
<input checked="" type="checkbox"/>	Confirmation of adequate domestic supply and pressure	Section 4.3
<input checked="" type="checkbox"/>	Confirmation of adequate fire flow protection and confirmation that fire flow is calculated as per the Fire Underwriter's Survey. Output should show available fire flow at locations throughout the development.	Section 4.7
<input checked="" type="checkbox"/>	Provide a check of high pressures. If pressure is found to be high, an assessment is required to confirm the application of pressure reducing valves.	Section 4.6 & Table B-5 Appendix B
<input type="checkbox"/>	Definition of phasing constraints. Hydraulic modeling is required to confirm servicing for all defined phases of the project including the ultimate design	Not applicable
<input checked="" type="checkbox"/>	Address reliability requirements such as appropriate location of shut-off valves Check on the necessity of a pressure zone boundary modification.	Section 4.3
<input checked="" type="checkbox"/>	Reference to water supply analysis to show that major infrastructure is capable of delivering sufficient water for the proposed land use. This includes data that shows that the expected demands under average day, peak hour and fire flow conditions provide water within the required pressure range	Section 4.5 & Table B-1 Appendix B
<input checked="" type="checkbox"/>	Description of the proposed water distribution network, including locations of proposed connections to the existing system, provisions for necessary looping, and appurtenances (valves, pressure reducing valves, valve chambers, and fire hydrants) including special metering provisions.	Section 4.2

<input type="checkbox"/>	Description of off-site required feeder mains, booster pumping stations, and other water infrastructure that will be ultimately required to service proposed development, including financing, interim facilities, and timing of implementation.	Not applicable
<input checked="" type="checkbox"/>	Confirmation that water demands are calculated based on the City of Ottawa Design Guidelines.	Table B-1 Appendix B
<input type="checkbox"/>	Provision of a model schematic showing the boundary conditions locations, streets, parcels, and building locations for reference.	Not applicable
DEVELOPMENT SERVICING REPORT: WASTEWATER		RESPONSE
<input checked="" type="checkbox"/>	Summary of proposed design criteria (Note: Wet-weather flow criteria should not deviate from the City of Ottawa Sewer Design Guidelines. Monitored flow data from relatively new infrastructure cannot be used to justify capacity requirements for proposed infrastructure).	Section 5.1
<input type="checkbox"/>	Confirm consistency with Master Servicing Study and/or justifications for deviations.	Not applicable
<input checked="" type="checkbox"/>	Consideration of local conditions that may contribute to extraneous flows that are higher than the recommended flows in the guidelines. This includes groundwater and soil conditions, and age and condition of sewers.	Section 5.2
<input checked="" type="checkbox"/>	Description of existing sanitary sewer available for discharge of wastewater from proposed development.	Section 5.2
<input type="checkbox"/>	Verify available capacity in downstream sanitary sewer and/or identification of upgrades necessary to service the proposed development. (Reference can be made to previously completed Master Servicing Study if applicable)	Not applicable
<input checked="" type="checkbox"/>	Calculations related to dry-weather and wet-weather flow rates from the development in standard MOE sanitary sewer design table (Appendix 'C') format.	Table C-6 in Appendix C
<input checked="" type="checkbox"/>	Description of proposed sewer network including sewers, pumping stations, and forcemains.	Section 5.2
<input type="checkbox"/>	Discussion of previously identified environmental constraints and impact on servicing (environmental constraints are related to limitations imposed on the development in order to preserve the physical condition of watercourses, vegetation, soil cover, as well as protecting against water quantity and quality).	Not applicable
<input type="checkbox"/>	Pumping stations: impacts of proposed development on existing pumping stations or requirements for new pumping station to service development.	Not applicable
<input type="checkbox"/>	Forcemain capacity in terms of operational redundancy, surge pressure and maximum flow velocity.	Not applicable
<input type="checkbox"/>	Identification and implementation of the emergency overflow from sanitary pumping stations in relation to the hydraulic grade line to protect against basement flooding.	Not applicable
<input type="checkbox"/>	Special considerations such as contamination, corrosive environment etc.	Not applicable
DEVELOPMENT SERVICING REPORT: STORMWATER CHECKLIST		RESPONSE
<input checked="" type="checkbox"/>	Description of drainage outlets and downstream constraints including legality of outlets (i.e. municipal drain, right-of-way, watercourse, or private property)	Section 6
<input type="checkbox"/>	Analysis of available capacity in existing public infrastructure.	Not applicable
<input checked="" type="checkbox"/>	A drawing showing the subject lands, its surroundings, the receiving watercourse, existing drainage patterns, and proposed drainage pattern.	Figure A-1 & A-2
<input type="checkbox"/>	Water quantity control objective (e.g. controlling post-development peak flows to pre-development level for storm events ranging from the 2 or 5 year event (dependent on the receiving sewer design) to 100 year return period); if other objectives are being applied, a rationale must be included with reference to hydrologic analyses of the potentially affected subwatersheds, taking into account long-term cumulative effects.	Not Applicable
<input type="checkbox"/>	Water Quality control objective (basic, normal or enhanced level of protection based on the sensitivities of the receiving watercourse) and storage requirements.	Not Applicable
<input checked="" type="checkbox"/>	Description of the stormwater management concept with facility locations and descriptions with references and supporting information.	Section 6.2 & 6.3
<input type="checkbox"/>	Set-back from private sewage disposal systems. Watercourse and hazard lands setbacks.	Not Applicable
<input checked="" type="checkbox"/>	Record of pre-consultation with the Ontario Ministry of Environment and the Conservation Authority that has jurisdiction on the affected watershed.	Appendix E
<input type="checkbox"/>	Confirm consistency with sub-watershed and Master Servicing Study, if applicable study exists.	Not Applicable
<input checked="" type="checkbox"/>	Storage requirements (complete with calculations) and conveyance capacity for minor events (1:5 year return period) and major events (1:100 year return period).	Section 6.9 & Table D12-D16 of Appendix D

<input type="checkbox"/>	Identification of watercourses within the proposed development and how watercourses will be protected, or, if necessary, altered by the proposed development with applicable approvals.	Not Applicable
<input checked="" type="checkbox"/>	Calculate pre and post development peak flow rates including a description of existing site conditions and proposed impervious areas and drainage catchments in comparison to existing conditions.	Section 6.6, 6.8 & Table D-8 & D11 of Appendix D
<input type="checkbox"/>	Any proposed diversion of drainage catchment areas from one outlet to another.	Not Applicable
<input checked="" type="checkbox"/>	Proposed minor and major systems including locations and sizes of stormwater trunk sewers, and stormwater management facilities.	Section 6.8
<input type="checkbox"/>	If quantity control is not proposed, demonstration that downstream system has adequate capacity for the post-development flows up to and including the 100-year return period storm event.	Not Applicable
<input type="checkbox"/>	Identification of potential impacts to receiving watercourses Identification of municipal drains and related approval requirements.	Not Applicable
<input checked="" type="checkbox"/>	Descriptions of how the conveyance and storage capacity will be achieved for the development.	Section 6.9
<input checked="" type="checkbox"/>	100-year flood levels and major flow routing to protect proposed development from flooding for establishing minimum building elevations (MBE) and overall grading.	Grading Plan
<input type="checkbox"/>	Inclusion of hydraulic analysis including hydraulic grade line elevations.	Not Applicable
<input checked="" type="checkbox"/>	Description of approach to erosion and sediment control during construction for the protection of receiving watercourse or drainage corridors.	Section 7
<input type="checkbox"/>	Identification of floodplains – proponent to obtain relevant floodplain information from the appropriate Conservation Authority. The proponent may be required to delineate floodplain elevations to the satisfaction of the Conservation Authority if such information is not available or if information does not match current conditions.	Not Applicable – No requirements from Conservation Authority
<input type="checkbox"/>	Identification of fill constraints related to floodplain and geotechnical investigation.	See geotechnical report
<input checked="" type="checkbox"/>	The Servicing Study shall provide a list of applicable permits and regulatory approvals necessary for the proposed development as well as the relevant issues affecting each approval. The approval and permitting shall include but not be limited to the following:	Appendix E
<input type="checkbox"/>	Conservation Authority as the designated approval agency for modification of floodplain, potential impact on fish habitat, proposed works in or adjacent to a watercourse, cut/fill permits and Approval under Lakes and Rivers Improvement Act. The Conservation Authority is not the approval authority for the Lakes and Rivers Improvement Act. Where there are Conservation Authority regulations in place, approval under the Lakes and Rivers Improvement Act is not required, except in cases of dams as defined in the Act.	Not Applicable
<input type="checkbox"/>	Application for Certificate of Approval (CofA) under the Ontario Water Resources Act.	Not Applicable
<input type="checkbox"/>	Changes to Municipal Drains.	Not Applicable
<input type="checkbox"/>	Other permits (National Capital Commission, Parks Canada, Public Works and Government Services Canada, Ministry of Transportation etc.)	Not Applicable
CONCLUSION CHECKLIST		RESPONSE
<input checked="" type="checkbox"/>	Clearly stated conclusions and recommendations	In Section 8
<input checked="" type="checkbox"/>	Comments received from review agencies including the City of Ottawa and information on how the comments were addressed. Final sign-off from the responsible reviewing agency.	Appendix E
<input checked="" type="checkbox"/>	All draft and final reports shall be signed and stamped by a professional Engineer registered in Ontario	Signed and stamped

Appendix H – Drawings

Site Plan, Renderings, and Architectural Plans

Civil Engineering Design Drawings by EXP (separate)

Landscape Plan

Mechanical Plans and Details of Oil Grit Separator

GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET



GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

SITE PLAN



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

AM10[2865] S473	Requirements	Provided	Meets Standard
Minimum lot area Table 185(a)	No minimum	5134 m ²	Yes
Minimum lot width Table 185(b)	No minimum	41.49 m	Yes
Minimum front yard setback Richmond Rd S473	0 m	0 m	Yes
Minimum corner side yard setback (Forest St) S473	0 m	0 m	Yes
Building frontage for front and corner side yard s. 185(10)(b)(i)	At least 50% of the frontage along the front lot line and corner side lot line must be occupied by building walls located within: / Residential building: 4.5 m of the frontage / Mixed-use building: 3.0 m of the frontage	Tower A (mixed-use): 50% of frontage is occupied within 3.0 m of front and corner side lot line Tower B (residential): at least 50% of frontage is occupied within 4.5 m of corner side lot line	Yes
Minimum interior side yard S473	No minimum	2.7 m	Yes
Minimum rear yard setback for a residential use building (Bond St) S473	0.6 m	0.6 m	Yes
Minimum building height [2865] / S473	Minimum building height: 7.5 m and 2 storeys	41 m 12 storeys	Yes
Maximum building height S473	41 m / 12 storeys	41 m / 12 storeys	Yes
Ground floor façade s. 185(10)(g)	The ground floor façade facing a public street of a building located within 4.5m of the front lot line or corner lot line must include: / A minimum of one active entrance from each individual occupancy located immediately adjacent to the front lot line or corner side lot line in the case of non-residential uses; and	Active entrances face both the front and corner lot lines, within 4.5 m of the lot line. Entrances provided for retail and residential uses.	Yes

AM10[2865] S473	Requirements	Provided	Meets Standard
	/ A minimum of one active entrance in the case of a residential use building; Where an active entrance is angled on the corner of the building, such that it faces the intersection of the arterial mainstreet and a side street intersecting the arterial mainstreet, it is deemed to face both streets		
Transparent glazing s. 185(10)(h)	A minimum of 50% of the surface area of the ground floor façade, measured from the average grade up to a height of 4.5 metres, facing a public street must be comprised of transparent glazing	Ground floor façade is comprised of at least 50% glazing	Yes
Amenity Area s. 135	6 m ² per dwelling unit: (391 units)*(6m ²) = 2,346 m ²	Private: 1,436 m ² Communal: 2,075 m ² Total: 3,511 m ²	Yes
	50% of which must be communal: 2,346 m ² x 50% = 1,173 m ²	2,075 m ²	Yes
	At least one amenity area must be aggregated into an area with a minimum of 54m ²	Towers A & B common areas, level 1: 903 m ² Tower A common area, level 12: 152 m ²	Yes
Parking Provisions			
Minimum Parking Rate Area Z of Schedule 1A	No off-street motor vehicle parking is required to be provided under this section.	383 resident parking spaces provided	Yes
Minimum Visitor Parking Space Rate	0.1 spaces/ dwelling unit, less the first 12 units, and no more than 30 required Tower A: (168 units-12) * (0.1) = 16 visitor parking spaces Tower B: (223 units-12) * (0.1) = 21 visitor parking spaces Total: 37 parking spaces	37 parking spaces	Yes
Maximum Parking Spaces s. 103(1), Table 103 Area B of Schedule 1 Site is within 600 m of Lincoln Fields Station	1.75 per dwelling unit (combined total of resident and visitor parking) Tower A: 294 parking spaces Tower B: 390 parking spaces Combined: 684 parking spaces	420 parking spaces	Yes
	Min.	Max.	Yes

ZONING TABLE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

AM10[2865] S473	Requirements			Provided	Meets Standard
Parking Space Dimensions s. 106(1)	Width	2.6 m	3.1 m	Parking spaces are 2.6 x 5.2 m	
	Length	5.2 m	--		
Parking Space Dimensions, Small Car/ Reduced Size s. 106(3) and (4)	Up to 50% of the parking spaces in a parking lot or parking garage may be reduced to a minimum of 4.6m long and 2.4m wide, provided that any such space:			No reduced size parking spaces	Yes
	<ul style="list-style-type: none"> / Is visibly identified as being for a compact car / Is not a visitor parking space required under Section 102 / Is not abutting or near a wall, column or similar surface that obstructs the opening of the doors of a parked vehicle or limits access to a parking space, in which case the minimum width is 2.6 metres. 				
	Up to 5% of the parking spaces in a parking lot or parking garage may have a minimum width of 1.3m and a minimum length of 3m, provided any such space			No reduced size parking spaces	Yes
	<ul style="list-style-type: none"> / Is not a required parking space under Section 101 / Is not a required visitor parking space under Section 102 / Is visibly identified as being for a motorcycle, cargo bicycle or similar vehicle. 				
Minimum Driveway Width s. 107(1)(a)(iii)	A driveway providing access to a parking garage must have a minimum width of 6.0 m for a double traffic lane			6.0 m	Yes
Minimum Aisle Width, Mixed-Use Building Table 107	Minimum width for an aisle providing access to a parking space between 71° and 90°: 6.7 m			6.7 m	Yes
Minimum Bicycle Parking s. 111	0.50 per dwelling unit (391 dwelling units)*(0.5) = 196 bicycle parking spaces			250 bicycle parking spaces	Yes
Minimum Bicycle Parking Space Dimensions Table 111B		Width	Length	Bicycle parking spaces comply	Yes
	Horizontal	0.6 m	1.8 m		
	Vertical	0.5 m	1.5 m		
	Stacked	0.37 m	--		

AM10[2865] S473	Requirements	Provided	Meets Standard
Location of Bicycle Parking s. 111(7)	A maximum of 50% (98) of the required bicycle parking spaces or 15 spaces, whichever is greater, may be located in a landscaped area:	80 located in landscaped area	Yes
	A maximum of 98 bicycle parking spaces may be located in landscaped area		
Minimum Aisle Width, Bicycle Parking s. 111(9)	A bicycle parking space must have access from an aisle having a minimum width of 1.5 metres.	1.5 m	
Parking Space Orientation s. 111(10)	A minimum of 50% (98 bicycle parking spaces) of the bicycle parking spaces required by this by-law must be horizontal spaces at ground level.	98 horizontal bicycle parking spaces: 8 indoors + 90 outdoors	Yes
Location of Bicycle Parking s. 111(12)	Where the number of bicycle parking spaces required for a single office or residential building exceeds fifty 50 spaces, a minimum of 25% (49) of that required total must be located within:	Over 25% of the required bicycle parking spaces are located indoors – 160 bicycle parking spaces are provided indoors	Yes
	<ul style="list-style-type: none"> / a building or structure; / a secure area such as a supervised parking lot or enclosure with secure entrance; or / bicycle lockers. 		

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

SUMMARY STATISTICS FOR TOWER A & B

GREEN AREA : 798 m²

RESIDENTIAL TOTAL NET AREA

TOWER A (12 LEVELS) : (168 UNITS) 11 565 m²
TOWER B (12 LEVELS) : (223 UNITS) 15 585 m²
TOTAL : (391 UNITS) 27 150 m²

COMMERCIAL TOTAL NET AREA

TOWER A : 224 m²
TOWER B : 0 m²

UNDERGROUND PARKING TOTAL GROSS AREA

PER LEVEL AREA : 4833 m²

NUMBER OF INTERIOR PARKING (4 LEVELS)

REQUIRED MINIMUM 1.1 PER UNITS : 431 PARKINGS (MINIMUM)
NUMBER OF PARKING PROPOSED : 420 PARKINGS

NUMBER OF BIKES (50% OF NUMBER UNITS)

TOWER A & B P1 LEVEL (EXTRA)
INTERIOR : 52

TOWER A (84 MINIMUM REQUIRED)

INTERIOR (42 MIN.) : 52
EXTERIOR (42 MIN.) : 40

TOWER B (112 MINIMUM REQUIRED)

INTERIOR (56 MIN.) : 56
EXTERIOR (56 MIN.) : 50

NOTE ON THE SITE PLAN

THE PROPERTY BOUNDARIES INDICATED ON THE SITE PLAN ARE DERIVED FROM TOPOGRAPHICAL PLAN OF SURVEY OF LOT 41, PART OF LOT 42, 56 AND 57 REGISTERED PLAN 311 CITY OF OTTAWA, SURVEYED BY ANNIS, O'SULLIVAN, VOLLEBEKK TLD AND DATED 2019-04-30.

TOWER A - GROSS AREA PER LEVEL

GROSS AREA LEVEL 1 :	1217.94 m ²
GROSS AREA LEVEL 2 :	1217.94 m ²
GROSS AREA LEVEL 3 TO 6 :	1246.10 m ² x 4
GROSS AREA LEVEL 7 :	1146.39 m ²
GROSS AREA LEVEL 8 TO 11 :	1188.44 m ² x 4
GROSS AREA LEVEL 12 :	1044.76 m ²
TOTAL GROSS AREA :	14365.19 m²

TOWER B - GROSS AREA PER LEVEL

GROSS AREA LEVEL 1 :	1466.78 m ²
GROSS AREA LEVEL 2 :	1497.04 m ²
GROSS AREA LEVEL 3 TO 6 :	1629.32 m ² x 4
GROSS AREA LEVEL 7 :	1465.16 m ²
GROSS AREA LEVEL 8 TO 11 :	1513.39 m ² x 4
GROSS AREA LEVEL 12 :	1390.80 m ²
TOTAL GROSS AREA :	18390.62 m²

GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

UNDERGROUND PARKINGS




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

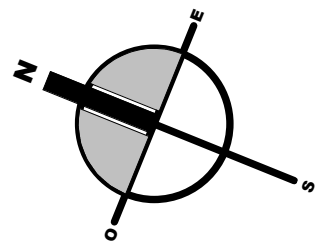

P1 PARKING
NUMBER OF PARKING : 87 SPACES

P2 PARKING
NUMBER OF PARKING : 111 SPACES

P3 PARKING
NUMBER OF PARKING : 111 SPACES

P4 PARKING
NUMBER OF PARKING : 111 SPACES

P1 BICYCLE PARKING
HORIZONTAL PARKING : 8 SPACES
VERTICAL PARKING: 44 SPACES


GROUND LEVEL BICYCLE PARKING
INDOOR VERTICAL PARKING: 108 SPACES
OUTDOOR HORIZONTAL PARKING: 90 SPACES

TOTAL : 250 SPACES
(REQUIRED MINIMUM 196 SPACES)

TOTAL : 420 SPACES
(REQUIRED MINIMUM 431 SPACES)

SPECIFIC TYPE OF PARKING :

STANDARD : 357
VISITOR : 37
UNIVERSAL : 11
ELECTRIC : 15

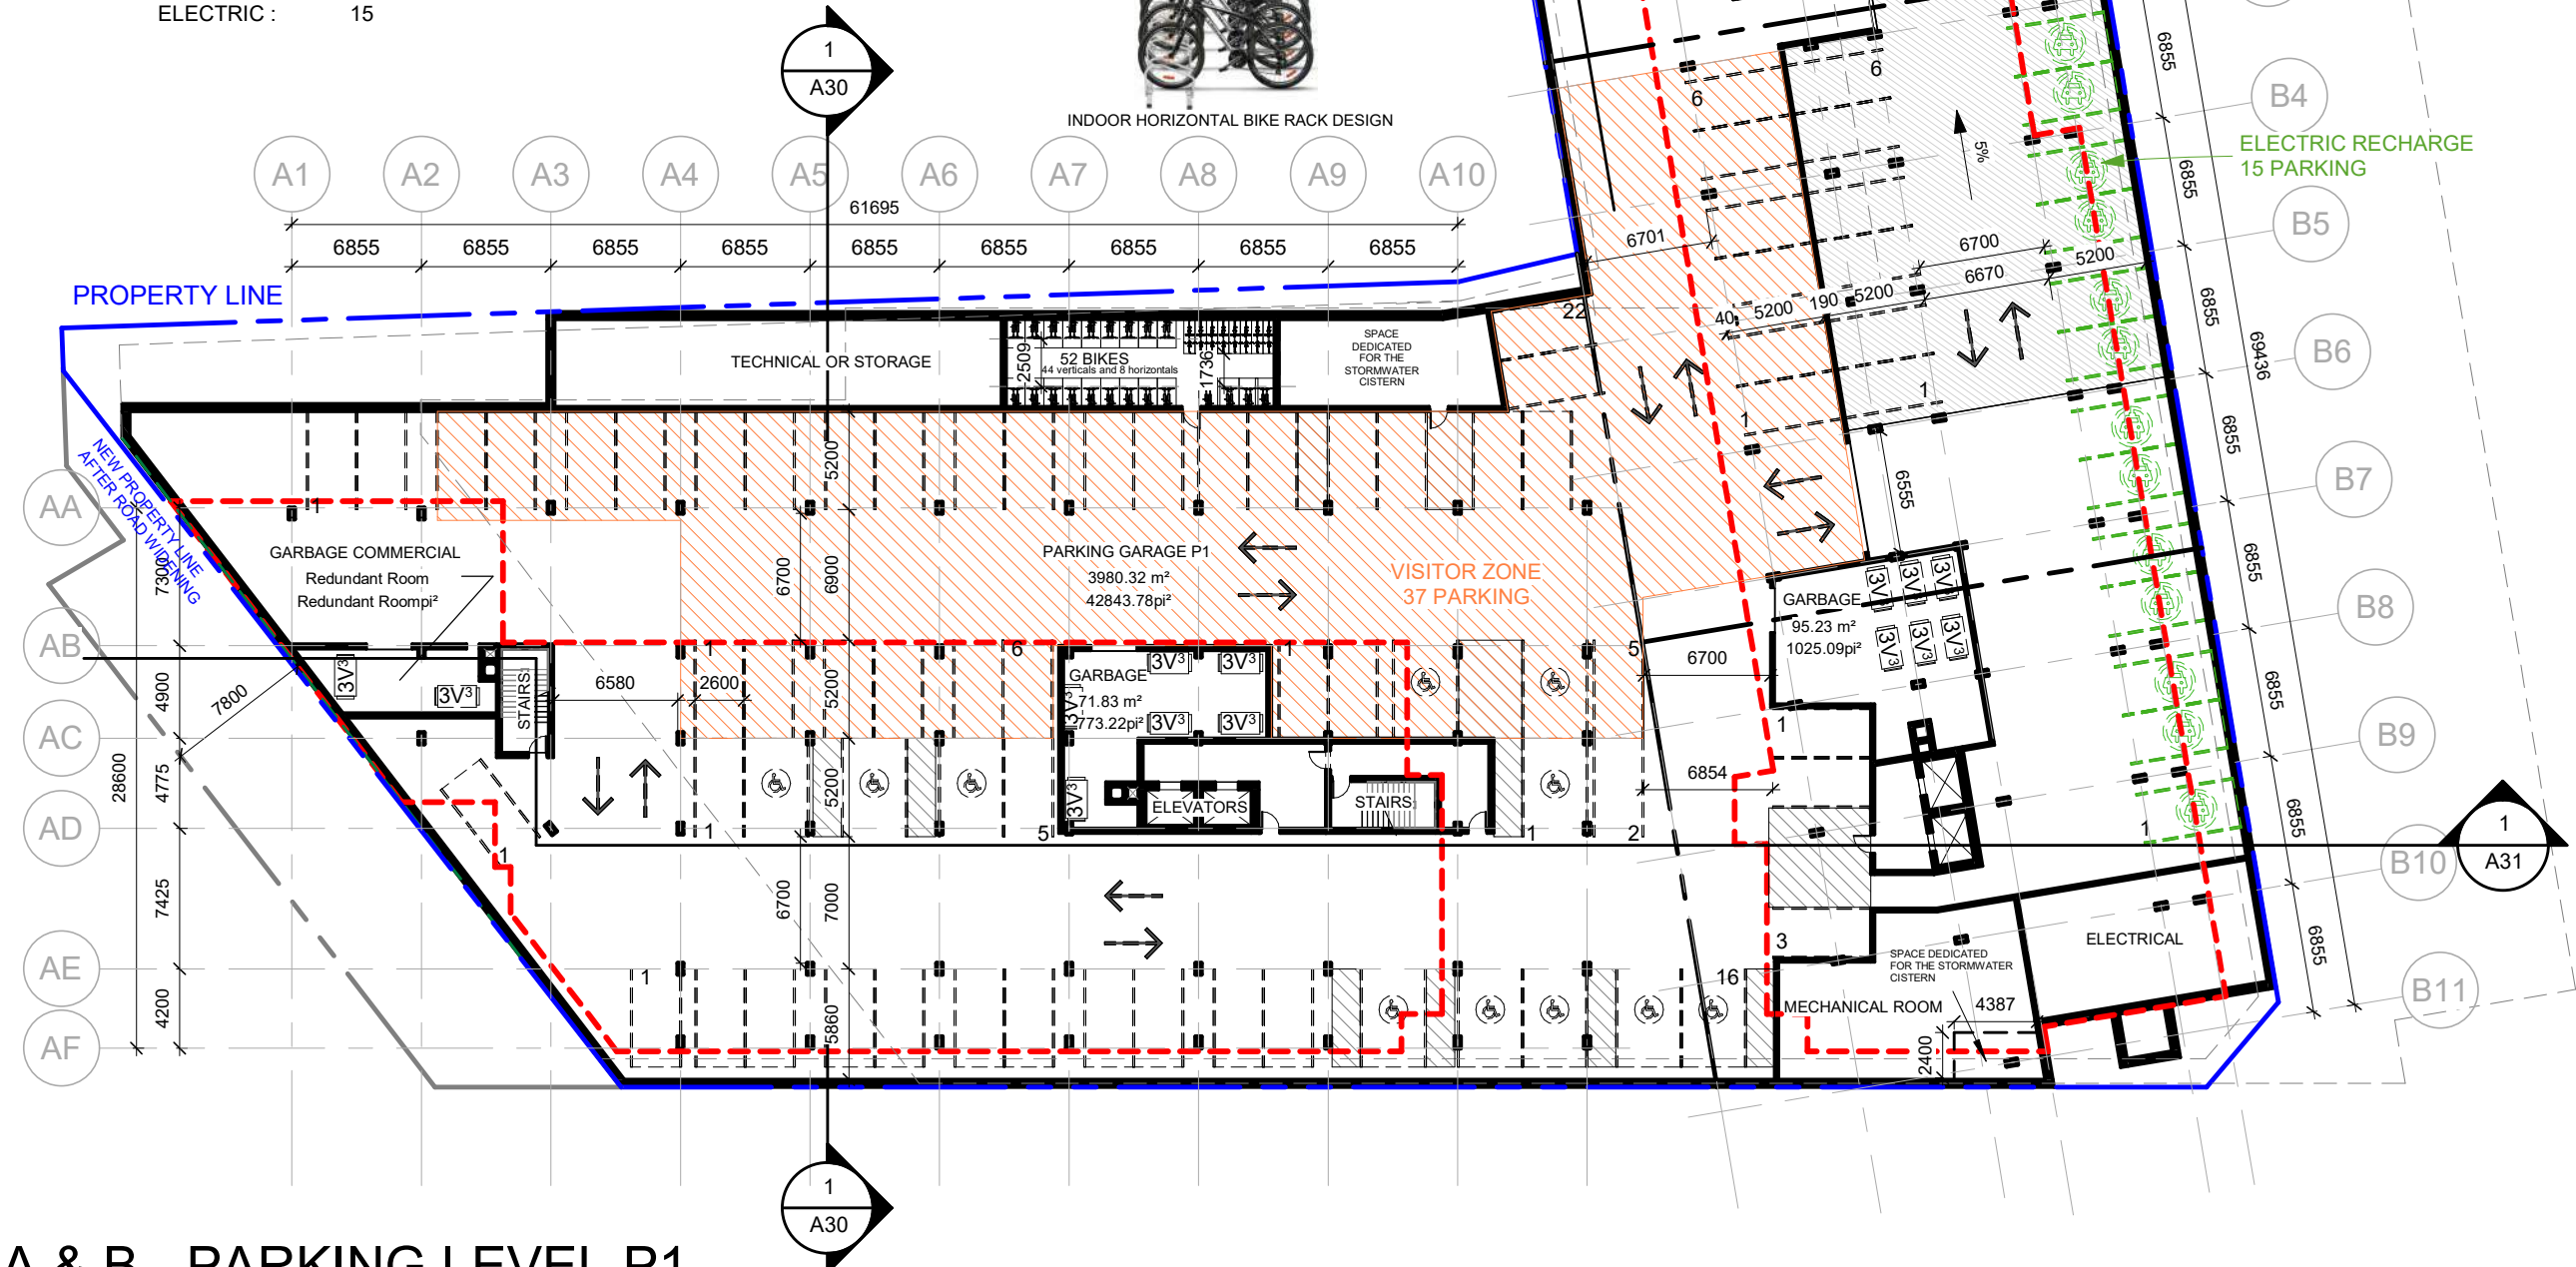

TOWER A & B - PARKING LEVEL P1

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7
1 : 400

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

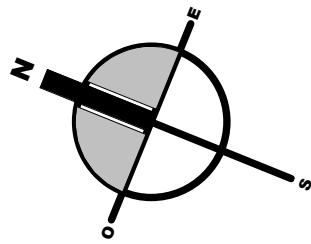

P2 PARKING
NUMBER OF PARKING : 111 SPACES

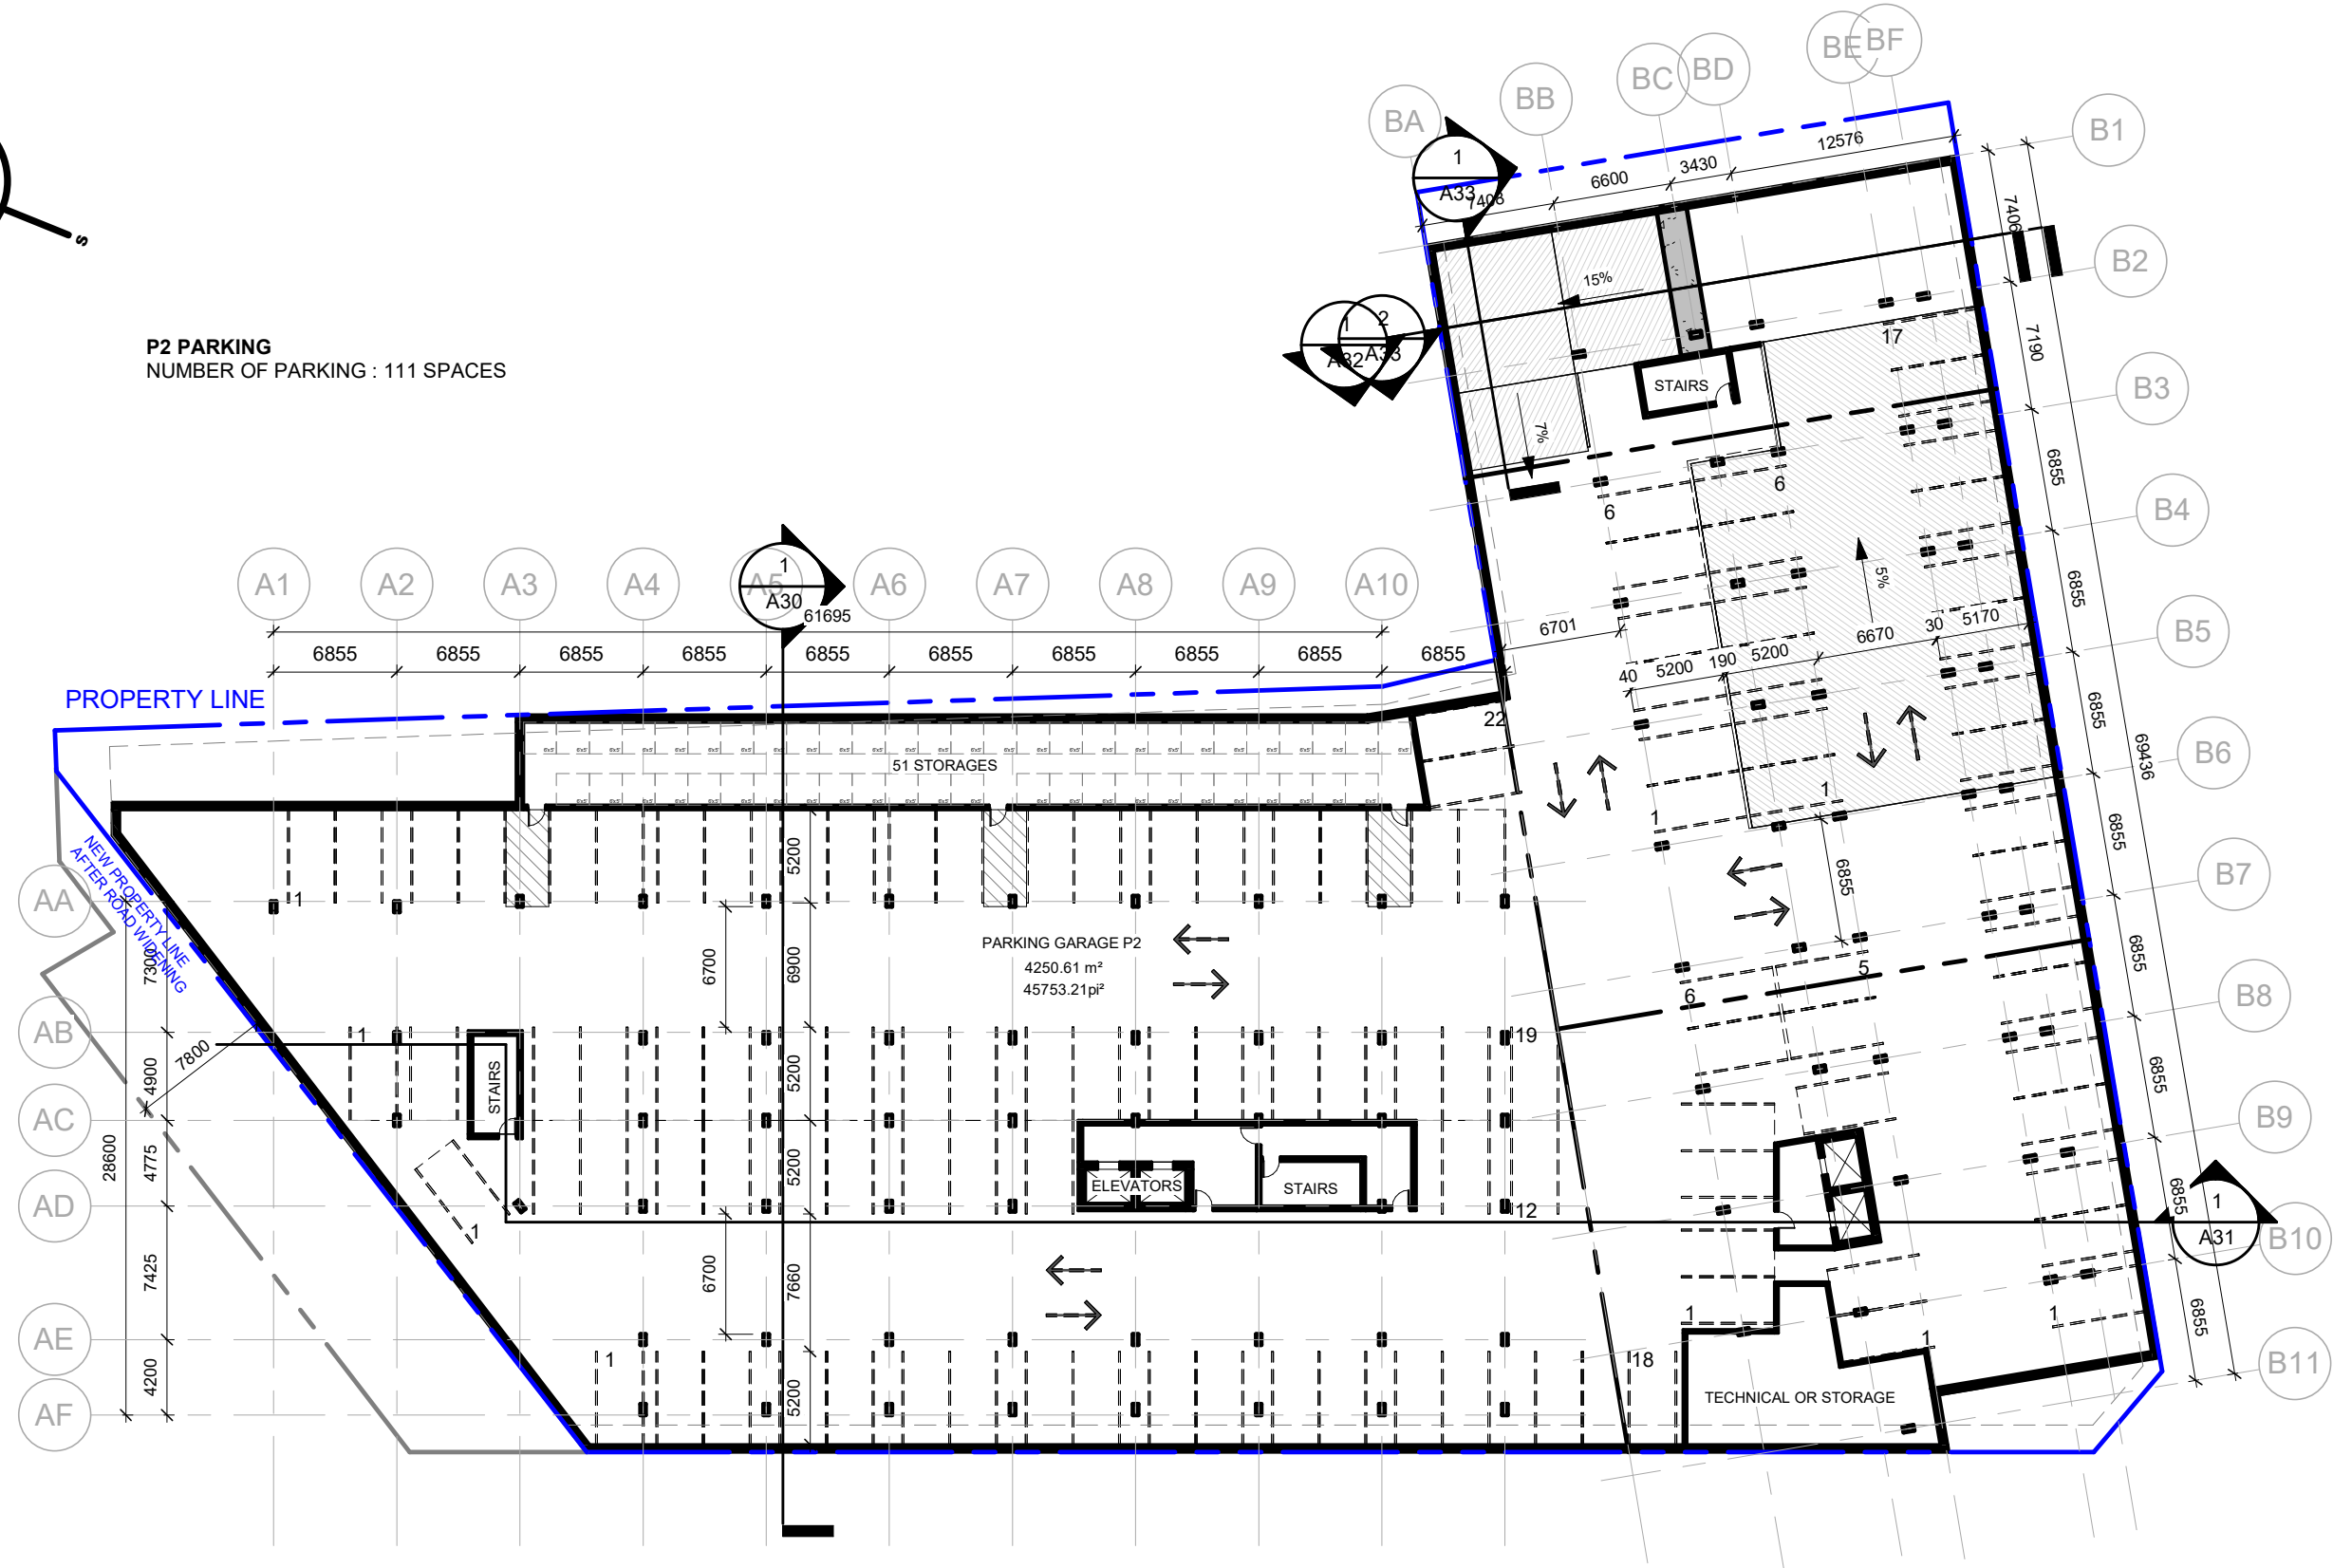

TOWER A & B - PARKING LEVEL P2

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 400




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

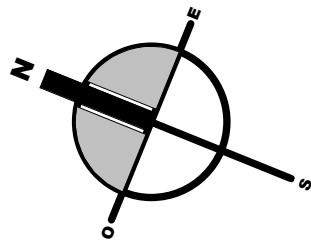

P3 PARKING
NUMBER OF PARKING : 111 SPACES

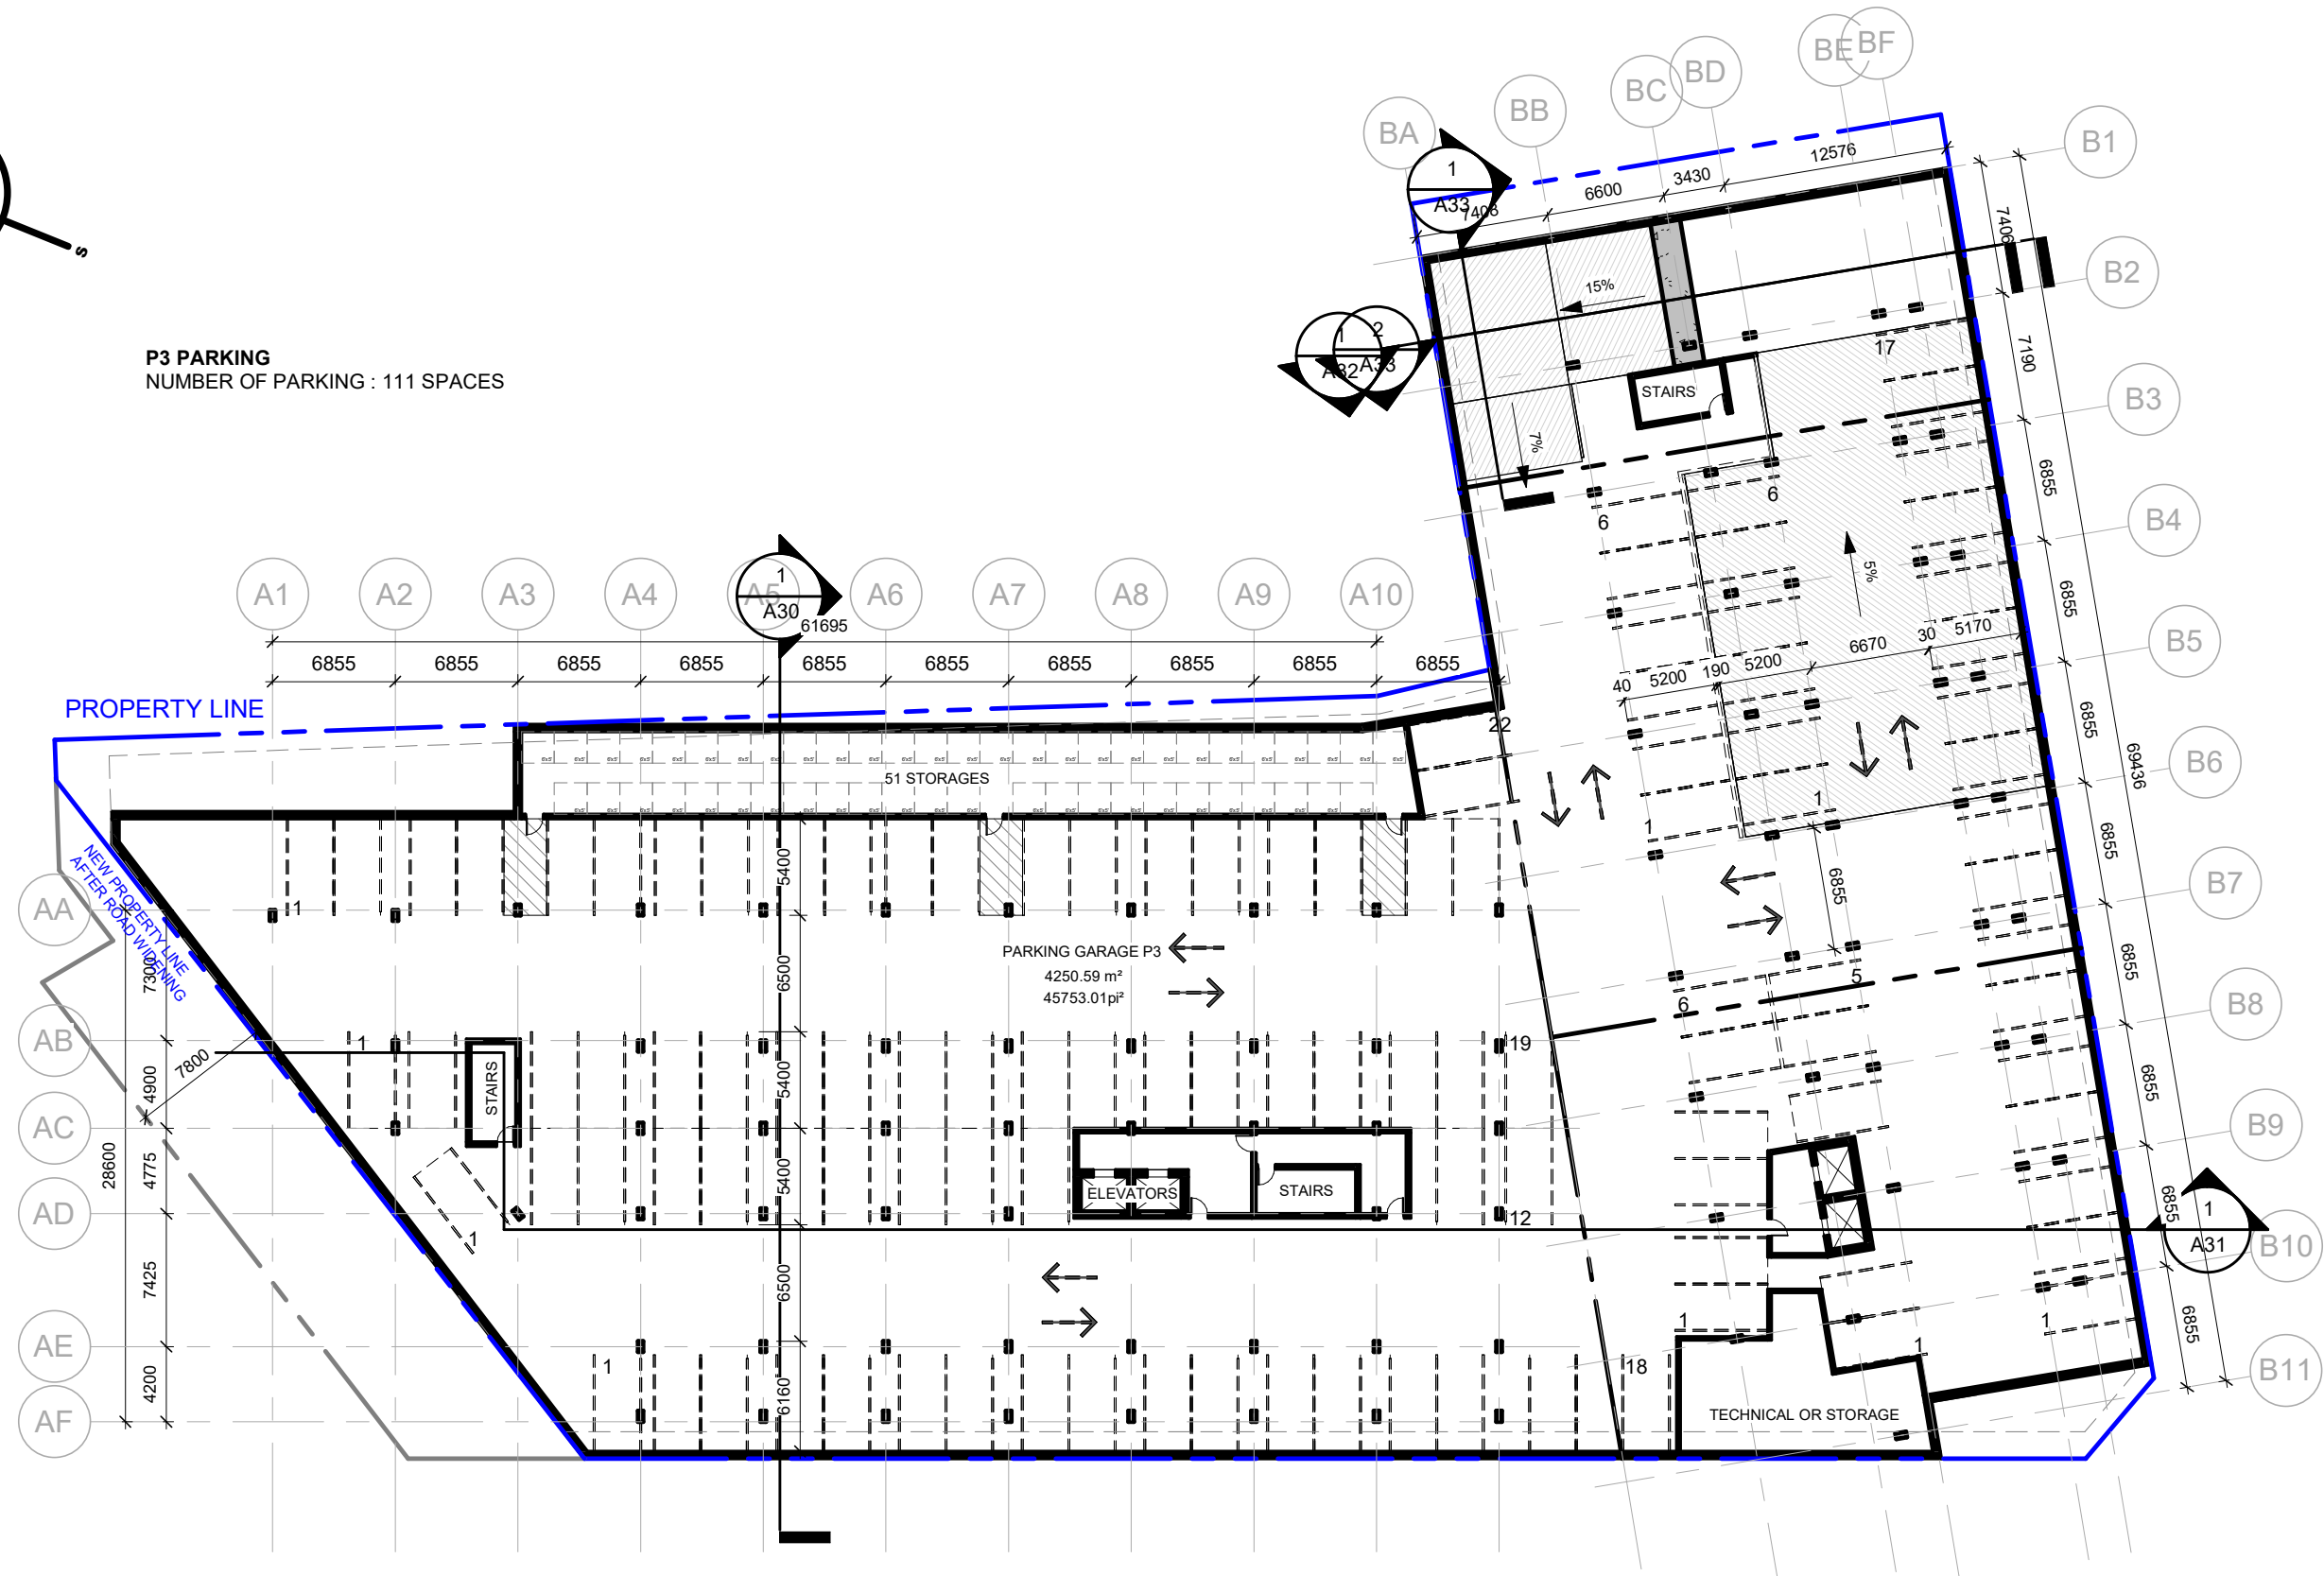

TOWER A & B - PARKING LEVEL P3

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 400




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

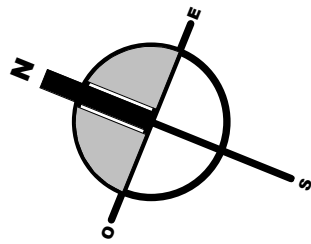

P4 PARKING
NUMBER OF PARKING : 111 SPACES

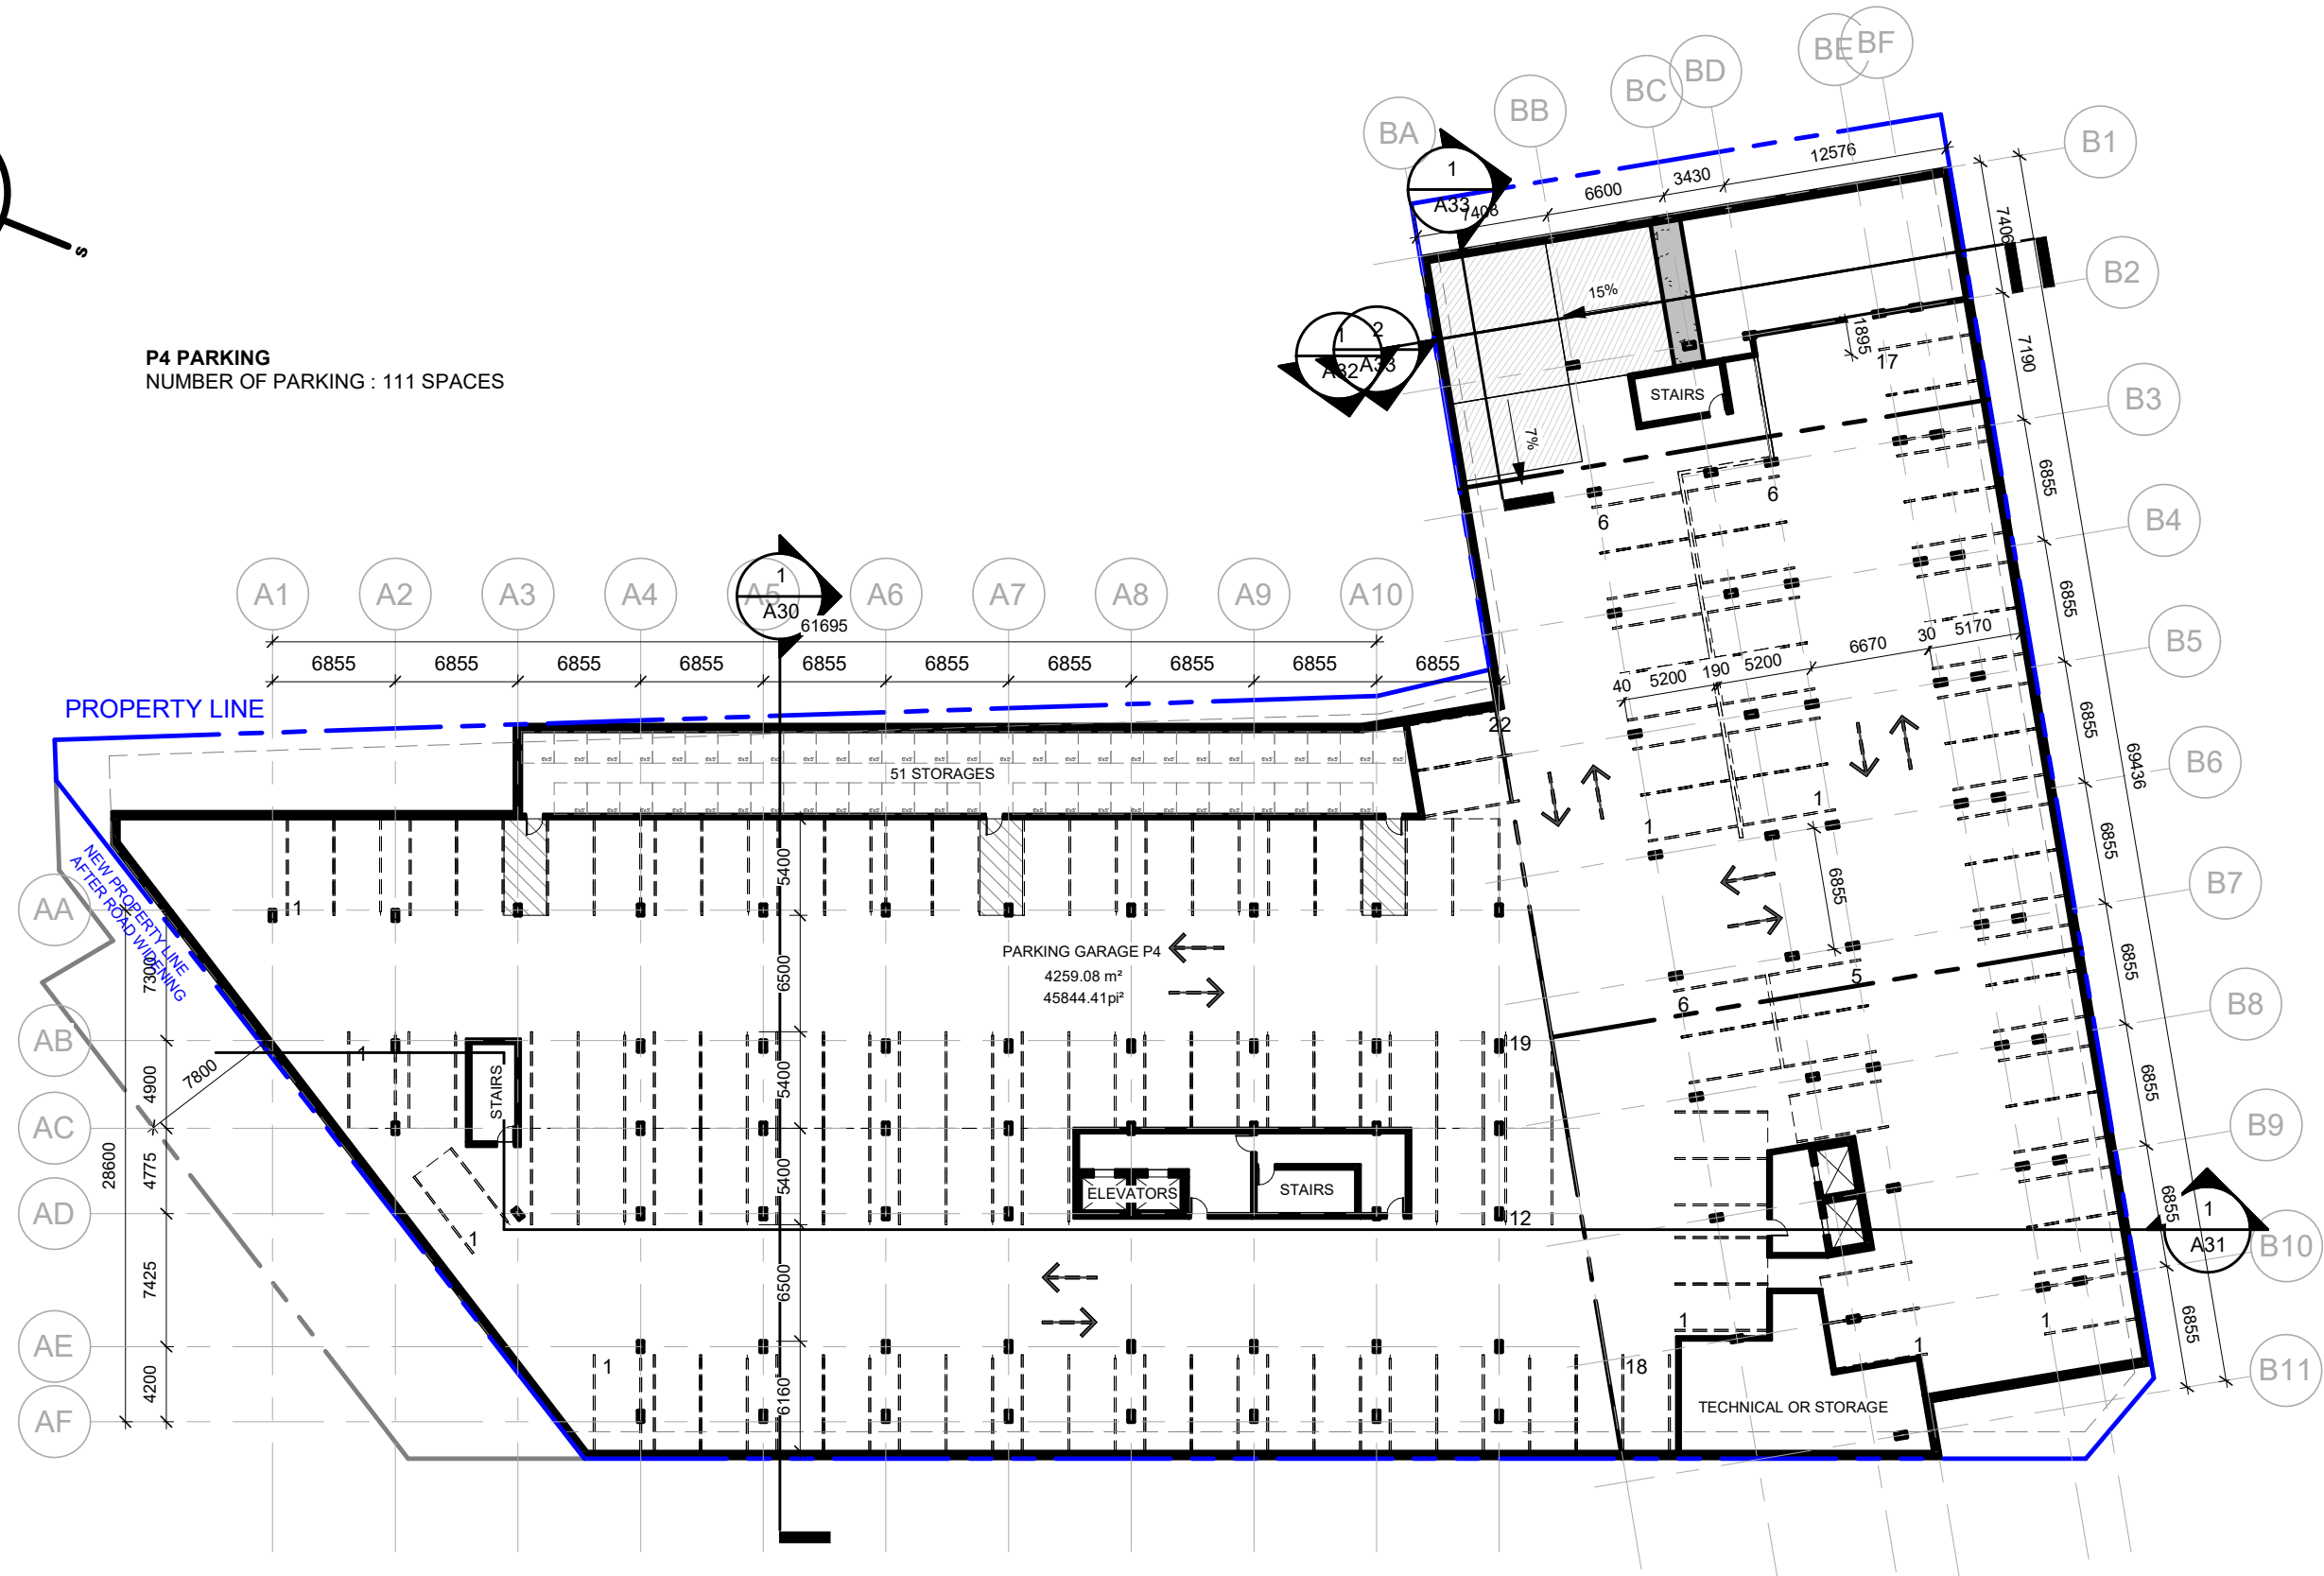

TOWER A & B - PARKING LEVEL P4

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 400



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

TOWER A

GROUPE HEAFEY
RICHMOND ROAD & FOREST STREET





GROSS AREA LEGEND



TOWER A - LEVEL 1

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



GROSS AREA LEGEND



TOWER A - LEVEL 2

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

ESQUISSE

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

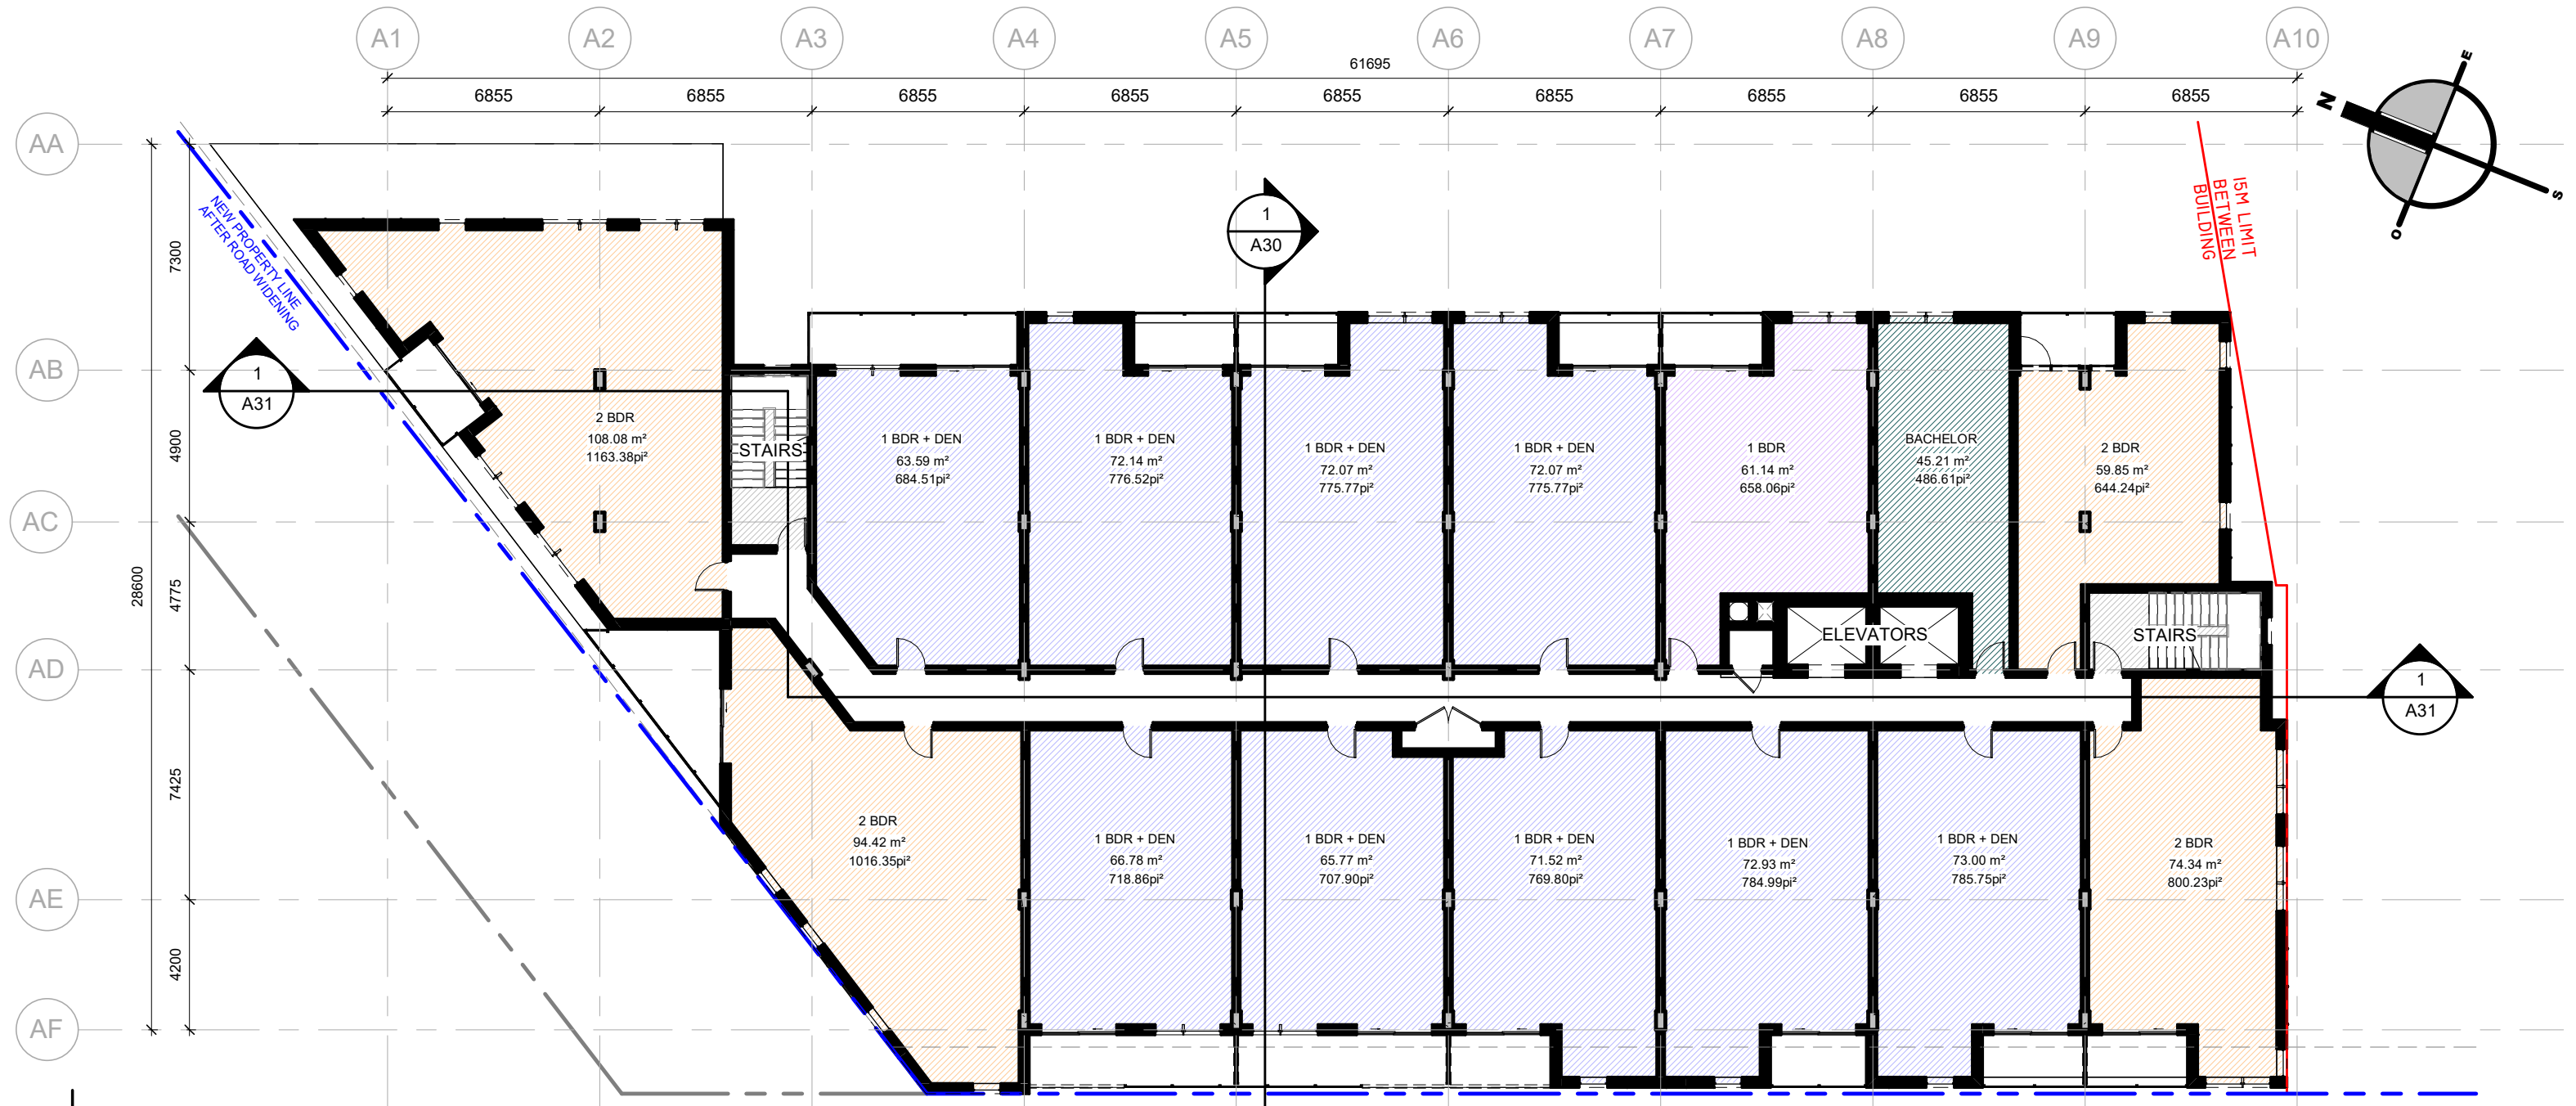

GROSS AREA LEGEND



TOWER A - LEVEL 3 TO 6

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

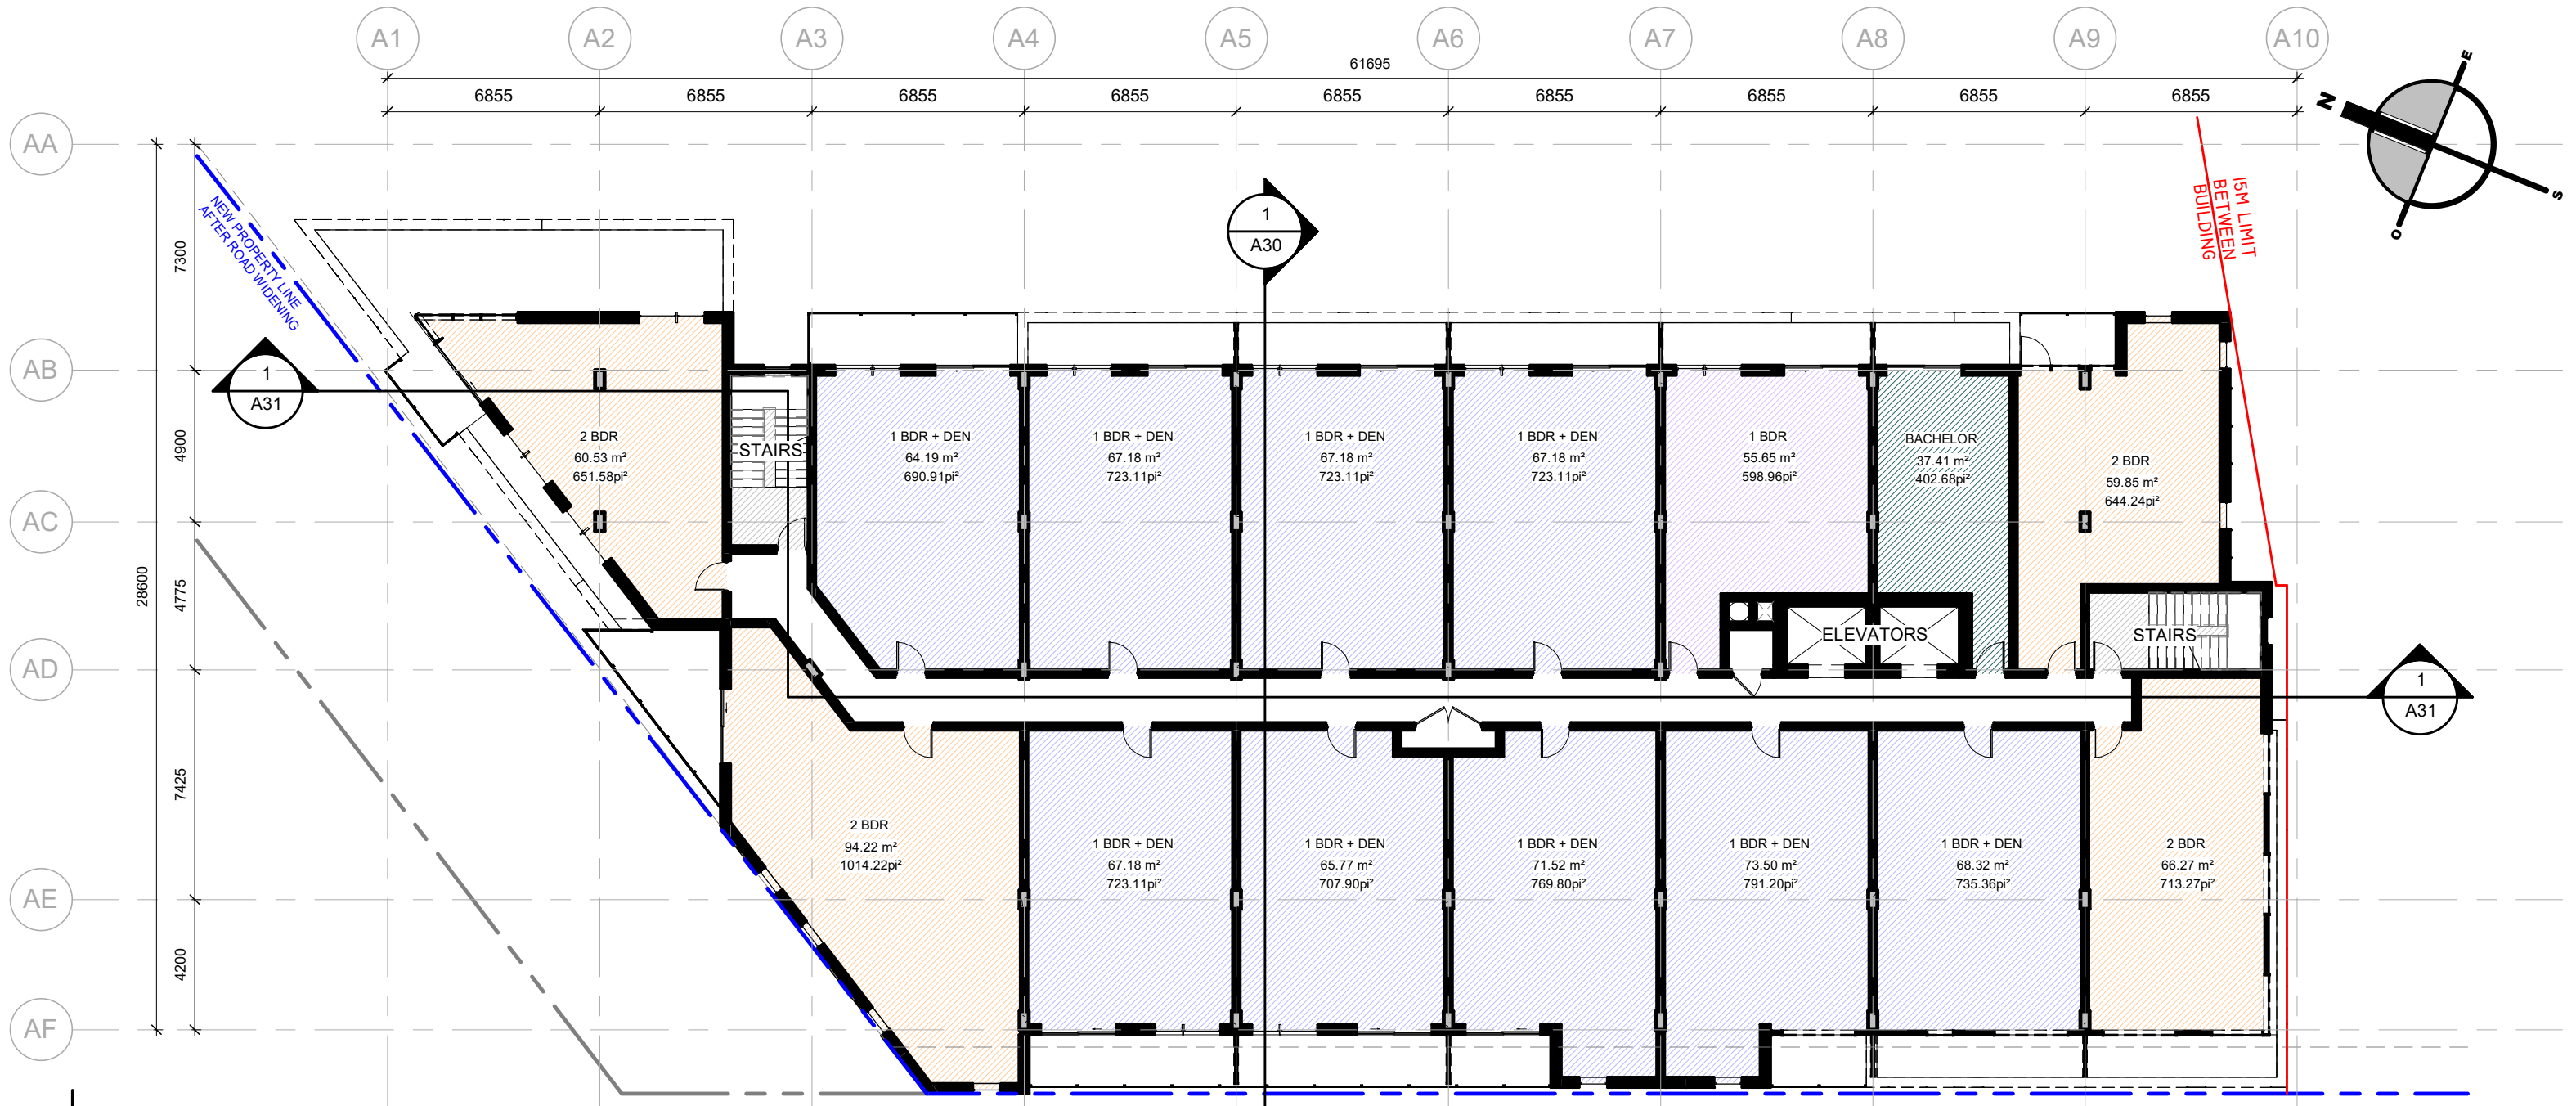

GROSS AREA LEGEND



TOWER A - LEVEL 7

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

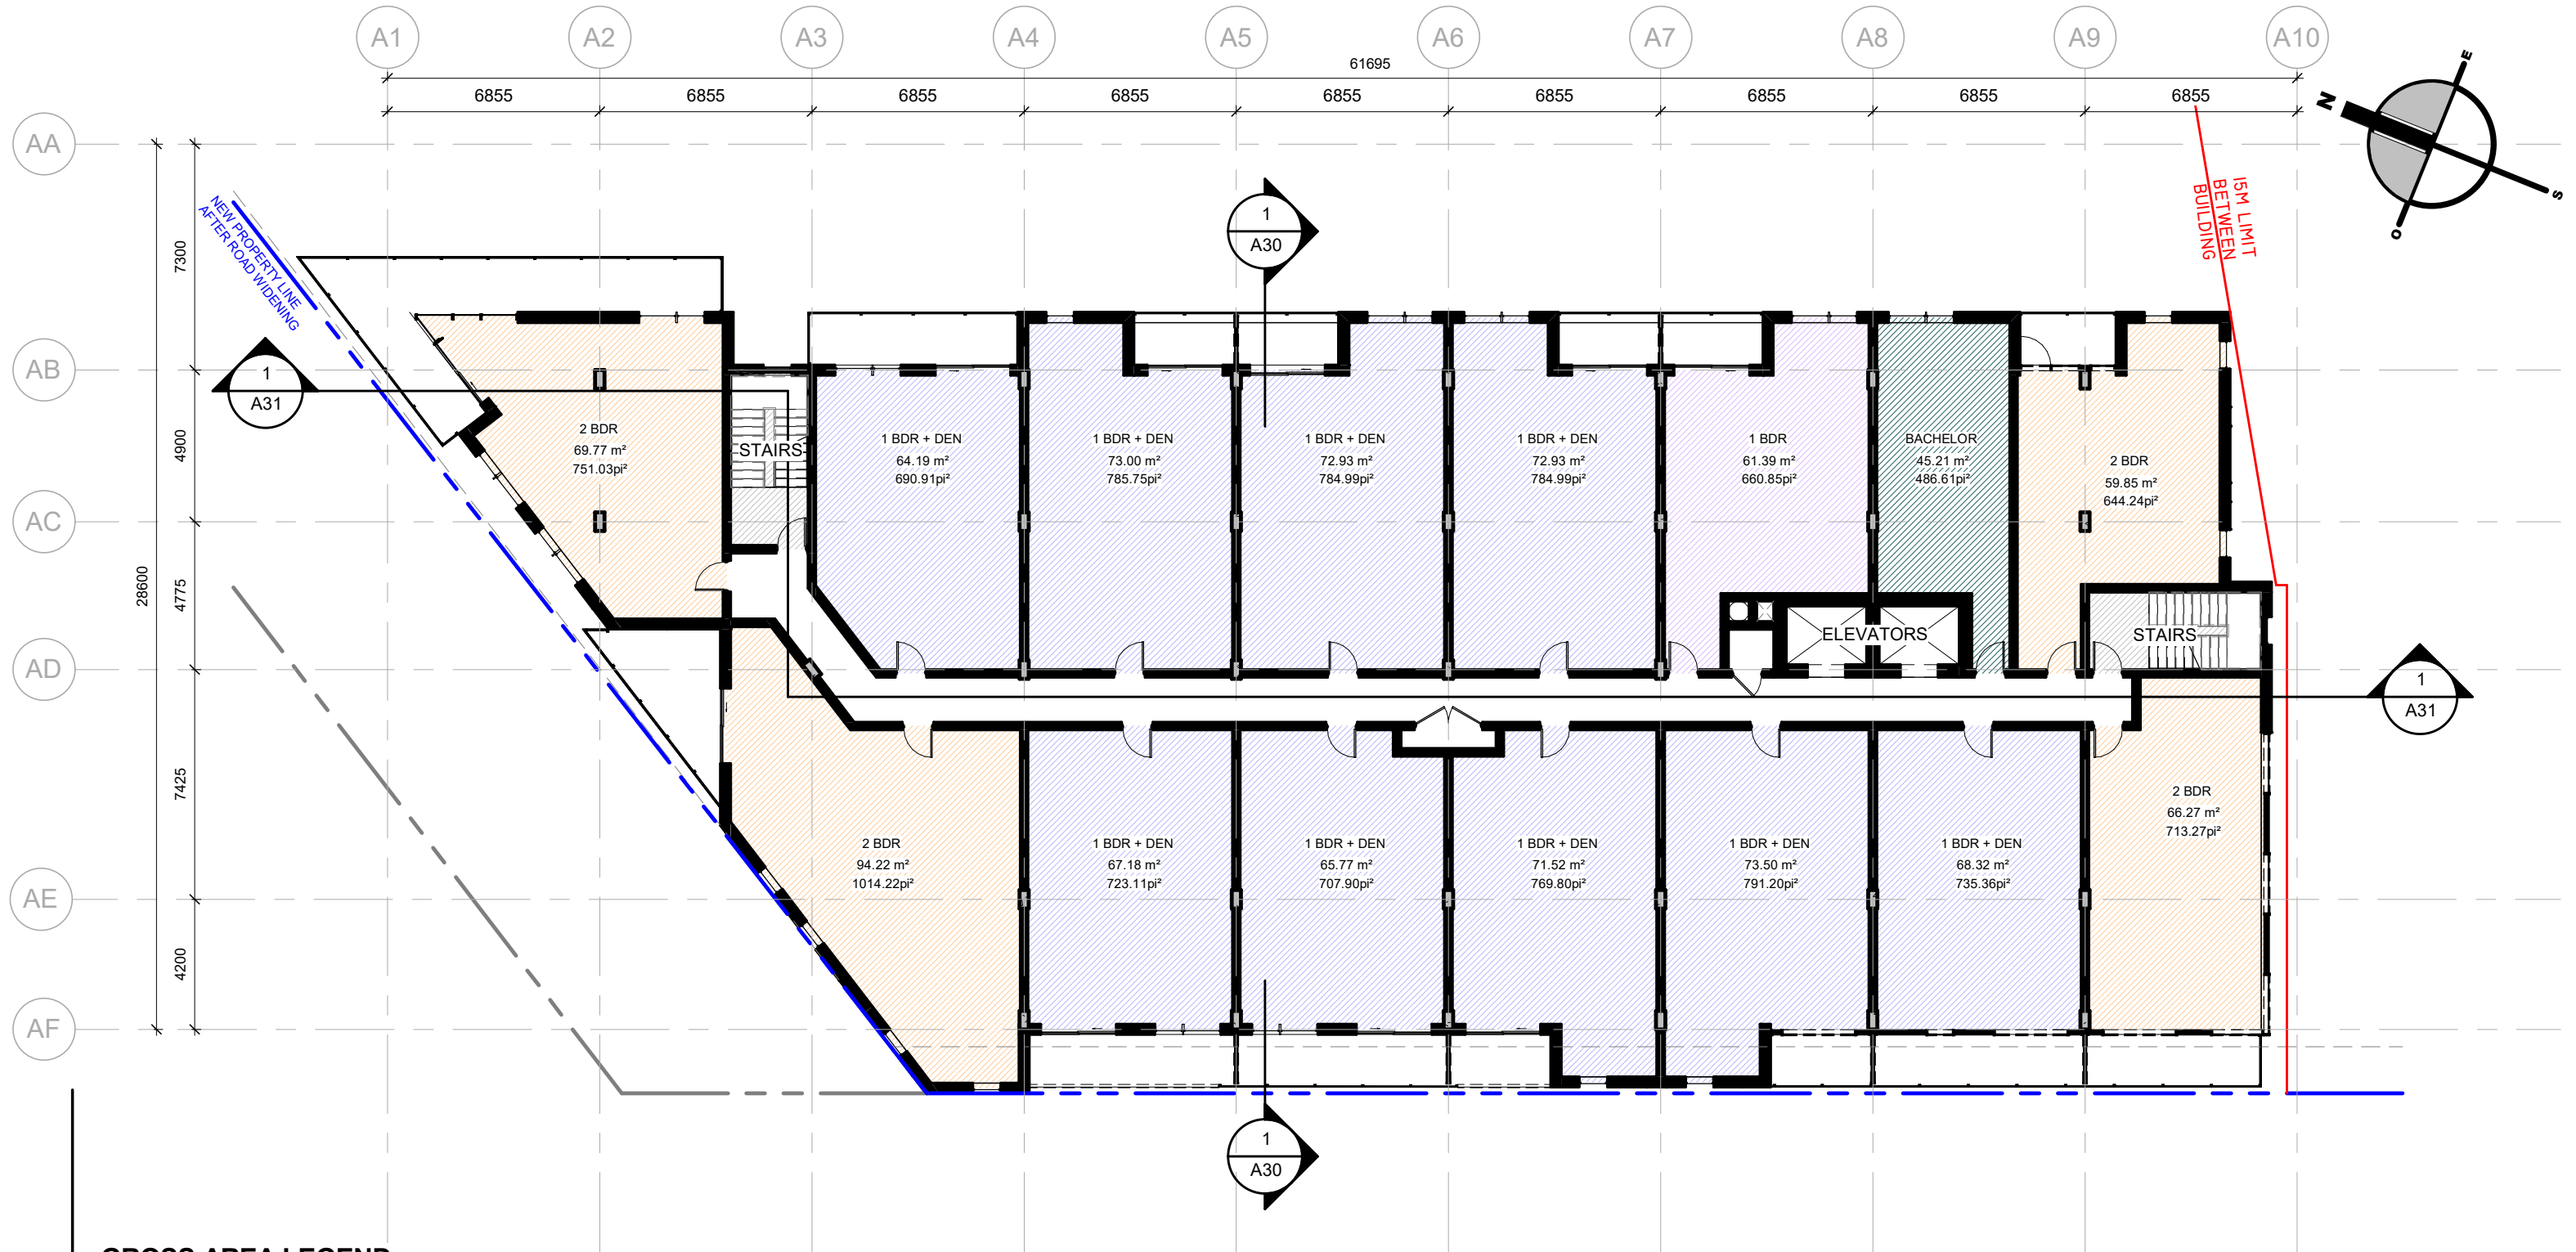

GROSS AREA LEGEND



TOWER A - LEVEL 8 TO 11

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

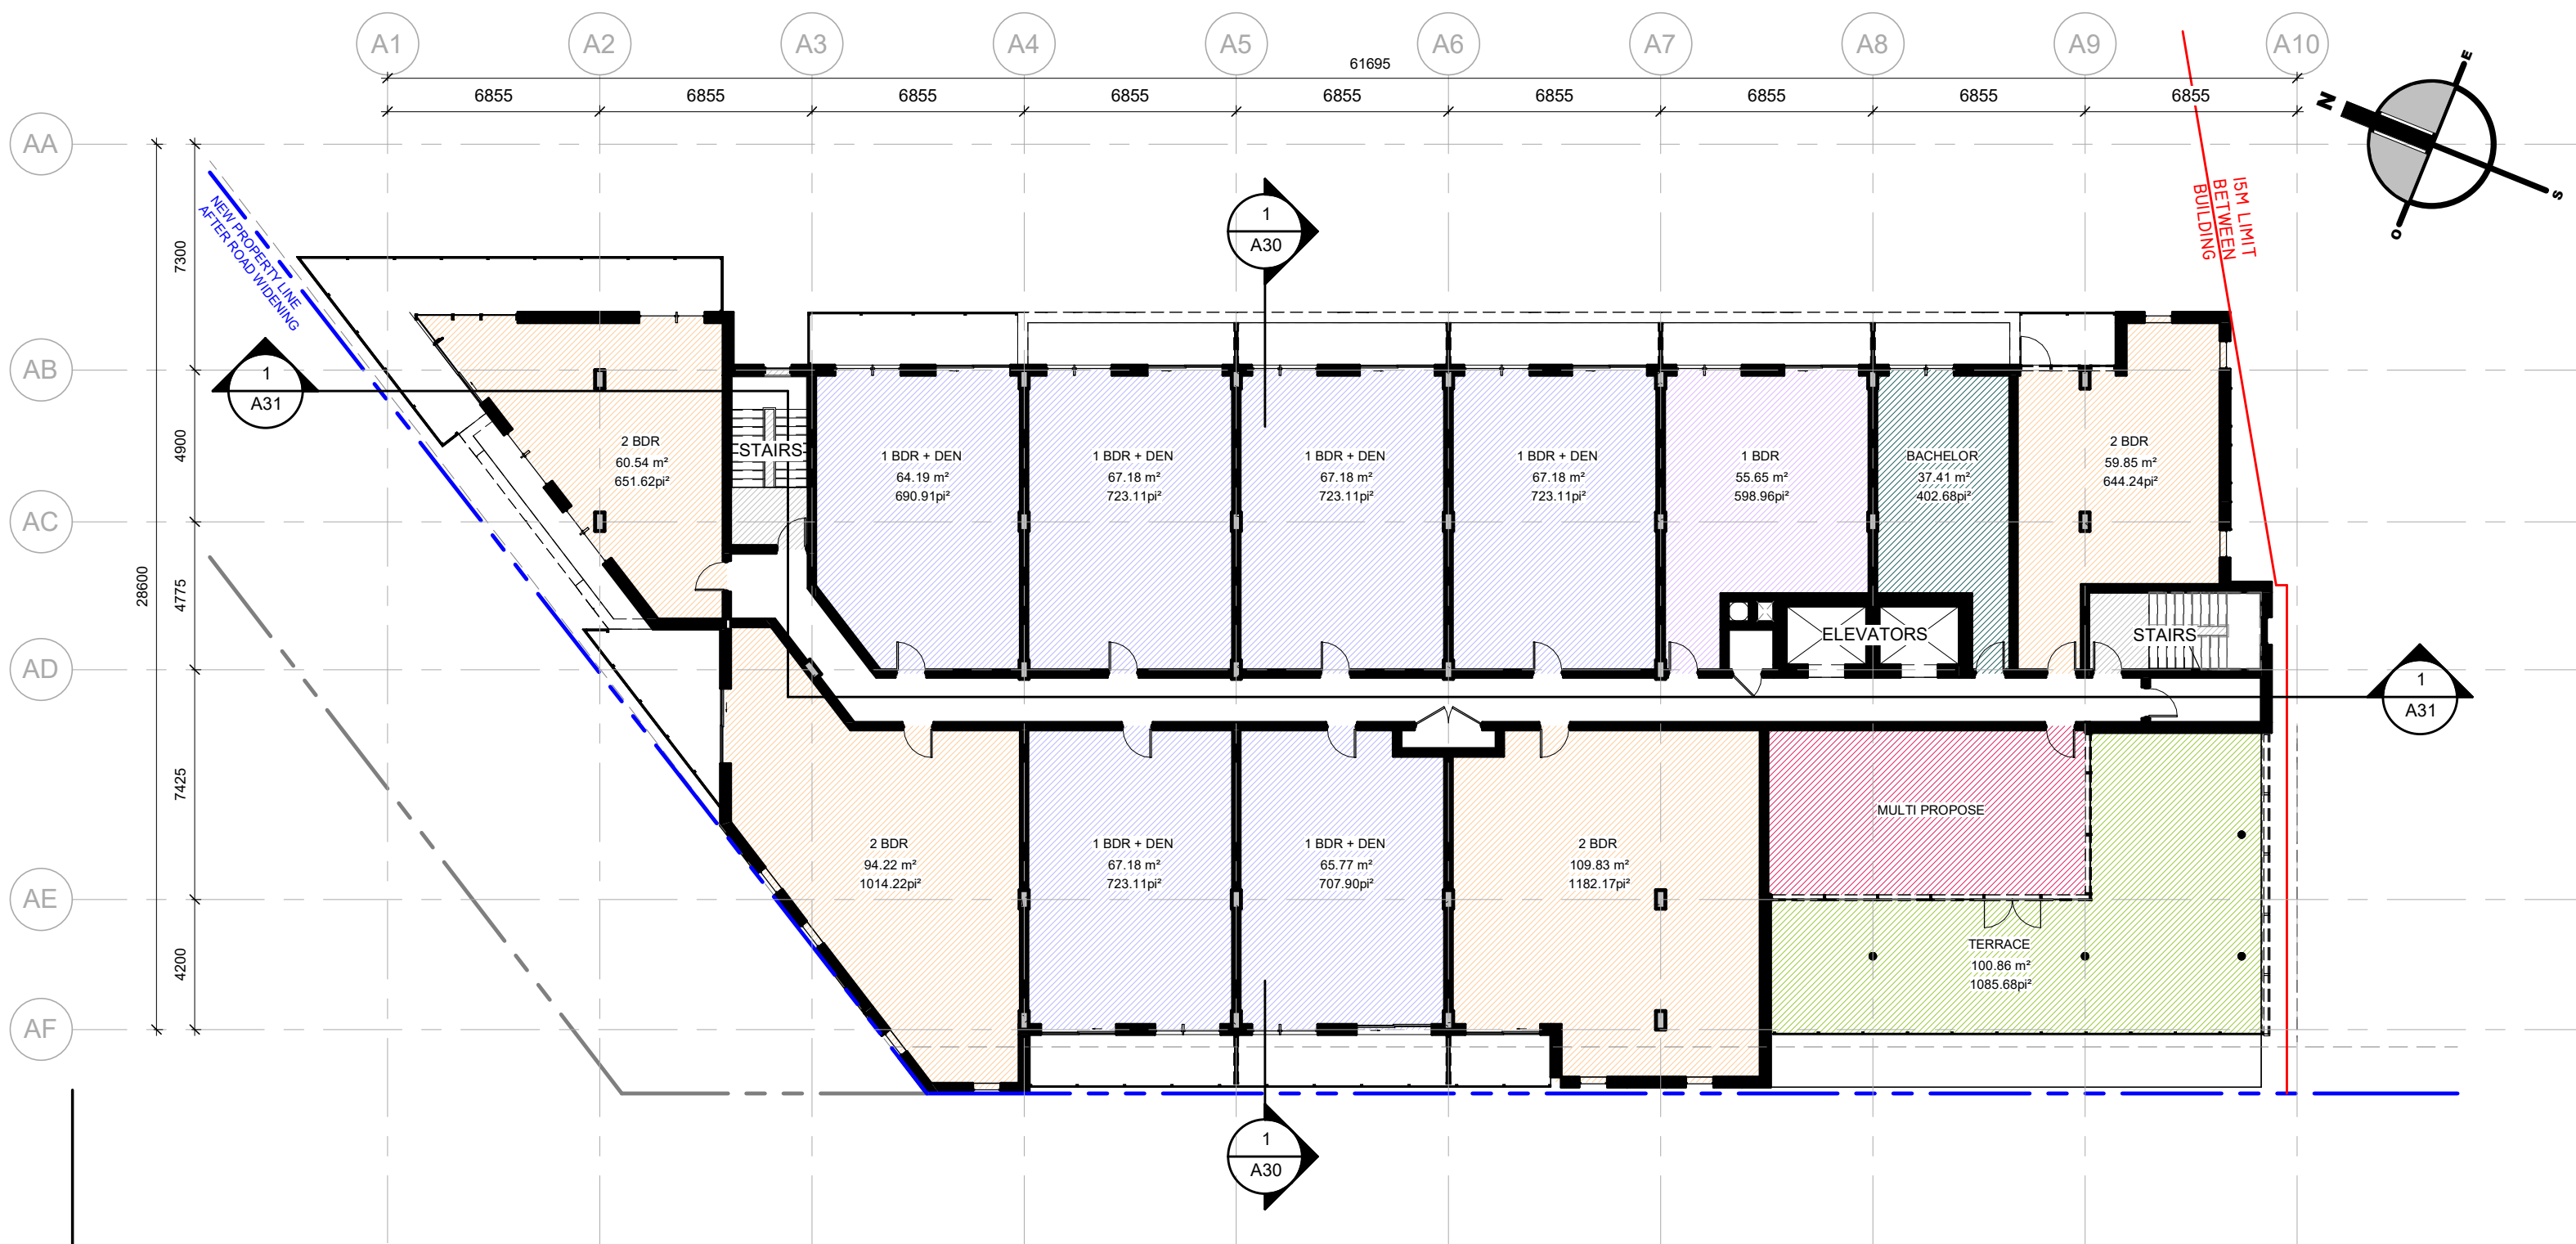

GROSS AREA LEGEND



TOWER A - LEVEL 12

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

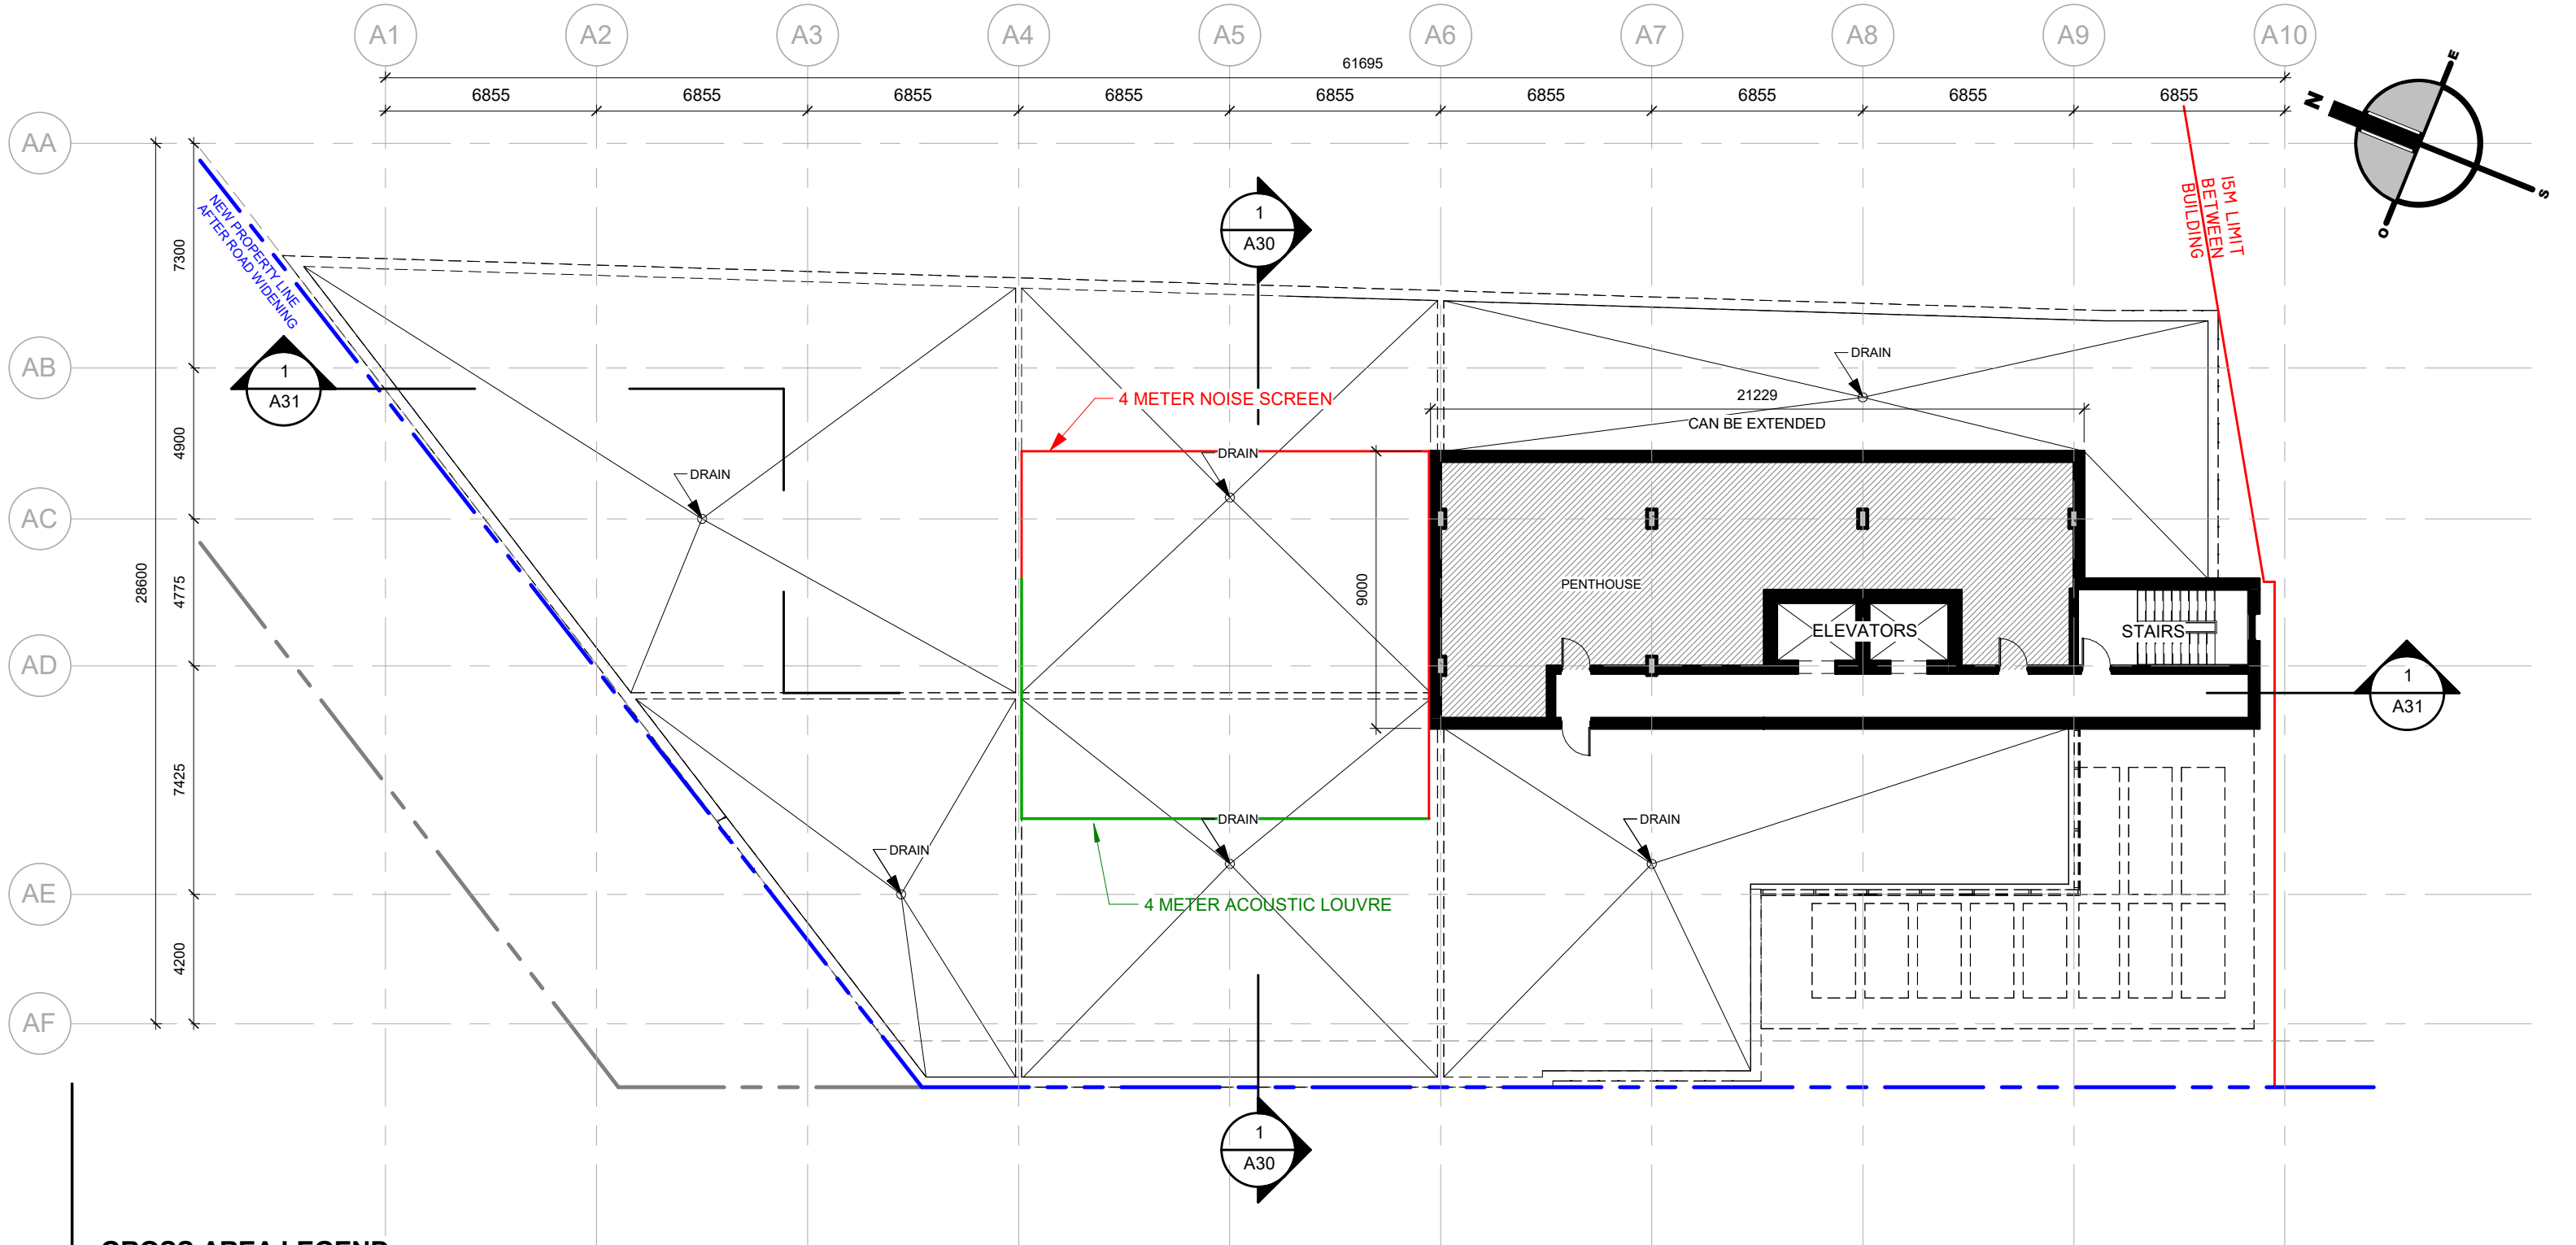

GROSS AREA LEGEND



TOWER A - LEVEL PENTHOUSE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

ROOM TYPOLOGY - TOWER A		
LEVEL	NAME	QTY
LEVEL 1	1 BDR	1
LEVEL 1	1 BDR + DEN	6
LEVEL 1	2 BDR	2
LEVEL 2	1 BDR	2
LEVEL 2	1 BDR + DEN	9
LEVEL 2	BACHELOR	1
LEVEL 3	1 BDR	1
LEVEL 3	1 BDR + DEN	9
LEVEL 3	2 BDR	4
LEVEL 3	BACHELOR	1
LEVEL 4	1 BDR	1
LEVEL 4	1 BDR + DEN	9
LEVEL 4	2 BDR	4
LEVEL 4	BACHELOR	1
LEVEL 5	1 BDR	1
LEVEL 5	1 BDR + DEN	9
LEVEL 5	2 BDR	4
LEVEL 5	BACHELOR	1
LEVEL 6	1 BDR	1
LEVEL 6	1 BDR + DEN	9
LEVEL 6	2 BDR	4
LEVEL 6	BACHELOR	1
LEVEL 7	1 BDR	1
LEVEL 7	1 BDR + DEN	9
LEVEL 7	2 BDR	4
LEVEL 7	BACHELOR	1
LEVEL 8	1 BDR	1
LEVEL 8	1 BDR + DEN	9
LEVEL 8	2 BDR	4
LEVEL 8	BACHELOR	1
LEVEL 9	1 BDR	1
LEVEL 9	1 BDR + DEN	9
LEVEL 9	2 BDR	4
LEVEL 9	BACHELOR	1
LEVEL 10	1 BDR	1
LEVEL 10	1 BDR + DEN	9
LEVEL 10	2 BDR	4
LEVEL 10	BACHELOR	1
LEVEL 11	1 BDR	1
LEVEL 11	1 BDR + DEN	9
LEVEL 11	2 BDR	4
LEVEL 11	BACHELOR	1
LEVEL 12	1 BDR	1
LEVEL 12	1 BDR + DEN	6
LEVEL 12	2 BDR	4
LEVEL 12	BACHELOR	1
TOTAL UNITS: 168		

1 BDR - TOWER A		
NIVEAU	NOM	NOMBRE
LEVEL 1	1 BDR	1
LEVEL 2	1 BDR	2
LEVEL 3	1 BDR	1
LEVEL 4	1 BDR	1
LEVEL 5	1 BDR	1
LEVEL 6	1 BDR	1
LEVEL 7	1 BDR	1
LEVEL 8	1 BDR	1
LEVEL 9	1 BDR	1
LEVEL 10	1 BDR	1
LEVEL 11	1 BDR	1
LEVEL 12	1 BDR	1
TOTAL: 13		

2 BDR - TOWER A		
NIVEAU	NOM	NOMBRE
LEVEL 1	2 BDR	2
LEVEL 3	2 BDR	4
LEVEL 4	2 BDR	4
LEVEL 5	2 BDR	4
LEVEL 6	2 BDR	4
LEVEL 7	2 BDR	4
LEVEL 8	2 BDR	4
LEVEL 9	2 BDR	4
LEVEL 10	2 BDR	4
LEVEL 11	2 BDR	4
LEVEL 12	2 BDR	4
TOTAL: 42		

TYPOLOGY - TOWER A		
NOM	NOMBRE	%
1 BDR	13	7%
1 BDR + DEN	102	61%
2 BDR	42	28%
BACHELOR	11	4%
TOTAL DE LOGEMENTS: 168		100%

1 BDR + DEN - TOWER A		
NIVEAU	NOM	NOMBRE
LEVEL 1	1 BDR + DEN	6
LEVEL 2	1 BDR + DEN	9
LEVEL 3	1 BDR + DEN	9
LEVEL 4	1 BDR + DEN	9
LEVEL 5	1 BDR + DEN	9
LEVEL 6	1 BDR + DEN	9
LEVEL 7	1 BDR + DEN	9
LEVEL 8	1 BDR + DEN	9
LEVEL 9	1 BDR + DEN	9
LEVEL 10	1 BDR + DEN	9
LEVEL 11	1 BDR + DEN	9
LEVEL 12	1 BDR + DEN	6
TOTAL: 102		

2 BDR + DEN - TOWER A		
NIVEAU	NOM	NOMBRE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

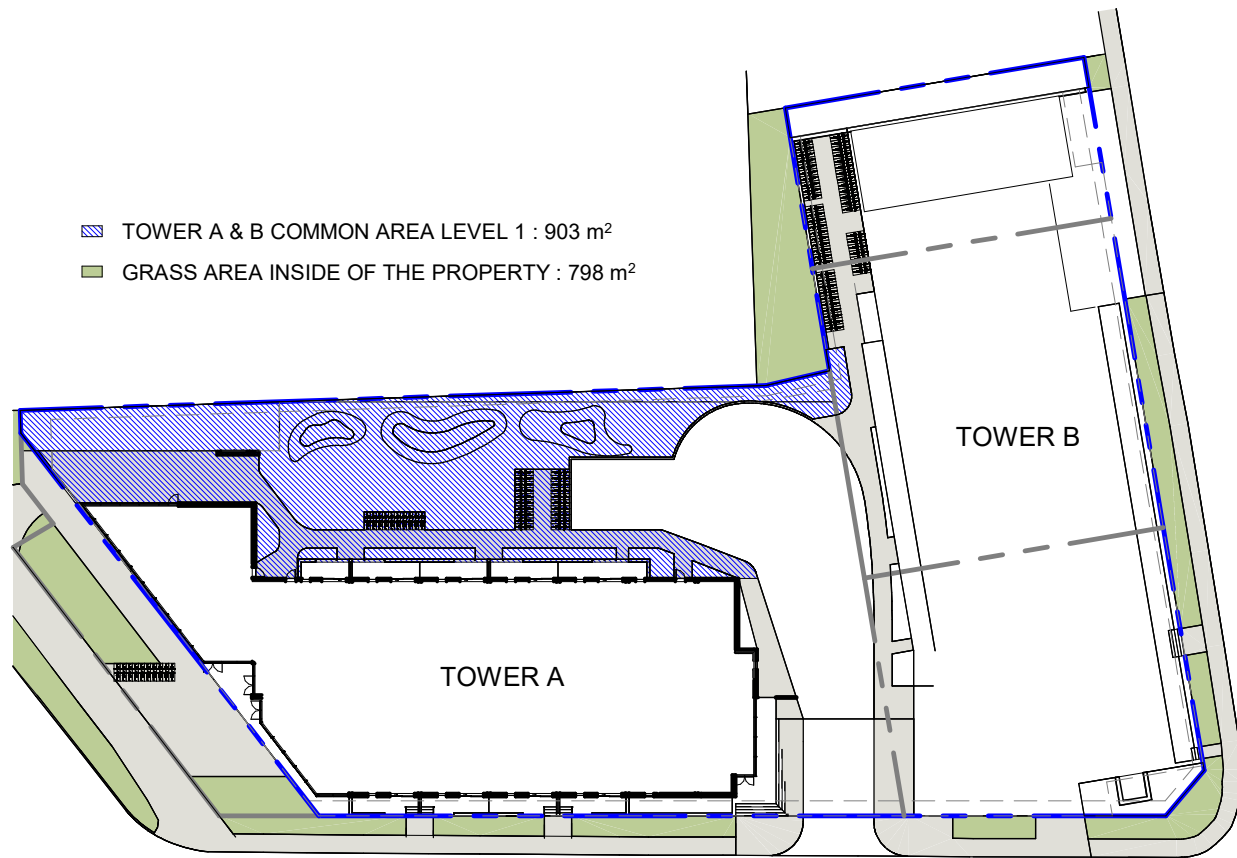


SITE PLAN - AMENITIES AREA
LEVEL 1

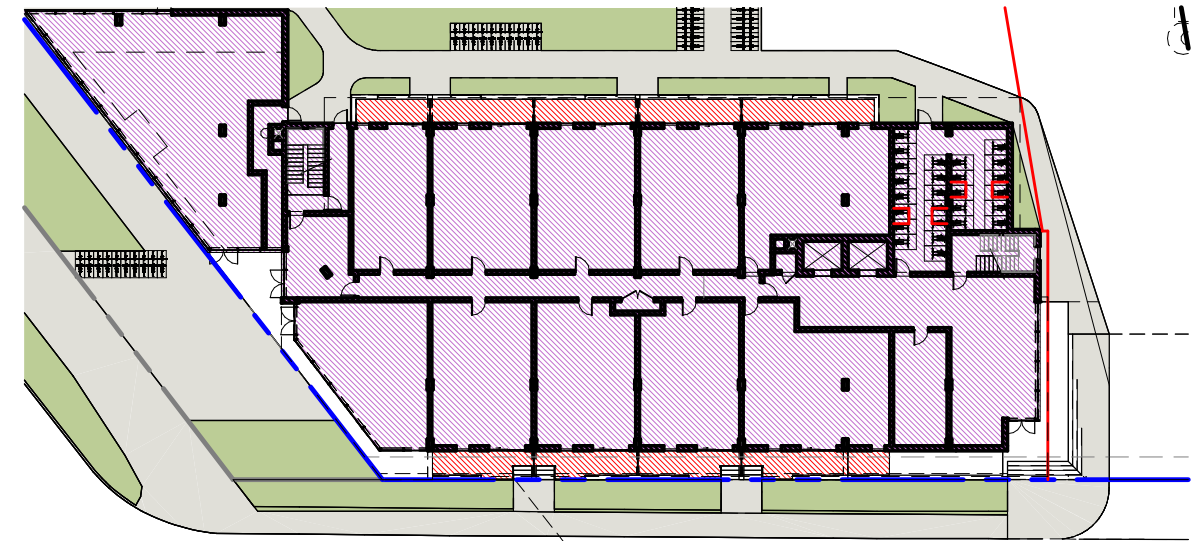

TOWER A - AMENITIES AREA
LEVEL 1

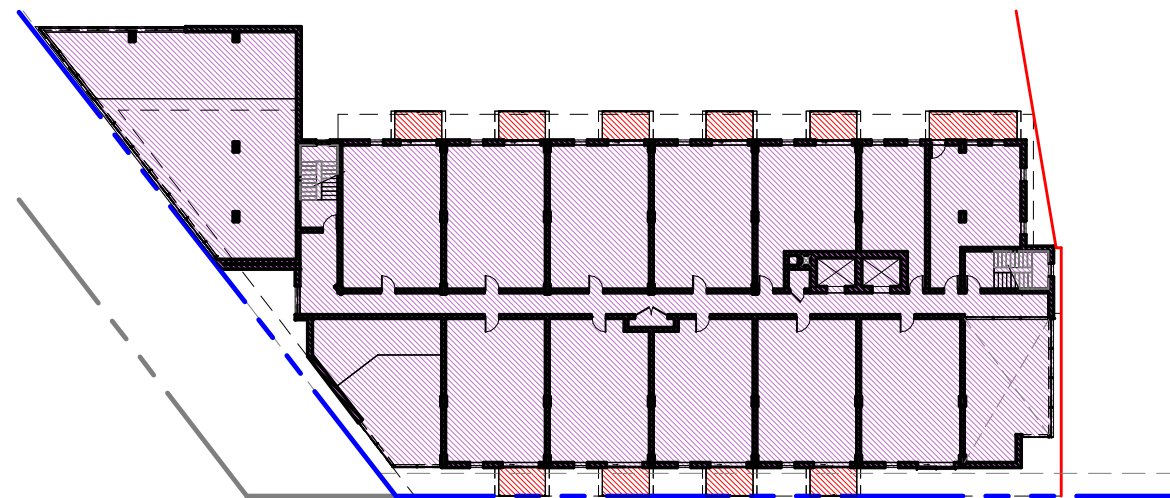

TOWER A - AMENITIES AREA
LEVEL 2

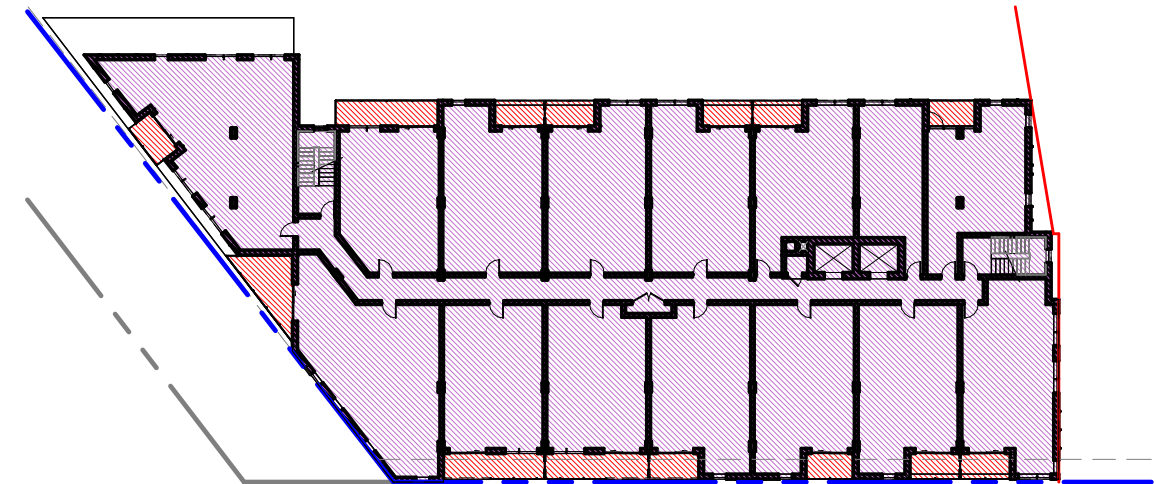

TOWER A - AMENITIES AREA
LEVEL 3 TO 6


GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

As indicated


D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

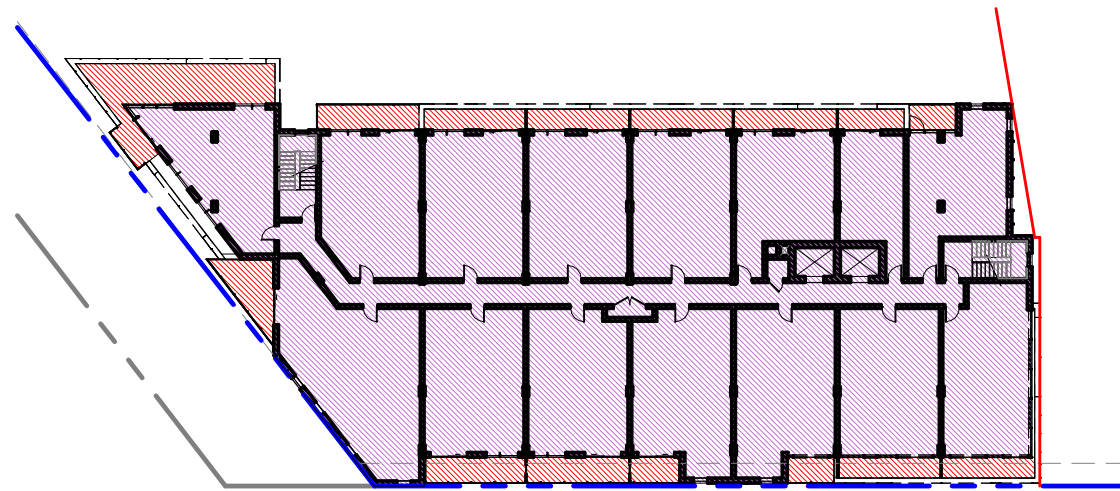


■ BALCONY AREA LEVEL 7 : 164 m² / 15 UNITS = 10.93 m²
■ GROSS AREA LEVEL 7 : 1146.39 m²

TOWER A - AMENITIES AREA LEVEL 7

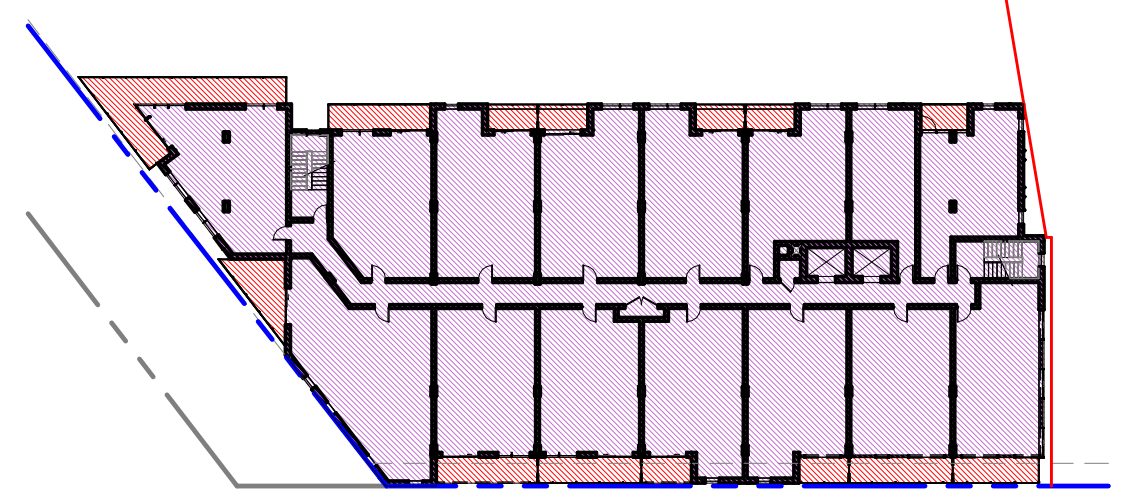

■ BALCONY AREA LEVEL 8 : 140 m² / 15 UNITS = 9.33 m²
■ GROSS AREA LEVEL 8 TO 11 : 1188.44 m²

TOWER A - AMENITIES AREA LEVEL 8 TO 11

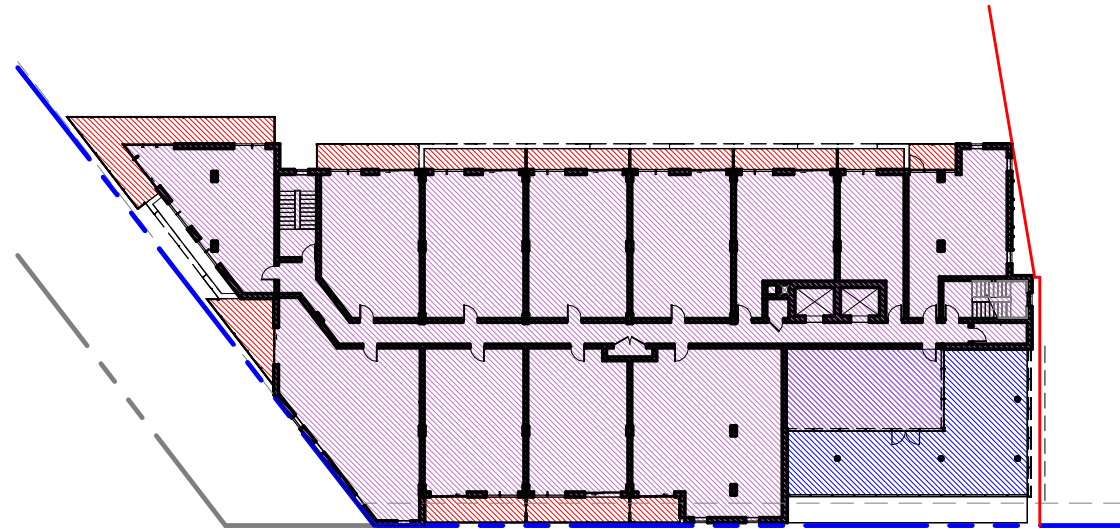

■ BALCONY AREA LEVEL 12 : 134 m² / 12 UNITS = 11.17 m²
■ GROSS AREA LEVEL 12 : 1044.76 m²
■ TOWER A COMMON AREA LEVEL 12 : 152 m²

TOWER A - AMENITIES AREA LEVEL 12

PRIVATE AMENITIES AREA

- BALCONY AREA LEVEL 1 : 102 m² / 9 UNITS = 11.33 m²
- BALCONY AREA LEVEL 2 : 64 m² / 12 UNITS = 5.33 m²
- BALCONY AREA LEVEL 3 : 103 m² / 15 UNITS = 6.87 m²
- BALCONY AREA LEVEL 4 : 103 m² / 15 UNITS = 6.87 m²
- BALCONY AREA LEVEL 5 : 103 m² / 15 UNITS = 6.87 m²
- BALCONY AREA LEVEL 6 : 103 m² / 15 UNITS = 6.87 m²
- BALCONY AREA LEVEL 7 : 164 m² / 15 UNITS = 10.93 m²
- BALCONY AREA LEVEL 8 : 140 m² / 15 UNITS = 9.33 m²
- BALCONY AREA LEVEL 9 : 140 m² / 15 UNITS = 9.33 m²
- BALCONY AREA LEVEL 10 : 140 m² / 15 UNITS = 9.33 m²
- BALCONY AREA LEVEL 11 : 140 m² / 15 UNITS = 9.33 m²
- BALCONY AREA LEVEL 12 : 134 m² / 12 UNITS = 11.17 m²

TOTAL PRIVATE AREA : 1436 m² / 168 UNITS = 8.55 m²
 REQUIRED 6 m²/ UNITS

COMMON AMENITIES AREA

- TOWER A & B COMMON AREA LEVEL 1 : 903 m²
- TOWER A COMMON AREA LEVEL 12 : 152 m²
- TOWER B COMMON AREA TOTAL : 222 m²
- GRASS AREA INSIDE OF THE PROPERTY : 798 m²


GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

As indicated

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

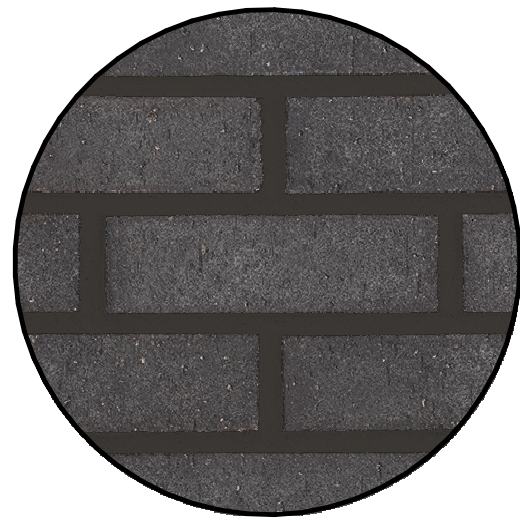

1

MASONRY
GLEN-GERY
COLOR VINTAGE
BLACK VELOUR




2

MASONRY
GLEN-GERY
COLOR REVERE
PEWTER VELOUR




3

ALUMINIUM SIDING
ALUPLANK
COLOR ACADIA
AXOTIC HONEY

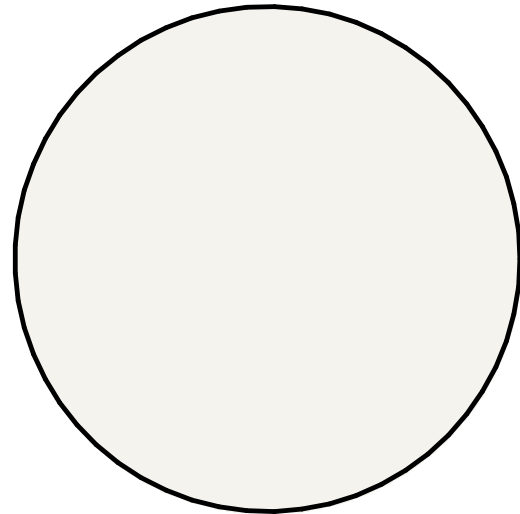


4

ALUMINIUM PANELS
ALUTECH
SICO COLOR NATURAL
WHITE 6000-11

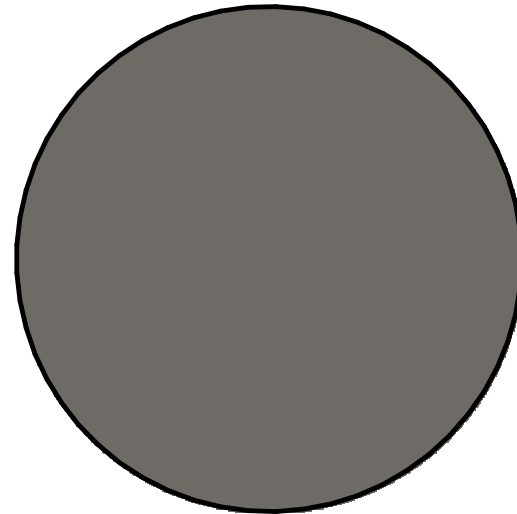


5

ALUMINIUM PANELS
ALUTECH
SICO COLOR NIGHT
OWL 6183-63

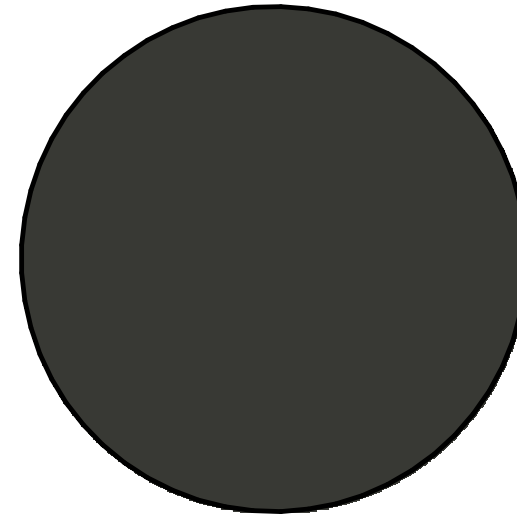


6

ALUMINIUM PANELS
ALUTECH
SICO COLOR BLACK
PEPPER 6182-83

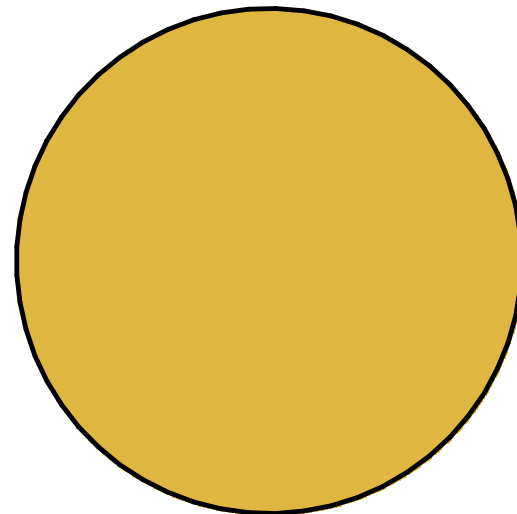

7

ALUMINIUM PANELS
ALUTECH
SICO COLOR GREEN
TOMATO RELISH
6097-64

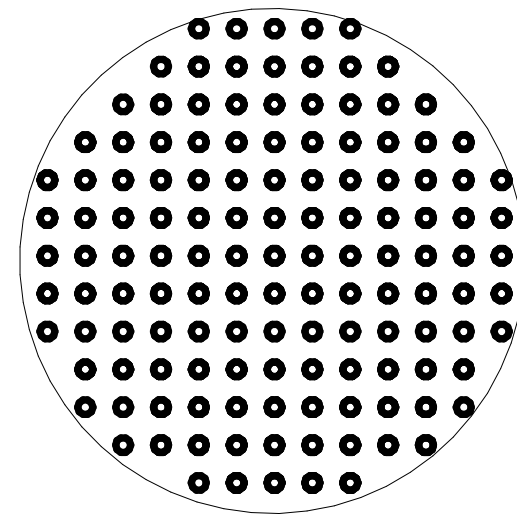

8

BIRD SAFETY WINDOW FILM
DOTS WITH MAXIMUM
SPACING OF 50 MM BY 50
MM, MINIMUM OF 4 MM
DIAMETER. TO BE APPLY ON
THE GLASS BALCONIES FOR
THE FIRST 4 FLOORS.

NOTE : COLORS SHOWN MAY VARY DUE TO SCREEN RESOLUTION. PLEASE SEE ACTUAL PRODUCTS SAMPLE FOR TRUE COLOR.

EXTERIOR MATERIALS

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

STATISTICS OF THE % MATÉRIALS
 BUILDING AREA : 1741 m²
 OPENING AREA : 800 m² (45.95%)
 MASONRY : 413 m² (23.72%)
 ALUMINIUM : 510 m² (29.29%)
 OTHER : 18 m² (1.03%)



TOWER A - FRONT ELEVATION (FOREST STREET)

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

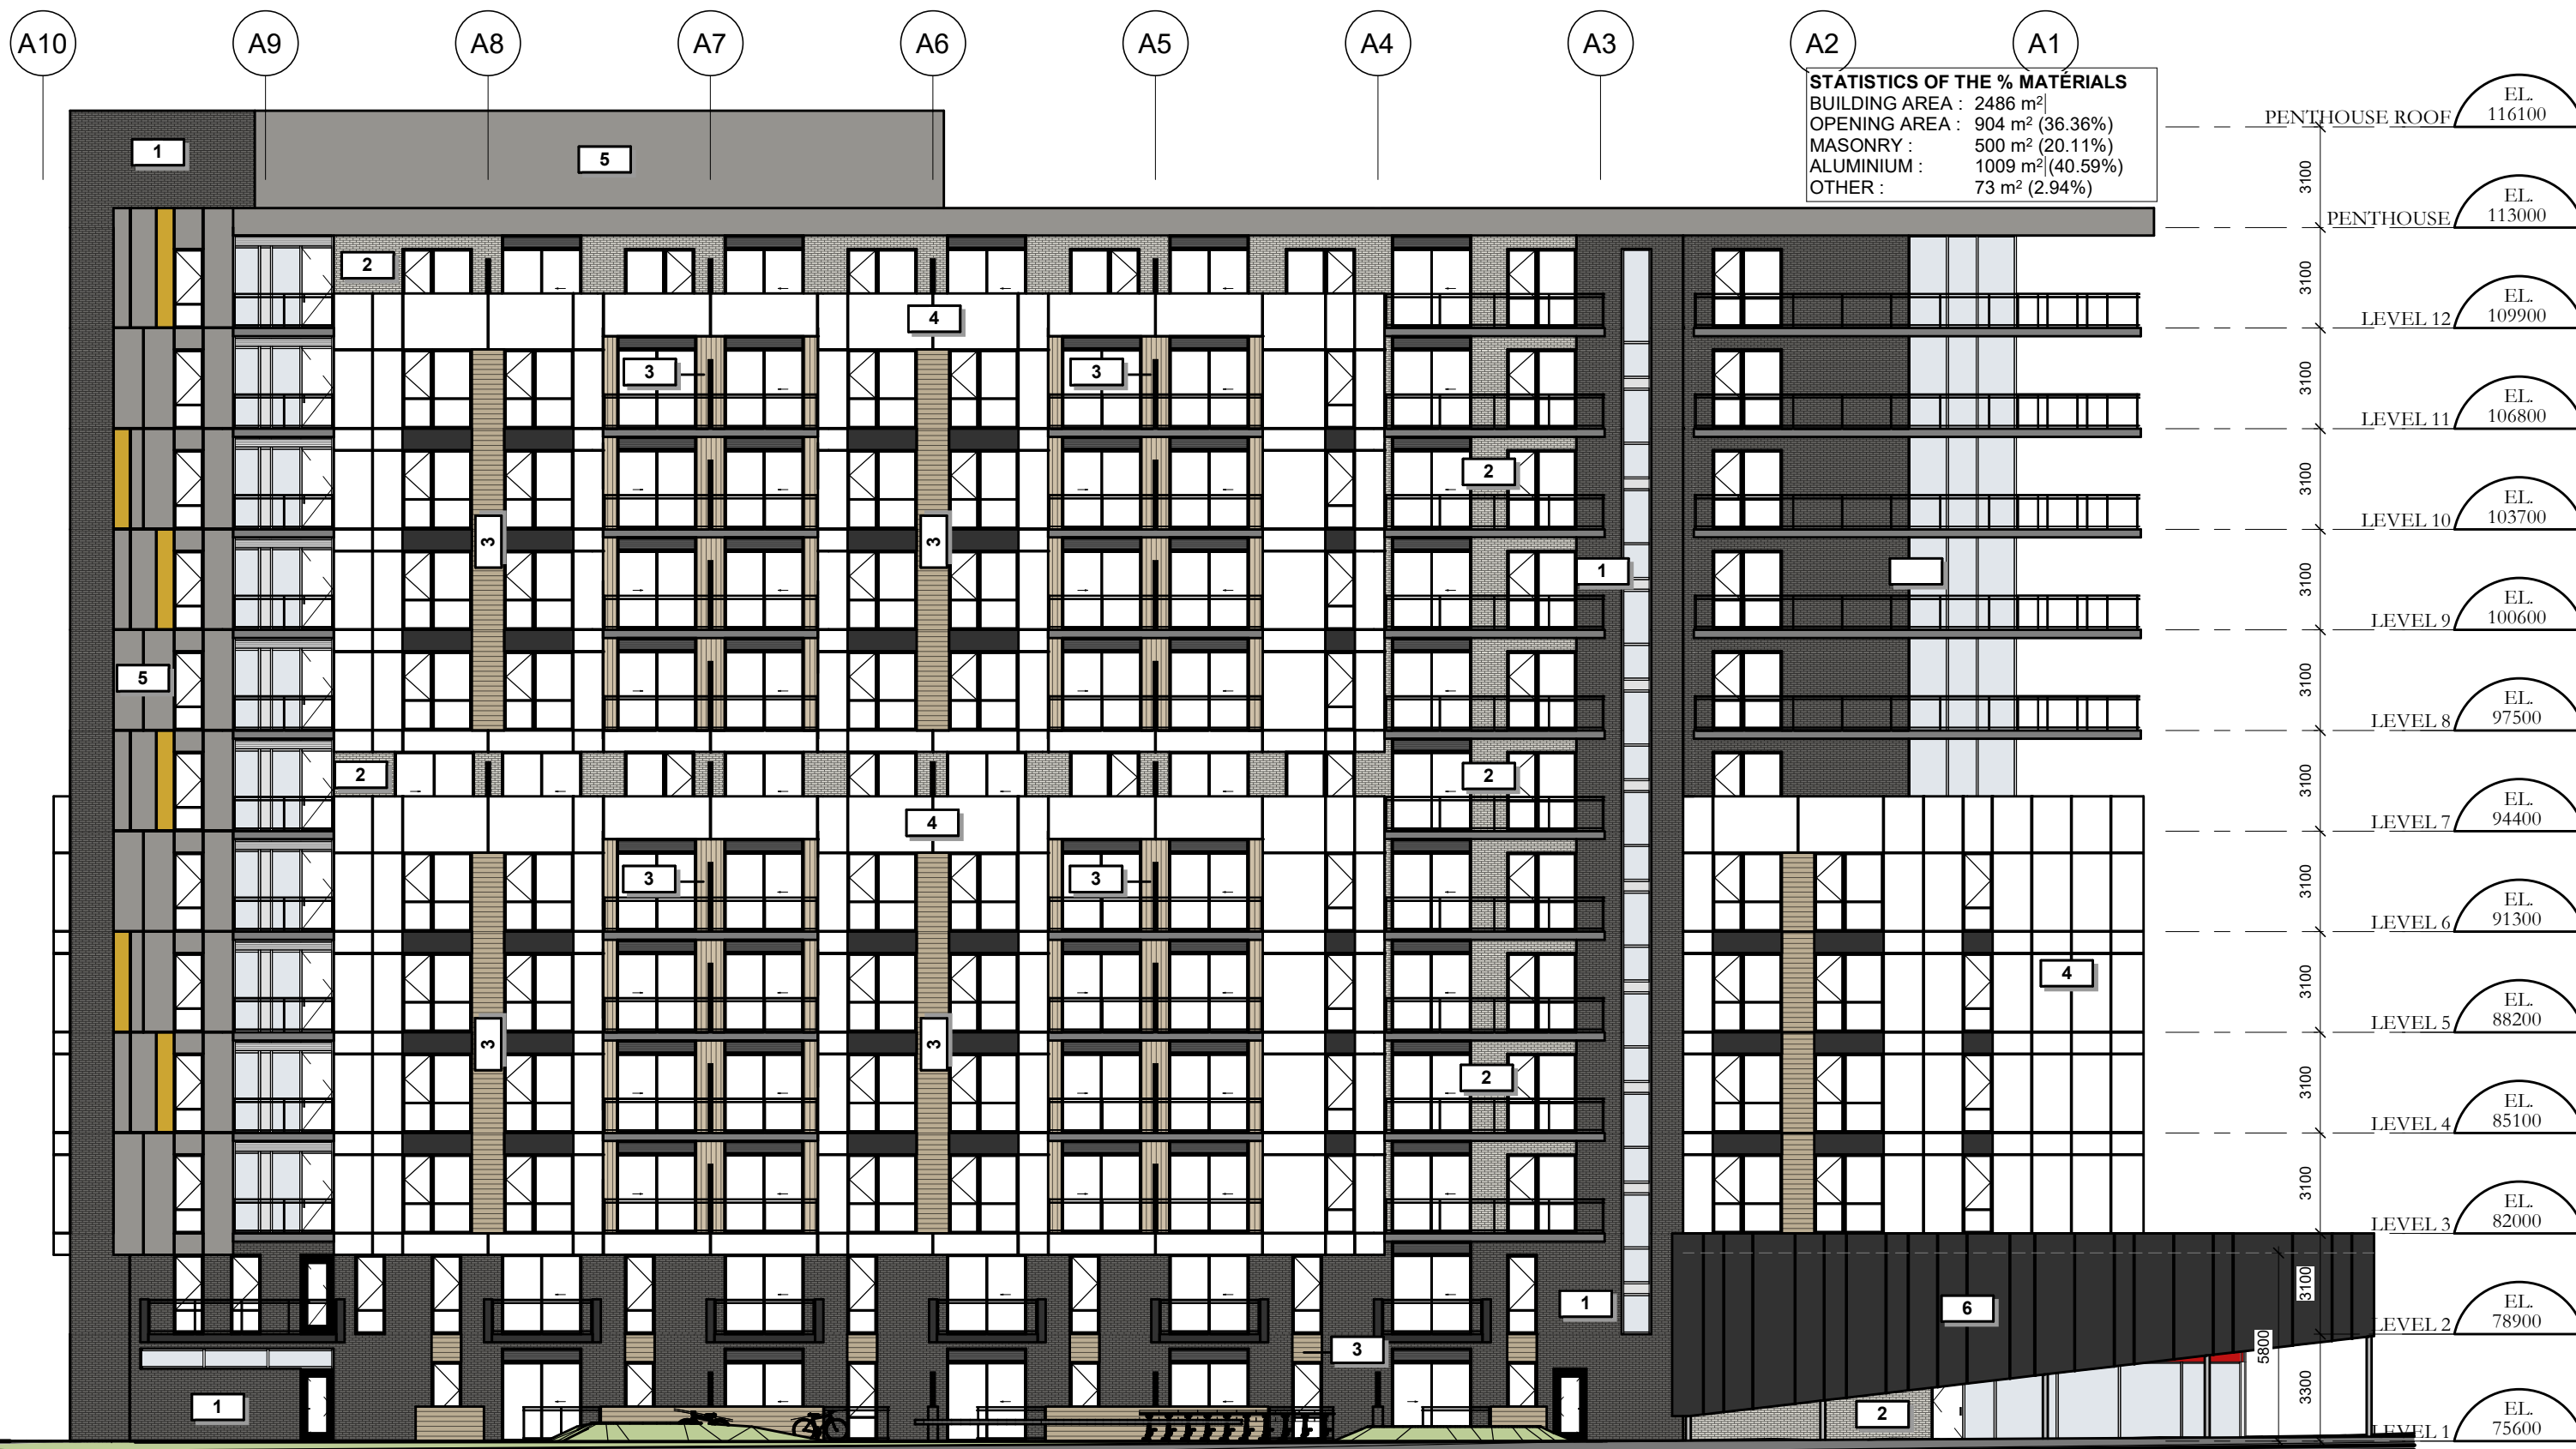

TOWER A - BACK ELEVATION

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

STATISTICS OF THE % MATERIALS
 BUILDING AREA : 1305 m²
 OPENING AREA : 450 m² (34.48%)
 MASONRY : 51 m² (3.91%)
 ALUMINIUM : 777 m² (59.54%)
 OTHER : 27 m² (2.07%)

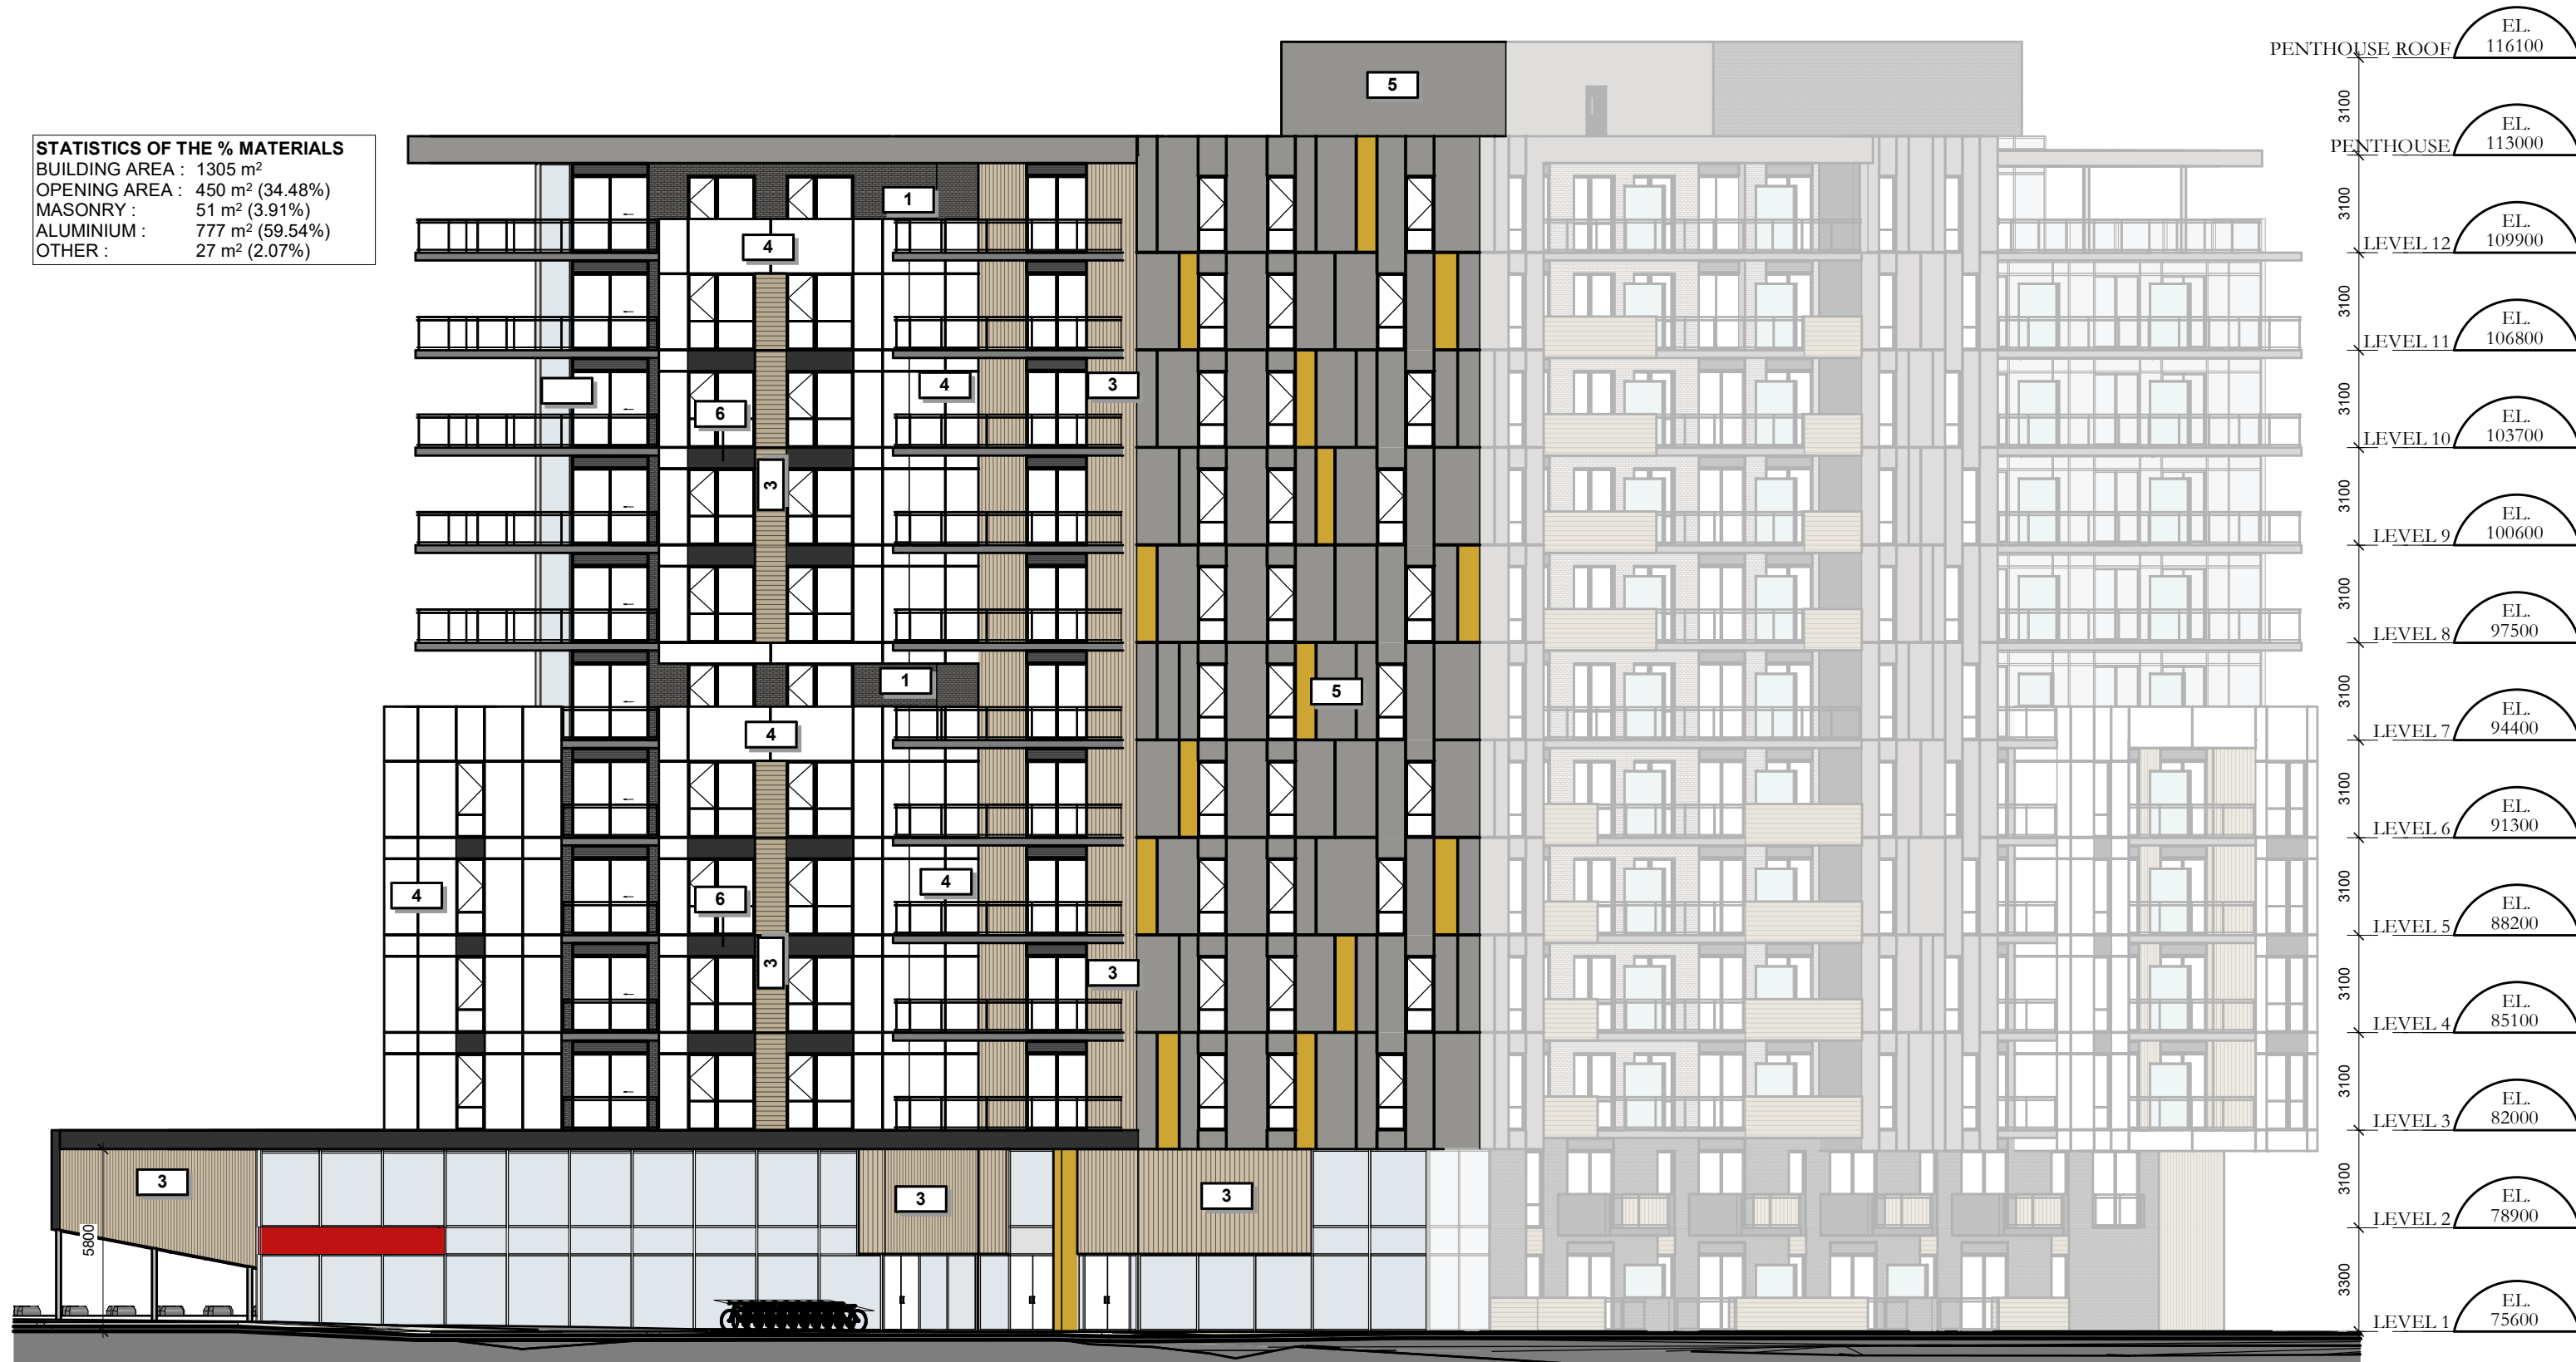

TOWER A - LEFT SIDE ELEVATION (RICHMOND ROAD)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault
 53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



STATISTICS OF THE % MATÉRIALS
 BUILDING AREA : 1059 m²
 OPENING AREA : 353 m² (33.33%)
 MASONRY : 231 m² (21.81%)
 ALUMINIUM : 473 m² (44.66%)
 OTHER : 2 m² (0.19%)

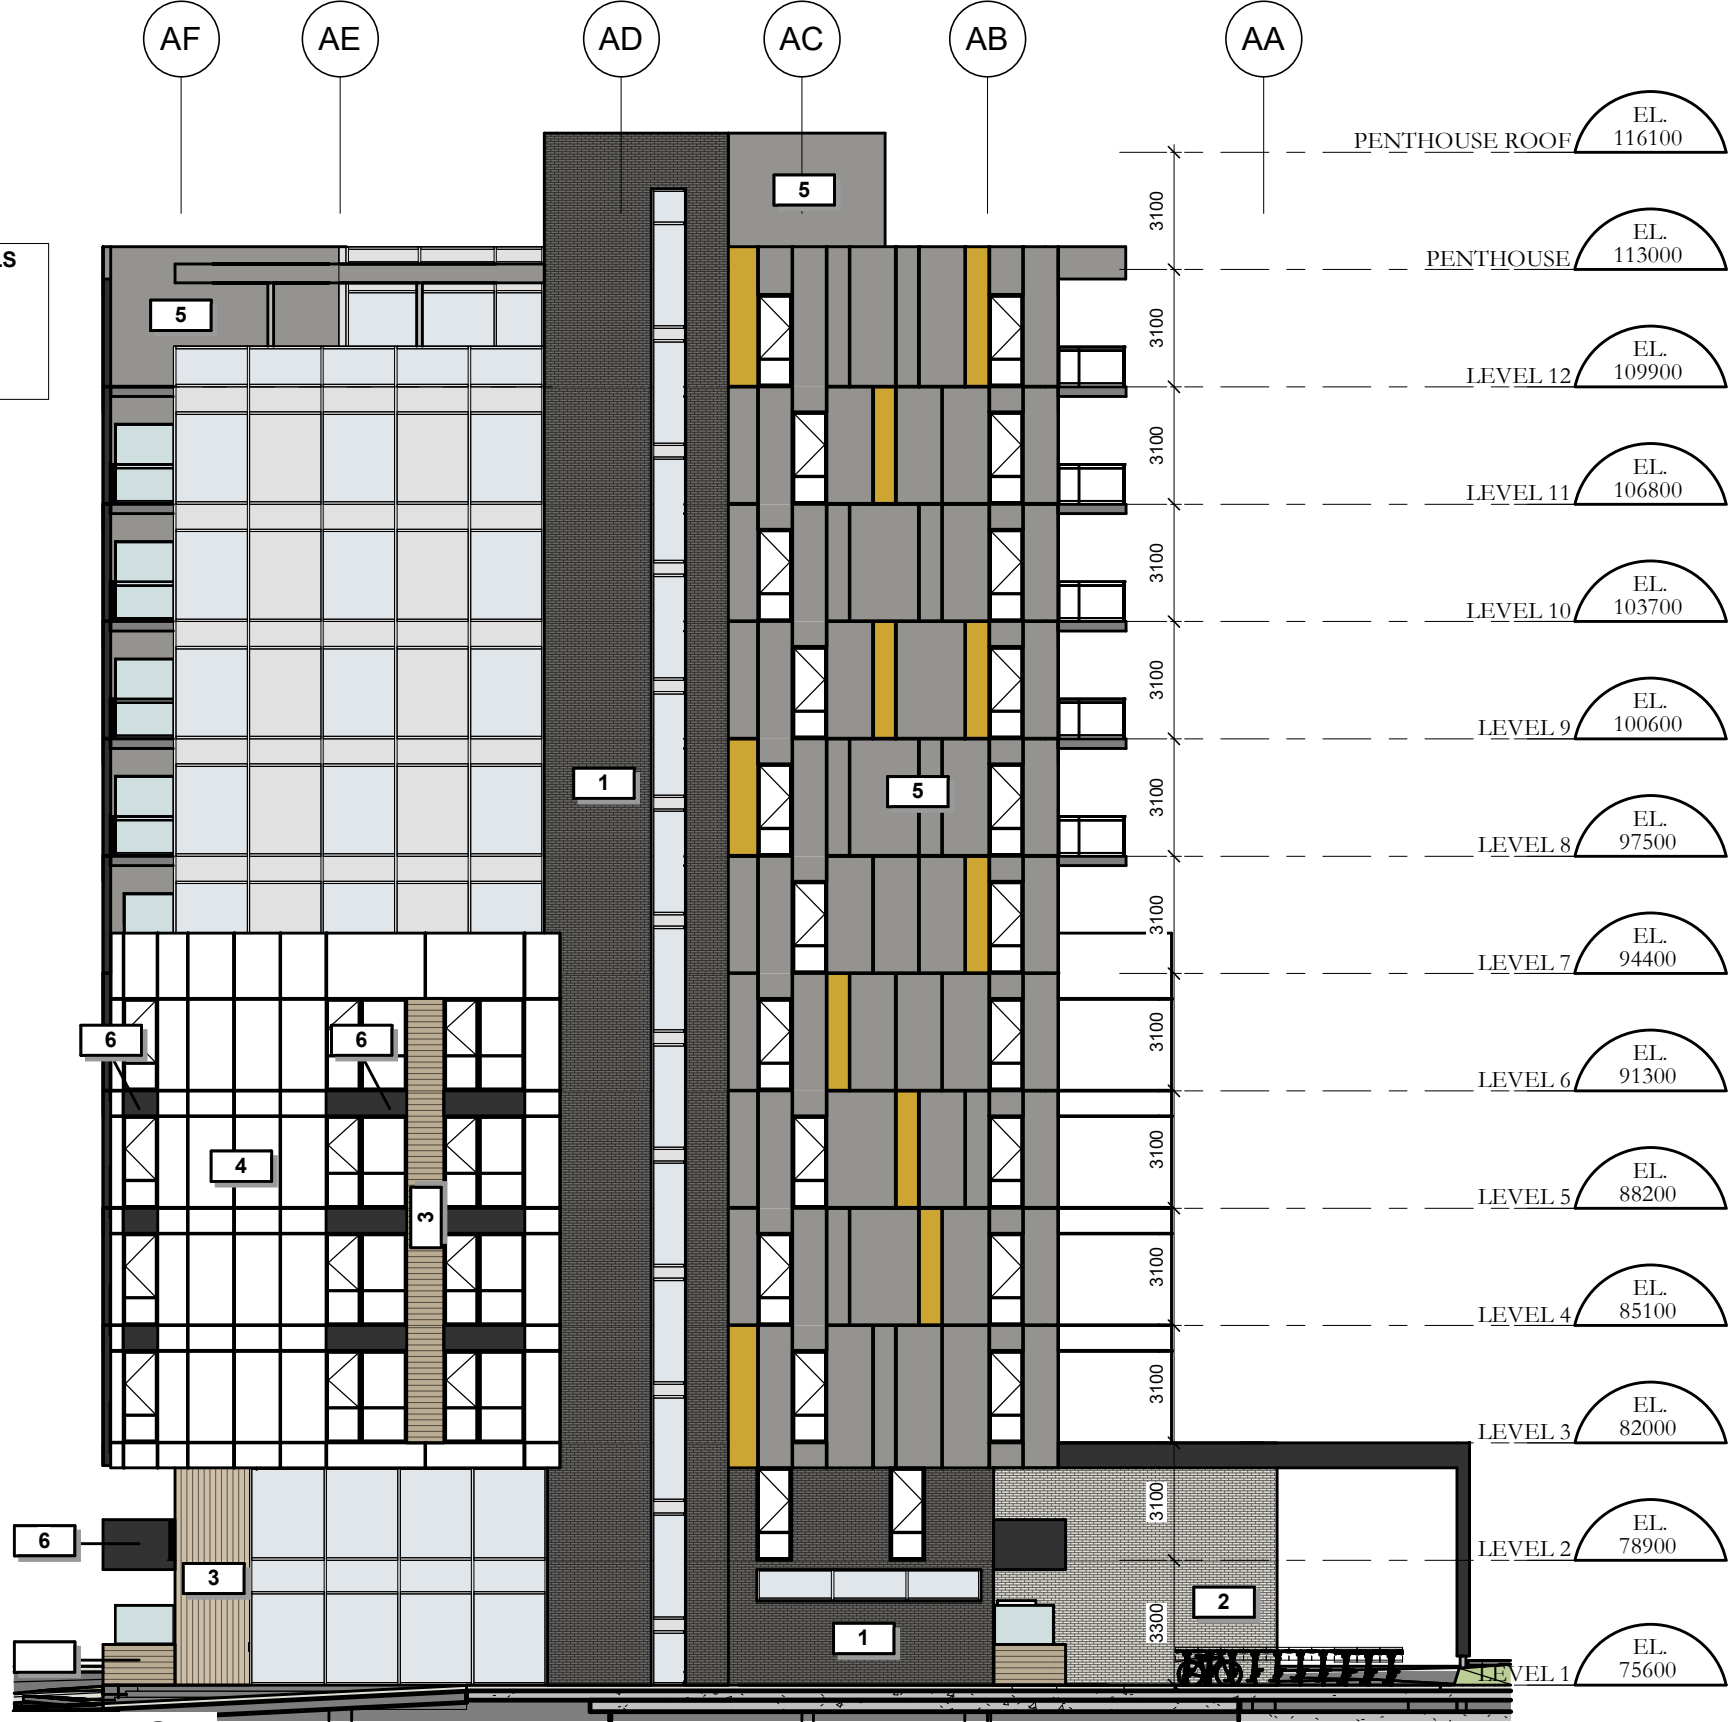

TOWER A - RIGHT SIDE ELEVATION

GROUP HEAFEY


365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault
 53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041	1887-2303-19
REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

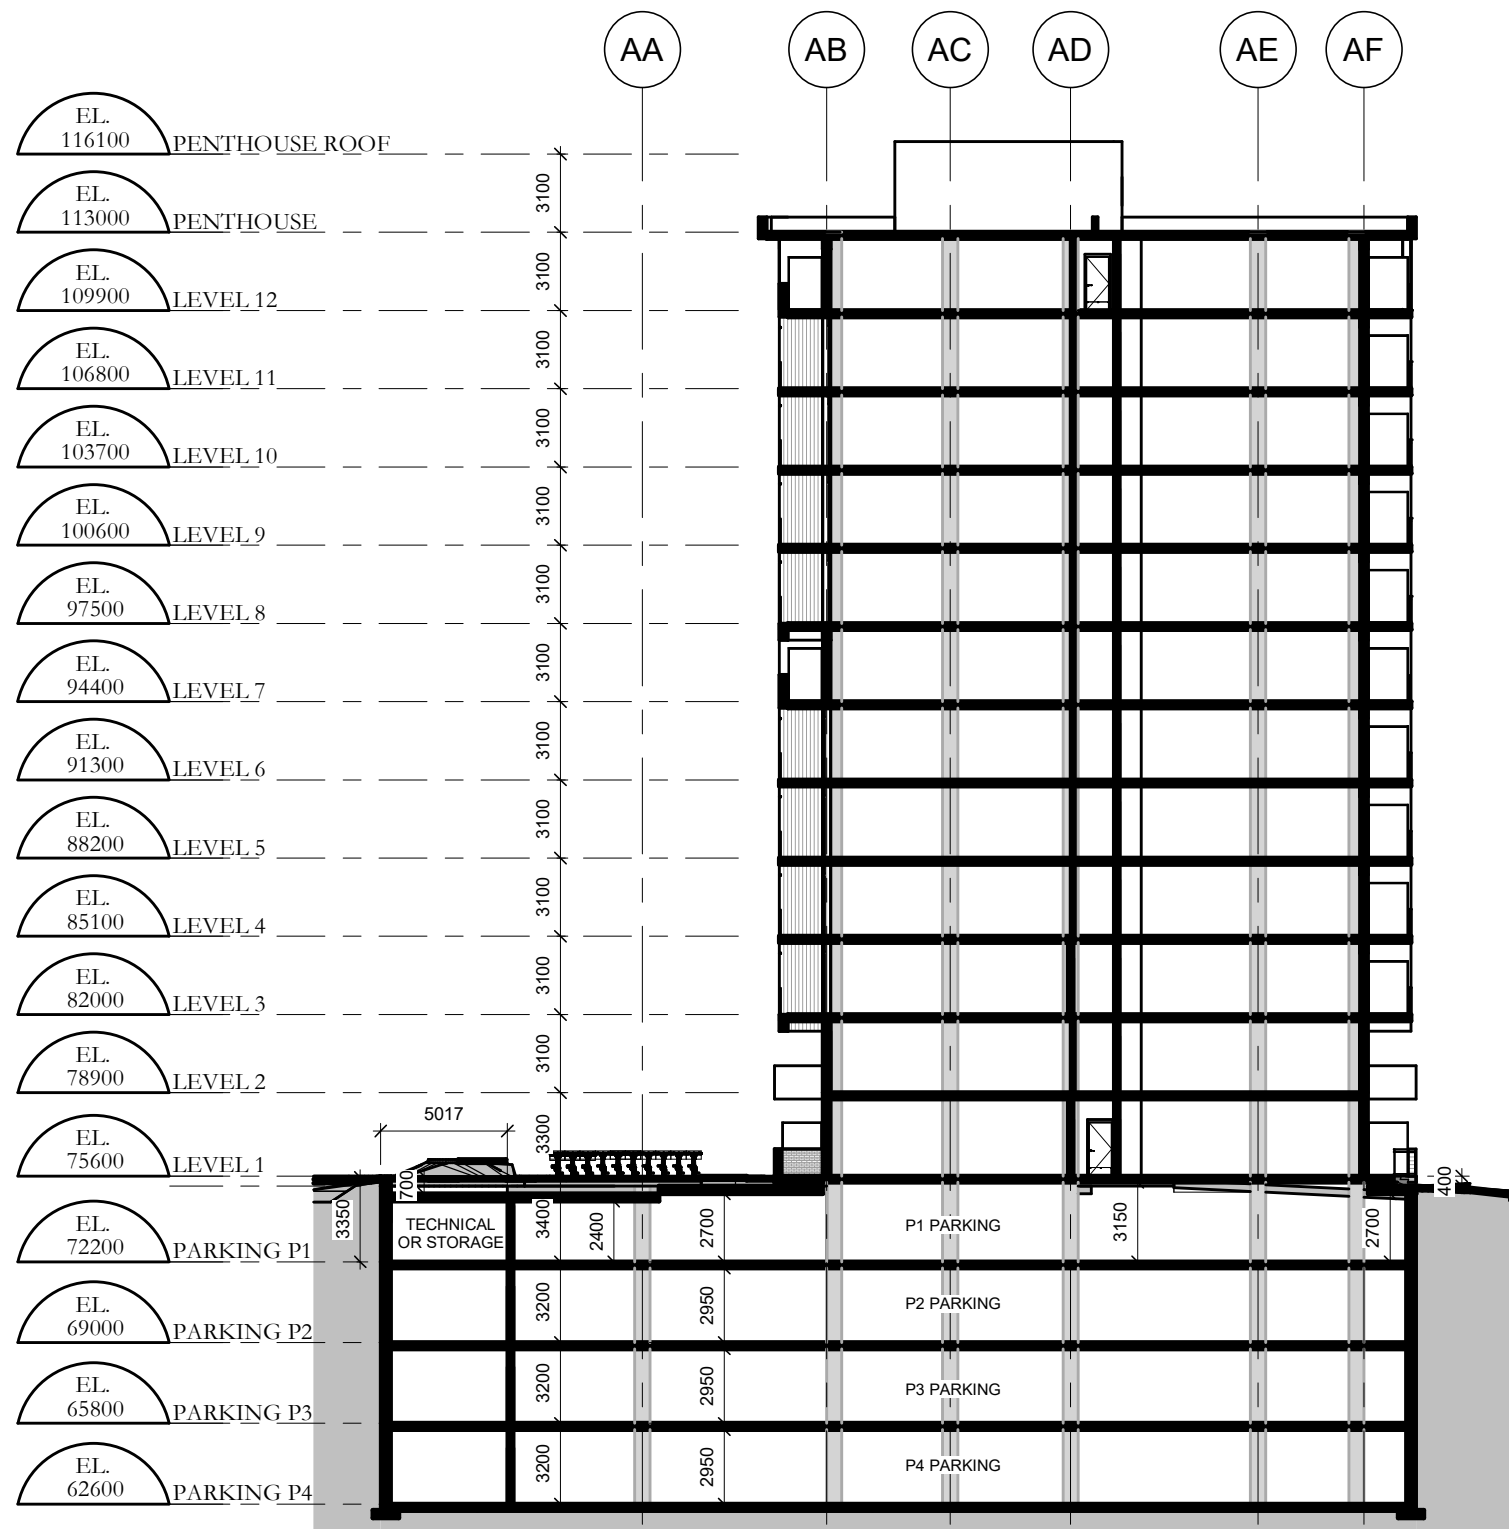

TOWER A - SECTION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 300

D07-12-20-0041 1887-2303-19




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

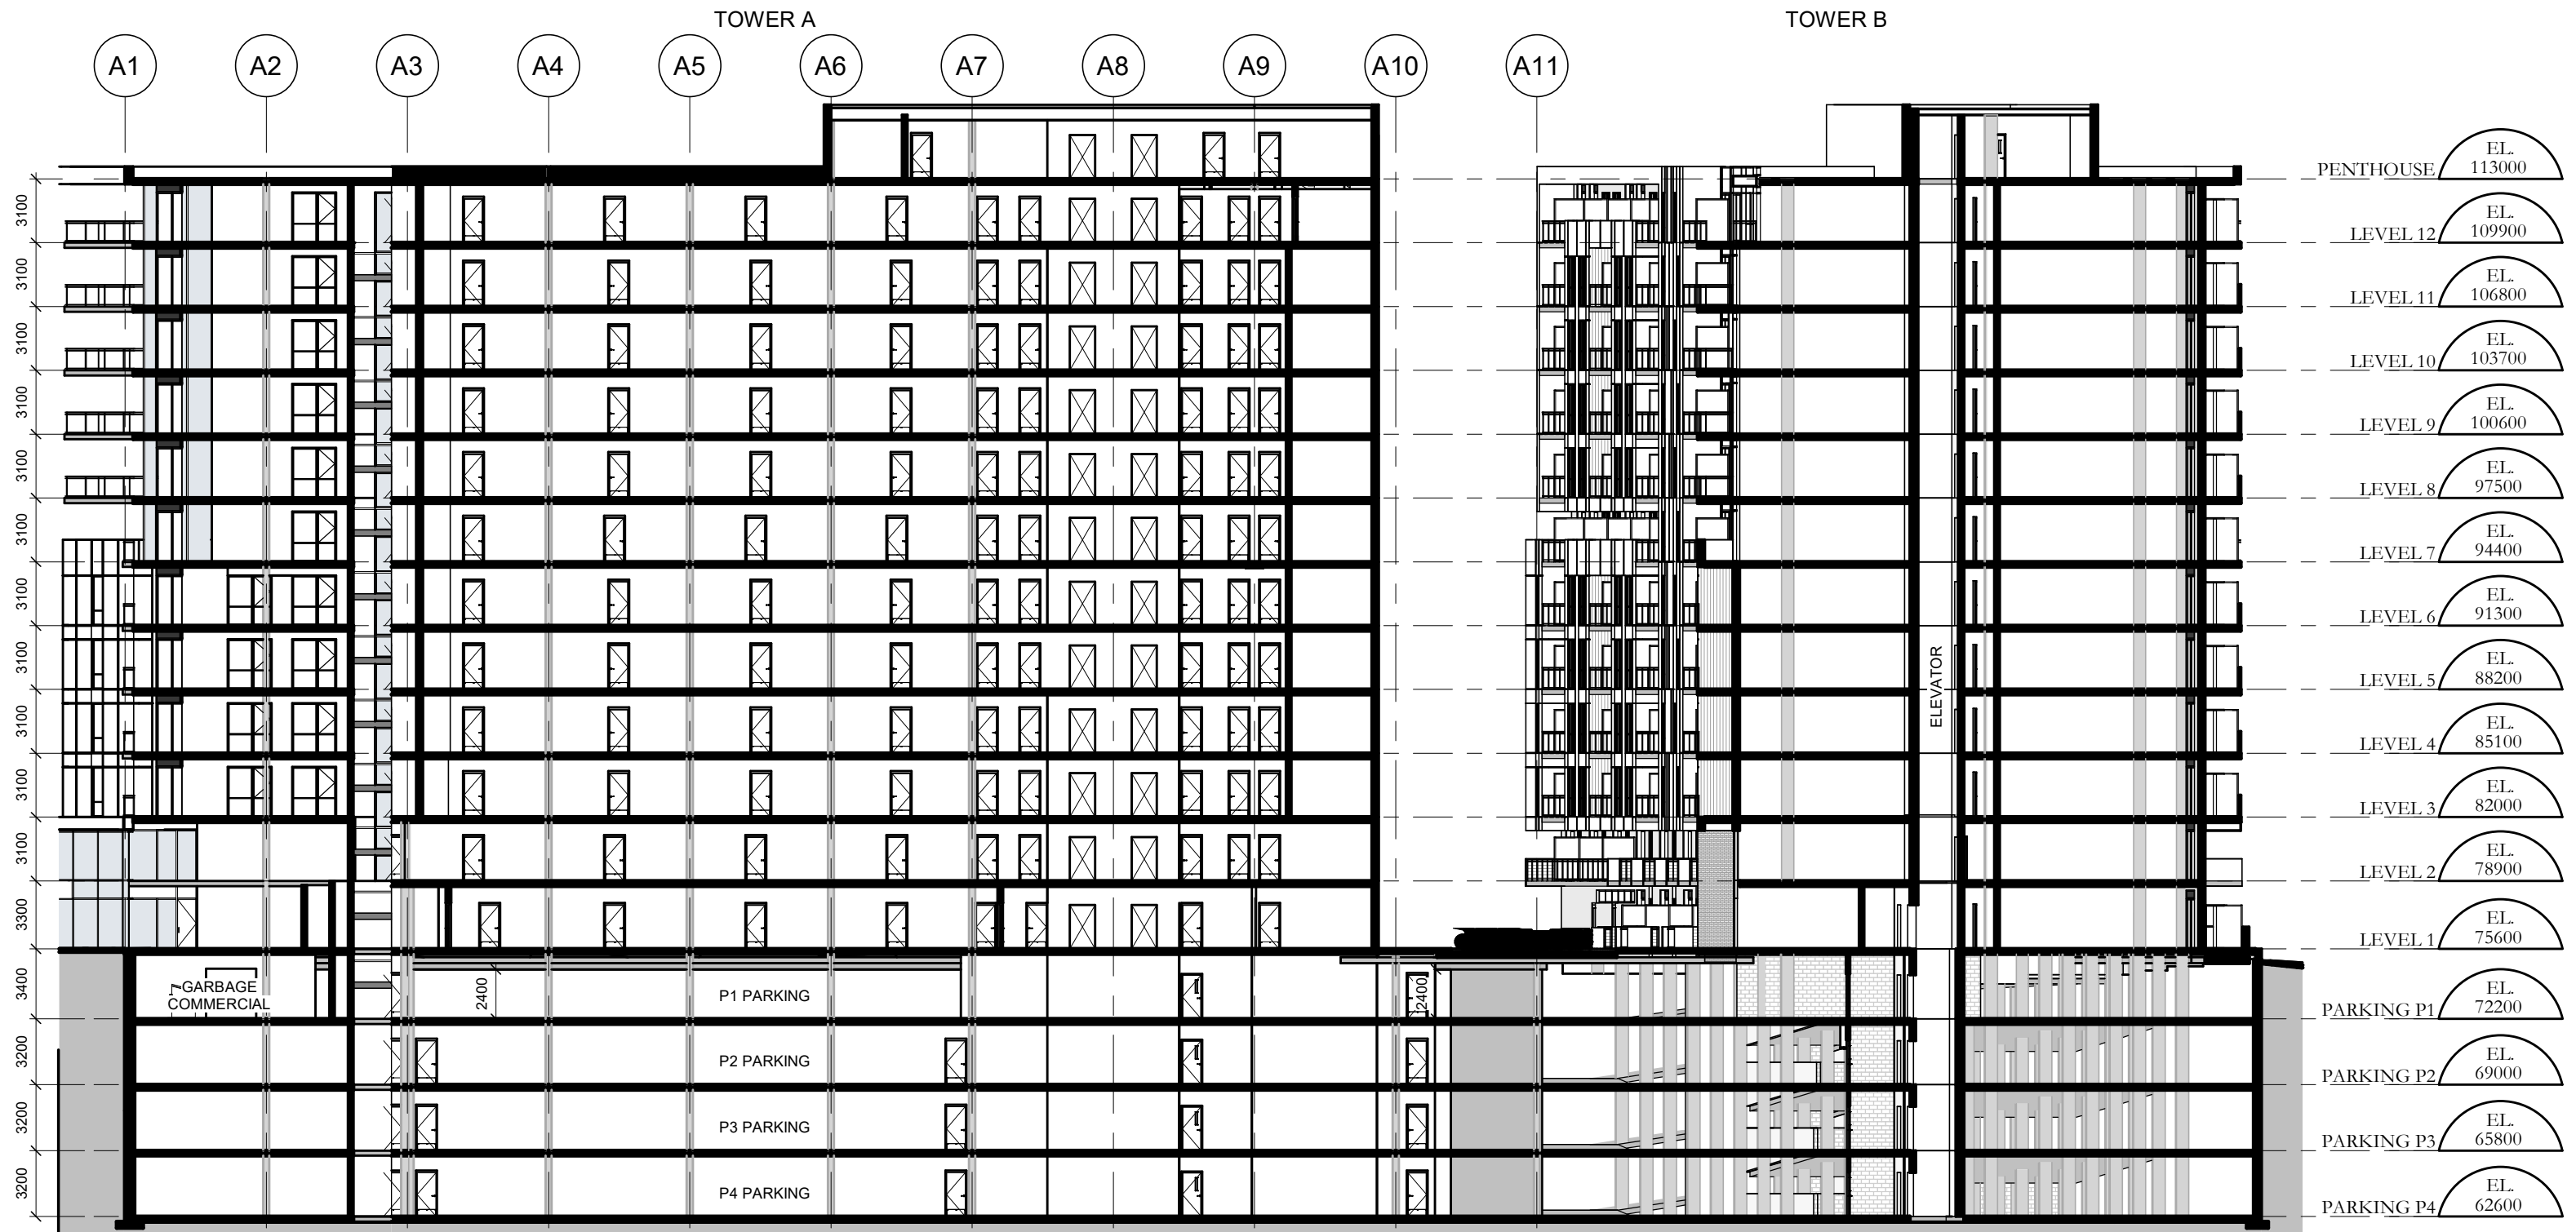

TOWER A & B - SECTION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 300



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

TOWER B

GROUPE HEAFEY
RICHMOND ROAD & FOREST STREET



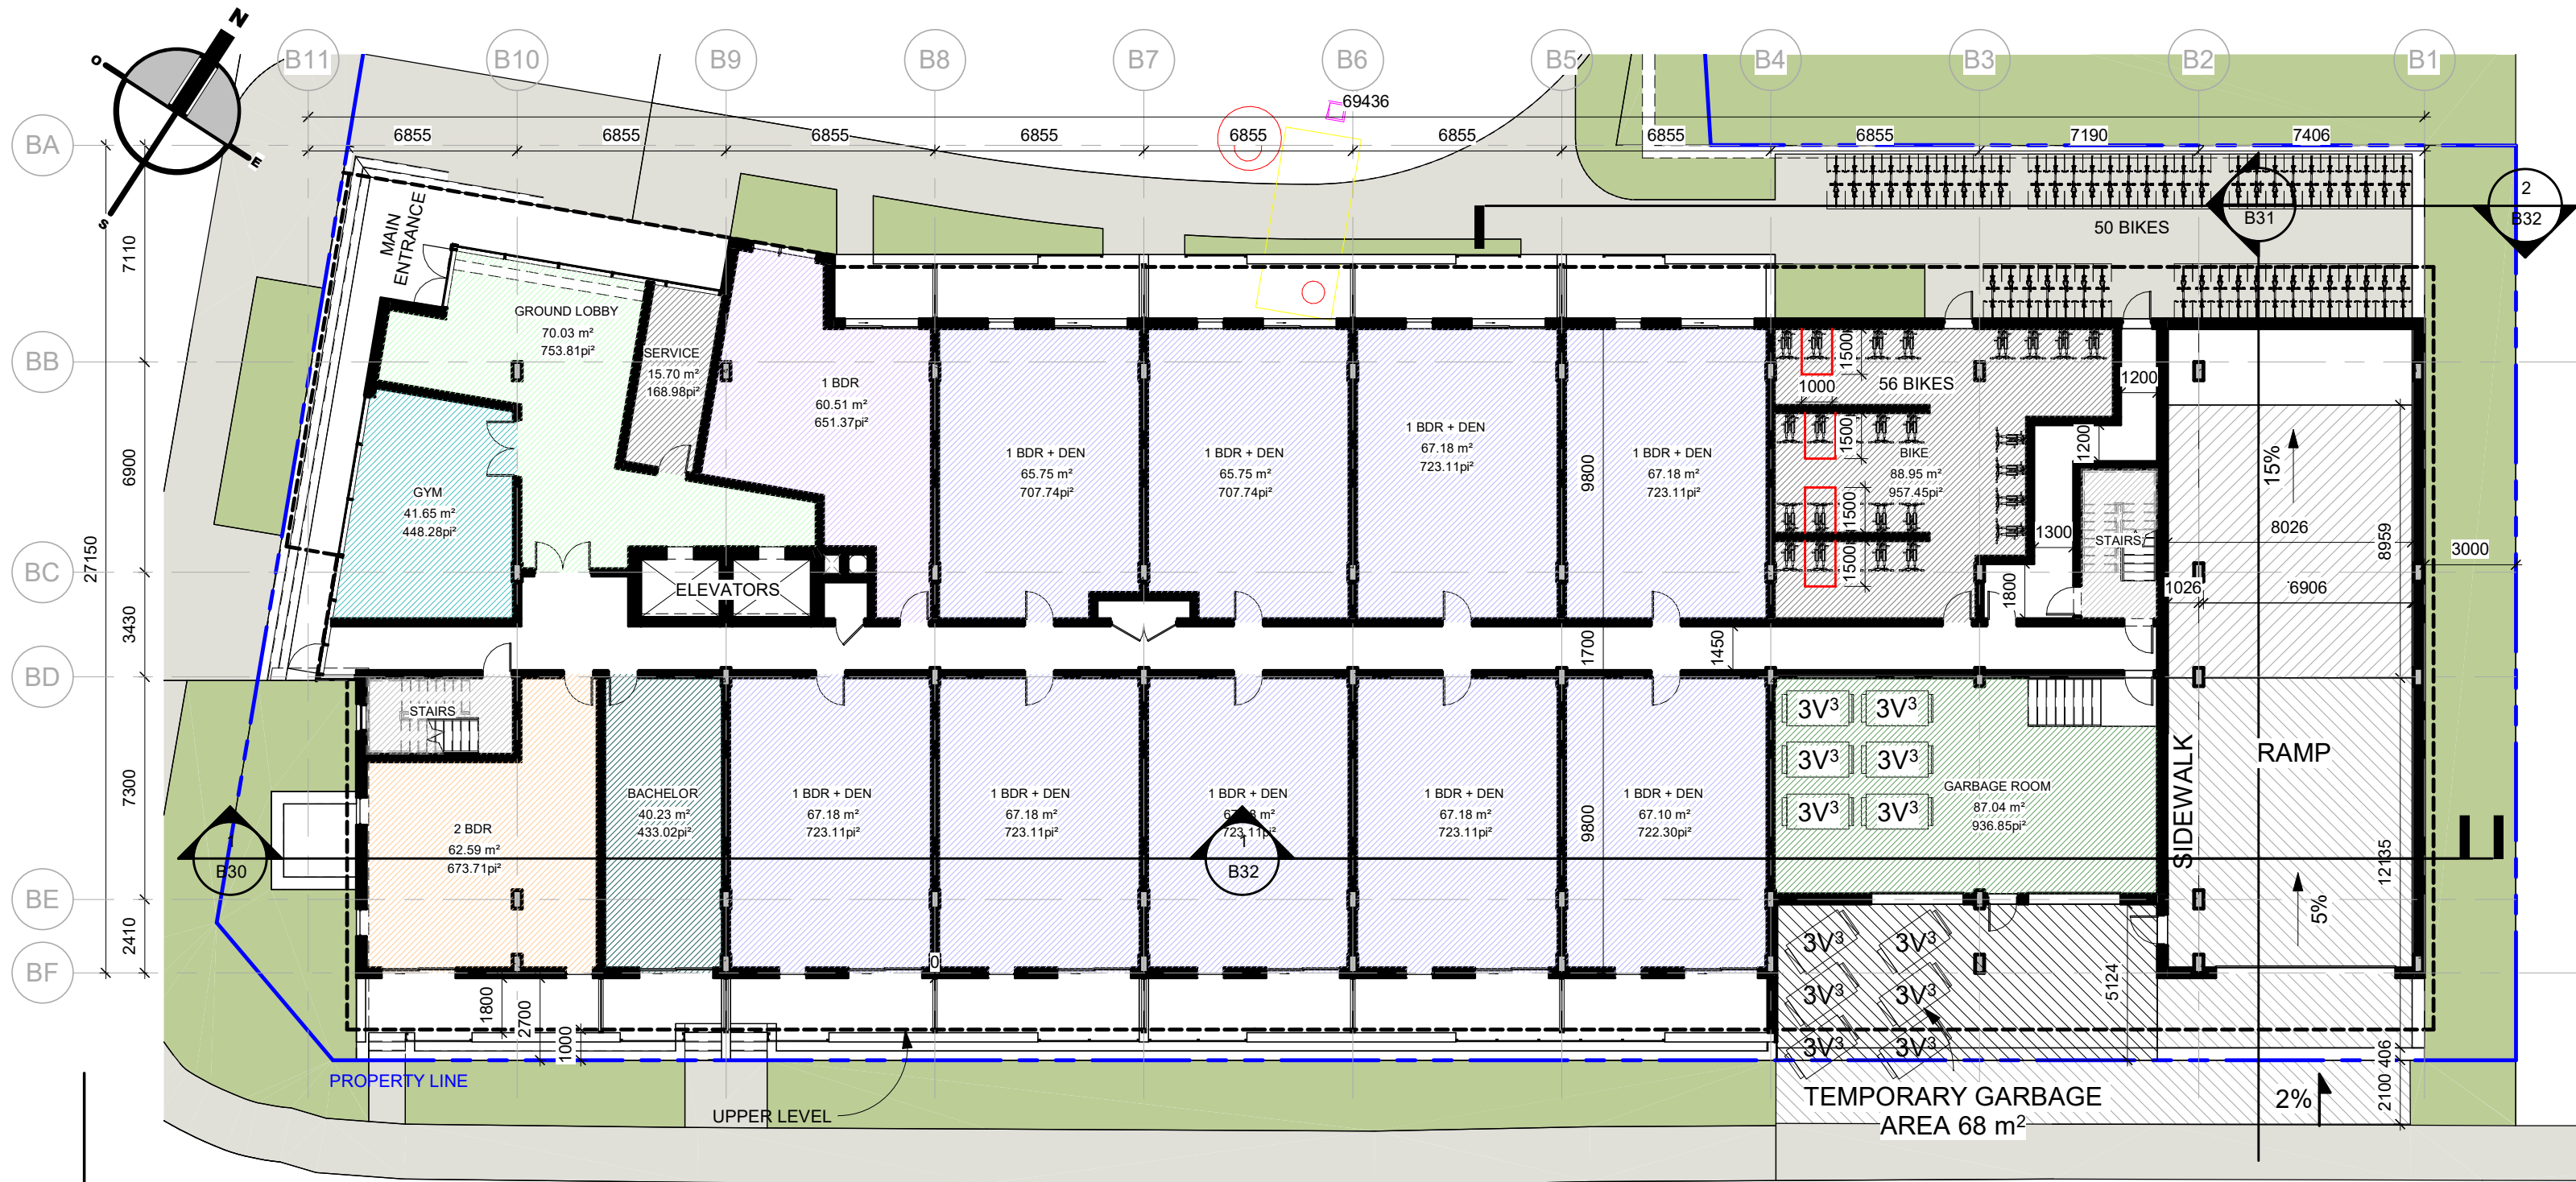

GROSS AREA LEGEND



TOWER B - LEVEL 1

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

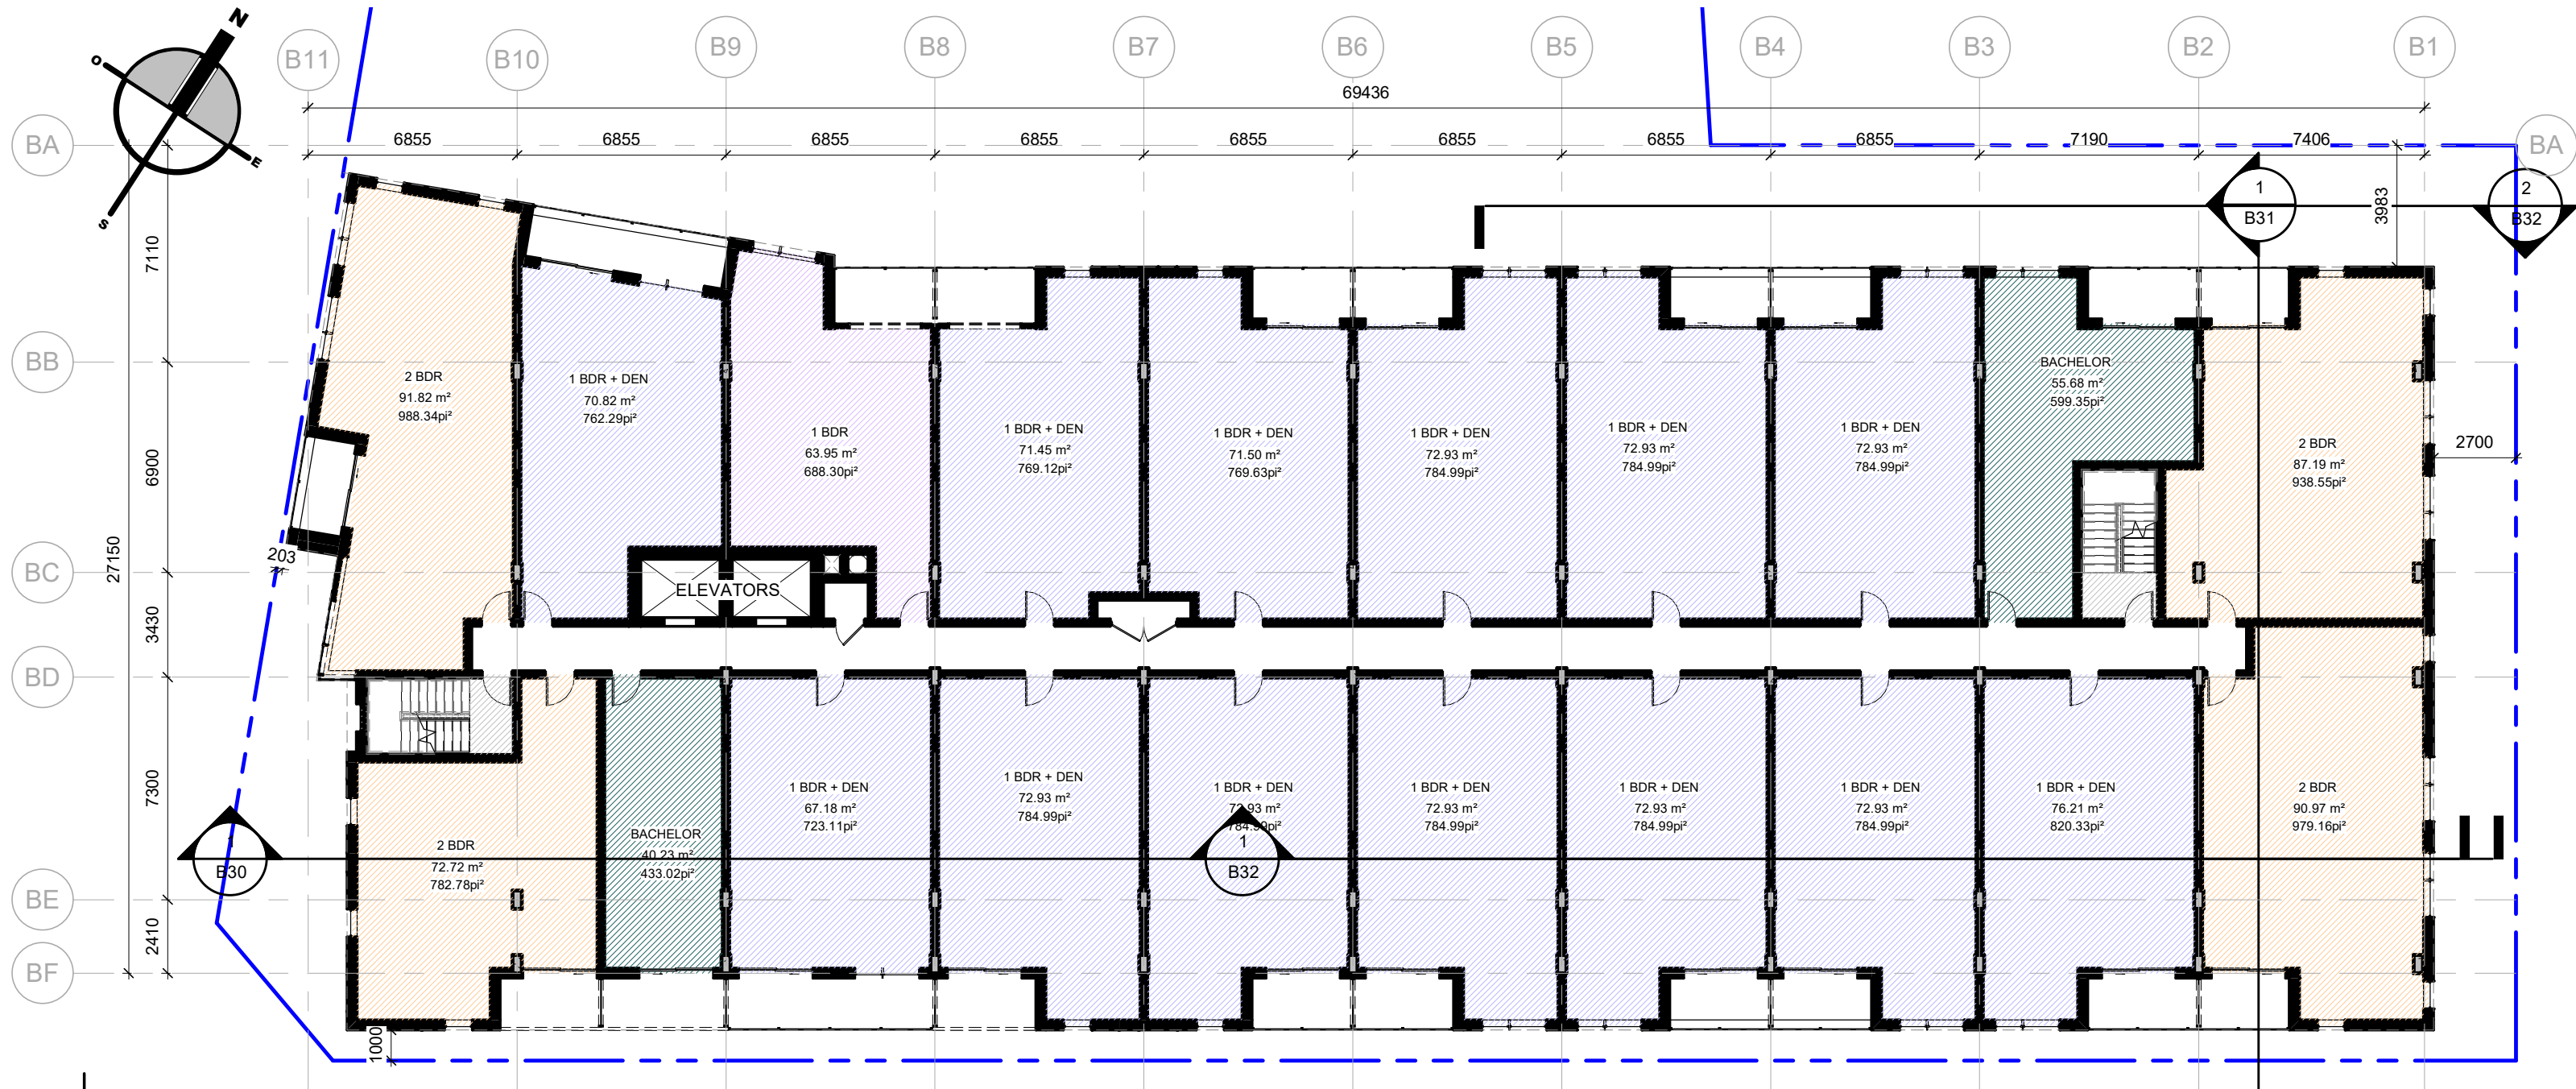

GROSS AREA LEGEND



TOWER B - LEVEL 3 TO 6

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

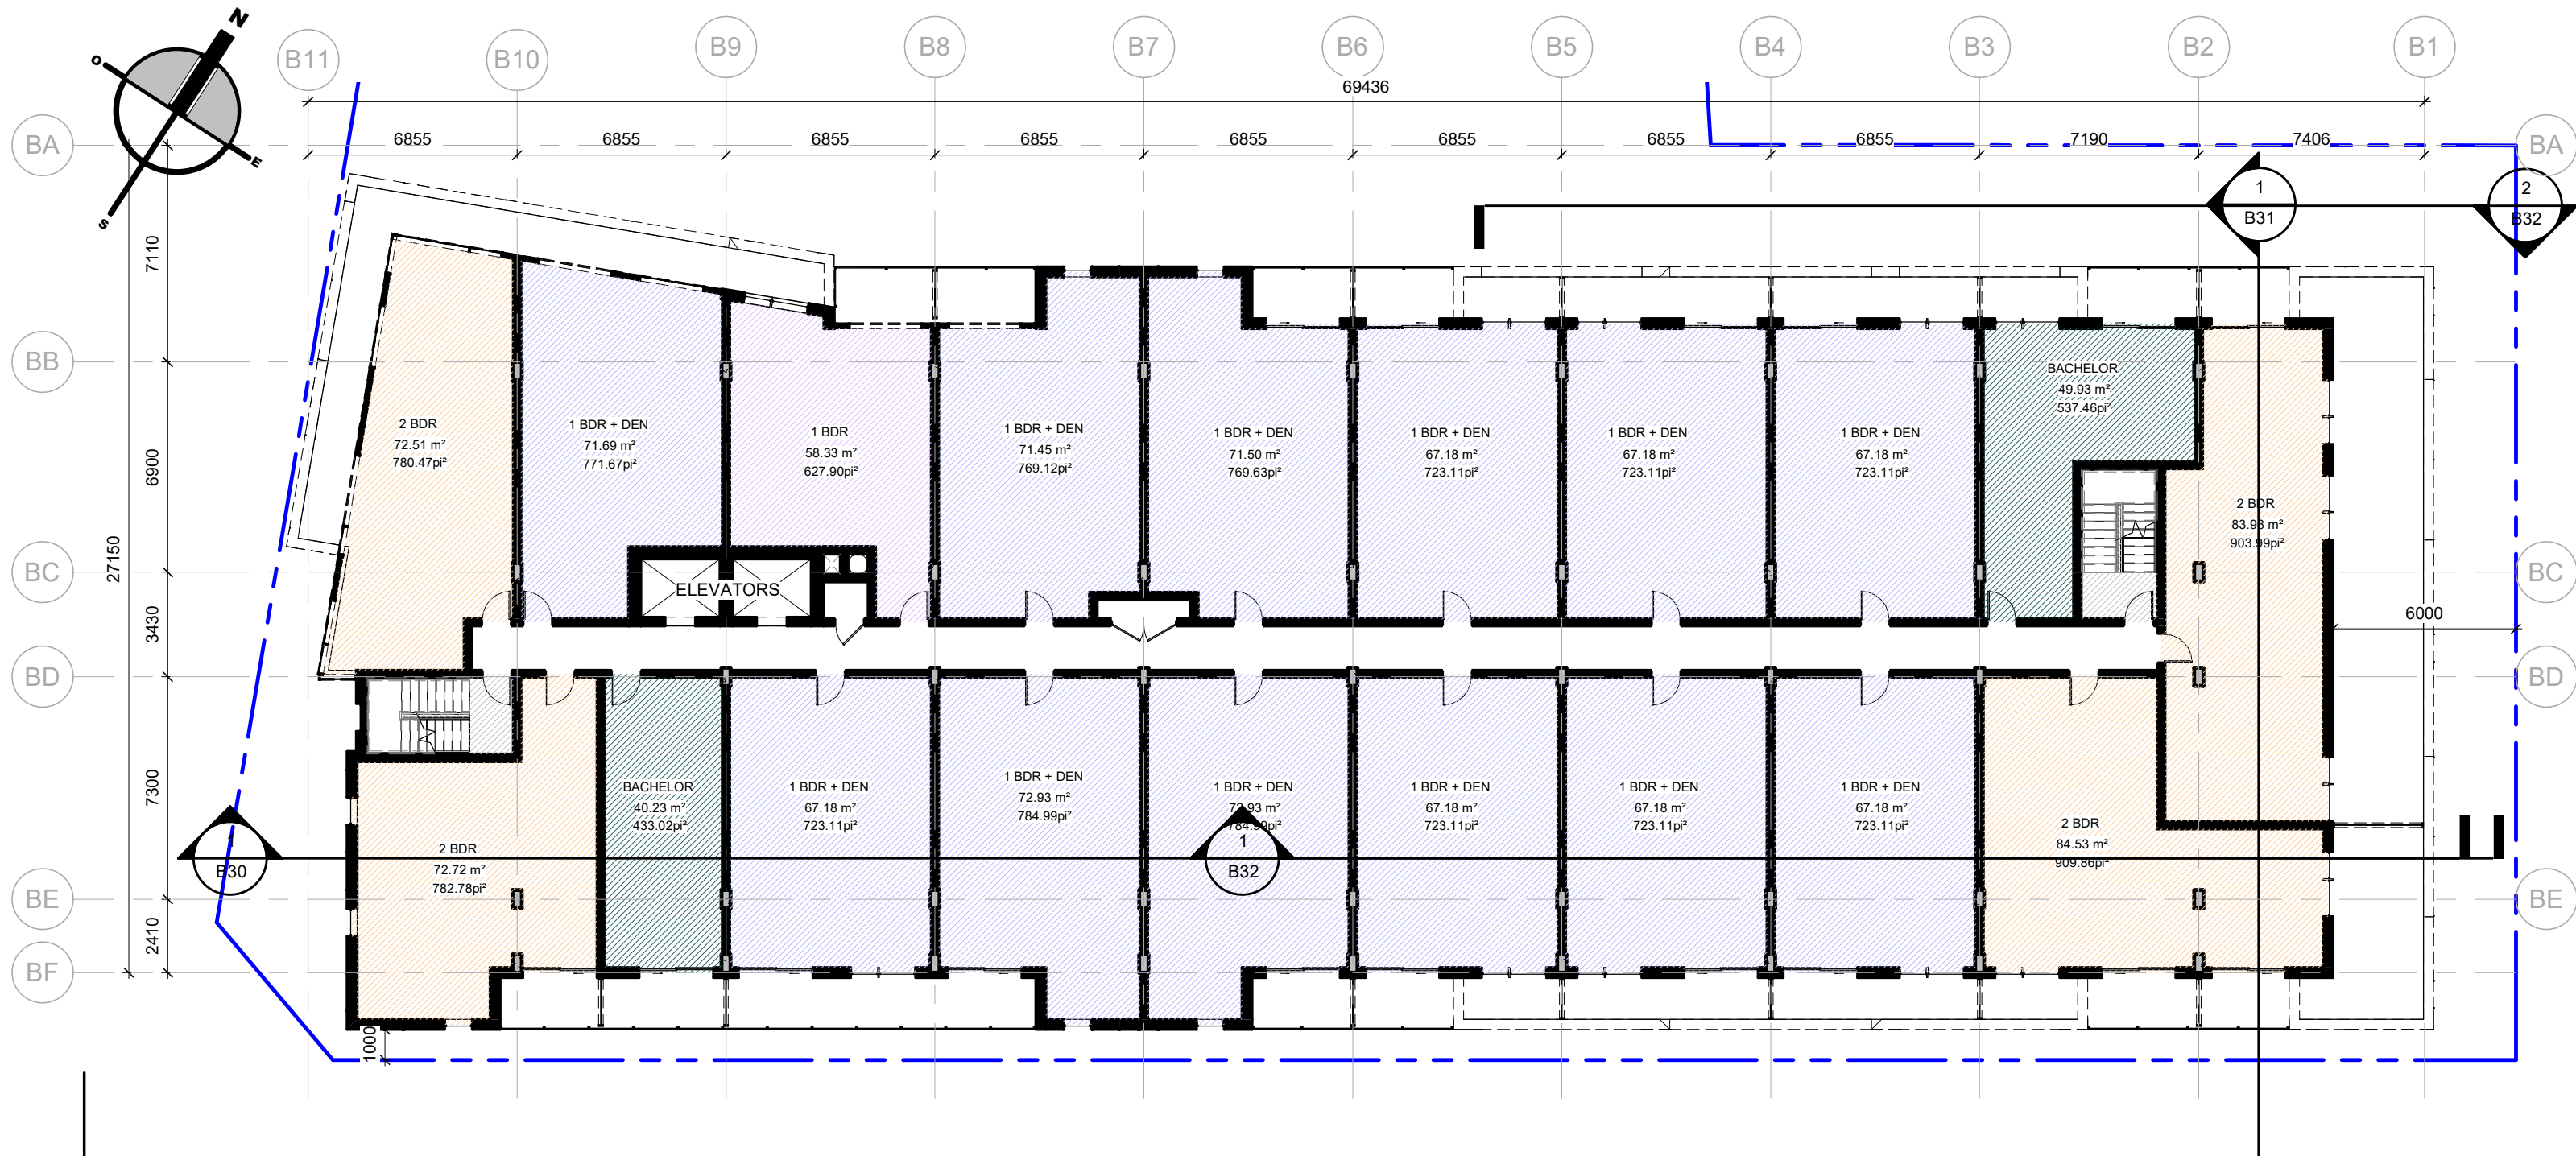

GROSS AREA LEGEND



TOWER B - LEVEL 7

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

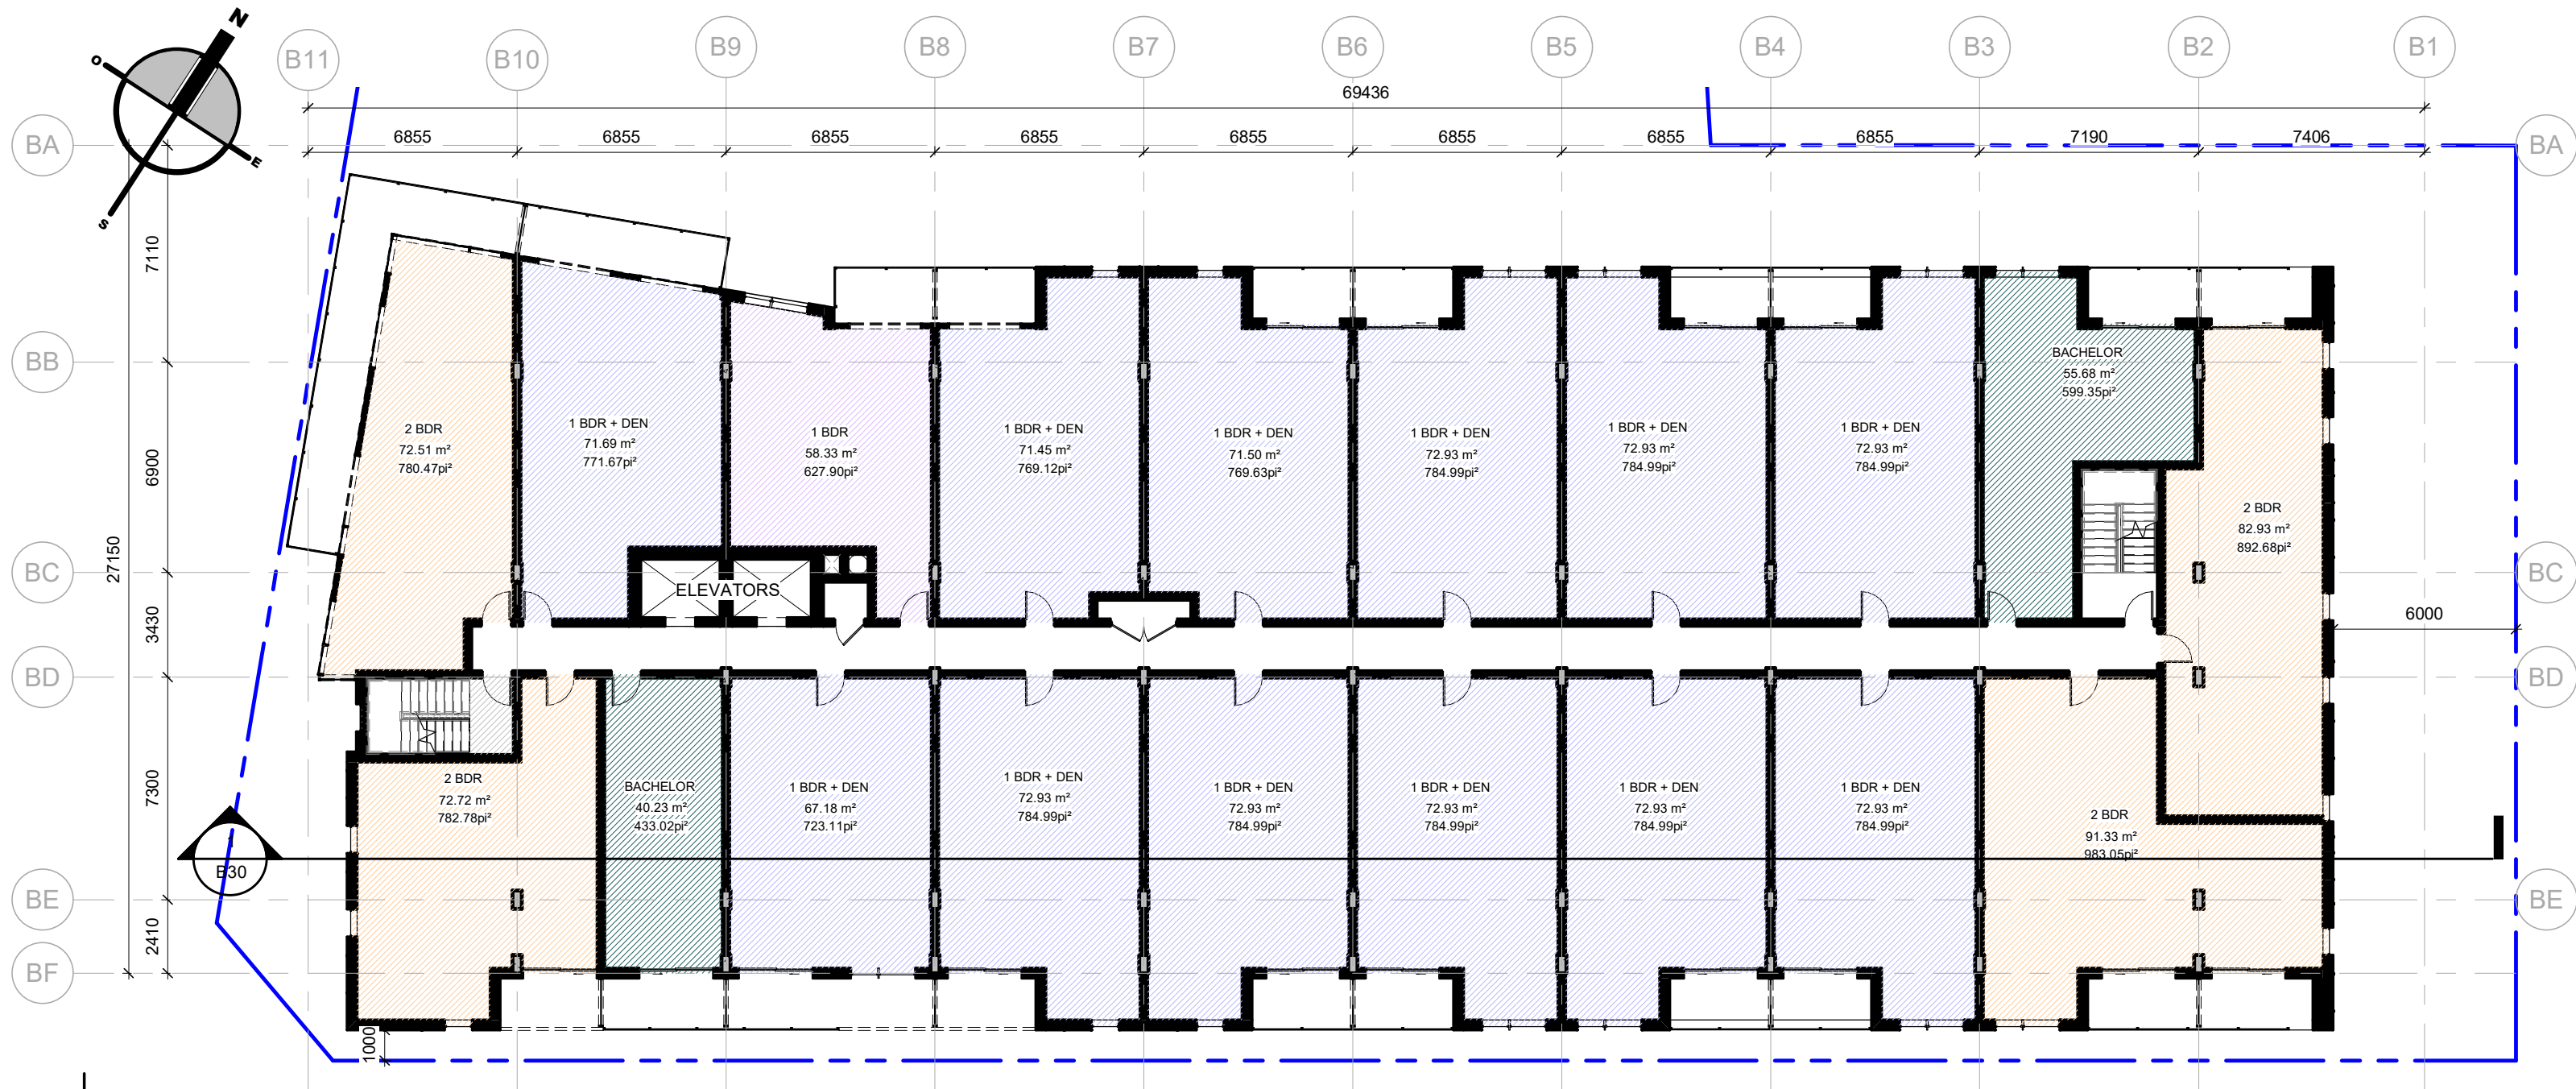

GROSS AREA LEGEND



TOWER B - LEVEL 8 TO 11

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

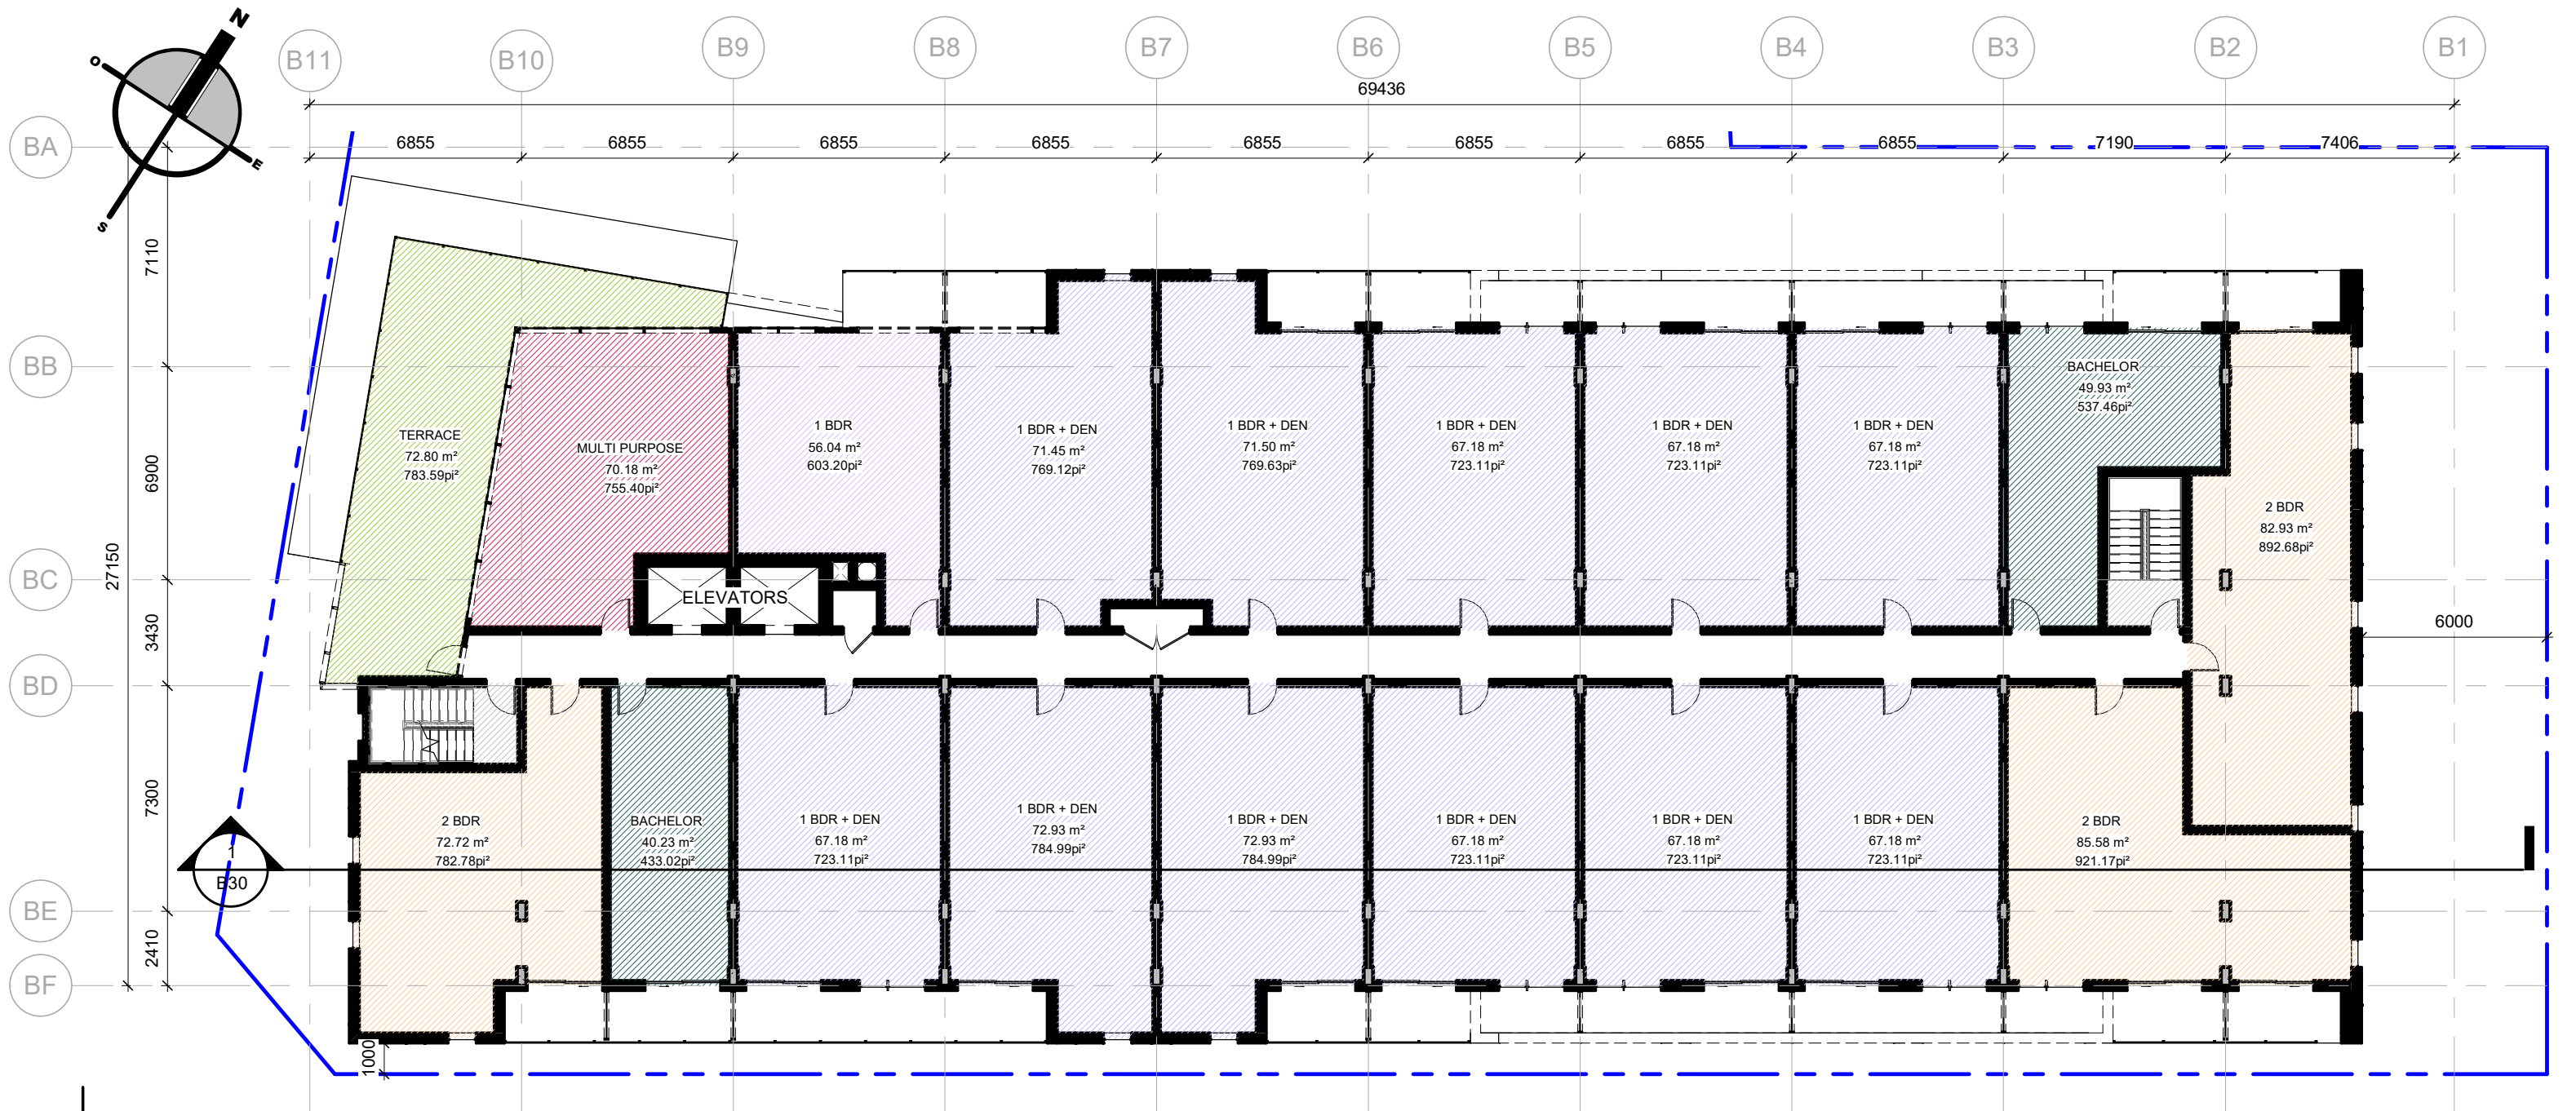

GROSS AREA LEGEND



TOWER B - LEVEL 12

GROUP HEAFEY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca




365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

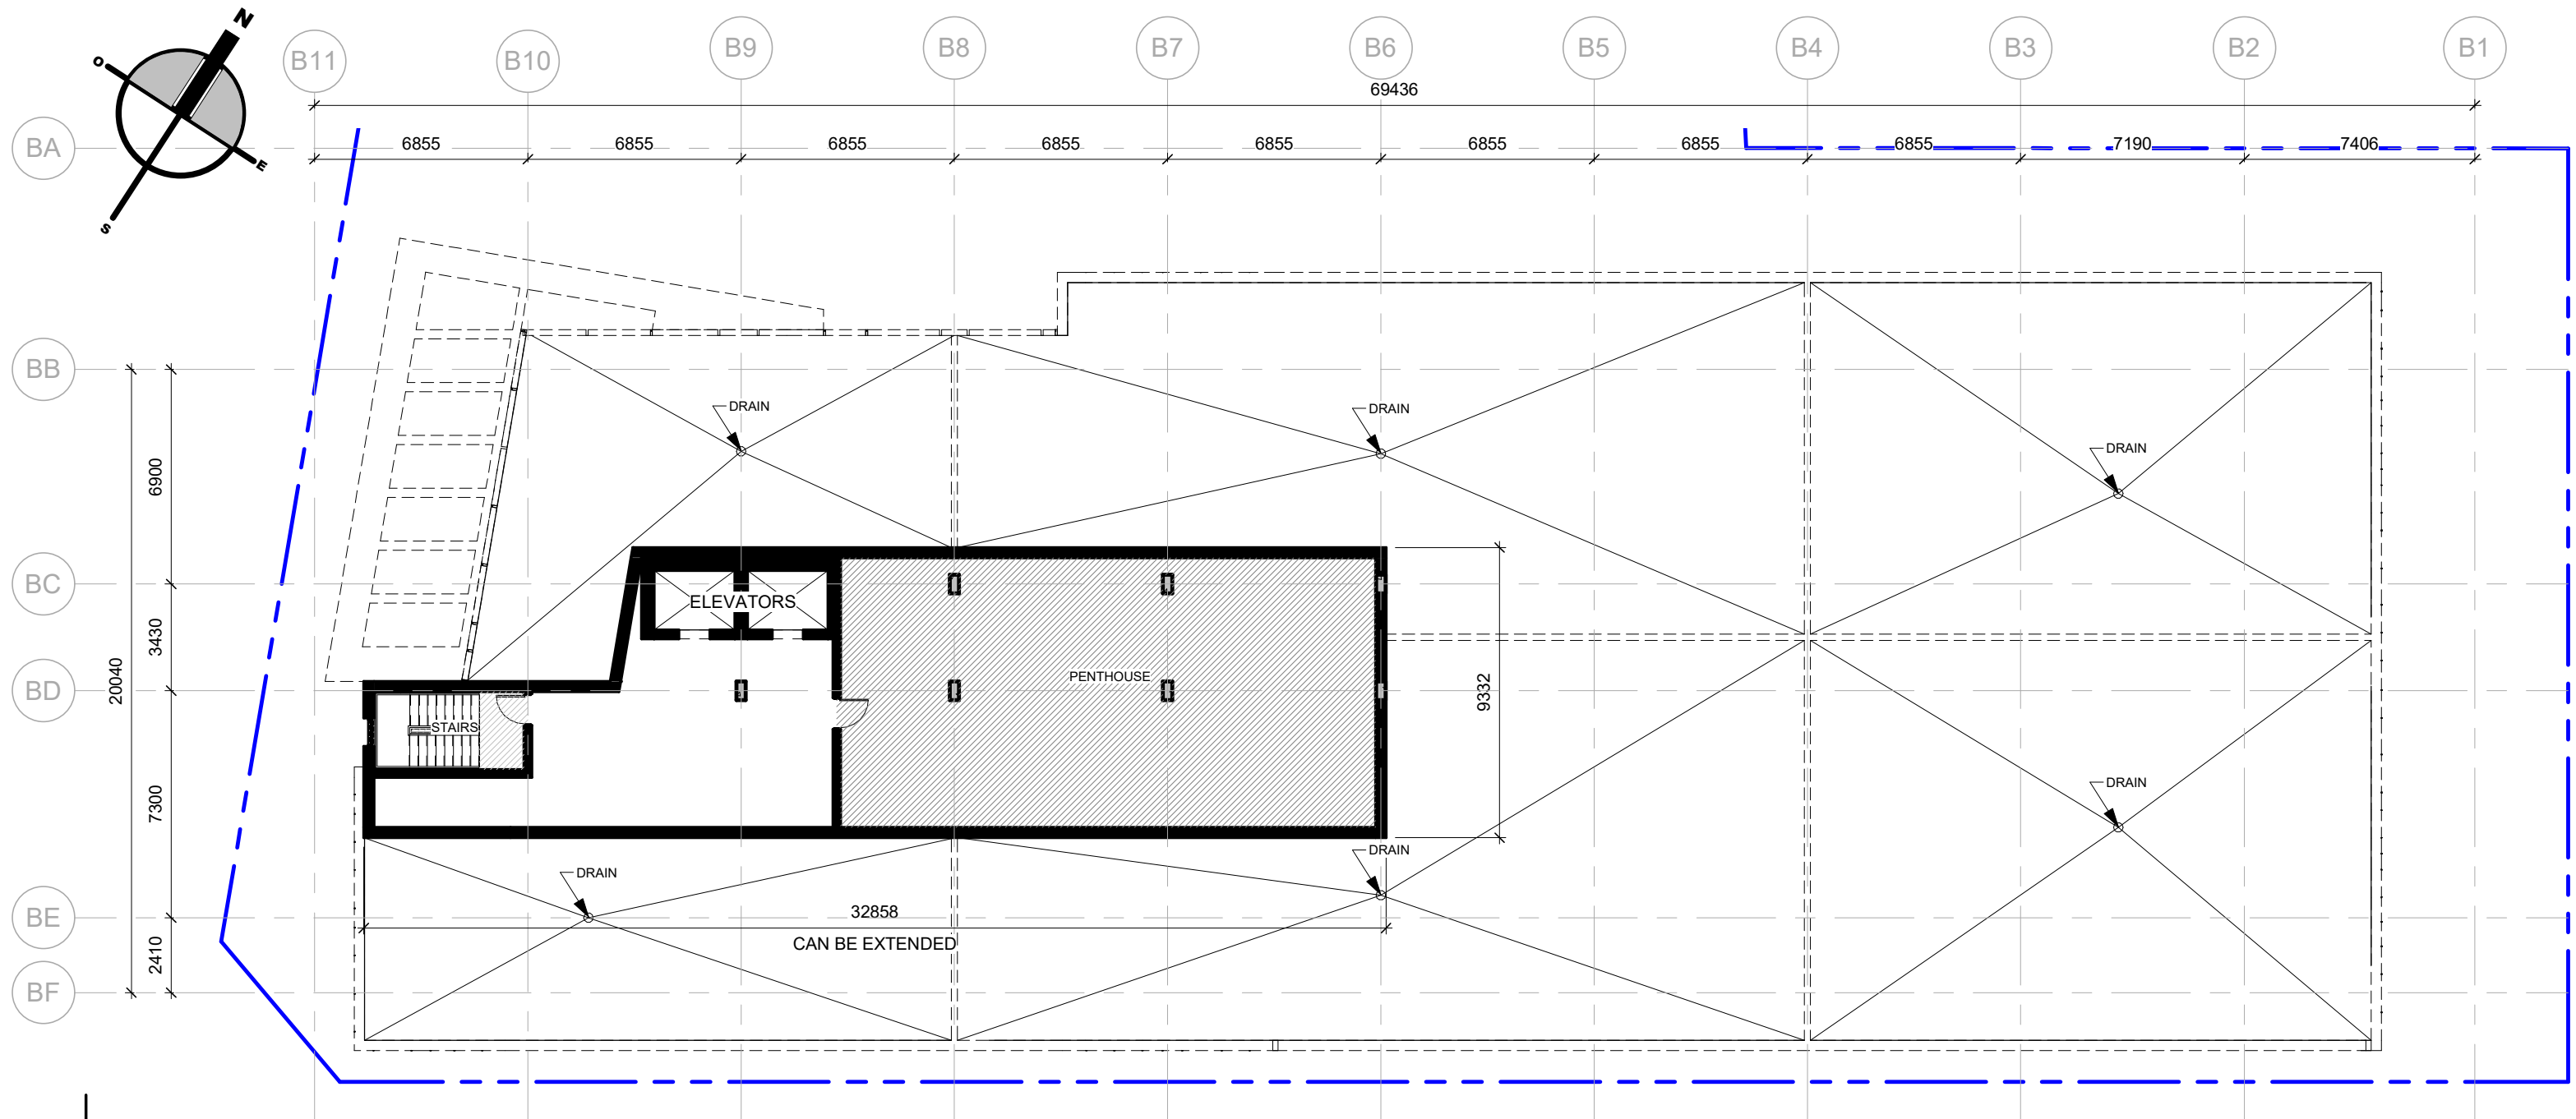

GROSS AREA LEGEND



TOWER B - LEVEL PENTHOUSE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

ROOM TYPOLOGY - TOWER B		
LEVEL	NAME	QTY
LEVEL 1	1 BDR	1
LEVEL 1	1 BDR + DEN	9
LEVEL 1	2 BDR	1
LEVEL 1	BACHELOR	1
LEVEL 2	1 BDR	1
LEVEL 2	1 BDR + DEN	13
LEVEL 2	2 BDR	3
LEVEL 2	BACHELOR	2
LEVEL 3	1 BDR	1
LEVEL 3	1 BDR + DEN	13
LEVEL 3	2 BDR	4
LEVEL 3	BACHELOR	2
LEVEL 4	1 BDR	1
LEVEL 4	1 BDR + DEN	13
LEVEL 4	2 BDR	4
LEVEL 4	BACHELOR	2
LEVEL 5	1 BDR	1
LEVEL 5	1 BDR + DEN	13
LEVEL 5	2 BDR	4
LEVEL 5	BACHELOR	2
LEVEL 6	1 BDR	1
LEVEL 6	1 BDR + DEN	13
LEVEL 6	2 BDR	4
LEVEL 6	BACHELOR	2
LEVEL 7	1 BDR	1
LEVEL 7	1 BDR + DEN	12
LEVEL 7	2 BDR	4
LEVEL 7	BACHELOR	2
LEVEL 8	1 BDR	1
LEVEL 8	1 BDR + DEN	12
LEVEL 8	2 BDR	4
LEVEL 8	BACHELOR	2
LEVEL 9	1 BDR	1
LEVEL 9	1 BDR + DEN	12
LEVEL 9	2 BDR	4
LEVEL 9	BACHELOR	2
LEVEL 10	1 BDR	1
LEVEL 10	1 BDR + DEN	12
LEVEL 10	2 BDR	4
LEVEL 10	BACHELOR	2
LEVEL 11	1 BDR	1
LEVEL 11	1 BDR + DEN	12
LEVEL 11	2 BDR	4
LEVEL 11	BACHELOR	2
LEVEL 12	1 BDR	1
LEVEL 12	1 BDR + DEN	11
LEVEL 12	2 BDR	3
LEVEL 12	BACHELOR	2
TOTAL DE LOGEMENTS: 223		

1 BDR - TOWER B		
LEVEL	NAME	QTY
LEVEL 1	1 BDR	1
LEVEL 2	1 BDR	1
LEVEL 3	1 BDR	1
LEVEL 4	1 BDR	1
LEVEL 5	1 BDR	1
LEVEL 6	1 BDR	1
LEVEL 7	1 BDR	1
LEVEL 8	1 BDR	1
LEVEL 9	1 BDR	1
LEVEL 10	1 BDR	1
LEVEL 11	1 BDR	1
LEVEL 12	1 BDR	1
TOTAL: 12		

2 BDR - TOWER B		
LEVEL	NAME	QTY
LEVEL 1	2 BDR	1
LEVEL 2	2 BDR	3
LEVEL 3	2 BDR	4
LEVEL 4	2 BDR	4
LEVEL 5	2 BDR	4
LEVEL 6	2 BDR	4
LEVEL 7	2 BDR	4
LEVEL 8	2 BDR	4
LEVEL 9	2 BDR	4
LEVEL 10	2 BDR	4
LEVEL 11	2 BDR	4
LEVEL 12	2 BDR	3
TOTAL: 43		

TYPOLOGY - TOWER B		
NAME	QTY	%
1 BDR	12	5%
1 BDR + DEN	145	66%
2 BDR	43	22%
BACHELOR	23	7%
TOTAL DE LOGEMENTS: 223		100%

1 BDR + DEN - TOWER B		
LEVEL	NAME	QTY
LEVEL 1	1 BDR + DEN	9
LEVEL 2	1 BDR + DEN	13
LEVEL 3	1 BDR + DEN	13
LEVEL 4	1 BDR + DEN	13
LEVEL 5	1 BDR + DEN	13
LEVEL 6	1 BDR + DEN	13
LEVEL 7	1 BDR + DEN	12
LEVEL 8	1 BDR + DEN	12
LEVEL 9	1 BDR + DEN	12
LEVEL 10	1 BDR + DEN	12
LEVEL 11	1 BDR + DEN	12
LEVEL 12	1 BDR + DEN	11
TOTAL: 145		

2 BDR + DEN - TOWER B		
LEVEL	NAME	QTY

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

ESQUISSE

D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



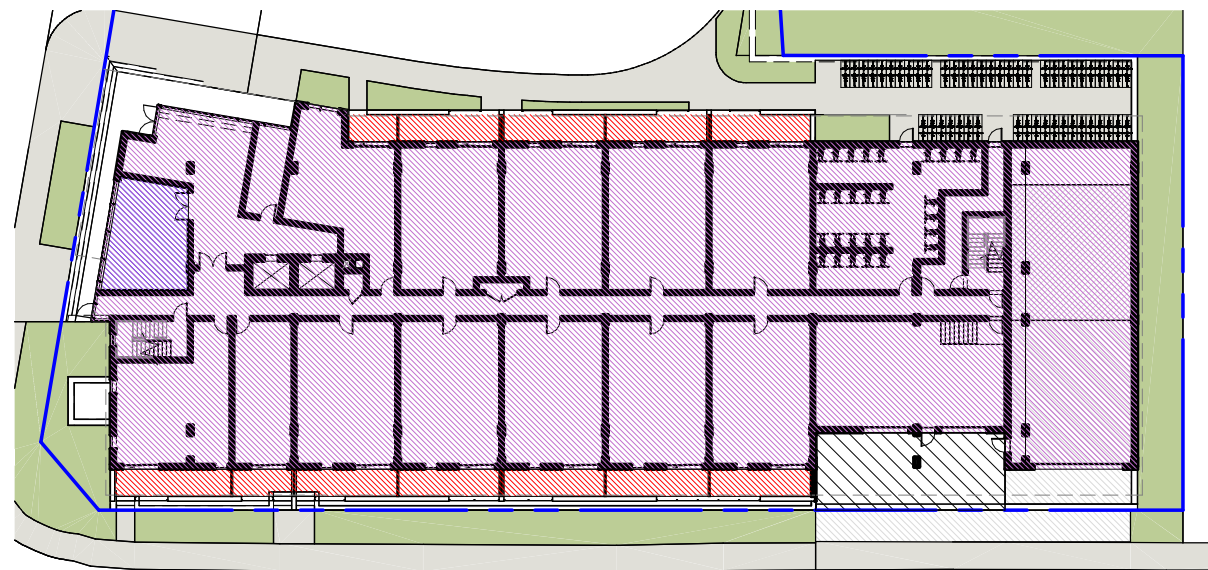


■ BALCONY AREA LEVEL 1 : 137 m² / 12 UNITS = 11.42 m²
■ COMMON AREA LEVEL 1 : 37 m²
■ GROSS AREA LEVEL 1 : 1466.78 m²

TOWER B - AMENITIES AREA LEVEL 1

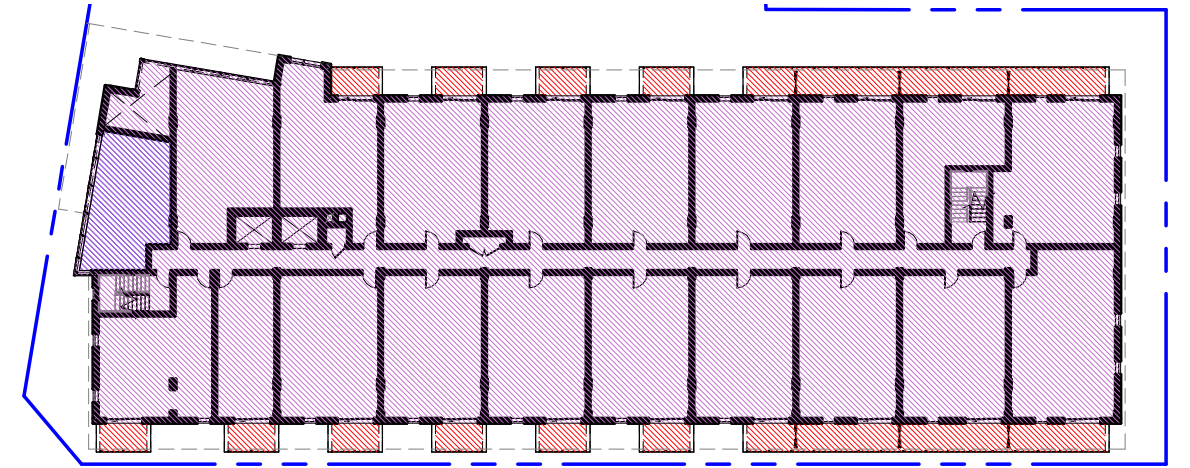


■ BALCONY AREA LEVEL 2 : 149 m² / 19 UNITS = 7.84 m²
■ COMMON AREA LEVEL 2 : 45 m²
■ GROSS AREA LEVEL 2 : 1497.04 m²

TOWER B - AMENITIES AREA LEVEL 2

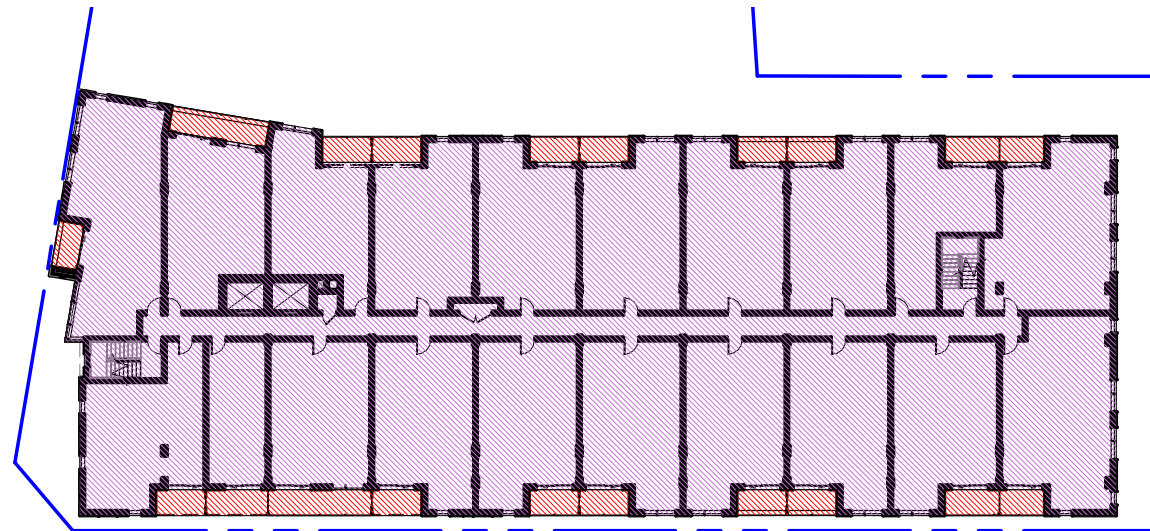

■ BALCONY AREA LEVEL 3 : 125 m² / 20 UNITS = 6.25 m²
■ GROSS AREA LEVEL 3 TO 6 : 1629.32 m²

TOWER B - AMENITIES AREA LEVEL 3 TO 6

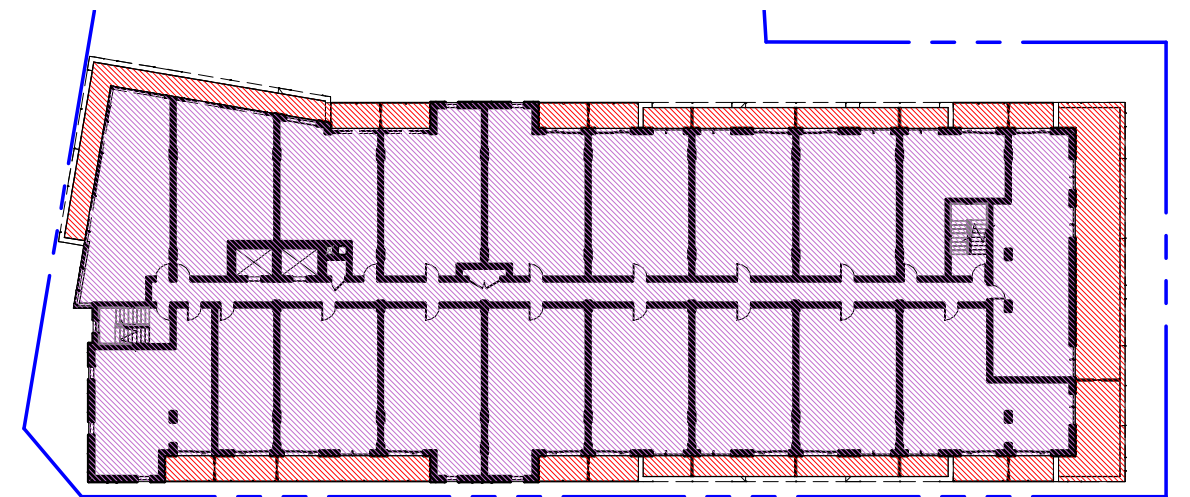

■ BALCONY AREA LEVEL 7 : 264 m² / 19 UNITS = 13.89 m²
■ GROSS AREA LEVEL 7 : 1465.16 m²

TOWER B - AMENITIES AREA LEVEL 7


GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 500

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

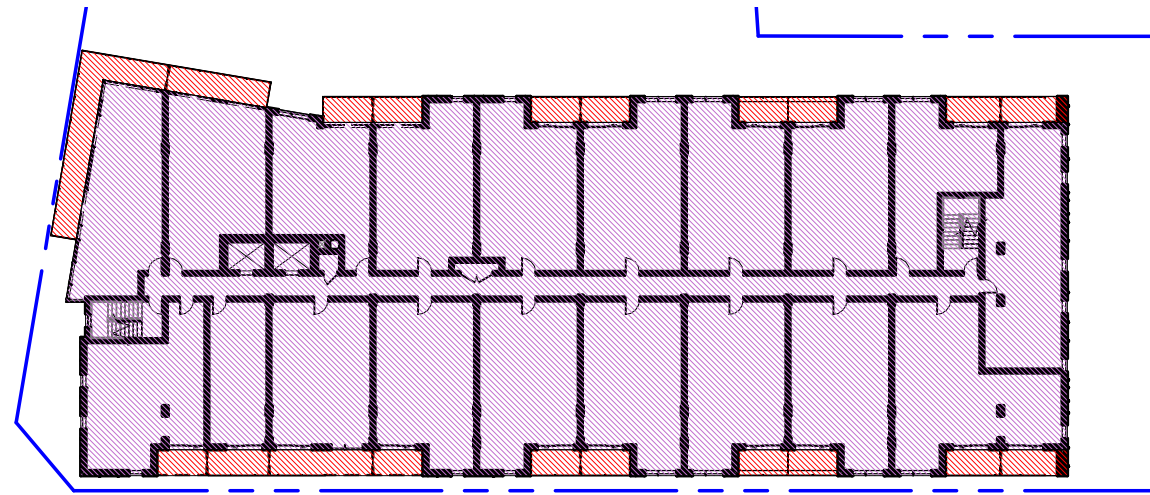

BALCONY AREA LEVEL 8 : 153 m² / 19 UNITS = 8.05 m²
 GROSS AREA LEVEL 8 TO 11 : 1513.39 m²

TOWER B - AMENITIES AREA LEVEL 8 TO 11


PRIVATE AMENITIES AREA

BALCONY AREA LEVEL 1 : 137 m² / 12 UNITS = 11.42 m²
 BALCONY AREA LEVEL 2 : 149 m² / 19 UNITS = 7.84 m²
 BALCONY AREA LEVEL 3 : 125 m² / 20 UNITS = 6.25 m²
 BALCONY AREA LEVEL 4 : 125 m² / 20 UNITS = 6.25 m²
 BALCONY AREA LEVEL 5 : 125 m² / 20 UNITS = 6.25 m²
 BALCONY AREA LEVEL 6 : 125 m² / 20 UNITS = 6.25 m²
 BALCONY AREA LEVEL 7 : 264 m² / 19 UNITS = 13.89 m²
 BALCONY AREA LEVEL 8 : 153 m² / 19 UNITS = 8.05 m²
 BALCONY AREA LEVEL 9 : 151 m² / 19 UNITS = 7.95 m²
 BALCONY AREA LEVEL 10 : 151 m² / 19 UNITS = 7.95 m²
 BALCONY AREA LEVEL 11 : 151 m² / 19 UNITS = 7.95 m²
 BALCONY AREA LEVEL 12 : 144 m² / 17 UNITS = 8.47 m²

TOTAL PRIVATE AREA : 1800 m² / 223 UNITS = 8.07 m²
REQUIRED 6 m²/ UNITS

COMMON AMENITIES AREA

COMMON AREA LEVEL 1 : 37 m²
 COMMON AREA LEVEL 2 : 45 m²
 COMMON AREA LEVEL 12 : 140 m²
TOTAL COMMON AREA : 222 m²

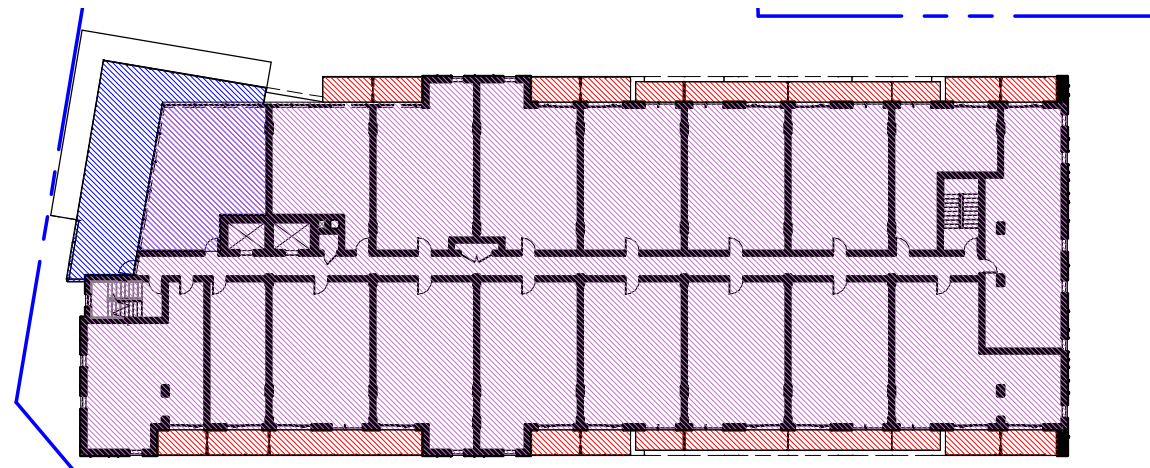

BALCONY AREA LEVEL 12 : 144 m² / 17 UNITS = 8.47 m²
 GROSS AREA LEVEL 12 : 1390.80 m²
 COMMON AREA LEVEL 12 : 140 m²


TOWER B - AMENITIES AREA LEVEL 12

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7
As indicated

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

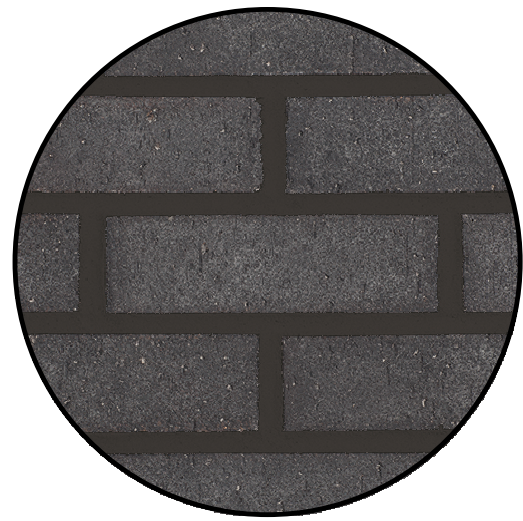

1

MASONRY
GLEN-GERY
COLOR VINTAGE
BLACK VELOUR




2

MASONRY
GLEN-GERY
COLOR REVERE
PEWTER VELOUR




3

ALUMINIUM SIDING
ALUPLANK
COLOR ACADIA
AXOTIC HONEY

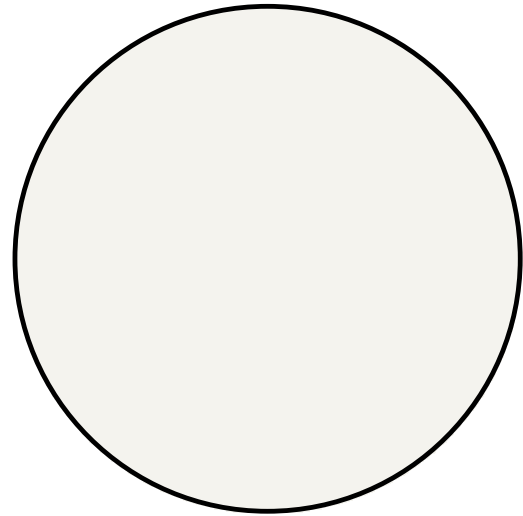


4

ALUMINIUM PANELS
ALUTECH
SICO COLOR NATURAL
WHITE 6000-11

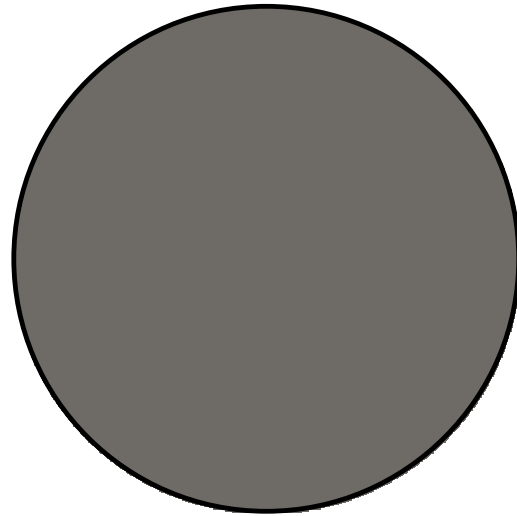


5

ALUMINIUM PANELS
ALUTECH
SICO COLOR NIGHT
OWL 6183-63

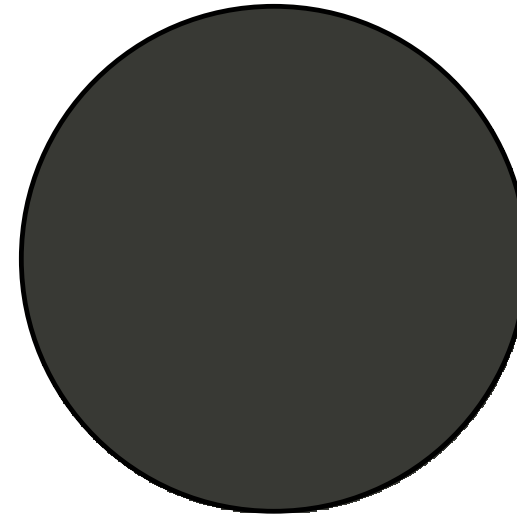


6

ALUMINIUM PANELS
ALUTECH
SICO COLOR BLACK
PEPPER 6182-83

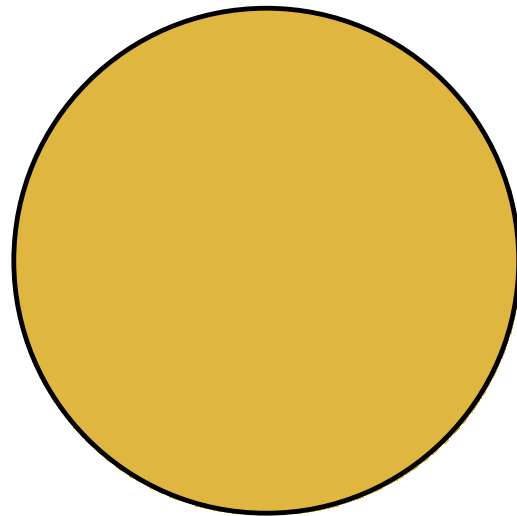

7

ALUMINIUM PANELS
ALUTECH
SICO COLOR GREEN
TOMATO RELISH 6097-64

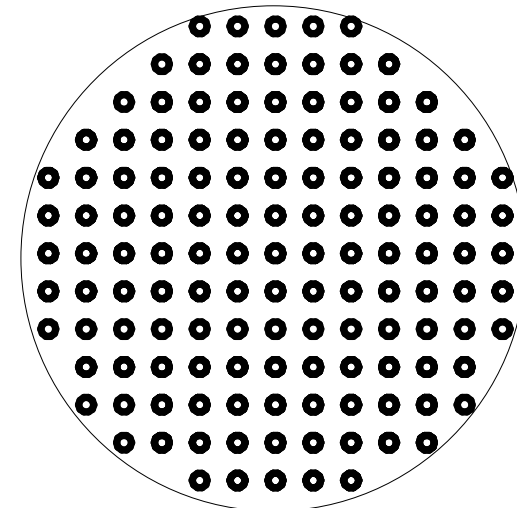

8

DOT SAFETY WINDOW FILM
DOTS WITH MAXIMUM
SPACING OF 50 MM BY 50
MM, MINIMUM OF 4 MM
DIAMETER. TO BE APPLY ON
THE GLASS BALCONIES FOR
THE FIRST 4 FLOORS.





NOTE : COLORS SHOWN MAY VARY DUE TO SCREEN RESOLUTION. PLEASE SEE ACTUAL PRODUCTS SAMPLE FOR TRUE COLOR.

EXTERIOR MATERIALS

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

STATISTICS OF THE % MATERIALS
 BUILDING AREA : 591 m²
 OPENING AREA : 430 m² (72.76%)
 MASONRY : 10 m² (1.69%)
 ALUMINIUM : 108 m² (18.27%)
 OTHER : 43 m² (7.28%)

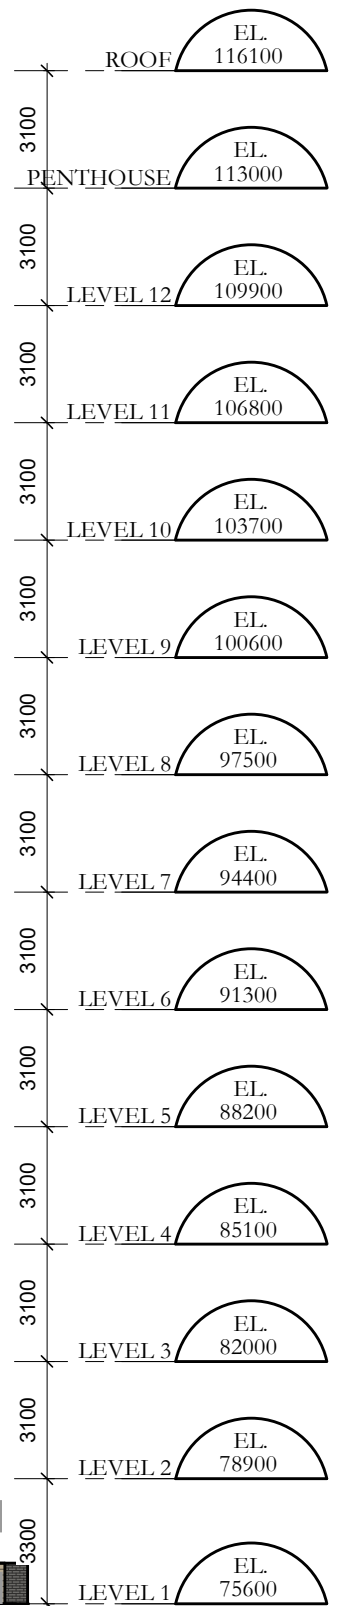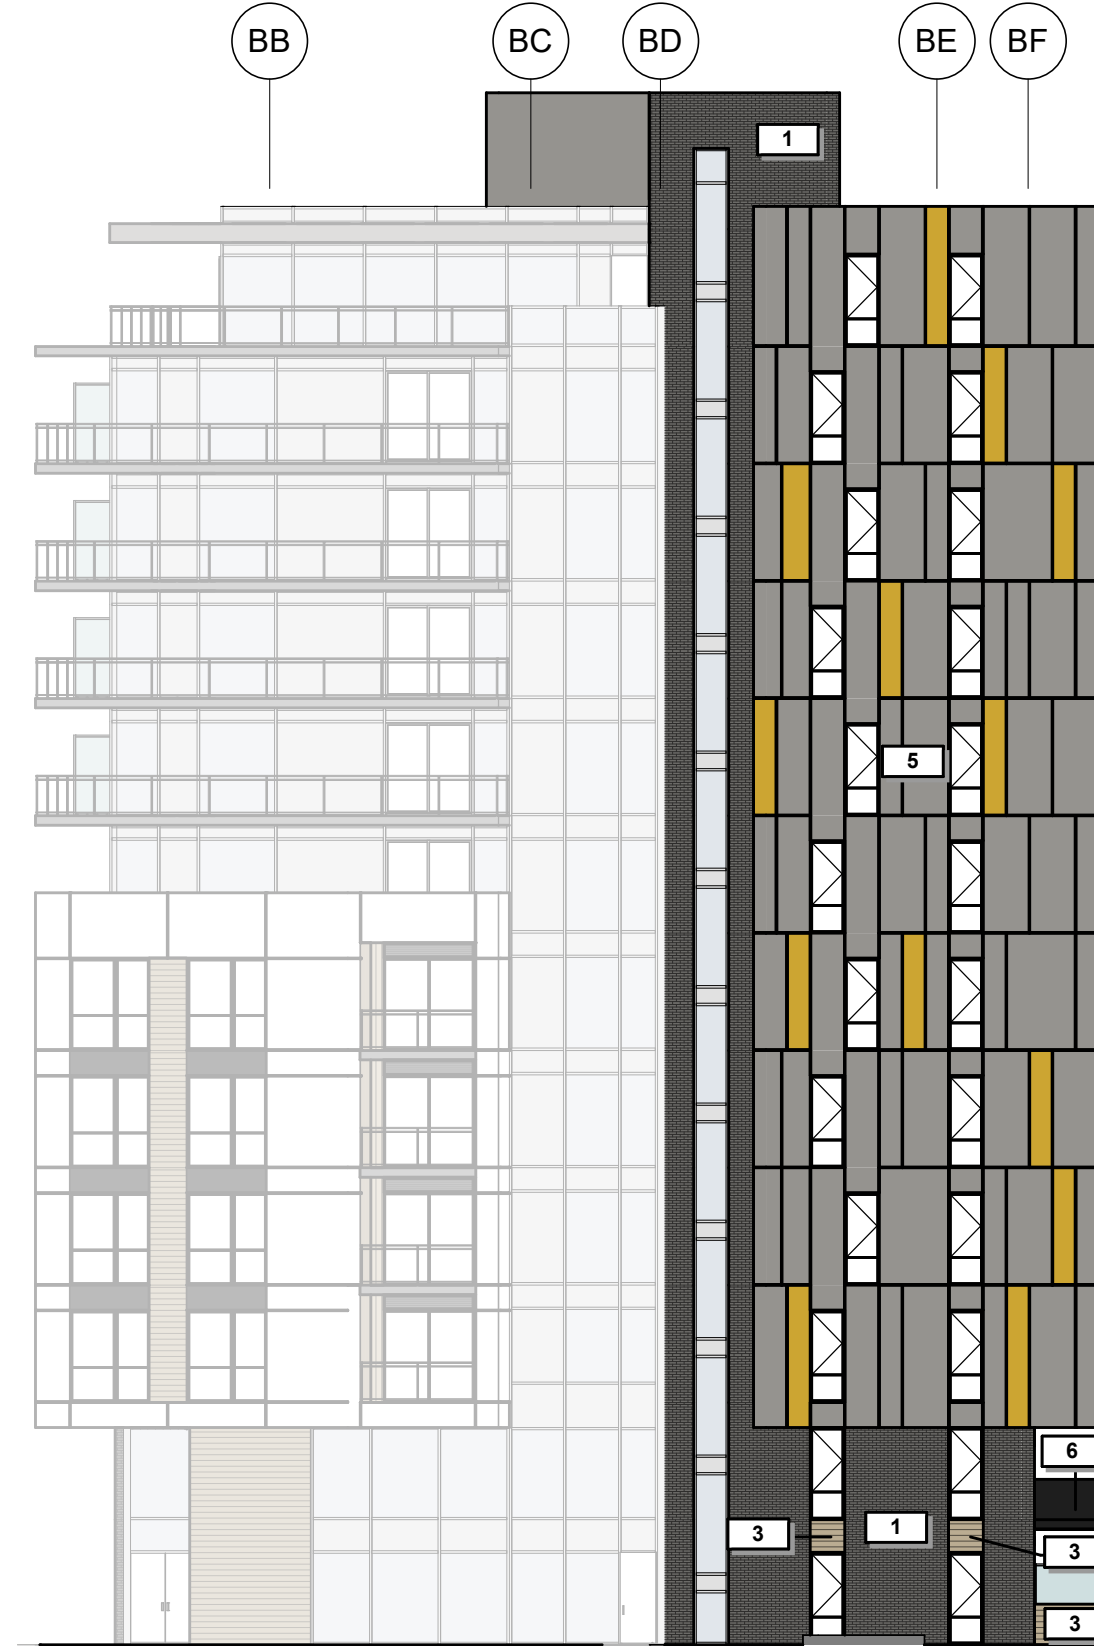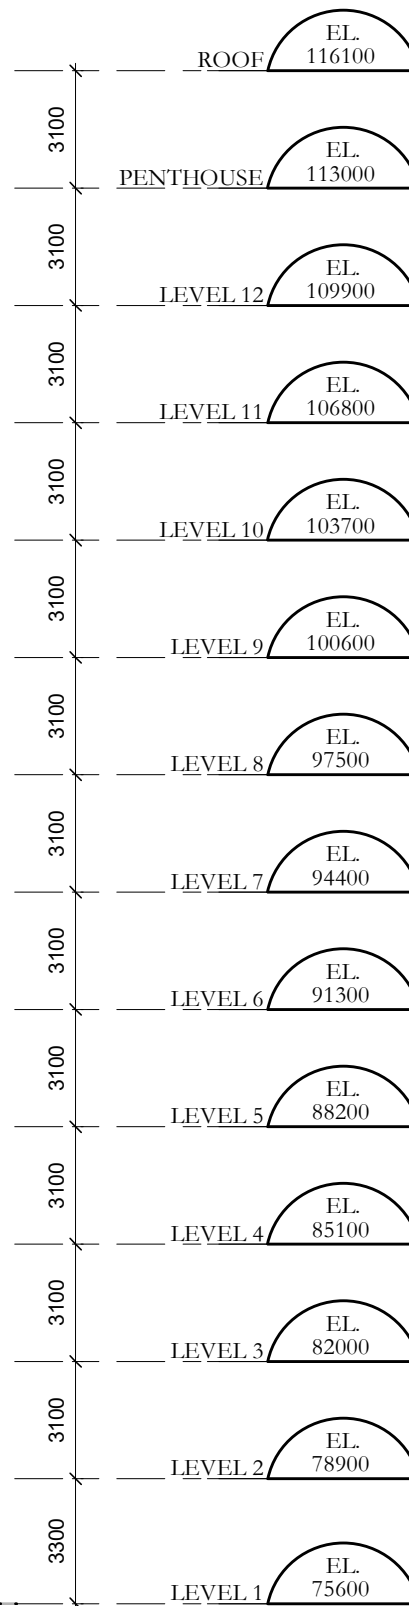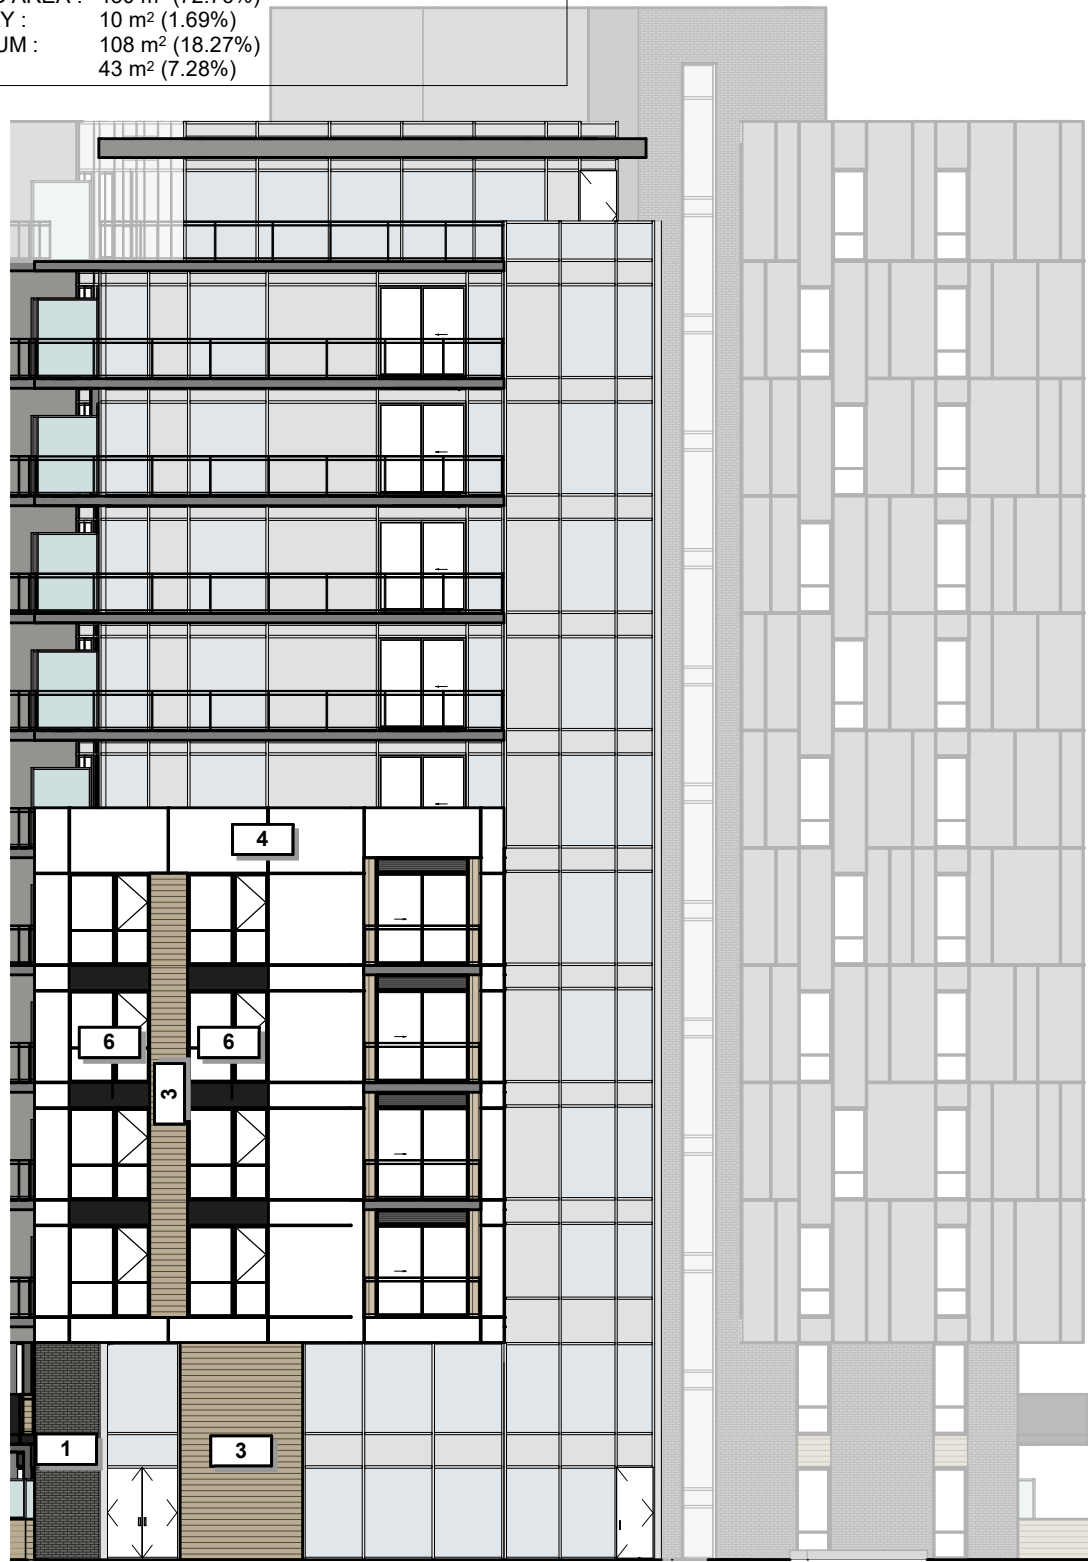

TOWER B - FRONT ELEVATIONS (FOREST STREET)

STATISTICS OF THE % MATERIALS
 BUILDING AREA : 460 m²
 OPENING AREA : 90 m² (19.57%)
 MASONRY : 103 m² (22.39%)
 ALUMINIUM : 267 m² (58.04%)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

STATISTICS OF THE % MATERIALS
 BUILDING AREA : 979 m²
 OPENING AREA : 198 m² (20.22%)
 MASONRY : 148 m² (15.12%)
 ALUMINIUM : 633 m² (64.66%)



TOWER B - BACK ELEVATION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



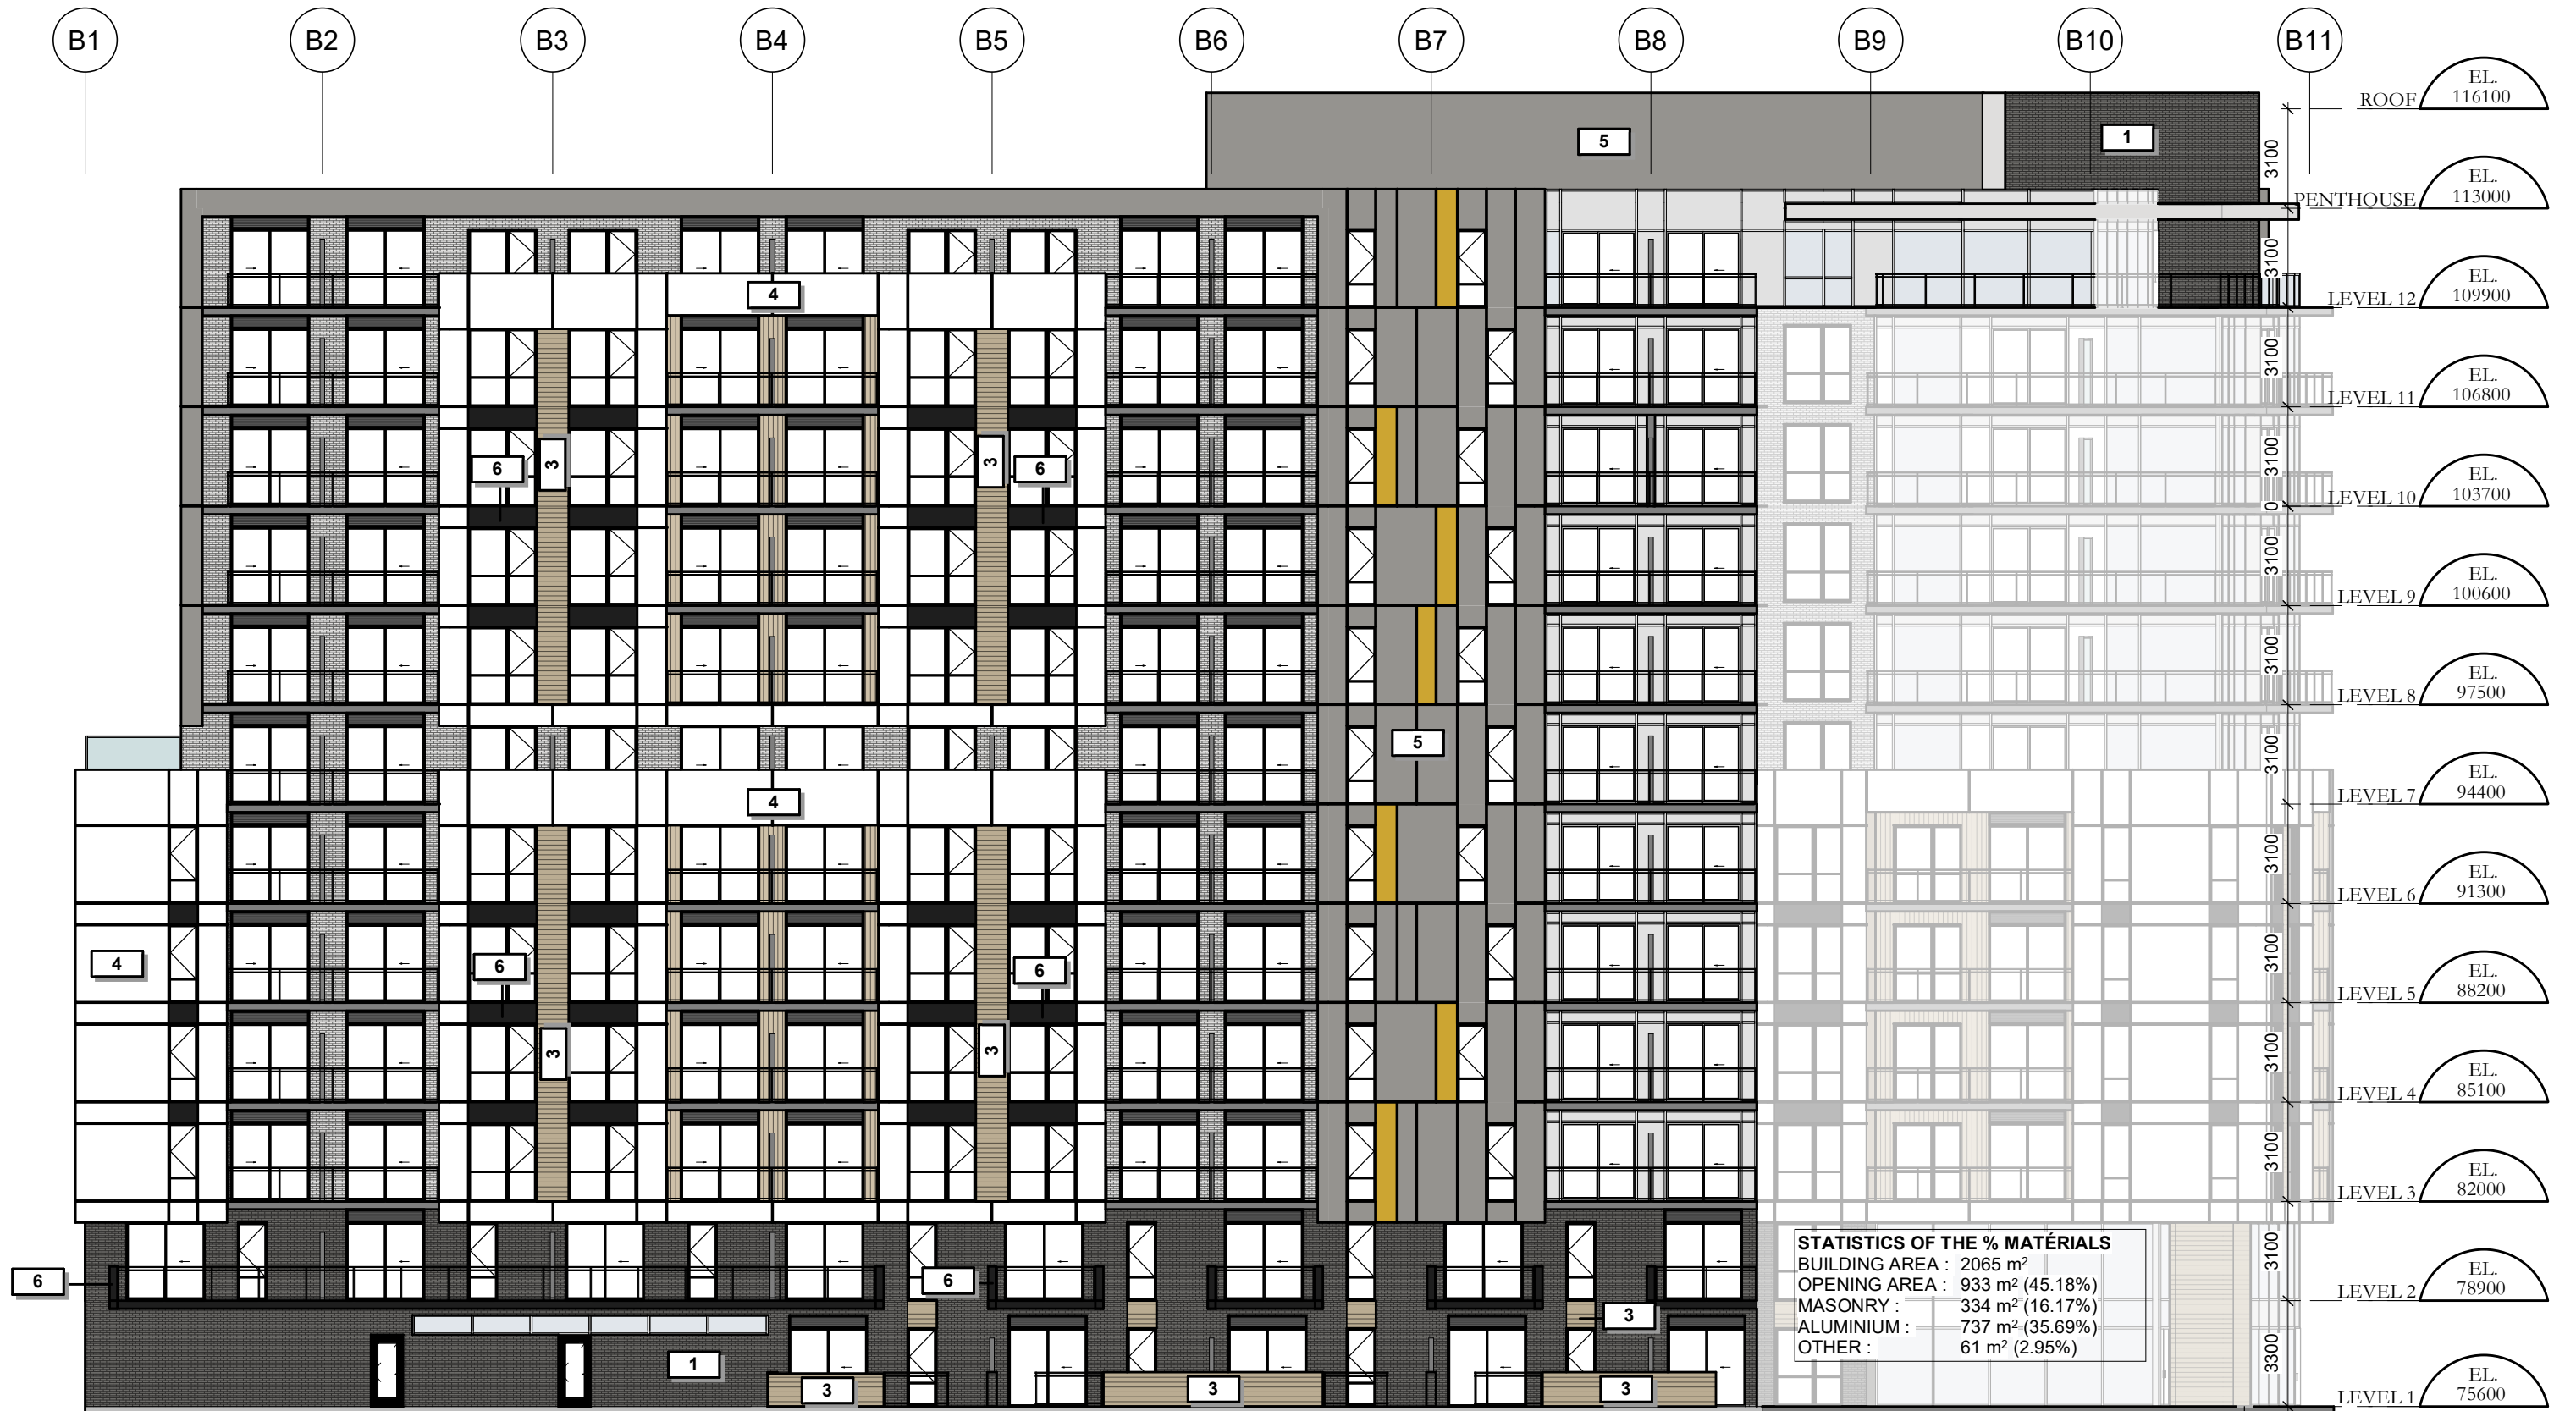

TOWER B - LEFT SIDE ELEVATION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



STATISTICS OF THE % MATÉRIALS
 BUILDING AREA : 532 m²
 OPENING AREA : 314 m² (59.02%)
 MASONRY : 38 m² (7.14%)
 ALUMINIUM : 160 m² (30.08%)
 OTHER : 20 m² (3.76%)



TOWER B - LEFT SIDE ELEVATION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca





TOWER B - RIGHT SIDE ELEVATION (BOND STREET)

GROUP HEAFEY




Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7
 1 : 200

D07-12-20-0041	1887-2303-19
REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

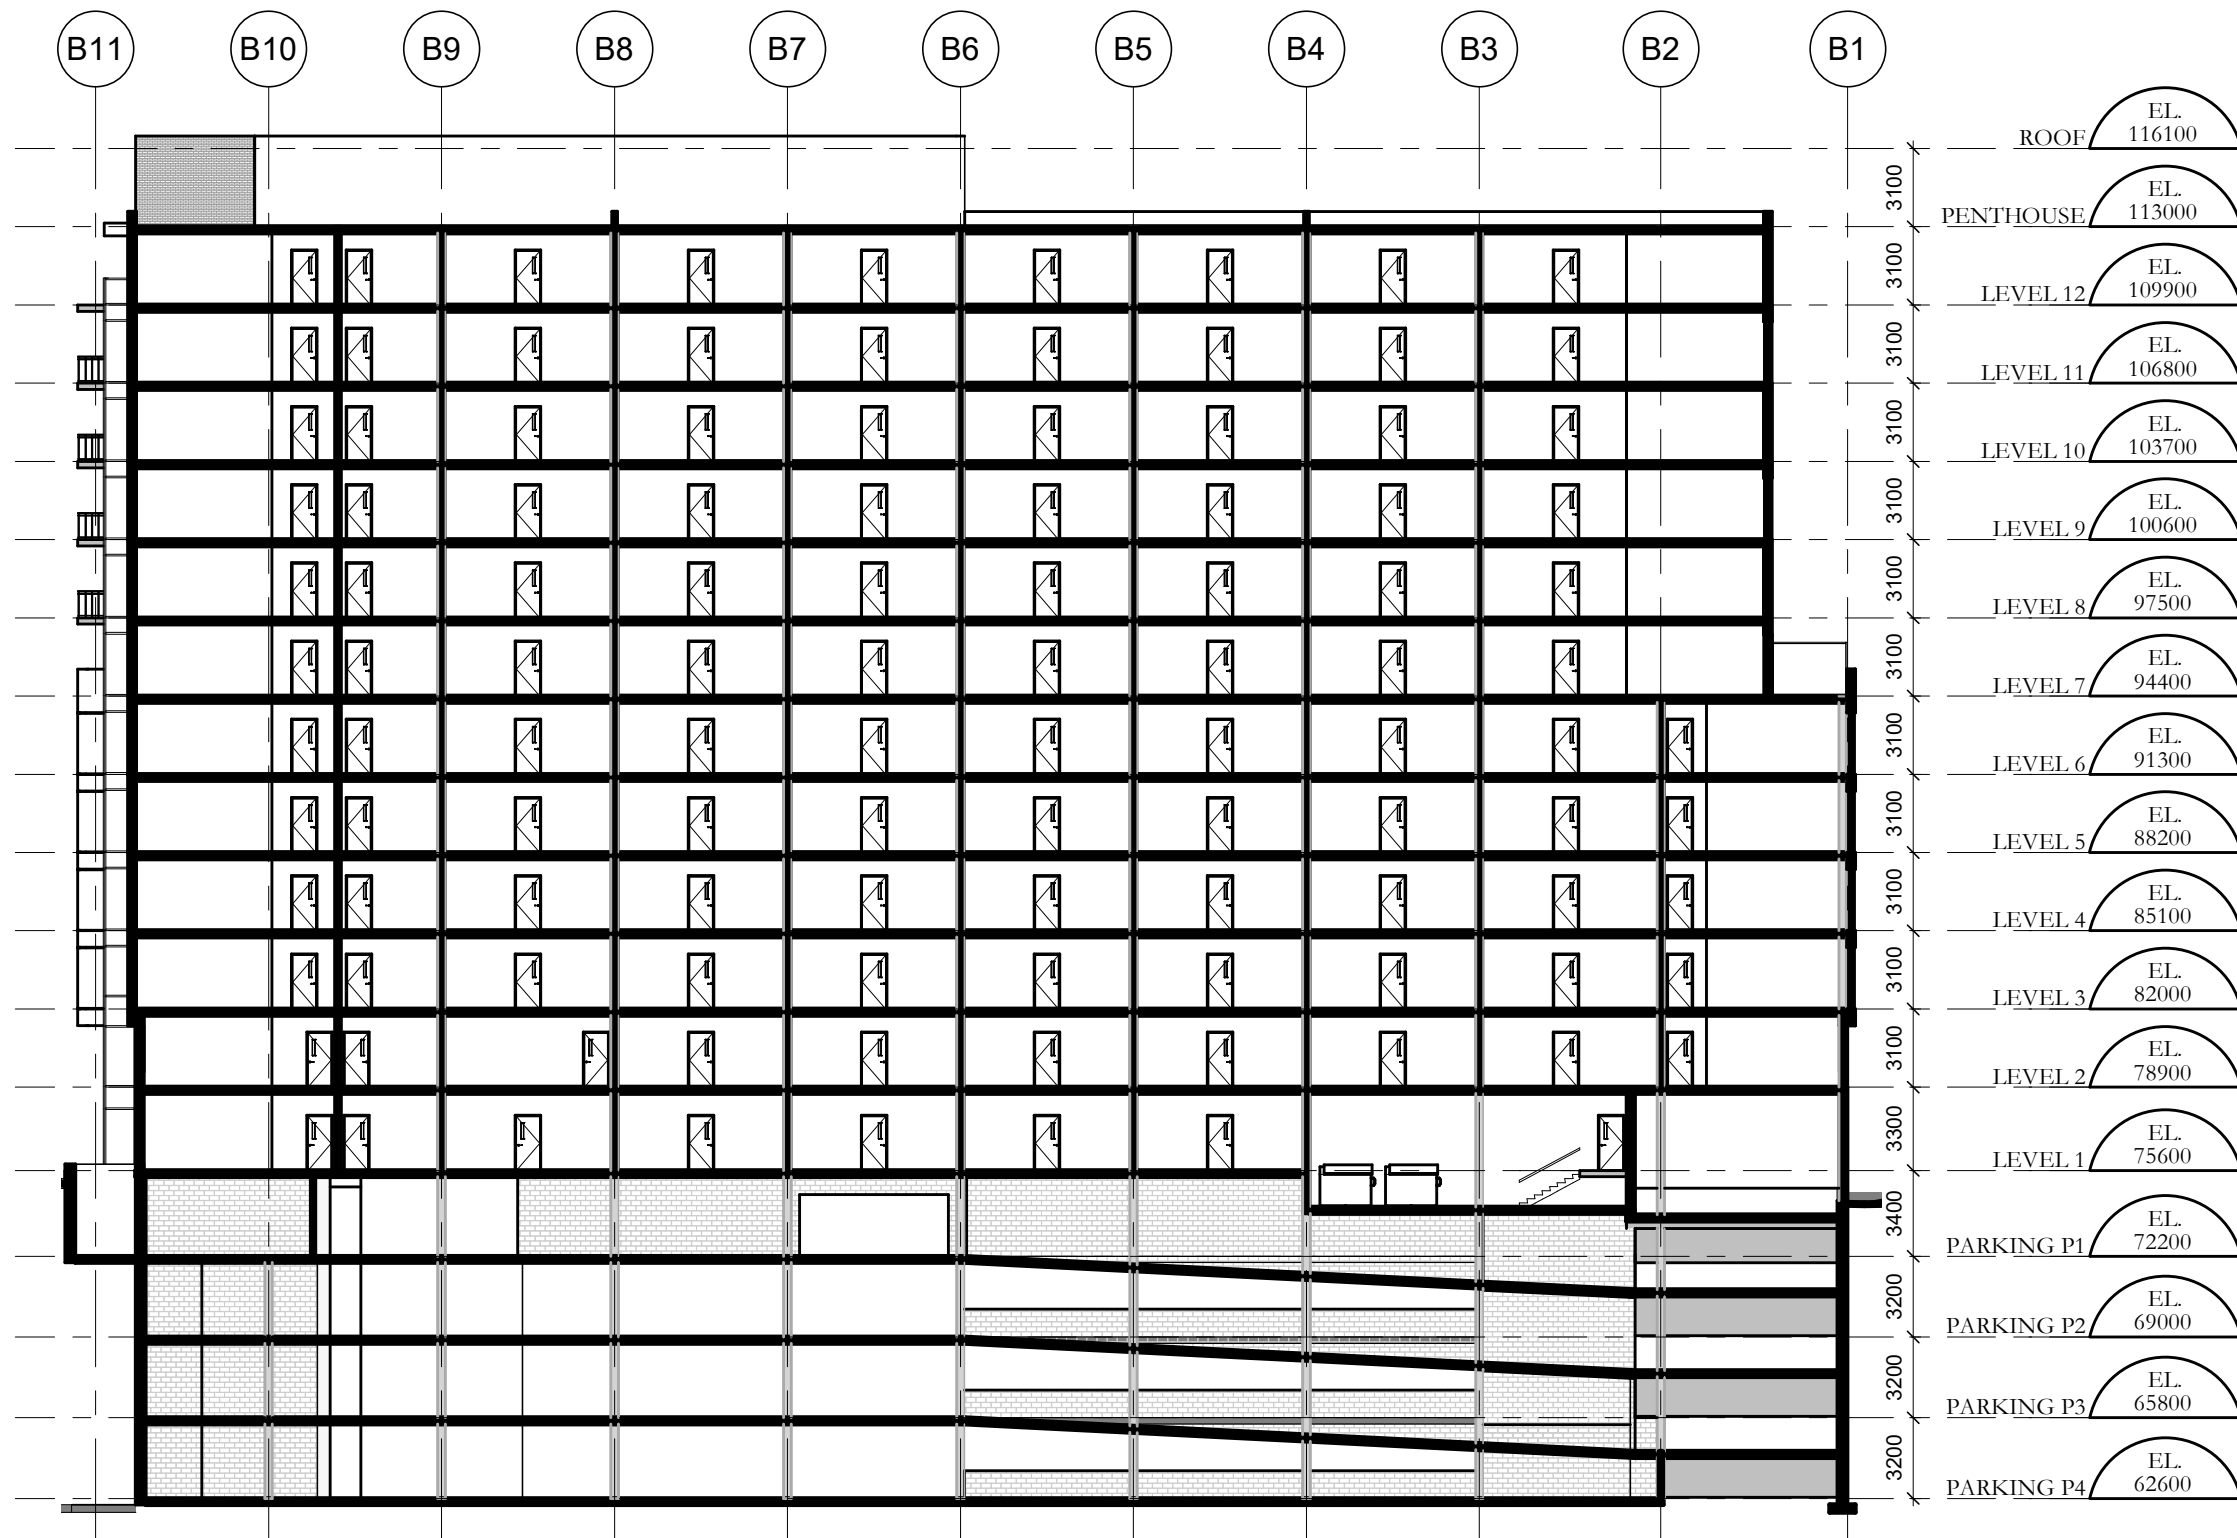

TOWER B - SECTION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 300




Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

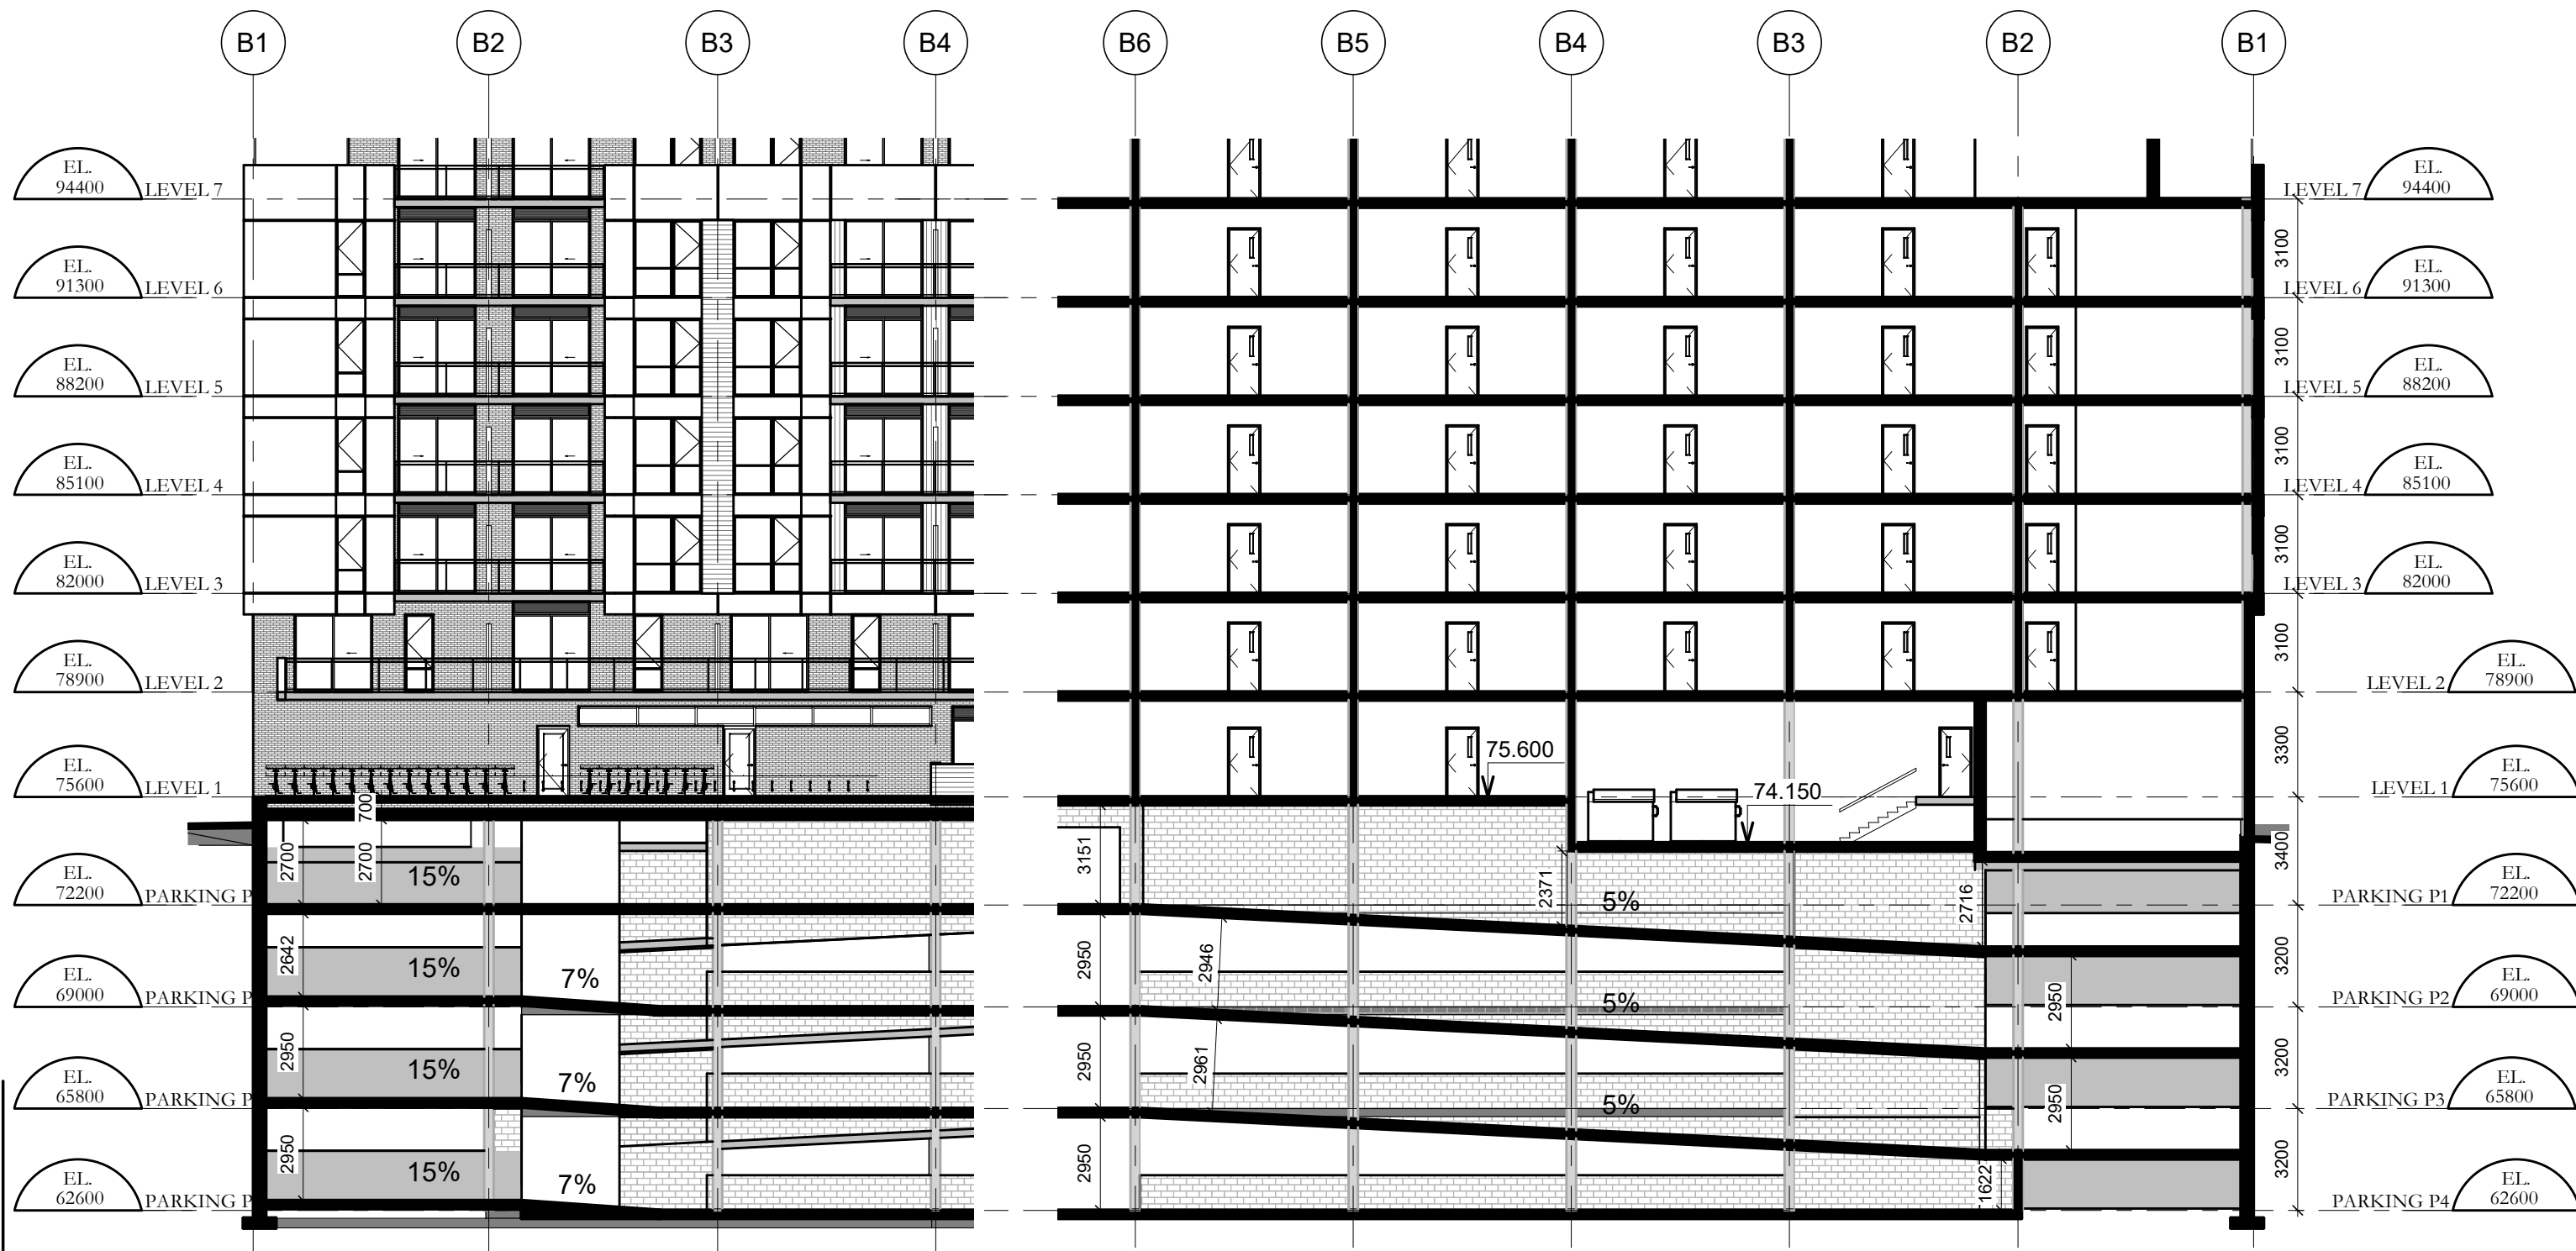

TOWER B - RAMP SECTIONS

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

1 : 200

D07-12-20-0041 1887-2303-19



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03

GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

SHADOWS STUDY



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



TOWER A & B - AERIAL VIEW FROM FOREST STREET

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7




Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

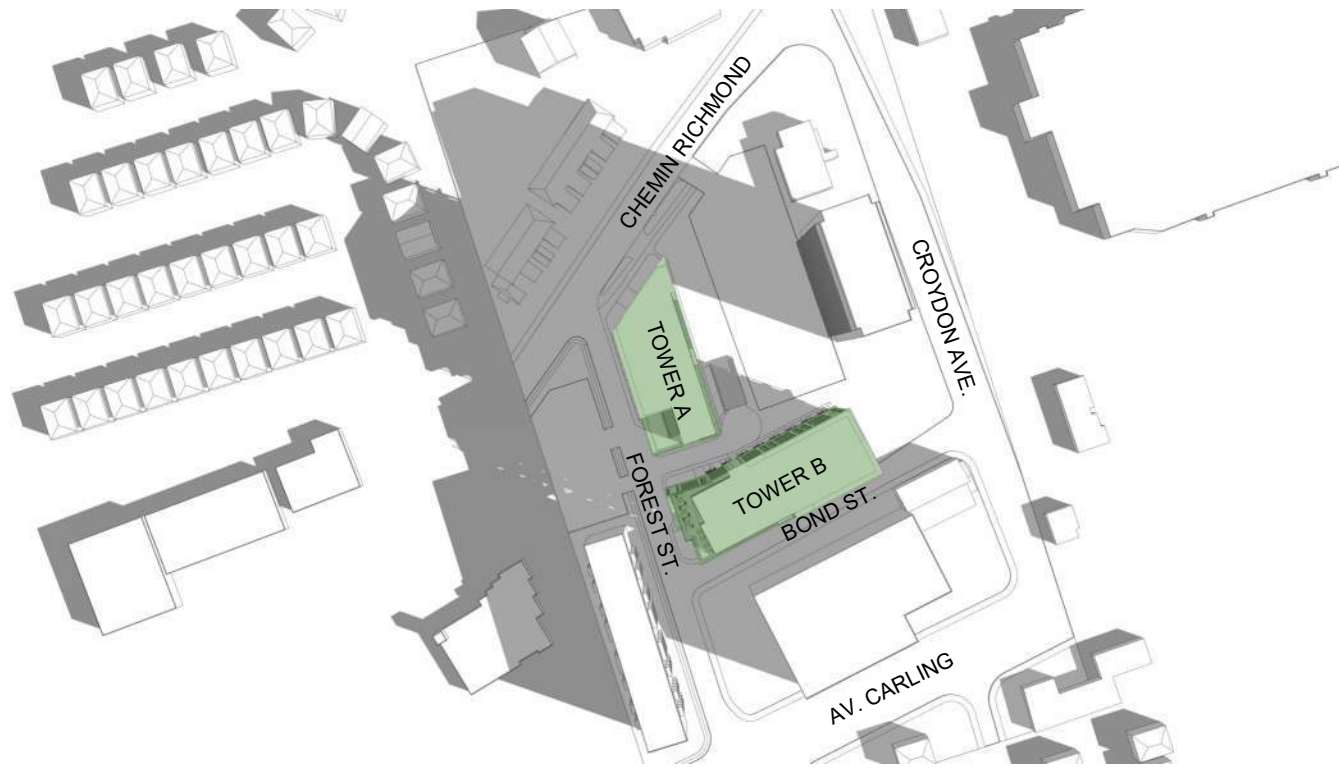

MARCH 21 AT 8H00

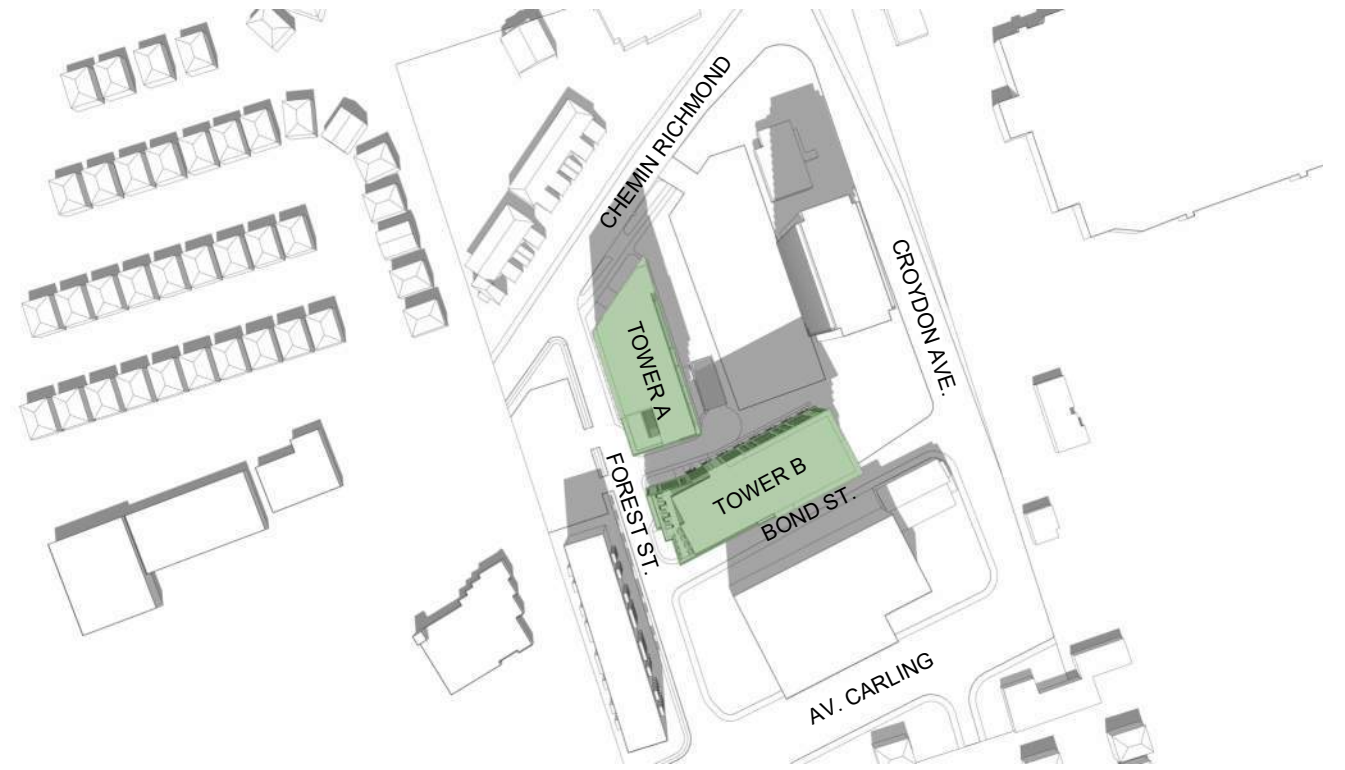

MARCH 21 AT 12H00

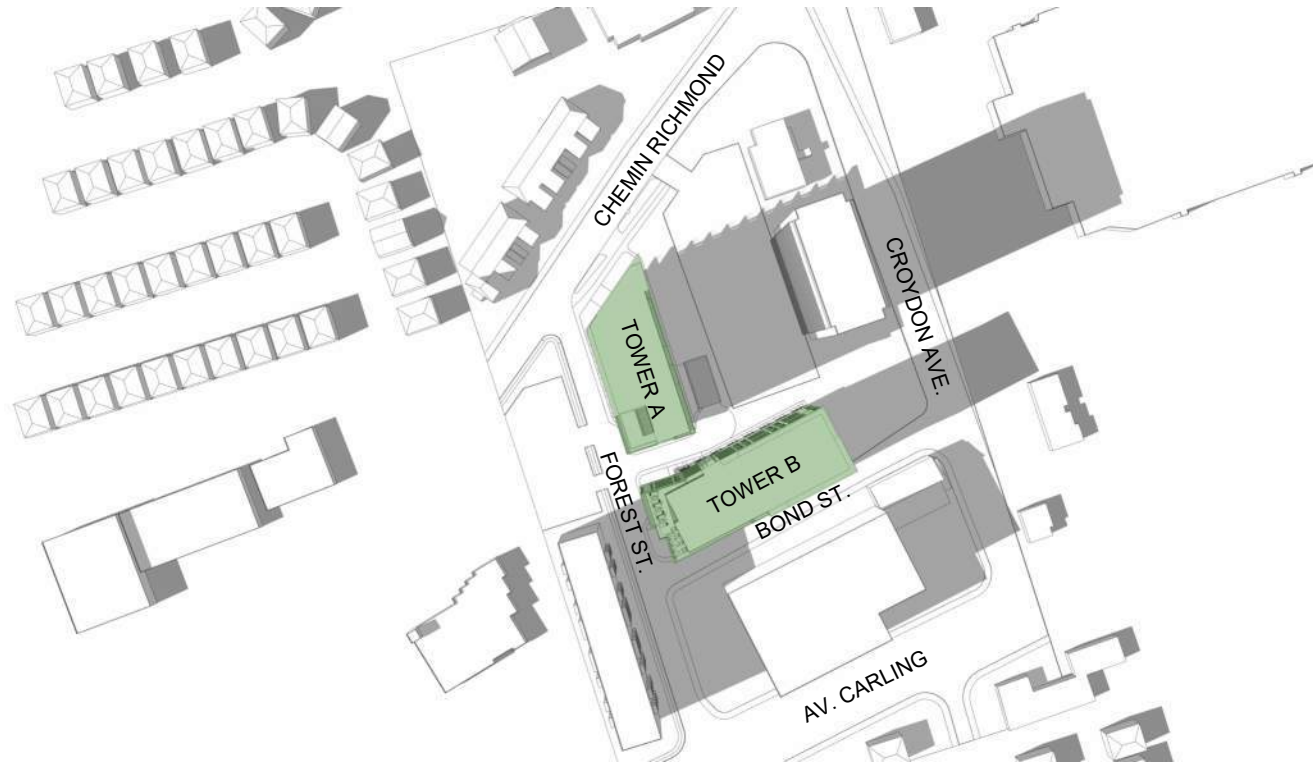

MARCH 21 AT 16H00

SHADOWING STUDY

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7




Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

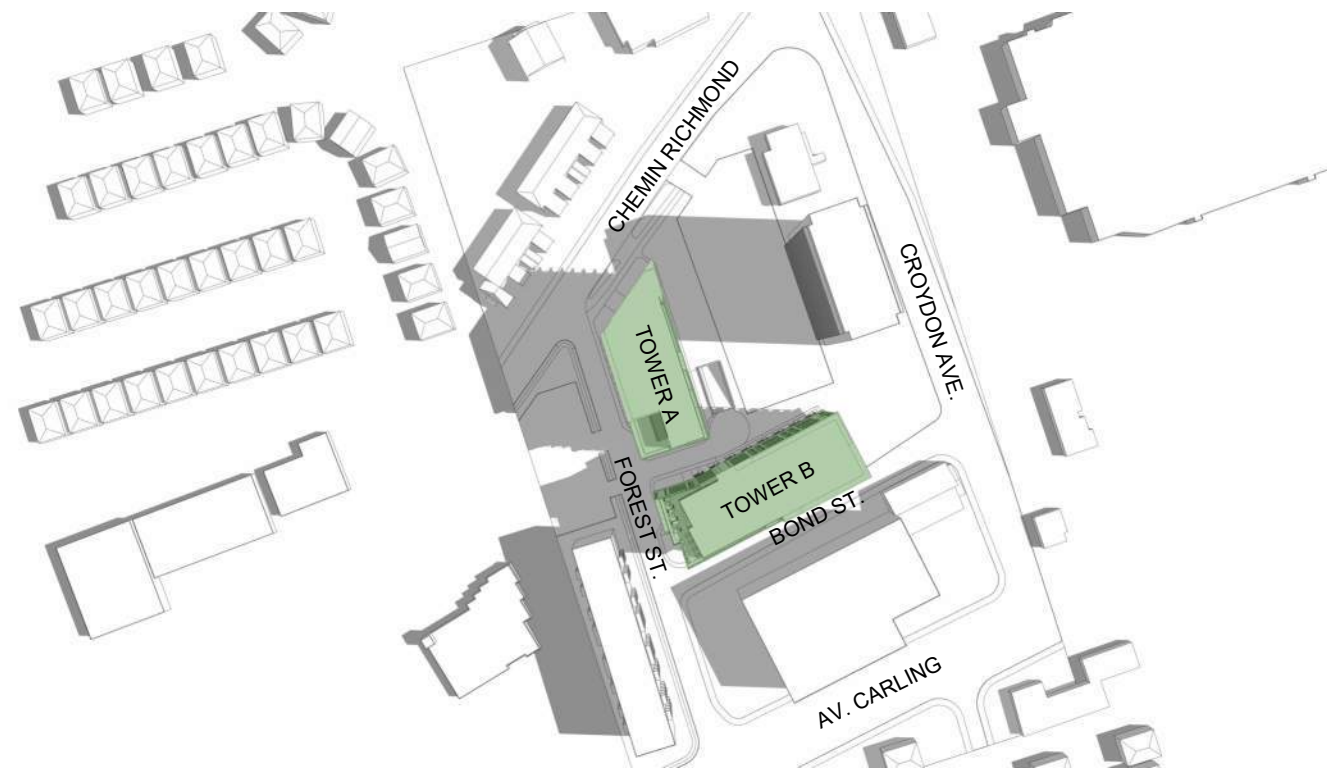

JUNE 21 AT 8H00

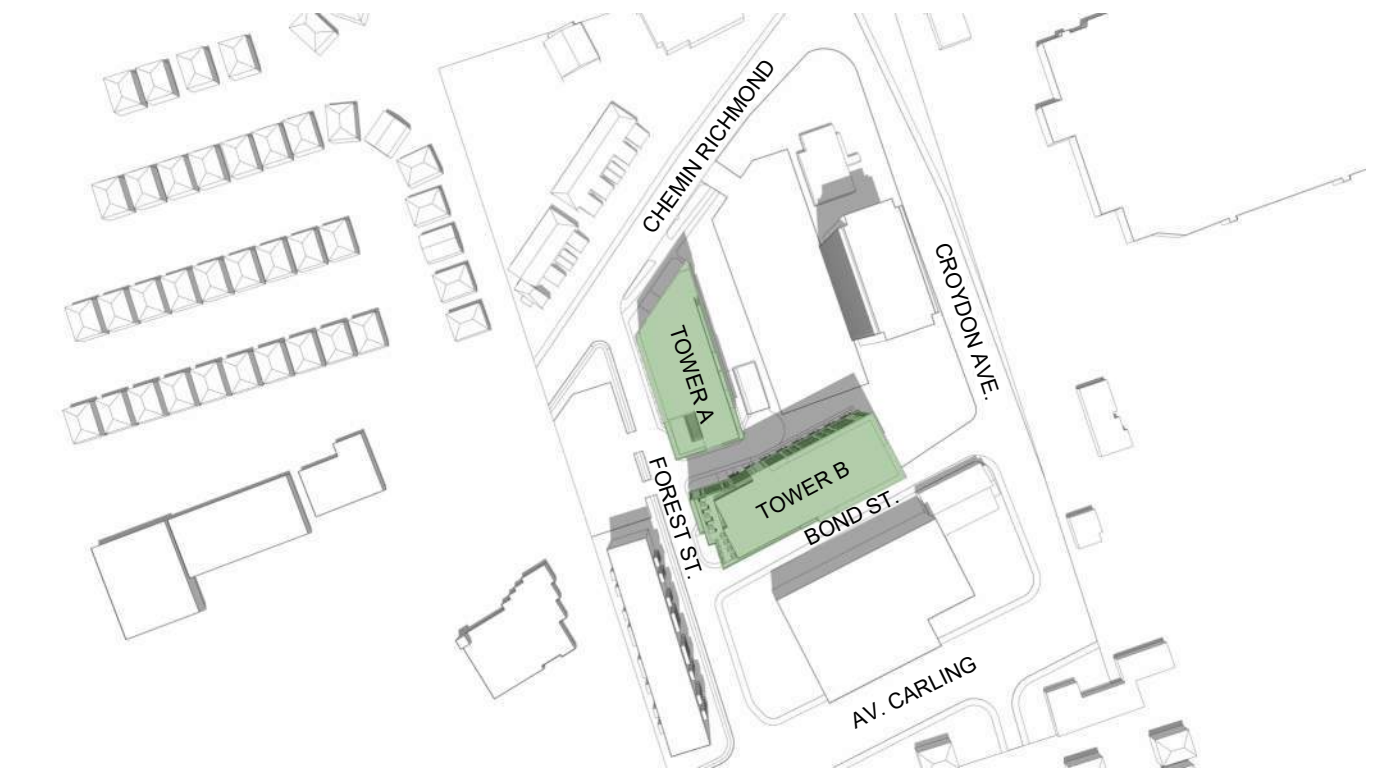

JUNE 21 AT 12H00

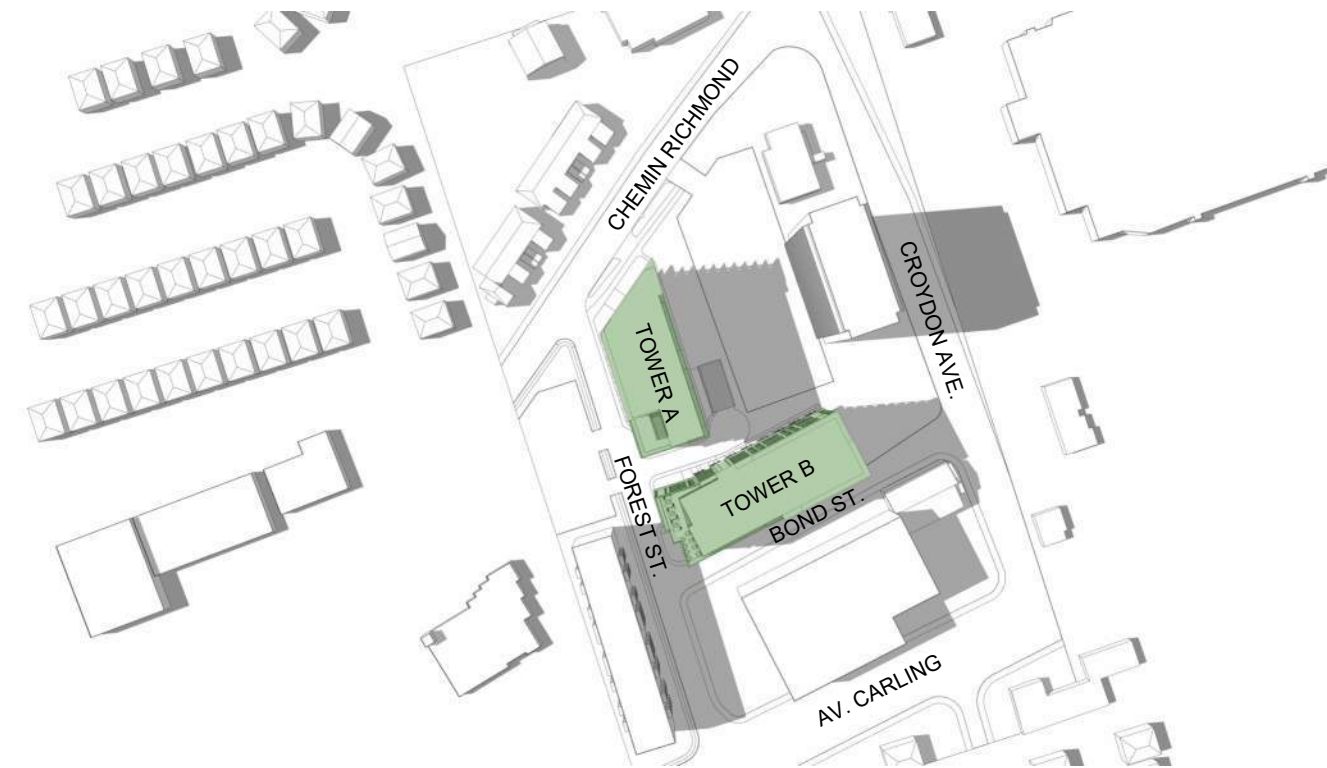

JUNE 21 AT 16H00

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7




Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca




D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

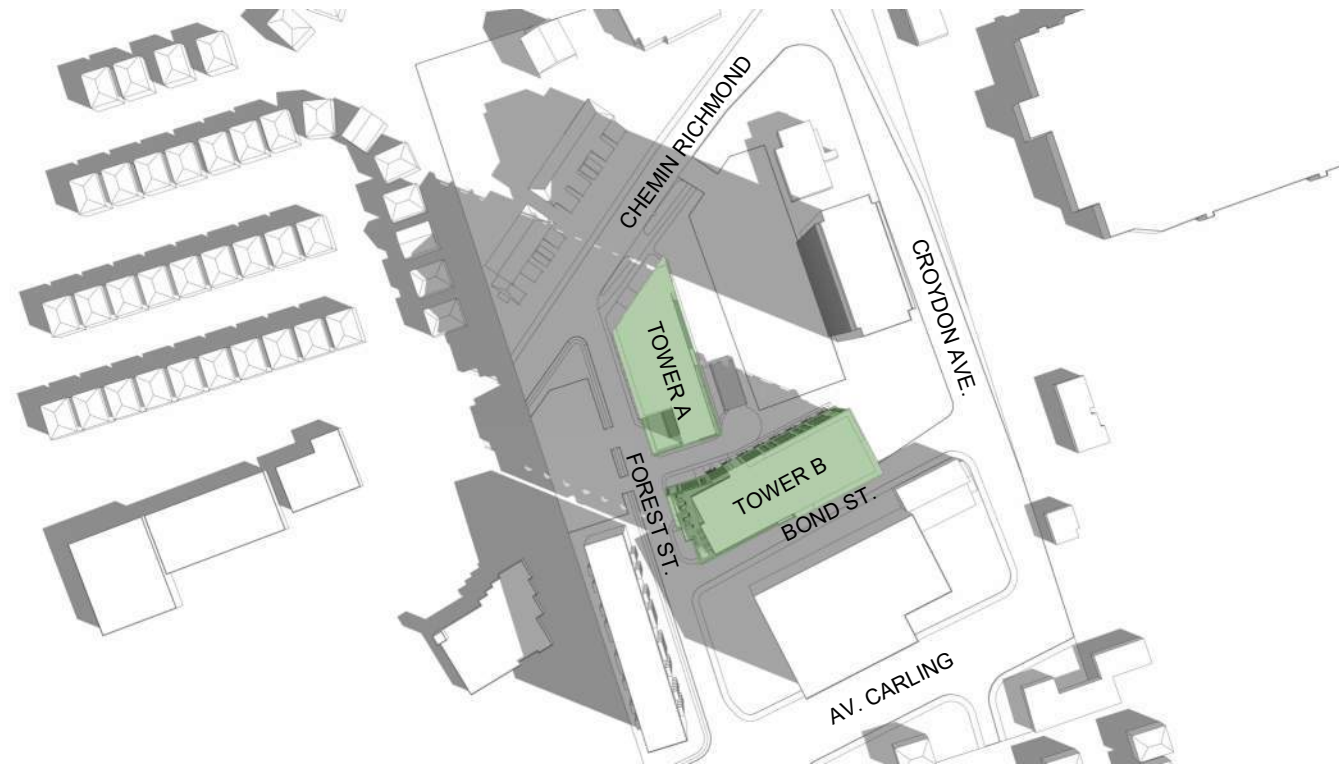

SEPTEMBER 21 AT 8H00

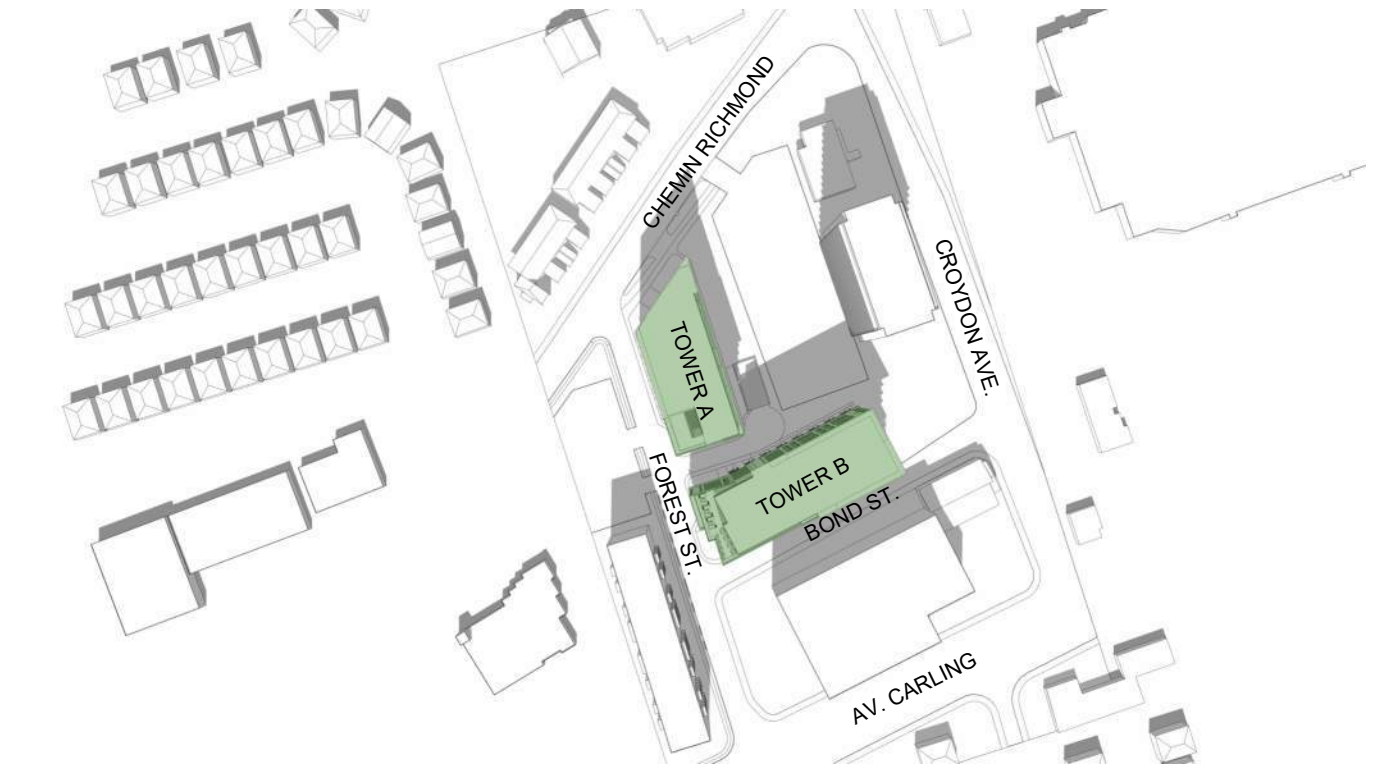

SEPTEMBER 21 AT 12H00

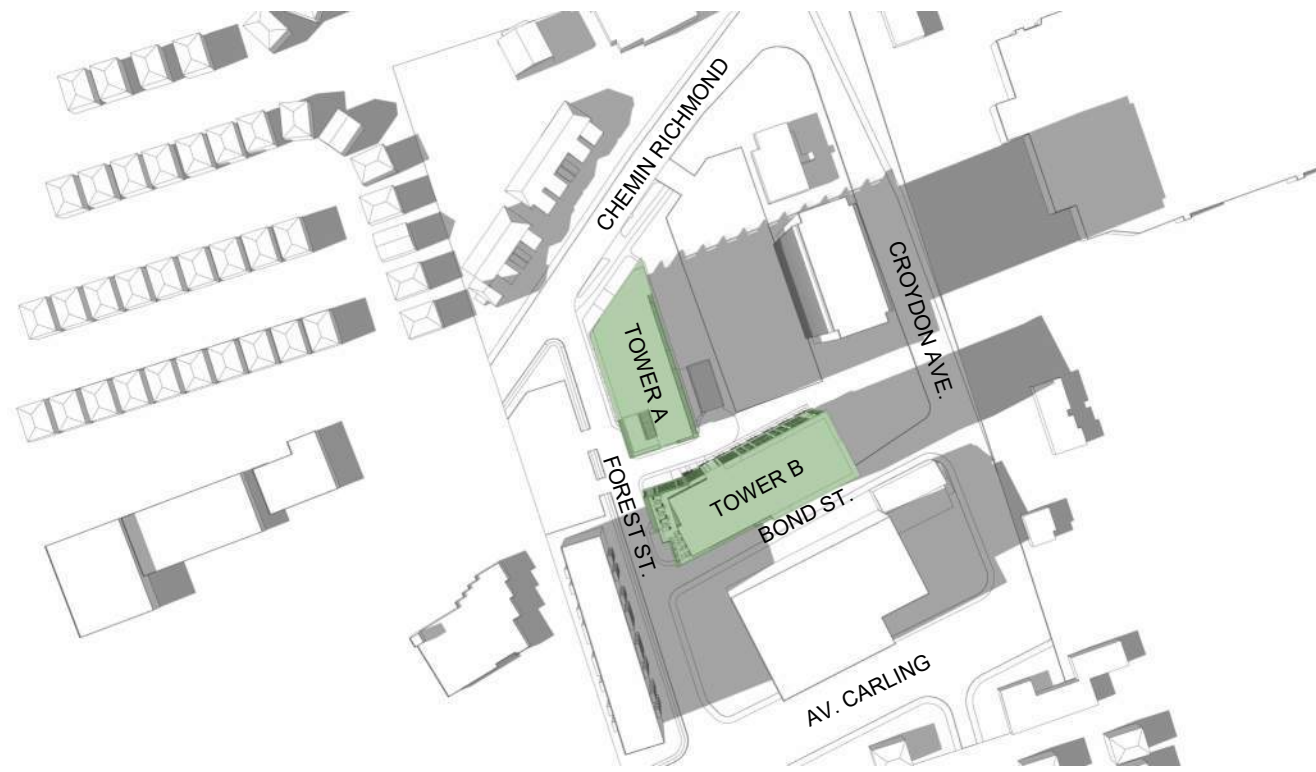

SEPTEMBER 21 AT 16H00

SHADOWING STUDY

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault


53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7

D07-12-20-0041 1887-2303-19


REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

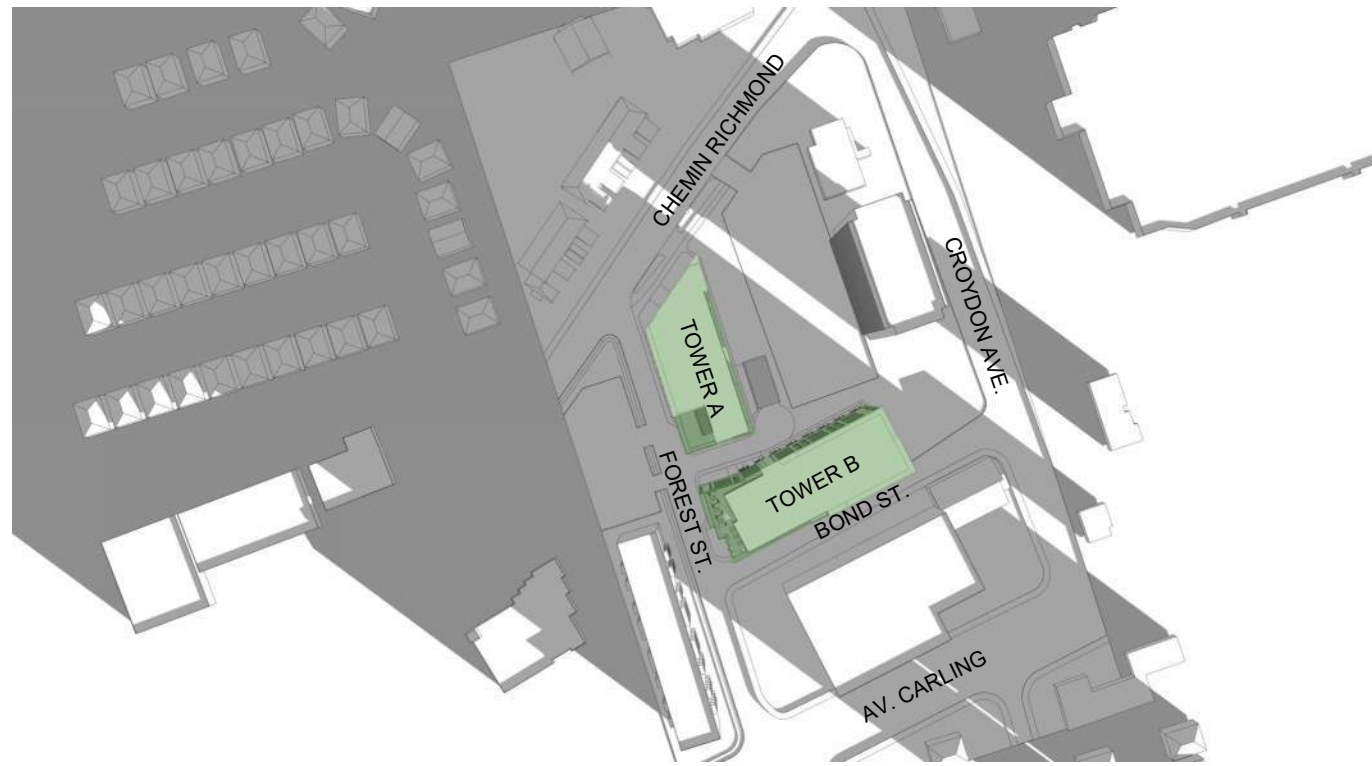

DECEMBER 21 AT 8H00



DECEMBER 21 AT 12H00

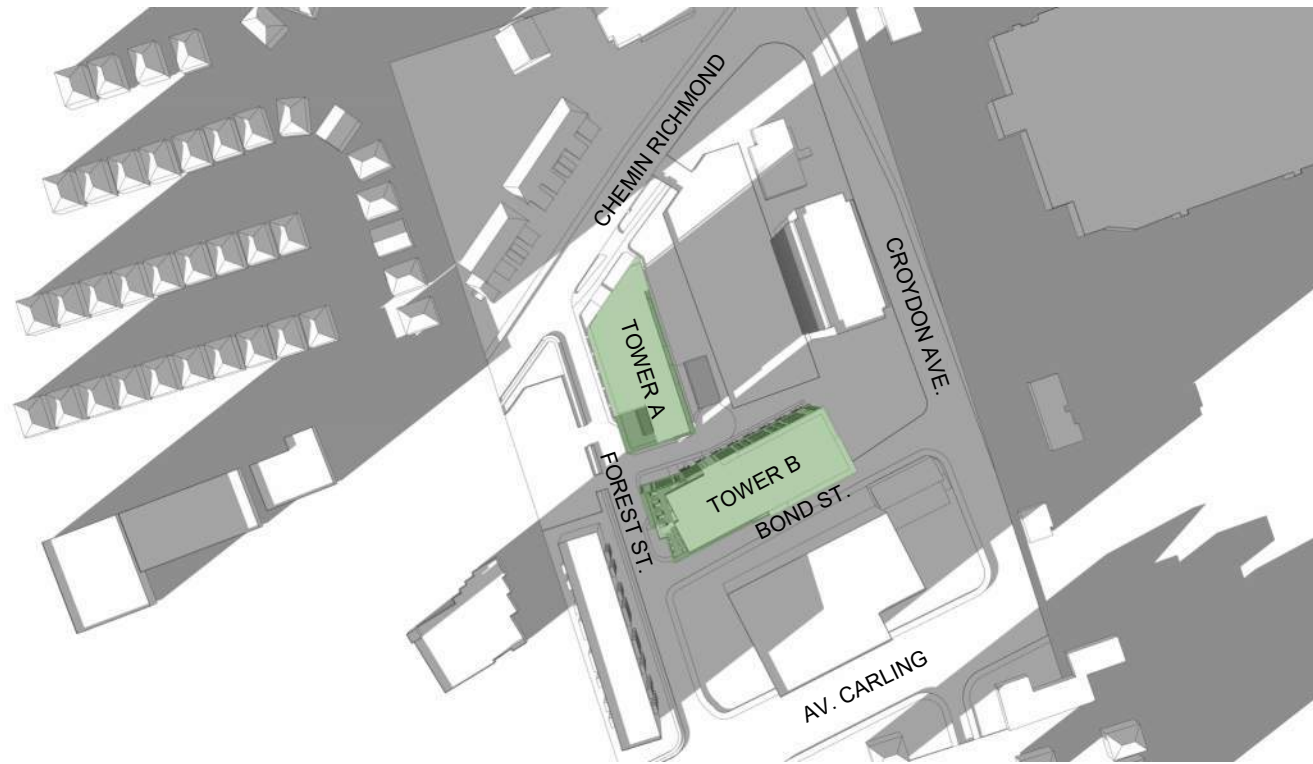

DECEMBER 21 AT 15H00

SHADOWING STUDY

GROUP HEAFEY



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



365 Forest Street, Ottawa, ON K2B 7Z7

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

GROUPE HEAFEY

RICHMOND ROAD & FOREST STREET

PROJECT RENDERINGS



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03



TOWER A - RICHMOND ROAD ELEVATION

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A & B - VIEW FROM RICHMOND ROAD

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A & B - EAST SIDE VIEW

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER B - VIEW FROM BOND STREET (PARKING ENTRANCE)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER B - VIEW FROM FOREST AND BOND STREET

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A & B - LOBBY ENTRANCE FROM FOREST STREET

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7


LAPALME RHEAULT
 ARCHITECTES | ASSOCIÉS

Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca


PMA
 ARCHITECTES


Heafey
 GROUPE
 GROUP

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A - VIEW FROM FOREST STREET LOBBY ENTRANCE



TOWER A - VIEW FROM FOREST STREET



TOWER B - VIEW FROM DROP OFF ZONE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A - VIEW FROM RICHMOND MAIN ENTRANCE

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrach.ca




D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A - VIEW OF THE COVERED EXTERIOR SPACE

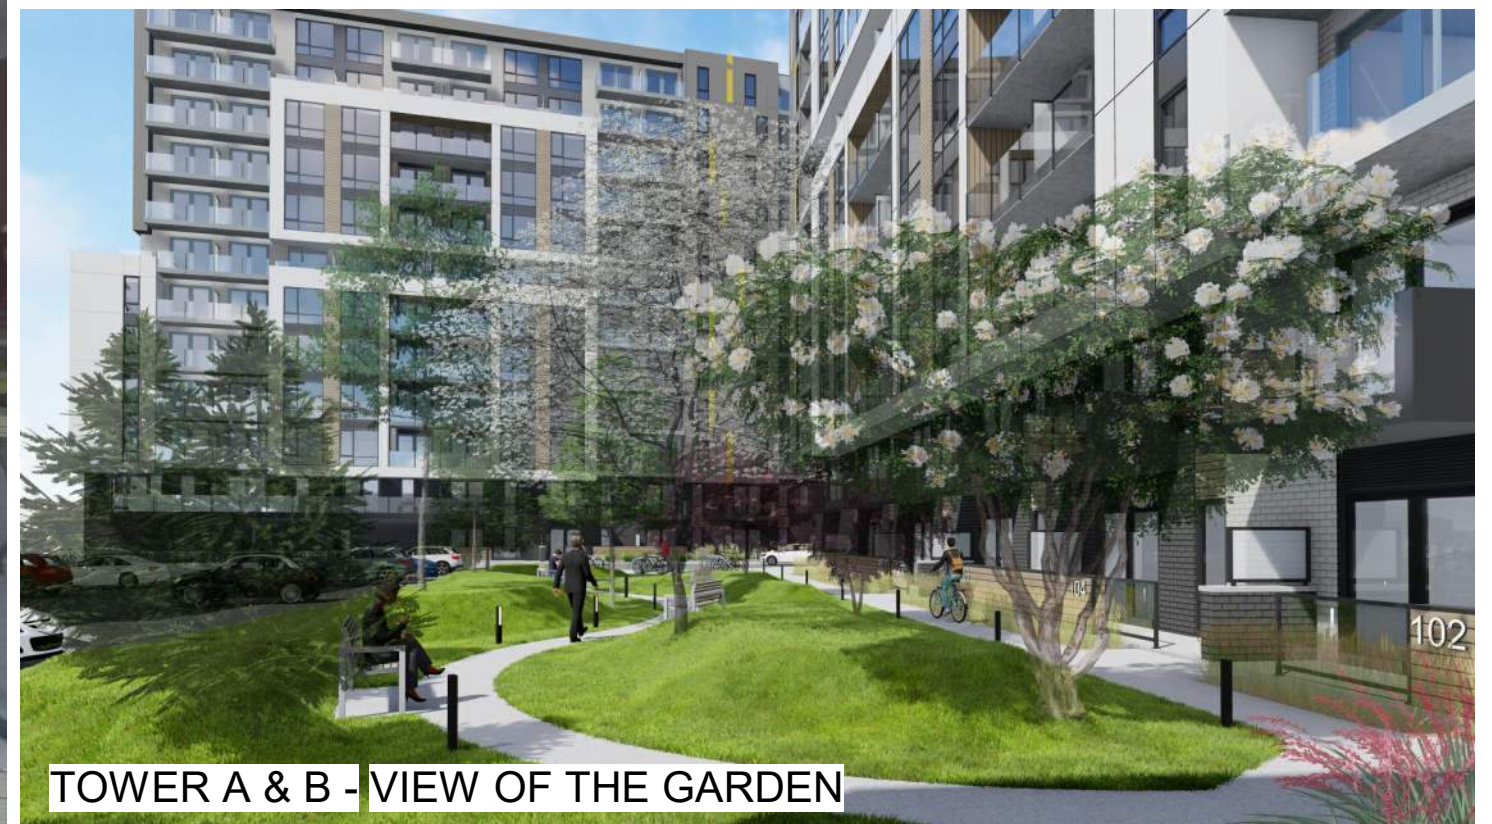

TOWER A & B - VIEW OF THE GARDEN

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



TOWER A & B - VIEW FROM RICHMOND ROAD AND FOREST STREET (NIGHT)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7

D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



Dessiné par : Tanya Nadeau
Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
Gatineau, QC J8Y 1R8
www.lrarch.ca





TOWER A - VIEW FROM RICHMOND MAIN ENTRANCE (NIGHT)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18



TOWER A & B - VIEW OF THE GARDEN (NIGHT)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



TOWER A - COMMERCIAL VIEW FROM RICHMOND ROAD (NIGHT)

GROUP HEAFEY

365 Forest Street, Ottawa, ON K2B 7Z7



Dessiné par : Tanya Nadeau
 Conçu par : Christian Rheault

53 blvd Saint-Raymond, Suite 200-A
 Gatineau, QC J8Y 1R8
 www.lrarch.ca



D07-12-20-0041 1887-2303-19

REVISION 00	2020-04-06
REVISION 01	2020-12-18
REVISION 02	2022-08-29
REVISION 03	2022-12-09
REVISION 04	2023-08-03
REVISION 05	2023-10-18

NOTES

- THESE NOTES APPLY TO ALL DRAWINGS.
- THE MECHANICAL DESIGN SHOWN IN THESE DRAWINGS IS BASED ON DATA TAKEN FROM EXP STORM WATER MANAGEMENT REPORT (SWM BELOW) AND COMPRISES SCHEDULE F OF THAT REPORT AND ALSO FROM EXP'S C100 DRAWING (EDITED FOR BREVITY).
- REFER TO EXP DRAWINGS FOR CIVIL DESIGN.
- ALL STORM PIPE LOCATIONS, PIPE INVERTS, CATCH BASIN AND AREA DRAIN LOCATIONS ARE TAKEN FROM THE SWM.
- "PST" AREA DESIGNATIONS ARE TAKEN FROM FIGURE A-2 OF THE SWM.
- DATA FOR CISTERN SIZING WAS TAKEN FROM TABLES IN APPENDIX D OF THE SWM.
- CISTERN 1 IS INTENDED TO SERVE THE "10mm" VOLUME IDENTIFIED IN THE SWM.
- CISTERN 2 IS INTENDED TO SERVE ALL OTHER FLOWS IDENTIFIED IN THE SWM.
- THE OIL GRIT SEPARATOR (OGS, STORMCEPTOR MODEL EFO4) FLOW RATE AND AREA SERVED WAS DETERMINED FROM THE SWM. CHAMBER WILL BE FACTORY FABRICATED AND SIT ON THE P-1 SLAB WITH ACCESS IN THE LANDSCAPE AREA ABOVE. IT SHALL MEET OR EXCEED ALL THE REQUIREMENTS OF THE SWM. SIZE SHOWN HERE IS NOMINAL 1500mm DIAMETER, 900mm SOLID ACCESS HATCH, SIDE INLET AND DISCHARGE.
- THE PUMP/FILTRATION SYSTEM DESIGNATED P-01 CAPACITY IS BASED ON PROVIDING WATER FOR IRRIGATION AND FOR HOSE BIBB AND NON-FREEZE WALL HYDRANT USE. THE SYSTEM IS BASED ON "CLEAN FLO WATER TECHNOLOGIES" UL FILTRATION STORMWATER PROCESS DESIGN AND YIELDS WATER SUITABLE FOR NON-POTABLE USE. ALL PIPING AND EQUIPMENT CONNECTED TO THIS SYSTEM SHALL BE IDENTIFIED AS NON-POTABLE THROUGHOUT THE PROJECT. THE SYSTEM MAY ALSO BE USED FOR SELECT TOILET/URINAL FLUSHING.
- THE TREATMENT SYSTEM IS COMPRISED OF THE FOLLOWING:
 - PACKAGED STORMWATER PUMPING AND TREATMENT SYSTEM. THE SYSTEM SHALL BE DESIGNED TO AUTOMATICALLY REUSE STORMWATER. THE STORMWATER SHALL BE TREATED AND USED FOR IRRIGATION, HOSE BIBBS, TOILET AND URINAL FLUSHING.
 - PACKAGED SYSTEM SHALL BE A COMPLETELY SKID MOUNTED SYSTEM AND INCLUDE EVERYTHING IN A SINGLE COHESIVE FINISHED PRODUCT.
 - PACKAGED SYSTEM SHALL CONTAIN ALL COMPONENTS NECESSARY TO PROCESS AND PRESSURIZE THE COLLECTED STORMWATER INCLUDING BUT NOT LIMITED TO:
 - STORAGE TANK ACCESSORIES
 - TRANSFER PUMP
 - FILTRATION
 - ULTRAFILTRATION MEMBRANE
 - DAY TANK
 - CHLORINE INJECTION RECIRCULATION (NON GASEOUS STORAGE)
 - REPRESSURIZATION BOOSTER PUMPS
 - BLADDER TANK
 - STORMWATER CONTROL AND MONITORING SYSTEM
 - CONNECTION TO BUILDING AUTOMATION SYSTEM (BAS) BACNET TCP/IP PROTOCOL.

THIS DRAWING, OR PARTS THEREOF, MAY NOT BE REPRODUCED OR USED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE, WITHOUT THE WRITTEN PERMISSION OF OM&E ENGINEERING.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION, WHERE CONFLICT ARISES THE MORE STRINGENT OF THE TWO SHALL APPLY.

COPYRIGHT © 2023 QM&E ENGINEERING.

THE CONTRACT DOCUMENTS ARE THE PROPERTY OF OM&E ENGINEERING (QM&E)

THE CONTRACTOR SHALL OBTAIN A FULL SET OF ALL CONSULTANTS' DESIGN DOCUMENTS PRIOR TO STARTING WORK.

QM&E BEARS NO RESPONSIBILITY FOR INTERPRETATIONS OF THESE DOCUMENTS BY OTHERS.

UPON WRITTEN APPLICATION QM&E WILL PROVIDE WRITTEN CLARIFICATION REGARDING THE INTENT OF THE CONTRACT DOCUMENTS.

QM&E REVIEW OF SHOP DRAWINGS SUBMITTED BY THE CONTRACTOR IS FOR DESIGN CONFORMANCE ONLY.

DRAWINGS ARE NOT TO BE SCALED FOR CONSTRUCTION. CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS, ON SITE, REQUIRED TO PERFORM THE WORK AND REPORT ANY DISCREPANCIES WITH THE CONTRACT DOCUMENTS TO THE DESIGN TEAM BEFORE COMMENCING WORK.

LEGEND

- ST STORM DRAIN ABOVE GRADE/FLOOR
- ST STORM DRAIN BURIED
- NON-POTABLE WATER
- PIPE DROPS, PIPE RISES
- DIELECTRIC UNION
- PUMP, PIPE SIZE IS NOT CONNECTION SIZE.
- COMBO SHUTOFF AND BALANCING VALVE
- ISOLATING VALVE
- PRESSURE REDUCING VALVE
- STRAINER
- CHECK VALVE

DRAWING LIST

M-005	SITE PLAN TOWERS A AND B
M-006	CISTERN SCHEMATICS AND DETAILS
M-140	LEVEL P-2 MECHANICAL SWM DESIGN
M-150	LEVEL P-1 MECHANICAL SWM DESIGN


12	ISSUED FOR SITE PLAN COORDINATION	11 OCT 2023
11	REVISED AND RE-ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
10	ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
9	ISSUED FOR CONSULTANT COORDINATION	15 SEP 2022
8	ISSUED FOR SITE PLAN APPROVAL	09 DEC 2021
7	ISSUED FOR CONSULTANT COORDINATION	08 DEC 2021
6	ISSUED FOR SITE PLAN COORDINATION	26 NOV 2021
5	ISSUED FOR SITE PLAN COORDINATION	12 NOV 2021
4	ISSUED FOR COORDINATION (ONLY M-290)	26 MAY 2021
3	ISSUED FOR COORDINATION (ONLY M-005)	23 FEB 2021
2	ISSUED FOR COORDINATION	29 JAN 2021
1	ISSUED FOR DESIGN BRIEF	21 DEC 2020
NO.	REVISION	DATE

365 FOREST ST
TOWER A AND B



CURRENT DATE	Thu, 12 Oct 2023, 15:20
SCALE	IND
DRAWN	AR/CWC
DESIGNED	AR/CWC
CHECKED	CWC
PROJECT	20-0086
DRAWING NUMBER	M-005

SITE PLAN
TOWERS A AND B

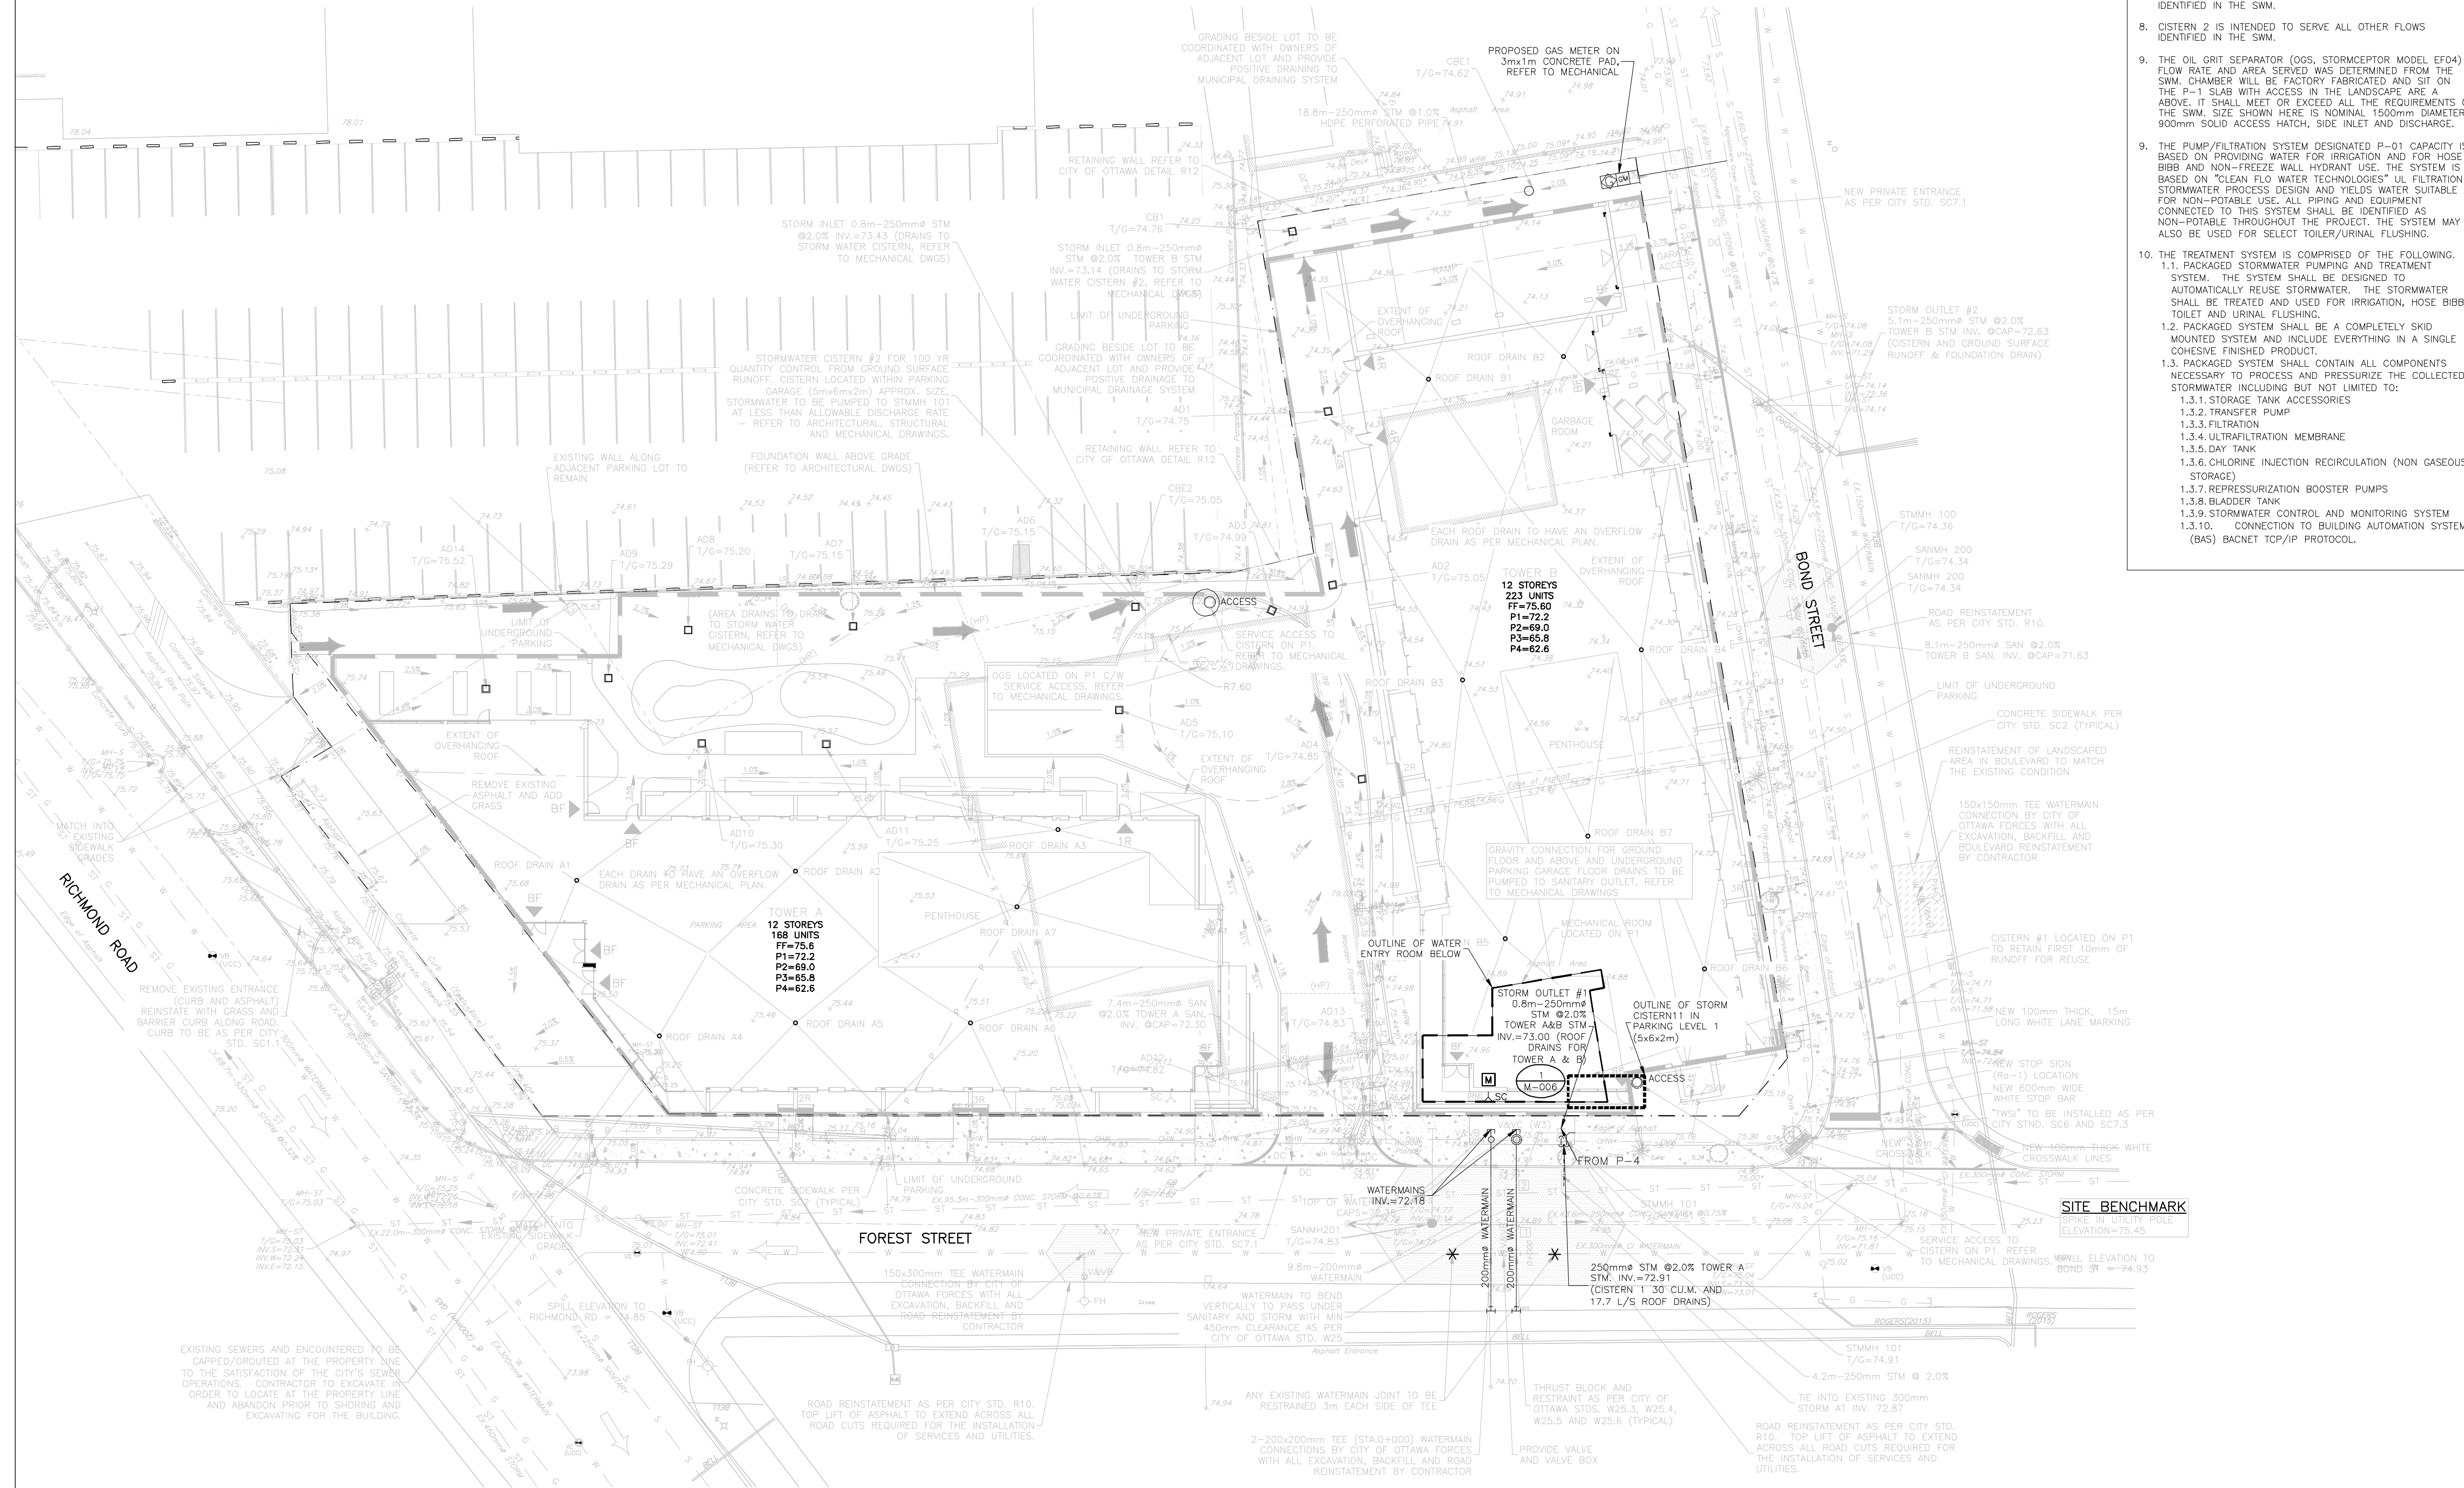

THIS DRAWING, OR PARTS THEREOF, MAY NOT BE REPRODUCED OR USED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE, WITHOUT THE WRITTEN PERMISSION OF QM&E ENGINEERING.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION. WHERE CONFLICT ARISES THE MORE STRINGENT OF THE TWO SHALL APPLY.

COPYRIGHT © 2023 QM&E ENGINEERING.

THE CONTRACT DOCUMENTS ARE THE PROPERTY OF QM&E ENGINEERING (QM&E)

THE CONTRACTOR SHALL OBTAIN A FULL SET OF ALL CONSULTANTS' DESIGN DOCUMENTS PRIOR TO STARTING WORK.



QM&E BEARS NO RESPONSIBILITY FOR INTERPRETATIONS OF THESE DOCUMENTS BY OTHERS.

UPON WRITTEN APPLICATION QM&E WILL PROVIDE WRITTEN CLARIFICATION REGARDING THE INTENT OF THE CONTRACT DOCUMENTS.

QM&E REVIEW OF SHOP DRAWINGS SUBMITTED BY THE CONTRACTOR IS FOR DESIGN CONFORMANCE ONLY.

DRAWINGS ARE NOT TO BE SCALED FOR CONSTRUCTION. CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS, ON SITE, REQUIRED TO PERFORM THE WORK AND REPORT ANY DISCREPANCIES WITH THE CONTRACT DOCUMENTS TO THE DESIGN TEAM BEFORE COMMENCING WORK.



20Q086

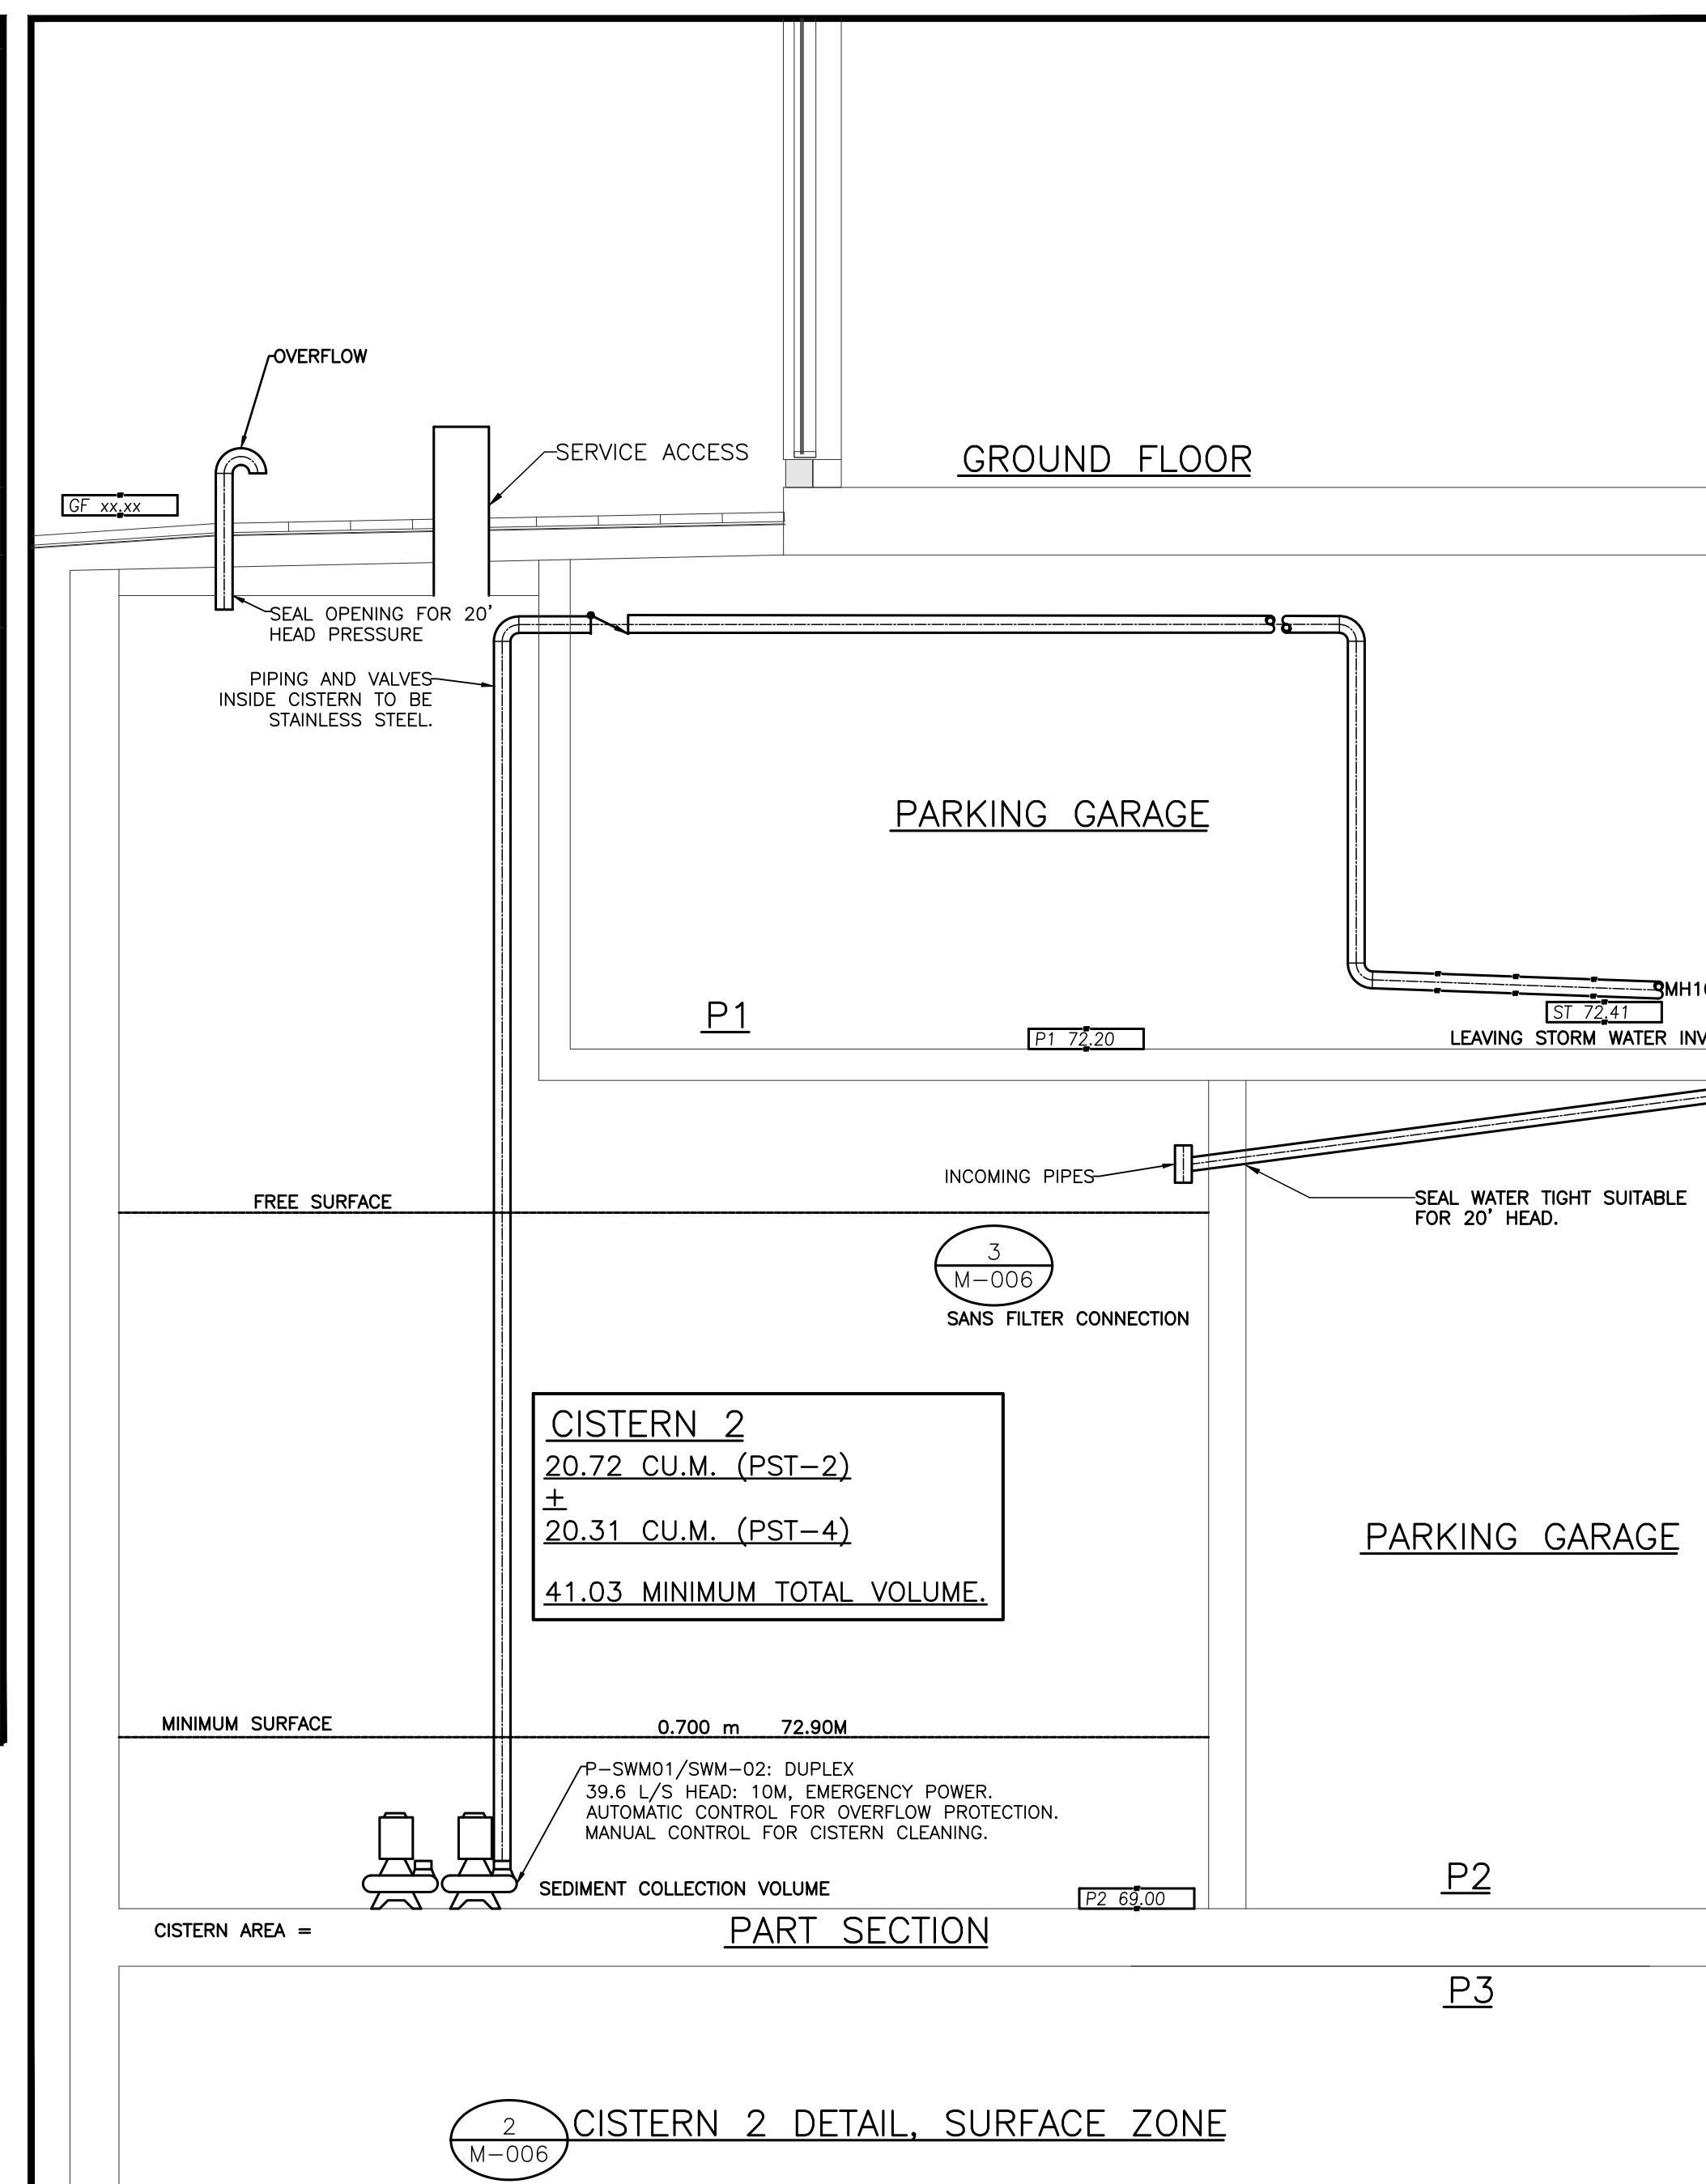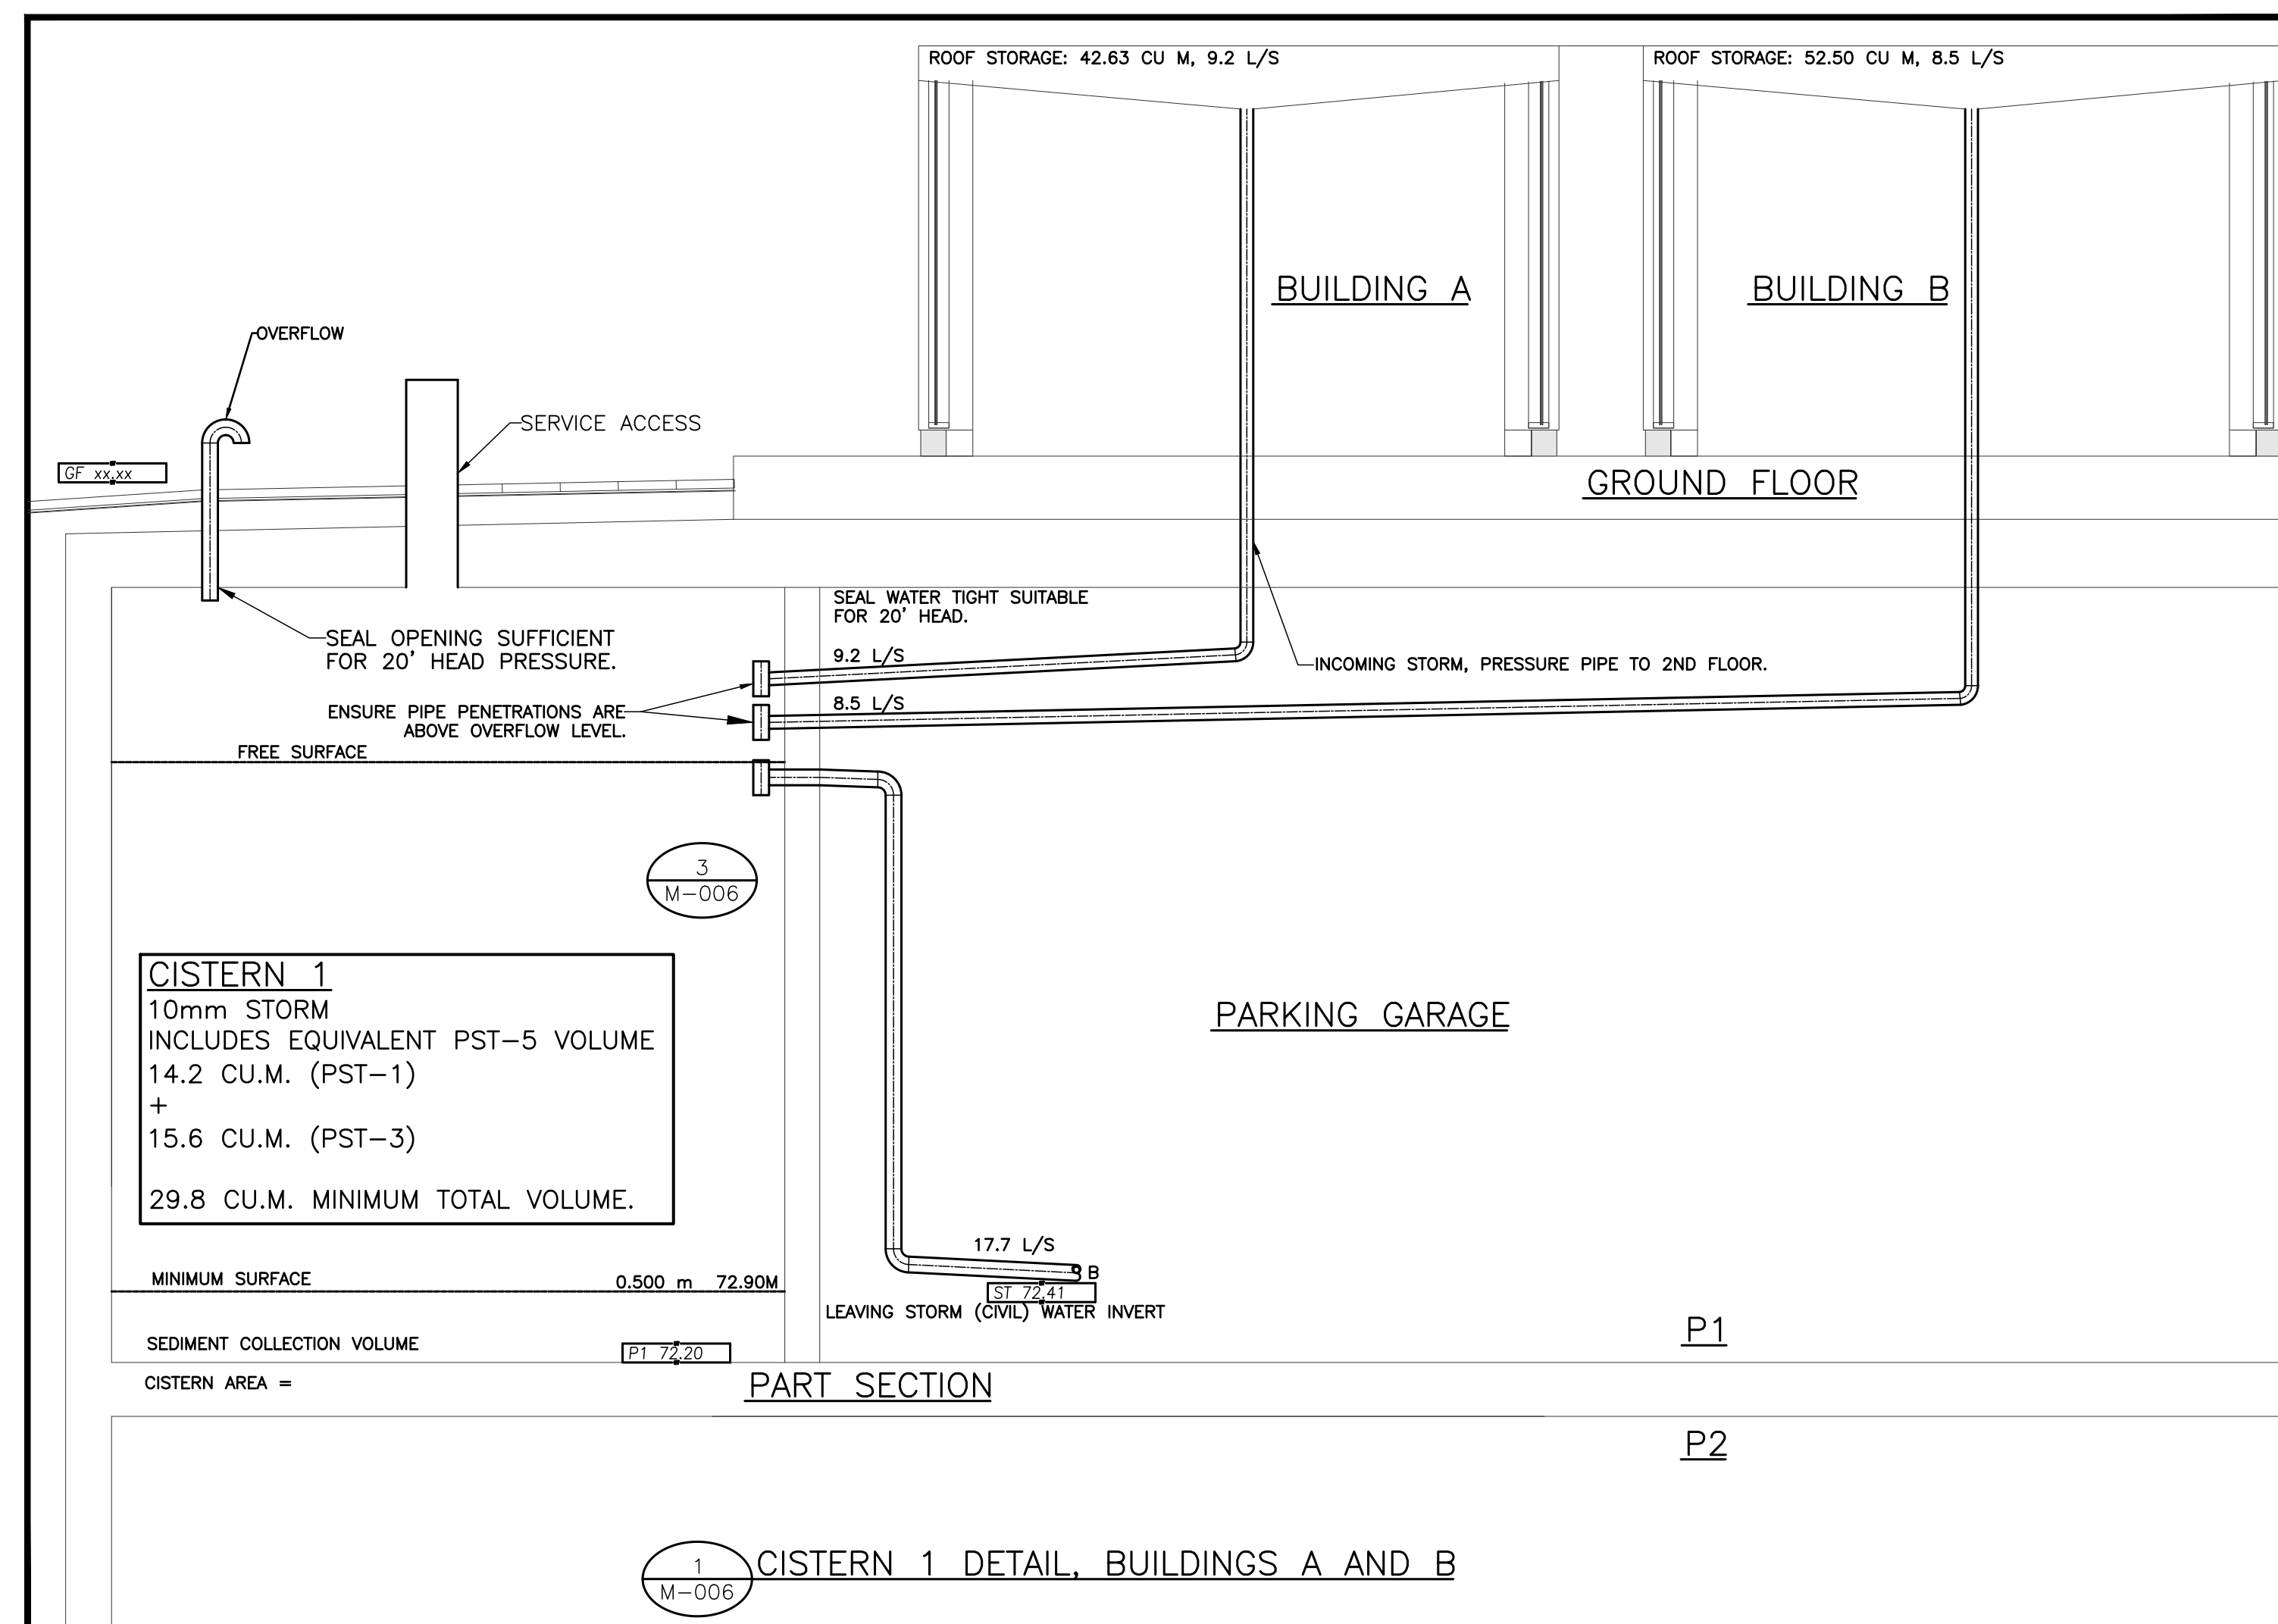

CISTERN AND OIL/GRIT SEPARATOR (OGS) SCHEDULE							
TAG	SWM REPORT FIGURE/TABLE	CATCHMENT	RELEASE RATE L/S	STORAGE CUBIC METER	10mm STORAGE CUBIC METER	TO LEAVING STORM	TO CISTERN
CIS-01	A-2/D-12 D-13	PST-1 + PST-2	9.2 - 8.5	42.63 - 52.50	29.8	GRAVITY	N/A
CIS-02	A-2/D-14	PST-4	16.5	41.03	0	PUMPED	N/A
			DRAINAGE AREA	TSS REMOVAL	WATER QUAL CAPTURE	OIL/FUEL SPILL RISK	
OGS	A-2/D-11	DRIVEWAY	0.1124 Ha	39.6	97%	>90%	YES

REFERENCE: SITE SERVICING AND STORM WATER MANAGEMENT REPORT 365 FOREST STREET, OTTAWA, ON AS PREPARED BY EXP

NOTES
1. SEE NOTES ON M-005

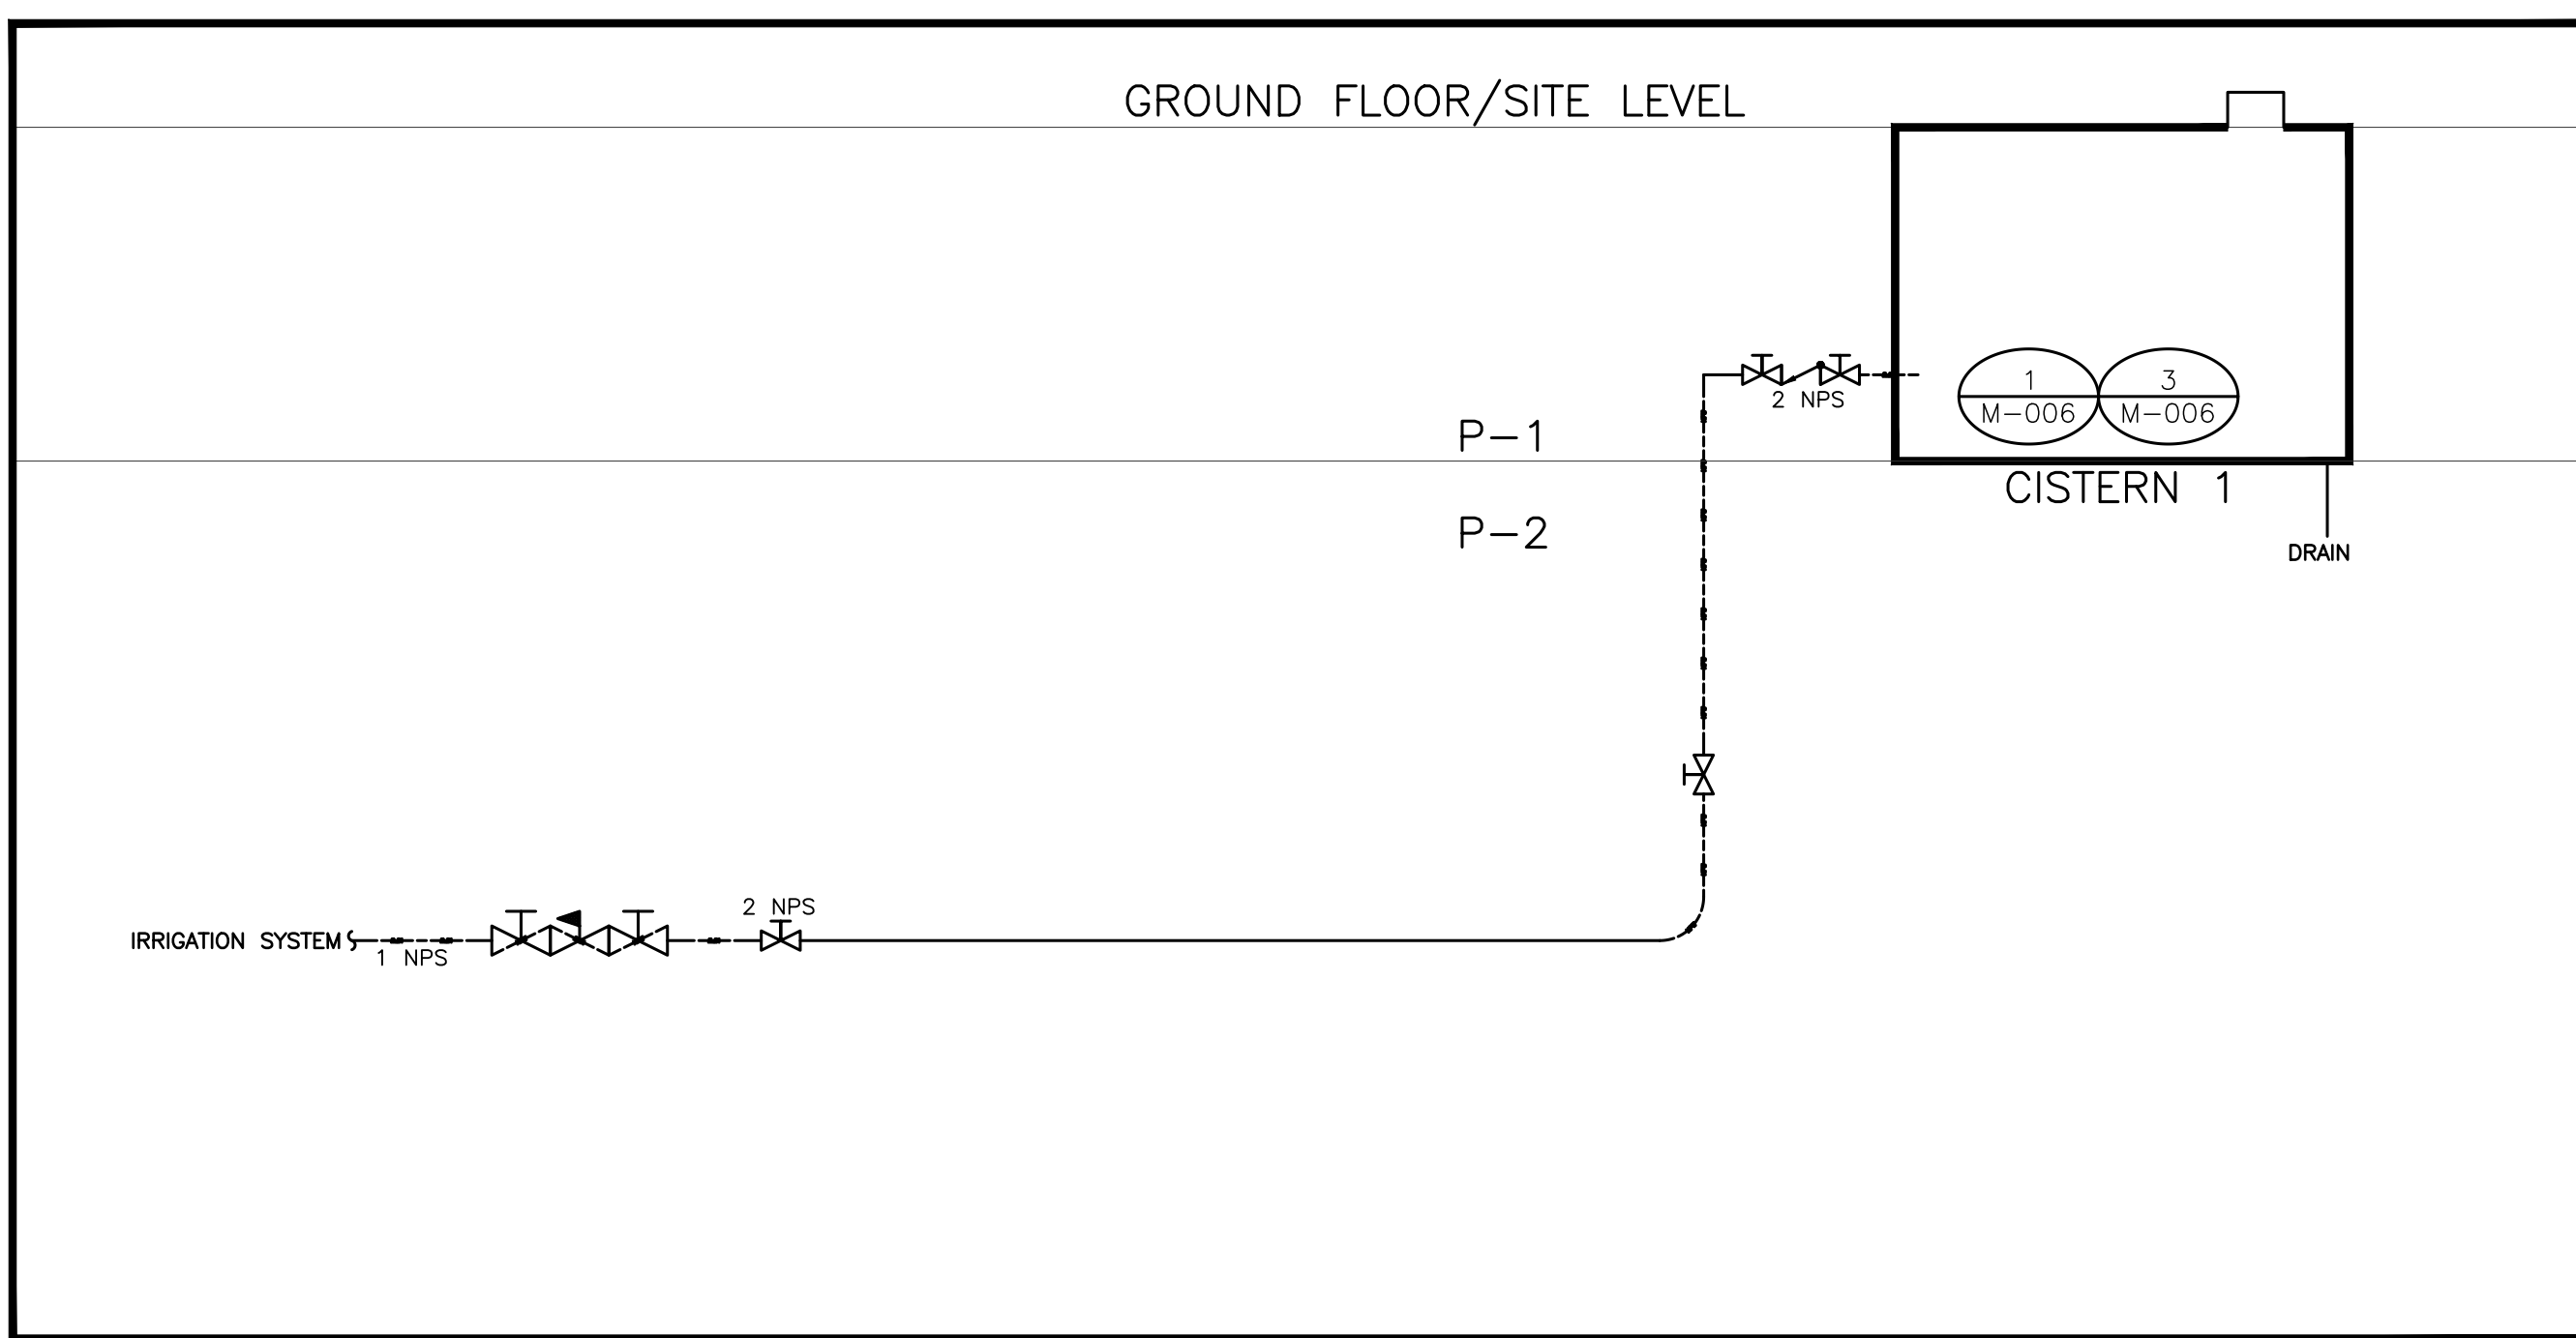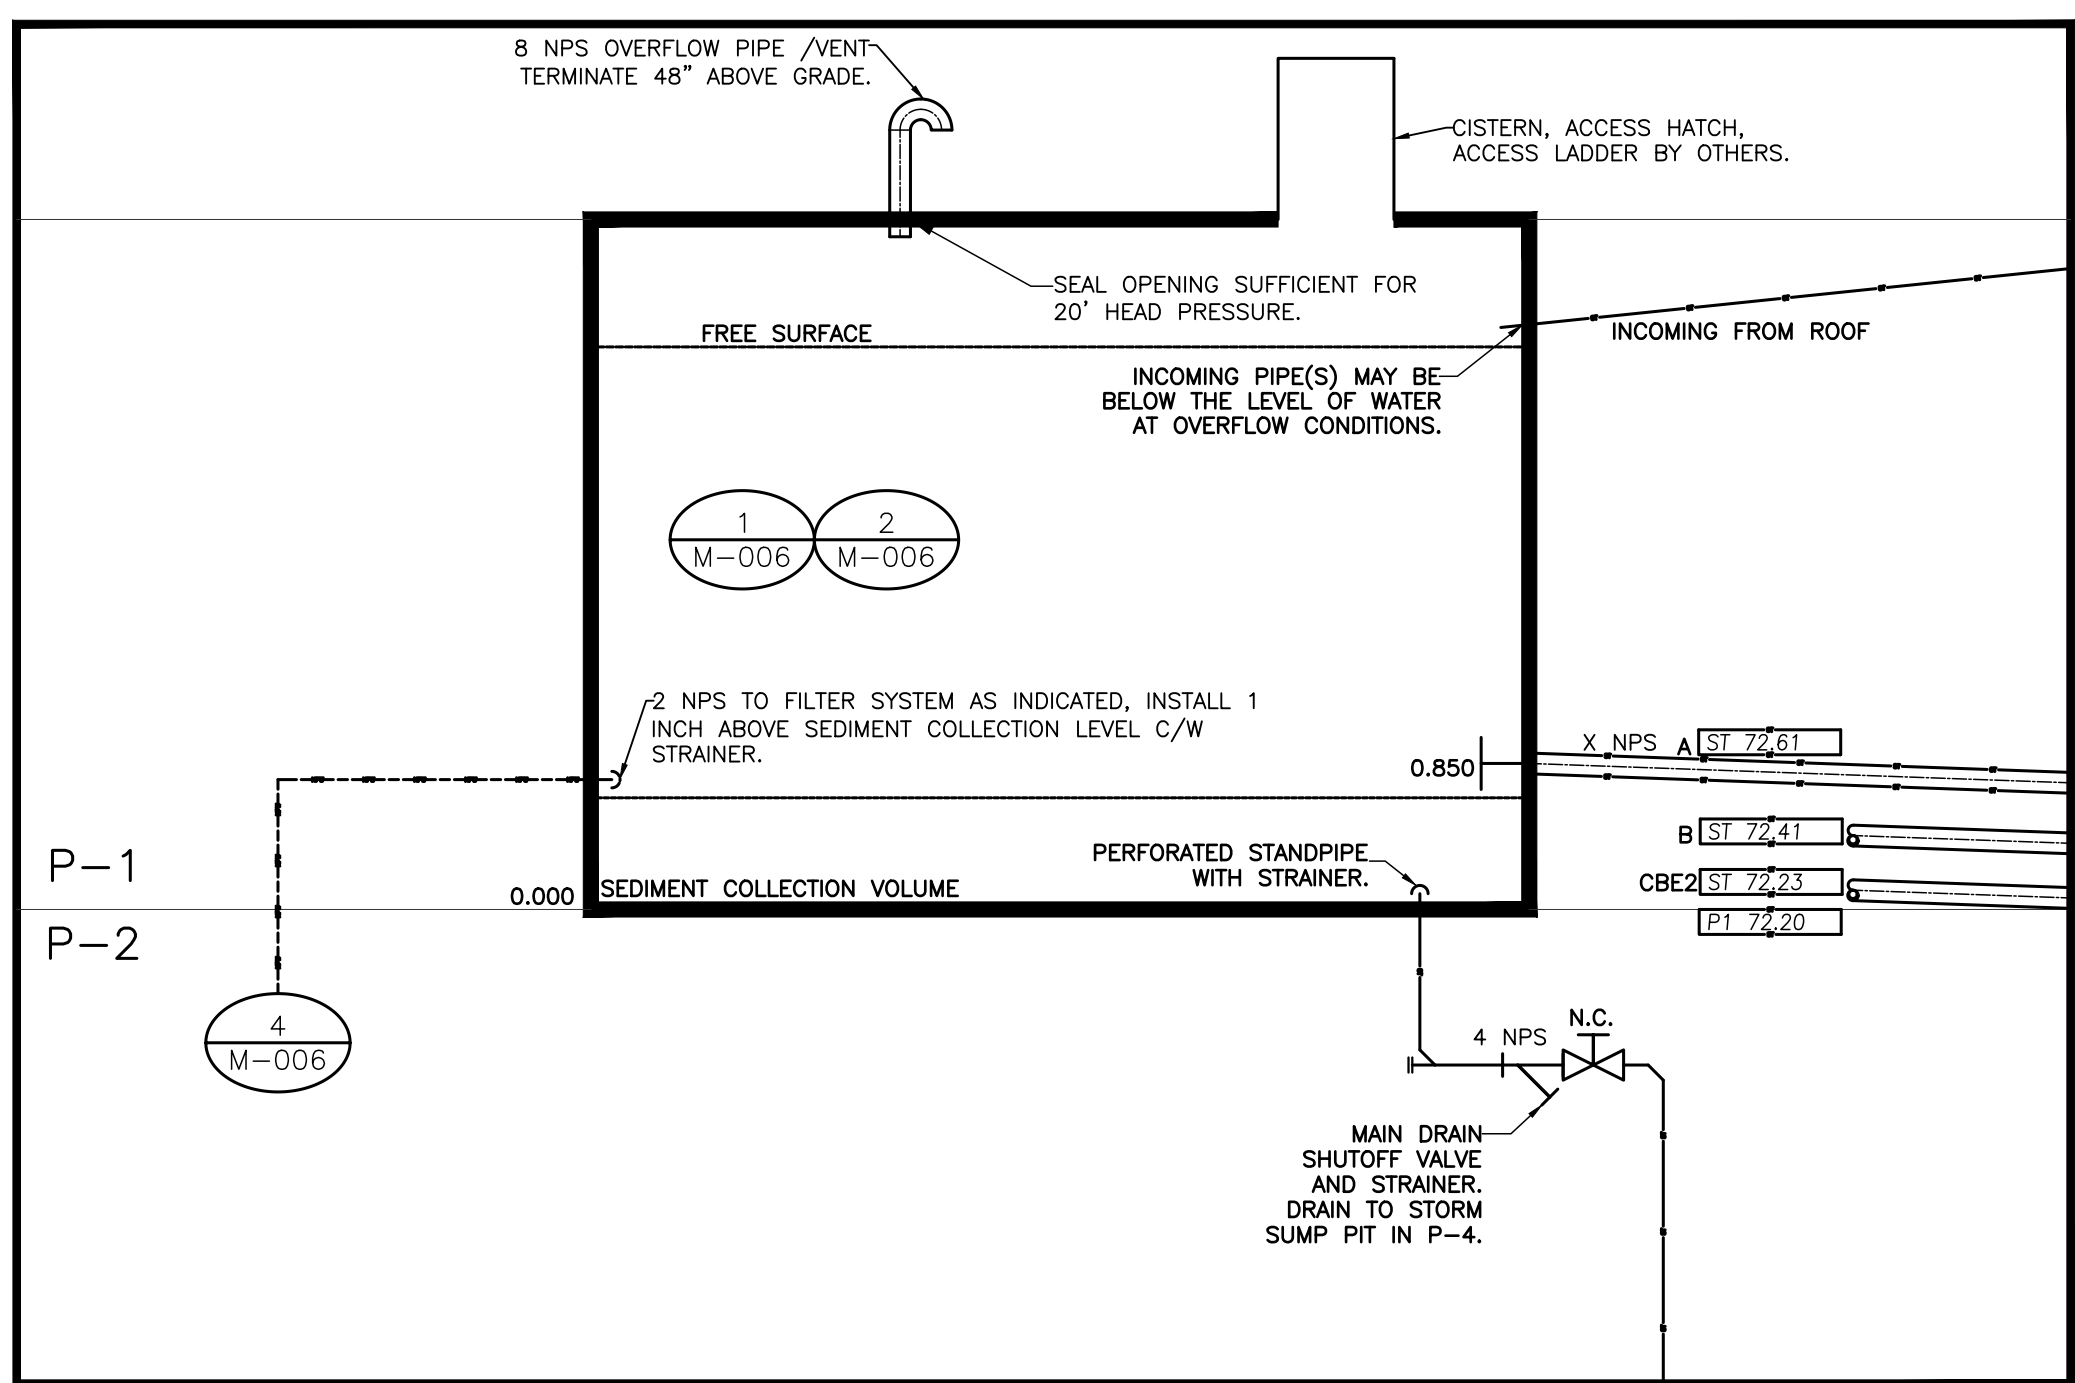

- CISTERN NOTES**
- SEE EXP SERVICES INC. STORMWATER MANAGEMENT REPORT FOR ADDITIONAL SUPPORTING INFORMATION FOR THE SYSTEM. THAT REPORT SHALL FORM PART OF THE SUPPORTING DOCUMENTS FOR THIS CONTRACT. CONTRACTOR SHALL READ THE REPORT PRIOR TO SUBMITTING CONTRACT PRICE.
 - THIS CONTRACTOR TO PROVIDE PIPING, CONTROLS, CONDUIT, WIRING AND EQUIPMENT FOR THE CISTERNS, CISTERNS TO BE PROVIDED BY GENERAL CONTRACTOR.
 - ALL PIPING SHALL BE PRESSURE PIPING INCLUDING STORM UP TO THE 2ND FLOOR.
 - ALL PIPING TO BE IDENTIFIED AS "NON-POTABLE WATER" IN ADDITION TO ANY IDENTIFICATION REQUIRED IN THE SPECIFICATION.
 - ALL PENETRATIONS OF THE CISTERN SHALL BE MADE PRESSURE AND WATER TIGHT.
 - THIS CONTRACTOR TO MEASURE AREA OF CISTERN AFTER IT IS FORMED AND DETERMINE HEIGHTS OF ALL WATER LEVELS, FLOAT LEVELS AND PIPE PENETRATIONS. SUBMIT FABRICATION SKETCH TO ENGINEER FOR REVIEW PRIOR TO STARTING WORK. ALL PIPE AND CONTROLS OPENINGS TO BE CORED IN THE CISTERN AFTER IT IS FORMED.

NO.	REVISION	DATE
12	ISSUED FOR SITE PLAN COORDINATION	11 OCT 2023
11	REVISED AND RE-ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
10	ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
9	ISSUED FOR CONSULTANT COORDINATION	15 SEP 2022
8	ISSUED FOR SITE PLAN APPROVAL	09 DEC 2021
7	ISSUED FOR CONSULTANT COORDINATION	08 DEC 2021
6	ISSUED FOR SITE PLAN COORDINATION	26 NOV 2021
5	ISSUED FOR SITE PLAN COORDINATION	12 NOV 2021
4	ISSUED FOR COORDINATION (ONLY M-290)	26 MAY 2021
3	ISSUED FOR COORDINATION (ONLY M-005)	23 FEB 2021
2	ISSUED FOR COORDINATION	29 JAN 2021
1	ISSUED FOR DESIGN BRIEF	21 DEC 2020

365 FOREST ST
TOWER A AND B

QM&E ENGINEERING
1600 LAPERRIERE AVE., UNIT 200-A, OTTAWA, ONT., K1Z 8P5
TEL: (613) 366-4763 EMAIL: mail@qmeengineering.com

CURRENT DATE	
SCALE	ND
DRAWN	AR/CWC
DESIGNED	AR/CWC
CHECKED	CWC
PROJECT	20-Q086
DRAWING NUMBER	M-006

CISTERN SCHEMATICS AND DETAILS

NOTES

1. SEE NOTES ON M-005

THIS DRAWING, OR PARTS THEREOF, MAY NOT BE REPRODUCED OR USED IN ANY FORM, BY ANY METHOD, FOR ANY PURPOSE, WITHOUT THE WRITTEN PERMISSION OF QM&E ENGINEERING.

THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE SPECIFICATION. WHERE CONFLICT ARISES THE MORE STRINGENT OF THE TWO SHALL APPLY.

COPYRIGHT © 2023 QM&E ENGINEERING.

THE CONTRACT DOCUMENTS ARE THE PROPERTY OF QM&E ENGINEERING (QM&E)

THE CONTRACTOR SHALL OBTAIN A FULL SET OF ALL CONSULTANTS' DESIGN DOCUMENTS PRIOR TO STARTING WORK.


QM&E BEARS NO RESPONSIBILITY FOR INTERPRETATIONS OF THESE DOCUMENTS BY OTHERS.

UPON WRITTEN APPLICATION QM&E WILL PROVIDE WRITTEN CLARIFICATION REGARDING THE INTENT OF THE CONTRACT DOCUMENTS.

QM&E REVIEW OF SHOP DRAWINGS SUBMITTED BY THE CONTRACTOR IS FOR DESIGN CONFORMANCE ONLY.

DRAWINGS ARE NOT TO BE SCALED FOR CONSTRUCTION. CONTRACTOR TO VERIFY ALL CONDITIONS AND DIMENSIONS, ON SITE, REQUIRED TO PERFORM THE WORK AND REPORT ANY DISCREPANCIES WITH THE CONTRACT DOCUMENTS TO THE DESIGN TEAM BEFORE COMMENCING WORK.

20Q086

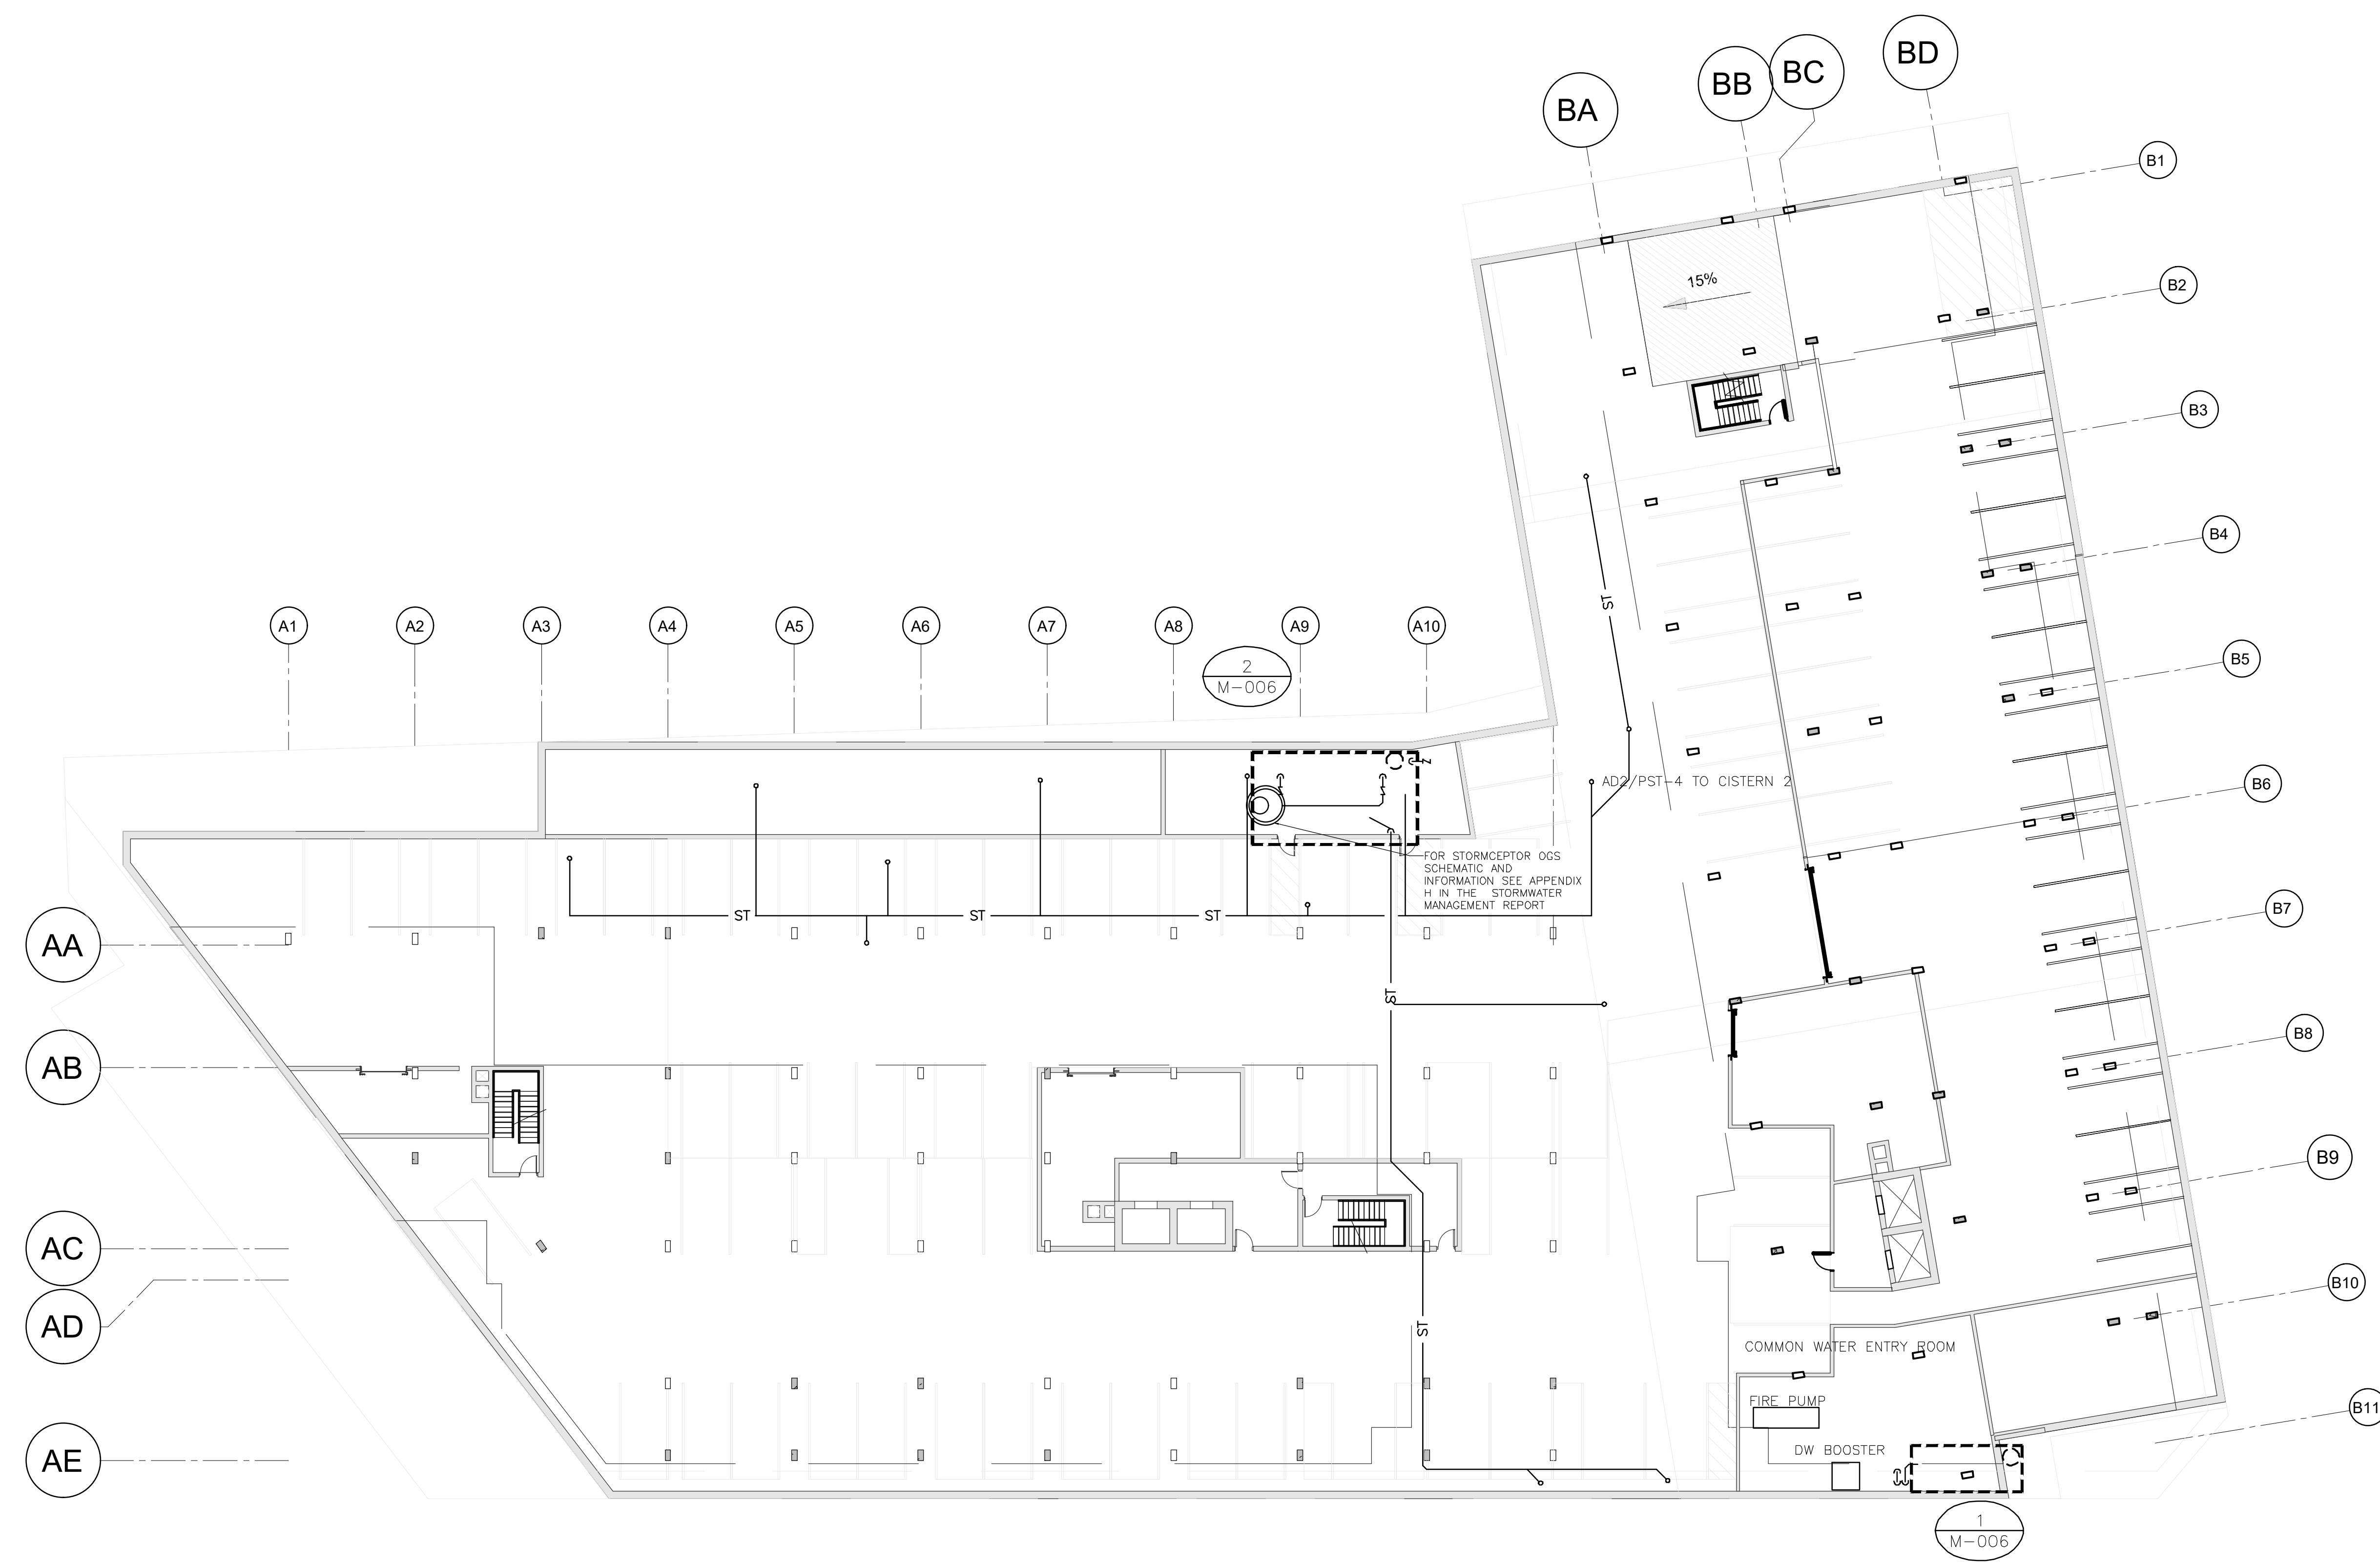

NO.	REVISION	DATE
12	ISSUED FOR SITE PLAN COORDINATION	11 OCT 2023
11	REVISED AND RE-ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
10	ISSUED FOR SITE PLAN COORDINATION	16 AUG 2023
9	ISSUED FOR CONSULTANT COORDINATION	15 SEP 2022
8	ISSUED FOR SITE PLAN APPROVAL	09 DEC 2021
7	ISSUED FOR CONSULTANT COORDINATION	08 DEC 2021
6	ISSUED FOR SITE PLAN COORDINATION	26 NOV 2021
5	ISSUED FOR SITE PLAN COORDINATION	12 NOV 2021
4	ISSUED FOR COORDINATION (ONLY M-290)	26 MAY 2021
3	ISSUED FOR COORDINATION (ONLY M-005)	23 FEB 2021
2	ISSUED FOR COORDINATION	29 JAN 2021
1	ISSUED FOR DESIGN BRIEF	21 DEC 2020


365 FOREST ST
TOWER A AND B



1600 LAPERRIERE AVE., UNIT 200-A, OTTAWA, ONT., K1Z 8P5
TEL. (613) 366-4783 EMAIL: mail@qmeengineering.com

CURRENT DATE	WKS. 11 Oct 2023, 17 34
SCALE	1:250
DRAWN	AR/CWC
DESIGNED	AR/CWC
CHECKED	CWC
PROJECT	20-0086
DRAWING NUMBER	M-150

1 FLOOR PLAN
M-150



LEVEL P-1
MECHANICAL SWM DESIGN