



Kollaard Associates

Engineers

210 Prescott Street, Unit 1

P.O. Box 189

Kemptville, Ontario K0G 1J0

Civil • Geotechnical •
Structural • Environmental •
Hydrogeology •

(613) 860-0923

FAX: (613) 258-0475

**SERVICING AND STORMWATER
MANAGEMENT REPORT**

121 BRAE CRESCENT
STITTSVILLE, ONTARIO

Prepared For:
Bryden Gibson Architects Incorporated
1066 Somerset Street West
Suite 200
Ottawa, Ontario
K1Y 4T3

PROJECT #: 220338

DISTRIBUTION

1 copies – City of Ottawa

1 copy – Bryden Gibson Architects Incorporated

1 copy – Kollaard Associates Inc.

Rev 0 – Issued for Site Plan Approval
Rev 1 – Response to Review Comments

May 12, 2023
January 12, 2024



TABLE OF CONTENTS

LIST OF APPENDICES	2
LIST OF DRAWINGS	2
1 INTRODUCTION	3
2 BACKGROUND	3
3 STORMWATER DESIGN	5
3.1 Introduction and Design Summary	5
3.2 Stormwater Management Design Criteria	5
3.3 Stormwater Quantity Control	6
3.3.1 Methodology	6
3.3.2 Time of Concentration	7
3.3.3 Runoff Coefficients	7
3.3.4 Pre-development Site Conditions	7
3.3.5 Pre-development Runoff Coefficient	7
3.3.6 Pre-development Flow Rate	8
3.3.7 Post-Development Site Conditions	8
3.3.8 Uncontrolled Runoff	9
3.3.9 Allowable Release Rate	9
3.3.10 Post Development Restricted Flow and Storage	9
3.3.11 Rooftop Storage	11
3.4 Stormwater Flows from Offsite Areas	11
3.5 Stormwater Quality Control	13
3.5.1 Quality Criteria	13
3.5.2 Quality Control Design Rationale	13
3.5.3 Rain Garden Vegetation, Planting Strategy and Plant Medium Depth	14
3.5.4 Quality Control Through Sand Filters	15
3.5.5 Volumetric Sizing	16
3.5.5.1 Sand Filter Sizing	18
3.5.5.2 Discharge Through Filters	19
3.6 Stormwater System Operation and Maintenance	19
3.6.1 Roof Drains	19
3.6.2 Rain Garden Maintenance	19
3.6.3 Inspections	20
4 SANITARY SEWER DESIGN	20
4.1 Design Flows	21
4.2 Sanitary Service Lateral	21
4.2.1 Sanitary Service Lateral Requirements	21
5 WATERMAIN DESIGN	22
5.1 Water Demand	23
5.2 Fire Flow	23
5.3 Existing Fire Hydrant	23
5.4 Boundary Conditions	24
5.5 Water Service Requirements	26
6 EROSION AND SEDIMENT CONTROL	26
7 CONCLUSIONS	27



LIST OF APPENDICES

Appendix A: Background Information

Appendix B: Storm Design Criteria and City of Ottawa Correspondence

Appendix C: Storm Design Information

Appendix D: Offsite Stormwater

Appendix E: Product Information

Appendix F: Fire Flow Calculations and Boundary Conditions

Appendix G: Drawings

LIST OF DRAWINGS

220338– PRE – Pre-Development Water Flows

220338 – POST – Controlled and Uncontrolled Areas

220338 – UPPER ROOF – Upper Roof Stormwater Plan

220338 – LOWER ROOF – Lower Roof Stormwater Plan

220338 – GR – Grading & Drainage Plan

220338 – SER – Site Servicing Plan

220338 – DETAILS – Site Servicing Details

220338 – RR – Roadway Reinstatement Plan

220338 – ESC – Erosion & Sediment Control Plan



1 INTRODUCTION

Kollaard Associates was retained by Bryden Gibson Architects Incorporated to complete a Site Servicing and Stormwater Management Report for a new multi-unit residential development in Stittsville, Ontario.

This report will address the serviceability of the proposed site, specifically relating to the adequacy of the existing sanitary sewer, storm sewer, and watermains to hydraulically convey the necessary storm runoff, sanitary sewage and water demands that will be placed on the existing system. The report shall also summarize the stormwater management (SWM) design requirements and proposed works that will address stormwater flows arising from the site under post-development conditions. The report will identify any stormwater servicing concerns and also describe any measures to be taken during construction to minimize erosion and sedimentation.

The proposed development is located at 121 Brae Crescent. The property is on the south side of Brae Crescent at the intersection of Brae Crescent and Norway Spruce Street. In older city records, the current Brae Crescent is sometimes referred to as Pine Street or Elm Street. In older city records, Norway Spruce Street is sometimes referred to as Spruce Street.

The site has a total area of 0.06 hectares and is vacant. It is understood that a multi-use building with a 160 square meter footprint will be constructed on the site. The proposed building will be 3-stories in height with associated surface parking. Parking access will be from Norway Spruce Street. There are to be five residential units in the building. Unit one is located in the basement, units two and three are located on the 1st floor, and units four and five will occupy both the 2nd and 3rd floors.

2 BACKGROUND

It is understood the sites at 121 Brae Crescent and 125 Brae Crescent were once part of the property at 123 Brae Crescent (historically labelled as 20 Spruce Street). The properties known as 121 Brae Crescent and 125 Brae Crescent are currently unoccupied.

City of Ottawa Drawing GO-244 p&p 25 (completed in 1979) shows the following information:

- Sanitary laterals extending east from the 250mm diameter sanitary main on Norway Spruce.
- A sanitary main connecting from the west section of Brae Street (Pine Street) to the main on Norway Spruce at manhole no.235.



- The sanitary main on Brae (Pine Street) does not extend eastward past the intersection of Norway Spruce.

A topographic survey completed by Annis, O’Sullivan Vollebakk Ltd in 2022 shows the following:

- A gas line connecting from the gas main on Norway Spruce Street to the residence at 123 Brae Crescent.
- An overhead hydro line connecting from a pole on Norway Spruce Street to the residence at 123 Brae Crescent.
- A water valve on Norway Spruce between the gas line and utility pole adjacent to the site.
- A water valve on Brae Crescent located at the entranceway to 123 Brae.

From these drawings it is understood that the property formerly known as 20 Spruce Street was serviced from Norway Spruce Street through the property now known as 121 Brae Crescent.

Discussions with the City of Ottawa (see appendix for correspondence) indicated that a plan and profile drawing (P&P) was tied to a consent application for the severance of lots 121, 123 and 125 Brae. The drawing shows the design of a proposed sanitary sewer extension from the manhole at the intersection of Norway Spruce and Brae (manhole no 235) to the midpoint on 125 Brae. A note on the drawing indicates that the contractor will locate and use the existing services that previously serviced 123 Brae to service the new development at 121 Brae.

Google Street View imagery shows that after 2009 and prior to 2012 work was completed on Brae Crescent with road cuts that extend from sanitary manhole no.235 eastward, terminating in front of the residence at 123 Brae. Road cuts are also shown above the watermain on Brae Crescent, extending to the water valve at the entrance in front of 123 Brae.

During a site investigation it was found that there is a sanitary pipe coming from the east and connecting to manhole no 235. The overhead hydro line connecting from a pole on Norway Spruce Street to the residence at 123 Brae Crescent still remains.

Although the City of Ottawa does not have records of an extension of a sanitary sewer toward the east on Brae, it is probable that one was completed between 2009 and 2012, and that a new sanitary lateral and water lateral were installed to service the residence at 123 Brae. The original sanitary and water stubs remain on Norway Spruce Street for use with a new development at 121 Brae.

Since the proposed development on 121 Brae will consist of a multi-unit dwelling and not a single family dwelling, it is unlikely that the existing laterals on Norway Spruce will be of adequate size for the sanitary and water demands of the new development. Therefore it is proposed to abandon these service stubs. The existing sanitary lateral should already be



capped at the property line. The existing water lateral should be abandoned at the main in accordance with the City of Ottawa standards. The new service lateral location and sizing information will be located on the Kollaard Associates Servicing Plan drawing 220338-SER.

It is strongly advised that the owner have site locates completed on the property to verify if there are still gas lines, and telecommunication lines running through the property of 121 Brae to service 123 Brae. The exact location of this information is unknown, and these utilities may need to be relocated.

3 STORMWATER DESIGN

3.1 Introduction and Design Summary

Design of the storm sewer system was completed in conformance with the City of Ottawa Sewer Design Guidelines (October 2012 as amended).

The majority of the runoff from the existing property currently drains via overland flows to the northwest, into the roadside ditch on Norway Spruce Street.

On site storage is to be provided on the upper and lower portions of the roof of the building. The release rate from the proposed on-site detention will be restricted by the use of adjustable flow control roof drains such that the post-development flows originating within the building footprint during a 100 year event do not exceed the 2-year pre-development conditions.

Calculations of the required storage volumes have been prepared based on the Rational Method as identified in Section 8.3.10.3 of the City's Sewer Guidelines. The depth and extent of surface storage will be illustrated on the upper roof drainage plan (220338-UPPER ROOF) and lower roof drainage plan (220338-LOWER ROOF).

3.2 Stormwater Management Design Criteria

Quantity and quality control criteria were provided by the City of Ottawa (CoO). The correspondence with the CoO is included in Appendix B. The stormwater management criteria for quantity and quality control as follows:

- Control the roof runoff for all storm events (up to and including 100 year events) on the proposed building to the 2-year release rate and the remainder of the site runoff can continue to flow as uncontrolled towards the existing roadside ditches.
- There should be no stormwater ponding in parking areas or drive aisle during the 2-year storm event.



- Stormwater flows from neighbouring properties conveyed through the south-eastern portion of the site should not be obstructed.
- An enhanced level (80% TSS) of protection is required for water quality control.

3.3 Stormwater Quantity Control

3.3.1 Methodology

Peak Flow for runoff quantities for the Pre-Development and Post-Development stages of the project were calculated using the rational method. The rational method is a common and straightforward calculation, which assumes that the entire drainage area is subject to uniformly distributed rainfall. The formula is:

$$Q = \frac{CiA}{360}$$

Where

Q is the Peak runoff measured in ***m³/s***

C is the Runoff Coefficient, **Dimensionless**

A is the runoff area in **hectares**

i is the storm intensity measure in ***mm/hr***

All values for intensity, *i*, for this project were derived from IDF curves provided by the City of Ottawa for data collected at the Ottawa International airport. For this project three return periods were considered 2, 5 and 100-year events. The formulas for each are:

2-Year Event

$$i = \frac{732.951}{(t_c + 6.199)^{0.810}}$$

5-Year Event

$$i = \frac{998.071}{(t_c + 6.053)^{0.814}}$$

100-Year Event

$$i = \frac{1735.688}{(t_c + 6.014)^{0.82}}$$

Where *t_c* is time of concentration



3.3.2 Time of Concentration

In keeping with the City of Ottawa Storm Sewer Guidelines, a minimum time of concentration of 10 minutes is to be used for urban development. As such a time of concentration of 10 minutes was used for both pre- and post-development conditions.

3.3.3 Runoff Coefficients

Runoff coefficients for impervious surfaces (roofs) were taken as 0.90, and pervious surfaces (grass) were taken as 0.20.

A 25% increase for the post development 100-year runoff coefficients was used as per City of Ottawa guidelines.

3.3.4 Pre-development Site Conditions

As previously indicated, the site is located at the intersection of Brae Crescent and Norway Spruce Street. The property has a total area of about 0.06 hectares and is currently vacant.

Based on the topographic survey, the majority of the runoff from the property drains via overland flows to the northwest into the roadside ditch on Norway Spruce Street. The ditch on Norway Spruce Street conveys the stormwater to the south.

Drawing 220338-PRE shows the pre-development site conditions.

3.3.5 Pre-development Runoff Coefficient

Pre-development site conditions are summarised for the site in the following Table 3-1.

Table 3-1 – Summary of Pre-Development Site Conditions

Description	Runoff Coefficient		Area (ha)
	2, 5-year	100year	
			0.060
Grass (Part 1: future footprint of building roof)	0.20	0.25	0.023
Grass (Part 2: uncontrolled remainder of the site)	0.20	0.25	0.037
Weighted Average C	0.20		

Since the quantity criteria for the site is based on controlling post-development roof drains to 2-year pre-development release rates, the pre-development site conditions have been separated into two parts. Part 1 is grass areas that will be occupied by the building roof in the future, and part 2 is the remainder of the site.



Based on the existing ground cover the pre-development runoff coefficient is 0.20.

3.3.6 Pre-development Flow Rate

The following parameters were used with the Rational Method to determine the pre-development runoff rate for a 2-year design storm:

- A time of concentration of 10 minutes
- IDF curves yielded an intensity of 76.81mm/hr for a 2-year storm.
- A runoff coefficient of 0.2.
- The part 1 site area of 0.023ha that will be occupied by the building roof in the future.

The pre-development runoff rate for the 2-year storm is:

$$2\text{-year pre-development part 1} = 2.78 \times 0.20 \times 76.81 \times 0.023 = 0.98 \text{ L/s}$$

3.3.7 Post-Development Site Conditions

For the purposes of this stormwater management design, the site has been divided into uncontrolled and controlled areas as outlined on drawing 220338-POST. The site has two controlled areas. The upper roof of the building (catchment CA1) and the lower roof of the building is the other controlled area (catchment CA2). Stormwater storage will be provided in CA1 and CA2. The CA1 roof area is 0.020ha. The CA2 roof area is 0.003ha.

In catchment CA1, run-off will be restricted by means of two WATTS Accutrol Roof Drains (with adjustable flow control. In catchment CA2, run-off will be restricted by means of one WATTS Accutrol Roof Drain (with adjustable flow control. The roof drainage from both the upper roof and lower roof will outlet to the roadside ditch on Norway Spruce Street. The internal piping or downspout configuration and sizing at the building will be determined by the mechanical engineer.

Majority of the runoff from the remaining uncontrolled areas will be conveyed to the roadside ditch on Norway Spruce Street. A marginal amount of runoff will be conveyed to the roadside ditch on Brae Crescent. The water in the ditch on Brae Crescent is conveyed to the ditch on Norway Spruce Street.

The uncontrolled area includes the driveway and parking lot south of the building. The uncontrolled area also consists of grass areas and concrete walkways surrounding the building. The following table provides a summary of the post development conditions.



Table 3-2 – Summary of Post-Development Site Conditions

Description	Runoff Coefficient (5yr)	Runoff Coefficient (100yr)	Weighted Average C (5yr)	Weighted Average C (100yr)	Catchment Area (Ha)
Controlled CA1					0.020
Upper Roof	0.90	1.00	0.90	1.00	0.020
Controlled CA2					0.003
Lower Roof	0.90	1.00	0.90	1.00	0.003
Uncontrolled					0.037
Asphalt/Concrete	0.90	1.00	0.75	0.84	0.029
Grass	0.20	0.25			0.008
Total					0.060

3.3.8 Uncontrolled Runoff

Flow from the uncontrolled area will be directed without restriction towards the roadside ditch on Norway Spruce Street.

Since the quality control criteria provided by the City of Ottawa only included criteria for the controlled roof area, detailed runoff calculations for the uncontrolled ground surfaces were not calculated.

3.3.9 Allowable Release Rate

The City of Ottawa requires that storm runoff from the roof areas be controlled to the 2-year pre-development levels (originating from the building footprint area). As determined in section 3.3.6 the pre-development runoff rate of part 1 (building roof areas) is 0.98 L/s. Therefore the maximum release rate from the combined CA1 and CA2 roof areas cannot be greater than 0.98L/s.

3.3.10 Post Development Restricted Flow and Storage

Runoff generated on the roof areas in excess of the allowable release rate will be temporarily stored on the building roofs of CA1 and CA2. The stored water will be released at a controlled rate during and following the storm event.



In order to achieve the allowable controlled area storm water release rate, storm water runoff from the upper roof (CA1) will be controlled by two roof drains fitted with one weir slot in each drain for flow control. The roof drain information for CA1 is as follows:

- Type of Drain: WATTS Large area roof drains with adjustable flow control RD-100-A1-ADJ
- Number of Drains: 2
- Number of Weirs in each drain: 1
- Weir Setting: Closed weir setting to control flows to a constant 0.32 L/s (5gpm) per weir.

The roof drains in CA1 will control all storm events up to and including 100yr event to a release of 0.63 L/s.

Stormwater runoff from the lower roof (CA2) will be controlled by one roof drain fitted with one weir slot. The roof drain information for CA2 is as follows:

- Type of Drain: WATTS Large area roof drain with adjustable flow control RD-100-A1-ADJ
- Number of Drains: 1
- Number of Weirs in each drain: 1
- Weir Setting: Closed weir setting to control flows to a constant 0.32 L/s (5gpm)

The roof drain in CA2 will control all storm events up to and including 100yr events to a release of 0.32 L/s.

The controlled roof drains are selected in order to ensure that the allowable maximum release rate for the 2-year, 5-year and 100-year storm events are not exceeded.

Runoff from the roof will be collected by a storm drain pipe specified by the mechanical engineer. The roof drainage from both the upper roof and lower roof will be directed to one storm drain outlet that will discharge the water to the roadside ditch on Norway Spruce Street.

The final roof layout will be completed once all mechanical systems are finalized in the building permit submission. Since it is unknown if there will be any HVAC equipment or access hatches added to the upper roof (CA1) it has been assumed that only 80% of the roof area is available for storage. In the lower roof portion (CA2) it has been assumed that 100% of the roof area is available for rooftop storage. Calculations for available rooftop storage are summarized in Appendix C. Roof drain specifications are provided in Appendix E.

The following tables present a summary of the controlled and uncontrolled runoff for each catchment and the required storage resulting from the restriction in flow rate.



Table 3-3 – Summary of Runoff Rates and Storage

Catchment Area ID.	Area	5 – year design Storm			100-year design Storm		
		Release Rate (L/s)	Required Storage (m ³)	Available Storage (m ³)	Release Rate (L/s)	Required Storage (m ³)	Available Storage (m ³)
CA1	0.020	0.64	3.60	9.30	0.64	8.60	9.30
CA2	0.003	0.32	0.26	2.80	0.32	0.72	2.80
Total Actual Controlled Area Release Rate							
		0.96			0.96		
Total Allowable Controlled Area Release Rate							
		0.98			0.98		

The total allowable runoff rate from the controlled area is 0.98 L/s. The total actual runoff rate from the combined roof area (during a 100 year storm event) is 0.96 L/s, which is less than the total allowable runoff rate.

Refer to Appendix A for a detailed summary of the stormwater management.

3.3.11 Rooftop Storage

The rooftop storage will be provided on the proposed building in catchments CA1 and CA2. The roof will be provided with a low slope towards the rooftop drains by means of a tapered roofing system product. The minimum slope on the roof will be 2.0%. The roof will be fitted with overflow scuppers 0.15 meters above the lowest point on the roof. Please refer to drawings 220338-UPPER ROOF and 220338-LOWER ROOF in the Appendix G.

3.4 Stormwater Flows from Offsite Areas

There is a swale that originates from the property at 125 Brae Crescent, and conveys water between the south-eastern portion of the lots at 121-125 Brae and the lot at 3 Norway Spruce Street to the roadside ditch on Norway Spruce Street. A GeoOttawa snapshot is included in appendix D showing the swale location.

The City of Ottawa provided design criteria that the stormwater flows from neighbouring properties conveyed through the south-eastern portion of the site (121 Brae) should not be obstructed.

A ditch inlet catchbasin is proposed at the south-east corner of the site at 121 Brae Crescent to capture the offsite runoff from the swale upstream of the site. The water is then conveyed



through a 375mm diameter pipe under the parking lot, and outlets to the roadside ditch on Norway Spruce.

In the GeoOttawa snapshot included in the appendix, the estimated catchment area contributing runoff to the proposed catchbasin is highlighted in red. The total catchment area is 0.36ha.

The runoff coefficients and offsite conditions are summarized in the table below.

Table 3-4 – Summary of Offsite Conditions

Description	Runoff Coefficient	Area (ha)
	100-year	
Entranceway (Uncontrolled Area)		0.363
Roof & Asphalt	1.00	0.048
Gravel	0.70	0.000
Grass	0.25	0.315
<i>Weighted Average C</i>	<i>0.35</i>	

The post-development time of concentration (tc) was taken from the City of Ottawa Sewer Design Guideline where the minimum time of concentration used is 10 minutes.

The rainfall intensity for a 100yr storm event was calculated using the same equation as shown in section 3.3.1. Using a time of concentration of 10min corresponds to a storm intensity of 178.56mm/hr for a 100yr storm event.

Using the rational method and the above calculated runoff coefficients and rainfall intensities, the runoff rate for the combined uncontrolled areas of the site is calculated as follows:

$$Q_{100\text{-offsite}} = 2.78 \times 0.35 \times 178.56 \times 0.36 = 62.5 \text{ L/sec.}$$

The runoff rate from the offsite neighbouring properties was therefore calculated to be 62.5L/s for a 100 year storm event, respectively.

The capacity of the proposed 375mm diameter storm pipe (under the parking area) was determined using manning’s equation. The manning’s equation was given by:

$$Q_{culvert} = \left(\frac{1}{n} \times R^{\frac{2}{3}} \times S^{\frac{1}{2}} \times A \right) \times 1000$$



Where:

Q is the pipe flow rate measured in **L/s**

n is the Manning roughness coefficient for a HDPE pipe.

R is the hydraulic radius (**m²/m**)

S is the culvert slope (**m/m**)

A is the cross sectional area of the culvert (**m²**)

Using a roughness coefficient of 0.013 and a slope of 0.41% for the 375mm diameter HDPE pipe the capacity was calculated to be 111 L/s m³/s.

Since the capacity of the pipe is greater than the 100yr stormwater flows directed to the pipe from the neighbouring properties, the proposed pipe size is sufficient to convey the stormwater without restriction to the roadside ditch on Norway Spruce Street.

3.5 Stormwater Quality Control

3.5.1 Quality Criteria

As previously indicated, during a pre-consultation with the City of Ottawa, the following quality control criteria were provided as follows:

- An enhanced level of treatment is to be provided for runoff from the site, corresponding to 80% total suspended solids removal.

3.5.2 Quality Control Design Rationale

The main consideration for quality control is the runoff from the parking lot on the site. Runoff from the impervious surfaces in the parking lot can accumulate pollutants such as sediment, nutrients (nitrogen and phosphorous) as well as oil, grease and heavy metals.

Treatment for the runoff being discharged from the parking lot will be provided by a treatment train approach. The treatment train consists of sedimentation within rain garden plantings followed by filtration through a sand filter located at the side of the garden. The combined area containing the plantings, as well as the area adjacent to the plantings containing the sand filter is referred to in the remainder of the report as the rain garden area.

Water from the parking lot will travel by sheet flow to a curb cut in the south west corner of the driveway. Water will be directed from the curb cut to the rain garden area. The rain garden area is sized to provide temporary detention of the entire quality control volume generated in the parking lot.



The rain garden area has been designed to outlet the quality storage volume horizontally through the sand filter into a subdrain. The perforated subdrain outlets to the roadside ditch on Norway Spruce Street.

It was assumed that runoff from roofs is considered clean water, not required to be filtered through the rain garden. The runoff from concrete walkways to the east and north of the building were also not considered in the sizing of the garden. Sources of pollution are considered minimum in the walkway areas. However, the walkways are to be surrounded by grass areas, where vegetative filtration would be provided as the stormwater enters the roadside ditch.

Design of the rain garden area was completed in conformance with the following documents:

- The Vermont Rain Garden Manual “Gardening to Absorb the Storm”
- Ministry of Environment Stormwater Management Planning and Design Manual (MOE Manual)

3.5.3 Rain Garden Vegetation, Planting Strategy and Plant Medium Depth

In part 4 of The Ministry of Environment Stormwater Management Planning and Design Manual (March 2003)(MOE Manual), it describes vegetation as a means of taking up nutrients from the stormwater, promote settling by reducing flow velocities and preventing particles from re-suspension.

The manual also maintains that the rooting system of many species of trees and shrubs effectively bind soils to establish a layer that is resistant to erosion.

Plantings will be receiving runoff from the parking lot. Plant selection is important when choosing vegetation that can tolerate both wet and dry conditions, as well as salt tolerance when in close proximity to the parking lot and public roadway. The plantings should be a mixture of bushes, perennials and grasses.

It is also recommended that sand be used instead of salt when completing snow removal in the parking lot, to reduce the amount of salt concentrations that will enter the gardens.

Part 4 of the MOE Manual indicates that common plant spacing is 0.75m to 1.5m. Planting rows should be perpendicular to the direction of water flow and staggered to minimize the potential for channelization.



The growing medium depth for the rain garden was calculated using the Vermont Rain Garden Manual table. Table 1 of the rain garden manual shows various depths of rain gardens depending on the slope of the landscape.

Table 1	
Slope	Depth
< 4%	3-5 in
5-7%	6-7 in
8-12%	8 in+

The location for the rain garden has a slope of less than 4%. Therefore using table 1 of the Vermont Rain Garden Manual shows the minimum depth as 75mm. A minimum growing medium depth of 100mm was used for the proposed bottom of the rain garden.

3.5.4 Quality Control Through Sand Filters

The MOE Manual provides guidance on design for stormwater quality control. Quality control design is completed with the fundamental understanding that the majority of sediment and particulate pollutants are washed from the site surfaces during minor (frequent) storm events. Section 3.3.1 of the MOE Manual indicates that in most cases, quality control design storms range from 12.5 mm to 25 mm. The MOE Manual also indicates that an alternate approach to the volumetric sizing of stormwater facilities for quality control has been applied in Ontario. The alternate approach is summarized in Table 3.2 *Water Quality Storage Requirements Based on Receiving Waters*. Table 3.2 of the MOE manual specifies the storage volume required to achieve an enhanced minimum required quality control level of treatment using filtration.

In Part 4, the MOE Manual details the design requirements of several types of end of pipe stormwater management facilities. The proposed stormwater management design for quality control will consist of filtration. Design guidance for filtration is provided in Part 4 Section 4.6.7 Filters of the MOE Manual.

Section 4.6.7 provides the design guidance with respect to the use of a filter as summarized in the table below. A column has been added to indicate how the proposed design conforms to the Criteria.



Table 3-5 MOE Design Guidance and Design Conformance

Design Element	Design Objective	Minimum Criteria	Design Conformance
Drainage Area		< 5 hectares	~ 0.02 hectares
Pre-treatment	Longevity	Pre-treatment by means of sedimentation chamber, or forebay, vegetated filter strip, swale or oil/grit separator	Vegetative filtration in rain garden storage area.
Storage Depth	Avoid Filter Compaction	Subsurface sand and organic filters: 0.5 m Maximum 1.0 m	Maximum storage depth of swale 0.5m.
Filter Media Depth	Filtering	Sand: 0.5 m	sand: 0.5m
Under-drain	Discharge	Minimum 100 mm perforated pipes bedded in 150 – 300 mm of 50 mm gravel	Horizontal discharge to 150mm diameter perforated pipe surrounded in minimum 150mm thickness of 50 mm clear stone.
Land use		any land use, often employed for commercial and industrial	Residential
Volumetric Sizing		provided in Table 3.2 under infiltration. By-pass flows should not occur below a 4 hr 15 mm design event	Quality storage volume sufficient to contain entire volume of a 4h 15 mm storm event before by-pass
Filter Size		Determined using the Darcy Equation	Determined using the Darcy Equation
Filter Lining	prevent clogging	liner to prevent native material from entering filter	Non-woven geotextile filter cloth used between native material/planting medium and sandfilter. Filter cloth also between filter and clearstone
Overflow / by-pass		required	overflow is provided above the quality storage requirement

3.5.5 Volumetric Sizing

The water quality storage volume requirement to achieve an enhanced level of treatment using the sand filter was determined from the MOE Manual Table 3.2 under infiltration. Please refer to the table below showing the percentage of impervious area for the parking lot as well as the required storage volume extrapolated from Table 3.2.



Table 3-6 Volumetric Sizing Parameters from MOE Manual Table 3.2

Drainage Area (ha)	% impervious	Storage Volume m ³ /ha	Storage Volume Required (quality) m ³
0.02	85	40	0.80

From the table above, quality control drainage area is 0.02 ha. The drainage area is a combination of the parking lot area and the footprint of the rain garden. 0.020 ha x 40 m³/ha gives a quality storage requirement of 0.80m³.

The MOE Manual in section 4.6.7 under the heading Volumetric Sizing provides the following additional design guidance when using filtration for quality control:

"Water quality volumes to be used in the design are provided in Table 3.2 under the "infiltration" heading. Erosion and quantity control volumes are not applicable to this type of SWMP. The design should be such that at a minimum, the by-pass of flows should not occur below or at the peak runoff from a 4 hour 15 mm design event."

In order to ensure that by-pass would not occur below a 4 hr 15 mm design event, the storm pond is designed to accommodate the volume of a 15 mm rainfall originating from the parking lot and rain garden area. The weighted average runoff coefficient for quality control drainage area of the site is C = 0.85. This indicates that 85% of the rainfall originating on the drainage area will runoff into the quality storage pond.

A 15mm storm event will result in a runoff volume of (0.02ha x 0.85 x15mm) 2.6m³ for the quality control drainage area. This results in a minimum quality storage requirement of 2.6m³ There is a total storage volume for quality control purposes of 3.3m³ in the rain garden area before discharge by means of the overflow channel will occur.

The sizing considerations for the rain garden area are summarized in the following table 3-7.



Table 3-7 Rain Garden Area Sizing Comparison for Quality Control

MOE Table 3.2 Storage Volume Required	15mm rainfall x catchment area x runoff coefficient= Volume Required prior to by-pass	Actual Storm Pond Volume to be Provided
m ³	m ³	m ³
0.8	2.6	3.3

Since the storm pond volume to be provided is greater than or equal to the MOE sizing requirements it is considered that the storm pond is of sufficient size to satisfy the quality treatment requirements.

3.5.5.1 Sand Filter Sizing

The MOE Manual indicates that the size of the filter be designed to ensure a specified volume is discharged within a specified time period using the Darcy Equation. The size of the filter and storage volume must be sufficient to ensure that no overflow or by-pass occurs below the 4 hr 15 mm design storm.

The proposed filter has been sized based on the space available for the filter. The proposed filter will be a horizontal sand filter and will be constructed with a minimum filter thickness (width) of 0.5m and a length of 4.4m.

The sand used to construct the filter will consist of imported filter media sand having a percolation rate “T” time of 6 min/cm and a maximum of 3 percent passing the 0.08 millimetre sieve size. This corresponds to a coefficient of permeability of k = 3600 millimetres per hour. The sand will be placed as shown on Kollaard Associates Inc. drawing #220338–GR and 220338-Details will have a minimum filter thickness of 0.5metres. The filter will be protected on the surface by a 100 mm thick layer of riverstone. A non-woven geotextile filter fabric (such as Terrafix 360R or an approved alternative) will be placed between the sand and the top layer of riverstone. The filter fabric will also be extended beneath and beside the filter to prevent contamination of the filter sand from the underlying native material. This fabric offers medium tensile strength at high elongation and good filtration, coupled with high permeability to allow for proper filtration, while holding the filter sand in place as designed. The Terrafix Geosynthetics Inc. specification sheet can be found in Appendix E.



The height of the sand filters was determined based on the quality storage volume requirement and the capacity of the rain garden area. The filter height was set to ensure that the minimum volume equal to the quality requirement would discharge through the sand filter.

As such the entire quality control volume required by the MOE Manual will be stored below the top of the sand filter and no by-pass or overtopping of the filter will occur below the 15mm storm event.

3.5.5.2 Discharge Through Filters

The average flow rate through the sand filters was calculated using Darcy's Equation to be:

$$Q = A K i$$

A = the cross sectional area of the filter

K = coefficient of permeability

i = hydraulic gradient = head across the filter / flow path across the filter

$$A = 0.3\text{m (depth)} \times 4.5\text{m (sand filter length)}$$

$$K = 1 \times 10^{-3} \text{m/s}$$

$$i = 0.45 / 0.9$$

$$Q_{\text{rain-garden}} = 0.7 \text{L/s}$$

Based on the discharge rates through the filter, it is expected that the draw down time in the rain garden is 3 hours.

3.6 Stormwater System Operation and Maintenance

3.6.1 Roof Drains

The accontrol roof drains should be inspected on a semi-annual basis and following major storm events. Any blockages or debris should be removed. If surface ponding on the roof areas area does not recede in a normal manner, the drains should be inspected for blockages.

3.6.2 Rain Garden Maintenance

Once plants mature, the maintenance of a rain garden is very low. Rain Garden maintenance information is provided below from the Rain Garden Manual for the Vermont and Lake Champlain Basin.



Inspect the rain garden after large storm events and at least monthly for improper water drainage, berm settling, soil erosion, as well as invasive plants.

Always water plants throughout the first year after planting until they are established. Species should be able to tolerate dry conditions on their own afterward. However, if plants become distressed additional hand watering may be required.

Cut away excessive dead plant material from living plants and for species that have died or may need replacement if they are not thriving. Shrubs and trees may need occasional pruning depending on desired aesthetics. Some plants may need to be divided if plantings become too crowded.

Remove weeds by hand pulling. Make sure to remove the entire root. Remove weeds before they flower or go to seed to prevent weeds from seeding themselves. After removal of extensive areas of weeds, consider adding vegetation or wood chips to prevent new weeds from establishing. Always bag and remove any invasive plants. Do not compost them on-site.

To prevent soil erosion, stabilize settled berms (with stone, quick-rooting species, or ground covers) and replace eroded soils. If the garden is holding water for more than 72 hours, soil compaction may have occurred. Resolve this problem through physical or vegetative methods such as deep tilling, soil amendment, or establishing deep rooted plant species.

The surface of the rain garden is to be covered with an erosion control blanket (such as a coconut rolled erosion control product) to protect the planting medium until vegetation is established. The erosion control blanket is suggested only in the first few years after the initial installation. Once the rain garden is established, the erosion control blanket may not be necessary.

3.6.3 Inspections

The owner or designated Property Management Company is responsible for inspections and maintenance. Records of inspections and maintenance should be kept for each visit. The suggested inspection schedule should be followed until the records indicate a more appropriate site specific schedule.

4 SANITARY SEWER DESIGN

The sanitary service lateral from the proposed development will be connected to the existing 250 mm diameter sanitary sewer along Norway Spruce Street.



Sewage discharges will be domestic in type and in compliance with the City of Ottawa Sewer Use By-law. The anticipated peak sanitary flow will be a total of approximately 0.18 L/s.

4.1 Design Flows

The proposed building will contain five residential units. The residential design flows were calculated using the Ottawa Sewer Guidelines – Technical Bulletin ISTB-2018-01.

Residential

Total domestic pop:

<i>One Bedroom units</i>	<i>(0) x 1.4 ppu:</i>	<i>0</i>
<i>Two Bedroom units</i>	<i>(3) x 2.1 ppu:</i>	<i>6.3</i>
<i>Three Bedroom units</i>	<i>(2) x 3.1 ppu:</i>	<i><u>6.2</u></i>

Total: 12.5

12.5 rounded to 13

$$Q_{\text{Domestic}} = 13 \times 280 \text{ L/person/day} \times (1/86,400 \text{ sec/day}) = 0.042 \text{ L/sec}$$

$$\text{Peaking Factor} = 1 + \left(\frac{14}{4 + \left(\frac{P}{1000} \right)^{0.5}} \right) * 0.8 = 3.72(4 \text{ maximum})$$

$$Q_{\text{Peak Domestic}} = 0.042 \text{ L/sec} \times 3.72 = 0.156 \text{ L/sec}$$

Infiltration

$$Q_{\text{Infiltration}} = 0.33 \text{ L/ha/sec} \times 0.06 \text{ ha} = 0.020 \text{ L/sec}$$

$$\text{Total Peak Sanitary Flow} = 0.156 + 0.020 = 0.18 \text{ L/sec}$$

4.2 Sanitary Service Lateral

4.2.1 Sanitary Service Lateral Requirements

The maximum peak sanitary flow for total residential use of the building is 0.18L/sec. The Ontario Building Code specifies minimum pipe size and maximum hydraulic loading for sanitary sewer pipe. OBC 7.4.10.8 (2) states "Horizontal sanitary drainage pipe shall be designed to carry no more than 65% of its full capacity." The capacity of the proposed 150 mm diameter



PVC sanitary sewer lateral at a 1% slope is 15.23/sec. Since $0.65 \times 15.23 = 9.90$ L/s is much greater than 0.18L/sec, a single sanitary sewer service lateral of 150 mm diameter at a 1% slope will be sufficient according to O.B.C 7.4.10.8 (2). It is noted that the actual slope varies to 12% which provides a much greater capacity. At 12% the flow velocity in the 150mm diameter sanitary service at full flow condition would be 2.98m/s. At the peak design flow the actual velocity would be 0.7m/s. Since the full flow and peak flow velocities are both less than 3.0m/s the velocity is within an acceptable range.

Alternatively Kollaard Associates has obtained the number of fixtures from floor plan drawings provided by Bryden Gibson Architects (2023/02/02).

From the Ontario Building Code (O.B.C) table 7.4.9.3, the total number of fixture units for the building is 92.5.

From OBC Table 7.4.10.8, the allowable number of fixture units for a 5" drain size (150mm diameter) sanitary service pipe at 1% is 600. Since the proposed number of fixture units is less than 600, than the proposed 150mm diameter service lateral would have adequate capacity.

The proposed 150mm diameter sanitary lateral is greater than 50% of the diameter of the main sewer diameter on Norway Spruce Street. The sanitary main is of asbestos concrete material. A manhole has been proposed at the connection of the lateral to the main, as per section 4.4.4.11 of the Ottawa Sewer Guidelines.

Extra care should be taken when installing the new lateral connection to the asbestos cement sanitary main. Cutting of the main pipe shall be in accordance with the Ontario Health and Safety Act (OSHA). Personal protective equipment and cleanup shall be in accordance with the OSHA.

If it is found that the existing lateral still goes into the site, it is to be abandoned and capped at the property line. The new lateral is to be installed at the location indicated on the Site Servicing drawing 220338 – SER.

5 WATERMAIN DESIGN

It is considered likely that the existing water service lateral and connections are undersized for a multi unit dwelling. The existing water lateral is to be blanked at the watermain to the satisfaction of City of Ottawa Services. The new lateral is to be installed at the location indicated on the Site Servicing drawing 220338 – SER.



The proposed 38mm (1.5 inch) diameter water service is to be used for the proposed building. The service lateral will be connected to the municipal watermain on Norway Spruce Street as indicated on the Site Servicing drawing 220338- SER.

5.1 Water Demand

The water demand for the proposed development was calculated based on the City of Ottawa Water Distribution Design Guidelines (as amended) as follows:

Residential

13persons x 280 L/person/day x (1/86,400 sec/day)

- Average daily demand 0.042 L/s
- Maximum daily demand (factor of 2.5) is $0.042\text{L/s} \times 2.5 = 0.105\text{ L/s}$
- Peak hourly demand (factor of 2.2) = $0.105\text{ L/s} \times 2.2 = 0.232\text{L/s}$

5.2 Fire Flow

Fire flow protection requirements are calculated as per the Ontario Building Code. The building is of combustible construction. The building does not contain sprinklers. Calculations of the fire flow required for the building are provided in Appendix F.

From Appendix D, the minimum fire flow requirement is 2700 L/min or 45 L/sec.

The fire protection will be provided by the existing hydrant on Norway Spruce, as described in section 5.3 below.

5.3 Existing Fire Hydrant

The fire hydrant within the vicinity of the site is located as follows: Norway Spruce directly in front of the property on the east side of the road (5 Norway Spruce Street) and 60m south of the site.

City of Ottawa Technical Bulletin ISTB-2018-02 Appendix I Table 1 provides guidance with respect to maximum flow from to be considered from a given hydrant. From this table, a Class AA hydrant can contribute a maximum flow of 5,700 L/min when located less than 75 metres from the building.



As previously indicated, the required fire flow is 2700L/min. The existing hydrants is considered to be sufficient to meet the required fire flow without needing an additional hydrant.

5.4 Boundary Conditions

The water demand due to occupancy together with the fire flow requirements were provided to the City of Ottawa as follows:

- Average daily water demand 0.05L/s
- Maximum daily water demand 0.13 L/s
- Peak hourly water demand 0.29L/s
- Fire Flow required 45L/s

The following are the boundary conditions, HGL, for hydraulic analysis that were provided for the above indicated peak hourly demand and fire flow demand.

Maximum HGL = 160.2

Minimum HGL = 155.6

Max Day + FireFlow = 155.4m

The boundary conditions were received for a connection on Brae Crescent at a ground surface elevation of 122.60. The City of Ottawa has confirmed that the boundary conditions are still valid for a proposed connection on Norway Spruce Street.

The water demand submitted for boundary conditions used a consumption rate of 350L/capita/day. As per the City of Ottawa Guidelines technical bulletin ISTB-2021, the consumption rate has been decreased to 280L/capita/day. The average daily water demand decreased by 0.06 L/s. It is expected that this minor decrease will have negligible impact on the minimum HGL.

The pressure loss to the third floor of the proposed building was calculated using Bernoulli's Equation in Combination with the Darcy – Weisbach Equation and the Colebrook Equation. The equations are shown below.

$$H_P + Z_1 - Z_2 + \frac{P_1 - P_2}{\rho g} + \frac{V_1^2 - V_2^2}{2g} = h_f + h_m \quad \text{where:}$$

$$h_m = K_m \frac{V^2}{2g} \quad Re = \frac{VD}{\nu} \quad Q = VA \quad A = \frac{\pi}{4} D^2$$

$$\text{Darcy - Weisbach Equation: } h_f = f \frac{L}{D} \frac{V^2}{2g} \quad \text{where:}$$

$$\text{If laminar flow } \left(Re < 4000 \text{ and any } \frac{e}{D} \right), \quad f = \frac{64}{Re}$$

$$\text{If turbulent flow } \left(4000 \leq Re \leq 10^8 \text{ and } 0 \leq \frac{e}{D} < 0.05 \right), \text{ then}$$

$$\text{Colebrook Equation: } \frac{1}{\sqrt{f}} = -2.0 \log \left(\frac{e/D}{3.7} + \frac{251}{Re \sqrt{f}} \right)$$



Table 5.0: Water Flow Analysis with a Maximum Hourly Design Flow

Scenario	Elevation (m)		HGL (m)		Pressure (KPa)		Flow (L/s)	Service Dia (mm)
Connection to existing 150mm watermain								
	Street	Basement	Street	Basement	Street	Basement		
Min HGL	122.10	124.5	155.60	155.56	328	304	0.29	38
Max HGL	122.10	124.5	160.20	160.13	373	349	0.29	38
	Street	3 rd floor	Street	3 rd floor	Street	3 rd floor		
Min HGL	122.10	133.22	155.60	155.51	328	219	0.29	38
Max HGL	122.10	133.22	160.20	160.09	373	263	0.29	38
	Street	Basement	Street	Basement	Street	Basement		
HGL Fire	122.10	123.00	155.4	155.36	326	317	0.29	38

*Assuming that the highest fixtures on each floor were 2.2m from the floor slab.

**Ground elevation is at 122.10.

In accordance with MOE Design Guidelines for Drinking Water Systems, the distribution system shall be sized so that under maximum hourly demand conditions the pressures are not less than 276 kPa (40 psi.)

In general conformance with the MOE Guidelines, and City of Ottawa Technical Bulletin ISD-2010-2, the desired range in pressure should be approximately 350KPa (50psi) to 480KPa (70psi) during normal operating conditions. As per the Ontario Building Code, the residual pressure should not exceed 552KPa (80psi).

Based on the results of the analysis as presented in the above table and using a 40mm diameter service, the minimum and maximum HGL provide a water pressure of between 305kPa and 349kPa at the basement of the proposed building.

The minimum and maximum HGL provide a water pressure of between 219kPa and 263kPa at the 3rd floor of the proposed building. The calculated residual pressure is below the minimum recommended residual pressure by the MOE of 275 kPa, and well below the desired pressure of 350KPa. The loss of pressure due to the elevation difference is of much more significance than the friction and minor losses.



Since the pressure on the first floor and third floor is less than 350 kPa, a booster pump would be required to provide adequate pressure in the building at all floors. The booster pump size is to be specified by the mechanical engineer.

The minimum pressure at the proposed building was verified for the maximum hourly demand using the HGL provided for the combined fire flow and maximum day to confirm that the minimum pressure is greater than 276 kPa

5.5 Water Service Requirements

Based on the proposed occupancy through the City of Ottawa Water Distribution Design Guidelines (as amended) and the Ontario Building Code requirements with respect to water service size based on number of fixture units served, a minimum water service size of 38mm is required.

6 EROSION AND SEDIMENT CONTROL

The owner (and/or contractor) agrees to prepare and implement an erosion and sediment control plan at least equal to the stated minimum requirements and to the satisfaction of the the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current best management practices for erosion and sediment control. It is considered to be the owners and/or contractors responsibility to ensure that the erosion control measures are implemented and maintained.

In order to limit the amount of sediment carried in stormwater runoff from the site during construction, it is recommended to install a silt fence along the property, as shown in Kollaard Associates Inc. Drawing #220338 - GEC. The silt fence may be polypropylene, nylon, and polyester or ethylene yarn.

If a standard filter fabric is used, it must be backed by a wire fence supported on posts not over 2.0 m apart. Extra strength filter fabric may be used without a wire fence backing if posts are not over 1.0 m apart. Fabric joints should be lapped at least 150 mm (6") and stapled. The bottom edge of the filter fabric should be anchored in a 300 mm (1 ft) deep trench, to prevent flow under the fence. Sections of fence should be cleaned, if blocked with sediment and replaced if torn.

The surface of the rain garden is to be covered with an erosion control blanket (such as a coconut rolled erosion control product) to protect the planting medium until vegetation is established. The coconut rolled erosion control product literature is provided in appendix E.



Many gardens use a top layer of wood chips or mulch on the surface, however these items can float if plants become submerged during an intense rainstorm. The erosion control blanket is to be staked or stapled to the ground surface to keep in place.

Filter socks should be installed across existing storm manhole and catch basin lids. As well, filter socks should be installed across the proposed catch basin and manhole lids immediately after the structures are placed. The filter socks should only be removed once the asphaltic concrete is installed and the site is cleaned.

The proposed landscaping works should be completed as soon as possible. The proposed granular and asphaltic concrete surfaced areas should be surfaced as soon as possible.

The silt fences should only be removed once the site is stabilized and landscaping is completed.

These measures will reduce the amount of sediment carried from the site during storm events that may occur during construction.

7 CONCLUSIONS

This report addresses the adequacy of the existing municipal storm and sanitary sewer system and watermain to service the proposed development of the residential building on Brae Crescent. Based on the analysis provided in this report, the conclusions are as follows:

SWM for the proposed development will be achieved by controlling the 100 year post development flow from the roof areas to 2-year pre-development levels.

The peak sewage flow rate from the proposed development will be 0.18 L/sec. The existing municipal sanitary sewer on Norway Spruce Street should have adequate capacity to accommodate the increase in peak flow. The City has not identified any capacity issues in the existing sanitary sewer system.

The existing municipal watermain along Norway Spruce Street will have adequate capacity to service the proposed development for both domestic and fire protection.


During all construction activities, erosion and sedimentation shall be controlled.



We trust that this report provides sufficient information for your present purposes. If you have any questions concerning this report or if we can be of any further assistance to you on this project, please do not hesitate to contact our office.

Sincerely,
Kollaard Associates, Inc.

Amanda Van Bruggen, E.I.T

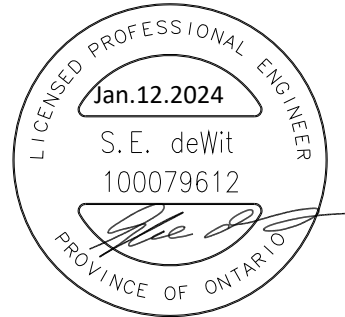

Steven deWit, P.Eng.






Appendix A: Background Information

- City of Ottawa Drawing – GO-244 Plan & Profile 25
- Topographic Plan of Survey – Part of Lot 1, Registered Plan 528
- City of Ottawa Correspondence


METRIC

All Dimensions Are In Millimetres And/Or Metres Unless Shown Otherwise.
All Underground Utilities Are Approximate. Contractor Is Required To Notify The Utility Before Excavating.

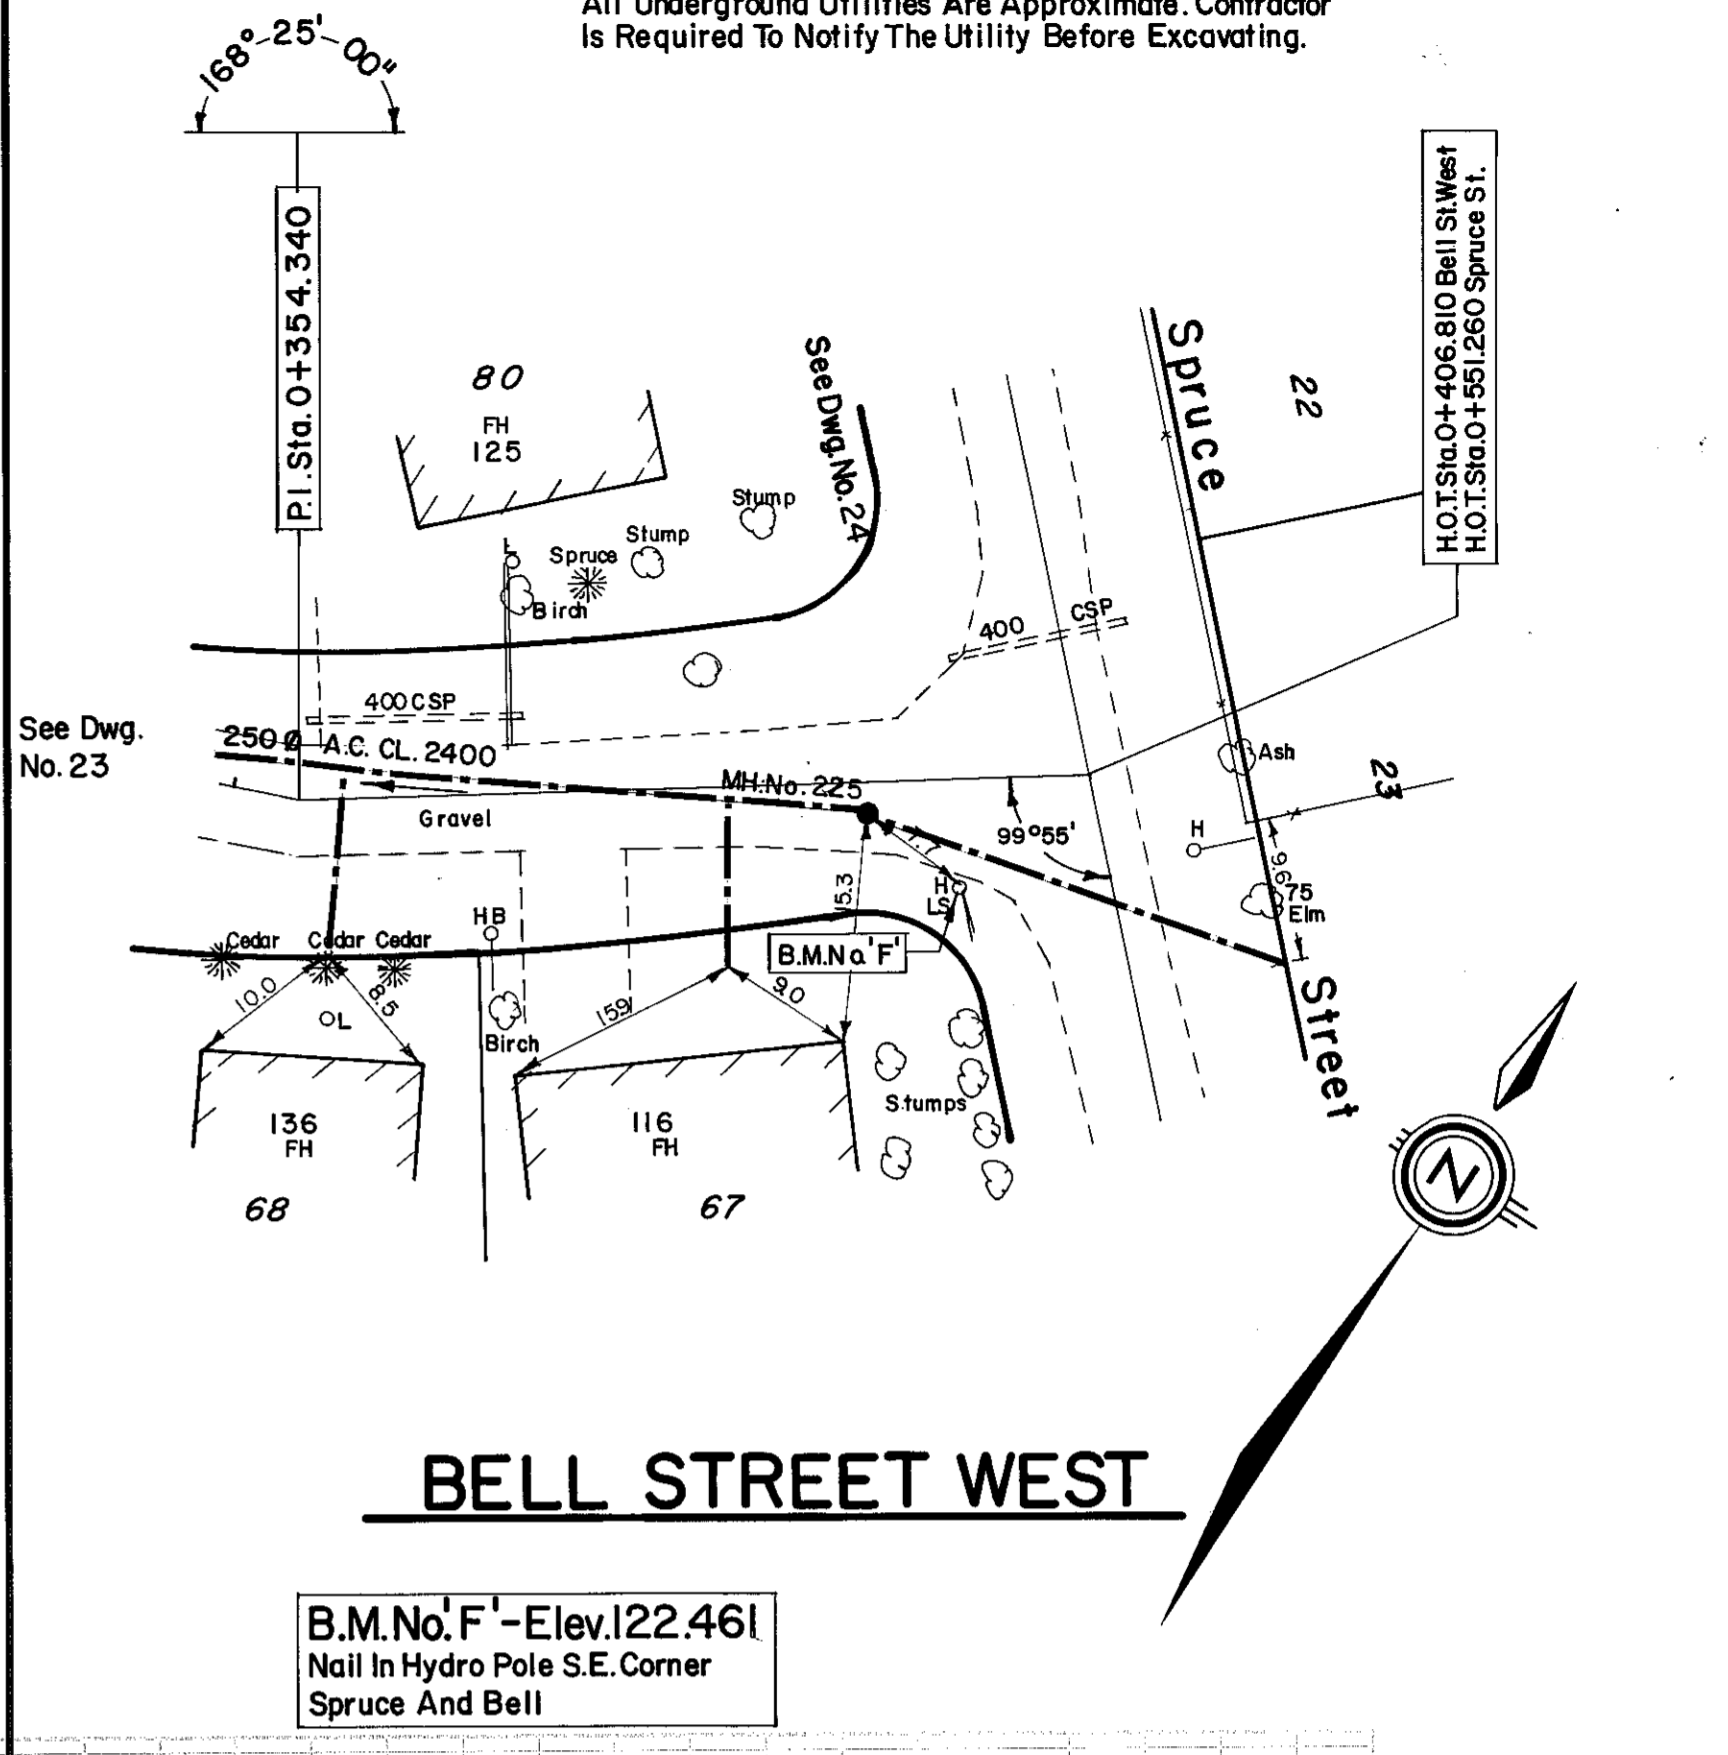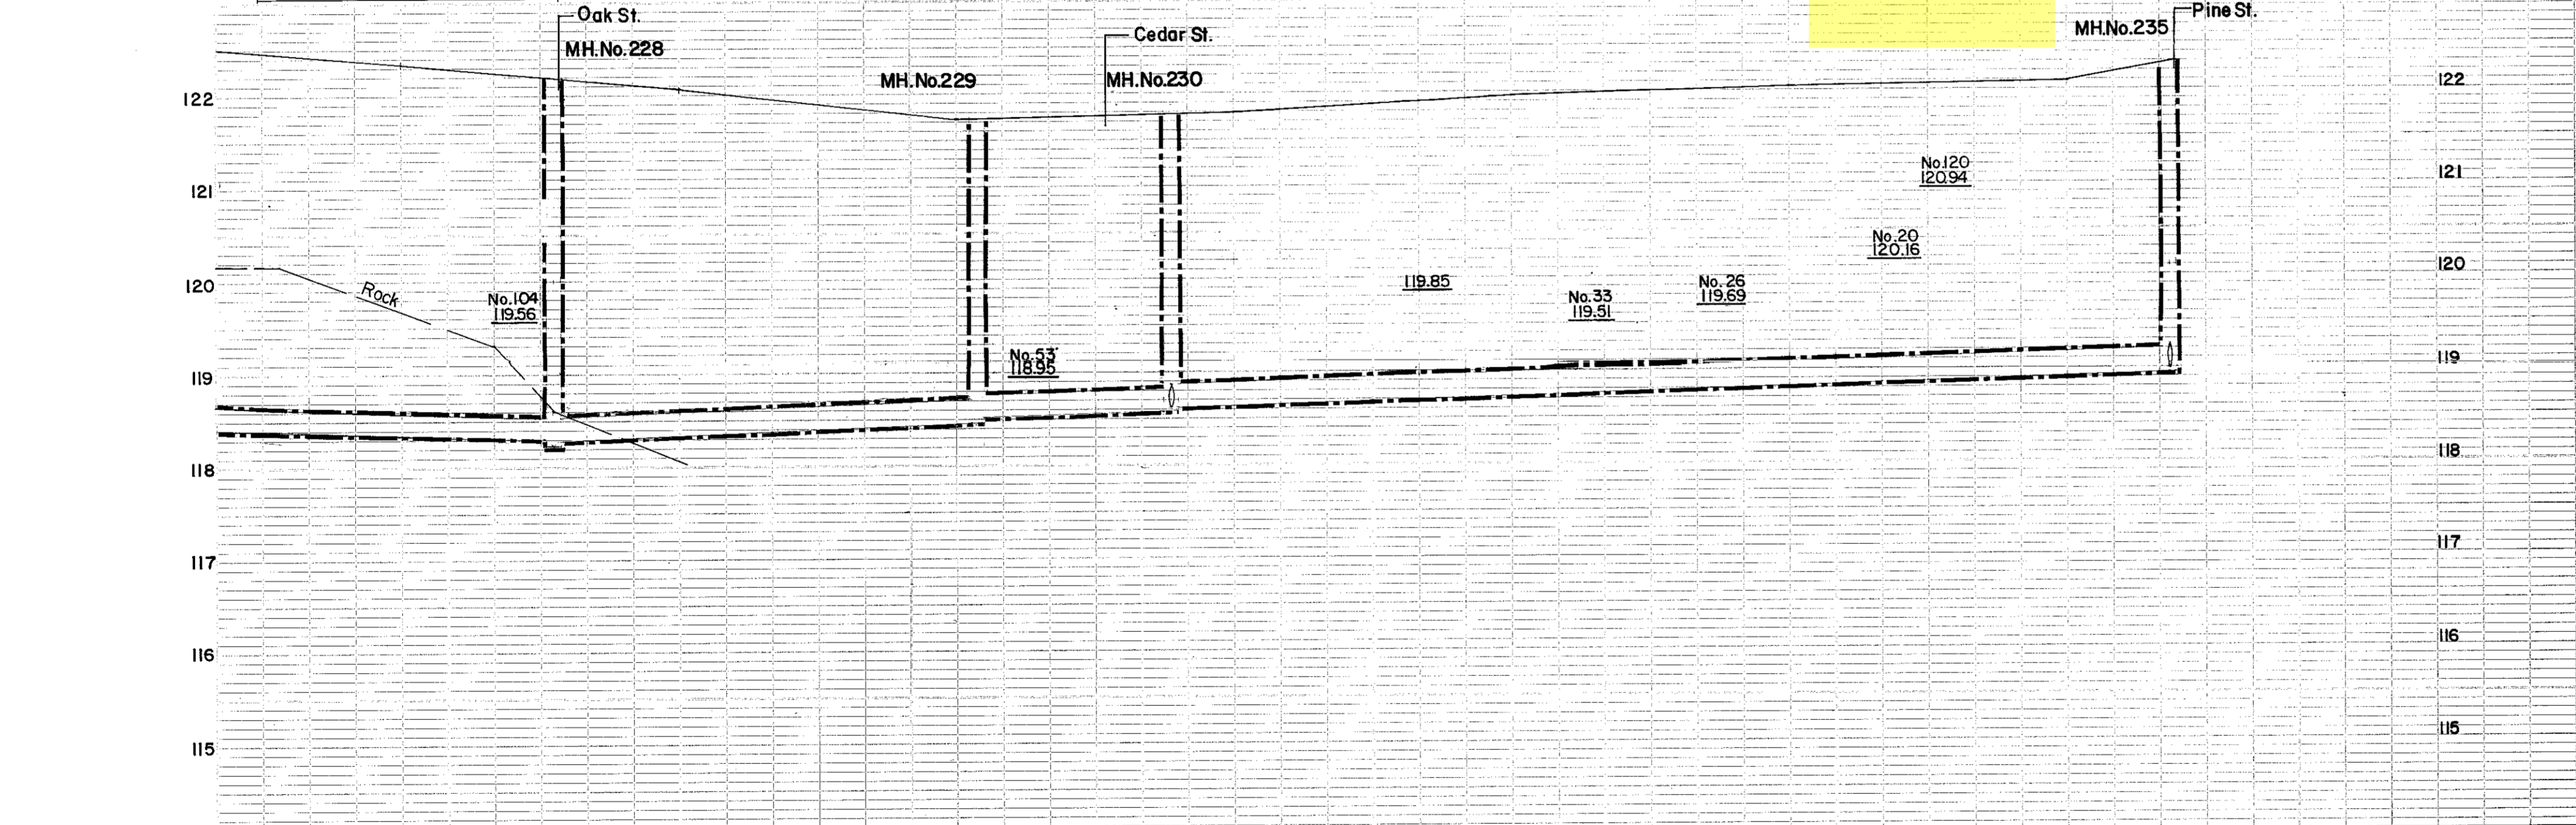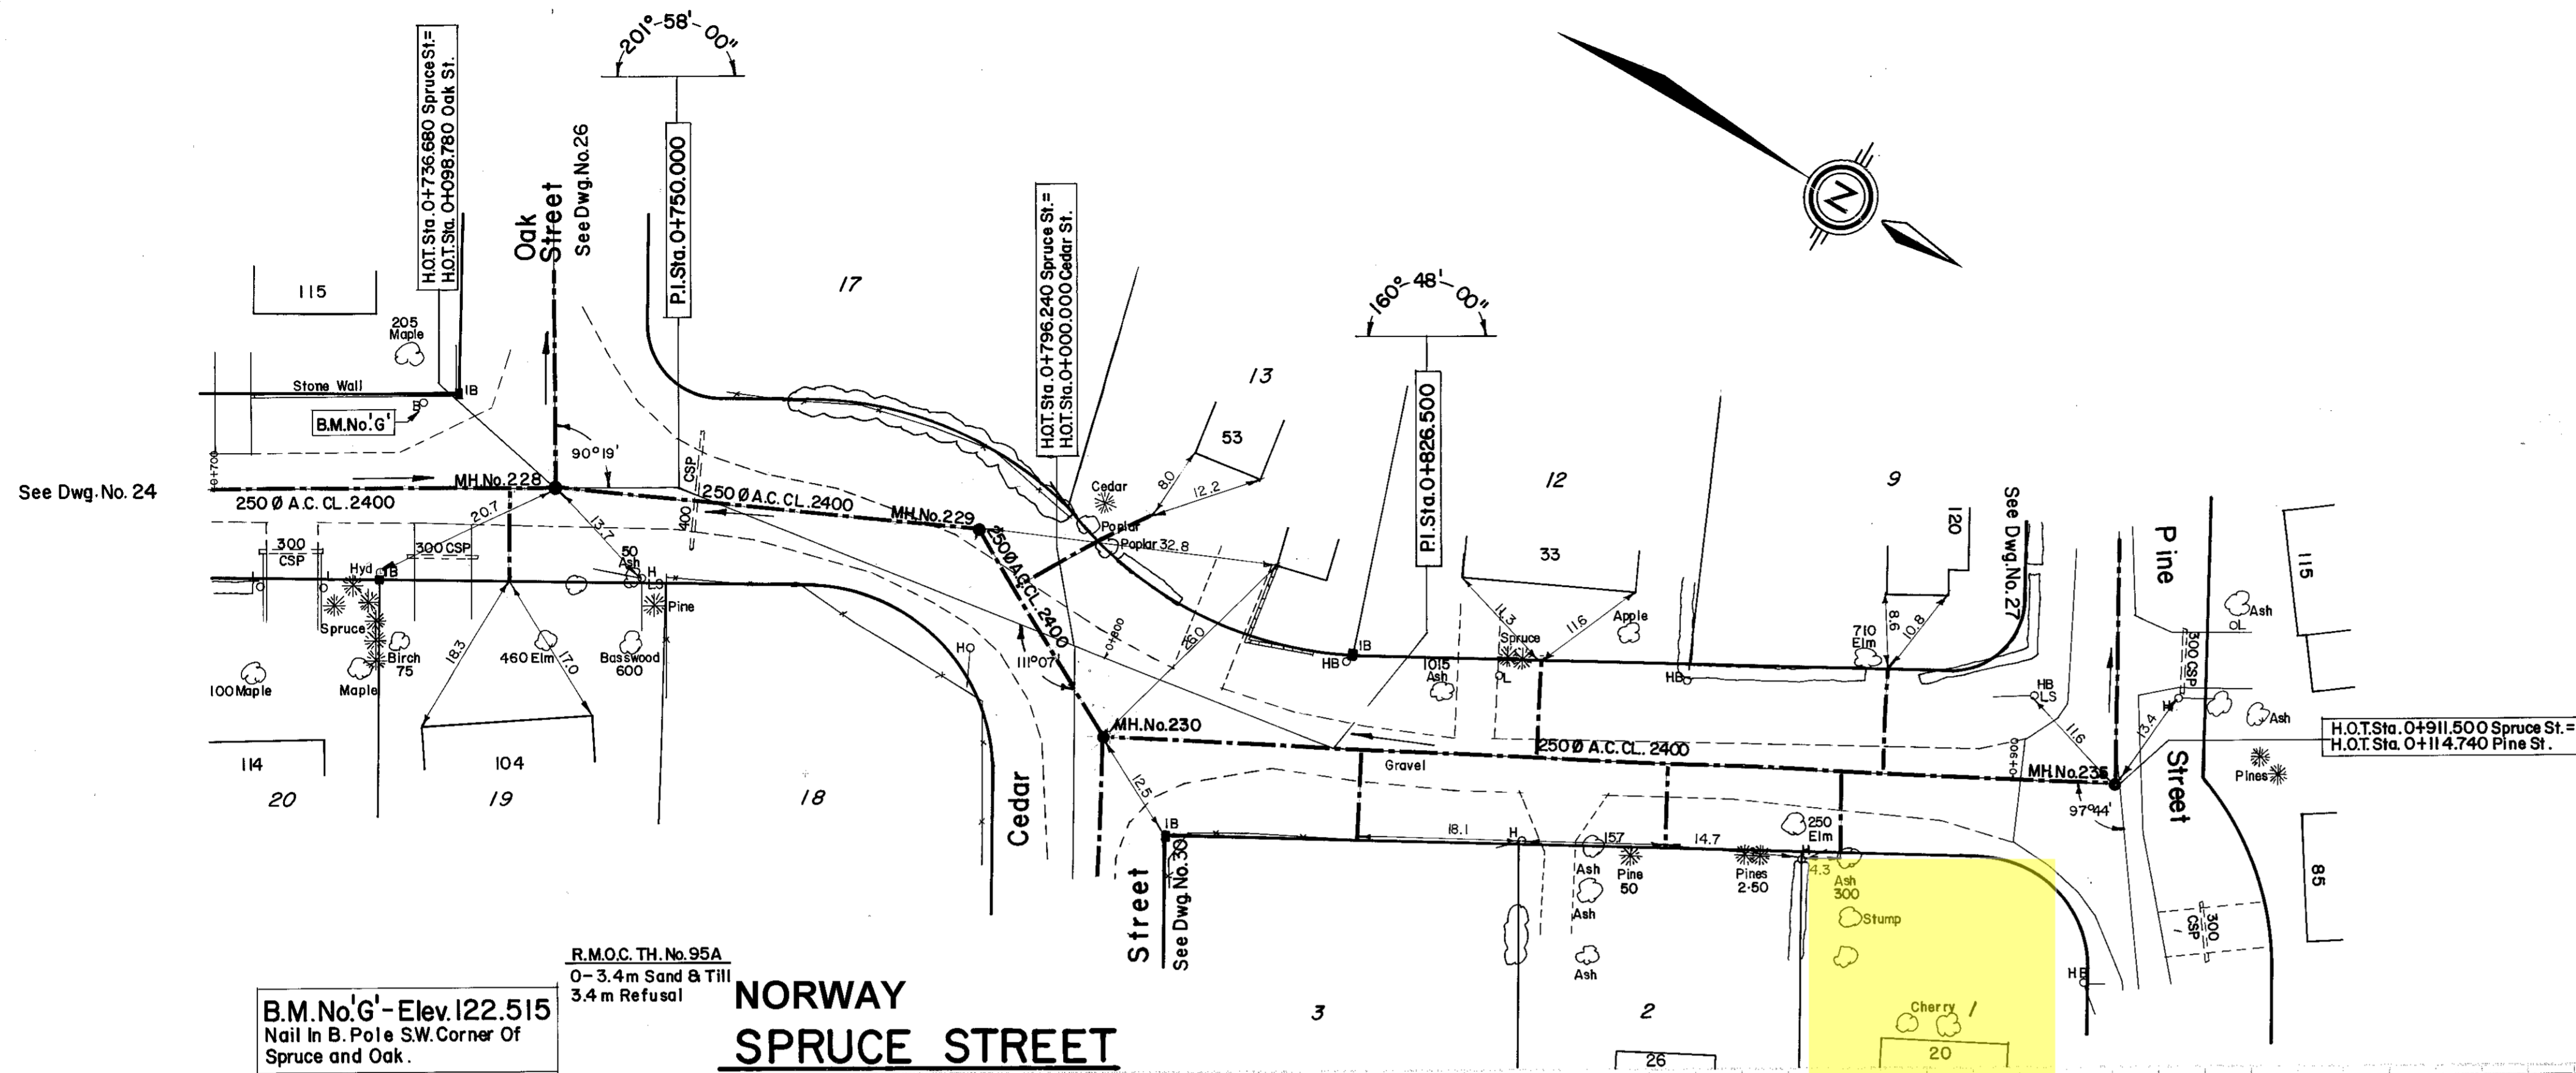


AS BUILT

EXISTING GRADE	122.360	122.080	121.750	121.800	121.970	122.050	122.100	122.300	122.780	122.810	122.060	EXISTING GRADE	
WATER MAIN TOP OF PIPE ELEVATION												WATER MAIN TOP OF PIPE ELEVATION	
SANITARY SEWER INVERT ELEVATION	250Ø x 77.5 @ 0.36%	250Ø x 45.7 @ 0.44%	250Ø x 27.3 @ 0.33%		250Ø x 110.5 @ 0.31%				250Ø x 67.0 @ 0.78%			SANITARY SEWER INVERT ELEVATION	
STORM SEWER INVERT ELEVATION												STORM SEWER INVERT ELEVATION	
CHAINAGE	0+700	0+725	0+750	0+775	0+800	0+825	0+850	0+875	0+900	0+350	0+375	0+400	CHAINAGE

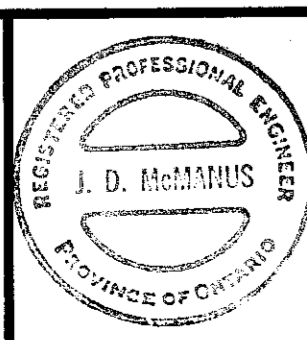

No.	BY	DATE	REVISION
8	EC	30/4/81	AS BUILT
7	D.M.	23/4/80	GENERAL REVISION
6	D.M.	12/2/80	MH229 RELOCATED, INVERTS REVISED

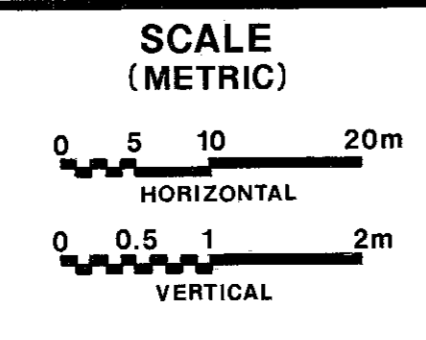

DESIGN	CHKD
D.M.	M.J.H.
DRAWN	CHKD
E.C.	D.M.
APPROVED	
W.P. No.	949

KOSTUCH ENGINEERING LIMITED
CONSULTING ENGINEERS
BROCKVILLE · OTTAWA · BELLEVILLE · CORNWALL


Ministry Of The Environment
Sewage Works Project No. 1-0127
Township Of Goulbourn
Stittsville Sanitary Sewers

SPRUCE STREET
STA. 0+700 to STA. 0+912
BELL STREET WEST
STA. 0+350 to STA. 0+407

DATE DRAWN	JULY 10, 1979
CONT. No.	3
DRAWING No.	25
REV. No.	8

PART OF LOT 1 REGISTERED PLAN 528 CITY OF OTTAWA

Surveyed by Annis, O'Sullivan, Vollebakk Ltd.

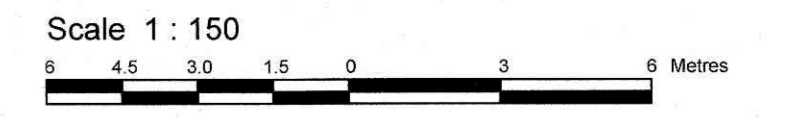


Metric DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048

Surveyor's Certificate

- I CERTIFY THAT: 1. This survey and plan are correct and in accordance with the Surveys Act and the Surveyors Act and the regulations made under them. 2. The survey was completed on the 30th day of March, 2022.

Date: 25/03/22 V. Andrew Shield, Ontario Land Surveyor.

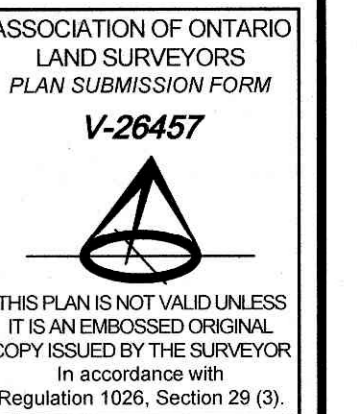

ANNIS, O'SULLIVAN, VOLLEBEKK LTD. grants to Natalie Taite (The Client), their solicitors, mortgages, and other related parties, permission to use original, signed, sealed copies of the Surveyor's Real Property Report in transactions involving The Client.

Notes & Legend


Table with 2 columns: Denotes and Survey Monument Planted. Includes symbols for SIB, SSIB, IB, IB#, (WIT), Meas., Acc., NT, (AOG), (P), (P1), (P2), (P3), (P4), C/L, T/G, T/P, CSP, MH-ST, MH-S, VC, WV, FH, GM, AN, UP, OHW, W, G, Deciduous Tree, Coniferous Tree, Diameter, and Location of Elevations.

Bearings are grid, derived from Can-Net 2016 Real Time Network GPS observations, MTM Zone 9 (76°30' West Longitude) NAD-83 (original).

For comparison purposes, a rotation of 0°23'20" counter-clockwise was applied to (P), (P1), (P2) and (P4).

UTILITY NOTES

- 1. This drawing cannot be accepted as acknowledging all of the utilities and it will be the responsibility of the user to contact the respective utility authorities for confirmation. 2. Only visible surface utilities were located. 3. Location of underground utilities illustrated of the plan are as marked by others. 4. A field location of underground plant by the pertinent utility authority is mandatory before any work involving breaking ground, probing, excavating etc.

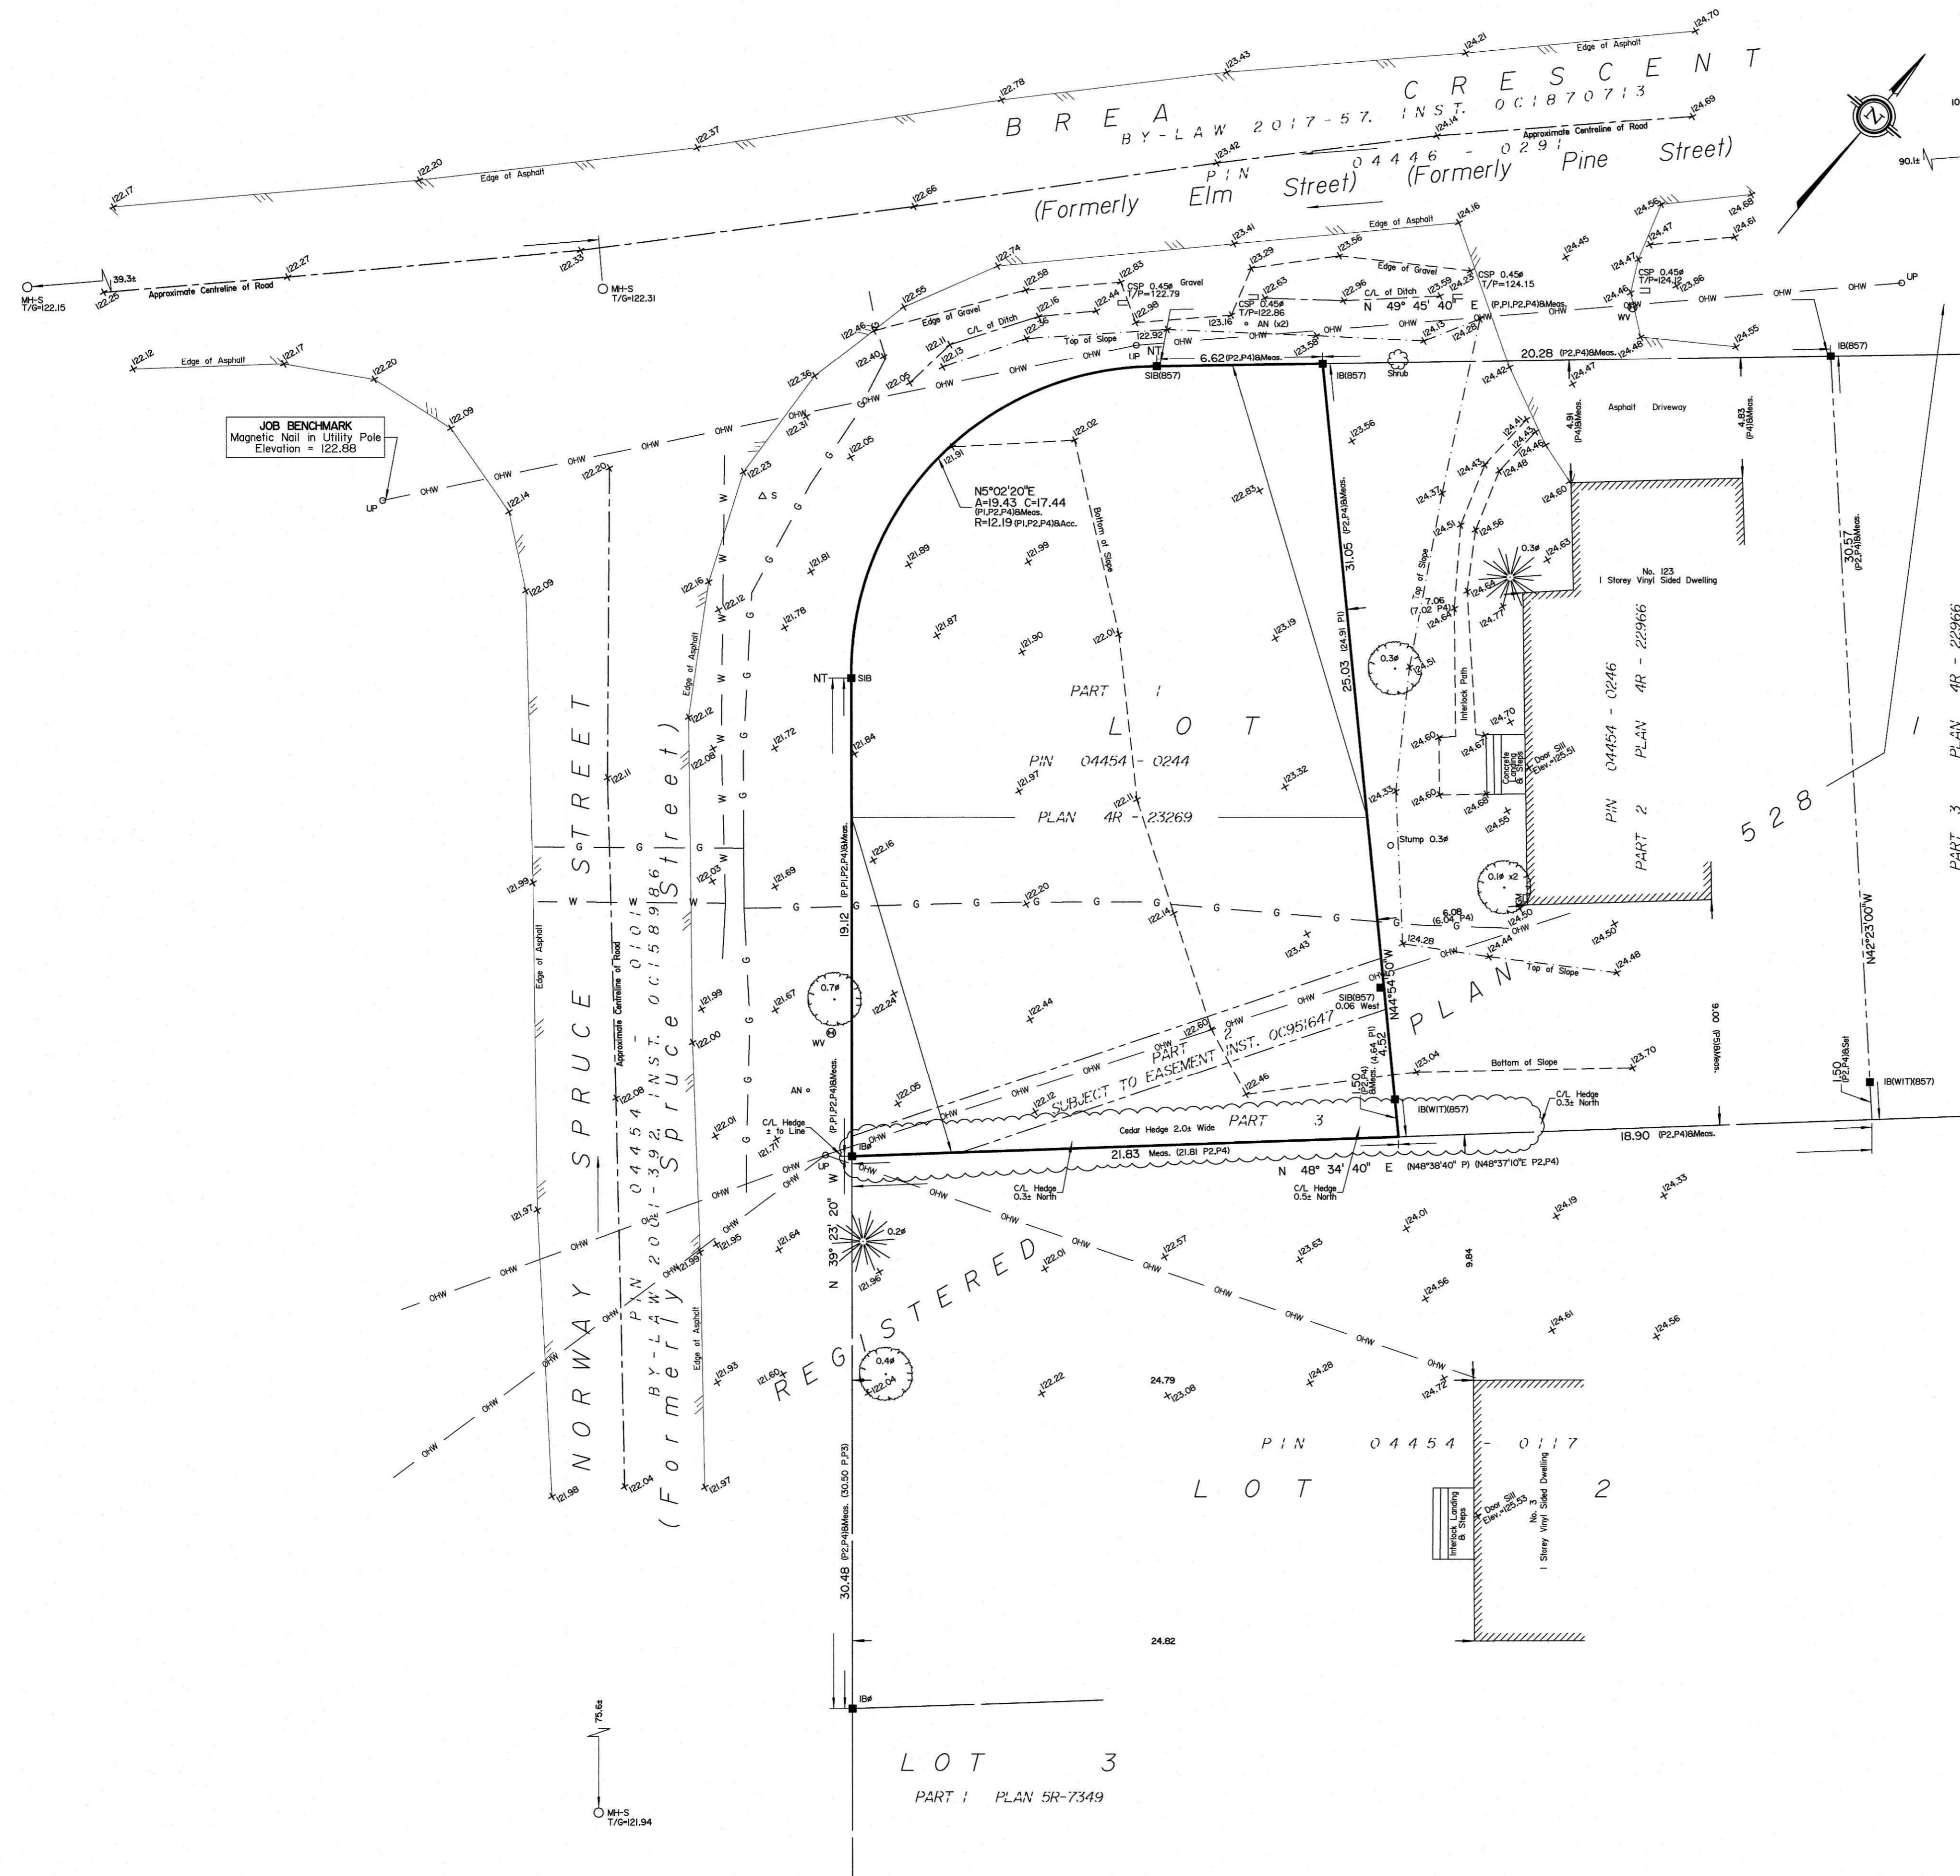

JOB BENCHMARK Magnetic Nail in Utility Pole Elevation = 122.68

MH-S 176=121.94

LOT 3 PART 1 PLAN 5R-7349

Nicole Rajnovich

From: Smith, Travis [travis.smith@ottawa.ca]
Sent: March 29, 2022 2:37 PM
To: Nicole Rajnovich
Subject: Re: 121 Brae Crescent - Servicing

Follow Up Flag: Follow up
Flag Status: Completed

Hi Nicole,

Quick search through available engineering drawings provided a P&P drawing for a sanitary sewer extension from the manhole at the intersection of Norway Spruce & Elm (Assume it was renamed to Brae) to the midpoint of 125 Brae.

This drawing includes a note that the contractor will locate and use the existing services that serviced 123 Brae (Part 2) previously for the new development at 121 Brae (Part 1).

Engineering drawings are now available through Email Geoinformation@ottawa.ca(link sends e-mail) or call 613-580-2424, ext. 44455.

Any follow-up questions let me know,

Travis Smith, P.Eng.

Engineering Intern

Planning, Real Estate and Economic Development Department / Direction générale de la planification, des biens immobiliers et du développement économique

Development Review - Rural

City of Ottawa | Ville d'Ottawa

110 Laurier Avenue West, Ottawa, ON | 110, Avenue. Laurier Ouest, Ottawa (Ontario) K1P 1J1

613.580.2424 ext./poste 16544, travis.smith@ottawa.ca

DUE to the City of Ottawa's public health directions related to COVID-19, I will be working from home. **Phone contact is limited and email is our best option. Thank you in advance.**

EN RAISON des directives de santé publique de la Ville d'Ottawa liées au COVID-19, je travaillerai à domicile. Le contact téléphonique est limité et le courrier électronique est notre meilleure option. Vous remerciant à l'avance.

From: Nicole Rajnovich <nicole@kollaard.ca>

Sent: Tuesday, March 29, 2022 2:16 PM

To: Smith, Travis <travis.smith@ottawa.ca>

Subject: 121 Brae Crescent - Servicing

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hi Travis,

We were asked to provide a quote for a grading and servicing design at 121 Brae Avenue and were wondering if you have any information on this property. It looks like it may have been part of a previous severance application. However there doesn't appear to be a sanitary sewer on Brae Crescent, so we are curious to where 123 Brae is being serviced from. Is it possible the sanitary service runs through or in from of this property? Any information you have would be helpful.

Thank you and best regards,

Nicole Rajnovich



Kollaard Associates
Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0 CANADA
t: 613.860.0923 x.263 f: 613.258.0475
www.kollaard.ca



'
This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.

'

Subject: Re: 121 Brae Crescent
From: "Smith, Travis" <travis.smith@ottawa.ca>
Date: 2023-03-03, 8:53 a.m.
To: "amanda@kollaard.ca" <amanda@kollaard.ca>
CC: "Rathnasooriya, Shika" <Thakshika.Rathnasooriya@ottawa.ca>

Hi Amanda,

After looking into the plans further, it appears that the plan I referenced was tied to the consent application for the 3 lots (121, 123, and 125 Elm (Brae)) and one of the conditions associated with that. It does not appear that the work was completed, and I do not have the context of why this work was not followed through. As the severance is completed, my assumption is that there is no plan to complete the works, other than as required to service the development of the parcels.

With that said, I would rely on the information provided by Shika in the pre-consultation and plans provided by GeoInformation Centre as it appears the contents of the plan I referenced would not accurately reflect work completed.

Apologies for the confusion, and if you have any other questions please let me know.

Regards,

Travis Smith, P.Eng.

Project Manager
Planning, Real Estate and Economic Development Department / Direction générale de la planification, des biens immobiliers et du développement économique
Development Review - Rural
City of Ottawa | Ville d'Ottawa
110 Laurier Avenue West, Ottawa, ON | 110, Avenue. Laurier Ouest, Ottawa (Ontario) K1P 1J1
613.580.2424 ext./poste 16544, travis.smith@ottawa.ca

Note that we are in a hybrid work arrangement, phone contact is limited and [email is our best option](#). Thank you in advance.

Notez que nous sommes dans un arrangement de travail hybride, le contact téléphonique est limité et [le courriel est notre meilleure option](#). Merci en avance.

From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: Thursday, March 2, 2023 9:07 AM
To: Smith, Travis <travis.smith@ottawa.ca>
Cc: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Subject: 121 Brae Crescent

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Good Morning Travis,

We are working on the stormwater, grading and servicing for a proposed 3 storey - 5 unit residential building at 121 Brae Crescent in Stittsville.

I believe you had talked to Nicole in our office back in March 2022, see the attached email.

I am trying to find more information on the sanitary extension on Brae toward Stittsville Main Street .

I had contacted the Geoinformation Centre and they provided me with the attached drawings. The drawing you were referring to in your email back in 2022, we didnt receive. Is that something we could get a copy of?

Do you know when the sanitary extension is suppose to be completed?

Any information you have on the sanitary extension, and servicing connections for 123 Brae would be greatly appreciated.

Kind Regards,

Amanda Van Bruggen

--



210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0
tel: 613-860-0923
www.kollaard.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.



Appendix B: Storm Design Criteria and City of Ottawa Correspondence

- City of Ottawa Engineering Comments (Quantity Criteria)
- City of Ottawa Correspondence (Quality Criteria)

MEMO

Date: October 5, 2022

To /
Destinataire Kelly Livingstone, Planner

From /
Expéditeur Shika Rathnasooriya, Project Manager,
Infrastructure Approvals

Subject /
Objet **Pre-Application Consultation**
121 Brae Crescent

Please note the following information regarding the engineering design submission for the above noted site:

1. The Servicing Study Guidelines for Development Applications are available at the following address: <https://ottawa.ca/en/planning-development-and-construction/developing-property/development-application-review-process/development-application-submission/guide-preparing-studies-and-plans#servicing-study-guidelines-development-applications>
2. Servicing and site works shall be in accordance with the following documents:
 - ⇒ Ottawa Sewer Design Guidelines (October 2012)
 - ⇒ Ottawa Design Guidelines – Water Distribution (2010)
 - ⇒ Geotechnical Investigation and Reporting Guidelines for Development Applications in the City of Ottawa (2007)
 - ⇒ City of Ottawa Slope Stability Guidelines for Development Applications (revised 2012)
 - ⇒ City of Ottawa Environmental Noise Control Guidelines (January 2016)
 - ⇒ City of Ottawa Park and Pathway Development Manual (2012)
 - ⇒ City of Ottawa Accessibility Design Standards (2012)
 - ⇒ Ottawa Standard Tender Documents (latest version)
 - ⇒ Ontario Provincial Standards for Roads & Public Works (2013)
3. Record drawings and utility plans are also available for purchase from the City (Contact the City's Information Centre by email at InformationCentre@ottawa.ca or by phone at (613) 580-2424 x.44455).
4. Clearly show and label all the easements on the property, on all plans.

5. Watermain Infrastructure:
- a) There are available 152mm diameter watermains located within the Brae Crescent and Norway Spruce Street ROW. A water boundary condition request is needed for the proposed water connection to the City main.
 - b) Assuming this will be one parcel of land, a perimeter meter is anticipated with subsequent sub-metering at each unit. Sub-metering will be the developer's responsibility.
 - c) As per Section 4.4.7.2 of the Ottawa Design Guidelines – Water Distribution, a DMA (District Metering Area) chamber will be required for private developments serviced by a connection 150mm or larger.
 - d) Water Boundary condition requests must include the location of the service and the expected loads required by the proposed development. Please provide an email to Shika Rathnasooriya (Thakshika.Rathnasooriya@ottawa.ca) with the following information:
 - i. Location of service
 - ii. Type of development and the amount of fire flow required (as per FUS, 1999 – See technical bulletin ISTB 2021-03).
 - iii. Average daily demand: ___ l/s.
 - iv. Maximum daily demand: ___ l/s.
 - v. Maximum hourly daily demand: ___ l/s.
6. Sanitary / Storm Infrastructure:
- a) There is an existing available 250mm diameter sanitary sewer located within Norway Spruce Street to make a service connection. A connection directly to the existing sanitary sewer within the easement is not permitted.
 - b) A monitoring maintenance hole will be required for a private sanitary sewer outletting to a public sanitary sewer. The maintenance hole should be located in an accessible location on private property near the property line (ie. Not in a parking area).
 - c) All services (STM, SAN, WTR) should be grouped in a common trench to minimize the number of road cuts.
 - d) Sewer connections to be made above the springline of the sewermain as per:
 - i. Std Dwg S11.1 for flexible main sewers.
 - ii. Std Dwg S11 (For rigid main sewers).
 - iii. Std Dwg S11.2 (for rigid main sewers using bell end insert method).

- iv. Connections to manholes permitted when the connection is to rigid main sewers where the lateral exceeds 50% the diameter of the sewermain. – Connect obvert to obvert with the outlet pipe unless pipes are a similar size.
7. The Stormwater Management Criteria, for the subject site, is to be based on the following:
 - a) Control the roof drains for all storm events on the proposed building to the 2-year release rate and the remainder of the site runoff can continue to flow as uncontrolled towards the existing roadside ditches.
 - b) Stormwater flows from neighboring properties conveyed through the southeastern portion of the site should not be obstructed.
 - c) There should be no stormwater ponding in parking areas or drive aisles during the 2-year storm event.
 - d) Quality control to be provided as specified by the MVCA. Include correspondence with MVCA in the stormwater/site servicing report.
8. MECP ECA Requirements:

An MECP Environmental Compliance Approval (Private Sewage Works) should not be required for the proposed development.
9. Phase 1 ESAs and Phase 2 ESAs must conform to clause 4.8.4 of the Official Plan that requires that development applications conform to Ontario Regulation 153/04.

Should you have any questions or require additional information, please contact me directly at Thakshika.Rathnasooriya@ottawa.ca.

Subject: RE: 121 Brae Crescent
From: "Rathnasooriya, Shika" <Thakshika.Rathnasooriya@ottawa.ca>
Date: 2023-02-24, 2:42 p.m.
To: "amanda@kollaard.ca" <amanda@kollaard.ca>

Hi Amanda,

An enhanced level (80% TSS) of protection is required for water quality control on this site.

Please let me know if you have any further questions.

Thanks,

Shika Rathnasooriya, P.Eng
Project Manager
Planning, Real Estate and Economic Development Department - West Branch
City of Ottawa
110 Laurier Avenue West Ottawa, ON
613.580.2424 ext. 23433

From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: February 10, 2023 10:31 AM
To: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Cc: Mercedes Liedtke <mliedtke@mvc.on.ca>
Subject: Re: 121 Brae Crescent

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hello Thakshika,

We are working on the stormwater management for the proposed 3-storey 5 unit apartment at 121 Brae Crescent in Stittsville.

I believe you were involved with the initial pre-consultation on this one. See the attached engineering comments.

From you section 7d comment, for SWM quality criteria I had sent an email to MVCA. See below.

With their review changes, could you provide us with the quality requirements.

Many Thanks,

Amanda Van Bruggen



210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0
tel: 613-860-0923
www.kollaard.ca

On 2023-02-10 10:13 a.m., Mercedes Liedtke wrote:

Good morning Amanda,

Thank you for the inquiry. As of January 1, 2023, MVCA is concentrating on water quantity reviews with respect to natural hazards. It would be best to contact the City in regard to the water quality requirements.

Thank you,

Mercedes Liedtke, MSc. | Environmental Planner | Mississippi Valley Conservation Authority
10970 Highway 7, Carleton Place, ON K7C 3P1
www.mvc.on.ca | t. 613 253 0006 ext. 267 | f. 613 253 0122 | mliedtke@mvc.on.ca



From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: February 10, 2023 8:56 AM
To: Mercedes Liedtke <mliedtke@mvc.on.ca>
Subject: 121 Brae Crescent

Good Morning Mercedes,

We are working on the stormwater management for a proposed 3-storey 5 unit apartment at 121 Brae Crescent in Stittsville.

There will be on site parking provided.

The City of Ottawa provided the owners with Servicing and Stormwater quantity criteria. (See attached). Could you provide us with the quality control requirements for the site?

Many Thanks,

Amanda Van Bruggen



Kollaard Associates
Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0
tel: 613-860-0923
www.kollaard.ca

This e-mail originates from the City of Ottawa e-mail system. Any distribution, use or copying of this e-mail or the information it contains by other than the intended recipient(s) is unauthorized. Thank you.

Le présent courriel a été expédié par le système de courriels de la Ville d'Ottawa. Toute distribution, utilisation ou reproduction du courriel ou des renseignements qui s'y trouvent par une personne autre que son destinataire prévu est interdite. Je vous remercie de votre collaboration.



Appendix C: Storm Design Information

- Pre Development Flows and STM Summary
- Actual Discharge Rate and Storage Volume Requirements (catchment 1)
- Storage Volume Provided in Catchment 1
- Actual Discharge Rate and Storage Volume Requirements (catchment 2)
- Storage Volume Provided in Catchment 2

**APPENDIX A: STORMWATER MANAGEMENT MODEL
ALLOWABLE RELEASE RATE AND SWM SUMMARY**

Client: Bryden Gibson Architects Incorporated
 Job No.: 220338
 Location: 121 Brae Crescent, Ottawa
 Date: December 19, 2023

PRE DEVELOPMENT FLOW - Of Future Roof Area Only

Runoff Coefficient Equation

$$C = (A_{\text{hard}} \times 0.9 + A_{\text{soft}} \times 0.2 + A_{\text{gravel}} \times 0.6) / A_{\text{tot}}$$

Area	Surface	Ha	"C"	C _{avg}
Total	Gravel	0.000	0.60	0.20
0.023	Roof/Asphalt/Concrete	0.000	0.90	
	Patio Stones	0.000	0.70	
	Grass	0.023	0.20	

2 Year Event			
Pre Dev.	C	Intensity	Area
2 Year	0.20	76.81	0.023
2.78CIA= 0.98		0.98 L/s	

**Use a 10 minute time of concentration for 5 year

Total Allowable Release: **0.98 L/s**

STORMWATER MANAGEMENT SUMMARY

Sub Area I.D.	Sub Area (ha)	2,5 year C	100 year 'C'	Outlet Location	2 Year Pre-development Release (L/s)	5 Year Controlled Release (L/s)	Required 5 year Storage (m ³)	100 Year Controlled Release (L/s)	Required 100 year Storage (m ³)	Total Storage Provided	100 year Storage Depth (mm)
Pre	0.023	0.20	0.25	OFFSITE	0.98	N/A	N/A	N/A	N/A		N/A
CA1	0.020	0.90	1.00	OFFSITE	N/A	0.64	3.60	0.64	8.60		145.00
CA2	0.003	0.90	1.00	OFFSITE	N/A	0.32	0.26	0.32	0.72		70.00
TOTAL	0.022					0.96	3.9	0.96	9.3		

**APPENDIX A: STORMWATER MANAGEMENT MODEL
ACTUAL DISCHARGE RATE AND STORAGE VOLUME REQUIREMENTS**

Client: Bryden Gibson Architects Incorporated
Job No.: 220338
Location: 121 Brae Crescent, Ottawa
Date: #VALUE!

**Use a 10 minute time of concentration

(CA1- UPPER ROOF)			5 Year Event				100 Year Event			
Area ha	Surface	Ha	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)
0.020	Roof	0.020	0.90	0.90	104.19	5.08	1.00	1.00	178.56	9.68
	Gravel	0.000	0.60				1.00			
	Patio Stone/Semipermeable block	0.000	0.70				0.88			
	Grass	0.000	0.20				0.25			

Total Allowable Release Rate 5 year 0.98 L/s
 100 year 0.98 L/s

Storage Requirements for Roof Area (CA1)

Area = 0.020 hectares
 5-year Runoff Coefficient = 0.90 post development
 100-year Runoff Coefficient = 1.00 post development

				Release Rate L/s							
				0	0.2	0.4	0.6	0.8	1	1.2	
Return Period	Time (min)	Intensity (mm/hr)	Flow Q (L/s)	Storage Required (m ³)							
5 Year	10	104.19	5.08	3.1	2.9	2.8	2.7	2.6	2.5	2.3	
	20	70.25	3.43	4.1	3.9	3.6	3.4	3.2	2.9	2.7	
	30	53.93	2.63	4.7	4.4	4.0	3.7	3.3	2.9	2.6	
	40	44.18	2.16	5.2	4.7	4.2	3.7	3.3	2.8	2.3	
	50	37.65	1.84	5.5	4.9	4.3	3.7	3.1	2.5	1.9	
	60	32.94	1.61	5.8	5.1	4.3	3.6	2.9	2.2	1.5	
	70	29.37	1.43	6.0	5.2	4.3	3.5	2.7	1.8	1.0	
Maximum 5 year storage rate				6.0	5.2	4.3	3.7	3.3	2.9	2.7	
				Release Rate L/s							
				0	0.2	0.4	0.6	0.8	1	1.2	
100 Year	10	178.56	9.68	5.8	5.7	5.6	5.4	5.3	5.2	5.1	
	20	119.95	6.50	7.8	7.6	7.3	7.1	6.8	6.6	6.4	
	30	91.87	4.98	9.0	8.6	8.2	7.9	7.5	7.2	6.8	
	40	75.15	4.07	9.8	9.3	8.8	8.3	7.9	7.4	6.9	
	50	63.95	3.47	10.4	9.8	9.2	8.6	8.0	7.4	6.8	
	60	55.89	3.03	10.9	10.2	9.5	8.7	8.0	7.3	6.6	
	70	49.79	2.70	11.3	10.5	9.7	8.8	8.0	7.1	6.3	
80	44.99	2.44	11.7	10.7	9.8	8.8	7.9	6.9	5.9		
Maximum 100 year storage rate				11.7	10.7	9.8	8.8	8.0	7.4	6.9	

APPENDIX A: STORMWATER MANAGEMENT MODEL
STORAGE VOLUME PROVIDED ROOF

Client: Bryden Gibson Architects Incorporated
 Job No.: 220338
 Location: 121 Brae Crescent, Ottawa
 Date: May 12, 2023

Storage Provided for Upper Roof Area (CA1)

Storage Depth (m)	Layer Thickness (m)	Top Layer Area (m ²)	Bottom Layer Area (m ²)	Incremental Volume (m ³)	Cumulative Storage Volume (m ³)	Release Rate Per Drain (L/sec)	Accutrol Weirs (L/sec)	Total Outflow (L/sec)	Draw Down Incremental (hrs)	Draw Down Cumulative (hrs)
0.15	0.01	142.3	132.9	1.4	9.3	0.320	0.640	0.640	4.05	19.6
0.14	0.01	132.9	122.9	1.3	7.9	0.320	0.640	0.640	3.45	15.5
0.13	0.01	122.9	112.3	1.2	6.7	0.320	0.640	0.640	2.89	12.1
0.12	0.01	112.3	101.4	1.1	5.5	0.320	0.640	0.640	2.38	9.2
0.11	0.01	101.4	89.8	1.0	4.4	0.320	0.640	0.640	1.92	6.8
0.10	0.01	89.8	77.8	0.8	3.5	0.320	0.640	0.640	1.50	4.9
0.09	0.01	77.8	65.3	0.7	2.6	0.320	0.640	0.640	1.14	3.4
0.08	0.01	65.3	52.3	0.6	1.9	0.320	0.640	0.640	0.83	2.2
0.07	0.01	52.3	39.7	0.5	1.3	0.320	0.640	0.640	0.58	1.4
0.06	0.01	39.7	28.6	0.3	0.9	0.320	0.640	0.640	0.38	0.8
0.05	0.01	28.6	19.3	0.2	0.5	0.320	0.640	0.640	0.23	0.5
0.04	0.01	19.3	11.8	0.2	0.3	0.320	0.640	0.640	0.13	0.2
0.03	0.01	11.8	6.2	0.1	0.1	0.320	0.640	0.640	0.06	0.1
0.02	0.01	6.2	2.3	0.0	0.0	0.250	0.500	0.500	0.03	0.0
0.01	0.01	2.3	0.0	0.0	0.0	0.130	0.260	0.260	0.01	0.0
0.00	0.00	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.00	0.0

Roof Drain Type - WATTS Large Area Roof Drain with Adjustable Flow Control. RD-100-A-ADJ - Closed Weir.

Number of Weirs 2

Number of Slots per Weir 1


Discharge per slot 0.32 L/sec

Maximum Discharge for the 5 year Storm Event 0.640 L/s
 Maximum Discharge for the 100 year Storm Event 0.640 L/s


Maximum Storage required for the 5 year Storm Event 3.6 (m³)
 Maximum Storage required for the 100 year Storm Event 8.6 (m³)

Storage Depth for the 5 year Storm Event 100 mm
 Storage Depth for the 100 year Storm Event 145 mm

CA1 - Storage Discharge Curve
Roof Top Storage (Upper Roof)

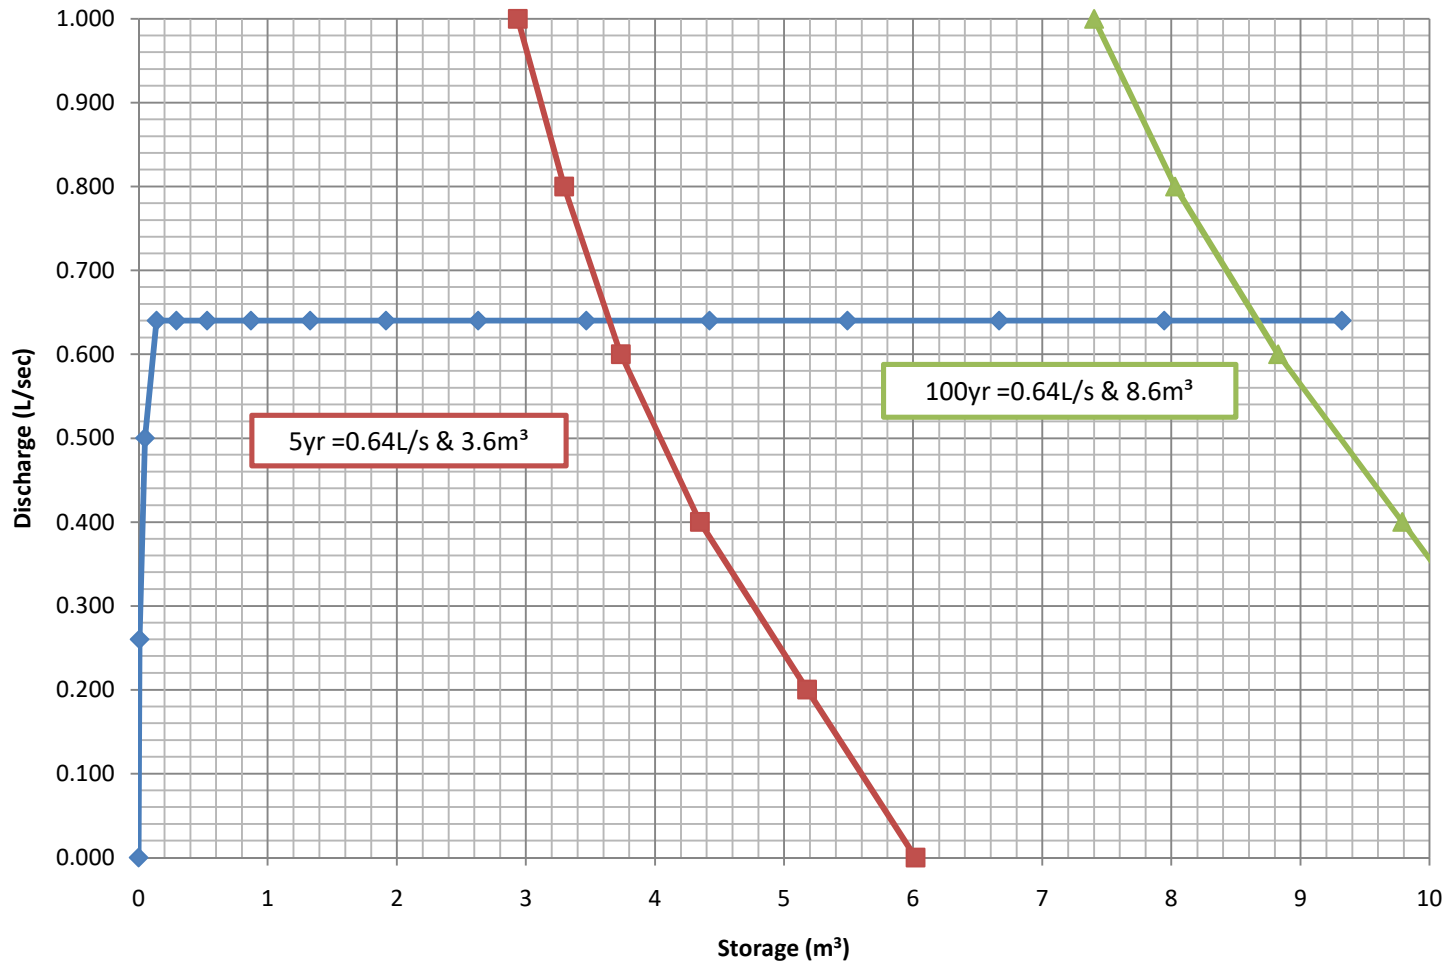

APPENDIX A: STORMWATER MANAGEMENT MODEL
Stage-Storage Curve CA1

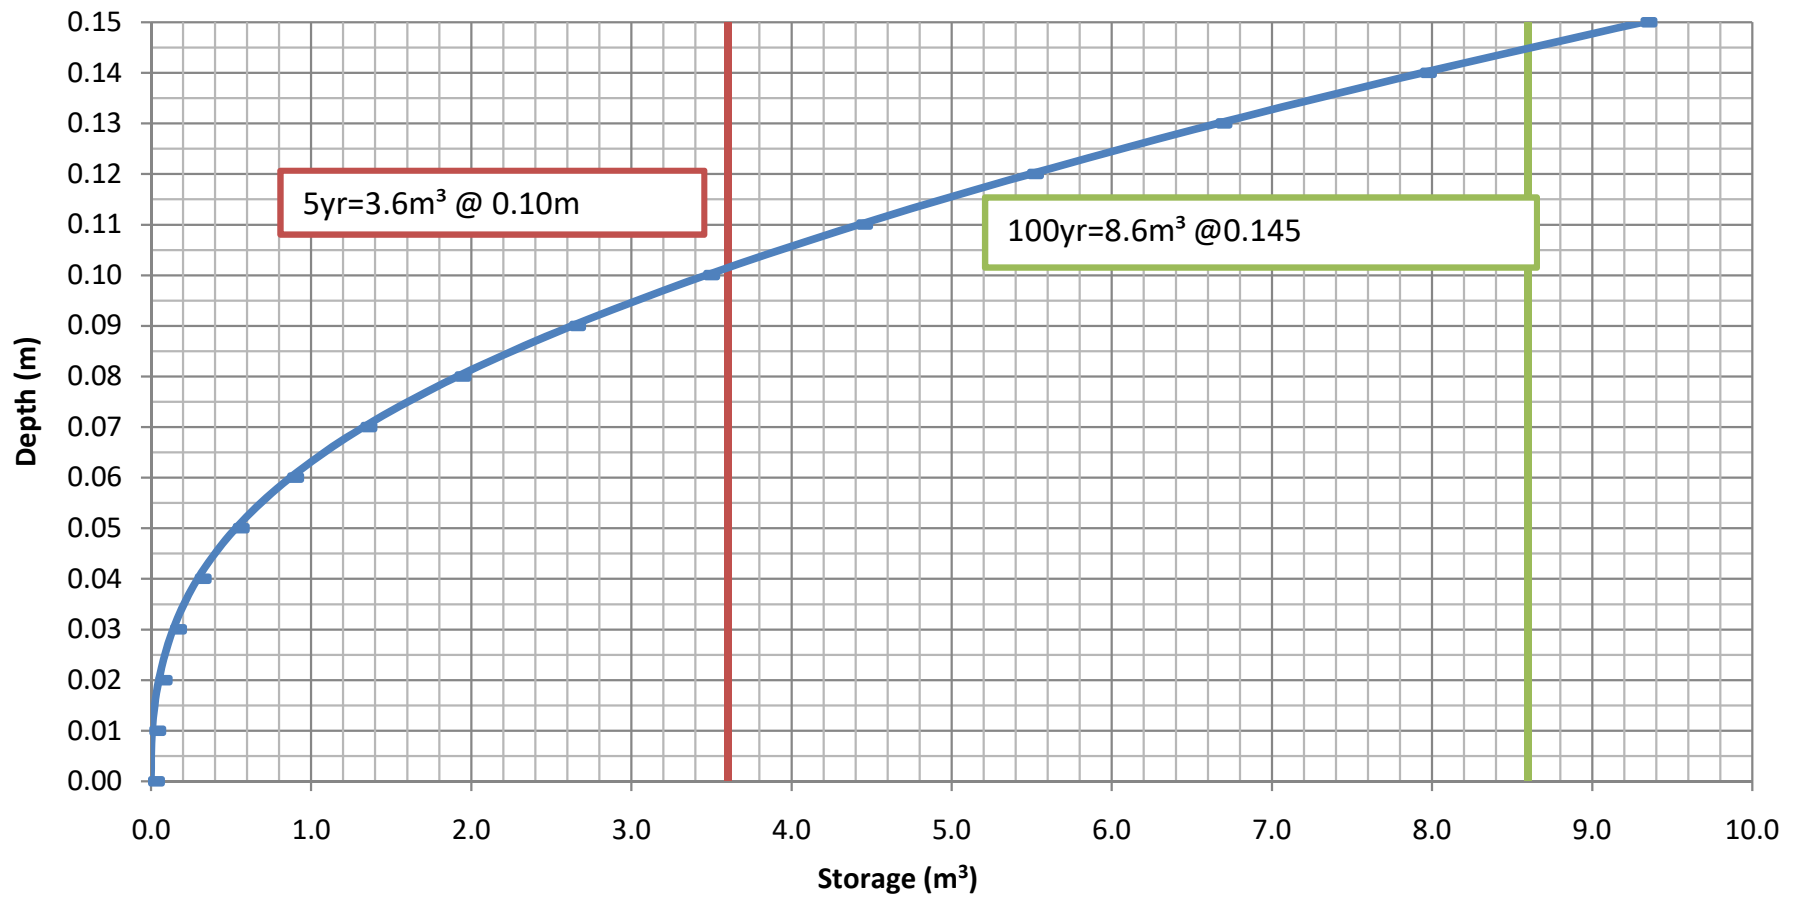

APPENDIX A: STORMWATER MANAGEMENT MODEL
ACTUAL DISCHARGE RATE AND STORAGE VOLUME REQUIREMENTS

Client: Bryden Gibson Architects Incorporated
 Job No.: 220338
 Location: 121 Brae Crescent, Ottawa
 Date: May 12,2023

**Use a 10 minute time of concentration

(CA2- LOWER ROOF)			5 Year Event				100 Year Event			
Area ha	Surface	Ha	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)	"C"	C _{avg}	Intensity (mm/hr)	Runoff Rate (L/s)
0.003	Asphalt/Concrete/Roof	0.003	0.90	0.90	104.19	0.70	1.00	1.00	178.56	1.34
	Gravel	0.000	0.60				1.00			
	Patio Stone/Semipermeable block	0.000	0.70				0.88			
	Grass	0.000	0.20				0.25			

Total Allowable Release Rate 5 year 0.98 L/s
 100 year 0.98 L/s

Storage Requirements for Roof Area (CA1)

Area = 0.003 hectares
 5-year Runoff Coefficient = 0.90 post development
 100-year Runoff Coefficient = 1.00 post development

Release Rate L/s				0	0.2	0.4	0.6	0.8	1	1.2
Return Period	Time (min)	Intensity (mm/hr)	Flow Q (L/s)	Storage Required (m ³)						
5 Year	10	104.19	0.70	0.4	0.3	0.2	0.1	-0.1	-0.2	-0.3
	20	70.25	0.47	0.6	0.3	0.1	-0.2	-0.4	-0.6	-0.9
	30	53.93	0.36	0.7	0.3	-0.1	-0.4	-0.8	-1.1	-1.5
	40	44.18	0.30	0.7	0.2	-0.2	-0.7	-1.2	-1.7	-2.2
	50	37.65	0.25	0.8	0.2	-0.4	-1.0	-1.6	-2.2	-2.8
	60	32.94	0.22	0.8	0.1	-0.6	-1.4	-2.1	-2.8	-3.5
	70	29.37	0.20	0.8	0.0	-0.8	-1.7	-2.5	-3.4	-4.2
	Maximum 5 year storage rate				0.8	0.3	0.2	0.1	-0.1	-0.2
Release Rate L/s				0	0.2	0.4	0.6	0.8	1	1.2
100 Year	10	178.56	1.34	0.8	0.7	0.6	0.4	0.3	0.2	0.1
	20	119.95	0.90	1.1	0.8	0.6	0.4	0.1	-0.1	-0.4
	30	91.87	0.69	1.2	0.9	0.5	0.2	-0.2	-0.6	-0.9
	40	75.15	0.56	1.4	0.9	0.4	-0.1	-0.6	-1.0	-1.5
	50	63.95	0.48	1.4	0.8	0.2	-0.4	-1.0	-1.6	-2.2
	60	55.89	0.42	1.5	0.8	0.1	-0.6	-1.4	-2.1	-2.8
	70	49.79	0.37	1.6	0.7	-0.1	-1.0	-1.8	-2.6	-3.5
	80	44.99	0.34	1.6	0.7	-0.3	-1.3	-2.2	-3.2	-4.1
Maximum 100 year storage rate				1.6	0.9	0.6	0.4	0.3	0.2	0.1

APPENDIX A: STORMWATER MANAGEMENT MODEL
STORAGE VOLUME PROVIDED ROOF

Client: Bryden Gibson Architects Incorporated
 Job No.: 220338
 Location: 121 Brae Crescent, Ottawa
 Date: May 12, 2023

Storage Provided for Lower Roof Area (CA2)

Storage Depth (m)	Layer Thickness (m)	Top Layer Area (m ²)	Bottom Layer Area (m ²)	Incremental Volume (m ³)	Cumulative Storage Volume (m ³)	Release Rate Per Drain (L/sec)	Accutrol Weirs (L/sec)	Total Outflow (L/sec)	Draw Down Incremental (hrs)	Draw Down Cumulative (hrs)
0.15	0.01	26.8	26.8	0.3	2.8	0.320	0.320	0.320	2.47	14.8
0.14	0.01	26.8	26.8	0.3	2.6	0.320	0.320	0.320	2.23	12.3
0.13	0.01	26.8	26.8	0.3	2.3	0.320	0.320	0.320	2.00	10.1
0.12	0.01	26.8	26.7	0.3	2.0	0.320	0.320	0.320	1.77	8.1
0.11	0.01	26.7	26.7	0.3	1.8	0.320	0.320	0.320	1.54	6.3
0.10	0.01	26.7	26.7	0.3	1.5	0.320	0.320	0.320	1.30	4.8
0.09	0.01	26.7	26.7	0.3	1.2	0.320	0.320	0.320	1.07	3.5
0.08	0.01	26.7	26.4	0.3	1.0	0.320	0.320	0.320	0.84	2.4
0.07	0.01	26.4	20.4	0.2	0.7	0.320	0.320	0.320	0.61	1.5
0.06	0.01	20.4	15.0	0.2	0.5	0.320	0.320	0.320	0.41	0.9
0.05	0.01	15.0	10.4	0.1	0.3	0.320	0.320	0.320	0.25	0.5
0.04	0.01	10.4	6.6	0.1	0.2	0.320	0.320	0.320	0.15	0.3
0.03	0.01	6.6	3.8	0.1	0.1	0.320	0.320	0.320	0.07	0.1
0.02	0.01	3.8	1.6	0.0	0.0	0.250	0.250	0.250	0.04	0.0
0.01	0.01	1.6	0.0	0.0	0.0	0.130	0.130	0.130	0.01	0.0
0.00	0.00	0.0	0.0	0.0	0.0	0.000	0.000	0.000	0.00	0.0

Roof Drain Type - WATTS Large Area Roof Drain with Adjustable Flow Control. RD-100-A-ADJ - Closed Weir.

Number of Weirs 1

Number of Slots per Weir 1


Discharge per slot 0.32 L/sec

Maximum Discharge for the 5 year Storm Event 0.320 L/s
 Maximum Discharge for the 100 year Storm Event 0.320 L/s


Maximum Storage required for the 5 year Storm Event 0.26 (m³)
 Maximum Storage required for the 100 year Storm Event 0.72 (m³)

Storage Depth for the 5 year Storm Event 50 mm
 Storage Depth for the 100 year Storm Event 70 mm

CA2 - Storage Discharge Curve
Roof Top Storage (Lower Roof)

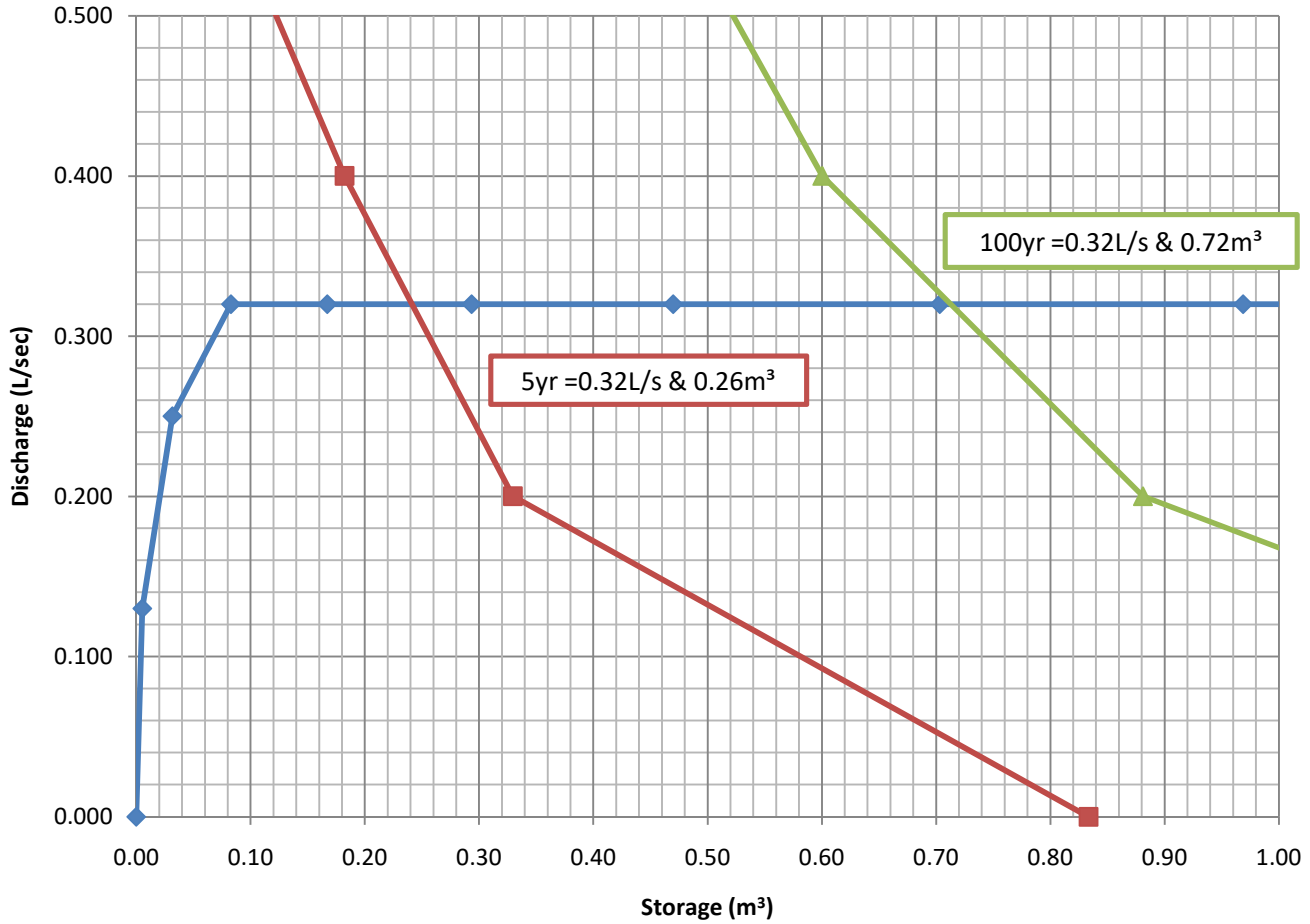

APPENDIX A: STORMWATER MANAGEMENT MODEL Stage-Storage Curve CA2

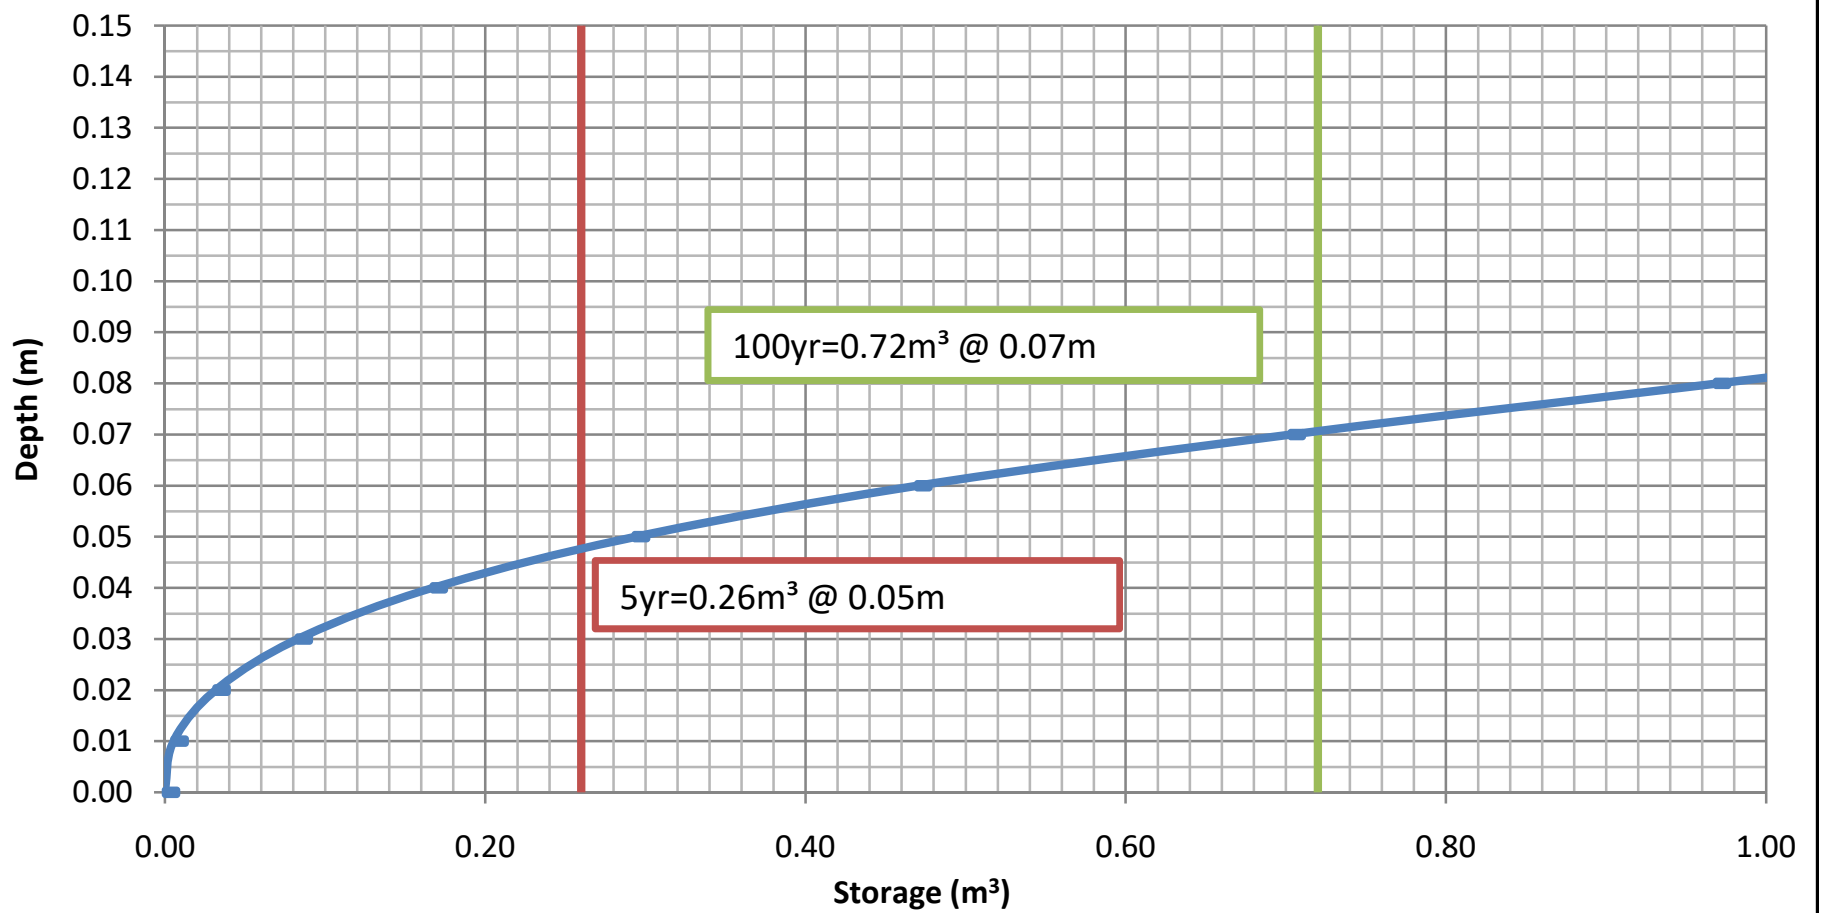

APPENDIX A: STORMWATER MANAGEMENT MODEL
OUTLET CONTROL STRUCTURE DESIGN SHEET - Rain Garden Area

Client: Bryden Gibson Architects Incorporated
 Job No.: 220338
 Location: 121 Brae Crescent, Ottawa
 Date: May 12, 2023

Outlet pipe invert

121.85

Infiltration Information
 Permeability k = 0.001 m/sec

Channel Information
 Top Width 1.300
 Bottom Width 1.000
 Roughness coefficient 0.03
 Channel Invert 122.25
 0.01 slope (grass)


Stage, WSE Elev (m)	Comments	Layer Thickness (m)	Water column depth (m)	Top Layer (m ²)	Bottom Layer (m ²)	Layer Volume (m ³)	Cummulative Storage Volume (m ³)	Infiltration					Channel Flow					Total outflow	Draw Down Incremental (hrs)	Draw Down Cummulative (hrs)	
								Length of sand filter (m)	Infiltration Area (m ²)	Head (m)	Flow Path Length (m)	Hydraulic Gradient	Outflow filtration (L/sec)	Head (m)	Z	Cross sectional area (m ²)	Wetted Perimeter				Outflow channel flow (L/sec)
122.300	Top of Rain Garden Area	0.050	0.35	15.40	14.70	0.8	4.1	4.4	1.5	0.45	0.41	1.1	1.7	0.05	3.00	0.06	1.32	23.774	25.5	0.01	3.23
122.250	Bottom of Outflow channel	0.050	0.30	14.70	13.90	0.7	3.3	4.4	1.3	0.40	0.43	0.9	1.2	0.00	0.00	0.00	0.00	0.000	1.2	0.16	3.22
122.200	Top of Sand Filter	0.050	0.25	13.90	13.10	0.7	2.6	4.4	1.1	0.35	0.46	0.8	0.8	0.00	0.00	0.00	0.00	0.000	0.8	0.22	3.06
122.150		0.050	0.20	13.10	12.30	0.6	2.0	4.4	0.9	0.30	0.49	0.6	0.5	0.00	0.00	0.00	0.00	0.000	0.5	0.33	2.83
122.100		0.050	0.15	12.30	11.50	0.6	1.3	4.4	0.7	0.25	0.53	0.5	0.3	0.00	0.00	0.00	0.00	0.000	0.3	0.53	2.51
122.050		0.050	0.10	11.50	10.60	0.6	0.7	4.4	0.4	0.20	0.57	0.4	0.2	0.00	0.00	0.00	0.00	0.000	0.2	0.99	1.98
122.000		0.050	0.05	10.60	0.00	0.2	0.2	4.4	0.2	0.15	0.66	0.2	0.1	0.00	0.00	0.00	0.00	0.000	0.1	0.98	0.98
121.950	Bottom of Storage	0.000	0.0	0.00	0	0.0	0.0	4.4	0.0	0.10	0.66	0.2	0.0	0.00	0.00	0.00	0.00	0.000	0.0	0.00	0.00

Overland Flow Channel Calculations

$$Q = VA \quad V = \frac{k}{n} R^{2/3} S^{1/2} \quad R = \frac{A}{P} \quad A = \frac{y}{2}(b + T)$$

$$P = b + y \left(\sqrt{1 + z_1^2} + \sqrt{1 + z_2^2} \right) \quad T = b + y(z_1 + z_2)$$


$$F = V \sqrt{\frac{T}{gA \cos \theta}} \quad \theta = \tan^{-1}(S)$$

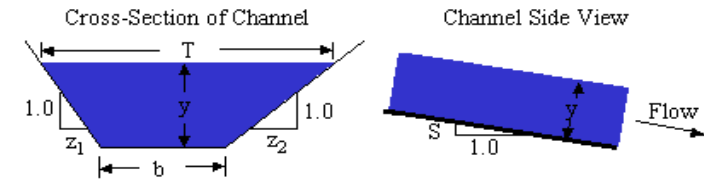



Appendix D: Offsite Stormwater

- Offsite Stormwater Catchment Area

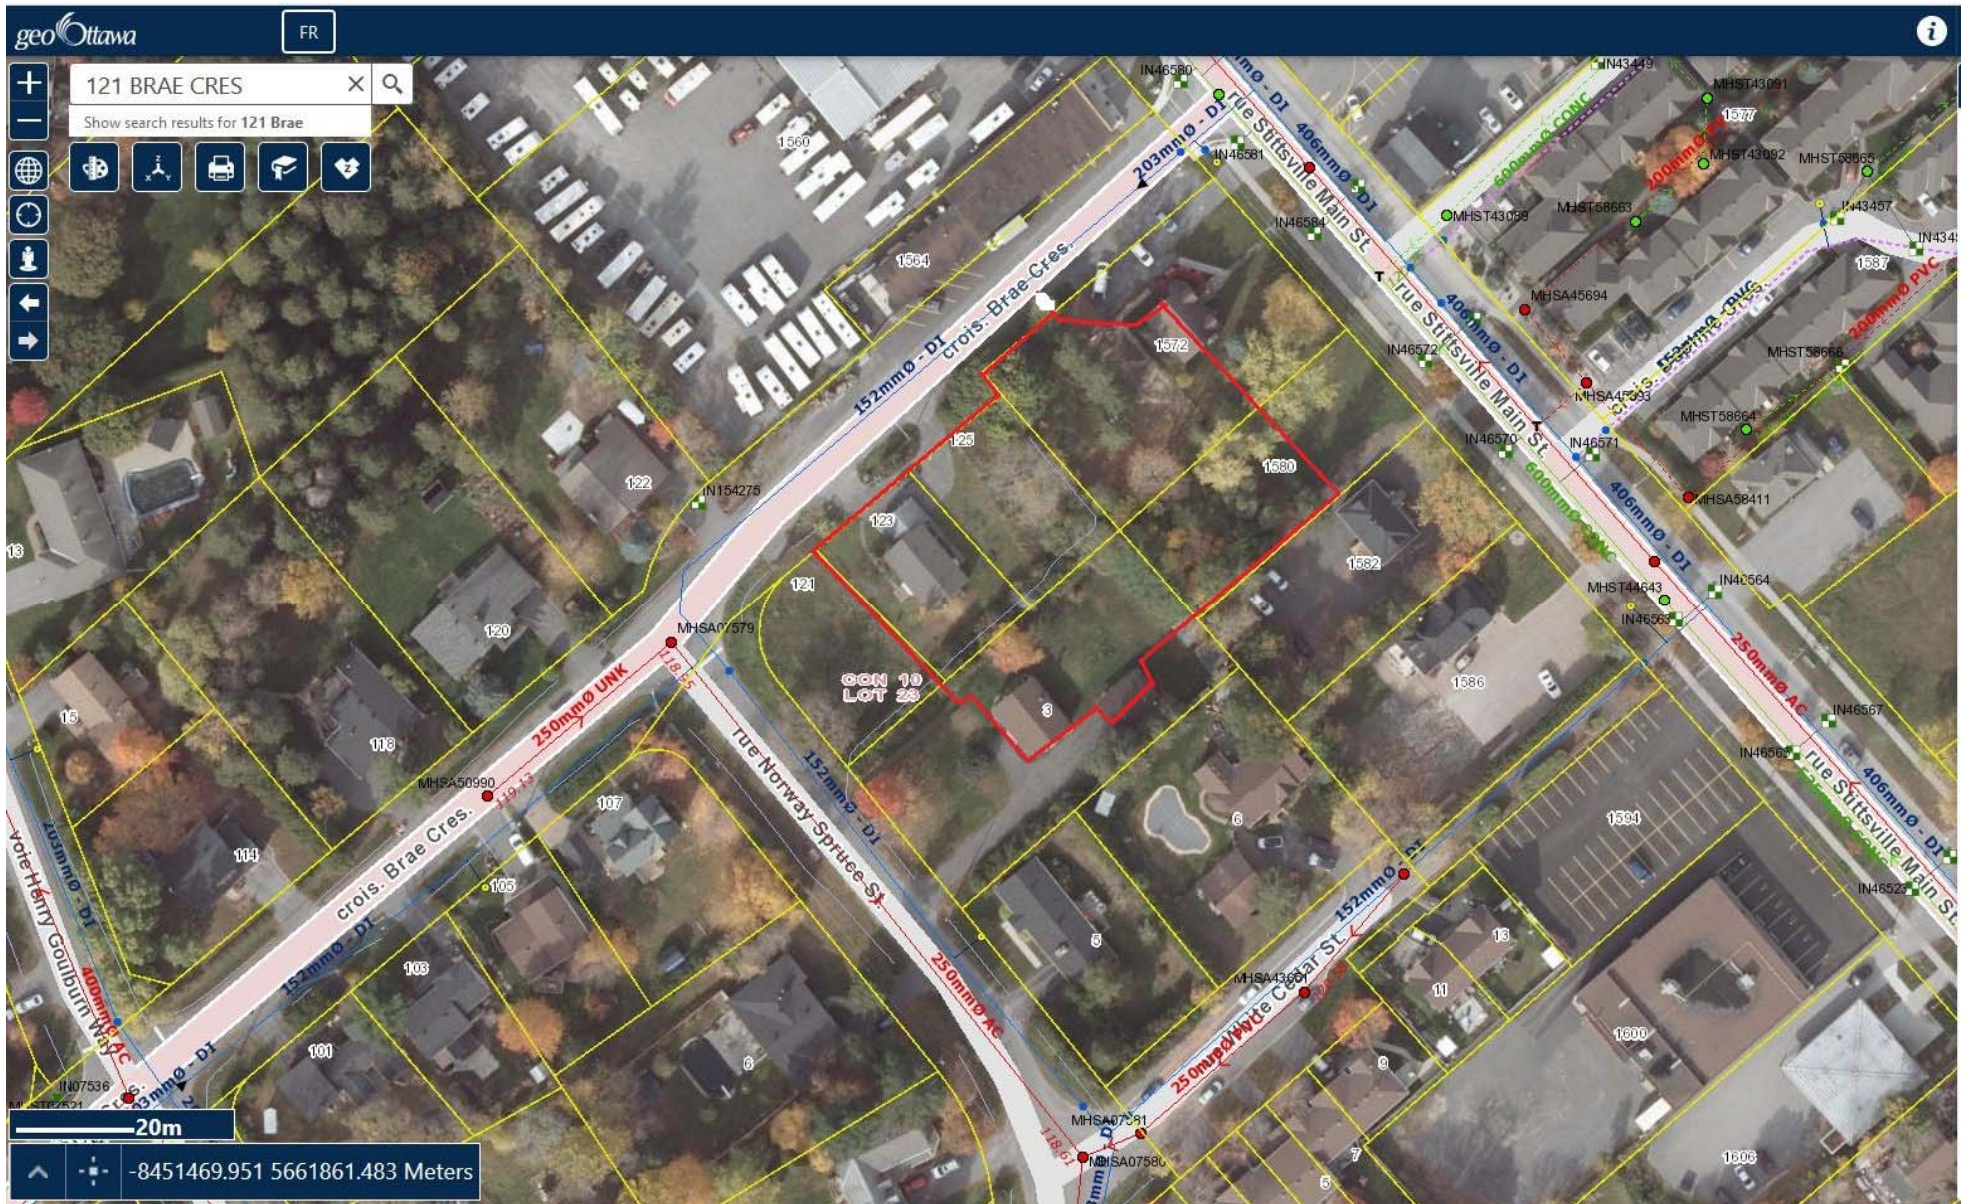

Offsite Contributing Area (Highlighted in red)
 Area = 0.36 hectares
 Runoff Coefficient = 0.35



Appendix E: Product Information

- Accutrol Weirs Flow Control and Roof Drains Sheets
- 360R Non Woven Geotextile
- Coconut Erosion Control Blanket



Adjustable Accutrol Weir

Tag: _____

Adjustable Flow Control for Roof Drains



ADJUSTABLE ACCUTROL (for Large Sump Roof Drains only)

For more flexibility in controlling flow with heads deeper than 2", Watts Drainage offers the Adjustable Accutrol. The Adjustable Accutrol Weir is designed with a single parabolic opening that can be covered to restrict flow above 2" of head to less than 5 gpm per inch, up to 6" of head. To adjust the flow rate for depths over 2" of head, set the slot in the adjustable upper cone according to the flow rate required. Refer to Table 1 below.
 Note: Flow rates are directly proportional to the amount of weir opening that is exposed.

EXAMPLE:

For example, if the adjustable upper cone is set to cover 1/2 of the weir opening, flow rates above 2" of head will be restricted to 2-1/2 gpm per inch of head.

Therefore, at 3" of head, the flow rate through the Accutrol Weir that has 1/2 the slot exposed will be:
 [5 gpm (per inch of head) x 2 inches of head] + 2-1/2 gpm (for the third inch of head) = 12-1/2 gpm.

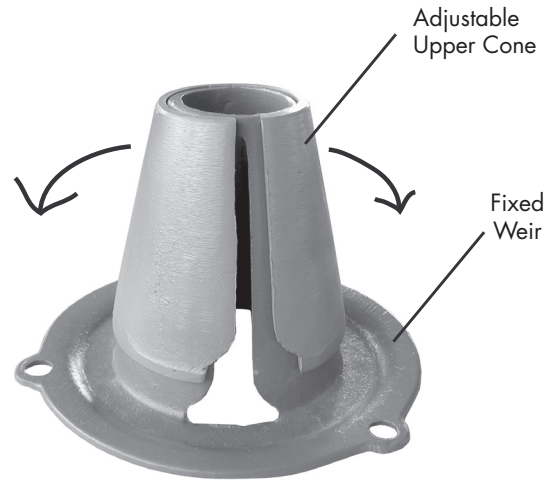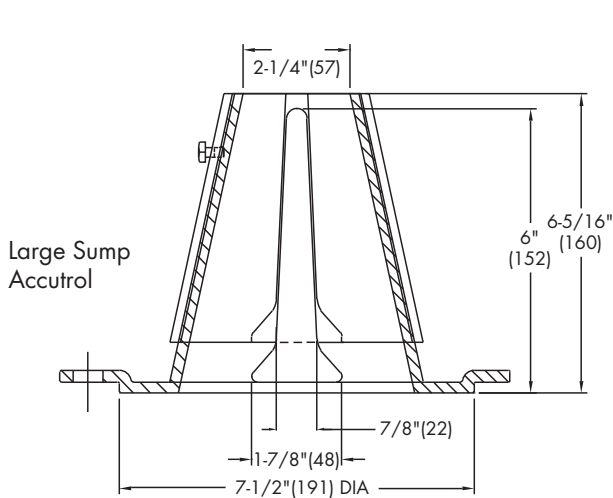

1/2 Weir Opening Exposed Shown Above

TABLE 1. Adjustable Accutrol Flow Rate Settings

Weir Opening Exposed	1"	2"	3"	4"	5"	6"
	Flow Rate (gallons per minute)					
Fully Exposed	5	10	15	20	25	30
3/4	5	10	13.75	17.5	21.25	25
1/2	5	10	12.5	15	17.5	20
1/4	5	10	11.25	12.5	13.75	15
Closed	5	5	5	5	5	5

Job Name _____
 Job Location _____
 Engineer _____

Contractor _____
 Contractor's P.O. No. _____
 Representative _____

Watts product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Watts Technical Service. Watts reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Watts products previously or subsequently sold.

USA: Tel: (800) 338-2581 • Fax: (828) 248-3929 • Watts.com
 Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • Watts.ca
 Latin America: Tel: (52) 81-1001-8600 • Fax: (52) 81-8000-7091 • Watts.com




A Watts Water Technologies Company

ACCUTROL WEIR FLOW CONTROL


SPECIFICATION: Watts Drainage Products epoxy coated cast iron Accutrol Weir is designed with parabolic openings which limit the flow of rain water off a roof. Each weir slot controls flow to 5 gpm per inch of head to a maximum of 30 gpm at 6" head (for large sump), 25 gpm at 5" head (for small sump). The Accutrol Weir is secured to the flashing clamp of the roof drain. The Accutrol Weir is available with 1 to 4 slots for the large sump drain and up to 3 slots for the small sump drain.

For Large Sump Roof Drains Specify the "-A" option and number of slots required. (ie. "RD-100-A2" for two slot weir)

For Small Sump Roof Drains Specify the "-A" option and number of slots required. (ie. "RD-200-A1" for one slot weir)

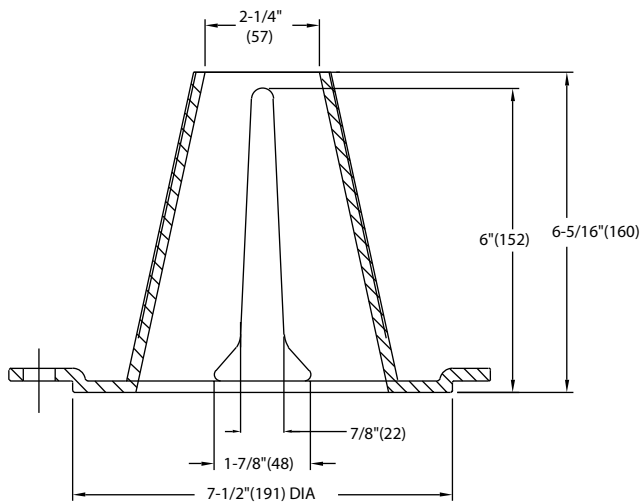

LARGE SUMP ACCUTROL WEIR

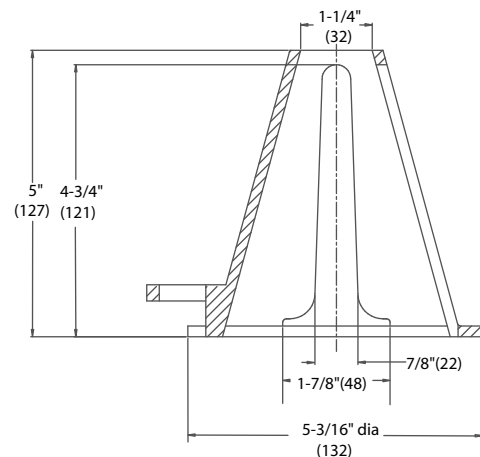

SMALL SUMP ACCUTROL WEIR

Job Name _____ Contractor _____

Job Location _____ Contractor's P.O. No. _____

Engineer _____ Representative _____

WATTS Drainage reserves the right to modify or change product design or construction without prior notice and without incurring any obligation to make similar changes and modifications to products previously or subsequently sold. See your WATTS Drainage representative for any clarification. Dimensions are subject to manufacturing tolerances.

Terrafix 360R - Geotextile

Function: Filtration & Drainage.

Terrafix 360R is a needle-punched nonwoven geotextile made of 100% virgin polypropylene staple fibers, which are formed into a random network for dimensional stability. Terrafix 360R resists ultraviolet deterioration, rotting, biological degradation, naturally encountered alkalis and acids. Polypropylene is stable within the pH range of 2-13.

Types of applications for 360R are: Subdrains, French Drains, Foundation Drains, Trench Drains, Blanket Drains.

360R used in weaker soil conditions. Used in conjunction with coarser drainage materials.

Property	ASTM Test Method	Value Metric Units
Typical Geotextile Properties		
• Weight (Typical)	D 5261	200 g / m ² (6 oz/sqyd)
• Grab Tensile Strength	D 4632	711 N
• Grab Elongation	D 4632	50%
• Tear Resistance	D 4533	267 N
• Puncture CBR	D 6241	400 N
• Permittivity	D 4491	1.6 sec ⁻¹
• Water Flow	D 4491	4480 l/min/m ²
• Apparent Opening Size	D 4751	0.212 mm
• U.V. Stability	D 4355	70% @ 500hrs

Material and Performance Specification

ECC-2™ Double Net Coconut Rolled Erosion Control Product

Description:

The ECC-2™ is made with uniformly distributed 100% coconut fiber and two polypropylene netsecurely sewn together with UV stabilized thread. The tightly compressed blankets are wrapped and include a product label, code and installation guide. The blankets are palletized for easy transportation. The ECC-2™ has functional longevity of approximately 36 months, but will vary depending on soil and climatic conditions, and is suitable for slopes 1:1 and medium to high flow channels. The ECC-2™ meets Type 4 specification requirements established by the Erosion Control Technology Council (ECTC) and Federal Highway Administration's (FHWA) FP-03 Section 713.17.

Matrix:	1	2	
	100% Coconut		
Netting:	Type		
	Top: Medium weight UV Stabilized Polypropylen		
	Middle: None		
	Bottom: Medium weight UV Stabilized Polypropylen		
Net Opening:	Top	Middle	
	0.75" x 0.75"	0.75" x 0.75"	
Thread:	Type	Color	
	UV Stabilized Thread	Black	
Roll Sizes:	Standard	"A" Size	Mega
Width:	8 ft 2.4 m	4 ft 1.2 m	16 ft 4.9 m
Length:	112.5 ft 34.3 m	225 ft 68.6 m	112.5 ft 34.3 m
Weight*:	57 lbs 25.9 kg	57 lbs 25.9 kg	114 lbs 51.7 kg
Area:	100 yd ² 83.6 m ²	100 yd ² 83.6 m ²	200 yd ² 167.2 m ²
#/Pallet:	25	9	25

*Weight at time of manufacturing

Index Value Properties*:

Property	Test Method	Typical	
Mass/Unit Area	ASTM D6475	8.30 oz/yd ²	281.4 g/m ²
Thickness	ASTM D6525	0.26 in	6.60 mm
Tensile Strength-MD	ASTM D6818	260 lb/ft	3.79 kN/m
Elongation-MD	ASTM D6818	20 %	
Tensile Strength-TD	ASTM D6818	175 lb/ft	2.55 kN/m
Elongation-TD	ASTM D6818	20.0 %	
Light Penetration	ASTM D6567	16 %	
Density / Specific Gravity	ASTM D792	N/A g/cm ³	
Water Absorption	ASTM D1117	199 %	

*May differ depending upon raw material variations

Slope Performance Design Values*:

Property	Test Method	Value	
C-Factors	ASTM D6459	0.01	
Slope Length (L)	≤ 3:1	3:1-2:1	≥ 2:1
< 50 ft (15 m)	0.010	0.023	0.072
50 ft – 100 ft	0.030	0.054	0.090
>100 ft (30 m)	0.064	0.084	0.104

*Large-Scale Results obtained by 3rd Party GAI Accredited Independent Laboratory

Bench-Scale Testing* (NTPPEP***):

Test Method	Parameters	Results
	50mm (2in) / hr-30 min	SLR**=8.45
ECTC Method 2 Rainfall	100mm (4in) / hr-30 min	SLR**=10.43
	150mm (6in) / hr-30 min	SLR**=12.90
ECTC Method 3 Shear Resistance	Shear at .50 in soil loss	2.59 lb/ft ²
ECTC Method 4 Germination	Top soil; Fescue; 21 day incubation	772 %

*Bench scale tests should not be used for design purposes.
**Soil Loss Ratio=Soil Loss Bare Soil/Soil Loss with RECP=1/C-Factor
***The preceding test data excerpts were reproduced with the permission of AASHTO, however, this does not constitute endorsement or approval of the product, material or device by AASHTO

Channel Performance Design Values*:

Property	Test Method	Value	
Unvegetated Shear Stress	ASTM D 6460	2.50 lbs/ft ²	119.70 Pa
Unvegetated Velocity	ASTM D 6460	10.0 ft/s	3.05 m/s
Vegetated Shear Stress	NA	N/A lbs/ft ²	N/A Pa
Vegetated Velocity	NA	N/A ft/s	N/A m/s
Manning's N (Value Represents a Range)		0.025	

*Large-Scale Results obtained by 3rd Party GAI Accredited Independent Laboratory



Appendix F: Fire Flow Calculations and Boundary Conditions

- O.B.C Fire Flow Calculations
- Separation Distances and Hydrant Map
- Boundary Condition Submission to City of Ottawa

FIRE FLOW REQUIREMENTS

Client: **Bryden Gibson Architects**
 Job No.: **220338**
 Location: **121 Brae Crescent, Stittsville**
 Date: **December 19, 2023**

Fire Water Storage and Supply Flow Rate Requirements

The following equation from the latest version of the Ontario Building Code (2012) was used for calculation of the on-site supply rates required to be supplied by the hydrants.

Formulae:
$$Q = KVS_{Tot}$$

$$S_{Tot} = 1.0 + [S_{side1} + S_{side2} + S_{side3} + S_{side4} + \dots]$$

OBC Classification of Building Use	Group, Division	3-storey residential 'C'	
Assumed Type of Construction	Combustible	Building is of Combustible construction	
Water Supply Coefficient (Table 1, OBC)	K	18	
Exposure Distance 1		11.4	m
Exposure Distance 2		1.2	m
Exposure Distance 3		12.4	m
Exposure Distance 4		15.6	m
Spatial Coefficient 1	Sside	0	
Spatial Coefficient 2	Sside	0.5	
Spatial Coefficient 3	Sside	0	
Spatial Coefficient 4	Sside	0	
Total Spatial Coefficient	Stot	1.5	
Average Building Height	H	10.8	m
Building Footprint	A	161	sq.m
Total Building Volume	V	1,739	cu.m
Minimum Supply of Water	Q	46,948	L
Required Fire Flow	Qf	2700	L/min
		45	L/s
		713	US gpm

per Table 2 on A-3.2.5.7 of the OBC

OBC - Table 2 of A-3.2.5.7. REQUIRE MINIMUM WATER SUPPLY FLOW RATE (L/min)		
Qf =	2700	If Q ≤ 108 000 L
Qf =	3600	108 000L < Q ≤ 135 000 L
Qf =	4500	135 000L < Q ≤ 162 000 L
Qf =	5400	162 000L < Q ≤ 190 000 L
Qf =	6300	190 000L < Q ≤ 270 000 L
Qf =	9000	Q > 270 000 L

DRAWING NUMBER:
220338 – FIRE

O.B.C SEPARATION DISTANCES &
HYDRANT LOCATIONS



GENERAL NOTES:

- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.88.
- This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Amis, O'Sullivan, Vollebæk Ltd. April 25, 2022.
- Contractor is responsible for location and protection of utilities.
- All dimensions to be verified on site by contractor prior to construction.
- Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
- Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
- The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
- The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
- A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
- The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
- Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
- Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
- All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
- This drawing is part of Kollaard Associates design report # 220338.

REV	BY	DATE	DESCRIPTION
0	AVB	2023/05/10	FOR SPC SUBMISSION



P.O. BOX 189, 210 PRESCOTT ST (613) 860-0923
KEMPTVILLE, ONTARIO info@kollaard.ca
KOG 1J0 FAX (613) 258-0475
http://www.kollaard.ca

CLIENT:
BRYDEN GIBSON


PROJECT:
PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
121 BRAE CRESCENT, STITTSVILLE,
ON, K2S 1P1

DESIGNED BY: -- DATE: MAY 05, 2023

DRAWN BY: AVB SCALE: 1:300

KOLLAARD FILE NUMBER:
220338

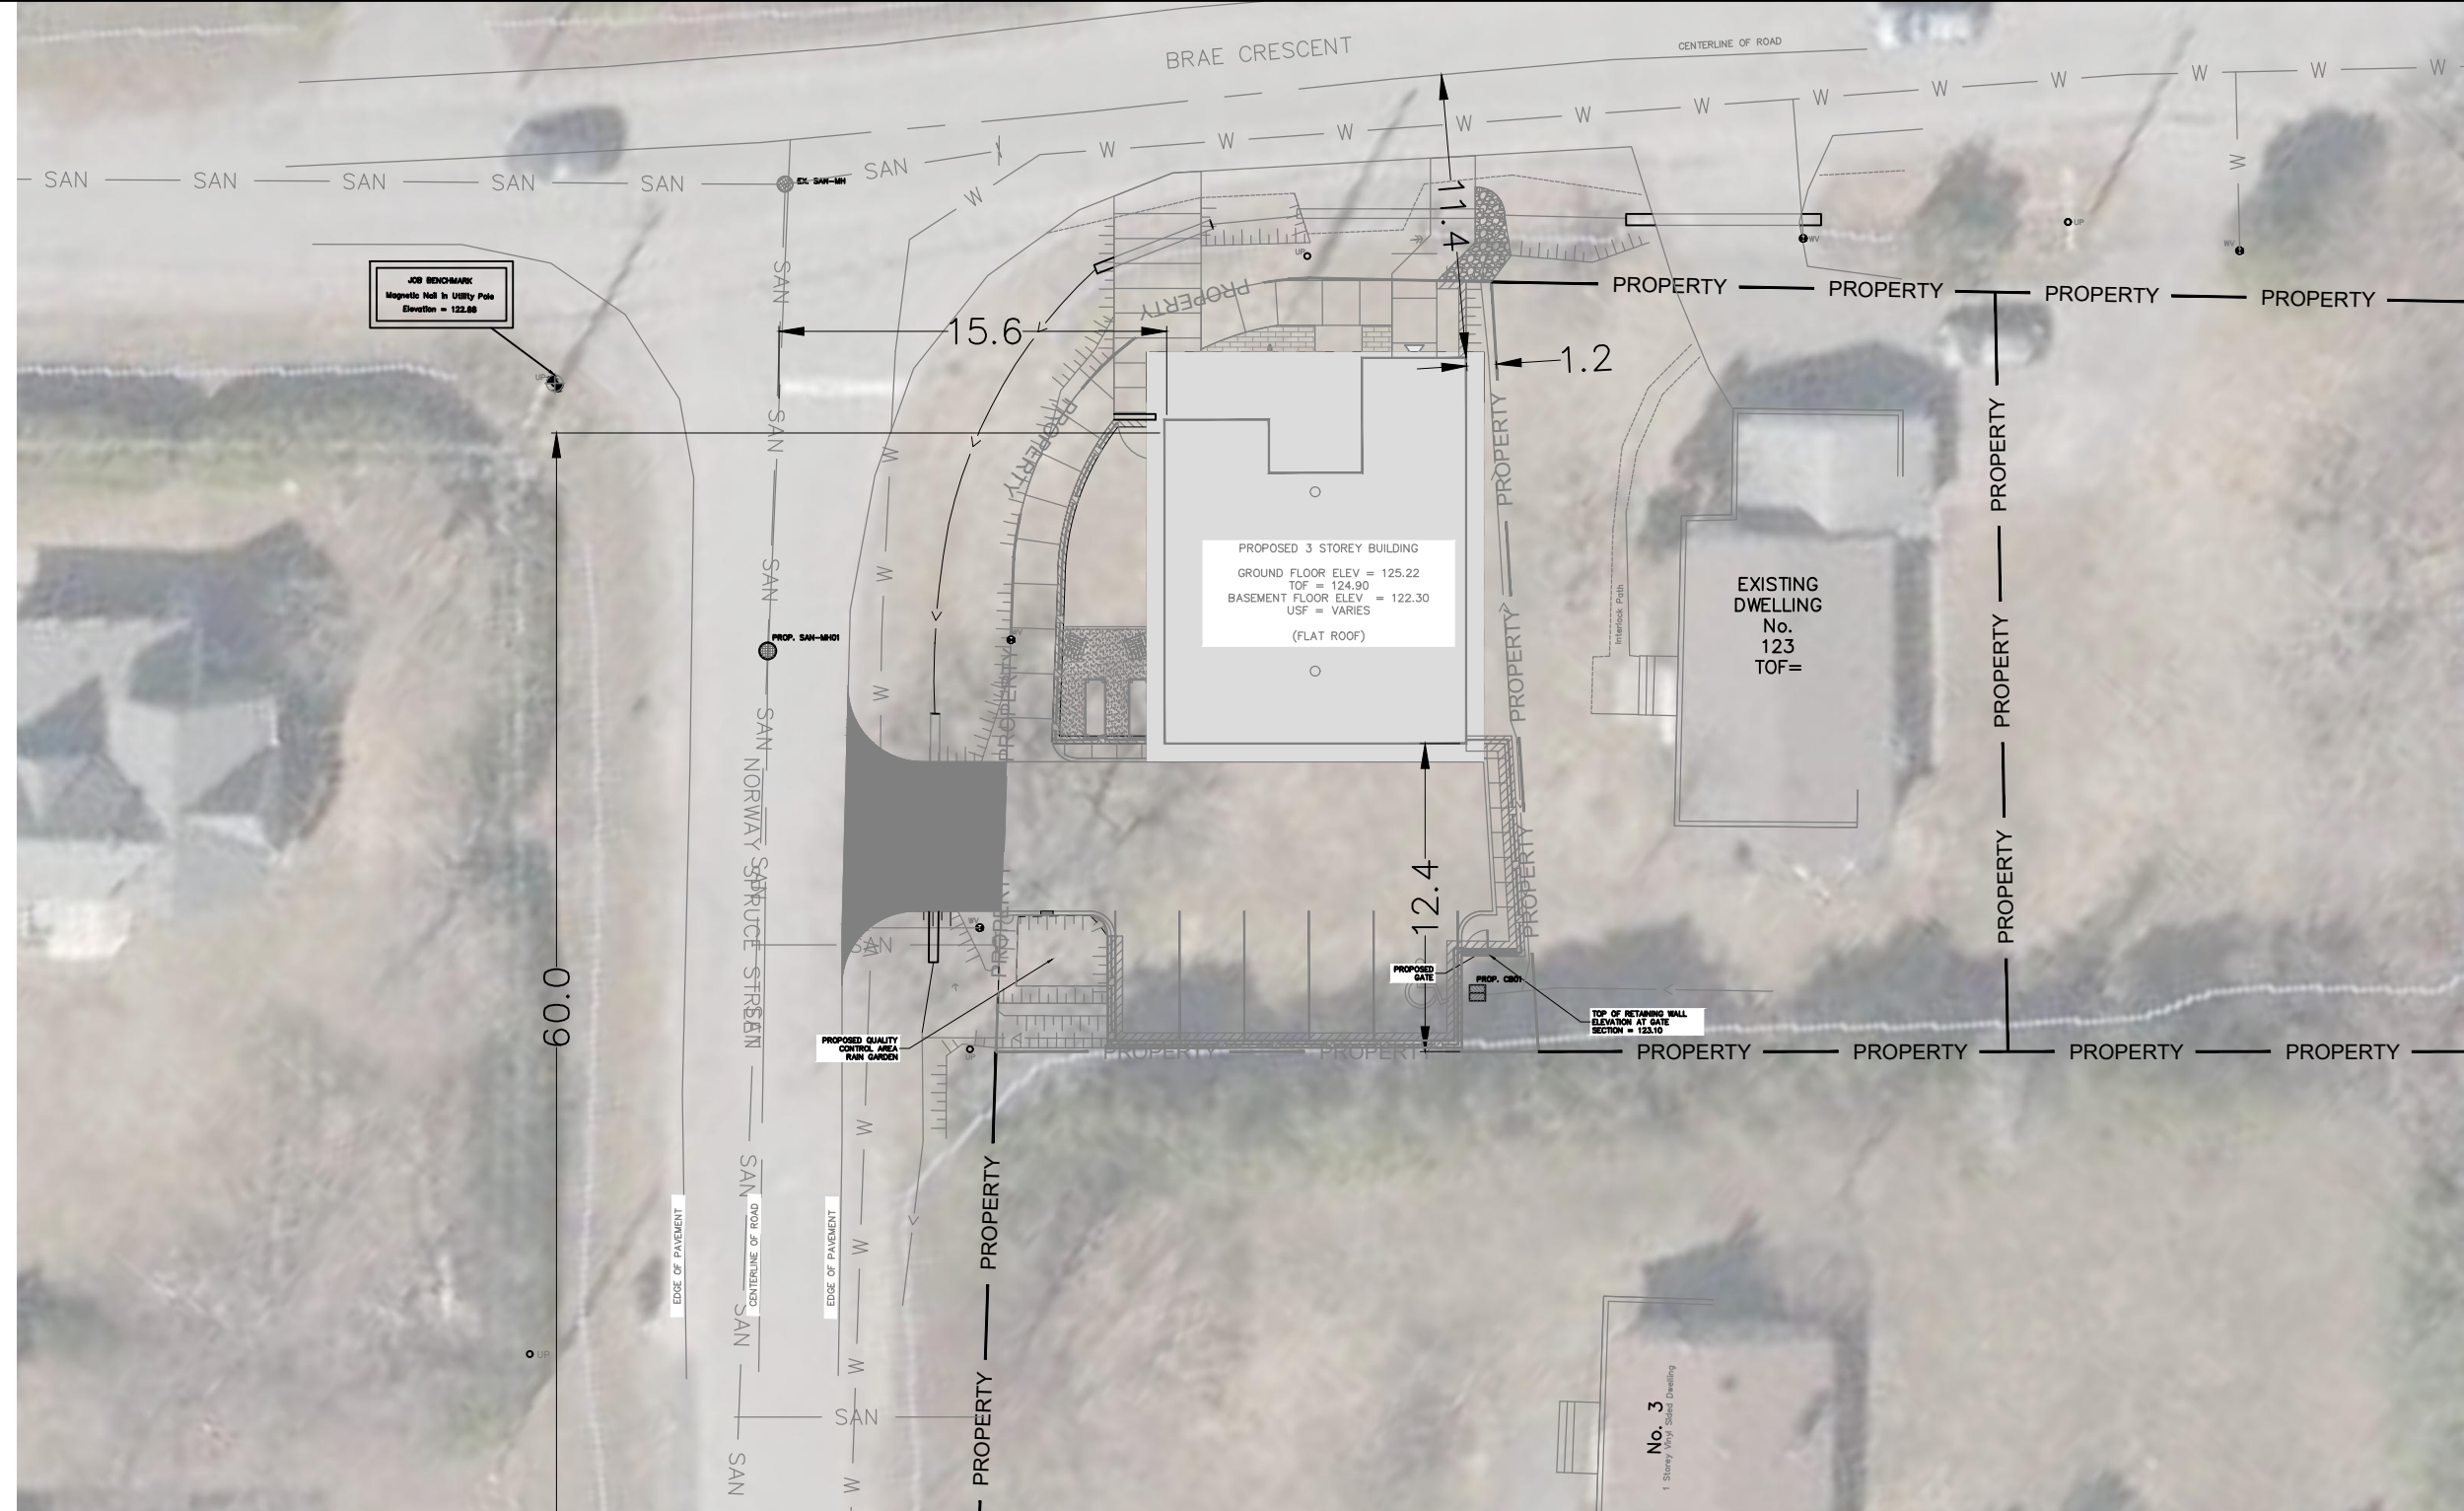

On 2023-04-12 1:56 p.m., Amanda VanBruggen wrote:

From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: April 10, 2023 9:21 AM
To: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Cc: james@kollaard.ca
Subject: Re: 121 Brae Crescent

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hello Shika,

Could you provide us with the boundary conditions for the site based on the following information:

- i) Location of service - see the attached geoOttawa screenshot. The red X denotes the proposed connection location.
- ii) Type of Development - Residential - 5 unit. (fire flow required as per OBC using technical bulletin ISTB 2021-03) : 45L/s
- iii) Average Daily Demand: 0.05L/s
- iv) Maximum Daily Demand: 0.13L/s
- v) Maximum hourly demand: 0.29L/s

Please let us know if you need any more information.

Kind Regards,

Amanda Van Bruggen



Kollaard Associates
Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0
tel: 613-860-0923
www.kollaard.ca

— 121 brae_GeoOttawa.JPG —

The screenshot displays the geoOttawa web application interface. At the top, the search bar contains '121 BRAE CRES'. The map shows an aerial view of a residential area with a red 'X' marking the location of 121 Brae Crescent. The map includes street names such as '152mm 0 - D1', '118th St', '121st St', '122nd St', '123rd St', '124th St', '125th St', '126th St', '127th St', '128th St', '129th St', '130th St', '131st St', '132nd St', '133rd St', '134th St', '135th St', '136th St', '137th St', '138th St', '139th St', '140th St', '141st St', '142nd St', '143rd St', '144th St', '145th St', '146th St', '147th St', '148th St', '149th St', '150th St', '151st St', '152nd St', '153rd St', '154th St', '155th St', '156th St', '157th St', '158th St', '159th St', '160th St', '161st St', '162nd St', '163rd St', '164th St', '165th St', '166th St', '167th St', '168th St', '169th St', '170th St', '171st St', '172nd St', '173rd St', '174th St', '175th St', '176th St', '177th St', '178th St', '179th St', '180th St', '181st St', '182nd St', '183rd St', '184th St', '185th St', '186th St', '187th St', '188th St', '189th St', '190th St', '191st St', '192nd St', '193rd St', '194th St', '195th St', '196th St', '197th St', '198th St', '199th St', '200th St'. A property report overlay is visible on the right side of the map, providing details for the selected parcel.

Property Report

Select a parcel on the map or search for an address to see a report for that property. Zoom in on the map if the property parcels are not visible.

Property Parcel:
Calculated Parcel Area¹: 597.22 m² (6428.42 ft²)
0.06 ha

Main Address:
121 BRAE CRES

Solid Waste Collection:
Waste Contractor: Miller
Zone: 1
Pickup Day/Calendar: WEDNESDAY/A

Garbage and Recycling Collection Calendar

Ward Information
Number: 6
Ward Name: Stittsville
Councillor Name: Glen Gower
[More info about Glen Gower](#)

Print Report
Property aerial photo

Additional Address(es):
1 NORWAY SPRUCE ST

— Attachments: —

121 brae_GeoOttawa.JPG

394 KB

Boundary Conditions 121 Brae Crescent

Provided Information

Scenario	Demand	
	L/min	L/s
Average Daily Demand	3	0.05
Maximum Daily Demand	8	0.13
Peak Hour	17	0.29
Fire Flow Demand #1	2,700	45.00

Location



Results

Connection 1 –Brae Crescent

Demand Scenario	Head (m)	Pressure ¹ (psi)
Maximum HGL	160.2	53.5
Peak Hour	155.6	46.9
Max Day plus Fire Flow	155.4	46.6

¹ Ground Elevation = 122.6 m

Disclaimer

The boundary condition information is based on current operation of the city water distribution system. The computer model simulation is based on the best information available at the time. The operation of the water distribution system can change on a regular basis, resulting in a variation in boundary conditions. The physical properties of watermains deteriorate over time, as such must be assumed in the absence of actual field test data. The variation in physical watermain properties can therefore alter the results of the computer model simulation. Fire Flow analysis is a reflection of available flow in the watermain; there may be additional restrictions that occur between the watermain and the hydrant that the model cannot take into account.

Subject: RE: 121 Brae Crescent
From: "Rathnasooriya, Shika" <Thakshika.Rathnasooriya@ottawa.ca>
Date: 2023-04-27, 9:57 a.m.
To: "amanda@kollaard.ca" <amanda@kollaard.ca>

Hi Amanda,

The BC is still valid since a 152 mm watermain is located on Norway Spruce and Brae Crescent.

Thanks,
Shika

From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: April 21, 2023 9:56 AM
To: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Subject: Re: 121 Brae Crescent

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.

ATTENTION : Ce courriel provient d'un expéditeur externe. Ne cliquez sur aucun lien et n'ouvrez pas de pièce jointe, excepté si vous connaissez l'expéditeur.

Hello Shika,

You had provided me with boundary conditions last week.

I just noticed that you have the proposed connection on Brae.

Please see the attached picture. The X denotes the proposed connection location on Norway Spruce.

Could you provide us with revised boundary conditions.

Many Thanks,

Amanda Van Bruggen



Kollaard Associates
Engineers

210 Prescott Street, Unit 1
P.O. Box 189
Kemptville, Ontario
K0G 1J0
tel: 613-860-0923
www.kollaard.ca

On 2023-04-14 8:48 a.m., Rathnasooriya, Shika wrote:

Hi Amanda,

Plas find boundary conditions attached.

Thanks,
Shika



From: Amanda VanBruggen <amanda@kollaard.ca>
Sent: April 12, 2023 1:56 PM
To: Rathnasooriya, Shika <Thakshika.Rathnasooriya@ottawa.ca>
Subject: Re: 121 Brae Crescent

CAUTION: This email originated from an External Sender. Please do not click links or open attachments unless you recognize the source.



Appendix G: Drawings

- 220338– PRE – Pre-Development Water Flows
- 220338 – POST – Controlled and Uncontrolled Areas
- 220338 – UPPER ROOF – Upper Roof Stormwater Plan
- 220338 – LOWER ROOF – Lower Roof Stormwater Plan
- 220338 – GR – Grading & Drainage Plan
- 220338 – SER – Site Servicing Plan
- 220338 – DETAILS – Site Servicing Details
- 220338 – RR – Roadway Reinstatement Plan
- 220338 – ESC – Erosion & Sediment Control Plan

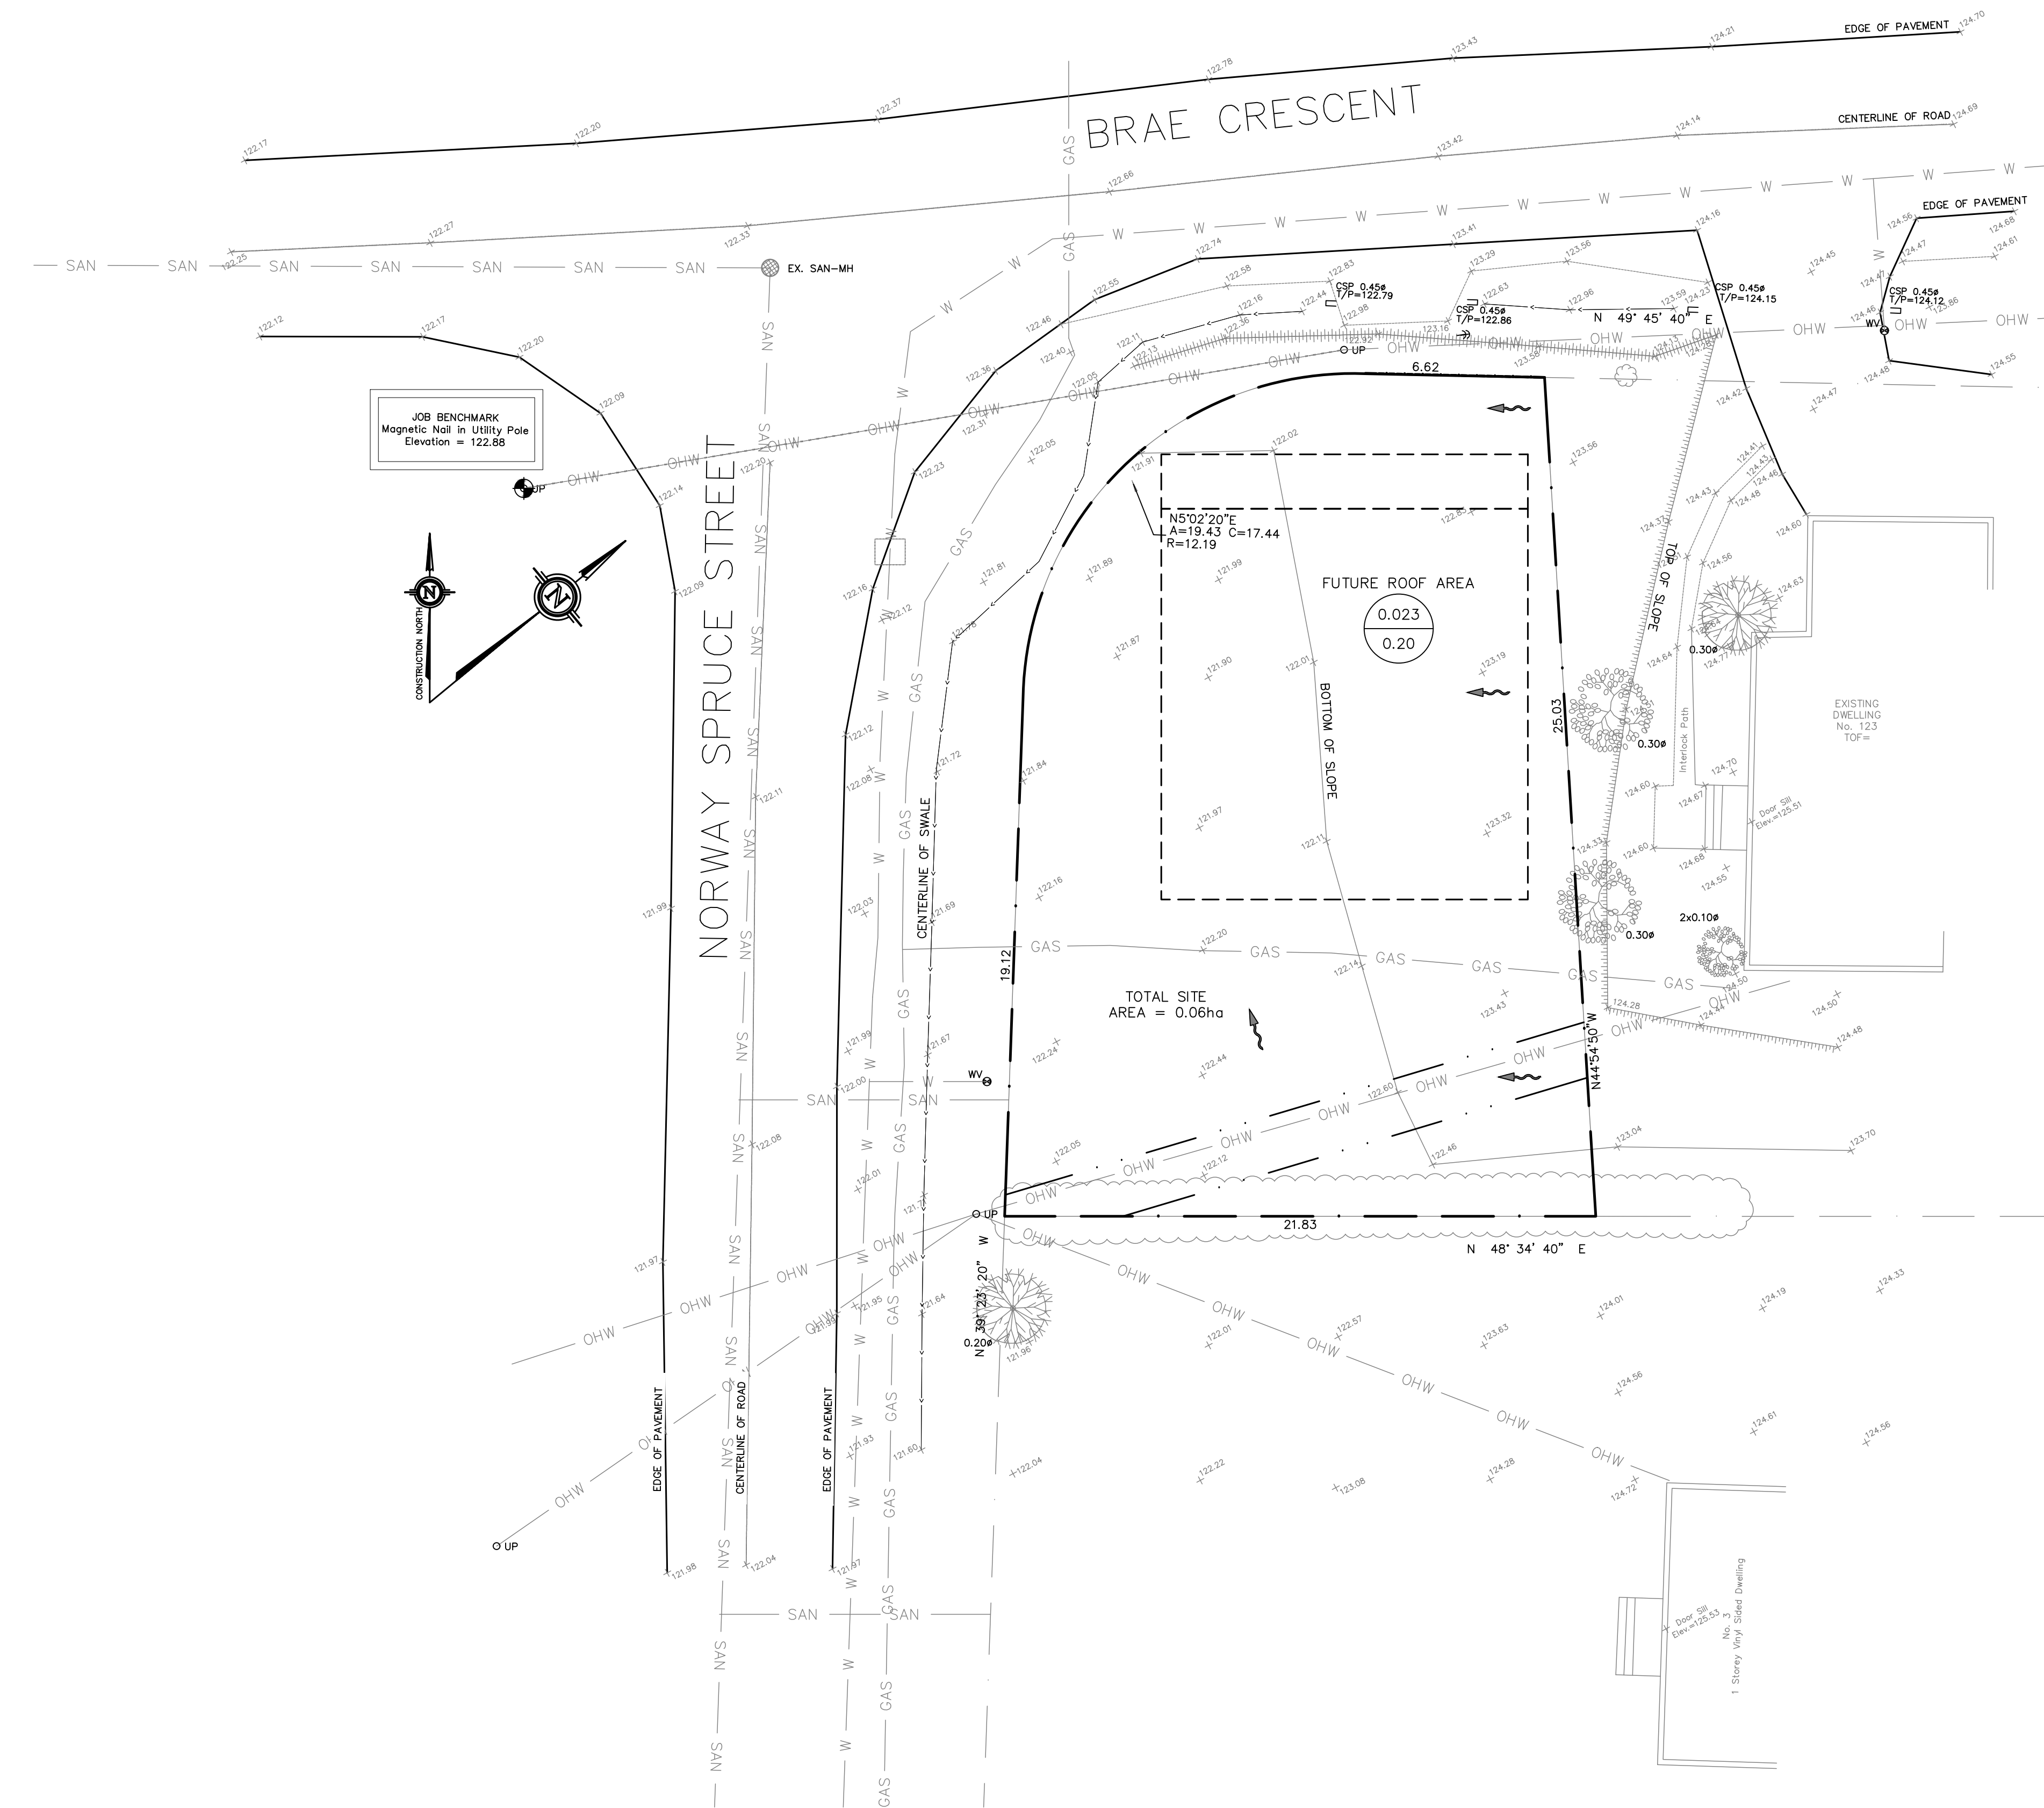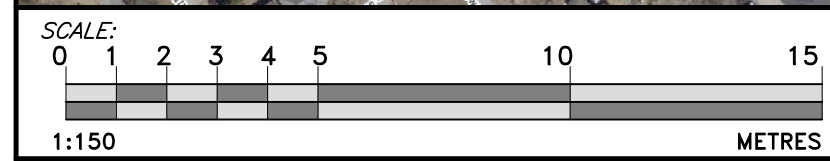

LEGEND (STORM WATER MANAGEMENT)

	CONTROLLED CATCHMENT LABEL
	CATCHMENT AREA (HECTARES)
	5 YEAR RUNOFF COEFFICIENT
	CATCHMENT AREA BOUNDARY
	DIRECTION OF FLOW
	PROPERTY LINE
	TOP OF SLOPE
	(QUANTITY) CONTROLLED AREA
	(QUANTITY) UNCONTROLLED AREA
	QUALITY CONTROLLED AREA
	PRE-DEVELOPMENT DRAINAGE PATTERN
	POST-DEVELOPMENT OVERLAND FLOW

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
 (613) 860-0923
 info@kollaard.ca
 P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca

CLIENT:
 BRYDEN GIBSON

PROJECT:
 PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
 121 BRAE CRESCENT, STITTSVILLE, ON, K2S 1P1


DESIGNED BY: ---	CHECKED BY: ---
DRAWN BY: JR	APPROVED BY: ---
DATE: MAY 12, 2023	
KOLLAARD FILE NUMBER: 220338	

DRAWING NUMBER:
 220338-PRE

DRAWING NAME:
 PRE-DEVELOPMENT DRAINAGE

PRE-DEVELOPMENT DRAWING
 SCALE = 1:150

DRAWING NUMBER: 220338-POST

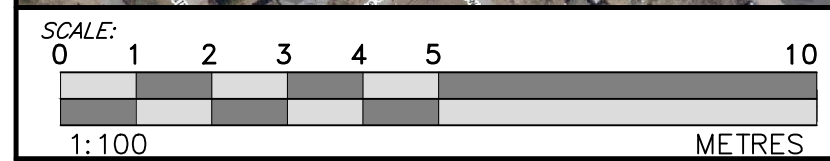

LEGEND (STORM WATER MANAGEMENT)

	CATCHMENT LABEL
	CATCHMENT AREA (HECTARES)
	5 YEAR RUNOFF COEFFICIENT
	CATCHMENT AREA BOUNDARY
	DIRECTION OF FLOW
	PROPERTY LINE
	TOP OF SLOPE
	(QUANTITY) CONTROLLED AREA
	(QUANTITY) UNCONTROLLED AREA
	QUALITY CONTROLLED AREA
	PRE-DEVELOPMENT DRAINAGE PATTERN
	POST-DEVELOPMENT OVERLAND FLOW

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates
Engineers
 (613) 860-0923
 info@kollaard.ca
 P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca

CLIENT:
 BRYDEN GIBSON

PROJECT:
 PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT


LOCATION:
 121 BREA CRESCENT, STITTSVILLE,
 ON, K2S 1P1

DESIGNED BY: SD	CHECKED BY: SD
DRAWN BY: JR	APPROVED BY: SD
DATE: MAY 12, 2023	
KOLLAARD FILE NUMBER: 220338	


DRAWING NUMBER: 220338-POST


DRAWING NAME: POST-DEVELOPMENT DRAINAGE

© COPYRIGHT 2024
 KOLLAARD ASSOCIATES INCORPORATED

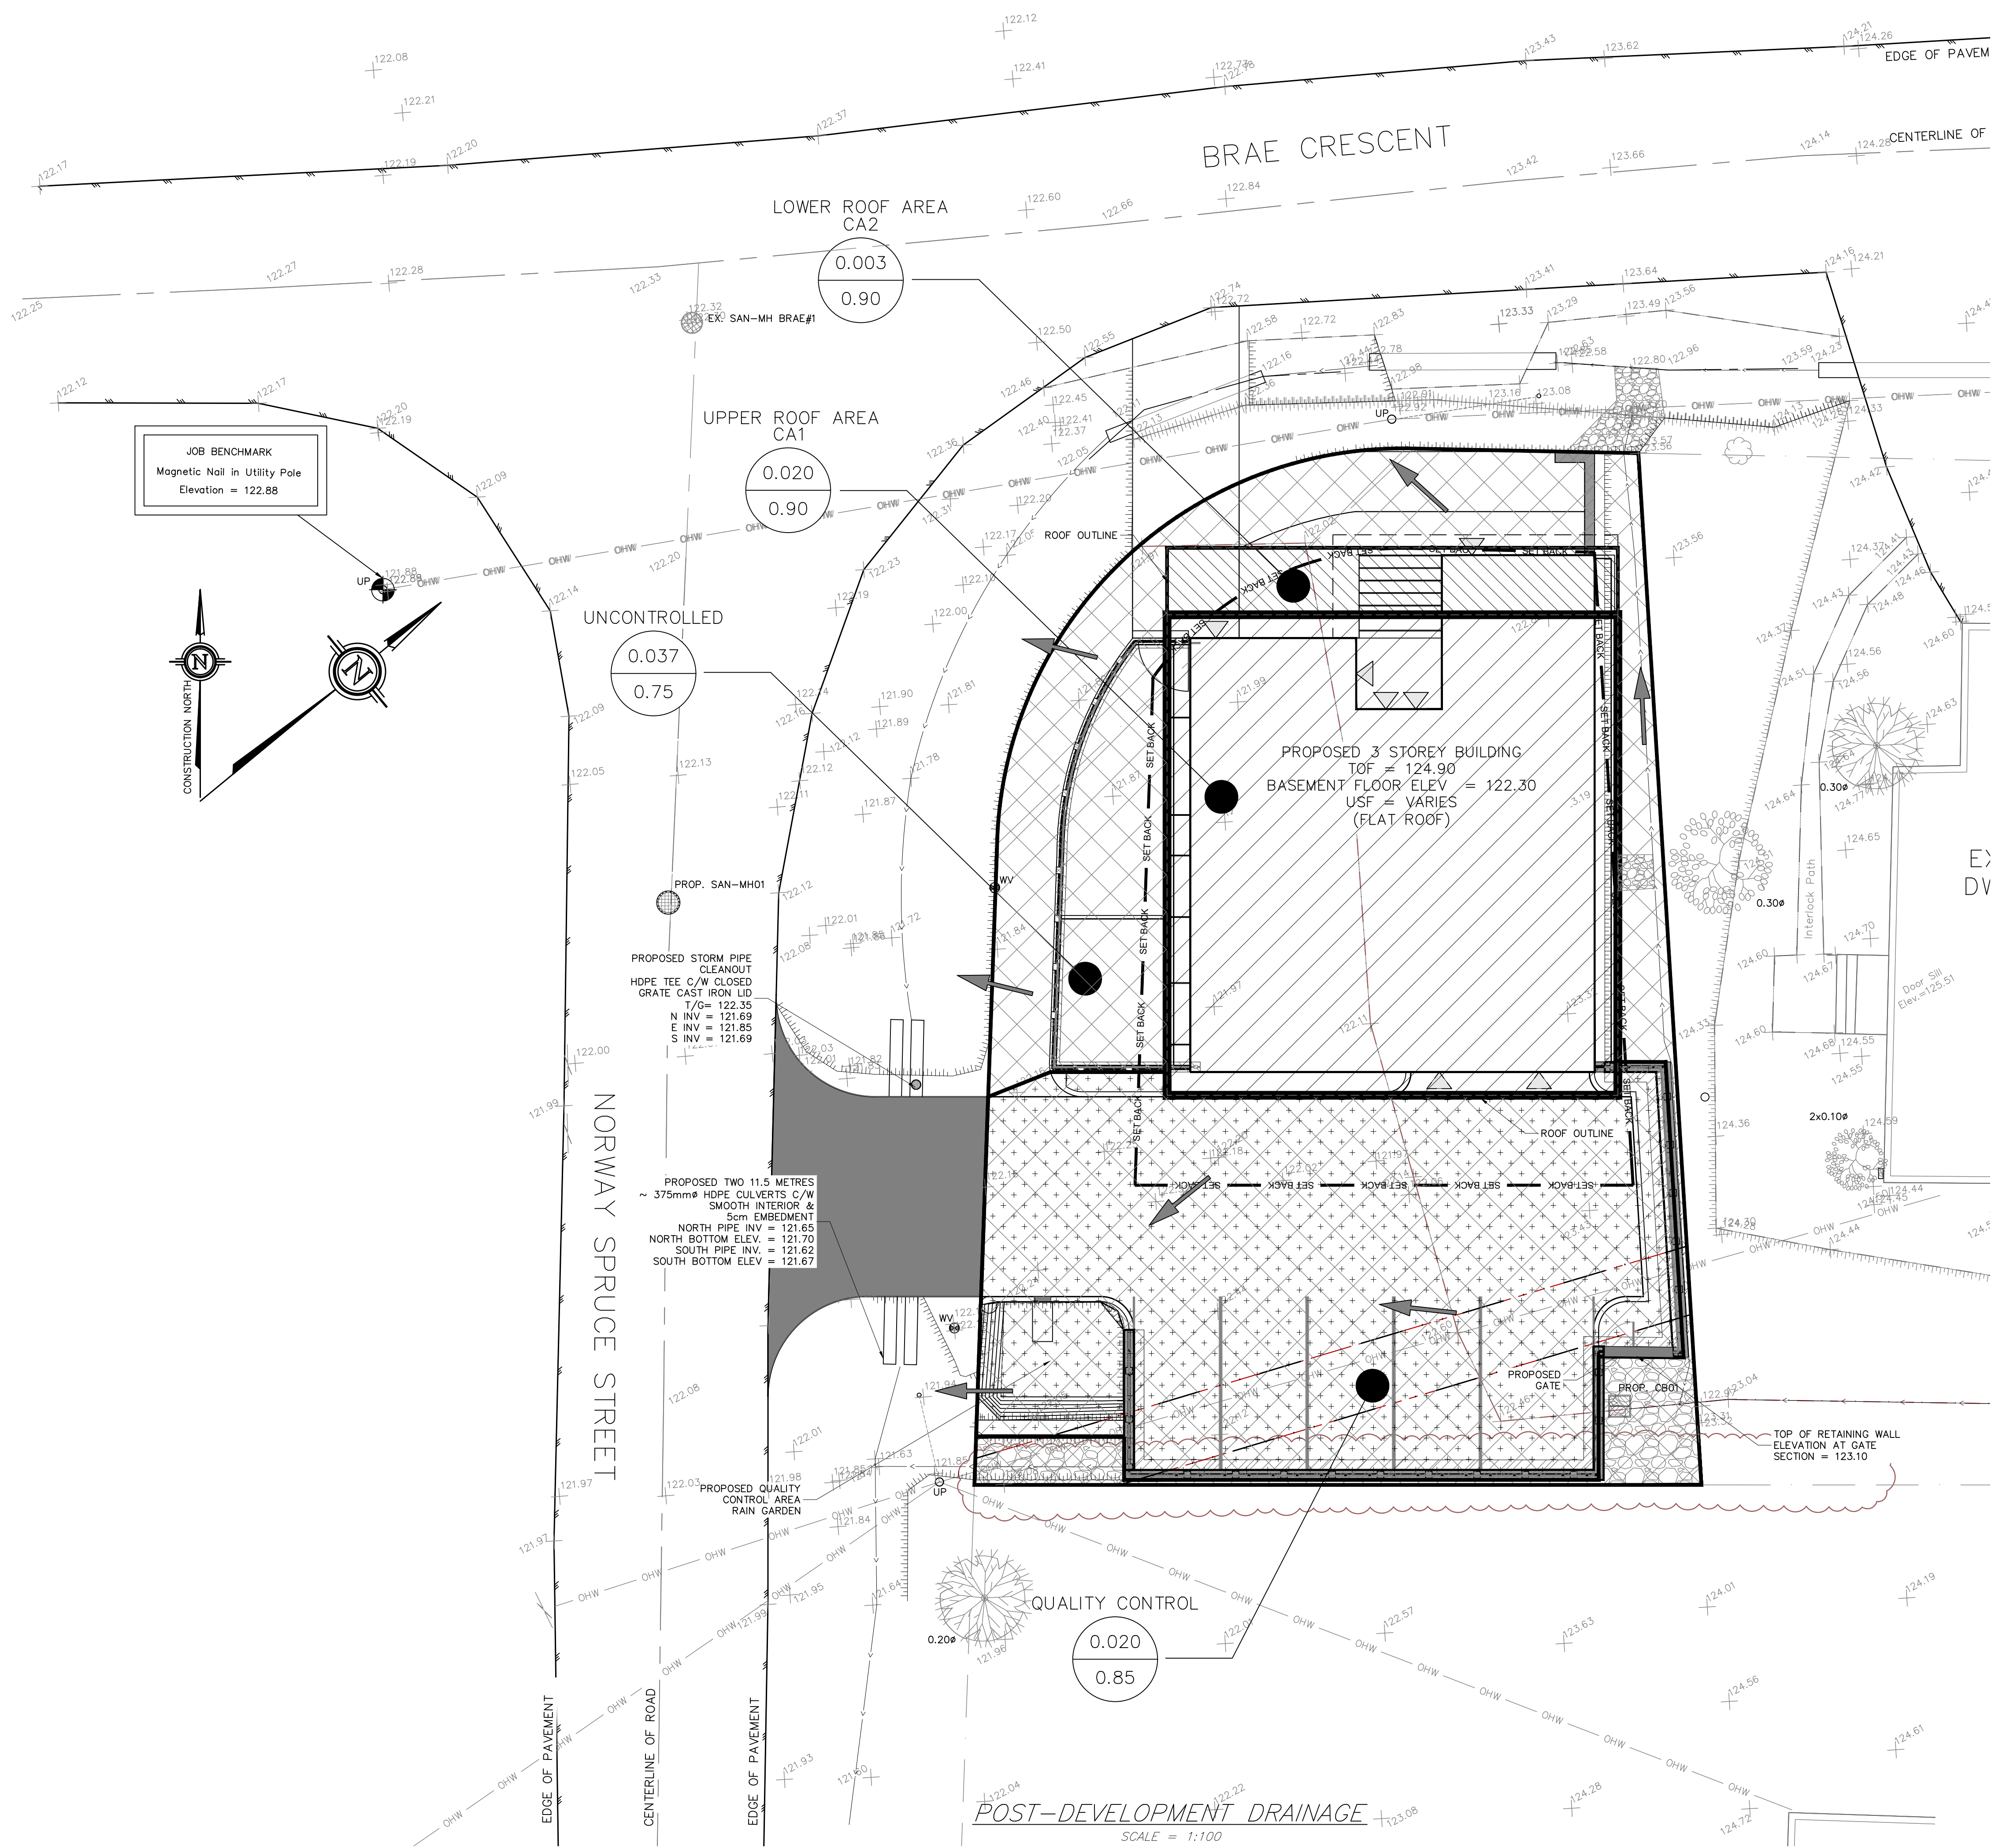

JOB BENCHMARK
 Magnetic Nail in Utility Pole
 Elevation = 122.88

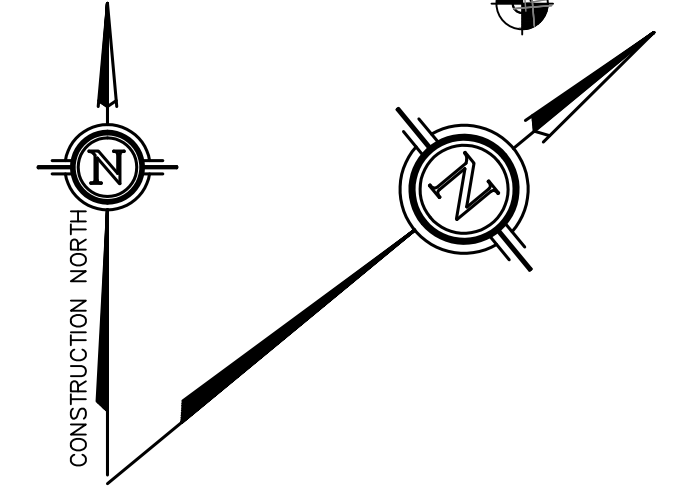

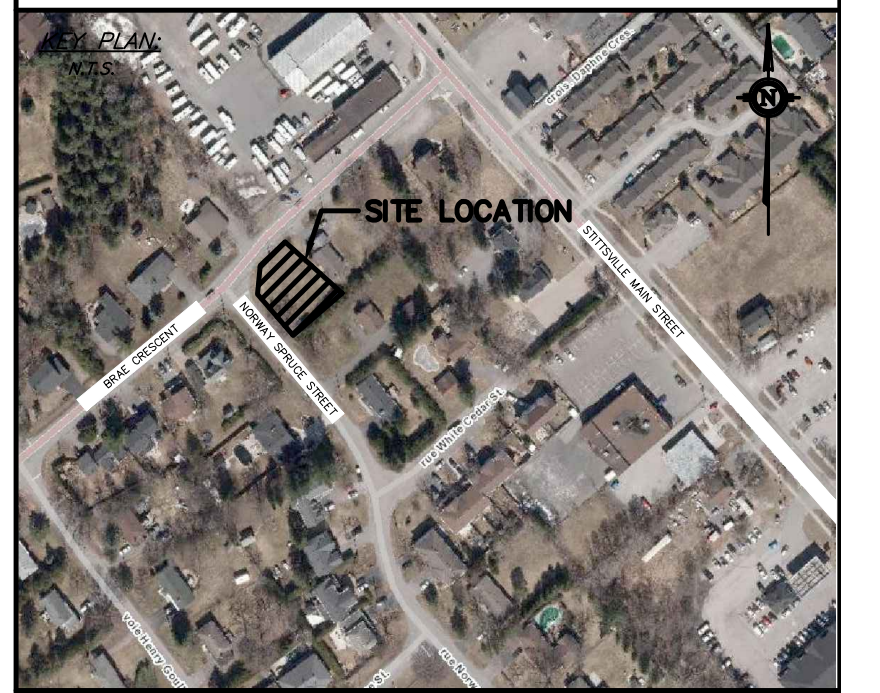

SCALE:

GENERAL NOTES:

- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.85.
- This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Annis, O'Sullivan, Vollebek Ltd. April 25, 2022.
- Contractor is responsible for location and protection of utilities.
- All dimensions to be verified on site by contractor prior to construction.
- Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
- Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
- The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
- The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
- A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
- The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
- Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
- Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
- All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
- This drawing is part of Kollaard Associates design report # 220338.

ROOF DRAIN DETAILS (LOWER ROOF)

- MODELL TYPE: WATTS MODEL "ADJUSTABLE ACCUTROL ONE SLOT WEIR" FOR LARGE ROOF DRAINS. CLOSED WEIR SETTING TO PERMIT THE RELEASE RATE OF 5gpm OR 0.32L/s PER DRAIN. UNDER A HEAD OF 150mm.
- NUMBER OF CONTROL DEVICES FOR TOTAL ROOF AREA: 1
- TOTAL RELEASE FROM ROOF AT MAXIMUM HEAD OF 150mm WITH (1) ONE DRAIN IS 5.0gpm or 0.32L/s.
- 5 YEAR ELEVATION: 50mm ABOVE THE ROOF DRAIN. 100 YEAR ELEVATION 70mm ABOVE THE ROOF DRAIN.
- ROOF PITCH IS ASSUMED TO HAVE 2% MINIMUM FOR MODIFIED BITUMINOUS MEMBRANE.
- THIS DRAWING IS PART OF KOLLAARD ASSOCIATES REPORT #220338.
- PROPOSED ROOF DRAINS AND SCUPPER LOCATIONS SHALL BE REVIEWED BY THE MECHANICAL AND STRUCTURAL BUILDING DESIGNERS.
- THE OWNER'S MECHANICAL AND STRUCTURAL ENGINEERS SHALL ENSURE THAT THE ADDITIONAL STORMWATER STORAGE VOLUME FROM STORMWATER MANAGEMENT MEASURES ARE ACCOUNTED FOR IN THE STRUCTURAL DESIGN OF THE WATERPROOFING OF THE ROOF AREA AND ANY OF THE SUPPORTING STRUCTURES THAT MAY BE AFFECTED BY THE STORED WATER.
- ROOF DRAINS SHALL OUTLET TO THE ROADSIDE DITCH ON NORWAY SPRUCE STREET AS SHOWN IN THE SERVICING PLAN 220338-SER.

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
 (613) 860-0923
 info@kollaard.ca

P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca

CLIENT:
 BRYDEN GIBSON


PROJECT:
 PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
 121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1


DESIGNED BY: SD
 CHECKED BY: SD
 DRAWN BY: JR
 APPROVED BY: --
 DATE: MAY 12, 2023
 KOLLAARD FILE NUMBER: 220338

DRAWING NUMBER:
 220338-LOWER ROOF

DRAWING NAME:
 LOWER ROOF STM PLAN

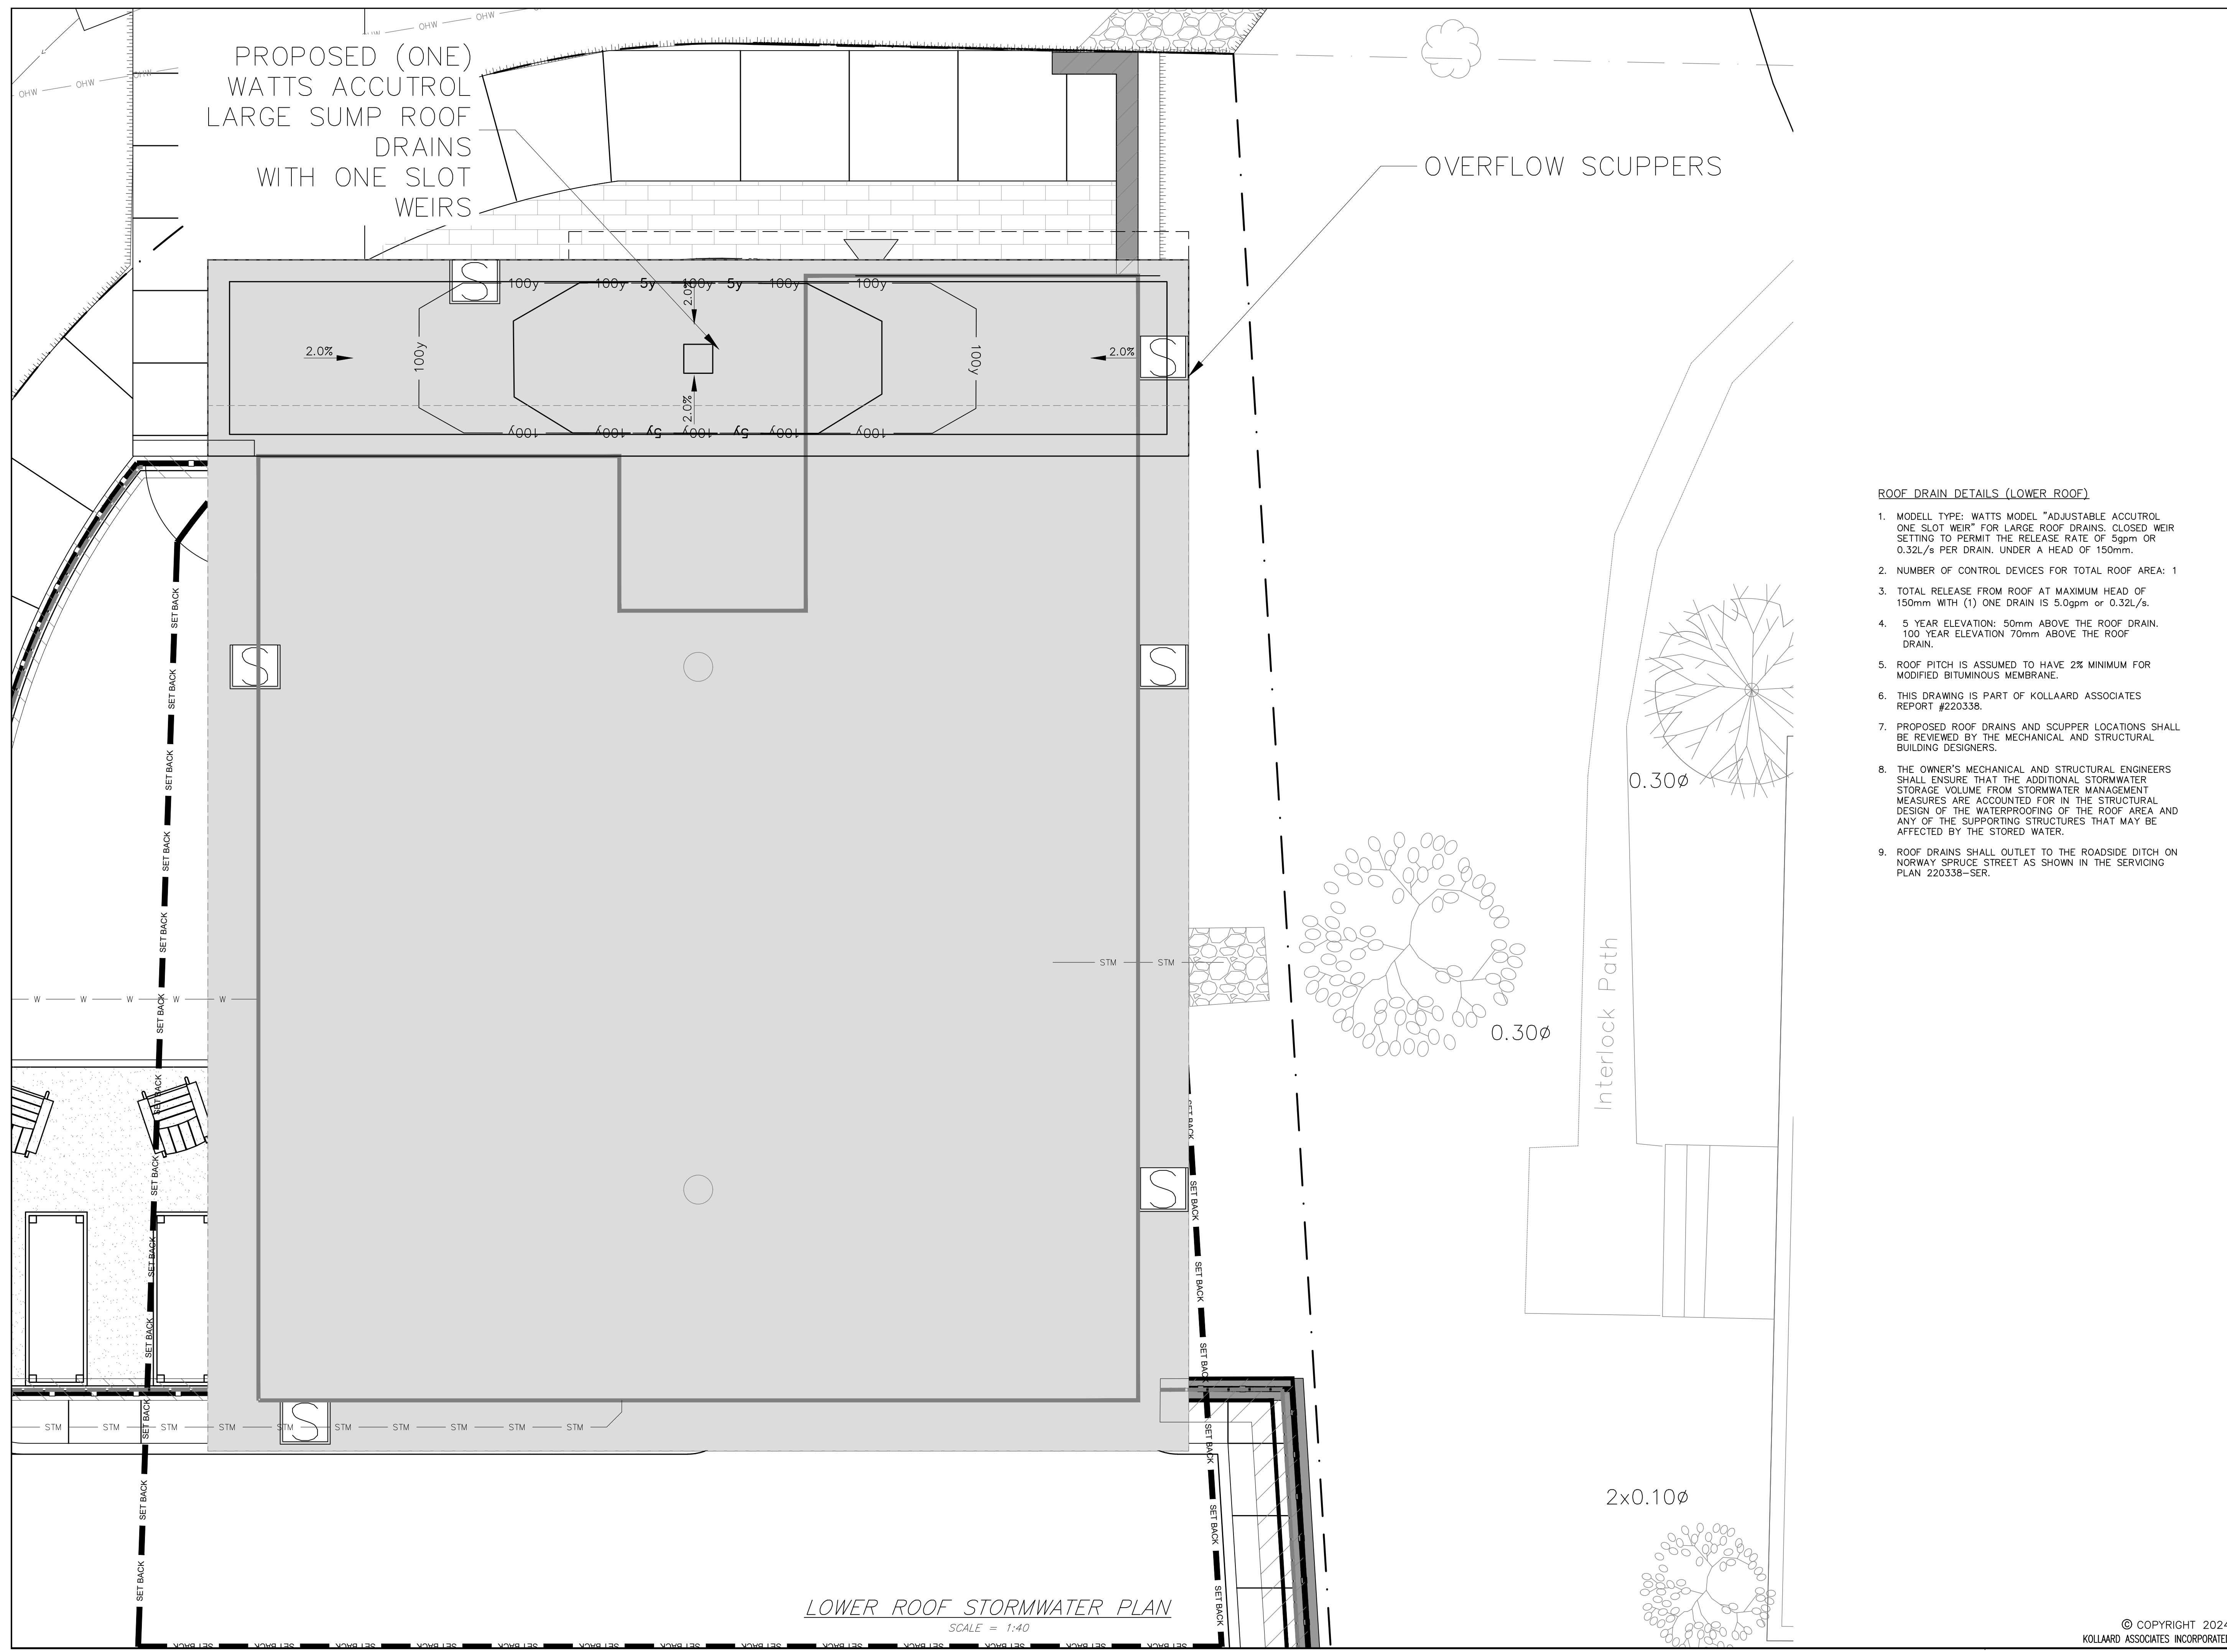

LOWER ROOF STORMWATER PLAN
 SCALE = 1:40

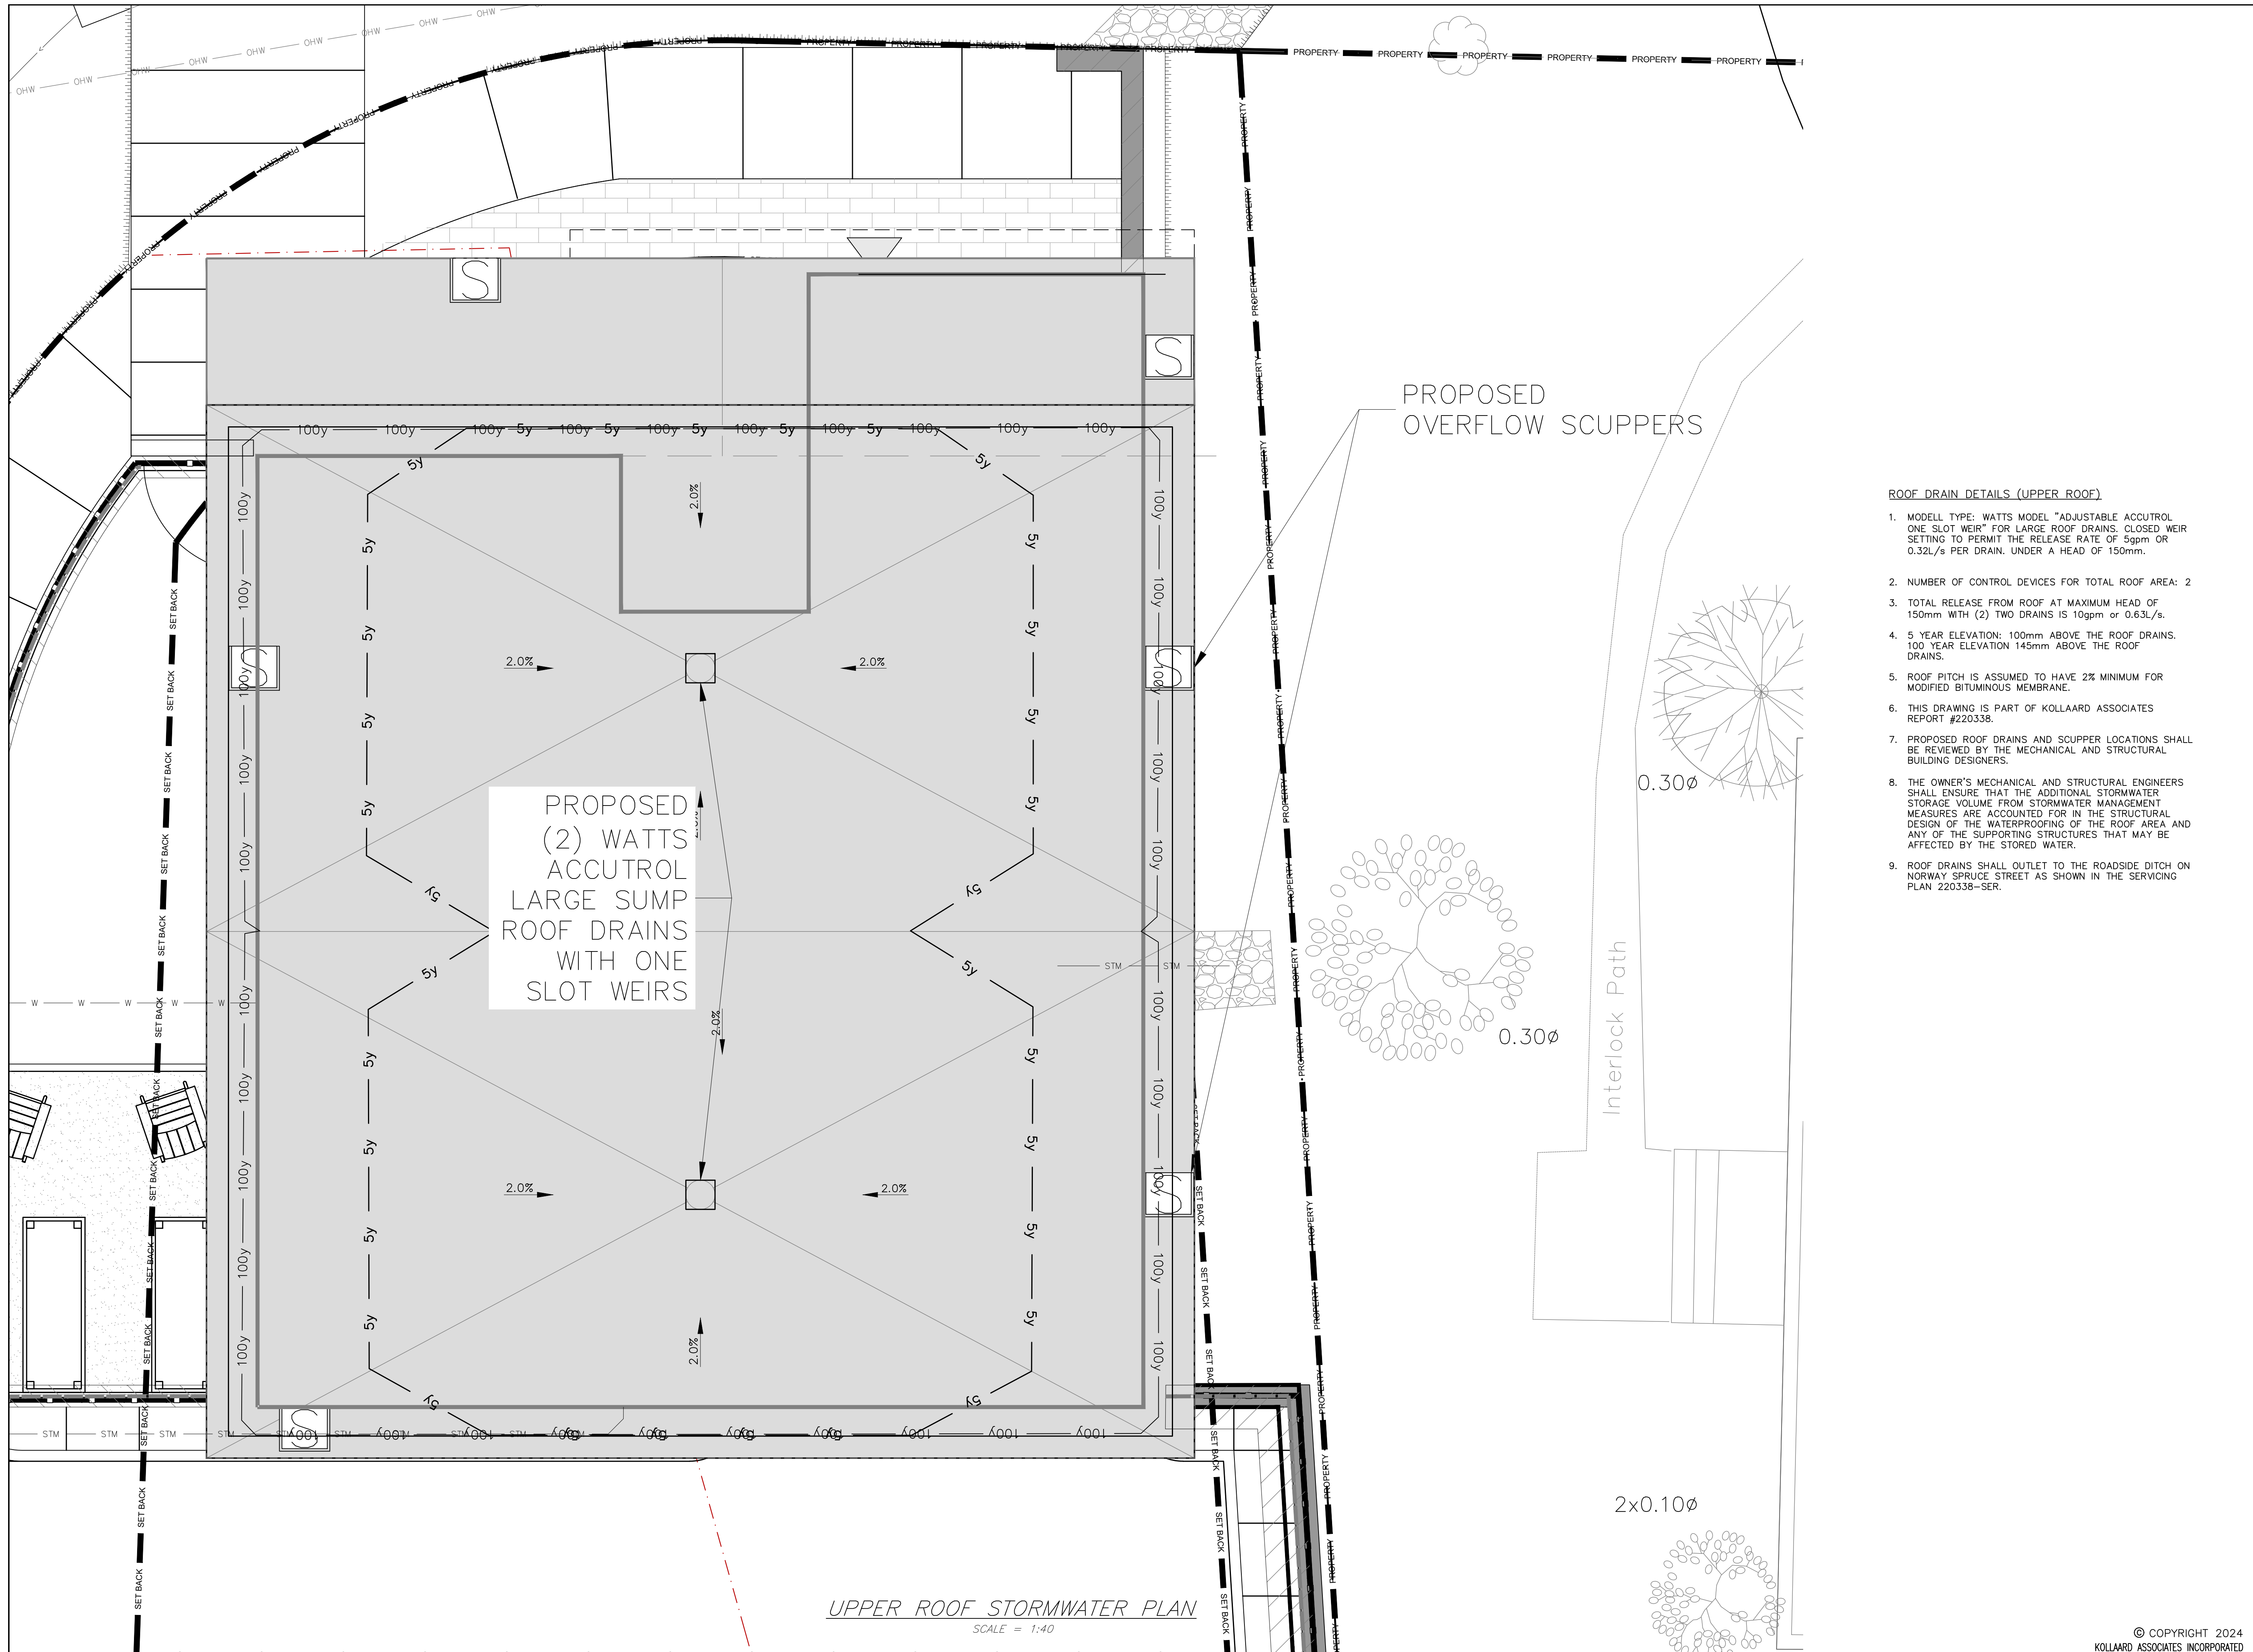

UPPER ROOF STORMWATER PLAN
SCALE = 1:40

DRAWING NUMBER:
220338-UPPER ROOF



SCALE:

GENERAL NOTES:

- All dimensions are in metres; all elevations are in metres and are geodetic. TBM Nail in utility pole. Elevation= 122.85.
- This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Annis, O'Sullivan, Vollebek Ltd. April 25, 2022.
- Contractor is responsible for location and protection of utilities.
- All dimensions to be verified on site by contractor prior to construction.
- Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
- Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
- The proposed grades have been set and verified for site grading control only. The grade raise of the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
- The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
- A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
- The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
- Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
- Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
- All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
- This drawing is part of Kollaard Associates design report # 220338.

ROOF DRAIN DETAILS (UPPER ROOF)

- MODELL TYPE: WATTS MODEL "ADJUSTABLE ACCUTROL ONE SLOT WEIR" FOR LARGE ROOF DRAINS. CLOSED WEIR SETTING TO PERMIT THE RELEASE RATE OF 5gpm OR 0.32L/s PER DRAIN. UNDER A HEAD OF 150mm.
- NUMBER OF CONTROL DEVICES FOR TOTAL ROOF AREA: 2
- TOTAL RELEASE FROM ROOF AT MAXIMUM HEAD OF 150mm WITH (2) TWO DRAINS IS 10gpm or 0.63L/s.
- 5 YEAR ELEVATION: 100mm ABOVE THE ROOF DRAINS. 100 YEAR ELEVATION 145mm ABOVE THE ROOF DRAINS.
- ROOF PITCH IS ASSUMED TO HAVE 2% MINIMUM FOR MODIFIED BITUMINOUS MEMBRANE.
- THIS DRAWING IS PART OF KOLLAARD ASSOCIATES REPORT #220338.
- PROPOSED ROOF DRAINS AND SCUPPER LOCATIONS SHALL BE REVIEWED BY THE MECHANICAL AND STRUCTURAL BUILDING DESIGNERS.
- THE OWNER'S MECHANICAL AND STRUCTURAL ENGINEERS SHALL ENSURE THAT THE ADDITIONAL STORMWATER STORAGE VOLUME FROM STORMWATER MANAGEMENT MEASURES ARE ACCOUNTED FOR IN THE STRUCTURAL DESIGN OF THE WATERPROOFING OF THE ROOF AREA AND ANY OF THE SUPPORTING STRUCTURES THAT MAY BE AFFECTED BY THE STORED WATER.
- ROOF DRAINS SHALL OUTLET TO THE ROADSIDE DITCH ON NORWAY SPRUCE STREET AS SHOWN IN THE SERVICING PLAN 220338-SER.

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates
Engineers
(613) 860-0923
info@kollaard.ca

P.O. BOX 189, 210 PRESCOTT ST.
KEMPTVILLE, ONTARIO
K0G 1J0 FAX (613) 258-0475
http://www.kollaard.ca

CLIENT:
BRYDEN GIBSON


PROJECT:
PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1

	DESIGNED BY: SD	CHECKED BY: SD
	DRAWN BY: JR	APPROVED BY: SD
DATE: MAY 12, 2023		KOLLAARD FILE NUMBER: 220338

DRAWING NUMBER:
220338-UPPER ROOF

DRAWING NAME:
UPPER ROOF STM PLAN

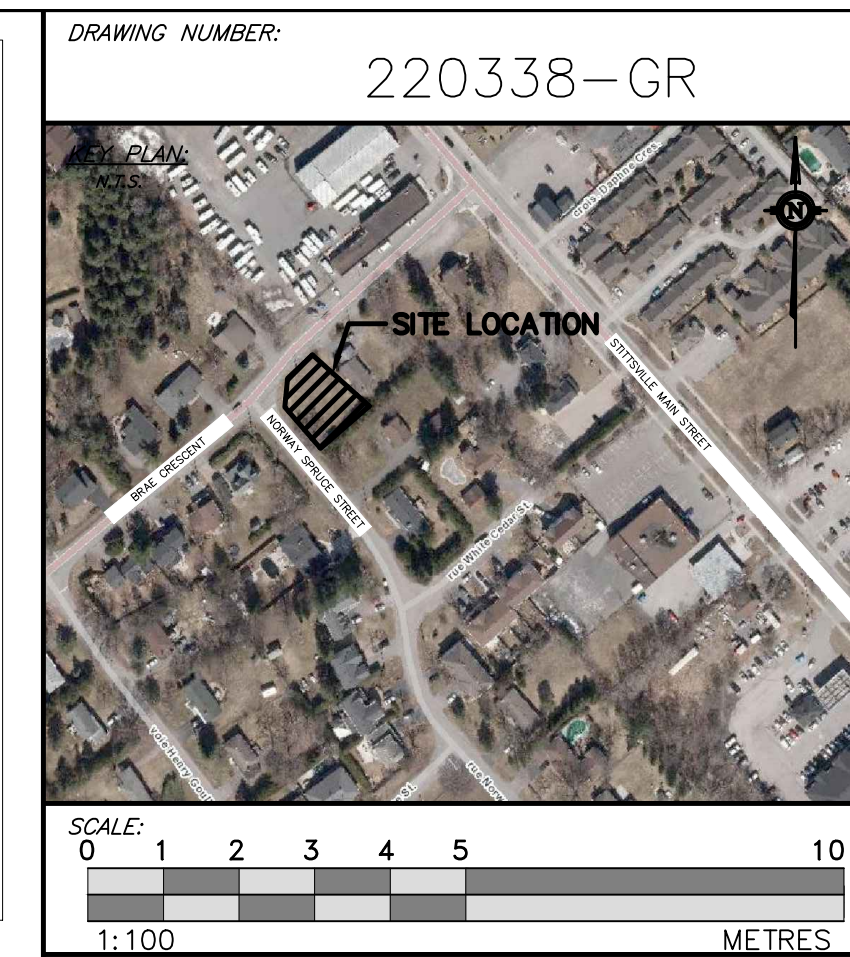


SCALE: 0 1 2 3 4 5 10 METRES
1:100

GENERAL NOTES:


- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.88
- This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Arnis, O'Sullivan, Volebek Ltd. April 25, 2022.
- Contractor is responsible for location and protection of utilities.
- All dimensions to be verified on site by contractor prior to construction.
- Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
- Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
- The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
- The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
- A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
- The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
- Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
- Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
- All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
- This drawing is part of Kollaard Associates design report # 220338.

GENERAL LEGEND


EXISTING ELEVATION	EXISTING HYDRO POLE
PROPOSED/EXISTING ELEVATIONS	EXISTING HYDRO GUY WIRE ANCHOR
PROPOSED CURB ELEVATION	EXISTING FIRE HYDRANT
PROPOSED TOP OF GRATE ELEVATION	EXISTING WATER VALVE
PROPOSED CATCH BASIN TOP OF GRATE ELEVATION	PROPOSED WATER VALVE
PROPOSED SIDEWALK ELEVATION	EXISTING STORM MANHOLE
PROPOSED TOP OF RETAINING WALL ELEVATION	EX. SAN-MH
PROPOSED BOTTOM OF RETAINING WALL ELEVATION	EXISTING SANITARY MANHOLE
PROPOSED ELEVATION	EX. VC
WATERMAIN	EXISTING VALVE CHAMBER
STORM SEWER	EX. CB
SANITARY SEWER	EXISTING CURB INLET CATCH BASIN
CENTERLINE OF ROAD	EX. CB
EDGE OF ROAD	EXISTING CATCH BASIN
TOP OF SLOPE	PROP. CB-MH
PROPERTY LINE	PROPOSED CATCH BASIN/MANHOLE
GAS LINE	PROP. CB
OVERHEAD WIRE	PROPOSED STORM MANHOLE
	PROP. SAN-MH
	PROPOSED SANITARY MANHOLE
	TEMPORARY BENCHMARK
	BUILDING ENTRANCE LOCATION
	STREET SIGN
	SILT FENCE

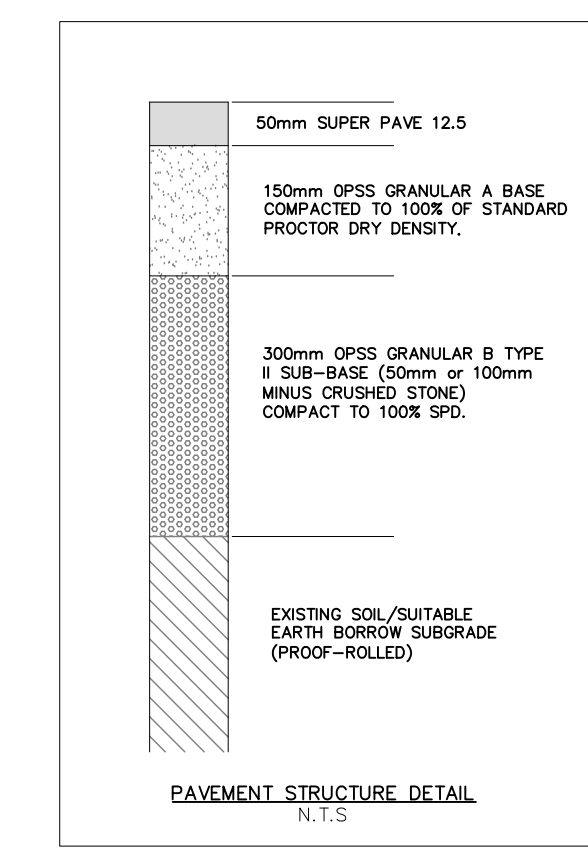

PAVEMENT STRUCTURE DETAIL N.T.S.

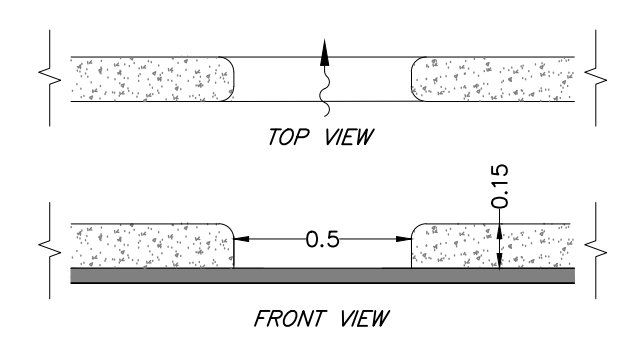

PROPOSED CURB CUT N.T.S.

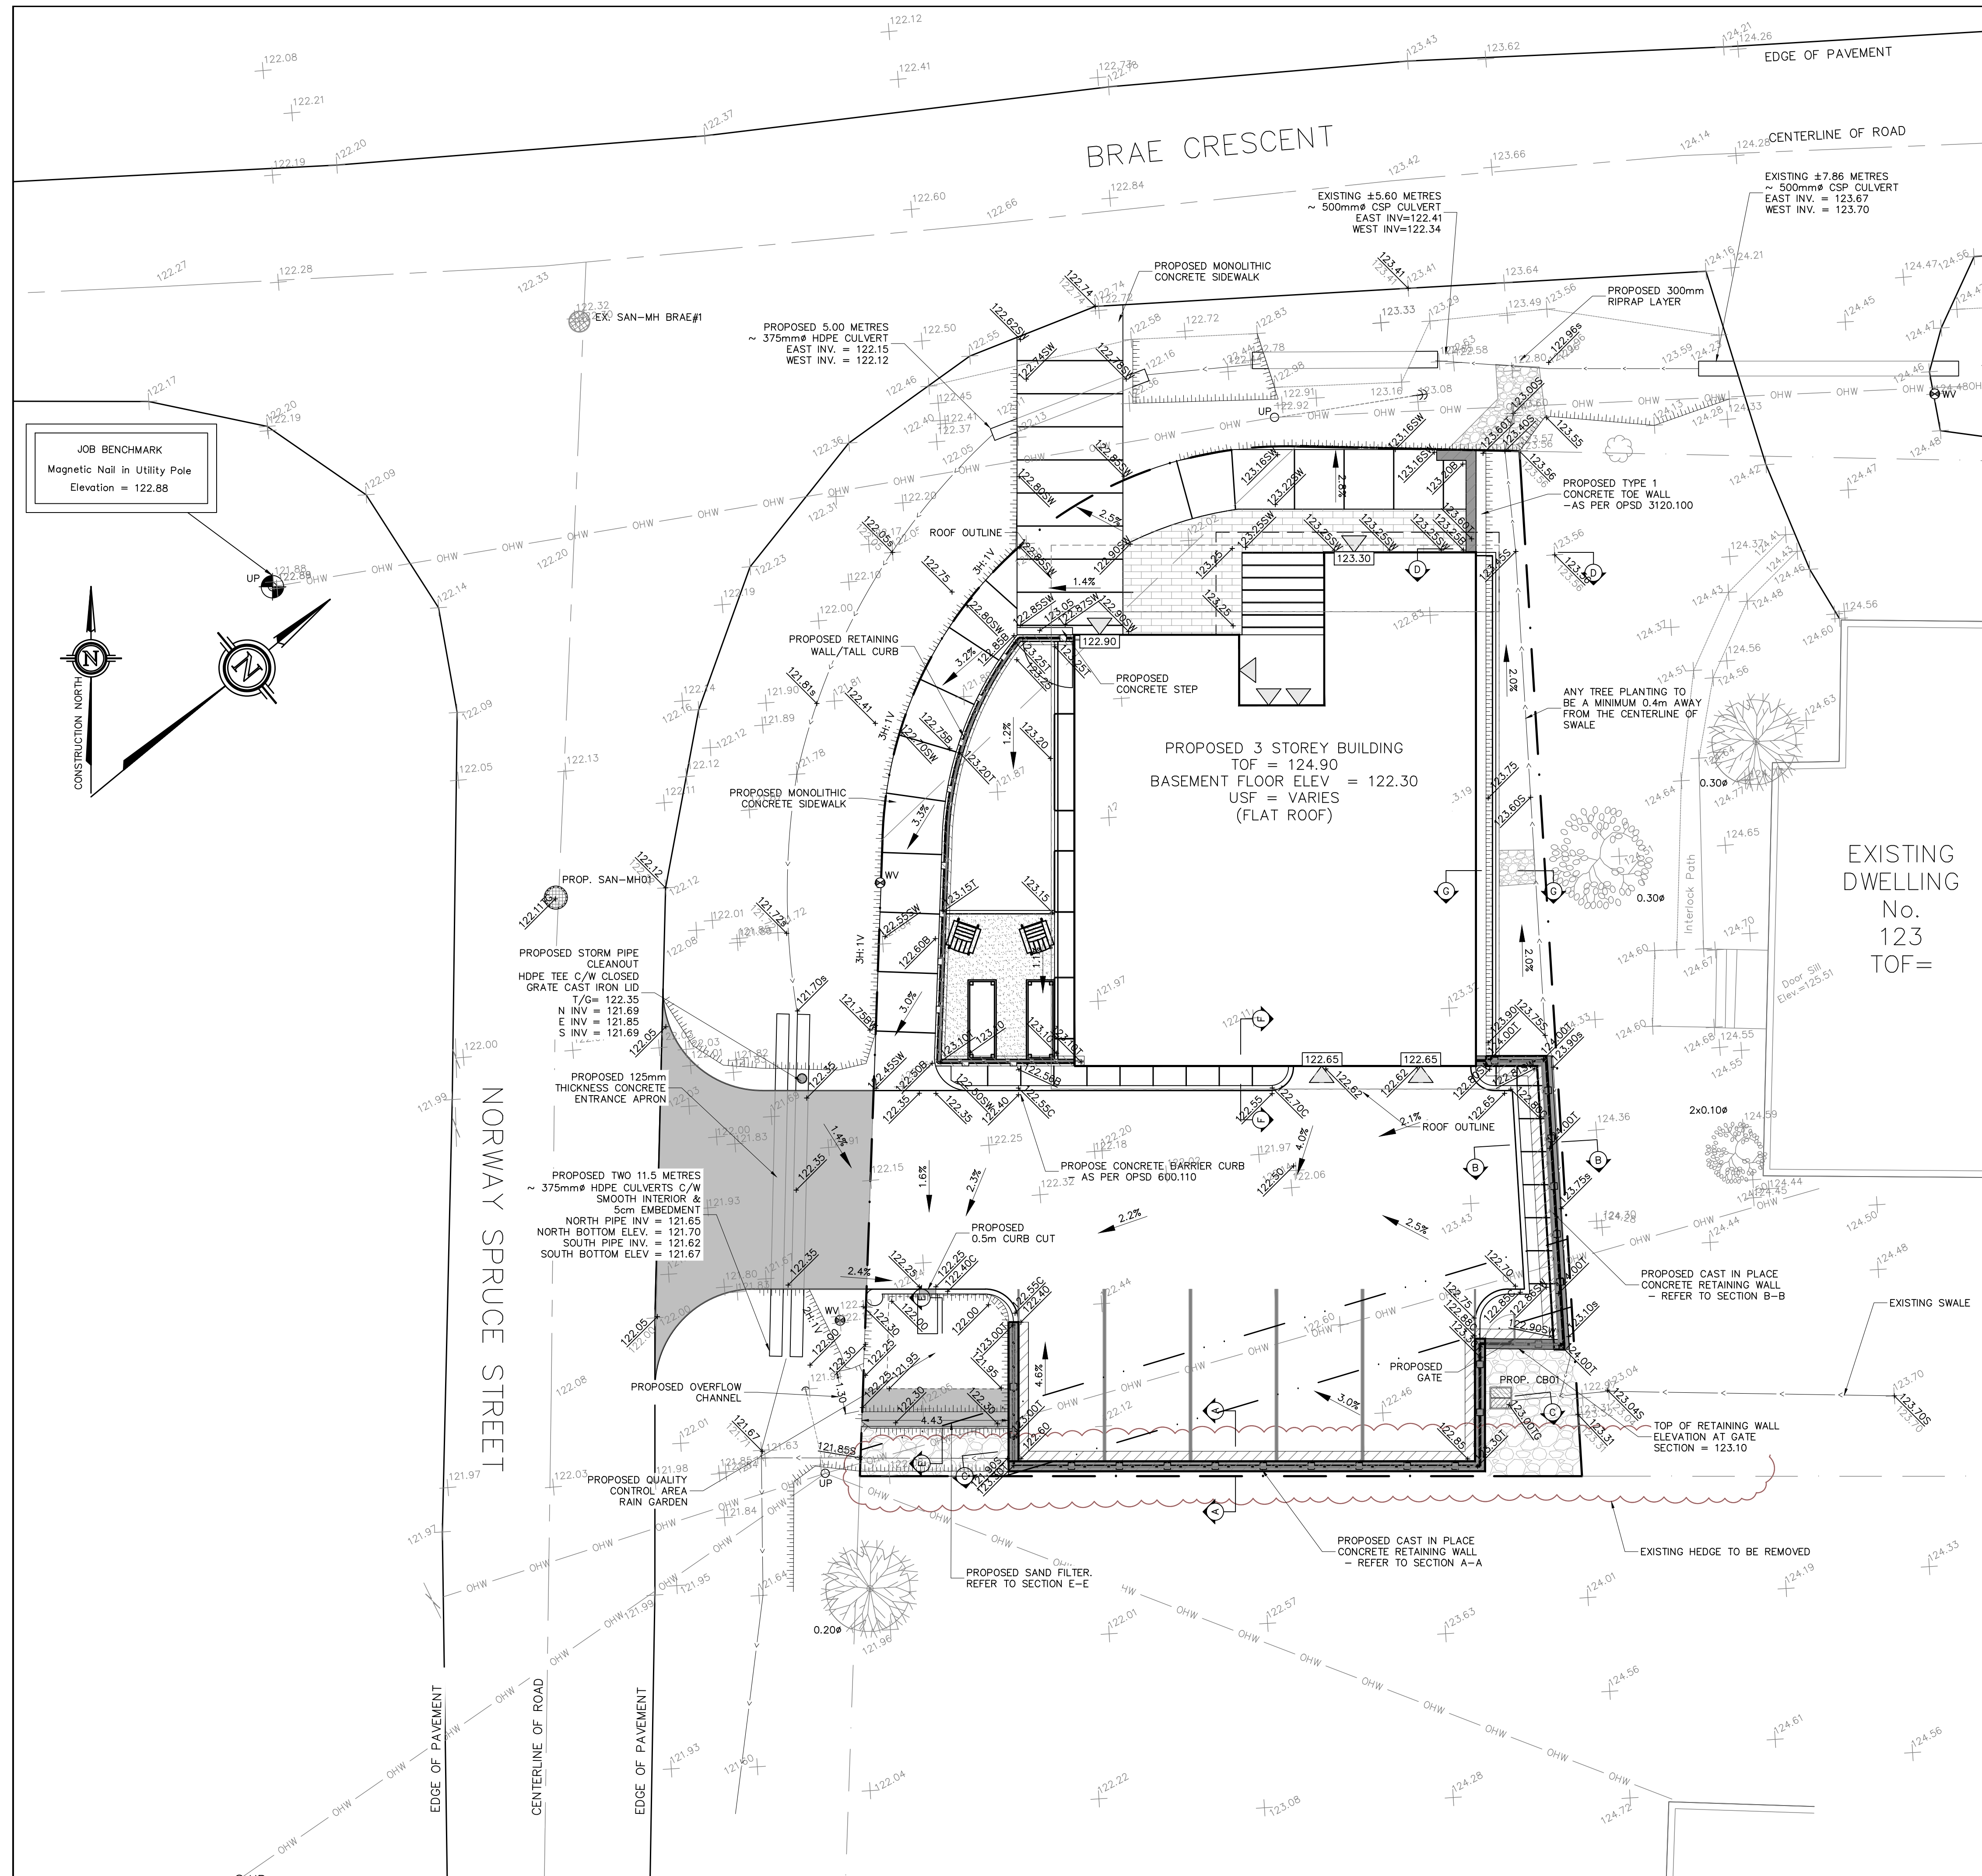

PROPOSED GRADING AND DRAINAGE PLAN
SCALE = 1:100

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
(613) 860-0923
info@kollaard.ca
P.O. BOX 189, 210 PRESCOTT ST.
KEMPTVILLE, ONTARIO
K0G 1J0 FAX (613) 258-0475
http://www.kollaard.ca


CLIENT:
BRYDEN GIBSON

PROJECT:
PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1


DESIGNED BY: SD	CHECKED BY: SD
DRAWN BY: JR	APPROVED BY: SD
DATE: MAY 12, 2023	
KOLLAARD FILE NUMBER: 220338	

DRAWING NUMBER:
220338-GR
DRAWING NAME:
GRADING AND DRAINAGE PLAN

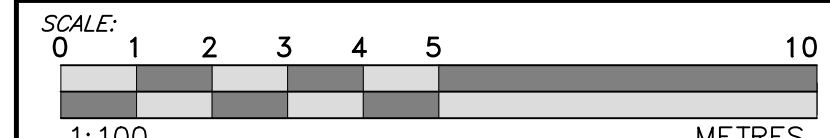

GENERAL NOTES:

- 1. All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.88.
2. This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Annis, O'Sullivan, Volebek Ltd. April 25, 2022.
3. Contractor is responsible for location and protection of utilities.
4. All dimensions to be verified on site by contractor prior to construction.
5. Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
6. Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
7. The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
8. The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
9. A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
10. The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
8. Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
8. Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
9. All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
10. This drawing is part of Kollaard Associates design report # 220338.

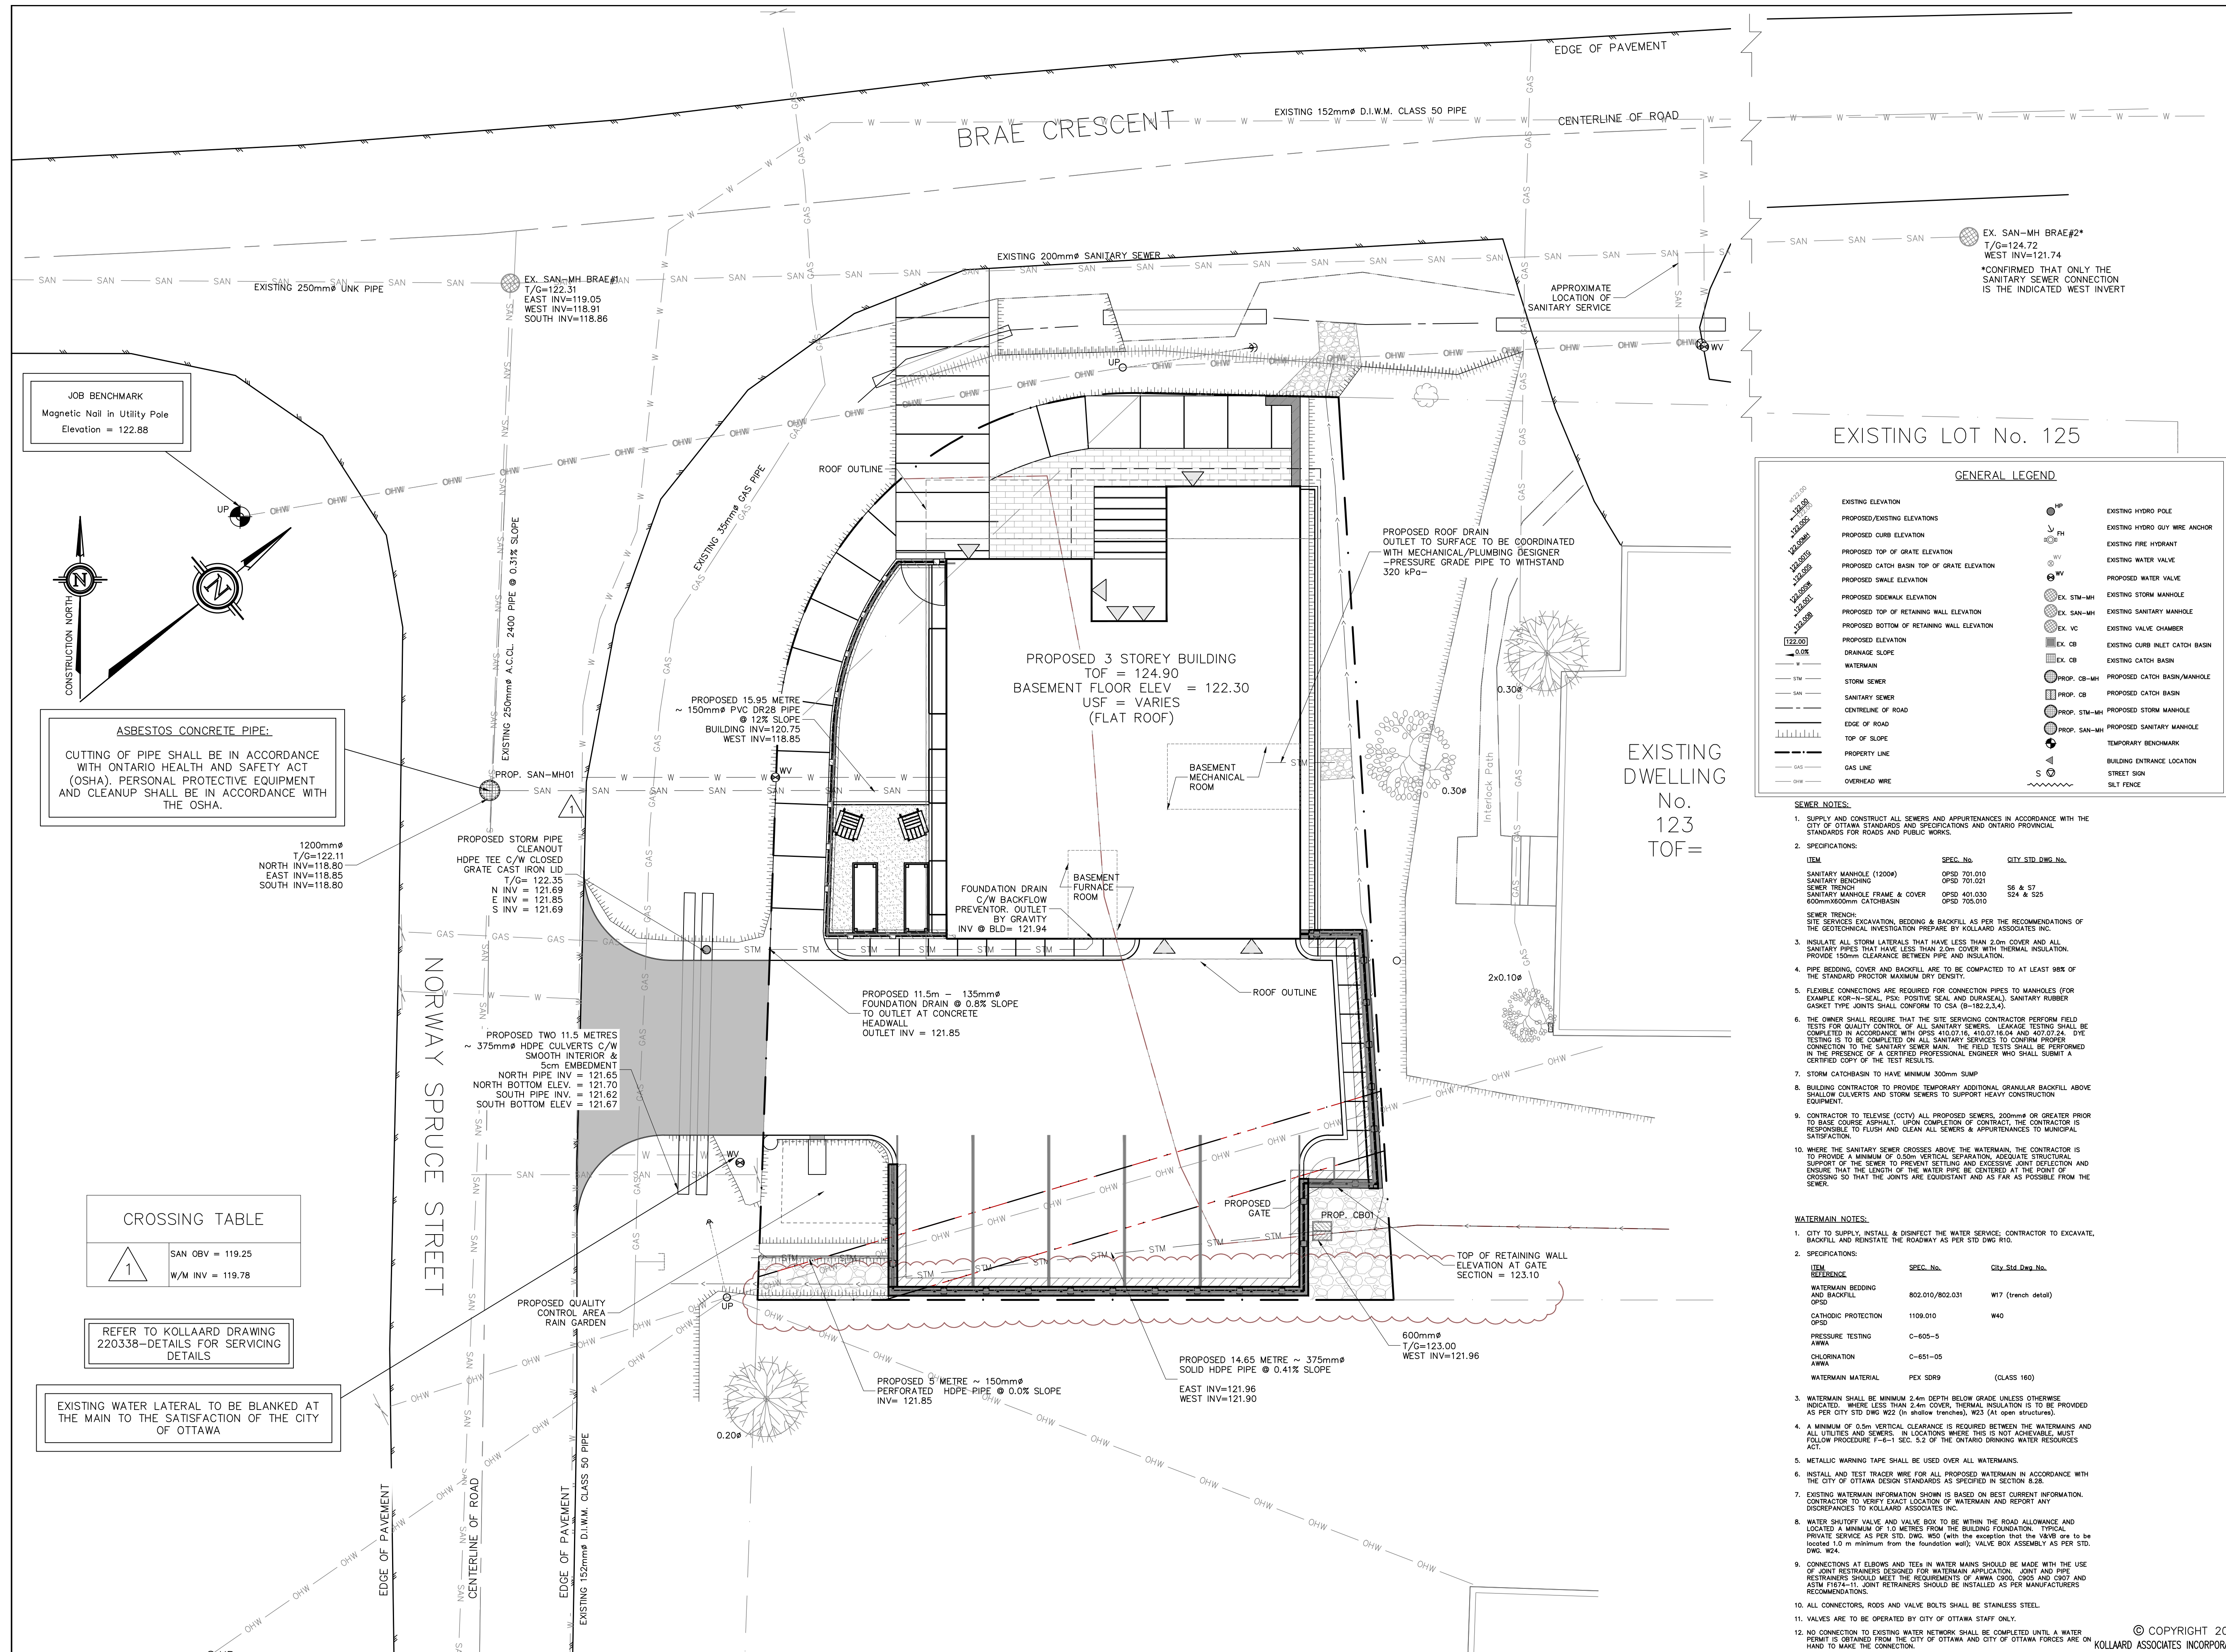

GENERAL LEGEND table with symbols for existing and proposed elevations, curbs, gratings, catch basins, manholes, and various utility lines (sanitary sewer, storm, gas, water, overhead wire).

- SEWER NOTES:
1. SUPPLY AND CONSTRUCT ALL SEWERS AND APPURTENANCES IN ACCORDANCE WITH THE CITY OF OTTAWA STANDARDS AND SPECIFICATIONS AND ONTARIO PROVINCIAL STANDARDS FOR ROADS AND PUBLIC WORKS.
2. SPECIFICATIONS:
ITEM SPEC. No. CITY STD. DWG. No.
SANITARY MANHOLE (1200) OPSD 701.010
SANITARY BENCHING OPSD 701.021
SEWER TRENCH OPSD 401.030 58 & 57
SANITARY MANHOLE FRAME & COVER OPSD 401.030 524 & 525
600mmx600mm CATCHBASIN OPSD 702.010
SEWER TRENCH:
SITE SERVICES EXCAVATION, BEDDING & BACKFILL AS PER THE RECOMMENDATIONS OF THE GEOTECHNICAL INVESTIGATION PREPARED BY KOLLAARD ASSOCIATES INC.
3. INSULATE ALL STORM LATERALS THAT HAVE LESS THAN 200mm COVER AND ALL SANITARY PIPES THAT HAVE LESS THAN 300mm COVER WITH THERMAL INSULATION. PROVIDE 150mm CLEARANCE BETWEEN PIPE AND INSULATION.
4. PIPE BEDDING, COVER AND BACKFILL ARE TO BE COMPACTED TO AT LEAST 98% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY.
5. FLEXIBLE CONNECTIONS ARE REQUIRED FOR CONNECTION PIPES TO MANHOLES (FOR EXAMPLE KOR-N-SEAL, PSE, POSITIVE SEAL AND DURASEAL). SANITARY RUBBER GASKET JOINTS SHALL CONFORM TO CSA (S-182.2.3.4).
6. THE OWNER SHALL REQUIRE THAT THE SITE SERVING CONTRACTOR PERFORM FIELD TESTS FOR QUALITY CONTROL OF ALL SANITARY SEWERS. LEAKAGE TESTING SHALL BE COMPLETED IN ACCORDANCE WITH OPSD 410.014, 410.014.01 AND 407.024. DYE TESTING IS TO BE COMPLETED ON ALL SANITARY SERVICES TO CONFIRM PROPER ALIGNMENT OF THE SANITARY SEWER MAIN. THE FIELD TESTS SHALL BE PERFORMED IN THE PRESENCE OF A CERTIFIED PROFESSIONAL ENGINEER WHO SHALL SUBMIT A CERTIFIED COPY OF THE TEST RESULTS.
7. STORM CATCHBASIN TO HAVE MINIMUM 300mm SLUMP.
8. BUILDING CONTRACTOR TO PROVIDE TEMPORARY ADDITIONAL GRANULAR BACKFILL ABOVE SHALLOW CULVERTS AND STORM SEWERS TO SUPPORT HEAVY CONSTRUCTION EQUIPMENT.
9. CONTRACTOR TO TELEPHONE (CCTV) ALL PROPOSED SEWERS, 200mm OR GREATER PRIOR TO BASE COURSE ASPHALT. UPON COMPLETION OF CONTRACT, THE CONTRACTOR IS RESPONSIBLE TO FLUSH AND CLEAN ALL SEWERS & APPURTENANCES TO MUNICIPAL SATISFACTION.
10. WHERE THE SANITARY SEWER CROSSES ABOVE THE WATERMAIN, THE CONTRACTOR IS TO PROVIDE A MINIMUM OF 0.5m VERTICAL SEPARATION. ADEQUATE STRUCTURAL SUPPORT OF THE SEWER TO PREVENT SETTLING AND EXCESSIVE JOINT DEFLECTION AND ENSURE THAT THE LENGTH OF THE WATER PIPE BE CENTERED AT THE POINT OF CROSSING SO THAT THE JOINTS ARE EQUIDISTANT AND AS FAR AS POSSIBLE FROM THE SEWER.

- WATERMAIN NOTES:
1. CITY TO SUPPLY, INSTALL & DISINFECT THE WATER SERVICE. CONTRACTOR TO EXCAVATE, BACKFILL AND REINSTATE THE ROADWAY AS PER STD DWG R10.
2. SPECIFICATIONS:
ITEM REFERENCE SPEC. No. City Std. Dep. No.
WATERMAIN BEDDING AND BACKFILL OPSD 802.010/802.031 W17 (trench detail)
CATHODIC PROTECTION OPSD 1109.010 W40
PRESSURE TESTING AWWA C-605-5
CHLORINATION AWWA C-651-05
WATERMAIN MATERIAL PEX SDR9 (CLASS 160)
3. WATERMAIN SHALL BE MINIMUM 2.4m DEPTH BELOW GRADE UNLESS OTHERWISE INDICATED. WHERE LESS THAN 0.4m COVER, THERMAL INSULATION IS TO BE PROVIDED AS PER CITY STD DWG W22 (in shallow trenches), W23 (in open structures).
4. A MINIMUM OF 0.5m VERTICAL CLEARANCE IS REQUIRED BETWEEN THE WATERMANS AND ALL UTILITIES AND SERVICES. IN LOCATIONS WHERE THIS IS NOT ACHIEVABLE, MUST FOLLOW PROCEDURE F-6-1 SEC. 5.2 OF THE ONTARIO DRINKING WATER RESOURCES ACT.
5. METALLIC WARNING TAPE SHALL BE USED OVER ALL WATERMANS.
6. INSTALL AND TEST TRACER WIRE FOR ALL PROPOSED WATERMAIN IN ACCORDANCE WITH THE CITY OF OTTAWA DESIGN STANDARDS AS SPECIFIED IN SECTION 6.28.
7. EXISTING WATERMAIN INFORMATION SHOWN IS BASED ON BEST CURRENT INFORMATION. CONTRACTOR TO VERIFY EXACT LOCATION OF WATERMAIN AND REPORT ANY DISCREPANCIES TO KOLLAARD ASSOCIATES INC.
8. WATER SHUTOFF VALVE AND VALVE BOX TO BE WITHIN THE ROAD ALLOWANCE AND LOCATED A MINIMUM OF 1.0 METRES FROM THE BUILDING FOUNDATION. TYPICAL PRIVATE SERVICE AS PER STD. DWG. W50 (with the exception that the valve box to be located 1.0 m minimum from the foundation wall). VALVE BOX ASSEMBLY AS PER STD. DWG. W24.
9. CONNECTIONS AT ELBOWS AND TEES IN WATER MAINS SHOULD BE MADE WITH THE USE OF JOINT RESTRAINTS DESIGNED FOR WATERMAIN APPLICATION. JOINT AND PIPE RESTRAINTS SHOULD MEET THE REQUIREMENTS OF AWWA C900, C905 AND C907 AND ASTM F1614-11. JOINT RESTRAINTS SHOULD BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS.
10. ALL CONNECTORS, RODS AND VALVE BOLTS SHALL BE STAINLESS STEEL.
11. VALVES ARE TO BE OPERATED BY CITY OF OTTAWA STAFF ONLY.
12. NO CONNECTION TO EXISTING WATER NETWORK SHALL BE COMPLETED UNTIL A WATER PERMIT IS OBTAINED FROM THE CITY OF OTTAWA AND CITY OF OTTAWA FORCES ARE ON HAND TO MAKE THE CONNECTION.

JOB BENCHMARK
Magnetic Nail in Utility Pole
Elevation = 122.88

ASBESTOS CONCRETE PIPE:
CUTTING OF PIPE SHALL BE IN ACCORDANCE WITH ONTARIO HEALTH AND SAFETY ACT (OSHA). PERSONAL PROTECTIVE EQUIPMENT AND CLEANUP SHALL BE IN ACCORDANCE WITH THE OSHA.

1200mm#
T/G=122.11
NORTH INV=118.80
EAST INV=118.85
SOUTH INV=118.80

PROPOSED STORM PIPE CLEANOUT
HDPE TEE C/W CLOSED GRATE CAST IRON LID
T/G= 122.35
N INV = 121.69
S INV = 121.65
S INV = 121.69

PROPOSED TWO 11.5 METRES
375mm# HDPE CULVERTS C/W SMOOTH INTERIOR & 5cm EMBEDMENT
NORTH PIPE INV = 121.65
NORTH BOTTOM ELEV. = 121.70
SOUTH PIPE INV. = 121.62
SOUTH BOTTOM ELEV = 121.67

PROPOSED 3 STOREY BUILDING
TOF = 124.90
BASEMENT FLOOR ELEV = 122.30
USF = VARIES (FLAT ROOF)

FOUNDATION DRAIN C/W BACKFLOW PREVENTOR. OUTLET BY GRAVITY
INV @ BLD = 121.94

PROPOSED 11.5m - 135mm# FOUNDATION DRAIN @ 0.8% SLOPE TO OUTLET AT CONCRETE HEADWALL
OUTLET INV = 121.85

PROPOSED 5 METRE ~ 150mm# PERFORATED HDPE PIPE @ 0.0% SLOPE
INV= 121.85

PROPOSED 14.65 METRE ~ 375mm# SOLID HDPE PIPE @ 0.41% SLOPE
EAST INV=121.96
WEST INV=121.90

600mm#
T/G=123.00
WEST INV=121.96

CROSSING TABLE
SAN OBV = 119.25
W/M INV = 119.78

REFER TO KOLLAARD DRAWING 220338-DETAILS FOR SERVICING DETAILS

EXISTING WATER LATERAL TO BE BLANKED AT THE MAIN TO THE SATISFACTION OF THE CITY OF OTTAWA

Kollaard Associates Engineers logo and contact information: (613) 860-0923, info@kollaard.ca

CLIENT: BRYDEN GIBSON

PROJECT: PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION: 121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1


Professional Engineer stamp for S.E. deWit, 100079612, dated JAN 12, 2024, with design and approval signatures.




SCALE: AS NOTED

GENERAL NOTES:


- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.85.
- This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Annis, O'Sullivan, Vollebek Ltd. April 25, 2022.
- Contractor is responsible for location and protection of utilities.
- All dimensions to be verified on site by contractor prior to construction.
- Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
- Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
- The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
- The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
- A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
- The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
- Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
- Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
- All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
- This drawing is part of Kollaard Associates design report # 220338.

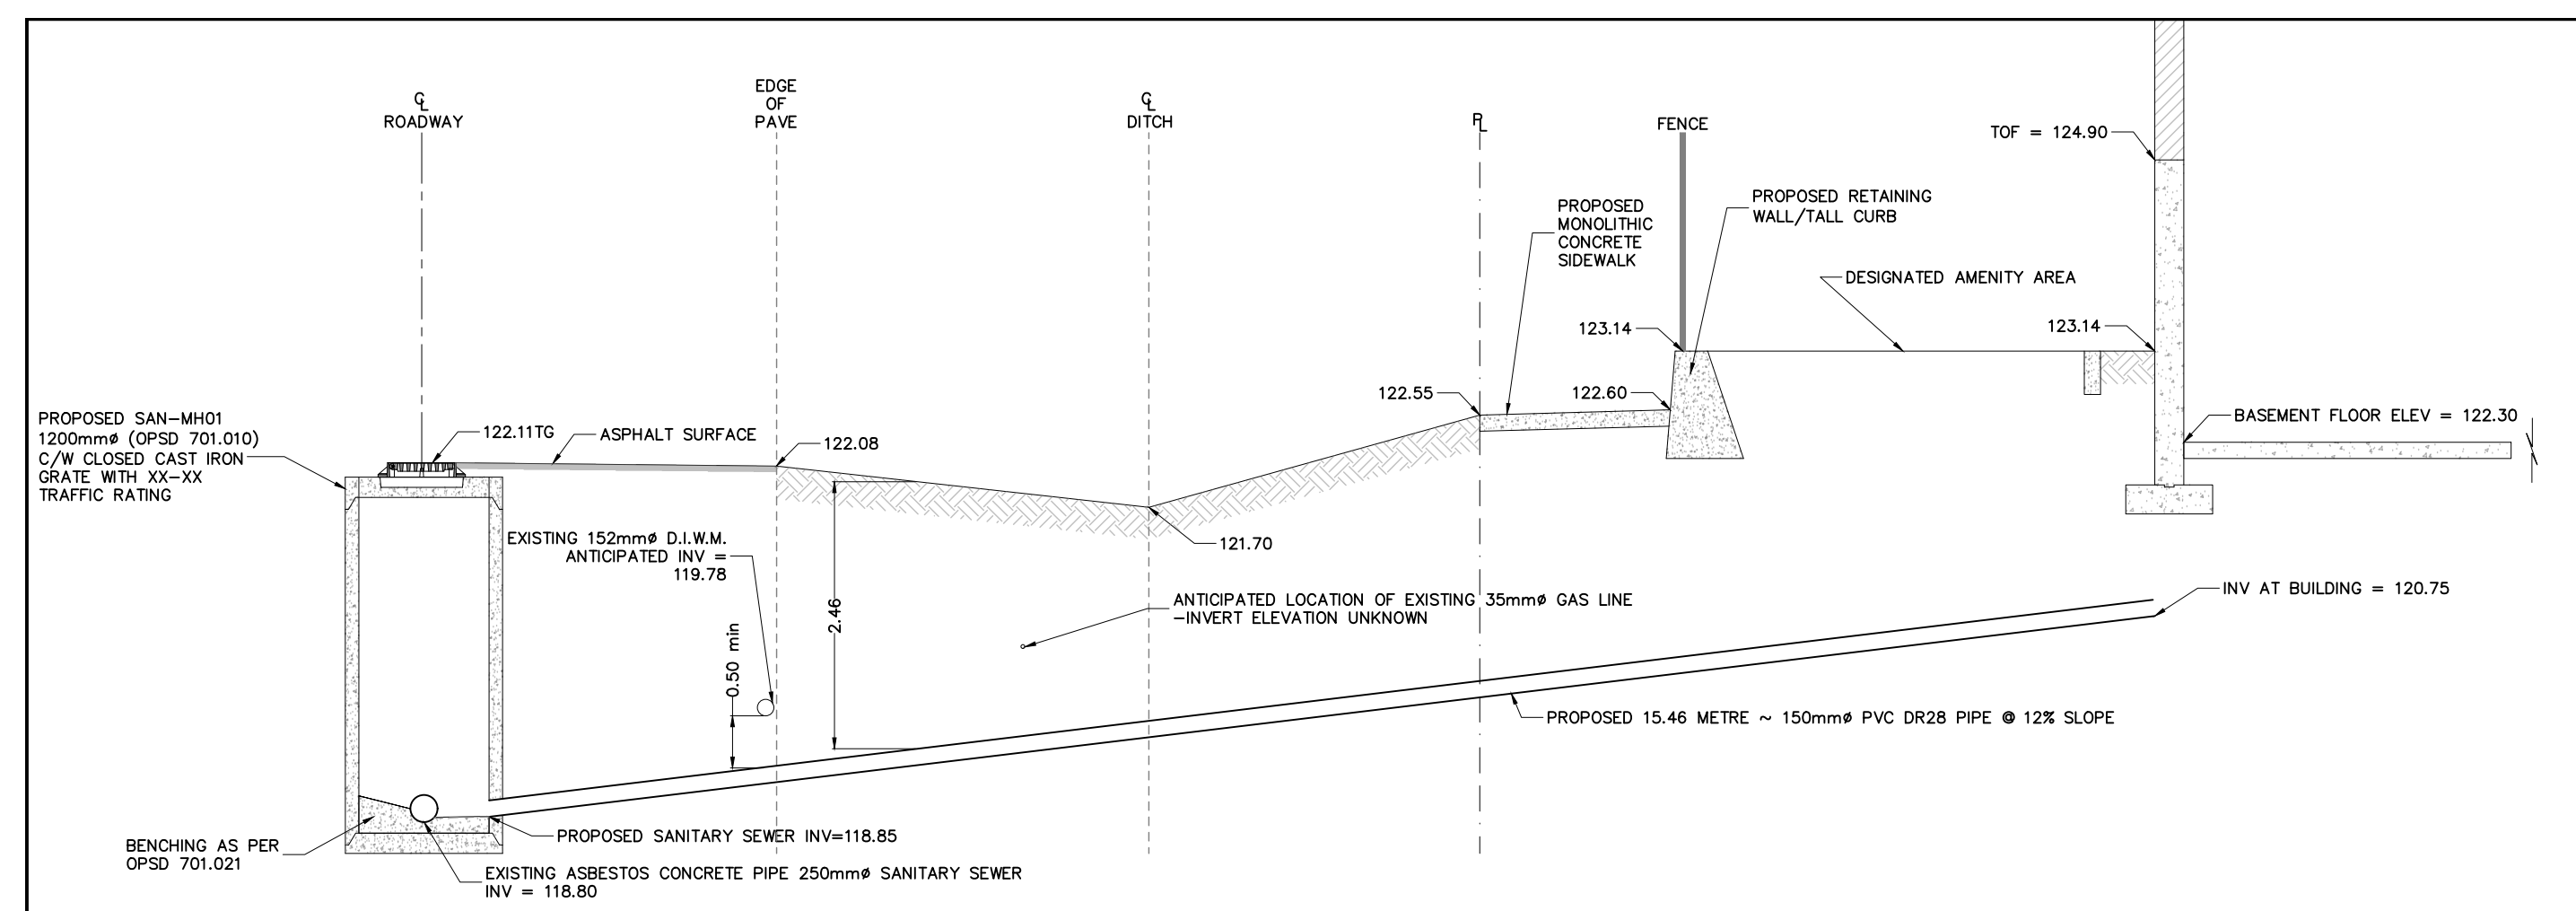


SANITARY SERVICE CONNECTION
N.T.S.

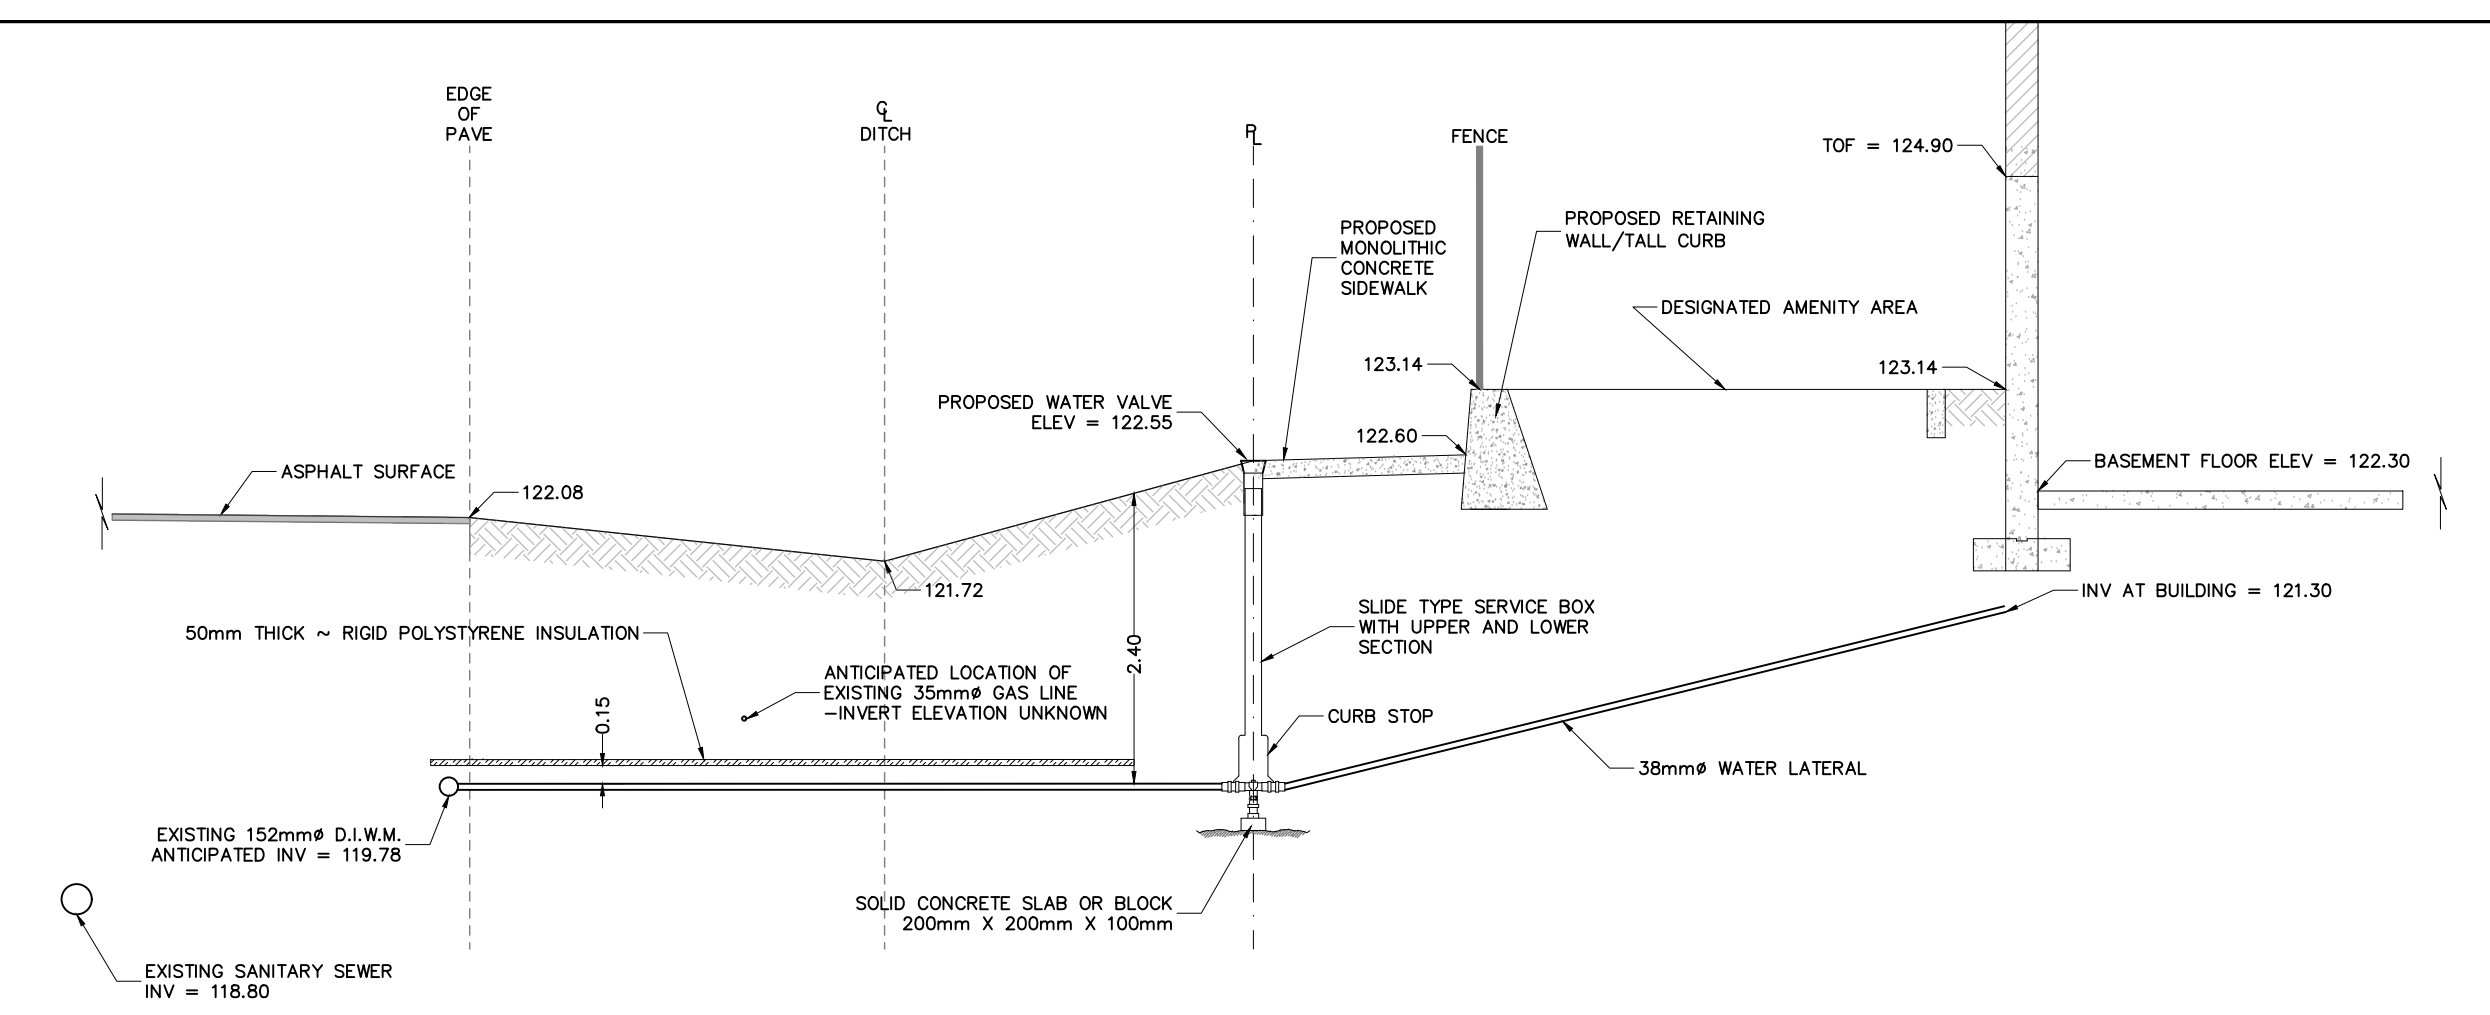


WATER SERVICE CONNECTION
N.T.S.

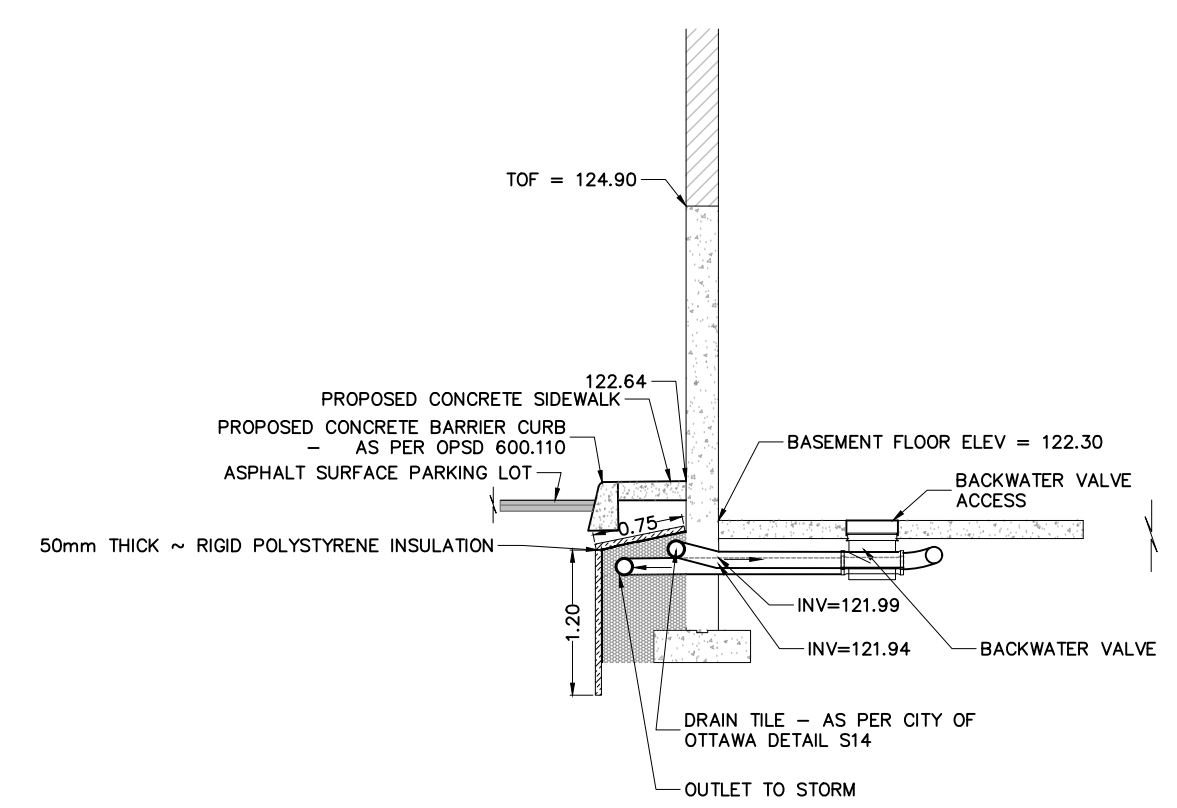


FOUNDATION DRAIN SECTION F-F
N.T.S.

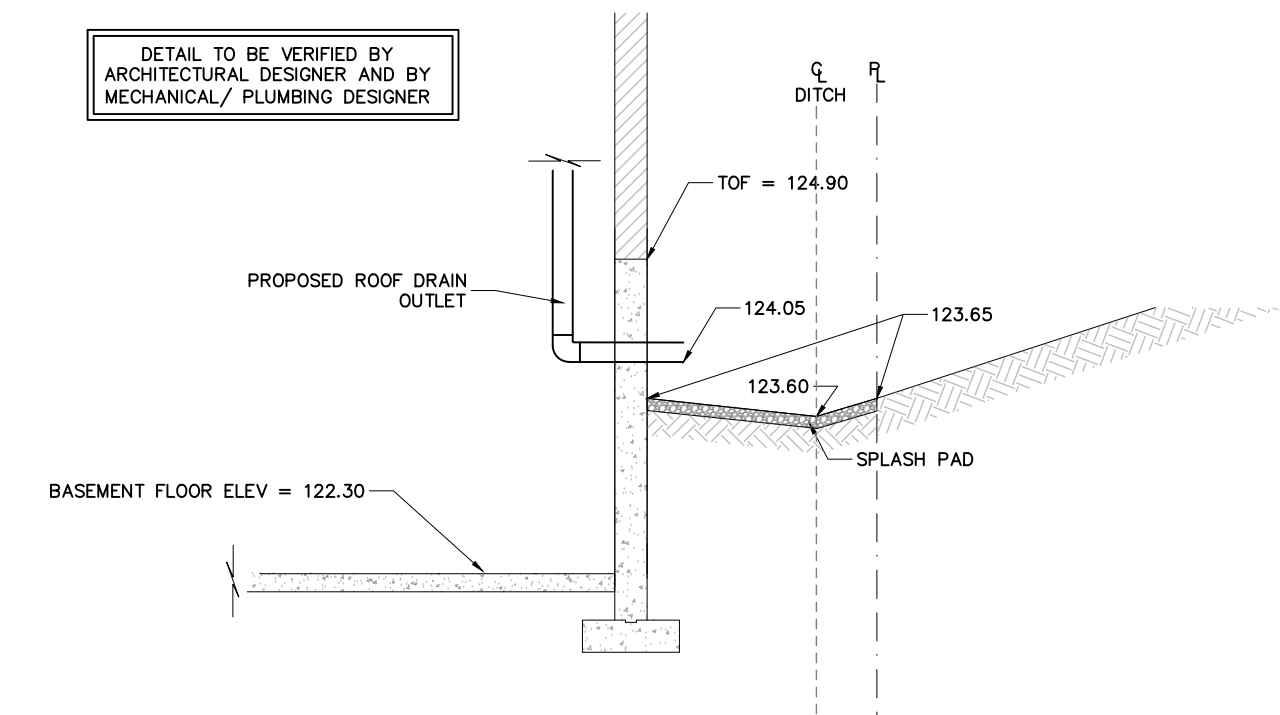


ROOF DRAIN OUTLET
N.T.S.

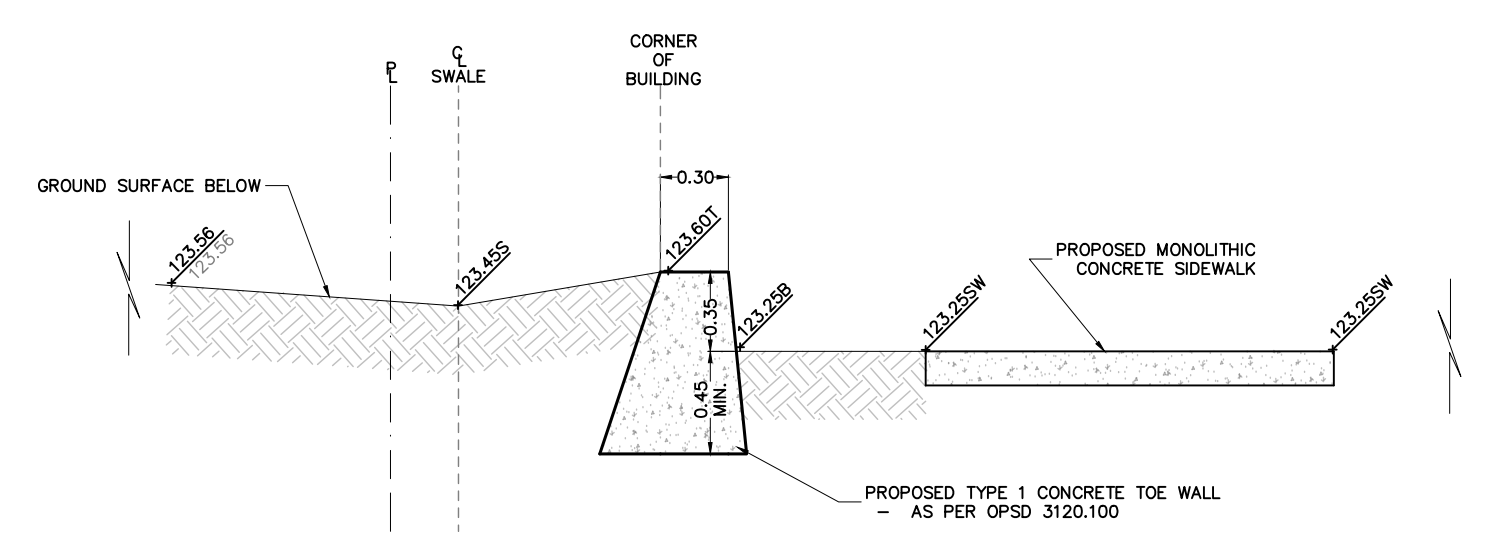


SECTION D-D
N.T.S.

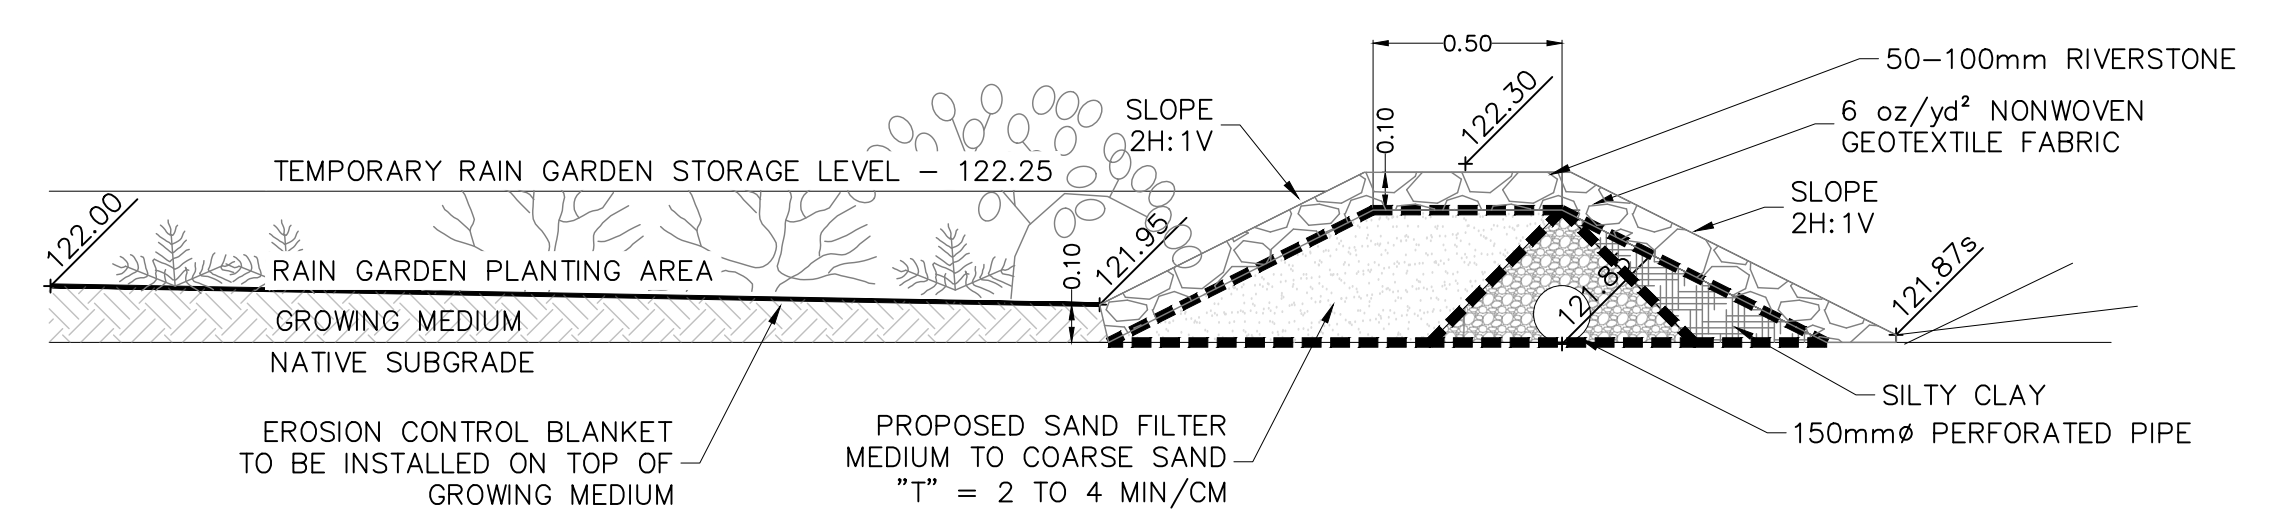


PROPOSED RAIN GARDEN AREA SECTION E-E
N.T.S.

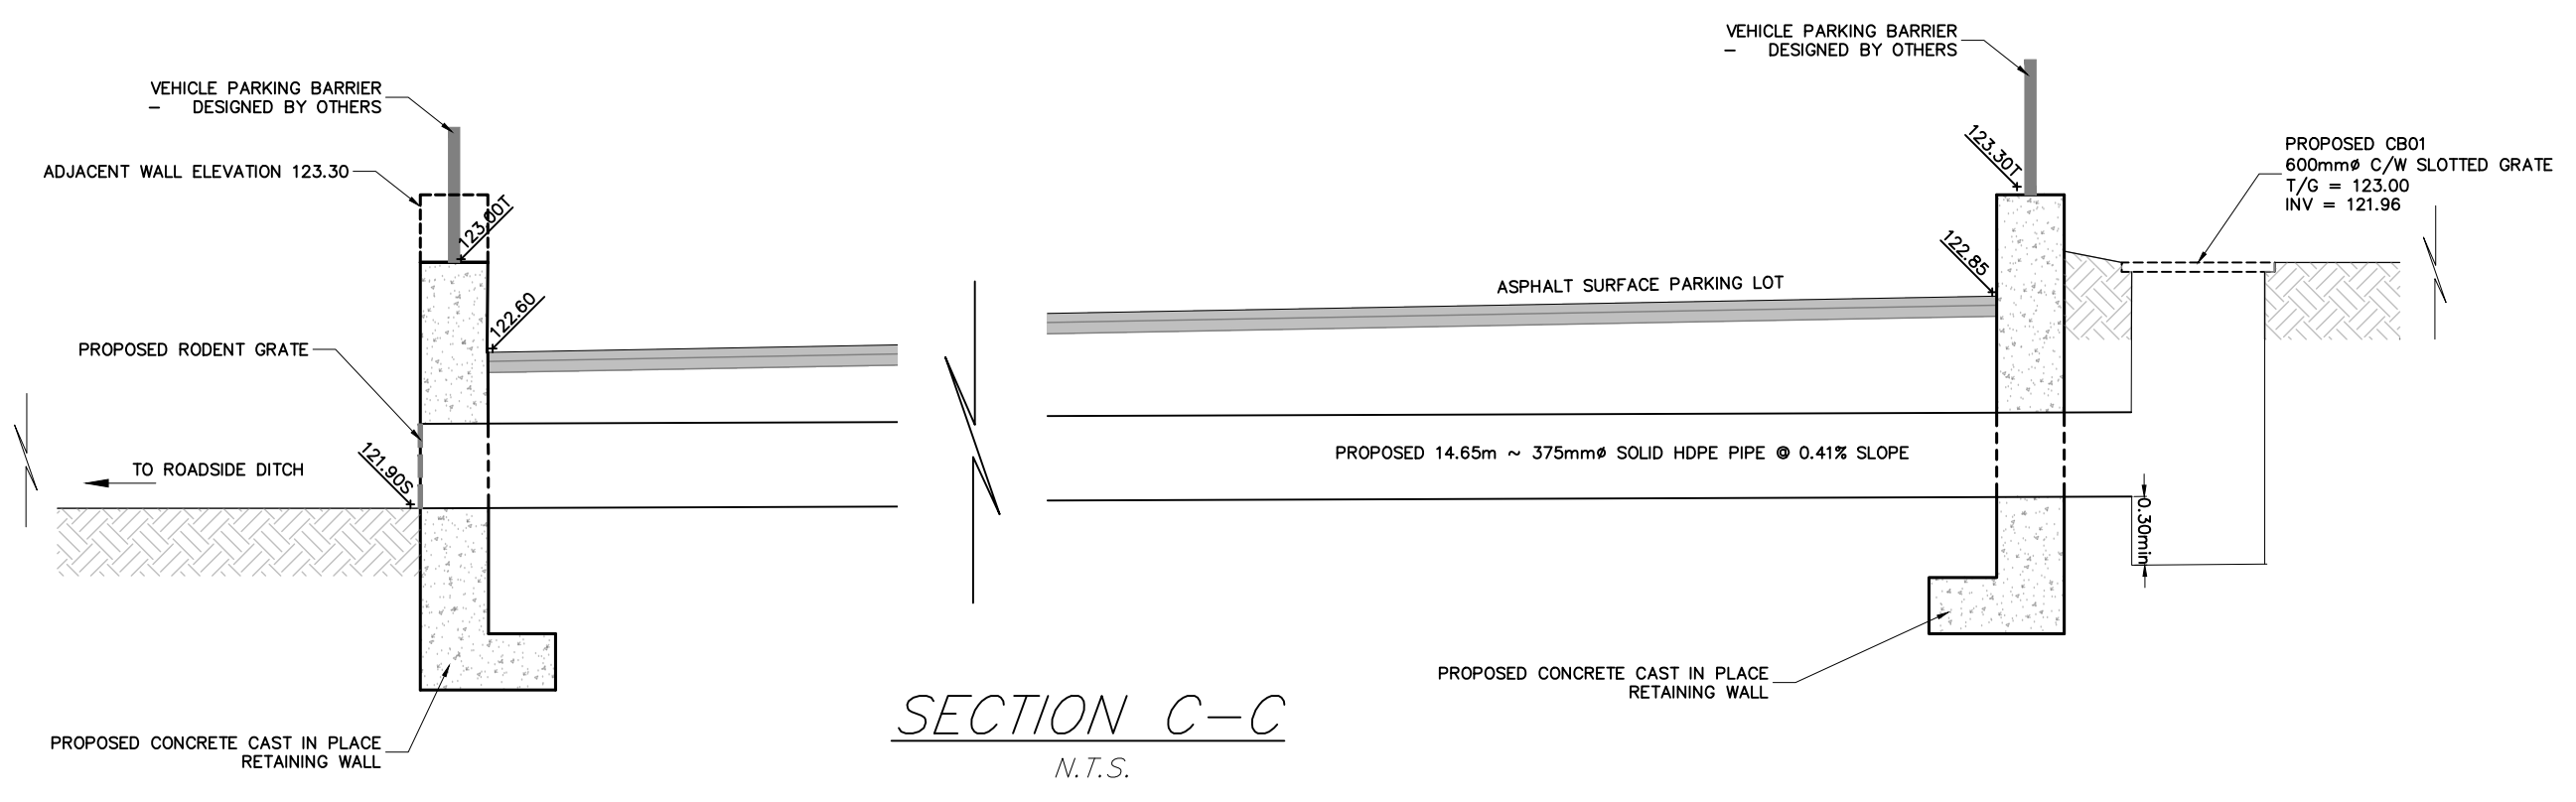

SECTION C-C
N.T.S.

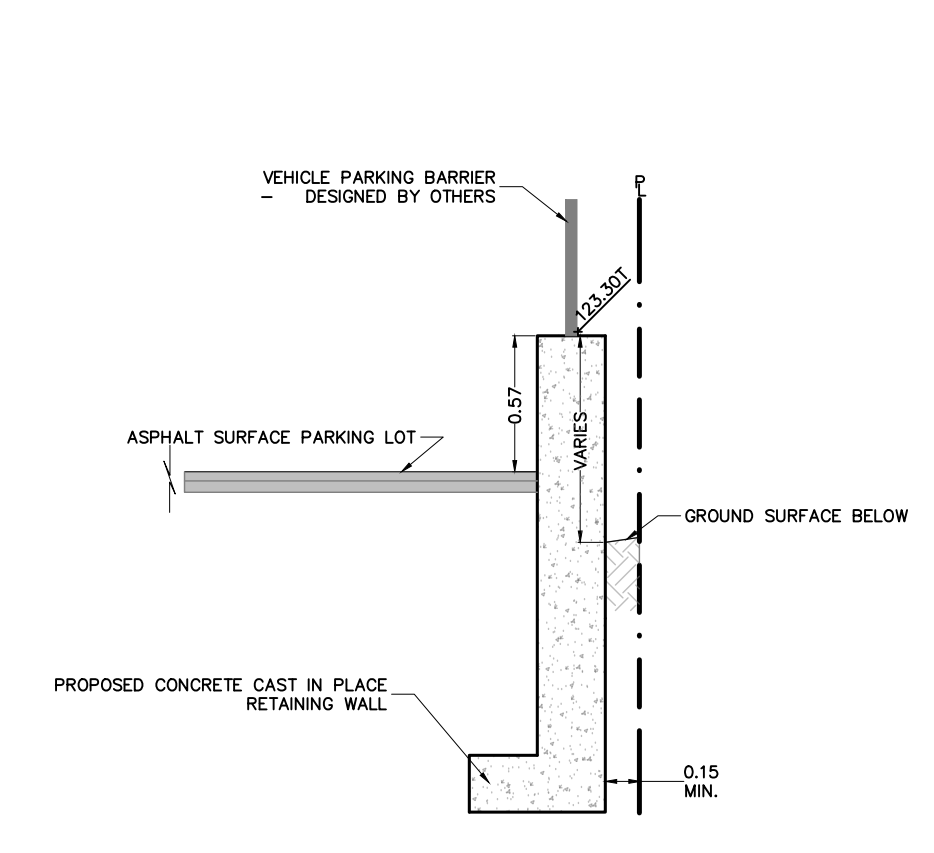

SECTION A-A
N.T.S.

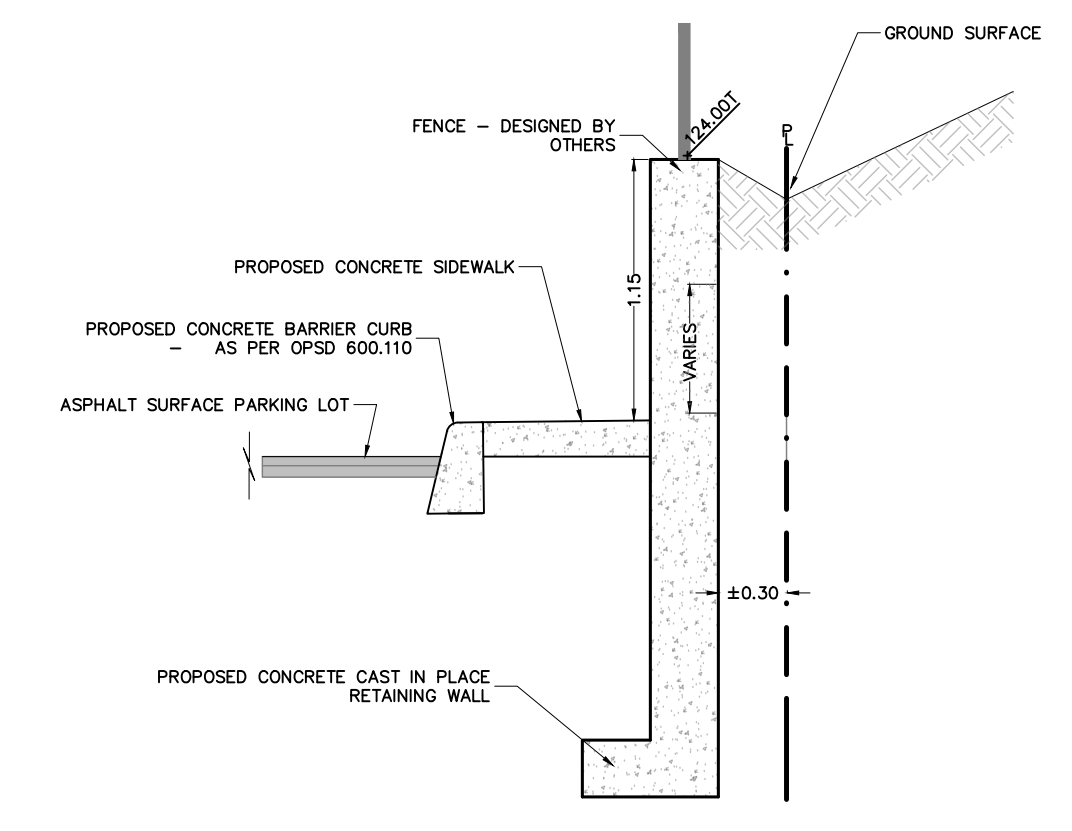

SECTION B-B
N.T.S.

DETAILS
NOT TO SCALE

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
 (613) 860-0923
 info@kollaard.ca
 P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca


CLIENT:
BRYDEN GIBSON

PROJECT:
PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1

DESIGNED BY: SD
 CHECKED BY: SD
 DRAWN BY: JR
 APPROVED BY: SD
 DATE: MAY 12, 2023
 KOLLAARD FILE NUMBER: 220338

DRAWING NUMBER: 220338-DETAILS
 DRAWING NAME: DETAILS

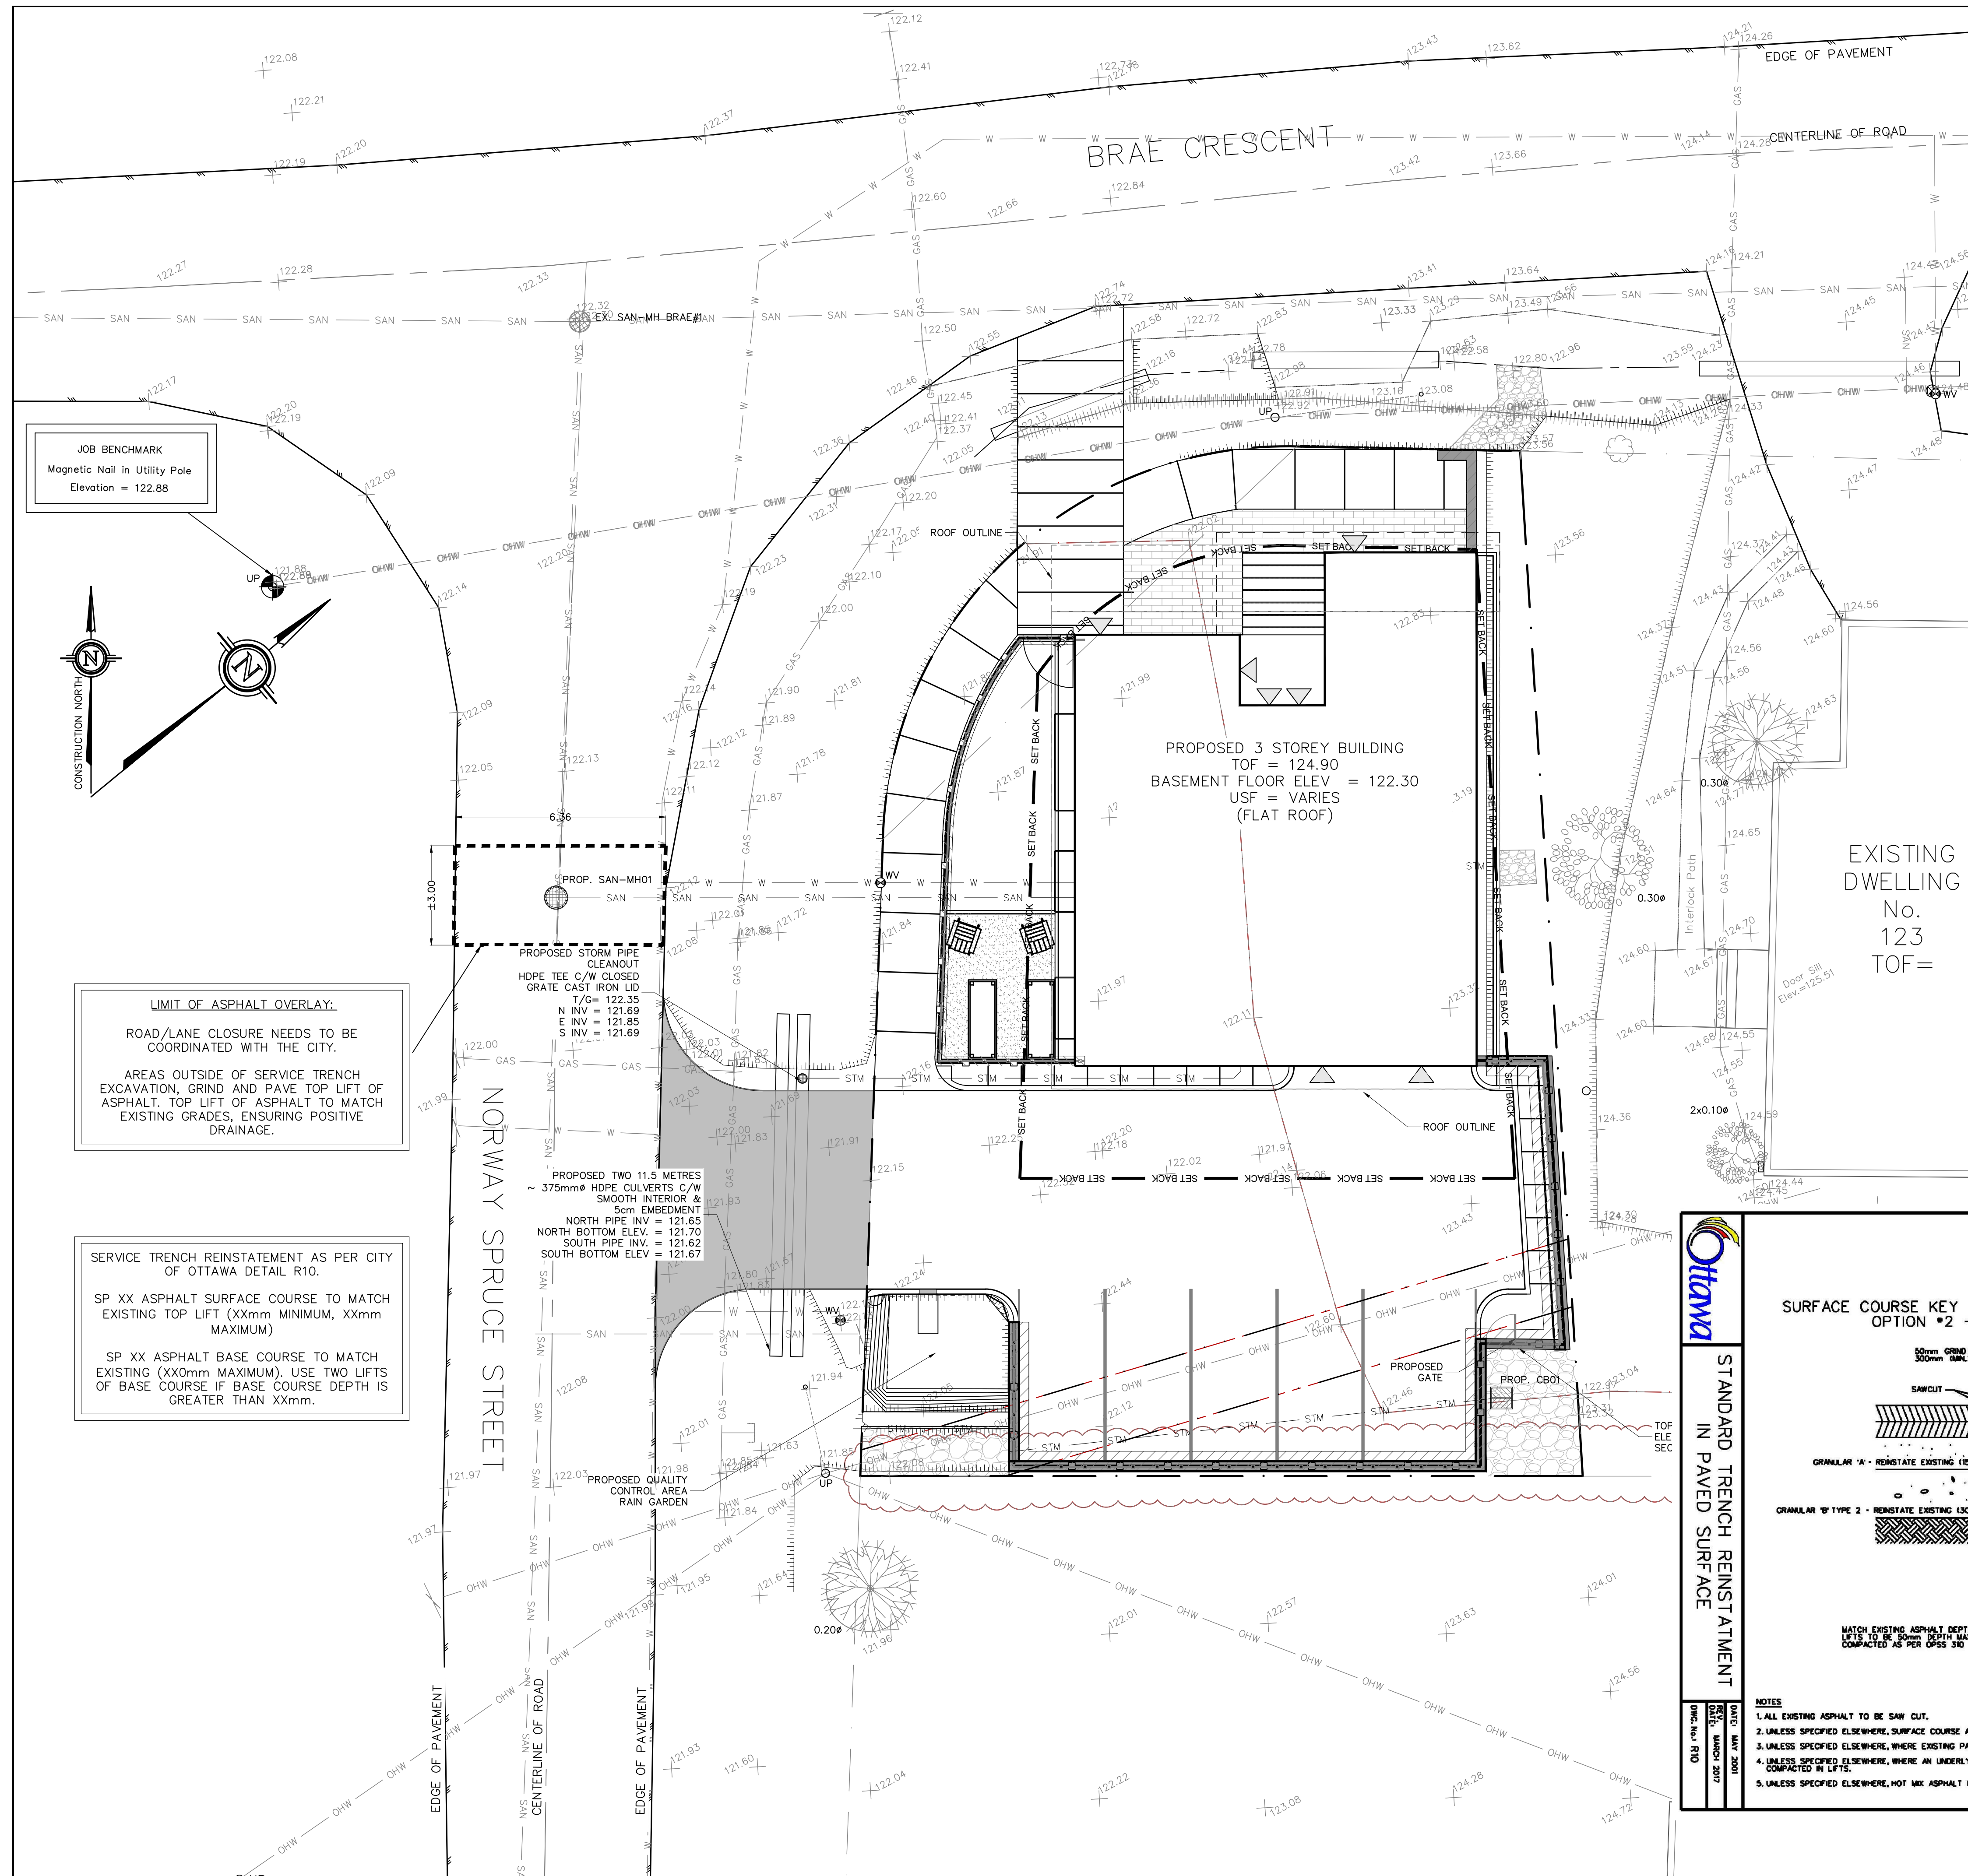

GENERAL LEGEND

EXISTING ELEVATION	EXISTING HYDRO POLE
PROPOSED EXISTING ELEVATIONS	EXISTING HYDRO GUY WIRE ANCHOR
PROPOSED CURB ELEVATION	EXISTING FIRE HYDRANT
PROPOSED TOP OF GRATE ELEVATION	EXISTING WATER VALVE
PROPOSED CATCH BASIN TOP OF GRATE ELEVATION	PROPOSED WATER VALVE
PROPOSED SIDEWALK ELEVATION	EXISTING STORM MANHOLE
PROPOSED TOP OF RETAINING WALL ELEVATION	EX. SAN-MH
PROPOSED BOTTOM OF RETAINING WALL ELEVATION	EXISTING SANITARY MANHOLE
PROPOSED ELEVATION	EXISTING VALVE CHAMBER
WATERMAN	EXISTING CURB INLET CATCH BASIN
STORM SEWER	EXISTING CATCH BASIN
SANITARY SEWER	PROPOSED CATCH BASIN/MANHOLE
CENTRELINE OF ROAD	PROPOSED CB-MH
EDGE OF ROAD	PROPOSED CATCH BASIN
TOP OF SLOPE	PROPOSED STORM MANHOLE
PROPERTY LINE	PROPOSED SAN-MH
GAS LINE	TEMPORARY BENCHMARK
OVERHEAD WIRE	BUILDING ENTRANCE LOCATION
	STREET SIGN
	SILT FENCE

DRAWING NUMBER: 220338-RR

SCALE: 0 1 2 3 4 5 10 METRES

1:100

- GENERAL NOTES:**
- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.88
 - This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Arnis, O'Sullivan, Volebek Ltd. April 25, 2022.
 - Contractor is responsible for location and protection of utilities.
 - All dimensions to be verified on site by contractor prior to construction.
 - Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
 - Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
 - The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
 - The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
 - A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
 - The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, but not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
 - Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
 - Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
 - All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
 - This drawing is part of Kollaard Associates design report # 220338.

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
 (613) 860-0923
 info@kollaard.ca

P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca

CLIENT: BRYDEN GIBSON


PROJECT: PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION: 121 BREA CRESCENT, STITTSVILLE, ON, K2S 1P1


DESIGNED BY: SD	CHECKED BY: SD
DRAWN BY: JR	APPROVED BY: SD
DATE: MAY 12, 2023	
KOLLAARD FILE NUMBER: 220338	

DRAWING NUMBER: 220338-RR

DRAWING NAME: ROADWAY REINSTATEMENT

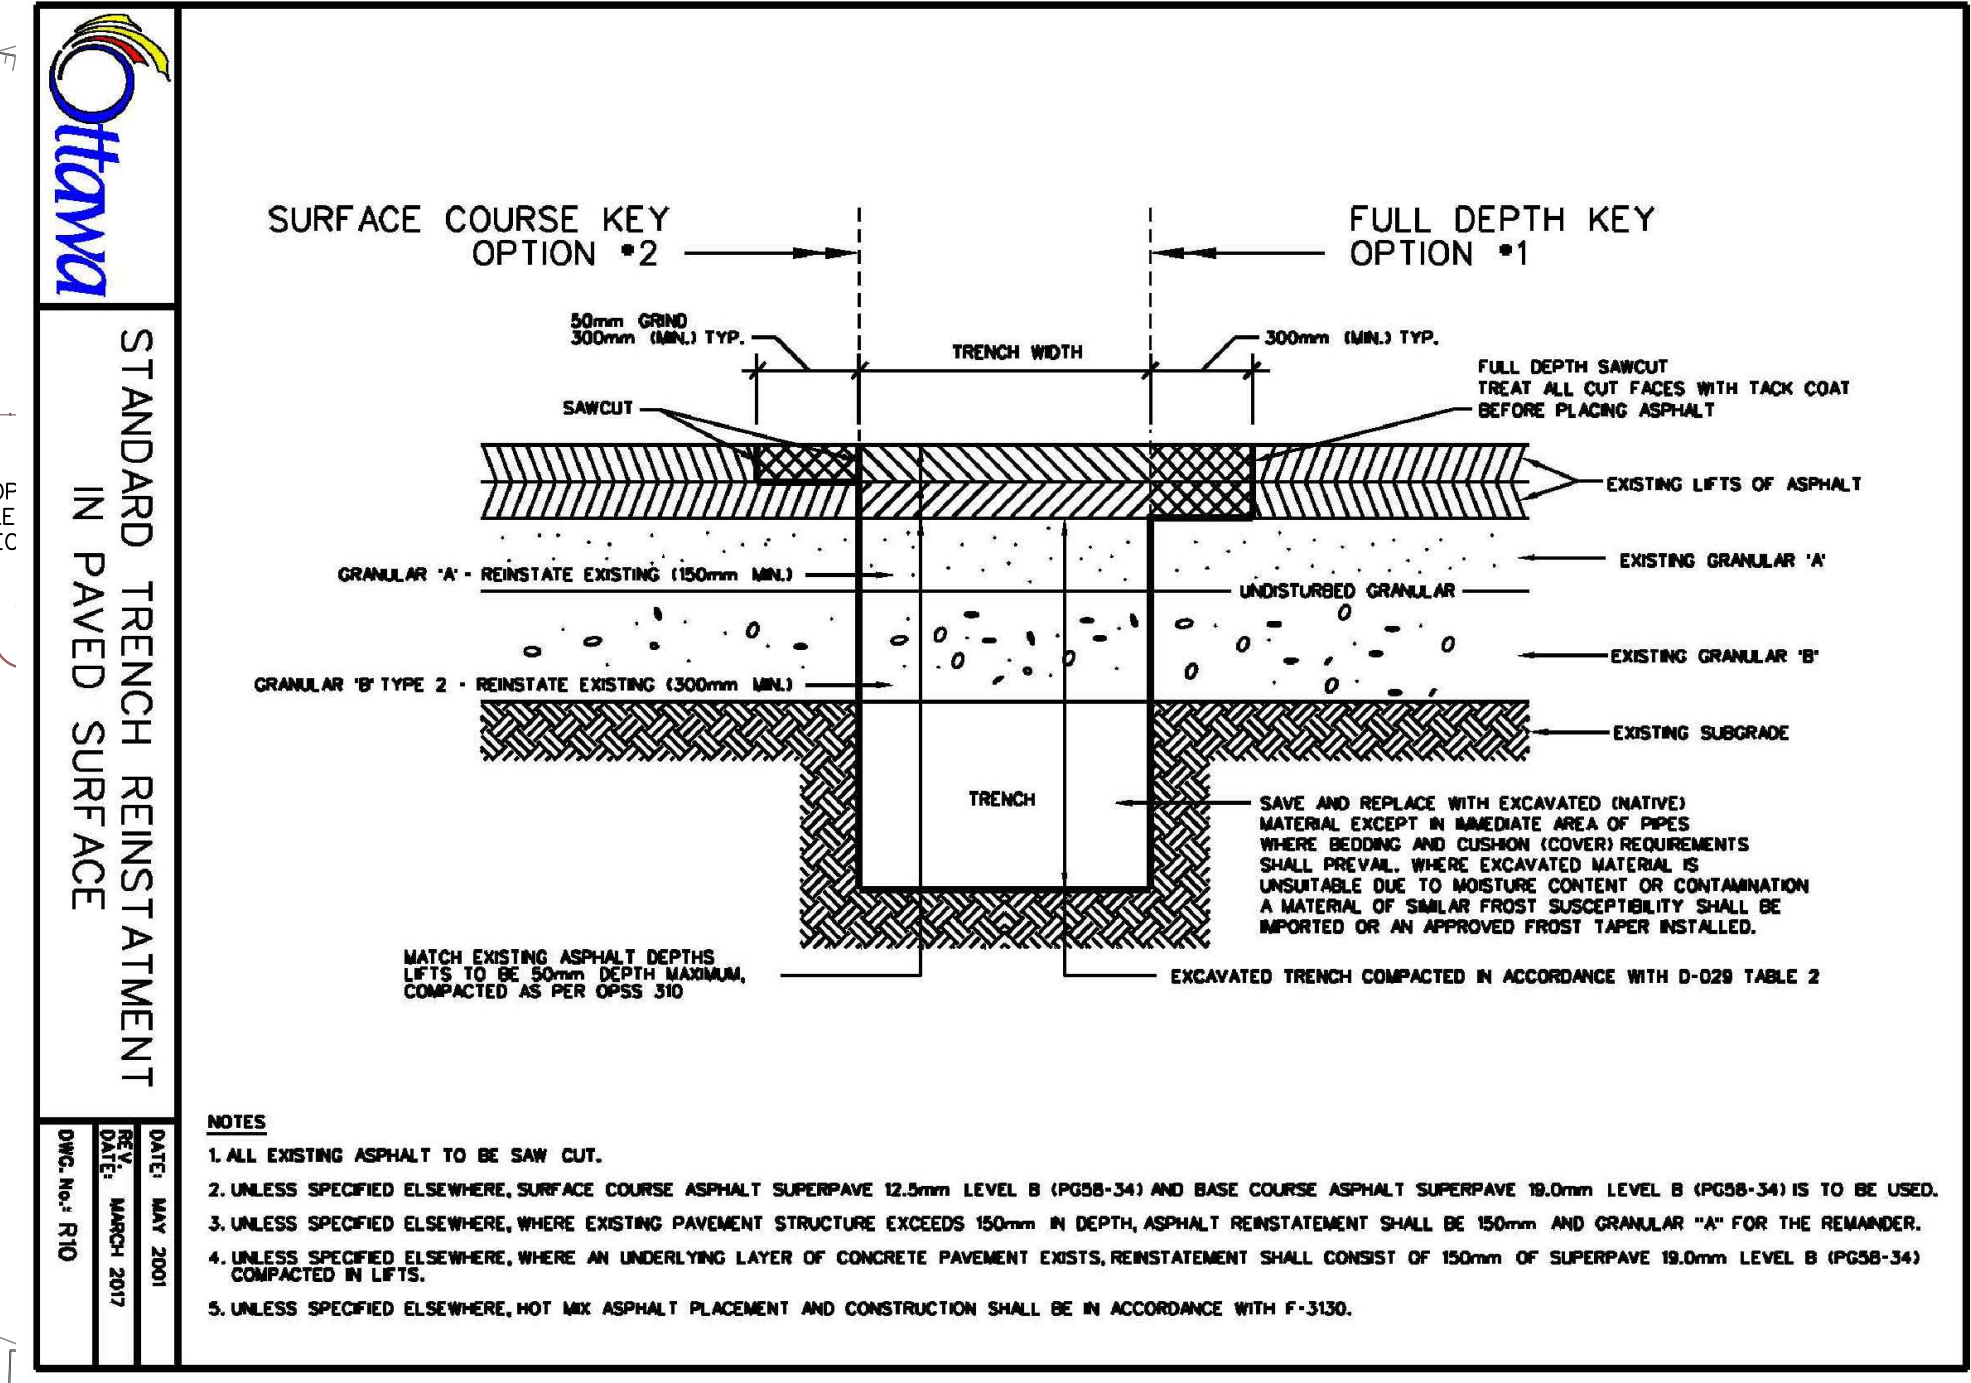

JOB BENCHMARK
 Magnetic Nail in Utility Pole
 Elevation = 122.88

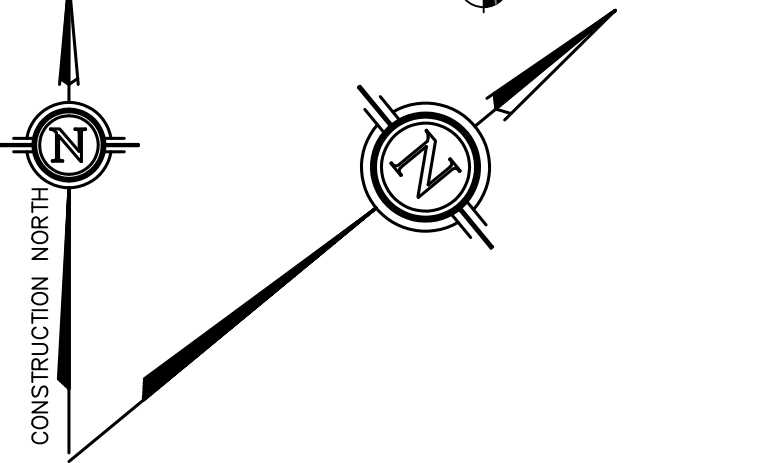

LIMIT OF ASPHALT OVERLAY:
 ROAD/LANE CLOSURE NEEDS TO BE COORDINATED WITH THE CITY.

AREAS OUTSIDE OF SERVICE TRENCH EXCAVATION, GRIND AND PAVE TOP LIFT OF ASPHALT. TOP LIFT OF ASPHALT TO MATCH EXISTING GRADES, ENSURING POSITIVE DRAINAGE.

SERVICE TRENCH REINSTATEMENT AS PER CITY OF OTTAWA DETAIL R10.

SP XX ASPHALT SURFACE COURSE TO MATCH EXISTING TOP LIFT (XXmm MINIMUM, XXmm MAXIMUM)


SP XX ASPHALT BASE COURSE TO MATCH EXISTING (XXmm MAXIMUM). USE TWO LIFTS OF BASE COURSE IF BASE COURSE DEPTH IS GREATER THAN XXmm.

NORWAY SPRUCE STREET

PROPOSED 3 STOREY BUILDING
 TOF = 124.90
 BASEMENT FLOOR ELEV = 122.30
 USF = VARIES
 (FLAT ROOF)



EXISTING DWELLING
 No. 123
 TOF =

PROPOSED ROADWAY REINSTATEMENT
 SCALE = 1:100

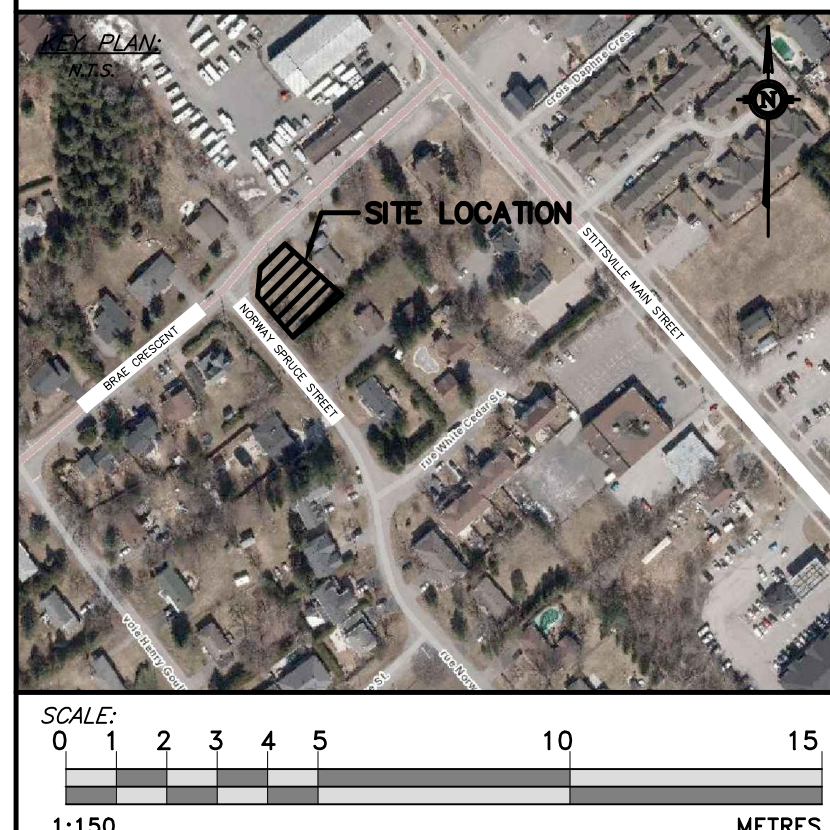

GENERAL LEGEND

EXISTING ELEVATION	EXISTING HYDRO POLE
PROPOSED/EXISTING ELEVATIONS	EXISTING HYDRO GUY WIRE ANCHOR
PROPOSED CURB ELEVATION	EXISTING FIRE HYDRANT
PROPOSED TOP OF GRATE ELEVATION	EXISTING WATER VALVE
PROPOSED CATCH BASIN TOP OF GRATE ELEVATION	PROPOSED WATER VALVE
PROPOSED SIDEWALK ELEVATION	EXISTING STORM MANHOLE
PROPOSED TOP OF RETAINING WALL ELEVATION	EXISTING SANITARY MANHOLE
PROPOSED BOTTOM OF RETAINING WALL ELEVATION	EXISTING VALVE CHAMBER
PROPOSED ELEVATION	EXISTING CURB INLET CATCH BASIN
DRAINAGE SLOPE	EXISTING CATCH BASIN
WATERMAIN	PROPOSED CATCH BASIN/MANHOLE
STORM SEWER	PROPOSED CATCH BASIN
SANITARY SEWER	PROPOSED STORM MANHOLE
CENTRELINE OF ROAD	PROPOSED SANITARY MANHOLE
EDGE OF ROAD	TEMPORARY BENCHMARK
TOP OF SLOPE	BUILDING ENTRANCE LOCATION
PROPERTY LINE	STREET SIGN
GAS LINE	SILT FENCE
OVERHEAD WIRE	

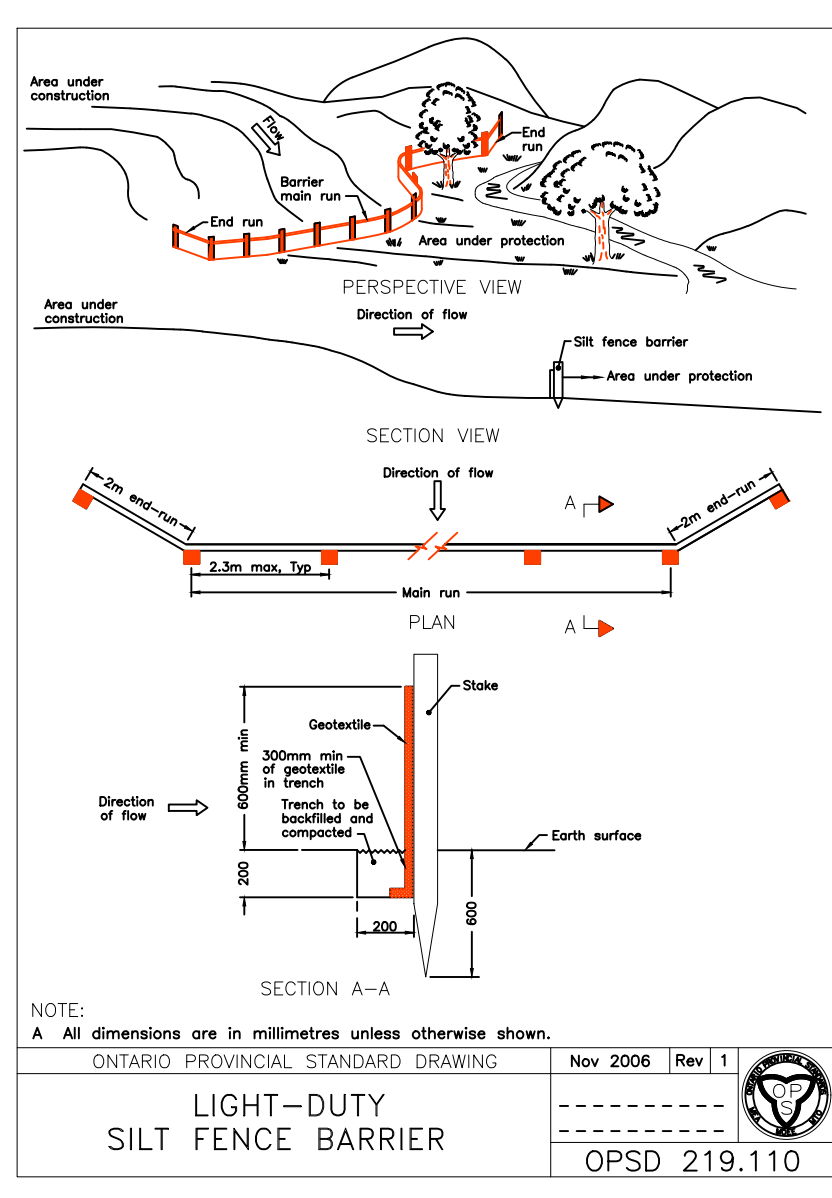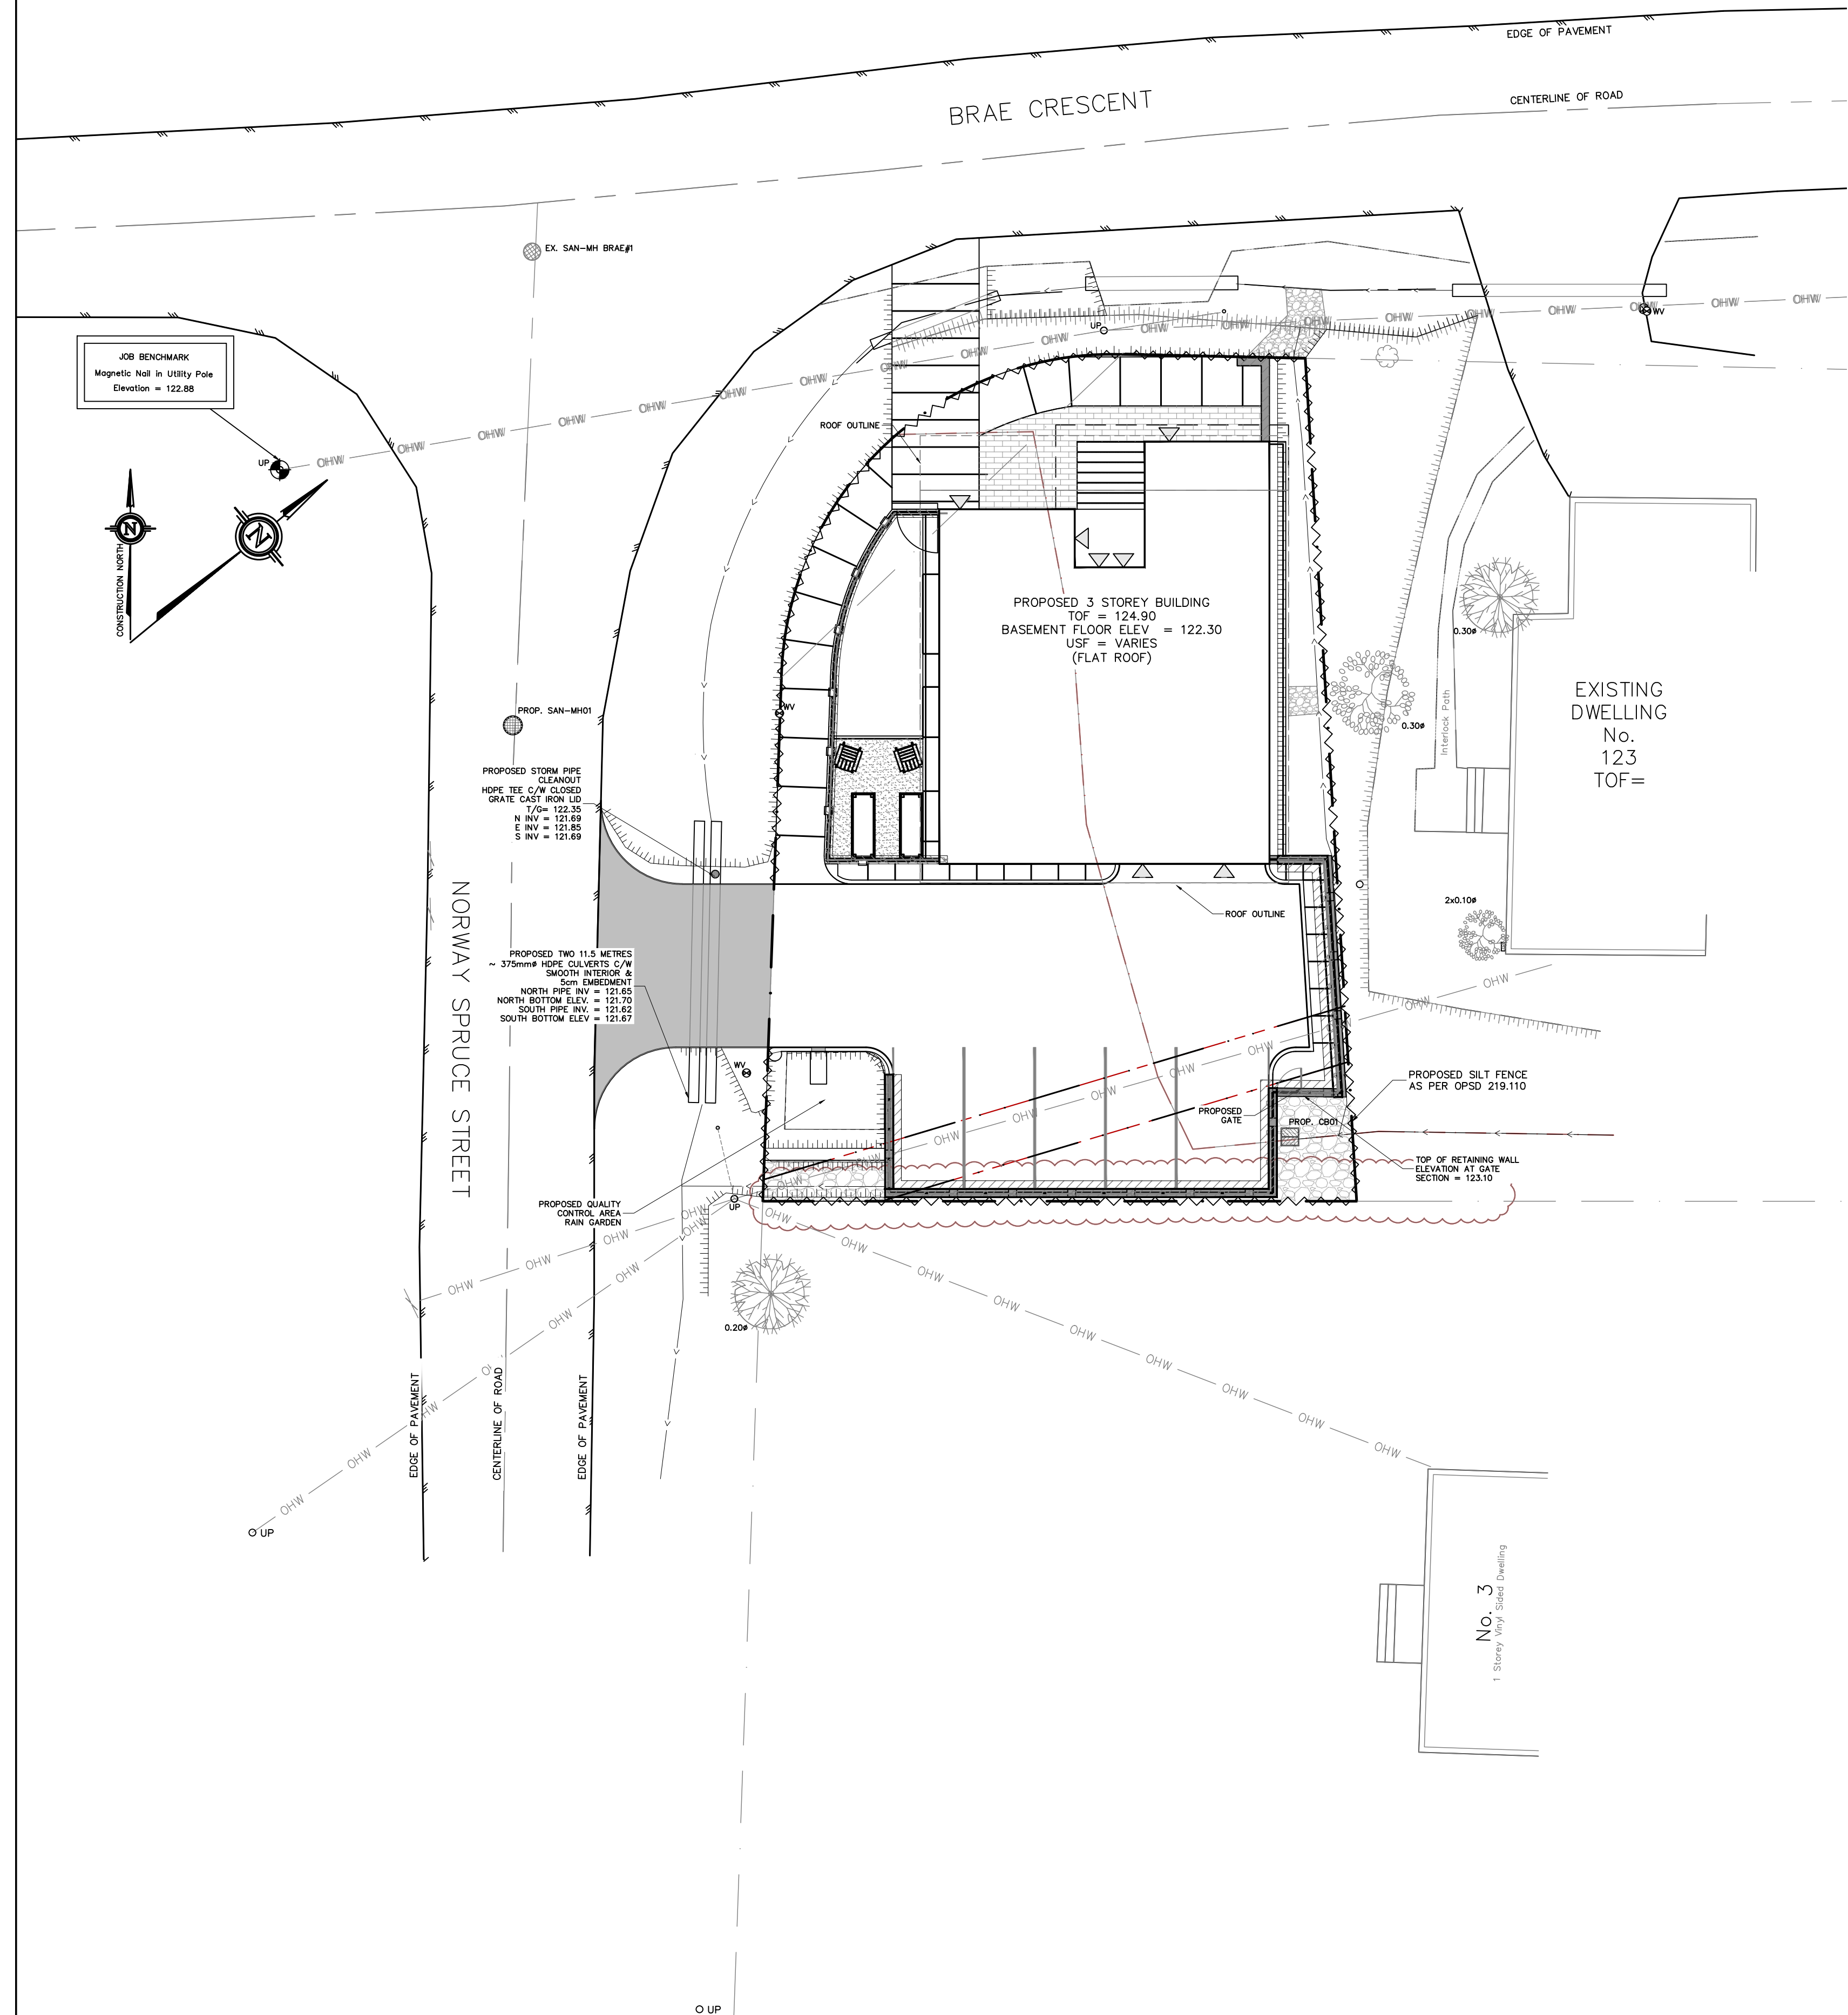

- GENERAL NOTES:**
- All dimensions are in metres; all elevations are in metres and are geodetic. TBM = Nail in utility pole. Elevation = 122.88.
 - This is not a legal survey. Boundary information was derived from topographic plan of survey of part lot 1, registered plan 528, City of Ottawa, by Annis, O'Sullivan, Vollebek Ltd. April 25, 2022.
 - Contractor is responsible for location and protection of utilities.
 - All dimensions to be verified on site by contractor prior to construction.
 - Any changes made to this plan must be verified and approved by Kollaard Associates Inc.
 - Client is responsible for acquiring all necessary permits. This drawing is not for construction until a building permit has been granted.
 - The proposed grades have been set and verified for site grading control only. The grade raise at the building location should be verified with regard to subsurface conditions by qualified geotechnical personnel after completion of the excavation.
 - The underside of footing elevation has been set based on the information available and may not have accounted for actual ground water conditions at the exact house location and should be verified by qualified geotechnical personnel upon completion of the excavation.
 - A geotechnical engineer should be retained to provide recommendations with respect to the sub-grade conditions prior to footing installation.
 - The owner agrees to prepare and implement an erosion and sediment control plan to the satisfaction of the City of Ottawa, appropriate to the site conditions, prior to undertaking any site alterations (filling, grading, removal of vegetation, etc.) and during all phases of site preparation and construction in accordance with the current Best Management Practices for Erosion and Sediment Control such as, and not limited to installing filter cloths across manhole/catchbasin lids to prevent sediments from entering structures and install and maintain a light duty silt fence barrier as required.
 - Inspection of rough grade by Kollaard Associates Inc. and City of Ottawa must be conducted prior to placement of topsoil or sod.
 - Hydro service to be installed according to the specifications of Ontario Hydro and the Mechanical Engineer.
 - All materials and construction to be in accordance with City of Ottawa standards and Ontario Provincial Standards and Specifications.
 - This drawing is part of Kollaard Associates design report # 220338.

No.	REVISION	DATE	BY
1	RESPONSE TO REVIEW COMMENTS	2024/01/12	AVB
0	ISSUED FOR SITE PLAN CONTROL	2023/05/10	AVB
#	REVISION ITEM / DESCRIPTION	REV. DATE	INT.

Kollaard Associates Engineers
 (613) 860-0923
 info@kollaard.ca
 P.O. BOX 189, 210 PRESCOTT ST.
 KEMPTVILLE, ONTARIO
 K0G 1J0 FAX (613) 258-0475
 http://www.kollaard.ca

CLIENT:
 BRYDEN GIBSON

PROJECT:
 PROPOSED 3 STOREY RESIDENTIAL DEVELOPMENT

LOCATION:
 121 BREA CRESCENT, STITTSVILLE,
 ON, K2S 1P1

DESIGNED BY: SD	CHECKED BY: SD
DRAWN BY: JR	APPROVED BY: SD
DATE: MAY 12, 2023	
KOLLAARD FILE NUMBER: 220338	

DRAWING NUMBER: 220338-ESC
 DRAWING NAME: EROSION AND SEDIMENT CONTROL